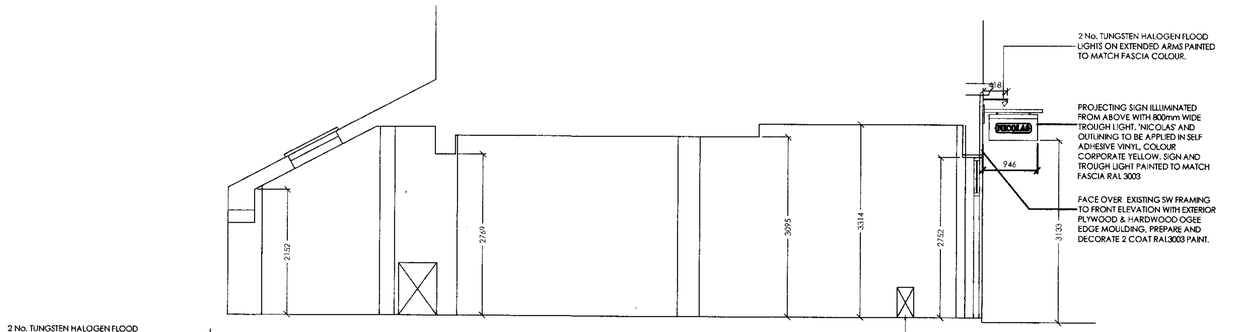

View A

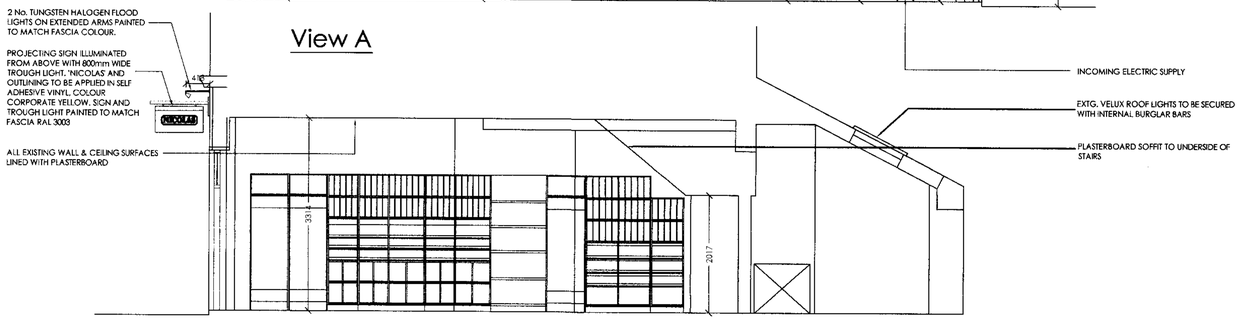

View B

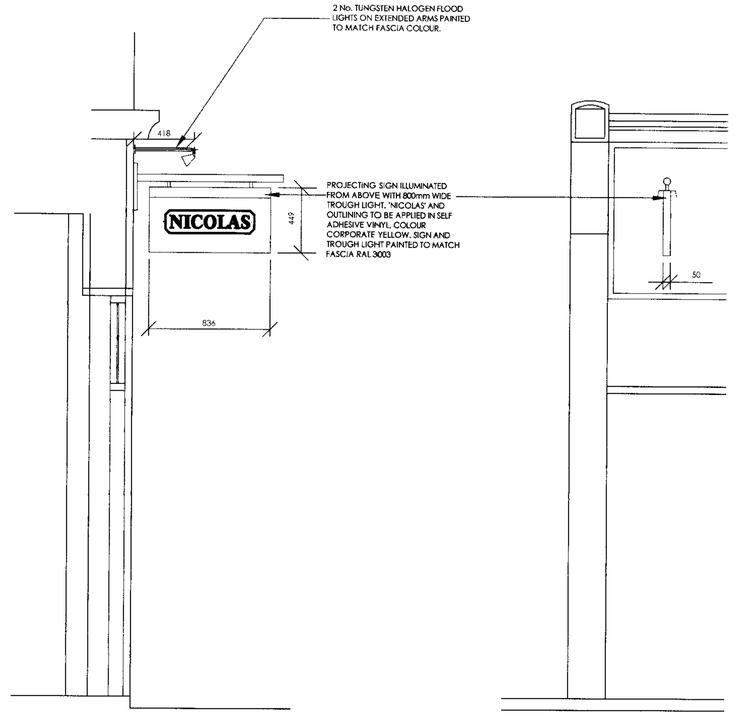

Section thro fascia

Part front view

SCALE 1:20

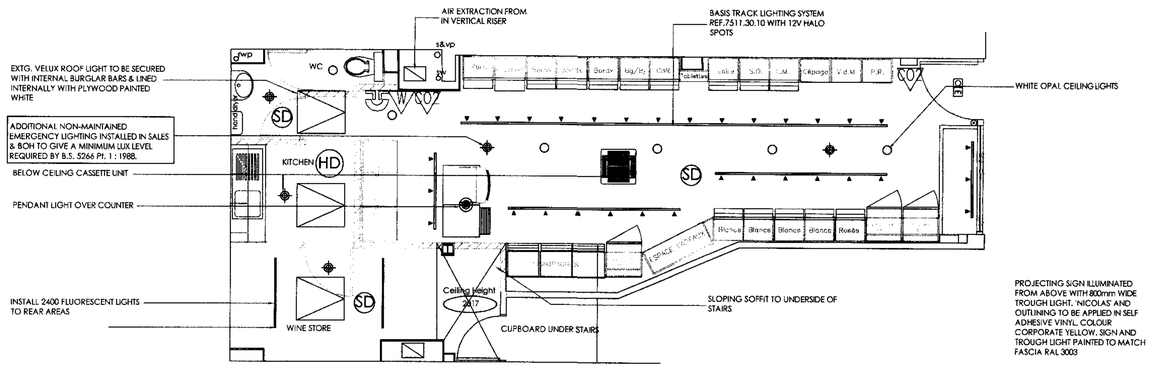

Ceiling Plan

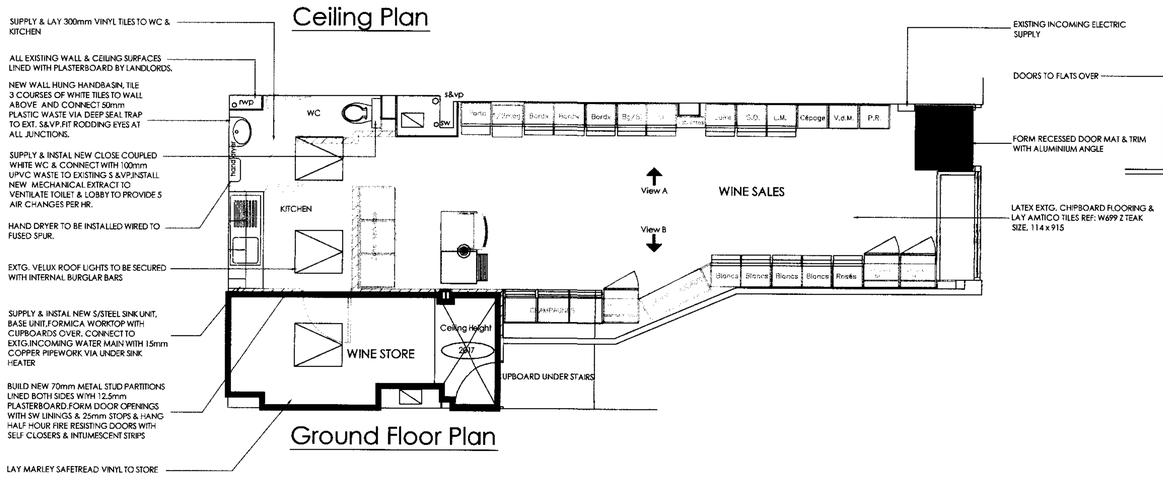

Ground Floor Plan

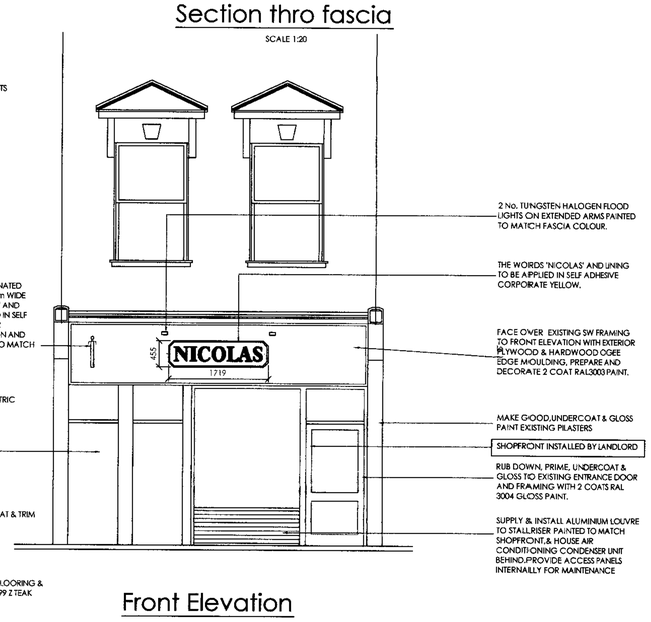

Front Elevation

DO NOT SCALE FROM DRAWING. DIMENSIONS TO BE CHECKED ON SITE.

TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS & SPECIFICATIONS BY SPECIALIST CONTRACTORS.

ALL DIMENSIONS ARE TO STRUCTURAL ELEMENTS UNLESS OTHERWISE STATED.

ANY DISCREPANCIES BETWEEN DRAWINGS TO BE REPORTED TO TROIKA BEFORE COMMENCEMENT OF AFFECTED WORK.

THIS DRAWING IS COPYRIGHT OF **TROIKA RETAIL CONSULTANCY** AND SHALL NOT BE REPRODUCED WITHOUT THEIR PERMISSION.

LEGEND

- FLUORESCENT EMERGENCY LIGHT FITTING WITH RUNNING MAN SYMBOL.
- NON MAINTAINED EMERGENCY LIGHT FITTING.
- FIRE ALARM BREAK GLASS CALL POINT.
- FIRE ALARM SOUNDER.
- 9 LITRE WATER EXTINGUISHER.
- CARBON DIOXIDE FIRE EXTINGUISHER.
- FIRE EXIT DIRECTIONAL SIGN.
- "PUSH BAR TO OPEN" SIGN. (50mm LETTERS)
- "FIRE EXIT KEEP CLEAR" SIGN.
- SMOKE DETECTOR
- HEAT DETECTOR
- EXTRACT
- DOUBLE SWITCH SOCKET AT HIGH LEVEL

NOTES

ALL FINISHES TO PROVIDE CLASS "1" SPREAD OF FLAME TO WALLS & CEILINGS, CLASS "0" TO FIRE ESCAPE ROUTES.

NEW EMERGENCY LIGHTING INSTALLATION TO COMPLY WITH B.S. 5288 Pt. 1 : 2002.

NEW FIRE SAFETY SIGNS & EXIT NOTICES TO COMPLY WITH B.S. 5499 Pt.1 : 1990

MANUAL FIRE ALARM TO BE INSTALLED TO COMPLY WITH B.S. 5839 Pt 1 : 2002.

ELECTRICAL INSTALLATION TO BE IN ACCORDANCE WITH THE 16th EDITION OF THE I.E.E. REGULATIONS. ALL CABLING TO BE LOW SMOKE FUME.

ALL LUMINAIRES TO COMPLY WITH B.S 4533 AND IEC 598 – 1+2. ALL NEW LIGHTING TO BE ENERGY LIGHTING, WHERE NECESSARY IN ACCORDANCE WITH APPROVED DOCUMENT L2 (SEE CLAUSES 1.48 – 1.52 AND 1.58 – 1.59.)

ALL DOORS TO BE PROVIDED WITH SIMPLE FASTENINGS THAT CAN BE OPENED FROM ESCAPE SIDE WITHOUT HAVING TO MANIPULATE MORE THAN ONE MECHANISM OR USE A KEY.

PROVIDE AND INSTALL ADEQUATE MECHANICAL VENTILATION TO ACHIEVE 8 LITRES PER PERSON PER HOUR TO AMENITY BLOCK AND 12 LITRES PER PERSON PER HOUR TO SALES AREA. FIRE DAMPERS TO BE PROVIDED WHERE DUCT PASSES THROUGH FIRE RESISTANT SEPARATION. FOR SMOKE EXTRACT THE FUSIBLE LINK TO BE RATED AT 141 DEGREES C.

MANUAL FIRE ALARM TO BE LINKED TO EXTG. SYSTEM

LIQUOR STORE TO BE FITTED WITH 30min FIRE DOOR.

- 7 NOV 2007

Rev.	Date	Description
B	07-11-07	Projecting sign shown at 1:20 scale
A	30-10-07	Smoke and heat detectors added

PRELIMINARY	-
TENDER	-
COMMENT/APPROVAL	19-10-07
CONSTRUCTION	-
AS BUILT	-

Client
Nicolas
12 Englands Lane
www.troikaretail.co.uk

TROIKA
T: 01708 768700 F: 01708 768708
E: cad@troikaretail.co.uk
3 Balgores Square Gidea Park Romford Essex RM2 6AU

Title
Proposed Shopfitting Plan, Sections & Elevation

Date	Scale	Drawn	Checked
18-10-07	1:50	TGW	TGW

Drawing No. TRC/1068-02 Rev B

PDF created with pdfFactory trial version www.pdffactory.com