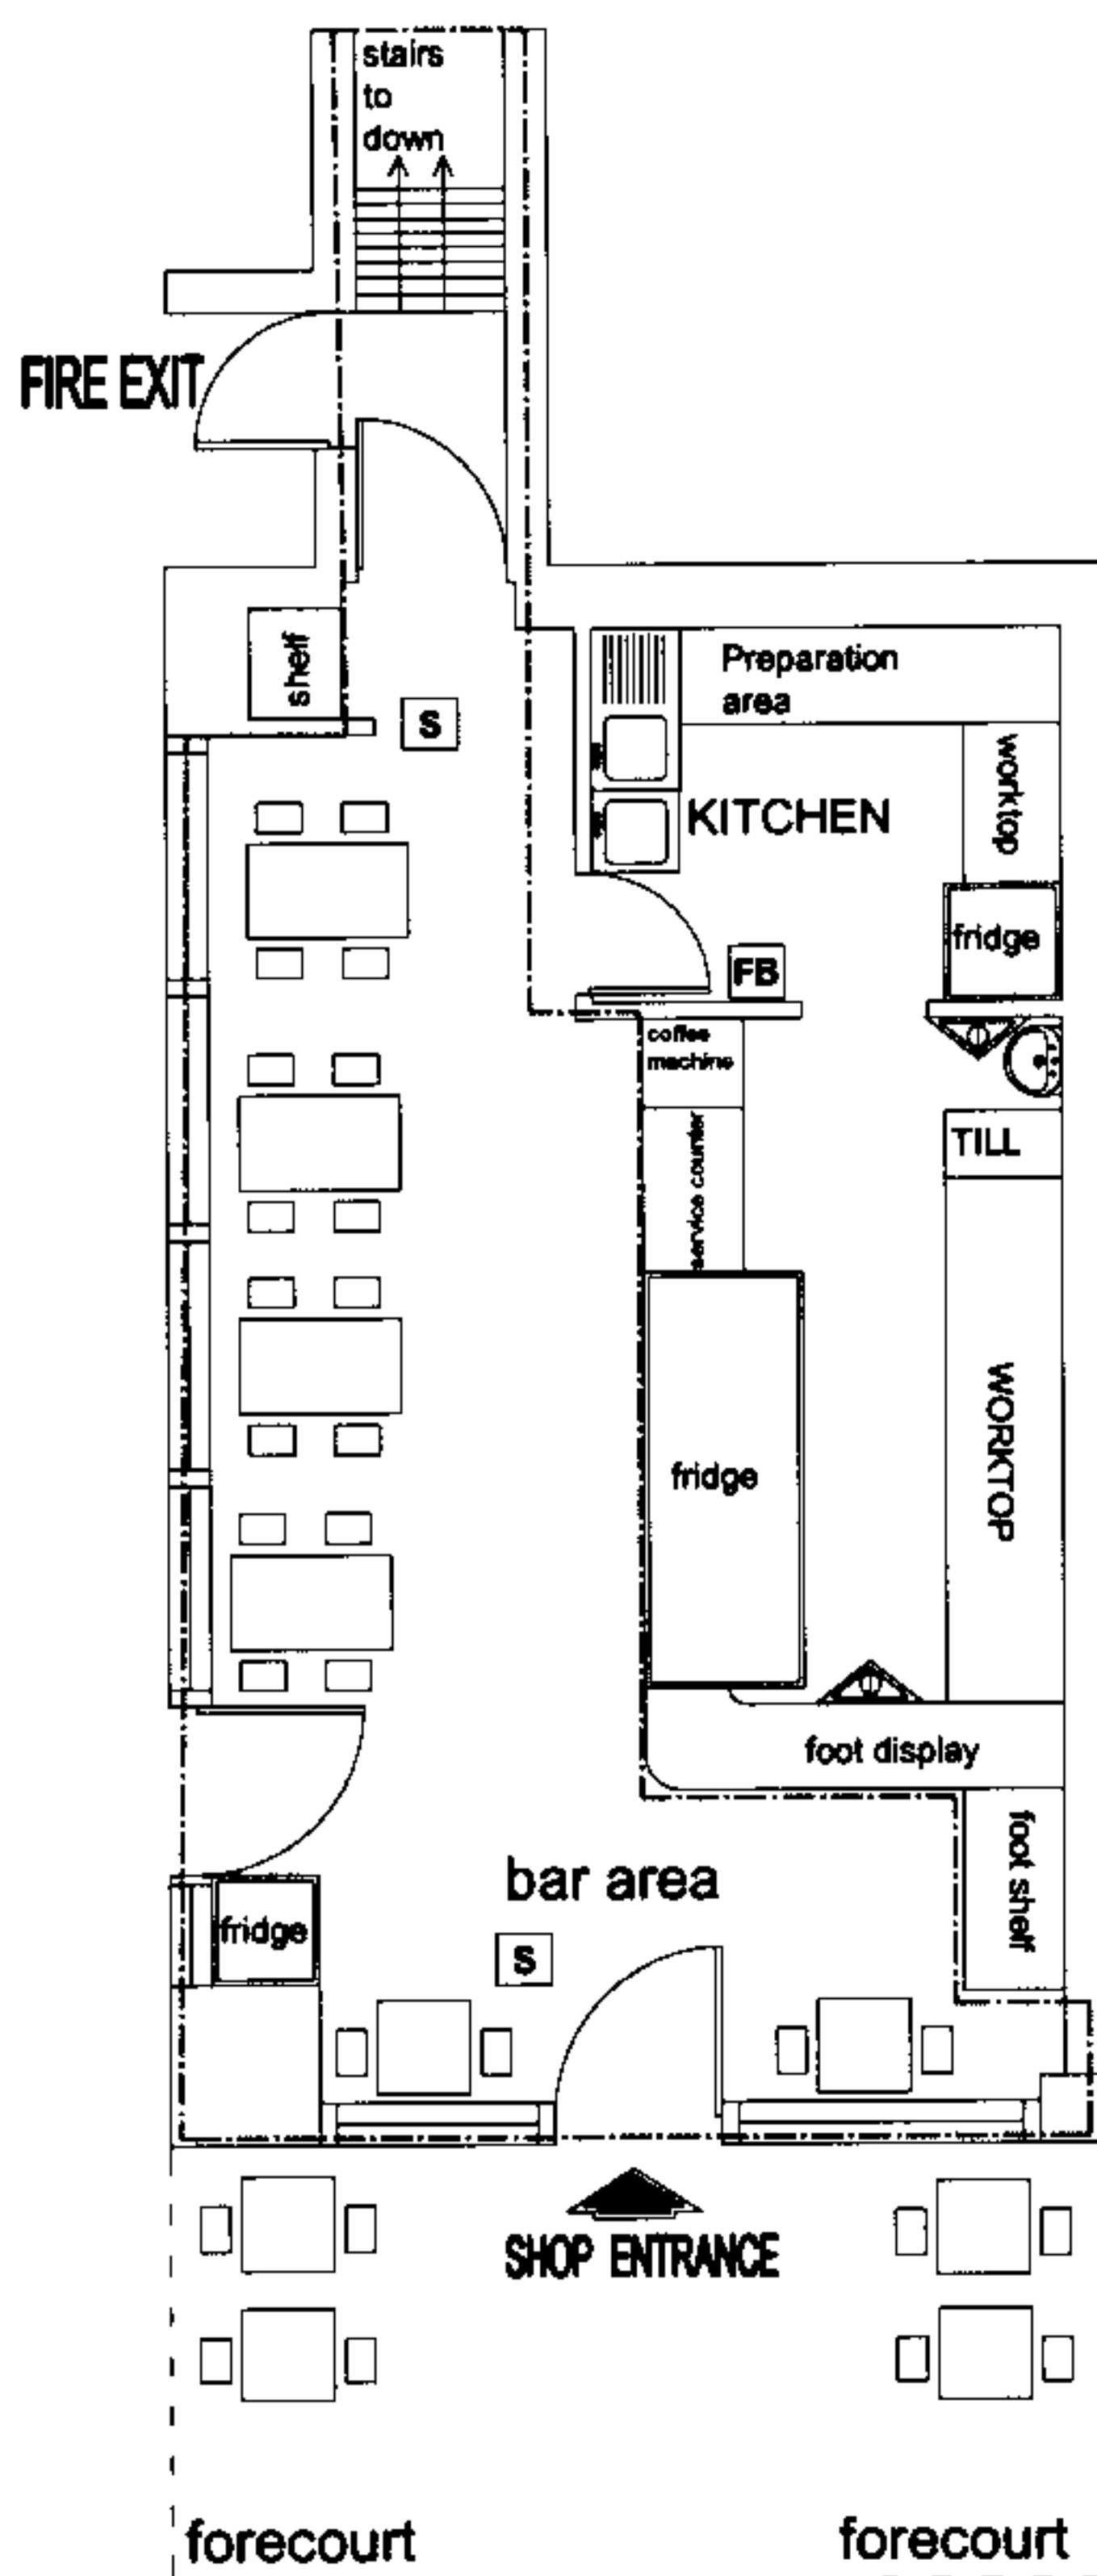




LEGEND

- WC AREA
- FRIDGES
- AMBIT OF LICENSED PREMISES
- SAFETY LIGHTS
- S SMOKE DETECTOR
- CARBON DIOXIDE FIRE EXTINGUISHER
- 9 LT. WATER FIRE EXTINGUISHER
- S 20 FIRE ESCAPE KEEP CLEAR
- CCTV
- S 22 INTERNALLY ILLUMINATED FIRE ESCAPE SIGN (BS 5266)
- FB FIRE BLANKET
- FAN 6lt/s
- FIRE ALARM BELL
- BREAK GLASS MANUAL ALARM CALL-POINT
- FD FIRE DOOR

RECEIVED
13/12/06

public pavement

public pavement

0 cm 250 cm 500 cm

0 cm 100 cm 200 cm 300 cm 400 cm 500 cm

**SNACK CAFE
BAR**

3-16 WOBURN
PLACE
WC1H 0LS

**PROPOSED
GROUND FLOOR**

SCALE : 1/100@A4

DATE :13/12/06

REF. NO : 13122006-01




act2003

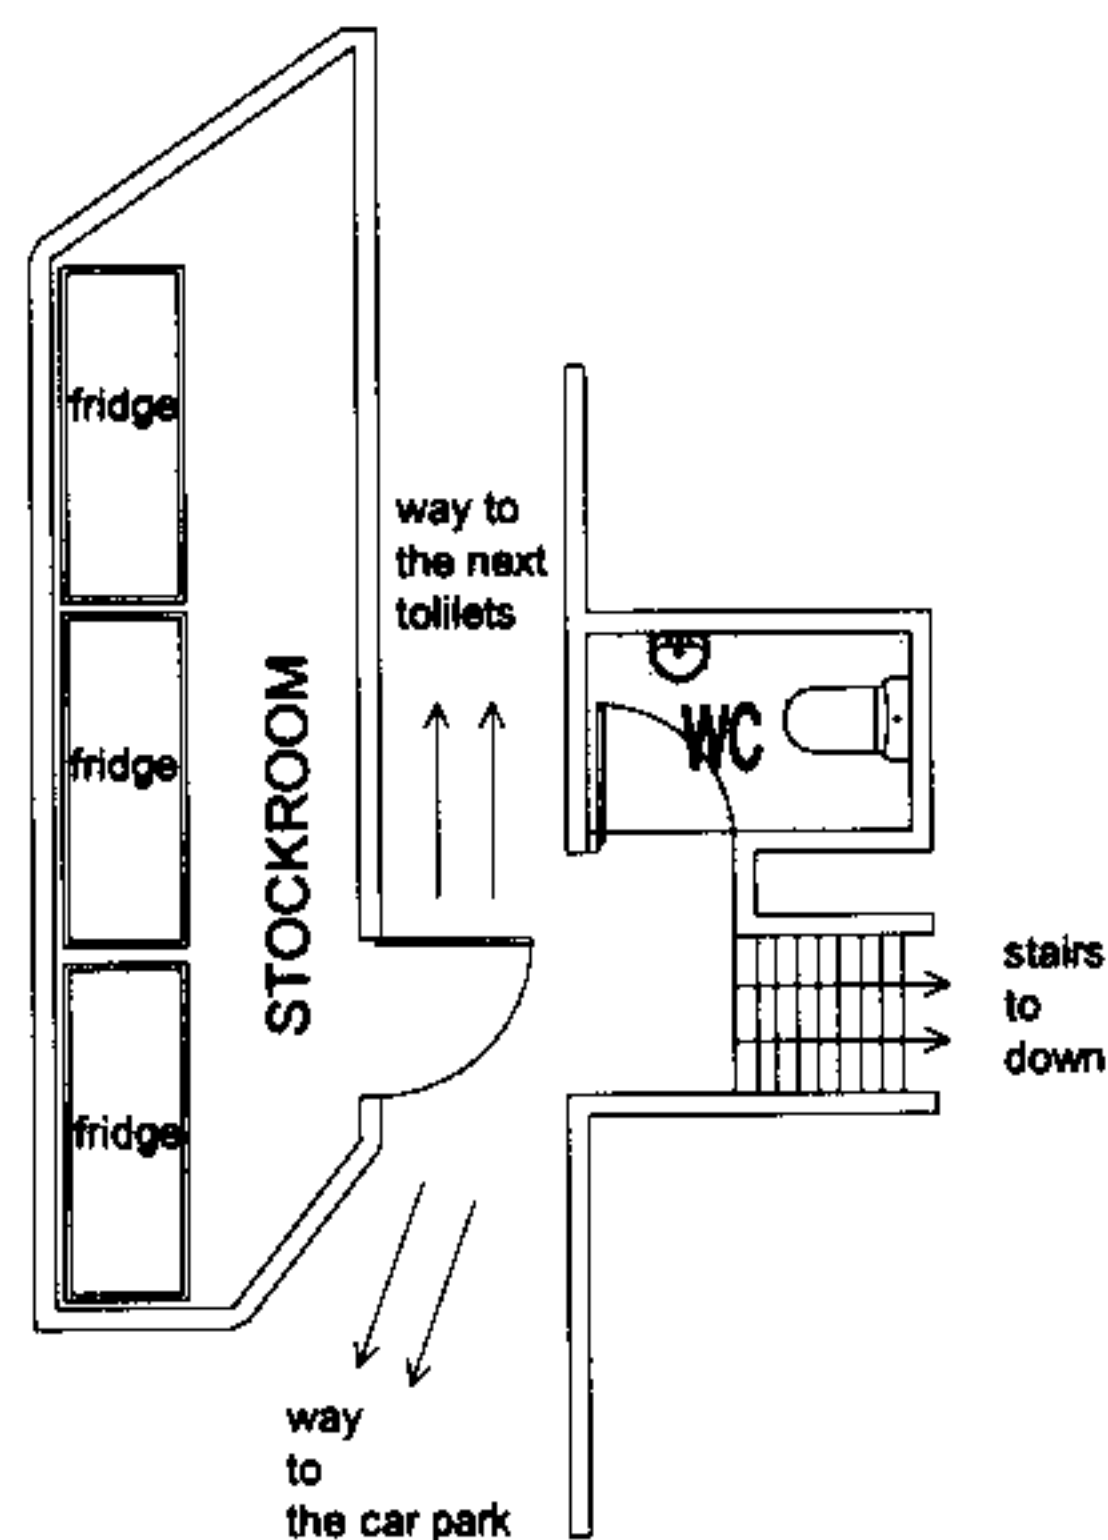
POSITIVE
business consultancy&training
90 Green Lanes LONDON
N16 9EJ

Tel : 020 7241 3636(4line)

www.act2003.com

LEGEND

-  WC AREA
-  FRIDGES
-  AMBIT OF LICENSED PREMISES
-  SAFETY LIGHTS
-  SMOKE DETECTOR
-  CARBON DIOXIDE FIRE EXTINGUISHER
-  9 LT. WATER FIRE EXTINGUISHER
-  S 20 FIRE ESCAPE KEEP CLEAR
-  CCTV
-  S 22 INTERNALLY ILLUMINATED FIRE ESCAPE SIGN (BS 5266)
-  FB FIRE BLANKET
-  FAN 6W/s
-  FIRE ALARM BELL
-  BREAK GLASS MANUAL ALARM CALL-POINT
-  FD FIRE DOOR



RECEIVED
- 8 FEB 2007

**SNACK CAFE
BAR**

3-16 WOBURN
PLACE
WC1H 0LS

**PROPOSED
GROUND FLOOR**

SCALE : 1/100@A4

DATE : 13/12/06

REF. NO : 13122006-02

act2003

POSITIVE
business consultancy & training
90 Green Lanes LONDON
N16 9EJ

Tel : 020 7241 3636(4line)

www.act2003.com

0 cm 250 cm 500 cm

0 cm 100 cm 200 cm 300 cm 400 cm 500 cm