

ADNITT ACOUSTICS
Renaissance House
32 Upper High Street
Epsom, Surrey
KT17 4AF

T: +44 (0)20 7099 9735
F: +44 (0)845 127 5121
E: enquiry@adnitt.com
W: www.adnitt.com



Report 1455/ENS/R2-
Issue Date 09 June 2014

Project **Red Lion Street Premier Inn**
29-37 Red Lion Street, London, WC1R 4PS

Title **Mechanical Plant Noise Acoustic Assessment**
Sub Title

Client McAleer & Rushe Group
17-19 Dungannon Road
Cookstown
BT80 8TL

Case No

Author Chris Turner BSc(Hons) MSc MIOA
MInstP

Checked Graham Shaw BSc(Hons) MSc
AMIOA AMInstP

Revision	Reason	Checked	Signature
A	Revised Prediction Model with Actual Plant Locations	CT	

CONTENTS

1.	INTRODUCTION	1
2.	MECHANICAL PLANT NOISE DESIGN CRITERIA	2
3.	ENVIRONMENTAL NOISE SURVEY	3
4.	MECHANICAL PLANT NOISE ASSESSMENT	4
5.	CONCLUSION	7

List of Tables

Table 1455/T1 - Local Authority Plant Noise Criteria	2
Table 1455/T2 - Equipment used during the noise survey.	3
Table 1455/T3 - Summary of Noise Survey Results	3
Table 1455/T4 - Identified Nearest Noise Sensitive Receptors	4
Table 1455/T5 - Noise Level Predictions for Plant located on Ground Floor Roof	4
Table 1455/T6 - Noise Level Predictions for Plant located on Roof Top	5
Table 1455/T7 - Noise Level Predictions for Single AHU located on fifth floor roof	5
Table 1455/T8 - Noise Level Predictions for group of four AHUs located on fifth floor roof	6
Table 1455/T9 - Noise Level Predictions for Kitchen Extract Fan located on fifth floor roof	6
Table 1455/T10 - Cumulative Plant Noise Level for each identified receptor	6

List of Attachments

Appendix A: Glossary of Acoustic Terms

Figure 1455/ TH 1 : Time History of External Noise Measurements

1. INTRODUCTION

- 1.1 Adnitt Acoustics have been commissioned by McAleer and Rushe Group to undertake a plant noise assessment of the proposed mechanical plant at the new Premier Inn development in Red Lion Street, London.
- 1.2 This assessment makes use of noise level information provided by Caldwell Consulting Engineers, noise survey data collected by Adnitt Acoustics and Camden Council Planning Policy DP28.
- 1.3 As this is a technical report it will be necessary to make use of some technical terms. To assist the reader a glossary has been included in Appendix A.

2. MECHANICAL PLANT NOISE DESIGN CRITERIA

- 2.1 The Local Authority, Camden Council, have provided the following planning policy with regard to noise from mechanical plant at the nearest noise sensitive receptors. This policy (Policy DP28) is reproduced as Table 1455/T1, below:

Noise description and location of measurement	Period	Time	Noise Level
Noise at 1 metre external to a sensitive façade	Day, evening and night	0000-2400	5dB(A)<LA90
Noise that has a distinguishable discrete continuous note (whine, hiss, screech, hum) at 1 metre external to a sensitive façade	Day, evening and night	0000-2400	10dB(A)<LA90
Noise that has distinct impulses (bangs, clicks, clatters, thumps) at 1 metre external to a sensitive façade	Day, evening and night	0000-2400	10dB(A)<LA90
Noise at 1 metre external to a sensitive façade where LA90>60dB	Day, evening and night	0000-2400	55dB L _{Aeq}

Table 1455/T1 - Local Authority Plant Noise Criteria

3. ENVIRONMENTAL NOISE SURVEY

- 3.1 Measurements of the internal and external ambient noise levels were undertaken between Tuesday 22nd October and Saturday 26th October 2013. The measurements consisted of a series of discreet but continuous 15 minute measurements on the roof of the existing building at 5th floor level.
- 3.2 The external position was located overlooking the Red Lion Street façade of the building on the flat roof at the 5th floor level of the existing building
- 3.3 A schedule of equipment used during the noise survey may be found in Table 6, below. The weather during the survey was mainly dry but windy. Full weather data was recorded on site shows that for a majority of the time the wind speeds were less than the 5m/s, which is the recommended maximum wind speed for ambient noise measurements given in BS 4142:1997.

Description	Manufacturer and Model Number	Serial Number
Sound Level Meter with Real Time Analyser	Cirrus Optimus Green	G061849
Calibrator	Cirrus CR:515	60704

Table 1455/T2 - Equipment used during the noise survey.

- 3.4 A summary of the results of the noise survey is presented in Table 7, below. To assist the reader these have been presented in terms of the daytime (07:00hrs - 23:00hrs) and night-time (23:00hrs - 07:00hrs) periods.

Measurement Position	Time Period	L _{Aeq,T} (dB)	L _{AFMax} (dB)	L _{A90} (dB)	Octave Band Levels (dB)				
					125Hz	250Hz	500Hz	1kHz	2kHz
External	Daytime	59.9	98.8	50	63.6	59.2	56.3	56.1	52.4
	Night-time	54.9	83.1	45	58.1	53.5	50.2	51.6	47.9

Table 1455/T3 - Summary of Noise Survey Results

- 3.5 The time history results of the overall A-weighted noise levels may be found in Figures 1455/TH1 which is appended to this report.

4. MECHANICAL PLANT NOISE ASSESSMENT

4.1 Predictions of mechanical plant noise have been undertaken using information provided by Caldwell Consulting Engineers. The noise level criteria have been derived from the Local Authority criteria and background noise survey as 39dB $L_{Aeq,T}$ at the nearest noise sensitive façade.

4.2 It is understood that there are three major plant areas:

- Rear of the building on the ground floor flat roof
- Roof of the building;
- Southern elevation of the building on the fifth floor flat roof;

4.3 The nearest noise sensitive receptors have been identified for each of the plant locations and are presented below. This has been calculated from Caldwell Consulting Engineer's site location plan drawing which has been appended to this report.

Plant Location	Nearest Sensitive Receptor	Distance
Rear of the building on the ground floor flat roof	Dock and Duck Yard, Princeton Street	5m
Roof of the building	10 - 21 Princeton Street	16m
Southern elevation of the building on the fifth floor flat roof	10 - 21 Princeton Street	One Air handling unit at 10m Four Air handling units at 15m Kitchen Extract Fan at 20m
	52 Red Lion Street	One Air handling unit at 25m Four Air handling units at 19m Kitchen Extract Fan at 17m

Table 1455/T4 - Identified Nearest Noise Sensitive Receptors

Plant Located on Ground Floor Roof

Description	Parameter	Octave Band Noise Levels (dB)							
		63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
A	Plant Sound Pressure Level at 1m	56.5	48.4	46.0	39.0	38.5	32.5	33.0	25.5
B	Correction for Number of Plant	5	7.0	7.0	7.0	7.0	7.0	7.0	7.0
C	Correction for Reflections	2	3.0	3.0	3.0	3.0	3.0	3.0	3.0
D	Distance Correction	5m	-14.0	-14.0	-14.0	-14.0	-14.0	-14.0	-14.0
E	SPL at receptor	49.5	41.4	39.0	32.0	31.5	25.5	26.0	18.5
F	A-Weighting	-26.2	-13.8	-8.6	-3.2	0.0	1.2	1.0	-1.1
G	SPL(A) at Receptor	23.3	27.6	30.4	28.8	31.5	26.7	27.0	17.4

Table 1455/T5 - Noise Level Predictions for Plant located on Ground Floor Roof

4.4 The predicted noise levels at this receptor for these units is 37dB $L_{Aeq,T}$ which is compliant with the criteria of the Local Planning Authority.

Plant Located on Rooftop level

Description	Parameter	Octave Band Noise Levels (dB)							
		63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
A	Plant Sound Pressure Level at 1m	56.5	48.4	46.0	39.0	38.5	32.5	33.0	25.5
B	Correction for Number of Plant	2	3.0	3.0	3.0	3.0	3.0	3.0	3.0
C	Correction for Reflections	2	3.0	3.0	3.0	3.0	3.0	3.0	3.0
D	Distance Correction	16m	-24.1	-24.1	-24.1	-24.1	-24.1	-24.1	-24.1
E	SPL at receptor		38.4	30.3	27.9	20.9	20.4	14.4	14.9
F	A-Weighting		-26.2	-13.8	-8.6	-3.2	0.0	1.2	1.0
G	SPL(A) at Receptor		12.2	16.5	19.3	17.7	20.4	15.6	15.9

Table 1455/T6 - Noise Level Predictions for Plant located on Roof Top

- 4.5 The predicted noise levels at this receptor for these units is 26dB $L_{Aeq,T}$ which is compliant with the criteria of the Local Planning Authority.

Plant Located on Fifth Floor Roof

Description	Parameter	Octave Band Noise Levels (dB)							
		63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
A	Plant Sound Pressure Level at 1m	51.0	52.0	47.0	43.0	42.5	44.0	42.0	38.5
B	Correction for Number of Plant	1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
C	Correction for Reflections	2	3.0	3.0	3.0	3.0	3.0	3.0	3.0
D	Distance Correction	10	-20.0	-20.0	-20.0	-20.0	-20.0	-20.0	-20.0
E	SPL at receptor		34.0	35.0	30.0	26.0	25.5	27.0	25.0
F	A-Weighting		-26.2	-13.8	-8.6	-3.2	0.0	1.2	1.0
G	SPL(A) at Receptor		7.8	21.2	21.4	22.8	25.5	28.2	26.0

Table 1455/T7 - Noise Level Predictions for Single AHU located on fifth floor roof

Description	Parameter	Octave Band Noise Levels (dB)							
		63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
A	Plant Sound Pressure Level at 1m	56.5	48.4	46.0	39.0	38.5	32.5	33.0	25.5
B	Correction for Number of Plant	4	6.0	6.0	6.0	6.0	6.0	6.0	6.0
C	Correction for Reflections	2	3.0	3.0	3.0	3.0	3.0	3.0	3.0
D	Distance Correction	15	-23.5	-23.5	-23.5	-23.5	-23.5	-23.5	-23.5
E	SPL at receptor		42.0	33.9	31.5	24.5	24.0	18.5	11.0

	Description	Parameter	Octave Band Noise Levels (dB)							
			63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
F	A-Weighting		-26.2	-13.8	-8.6	-3.2	0.0	1.2	1.0	-1.1
G	SPL(A) at Receptor		15.8	20.1	22.9	21.3	24.0	19.2	19.5	9.9

Table 1455/T8 - Noise Level Predictions for group of four AHUs located on fifth floor roof

	Description	Parameter	Octave Band Noise Levels (dB)							
			63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
A	Plant Sound Pressure Level at 1m		82.0	48.0	41.0	56.0	47.0	45.0	49.0	46.0
B	Correction for Number of Plant	1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
C	Correction for Reflections	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
D	Distance Correction	18m	-25.1	-25.1	-25.1	-25.1	-25.1	-25.1	-25.1	-25.1
E	SPL at receptor		56.9	22.9	15.9	30.9	21.9	19.9	23.9	20.9
F	A-Weighting		-26.2	-13.8	-8.6	-3.2	0.0	1.2	1.0	-1.1
G	SPL(A) at Receptor		30.7	9.1	7.3	27.7	21.9	21.1	24.9	19.8

Table 1455/T9 - Noise Level Predictions for Kitchen Extract Fan located on fifth floor roof

- 4.6 The predicted noise levels at 10 - 21 Princeton Street for these units is 37dB $L_{Aeq,T}$ and at 50 Red Lion street is 36dB $L_{Aeq,T}$ which is compliant with the criteria of the Local Planning Authority.

Cumulative Plant Noise Levels

- 4.7 Predictions of cumulative plant noise levels have been undertaken for each of the receptors and the results are presented in the Table below.

Receptor	Predicted Cumulative Plant Noise Level ($L_{Aeq,T}$)
10-21 Princeton Street	38.2 dB
Dog and Duck Yard, Princeton Street	37.9 dB
50 Red Lion Street	36.3 dB

Table 1455/T10 - Cumulative Plant Noise Level for each identified receptor

- 4.8 The predictions show that the cumulative noise level for all items of plant at the three identified receptors comply with the criteria of the Local Planning Authority.

5. CONCLUSION

- 5.1 Adnitt Acoustics were commissioned by McAleer and Rushe Group to undertake a plant noise assessment of the proposed mechanical plant at the new Premier Inn development in Red Lion Street, London.
- 5.2 This assessment made use of noise level information provided by Caldwell Consulting Engineers, noise survey data collected by Adnitt Acoustics and Camden Council Planning Policy DP28.
- 5.3 The assessment showed that at the nearest façades comply with the criteria set out by Camden Council.


Chris Turner BSc(Hons) MSc MIOA MInstP



for ADNITT ACOUSTICS

APPENDIX A: GLOSSARY OF ACOUSTIC TERMS


dB	Sound levels are usually measured in decibels (dB) and relate absolute values to a reference value. The decibel scale is logarithmic and it ascribes equal values to proportional changes in sound pressure, which reflects the response of the human ear to sound.
L_p	The sound pressure level, L_p , is a measure of the total instantaneous sound pressure at a point in space. The threshold of hearing occurs at approximately 0 dB and the threshold of pain is around 140 dB.
dB(A)	The sensitivity of the ear is frequency dependent. Sound level meters are fitted with a weighting network which approximates to this response and allows sound levels to be expressed as an overall single figure value, in dB(A). For clarity and convenience, the 'A' is often included in the acoustic descriptor, eg LAeq, rather than in brackets after the units. For example, A-weighted levels can be quoted as 55 dB LAeq.
$L_{Aeq,T}$	The most widely used unit is the equivalent continuous A-weighted sound pressure level ($L_{Aeq,T}$). It is an energy average and is defined as the level of a notional sound which (over a defined period of time, T) would deliver the same A-weighted sound energy as the actual fluctuating sound.
$D_{nT,w}$ (dB)	D_{nT} is widely used to set sound insulation criteria for dwellings, where T_0 is taken as 0.5 seconds. The suffix $_w$ indicates that the third octave band values have been weighted with an emphasis on low frequency to obtain a single number rating.
R_w (dB)	The sound reduction index, R, of an element such as a wall, floor, door or window describes the sound transmitted through that element. It is measured in a laboratory with suppressed flanking transmission. R varies with frequency and is expressed as a value for each one-third octave band or octave band. The suffix $_w$ indicates that the third octave band values have been weighted with an emphasis on low frequency to obtain a single number rating.
$L'_{nT,w}$ (dB)	L'_{nT} is widely used for dwellings, where T_0 is taken as 0.5 seconds. The suffix $_w$ indicates that the third octave band values have been weighted with an emphasis on low frequency to obtain a single number rating.

Figure 1455/ TH 1 : Time History of External Noise Measurements

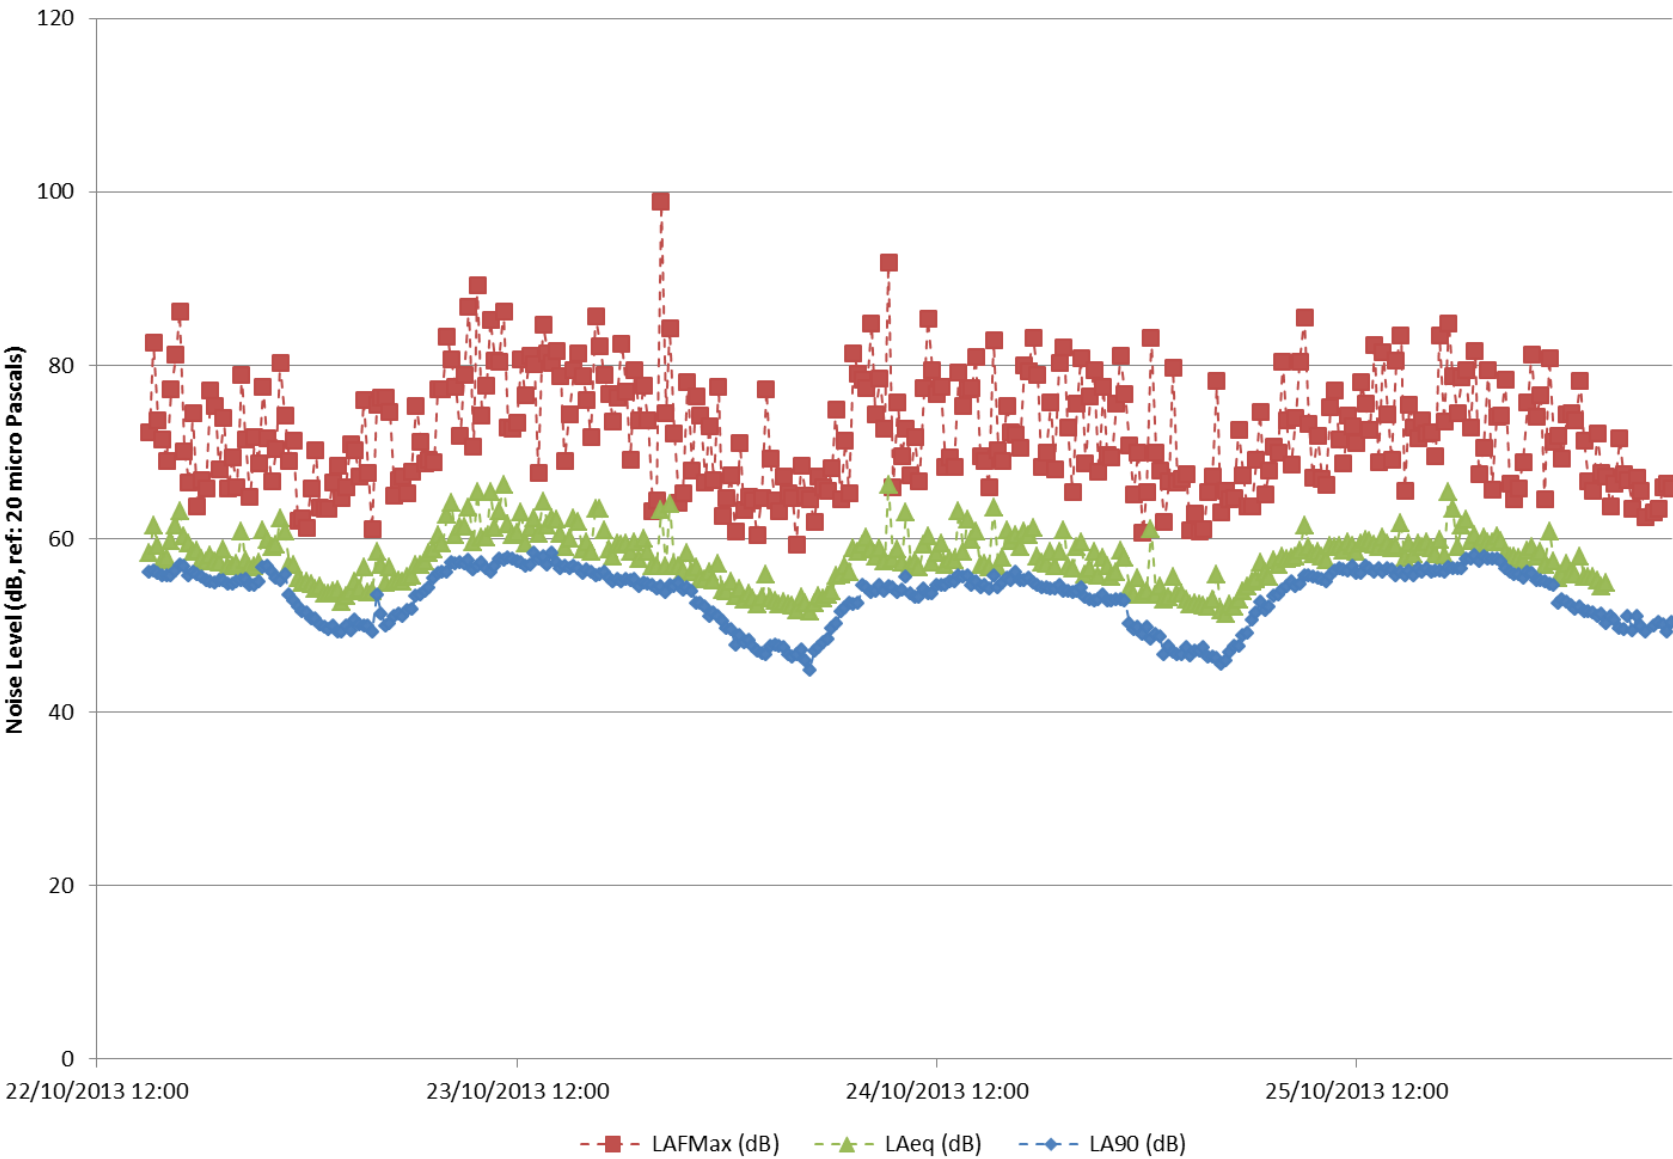

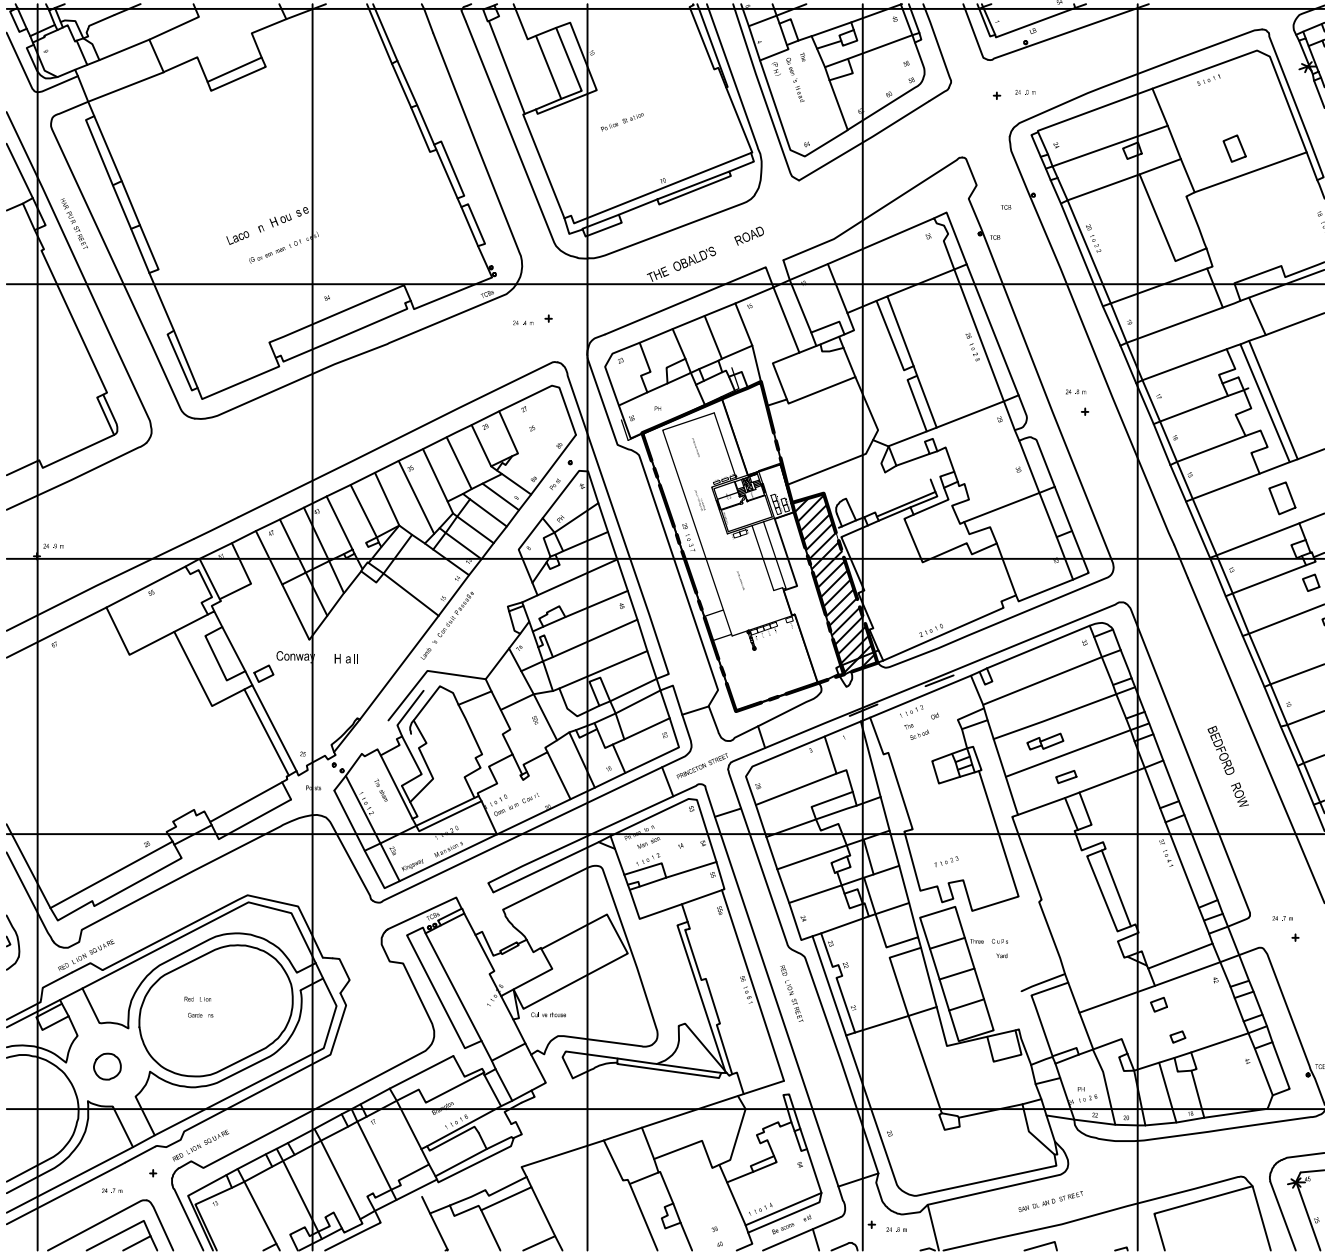

North Point



Denotes Site Boundary



Denotes Part of the site below ground only

926sq.m Area of building

456sq.m Area of hard landscaping

Rev A: Building and Hard landscaping areas added for BREM, CA, 22.01.14		
PRELIMINARY FOR TENDER FOR CONSTRUCTION AS BUILT		
Project Red Lion		
McAuliffe & Ruhe		
Proposed Site Location Plan		
drawing number U165 - H12 rev A		
scale 1:1250	date Nov 2013	
drawn ed	checked —	approved —