

# **Energy Statement & The Energy Efficiency and Renewable Energy Plan & Sustainability Plan**

**Centre Point**

106610/LA/120207

Revision 09

15 October 2013

This document forms part of the Planning Application which received a Resolution to Grant on 4<sup>th</sup> July 2013. It has been amended to deal with S106 matters and should be appended thereto as an Approved Document

Issue	Date	Reason for Issue	Prepared	Checked	Approved
01	10 Feb 2012	Draft for comment	MLT 10/2	AD 10/2	NDB 10/2
02	30 Mar 2012	Planning	MLT 30/3	AD 30/3	NDB 30/3
03	4 Apr 2012	Updated Planning	MLT 04/4	AD 04/4	NDB 04/4
04	18 May 2012	Comments from team incorporated	NDB 18/4	SC 18/4	NDB 18/4
05	25 May 2012	Updated Energy & CO <sub>2</sub>	MA 25/5	SC 25/5	NDB 25/5
06	28 May 2012	Comments from team incorporated	MA 28/5	SC 28/5	NDB 28/5
07	Mar 2013	Revised Scheme	LA 15/03	SC 15/03	NDB 15/03
08	Mar 2013	Comments from team incorporated	LA 27/03	SC 27/03	NDB 27/03
09	Oct 2013	Amendments' pursuant to Section 106 requirements	NDB 15/10	NDB 15/10	NDB 15/10

Energy Statement & Energy Efficiency and Renewable Energy Plan & Sustainability Plan  
106610/LA/120207  
Revision 09

Grontmij  
1 Bath Road  
Maidenhead  
Berkshire  
SL6 4AQ

+44 (0)1628 623 423  
building.services@grontmij.co.uk  
grontmij.co.uk/buildingservices

© Grontmij 2013 This document is a Grontmij confidential document. It may not be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording or otherwise disclosed in whole or in part to any third party without our express prior written consent. It should be used by you and the permitted discloses for the purpose for which it has been submitted and for no other.  
Registered Office: Grontmij Limited, Grove House, Mansion Gate Drive, Leeds, LS7 4DN. Company Registration No 2888385

value beyond engineering

## Contents

1.	Executive Summary .....	4
1.1	Part L 2010 – Option B .....	5
1.2	London Plan – Option A .....	6
1.3	London Plan – Option B .....	6
2.	Introduction .....	7
2.1	Purpose of the Report .....	7
2.2	Building Regulations .....	7
2.3	Planning Policies .....	8
2.3.1	National Planning Policy .....	8
2.3.2	Regional Planning Policy .....	8
2.3.3	Local Planning Policy .....	10
2.4	BREEAM / Code for Sustainable Homes .....	10
3.	Development Options .....	11
4.	Baseline Building Emissions .....	12
4.1	Option A .....	12
4.2	Option B .....	12
5.	Be Lean - Reducing Energy Demand .....	13
5.1	Passive Design Features .....	13
5.1.1	Building Envelope Thermal Properties .....	13
5.1.2	Facade Optimisation .....	13
5.2	Active Design Features: Unregulated Energy Use .....	13
5.2.1	Low Energy White Goods .....	13
5.2.2	Low Energy Culture .....	13
5.3	Active Design Features: Regulated Energy Use .....	13
5.3.1	Low Energy Lighting .....	13
5.3.2	Air Handling Heat Recovery .....	13
5.3.3	Power Factor Correction .....	14
5.3.4	Automatic Monitoring and Targeting .....	14
5.4	Lean Carbon Dioxide Emissions .....	14
5.4.1	Option A .....	14
5.4.2	Option B .....	14

6.	Be Clean - Supplying Energy Efficiently .....	15
6.1	District Heating/Cooling Networks .....	15
6.2	Site-Wide Heating/Cooling Networks .....	15
6.3	Adoption of a C/CHP System .....	15
6.4	Fuel Cell to Drive C/CHP .....	16
6.5	Clean Carbon Dioxide Emissions .....	16
6.5.1	Option A .....	16
6.5.2	Option B .....	16
7.	Be Green - Renewable Energy .....	17
7.1	Renewable Technologies .....	17
7.1.1	Biomass / Biodiesel Heating / Cooling / Electricity .....	17
7.1.2	Renewable Energy from Waste .....	17
7.1.3	Photovoltaics .....	17
7.1.4	Solar Hot Water Heating .....	17
7.1.5	Wind Turbines .....	18
7.1.6	Ground Source Heat Pumps .....	18
8.	Sustainability Statement .....	19
8.1	Option A .....	19
8.2	Option B .....	20

## Appendices

Appendix A	Code for Sustainable Homes (Domestic New Build)
Appendix B	BREEAM (Domestic Refurbishment)
Appendix C	BREEAM (Retail)
Appendix D	Energy Schematic
Appendix E	CHP Analysis

i. **Executive Summary**

The redevelopment scheme for Centre Point has recently evolved such that additional land has been brought into the scheme, with additional new-build affordable residential apartments being proposed. These will be situated to the south end of the site, on land that is currently occupied by a public house.

This statement has been prepared in response to these new proposals.

There are two options presented in this Statement, which reflect the two proposals outlined for the new-build residential units. These are referred to throughout this report as Option A and Option B (see Section 3 for further details).

**Option A** includes a proposed affordable housing scheme which is made up of 13No. apartment units. **Option B** includes a proposed affordable housing scheme which is made up of 16No. apartment units. In both options, the remainder of the development (incorporating Centre Point Tower, Centre Point House and Centre Point Link) remains the same.

The energy strategy for both options has been developed in line with the guidelines set out in Part L 2010 of the Building Regulations and in the London Plan. **Lean, Clean and Green** measures have been adopted, with the resulting development achieving carbon emissions reductions far in excess of the current Building Regulations, and measuring favourably in relation to the London Plan.

Regarding BREEAM and Code for Sustainable Homes:

- Centre Point Tower residential will target '**Excellent**' rating when assessed against BREEAM Refurbishment 2012 (Domestic Buildings).
- Centre Point retail and leisure units will target '**Very Good**' rating when assessed against BREEAM Refurbishment 2012 (Non-Domestic Buildings)
- New-build residential units will target '**Level 4**' ratings when assessed under Code for Sustainable Homes

Relative to Part L of the Building Regulations 2010, the two options can be summarised by the two graphs opposite.

When measured against the requirements of the London Plan, the development can be summarised by the tables on the following page, as presented in pages 5 & 6 of the *GLA Guidance on Preparing Energy Assessments, Sept 2011*.

Pursuant to Section 106 Agreement the following should be noted:

1. This report states the measures to be adopted for reducing carbon emissions using the Lean, Clean and Green hierarchy.
2. It is confirmed that low and zero carbon technologies will be metered.


3. It is confirmed that the development will be provided with a Building Energy Management system to control and monitor the use of heating, cooling and hours of plant operation
4. As stated in Section 6, provision is made for connection to a local heat network when available. Provision also provided for connection to the adjacent site currently owned by Consolidated Land.
5. A pre assessment of the Development has been carried out by the BREEAM and CfSH Assessor and overseen by the BRE.
6. The BREEAM and CfSH Assessor will undertake a Post Completion Review of the Development and this will be overseen by the BRE
7. Residential apartments will be assessed using the BREEAM Domestic Refurbishment accreditation scheme that has replaced the now defunct ECO Homes Assessment.
8. Submissions will be made to Camden Council Building Control Officer as the development progresses. Any changes to the Plan as set out in this document will be submitted to the Camden Council Planning Department for prior approval.

# 01

## Executive Summary

### Part L 2010 – Option A


Relative to Part L of the Building Regulations 2010, regulated emissions are calculated to be 27.0% lower than the target emissions:

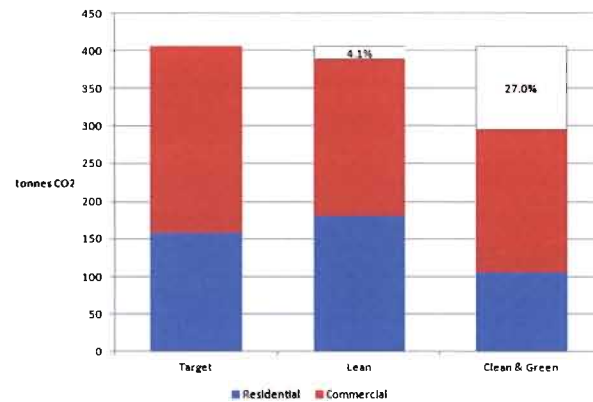

1.1

### Part L 2010 – Option B

Relative to Part L of the Building Regulations 2010, regulated emissions are calculated to be 27.5% lower than the target emissions:

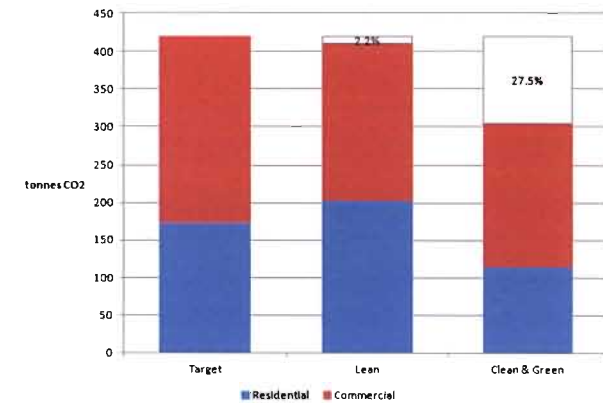

## 1.2 London Plan – Option A

GLA Table 1: Carbon dioxide emissions after each stage of the energy hierarchy

	Carbon Dioxide Emissions(tonnes CO <sub>2</sub> per annum)	
	Regulated	Unregulated
Building Regulations 2010 Part L compliant development	405.3	513.1
After energy demand reduction	388.8	513.1
After CHP	295.9	513.1
After renewable energy	295.9	513.1

GLA Table 2: Regulated carbon dioxide savings from each stage of the energy hierarchy

	Regulated Carbon Dioxide Savings	
	Tonnes CO <sub>2</sub> per annum	%
Savings from energy demand reduction	16.5	4.1%
Savings from CHP	92.9	23.9
Total	109.4	27.0%

## 1.3 London Plan – Option B

GLA Table 1: Carbon dioxide emissions after each stage of the energy hierarchy

	Carbon Dioxide Emissions(tonnes CO <sub>2</sub> per annum)	
	Regulated	Unregulated
Building Regulations 2010 Part L compliant development	419.9	520.8
After energy demand reduction	410.7	520.8
After CHP	304.4	520.8
After renewable energy	304.4	520.8

GLA Table 2: Regulated carbon dioxide savings from each stage of the energy hierarchy

	Regulated Carbon Dioxide Savings	
	Tonnes CO <sub>2</sub> per annum	%
Savings from energy demand reduction	9.2	2.2%
Savings from CHP	106.3	25.9%
Total	115.5	27.5%

2.

## Introduction

The following report outlines the energy strategy for the proposals at Centre Point. The site was originally constructed in the 1960's as a mixed use complex, comprising of offices in Centre Point Tower (CPT), retail & office in the Centre Point Link (CPL) and residential, retail & office in Centre Point House (CPH).

The proposal is to create a new mixed use development in which CPT will receive refurbished residential accommodation, while retail and leisure units will be located in CPL and the lower levels of CPH and CPT.

A small public house at the south end of the site has recently been drawn into the scheme. The proposals here include for constructing new-build affordable housing units on the site, with a retail outlet at ground level. This element of the scheme will be referred to throughout this document as 'The Pub Site'.



It is noted that the existing building structure in CPT, CPH and CPL is thermally inefficient and has significant cold bridging issues. These are primarily caused by the external facade being directly connected to the structural floor slabs without a thermal break. This has impacted on the extent to which the facade performance can be improved and has reduced the level of carbon savings that can be achieved.

2.1

## Purpose of the Report

Reducing carbon dioxide emissions into the atmosphere to reduce the impact on climate change is one of the major objectives of sustainable development.

This report considers a number of measures by which this can be achieved for the Centre Point proposals and recommends those which are most appropriate in terms of environmental, technical and economic feasibility, as well as outlining the proposed energy strategy. It demonstrates that existing developments such as this can be adapted and improved to meet the standards of new buildings, in which people can live and work reducing dramatically the amount of fossil fuels consumed and reduce the release of unsustainable quantities of carbon dioxide into the atmosphere.

This is a technical report. Whilst the development is an existing site it follows the guidelines set out in the document "Integrating renewable Energy into New Developments: Toolkit for planners, developers and consultants" as produced by London Renewables.

This document deals with passive and active energy efficiency, as well as a centralised energy centre complying with local planning policy, including the Mayor of London's Energy Strategy and The London Borough of Camden Planning guidance.

Note that it has not been found feasible to incorporate 'Green' technologies into the development, due to site and/or technical constraints. These include the listed status of the building and limited space to provide these features which would adversely affect the external appearance of the building.

Two of the major requirements of the 2011 London Plan are that the 'Green' building exceeds the 2010 Part L regulations by a minimum of 25%, and that, where feasible, renewable technologies contribute to at least 20% of the overall reduction in carbon dioxide emissions.

2.2

## Building Regulations

The relevant national regulations (The Building Regulations Part L, Conservation of Fuel & Power) are also referenced. The current, 2010, edition is part of a rolling programme intended to reduce carbon dioxide emissions from buildings through a combination of energy efficiency measures and on-site renewable energy.

The analysis undertaken to establish compliance with Building Regulations has been conducted in accordance with the guidance set out in the London Plan, namely the Energy Hierarchy, Lean, Clean, Green (see overleaf).



### 2.3 Planning Policies

The planning policies relating to the Centre Point Development's Energy Statement are as follows:

#### 2.3.1 National Planning Policy

The National Planning Policy Framework, issued in March 2012, sets out the Government's planning policies for England and how these are expected to be applied. The key policies highlighted in this document which relate to energy and climate change include:

Local Planning Authorities should ensure that development plans address the potential impacts of climate change through policies which reduce energy use and improve energy efficiency in existing buildings, reduce greenhouse gas emissions and promote the development of renewable energy sources in a way that is consistent with the Government's Zero Carbon Buildings Policy.

Local Planning Authorities should expect new developments to fully investigate the feasibility of using decentralised energy supplies and to take account of landform, layout, building orientation, massing and landscaping to minimise energy consumption.

Local Planning Authorities should have a positive strategy to promote energy generated from renewable and low carbon sources, whilst ensuring that adverse impacts (including landscape and visual impacts) are addressed satisfactorily. Economic and social impacts should also be considered, particularly in identification of suitable areas for renewable or low carbon energy sources and the support of community-led initiatives.

#### 2.3.2 Regional Planning Policy

The Mayor of London published the current revision of the 'London Plan' in July 2011. This is the Spatial Development Strategy for Greater London. The Development Plans of all London Boroughs must be in general conformity with the provisions of the London Plan.

To support borough planners, the Mayor has also published a guidance document via London Renewables: "Integrating Renewable Energy into New Developments: A Toolkit for Planners, Developers and Consultants" (Sep 2004) and the Supplementary Planning Guidance "Sustainable Design and Construction" (May 2006).

The London Plan includes policies both for reducing energy consumption within buildings and, significantly, promoting the use of decentralised electricity generation and renewable energy. These policies cover the role of boroughs in supporting the Mayor's Energy Strategy and the requirements of planning applications.

The London Plan recognises that energy efficiency should come before energy supply considerations and has suggested a simple strategy known as the Mayor's Energy Hierarchy. This system follows good practice in the design of low carbon buildings and comprises three distinct stages in order of application:

- Use Less Energy (Be Lean)
- Supply Energy Efficiently (Be Clean)
- Use Renewable Energy (Be Green)

This strategy puts energy efficiency/conservation measures first in reducing emissions, 'Be Lean'. Following this, consideration must be given to supplying the resultant reduced energy demand as efficiently as possible, including the use of site wide networks, combined heat and power (CHP) and tri-generation (CCHP), 'Be Clean'. Finally, sources of renewable energy should be examined, 'Be Green'.

The mayor will expect all major developments to demonstrate that the proposed heating and cooling systems have been selected in accordance with the following order of preference:

- Connection to an existing district heating or cooling networks
- Site-wide heating networks
- Gas-fired C/CHP (or fuel cell)
- Gas-fired C/CHP (or fuel cell) plus heat or coolth export beyond the development
- Site wide cooling network

The possibility of connecting to an existing district heating network has been considered. There are currently no existing or proposed district heating networks in the vicinity of the site (see Section 6). Discussions have also been held with Consolidated Developments Ltd who own the adjacent site to the South. These options do not appear viable and hence a site wide air sourced water cooled heat pump network is being considered. Provision will be made within the heating and condenser networks for future connections to district heating networks and/or adjacent developments.

The current London Plan includes a notional target for on-site renewable energy, unless it can be demonstrated that such provision is not feasible. This target is for renewable energy to achieve a 20% reduction in carbon dioxide emissions after any energy efficiency measures and (non-renewable) C/CHP schemes have been applied.

The Plan also states that provision must be made in some form for the future Hydrogen Economy.

The table below outlines the key policies in the 2011 London Plan which this report addresses and the impact on the Centre Point proposals. It also summarises how the development will address these policies.



Ref	Policy Outline	Proposed Scheme
5.1	Climate Change Mitigation	Refer to responses to policies 5.2, 4A.6 and 4A.7.
5.2	Minimising Carbon Dioxide Emissions.	<p>The proposals will, wherever possible, go beyond the requirements for Building Regulations and the targets outlined in Policy 5.2 of the London Plan 2011 in reducing CO<sub>2</sub> emissions, wherever technically and economically feasible. Annual emissions for the development are expected to be approximately 26.9% below a baseline of 2010 building regulations compliant buildings including non-regulated energy uses. This document sets out the assessment as described in policy 5.2 and the recent GLA energy team guidance on Planning Energy Assessments.</p> <p>Calculations are based on the use of accredited Part L software. A baseline CO<sub>2</sub> emission has been determined representing the Target Emission Rate (TER)</p> <p>The Building Emission Rate of the proposed buildings will be less than the TER as defined by Part L 2010. This will be achieved by passive design of the buildings and the incorporation of energy efficient plant &amp; systems.</p>
5.3	Sustainable Design and Construction	<p>For the residential areas the design has been carried out against CFSH Level 4 criteria, however given that the development is existing, Ecohomes accreditation is applicable. Initial assessments suggest a 'Very Good' rating is achievable.</p> <p>Many aspects of this policy will be dealt with via the BREEAM and Code for Sustainable Homes assessments.</p> <p>Other responses within this table also apply to this policy.</p> <p>BREEAM and CFSH assessments can be found in the Appendices.</p>
5.4	Retrofitting	The development is an existing site and all buildings will be retained and will be connected to the central energy centre. Wherever possible all areas will be upgraded as far as practicable within the constraints of the building's listing.

5.5	Decentralised Energy Networks	Centralised energy plant will serve the entire development. This will include heating & cooling by a site wide air sourced water loop which feeds heat pumps throughout the site. A site wide domestic hot water network fed by gas fired CHP will serve the development.
5.6	Decentralised Energy: Networks in development proposals.	<p>There is no existing or planned district heating schemes in the vicinity of the site.</p> <p>An onsite air sourced heat pump network backed up by CHP and a CHP led domestic hot water network will serve the entire development. This central energy system will incorporate connections ready to connect to future district heating schemes.</p> <p>The possibility of incorporating the Centre Point energy system with a new development to the south will be investigated</p> <p>Passive measures &amp; façade optimisation will be used to minimise the requirement for heating &amp; cooling.</p>
5.7	Renewable Energy	Various other renewable technologies have been examined but the structural and technical constraints of the existing buildings do not make adoption of renewable technologies appropriate. For example, the planned limited structural foundation works do not permit the adoption of ground sourced technologies.
5.8	Innovative Energy Technologies	The building energy systems will be designed such that the CHP unit can be replaced with a fuel cell once these become economically and technically viable for the development.
5.9	Overheating and Cooling	General building design, such as optimisation of the façade and openable windows will minimise the effect of solar gains to the buildings and subsequently the requirement for space cooling.

## 2.3.3

**Local Planning Policy**

Camden Council's Local Development Framework namely the Core Strategy and Development Policies document was adopted in November 2010 Policy DP22 – Promoting Sustainable Design and Construction is relevant to this report. The policy requires Code for Sustainable Homes (CFSH) Level 4 for residential, BREEAM (Domestic Refurbishment) 'Very Good' targeting 'Excellent' for residential refurbishment and BREEAM 'Very Good' targeting 'Excellent' for non-domestic.

The policy also asks that buildings are designed to avoid overheating and the use of air-conditioning to be avoided where possible.

The policy also requires that green roofs, brown roofs, or green walls are incorporated in all buildings.

Generally, the policies detailed in the London Plan 2011 are equivalent to or more onerous in terms of energy use and carbon emissions than local planning policy. Compliance with the London Plan will ensure compliance with Camden Council policies.

## 2.4

**BREEAM / Code for Sustainable Homes**

The Building Research Establishment Environmental Assessment Method, known as BREEAM, describes the environmental performance standard against which buildings in the UK can be assessed, rated and certified.

The BREEAM Scheme Document and the information detailed therein has been designed to be used by trained, qualified and licensed BREEAM Assessors in accordance with the procedural and operational requirements of BREEAM under the terms and conditions of a relevant BREEAM licence.

The BREEAM Technical Guidance has been drafted by the BREEAM Centre at the Building Research Establishment (BRE).

The BRE also develops the Code for Sustainable Homes. This is in effect a BREEAM assessment to be used for new-build residential developments. Like BREEAM, the Code for Sustainable Homes has been designed to be used by trained, qualified and licensed Assessors in accordance with the procedural and operational requirements of the Code under the terms and conditions of a relevant Code for Sustainable Homes licence.

The development at Centre Point will be assessed under the following schemes:

CPT residential: BREEAM Refurbishment 2012 (Domestic Buildings)

Target '**Excellent**'

CP retail/leisure: BREEAM Refurbishment 2012 (Non-Domestic Buildings)

Target '**Very Good**'

IFox (formally WLH) residential: Code for Sustainable Homes

Target '**Level 4**'

See Appendix A-C for pre-assessments for each of these schemes.

3.

Development Options

The recent inclusion of designs for redeveloping the existing public house warrants a reassessment of the Energy Strategy. This report aims to address this.

There are currently two options being forwarded for consideration. These relate to the massing and design for the affordable housing units and the ground level retail unit planned for the Pub site.

Each option has been assessed separately and each will be discussed in this Statement.

Option A	Residential GEA (m <sup>2</sup> )	Retail GEA (m <sup>2</sup> )	Total GEA (m <sup>2</sup> )
----------	-----------------------------------	------------------------------	-----------------------------

Total Proposed GEA (m2)	33,861	8155	42,015
-------------------------	--------	------	--------

Option B	Residential GEA (m <sup>2</sup> )	Retail GEA (m <sup>2</sup> )	Total GEA (m <sup>2</sup> )
----------	-----------------------------------	------------------------------	-----------------------------

Total Proposed GEA (m2)	33,968	8156	42,124
-------------------------	--------	------	--------

4.

## Baseline Building Emissions

Part L, 2010, of the Buildings Regulations use a 2010 compliant “Notional” building against which target reductions in carbon emissions must be achieved.

The 2010 Approved Documents Part L and supporting second or third tier documents set out in detail how a 2010 notional building should be modelled to produce a base energy demand and the resultant carbon dioxide emissions assessment.

The current London Plan assesses a development or building's carbon dioxide emissions against the Part L 2010 compliant building. This figure is calculated using Part L accredited software. The energy use assessment for Part L of the Building Regulations does not include all forms of energy use only ‘Regulated’ energy use is assessed. The London Plan however requires that ‘unregulated’ energy use such as appliances and cooking are also considered.

The ‘unregulated’ energy use is calculated by reference to published material or by calculation.

- For residential areas, an allowance for cooking & appliances has been added based on the information outlined in the SAP worksheet 9.90.
- For the functional non-domestic areas, an allowance for small power has been added based on output from the Part L model for the building (i.e. the NCM).
- For plant rooms, an estimate has been made of the lighting & small power energy demand.

The treated areas of the building have been modelled using the National Calculations Method (NCM). This is incorporated in SAP and a dynamic thermal simulation tool (TAS by EDSL Ltd) accredited for carrying out carbon emissions calculations. The results have been used to estimate energy consumption and carbon dioxide emissions. This summation is known as the ‘Baseline’ emissions rate. All carbon reduction measures are assessed against this.

Allowances for energy consumption not included under Part L have been made by reference to published material or by calculation. These include small power (energy use for electrical appliances).

Regulated energy use and the associated carbon dioxide emissions have been calculated using TAS version 9.2.1.3 and SAP 2010.


Unregulated energy use and the associated carbon dioxide emissions for the non domestic buildings has been calculated using the TAS UK Building Regulations Studio, CIBSE publications for guidance, as well as evidence established through previous development work.

The charts opposite indicate the performance of the development relative to Part L of the Building Regulations 2010.

4.1

### Option A


Site-wide regulated emissions target for Option A are 405.3 tonnes.

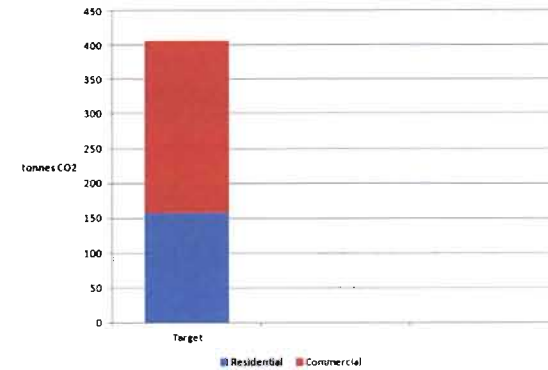

4.2

### Option B

Site-wide regulated emissions target for Option B are 419.9 tonnes.

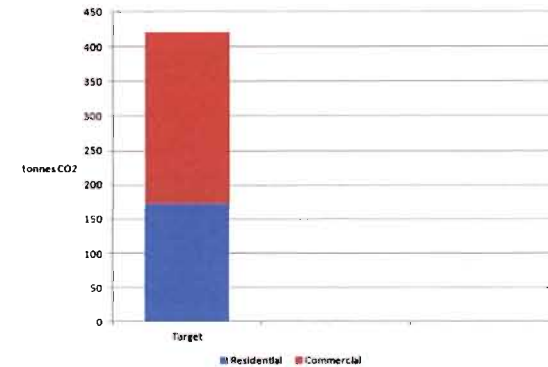

5.	<b>Be Lean - Reducing Energy Demand</b>
	Energy efficient servicing strategies and equipment have been used throughout the development to <i>reduce energy demand</i> . Features employed include:
5.1	<b>Passive Design Features</b>
5.1.1	<b>Building Envelope Thermal Properties</b>
	The façade design has been developed to meet or exceed the Building Regulations limiting performance criteria. Thermal bridging between the external fabric of the building and the structural floor slabs has been reduced by the additional thermal insulation applied but cannot be eliminated. This has impacted on the extent of carbon saving that is achievable.
	For the new-build residential at IFox, the building envelope design is more flexible. The design here will be driven by the same principles however as those that have been adopted for the residential units in CPT, namely to minimise heat loss in winter and heat gains in summer.
5.1.2	<b>Facade Optimisation</b>
	The design of the facade has a significant impact on the energy demand of a building in terms of heating, cooling and artificial lighting. As a listed building, there are limitations and restrictions on the extent of changes that can be made to Centre Point. A low solar transmittance of the glazing system, whilst reducing the demand for cooling energy, will also increase heating demand and artificial lighting energy consumption because it reduces daylight levels within the perimeter areas. A glazing of poor thermal and solar performance will reduce energy demand for artificial lighting but increase demand for heating and cooling. Hence a fine balance has been struck.
	Note that the benefit of increased daylight falls off rapidly once daylight factors exceed about 5%. The proportion of glazing also has a major impact on views out which is known to affect the well-being of occupants.
	An analysis of the likely solar exposure into each occupied area has been undertaken and the results used to determine the balance of solidity, shading and glazing solar performance (g-value) required to limit solar gains in the summer to acceptable levels. As a result, the Centre Point development glazing performance is maximised for each orientation - to control solar gains on the façades that would otherwise be susceptible to summer overheating (South, East and West), and to maximise solar exposure on the façade that will lose the most heat in the winter (north).
	The façade optimisation reduces the energy required for heating in the winter, as well as avoiding an unacceptable risk of summertime overheating.
	The facade design is more flexible for the new-build residential units on the IFox site. The design however will be again driven by the same principles as those adopted for CPT residential units.

5.2	<b>Active Design Features: Unregulated Energy Use</b>
5.2.1	<b>Low Energy White Goods</b>
	White goods are now provided with a certified energy label. These are rated A+, A, B and C with C being the least efficient.
	It is intended that all white goods provided will be rated at the highest energy efficiency rating available. This will result in an emissions saving of circa 2.5% from previous building regulations.
5.2.2	<b>Low Energy Culture</b>
	Providing building users and operators with practical guidance on the importance and methods of energy efficiency can lead to effective, low cost reductions in energy usage and carbon emissions. Savings can be expected in, for example:
	<ul style="list-style-type: none"> <li>• Operating Comfort Cooling Systems Efficiently in Mixed Mode</li> <li>• Lighting Energy: A Culture of 'Turn-It-Off'</li> <li>• Small Power: Including Avoiding Monitors and PCs, etc., in Stand-By Mode</li> <li>• Heating Energy: For Example Reducing Thermostat Settings</li> </ul>
	The amount of energy that can be saved will be dependent upon the motivation of the occupants and the effectiveness of the awareness programmes. Such programmes cannot be a one-off event and must make progress in energy efficiency transparent. It is recommended that targets are set and that recognition is given to users and operators who achieve these targets.
	Training of operators and facility managers is particularly important to provide them with the skills and knowledge to implement change and continue to improve an energy management programme. Whilst this will be encouraged it is not possible to quantify the savings achieved.
5.3	<b>Active Design Features: Regulated Energy Use</b>
5.3.1	<b>Low Energy Lighting</b>
	LED luminaries will be used predominantly, with high frequency ballasts and high efficacy lamps and luminaries also utilised where required. Lighting controls can further reduce energy consumption. Lighting controls such as daylight control, presence sensors, etc., will be used, where appropriate.
5.3.2	<b>Air Handling Heat Recovery</b>
	Appropriately designed heat recovery on mechanical ventilation can provide significant energy savings. All ventilation systems will include heat recovery where technically feasible. It is currently proposed all air handling units (AHUs), will contain plate heat

exchangers, where conditions allow. Whole house ventilation units will incorporate heat recovery.

#### 5.3.3 Power Factor Correction

The Building Regulations Approved Document L2A identifies that the provision of power factor correction to the building electrical supply can provide significant savings in electrical consumption. A saving in electrical energy consumption of 1.5% is awarded for power factor correction to 0.9 and a saving of 2.5% awarded for power factor correction to 0.95 power factor. Centre Point intends to have a power factor correction of 0.95.

#### 5.3.4 Automatic Monitoring and Targeting

The Building Regulations Approved Document L2 identifies that the provision of automatic monitoring and targeting on new equipment with alarms for out of range values, can provide significant savings in energy consumption of the building services systems. A saving in energy consumption of 5% is awarded for complete installations that measure, record, transmit, analyse, report and communicate meaningful energy management information to enable the operator and occupier to manage the energy it uses.


### 5.4

## Lean Carbon Dioxide Emissions

#### 5.4.1

### Option A


Site-wide regulated emissions are reduced by 4.1% due to **Lean** measures.

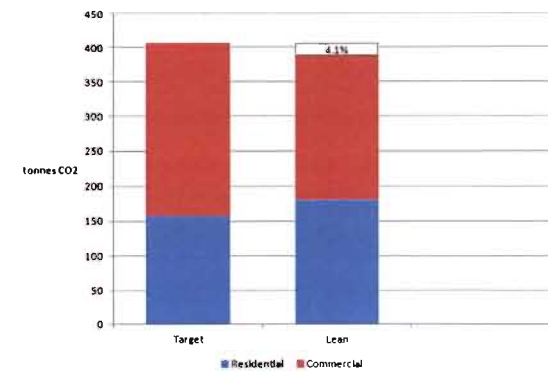

#### 5.4.2

### Option B

Site-wide regulated emissions are reduced by 2.2% due to **Lean** measures.

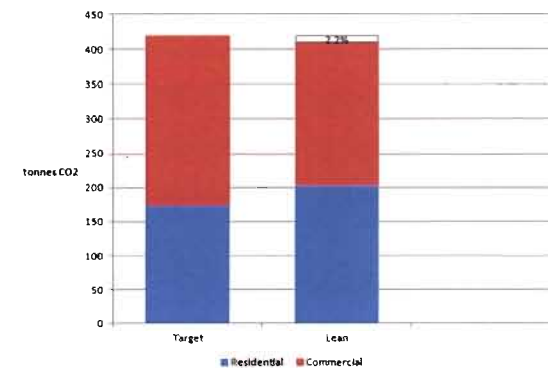

## 6. Be Clean - Supplying Energy Efficiently

After minimising the energy demand, the development's energy performance is further improved by ensuring the energy required is generated as efficiently as possible. The London Plan Policy 5.6 details how this can be done and defines the hierarchy by which the energy systems should be selected:

- Connection to existing low carbon heat distribution networks
- Provide a site wide energy system
- Adopt a C/CHP unit
- Export energy from a site wide C/CHP

### 6.1 District Heating/Cooling Networks

The feasibility of connecting the development to a district heating network has been assessed, making reference to the London Heat Map. The following image is an extract of the London Heat Map for the area surrounding Centre Point, this indicates that there are no existing or proposed networks in this area.



Discussions have been held with Consolidated Developments Ltd who are in the process of developing a planning application for a mixed use development to the south of the

Centre Point site. The discussions centred on the potential for optimising the use of energy by linking the two sites. Joint discussions were also held with the Carbon Trust and Mitie that were facilitated by Camden Council. It was agreed that the viability of a combined energy centre for the two sites will not be practical in programme terms, will not deliver further carbon savings and is not financially viable. The potential for the transfer and use of waste heat between the two sites is being progressed.

Irrespective of the study outcome, capped connections and space for heat exchanger interfaces will be provided to allow future connection to a local heat network if this materialises in the future.

### 6.2 Site-Wide Heating/Cooling Networks

A site wide air cooled condenser loop system will be utilised across the development. This will be connected to heat pumps (providing heating and cooling). Heat recovery will be utilised across the system wherever possible, such that waste heat from the retail units being cooled can be used in the residential areas when there is a heating demand.

The development has been designed to minimise the requirement for cooling and to avoid overheating, by the measures detailed in Section 5. The façade includes optimised glazing performance based on orientation. The opportunity to open windows to provide natural ventilation is afforded to the residential units as an alternative to mechanical cooling.

The major centralised plant will be located at basement level, with ambient energy rejection plant located at roof level.

An energy schematic, indicating the extent of the communal heat sink and heating network is shown in Appendix D of this report.

### 6.3 Adoption of a C/CHP System

The use of absorption cooling has been reviewed in conjunction with the CHP waste heat. Due to the low cooling loads and intermittent nature of the demand this option has been discounted.

The site wide space cooling and heating demand will be met by the heat pump systems served by a common condenser circuit. A gas fired CHP will meet the domestic hot water demand and top up heat to the condenser circuit in cold extremes. This unit will provide heat whilst generating electricity. The system shall primarily meet the base landlord's electricity demand.

A detailed study has been undertaken to establish the optimal size and operating regime of the CHP plant (see Appendix E). This study has ensured the unit size of the CHP has been optimised to maximise efficiency in line with Building Regulations requirements and CHP QA standards. The electrical energy produced will be used in landlord and common parts of the development.



Discussions are being held with UK Power Networks (UKPN) to establish the feasibility of exporting excess electricity from CHP to the grid. We await confirmation that the expected permission will be granted.

#### 6.4 Fuel Cell to Drive C/CHP

An alternative option is available for replacing the CHP unit with a fuel cell.

The use of fuel cell technology has been investigated for other similar developments within this office. Whilst it has the potential to offer near zero NOx emissions, the fuel cell is comparable to gas fired CHP systems in terms of greenhouse gas (GHG) emissions. Its capital expense however means it is approximately 4 times more expensive to install, meaning the carbon savings benefit per unit capital cost makes this technology prohibitive in the current market.

Furthermore, at full load the fuel cell produces both high grade waste heat and low grade waste heat. Under the current strategy, the high grade heat is delivered at too high a temperature (approximately 300°C) to be used efficiently within the development.

For reasons noted above, fuel cell technology is not the preferred strategy for this scheme.


#### 6.5

#### Clean Carbon Dioxide Emissions

##### 6.5.1

#### Option A


Site-wide regulated emissions are reduced by a further 22.9% due to CHP, taking aggregate reduction in emissions due to **Lean** and **Clean** measures to 27.0%.

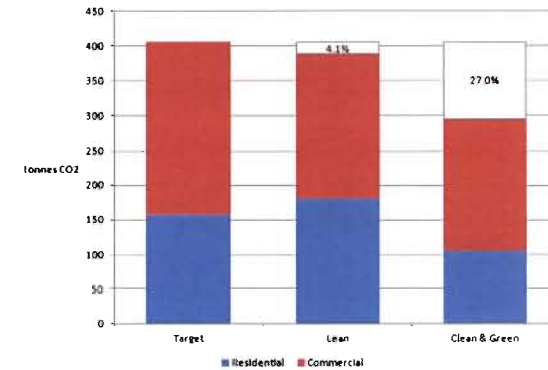

##### 6.5.2

#### Option B

Site-wide regulated emissions are reduced by a further 25.3% due to CHP, taking aggregate reduction in emissions due to **Lean** and **Clean** measures to 27.5%.

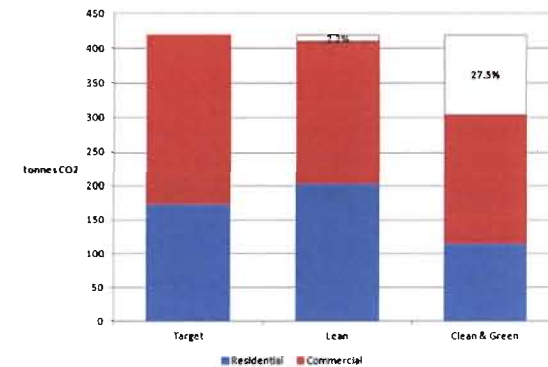

## 7. Be Green - Renewable Energy

The current version of the London Plan contains a presumption that development will seek to reduce carbon dioxide emissions through the use of on-site renewable energy generation wherever feasible. This reduction is measured against the energy efficient 'Lean' and 'Clean' design emissions.

The plan also recommends the following renewable energy technologies are likely to be the most effective in London developments, in terms of environmental, technical and economic feasibility:

- Biomass heating / cooling / electricity
- Renewable energy from waste
- Photovoltaic panels
- Solar hot water heating
- Wind turbines
- Ground source/ aquifer heat pumps
- Air source heat pumps

Each of these has been assessed. The results are shown within the following pages.

The London Plan also encourages the use of innovative energy technologies such as hydrogen fuel cell vehicles or anaerobic digestion. This includes the introduction of hydrogen supply and distribution infrastructure. These concepts are discussed within this section of the report.

## 7.1 Renewable Technologies

### 7.1.1 Biomass / Biodiesel Heating / Cooling / Electricity

A common and sustainable form of biomass is wood in the form of small chips or pellets. These are produced as a waste product in the forestry industry. The fuel is burnt in specially designed boilers with high efficiency filters on the exhaust to reduce particulate emissions.

Although carbon dioxide is emitted in the exhaust gas, this originated from the atmosphere and was stored within the trees by photosynthesis. As such, there is no net increase in atmospheric carbon emissions and it is considered a 'carbon neutral' fuel. However, some fossil fuel will be expended in producing and transporting biomass which is why there are some associated carbon emissions. The current building regulations specify an emission rate one-seventh that of natural gas.

The key issues with biomass are fuel handling and storage, fuel availability, emissions and ash disposal.

Where biomass boilers are installed, they need to operate under steady load conditions. Usually, therefore, gas fired boilers provide top up at times of peak load.

However due to the size of the installation and the frequency of fuel deliveries required biomass / bio-gas installations are impractical for this site.

Air quality is also seen to be an issue in London. Extensive filtration and catalytic conversion is required to reduce particulate matter (PM), nitrogen oxide (NOx) and the potential nitrous oxide (N<sub>2</sub>O) emissions from biomass installations, together with high level dispersion to meet the London air quality requirements. These restrictions mean that biomass / bio-gas heating and/or cooling is inappropriate for this development.

### 7.1.2 Renewable Energy from Waste

Generating energy from waste would not be appropriate for this development due to the relatively low levels of combustible waste generated on site.

### 7.1.3 Photovoltaics

The load carrying capacity of the flat roof areas is not adequate to take the load of PV panels. The tower roof space is taken up with heat rejection from the condenser water loop. There are also concerns about the visual impact that PV panels will have on the buildings appearance and the obvious listed building issues. The use of PV is therefore not recommended.

### 7.1.4 Solar Hot Water Heating

The option of providing solar hot water to the development has been considered. In addition to the difficulty in identifying suitable locations for panels within the development, it is recognised that they compete for thermal loads with CHP, making

their inclusion incompatible with the proposed strategy and as such this is not appropriate for this site.

#### 7.1.5

##### **Wind Turbines**

Wind turbines produce electricity directly from the energy in wind. This is then fed into the buildings electrical system via control gear.

Two types of wind turbine are available, horizontal axis and fixed axis. The former tend to be noisy and produce vibration. The latter are quieter in operation and more suited to installation on buildings but are generally less efficient and more expensive.

Recent measurements of a wind turbine on a London building has confirmed reports that wind turbulence around buildings greatly reduces energy output – typically half that suggested by manufacturers’ literature. There are also concerns relating to the visual impact of such devices on the building appearance which together with restrictions on building height means wind turbines are not recommended for this project.

#### 7.1.6

##### **Ground Source Heat Pumps**

A heat pump utilises the heat stored within the earth (consistently around 12°C) below the building to provide low grade hot water for use as heating. As the development is an existing site and there are no major construction works to the foundations, there is no scope for incorporating a closed loop ground source heat pump system.

Therefore this technology has been discounted from this development.

)

## 8. Sustainability Statement

### 8.1 Option A


This Energy Statement has been prepared in response to the new proposals for Planning consent regarding the redevelopment of Centre Point, in particular the inclusion of new construction of affordable housing on the site of the existing pub.

The energy strategy for **Option A** has been developed in line with the guidelines set out in Part L 2010 of the Building Regulations and in the London Plan. **Lean, Clean** and **Green** measures have been adopted, with the resulting development achieving carbon emissions reductions far in excess of the current Building Regulations, and measuring favourably in relation to the London Plan.

Regarding BREEAM and Code for Sustainable Homes:

- CPT residential will target 'Excellent' rating when assessed against BREEAM Refurbishment 2012 (Domestic Buildings)
- CP retail and leisure units will target 'Very Good' rating when assessed against BREEAM Refurbishment 2012 (Non-Domestic Buildings)
- The new affordable housing scheme on the Pub site will target 'Level 4' rating when assessed under Code for Sustainable Homes

Relative to Part L of the Building Regulations 2010, regulated emissions are calculated to be 27.0% lower than the target emissions:

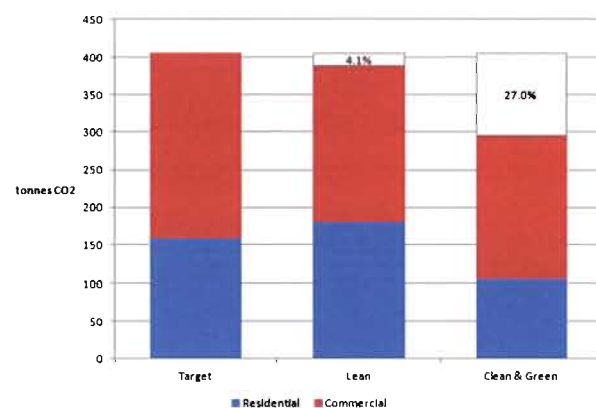

When measured against the requirements of the London Plan, the development can be summarised by the following tables, as per presented in pages 5 & 6 of the *GLA Guidance on Preparing Energy Assessments, Sept 2011*:

GLA Table 1: Carbon dioxide emissions after each stage of the energy hierarchy

	Carbon Dioxide Emissions(tonnes CO <sub>2</sub> per annum)	
	Regulated	Unregulated
Building Regulations 2010 Part L compliant development	405.3	513.1
After energy demand reduction	388.8	513.1
After CHP	295.9	513.1
After renewable energy	295.9	513.1

GLA Table 2: Regulated carbon dioxide savings from each stage of the energy hierarchy

	Regulated Carbon Dioxide Savings	
	Tonnes CO <sub>2</sub> per annum	%
Savings from energy demand reduction	16.5	4.1%
Savings from CHP	92.9	23.9%
Total	109.4	27.0%

## 8.2 Option B


This Energy Statement has been prepared in response to the new proposals for Planning consent regarding the redevelopment of Centre Point, in particular the inclusion of new construction of affordable housing on the site of the existing pub.

The energy strategy for **Option B** has been developed in line with the guidelines set out in Part L 2010 of the Building Regulations and in the London Plan. **Lean, Clean and Green** measures have been adopted, with the resulting development achieving carbon emissions reductions far in excess of the current Building Regulations, and measuring favourably in relation to the London Plan.

Regarding BREEAM and Code for Sustainable Homes:

- CPT residential will target 'Excellent' rating when assessed against BREEAM Refurbishment 2012 (Domestic Buildings)
- CP retail and leisure units will target 'Very Good' rating when assessed against BREEAM Refurbishment 2012 (Non-Domestic Buildings)
- The new affordable housing scheme on the Pub site will target 'Level 4' rating when assessed under Code for Sustainable Homes

Relative to Part L of the Building Regulations 2010, regulated emissions are calculated to be 27.5% lower than the target emissions:

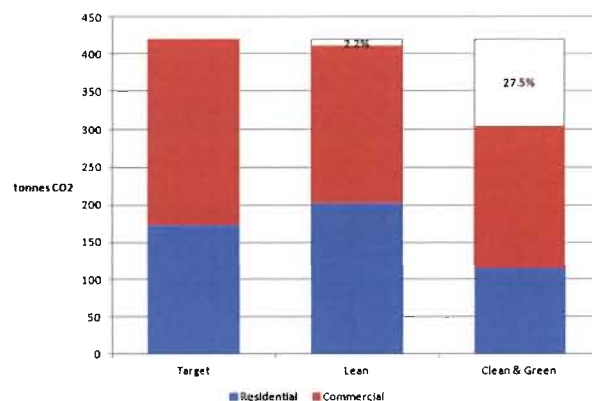

When measured against the requirements of the London Plan, the development can be summarised by the following tables, as per presented in pages 5 & 6 of the *GLA Guidance on Preparing Energy Assessments, Sept 2011*:

GLA Table 1: Carbon dioxide emissions after each stage of the energy hierarchy

	Carbon Dioxide Emissions(tonnes CO <sub>2</sub> per annum)	
	Regulated	Unregulated
Building Regulations 2010 Part L compliant development	419.9	520.8
After energy demand reduction	410.7	520.8
After CHP	304.4	520.8
After renewable energy	304.4	520.8

GLA Table 2: Regulated carbon dioxide savings from each stage of the energy hierarchy

	Regulated Carbon Dioxide Savings	
	Tonnes CO <sub>2</sub> per annum	%
Savings from energy demand reduction	9.2	2.2%
Savings from CHP	106.3	25.9%
Total	115.5	27.5%

# Appendices

## Appendix A - Code for Sustainable Homes (Domestic New Build)

106610/LA/120207 Issue 9



## Results

Development Name: Centre Point - Intrepid Fox

Dwelling Description: Both Options

Name of Company: Grontmij

Code Assessor's Name: David Partington

Company Address:

Notes/Comments:

The pre-assessment score combines credits that are mandatory as well as "tradable" credits that are typically achieved with little effort. All apartments will require a Code level 4 certificate. Some apartments may achieve credits currently not targeted but have not been applied as a worse case scenario.

## PREDICTED RATING - CODE LEVEL: 4


Mandatory Requirements: All Levels

% Points: 68.70% - Code Level: 4


Breakdown: Energy - Code Level: 4

Water - Code Level: 4

Graph 1: Predicted contribution of individual sections to the total score and percentage of total achievable score

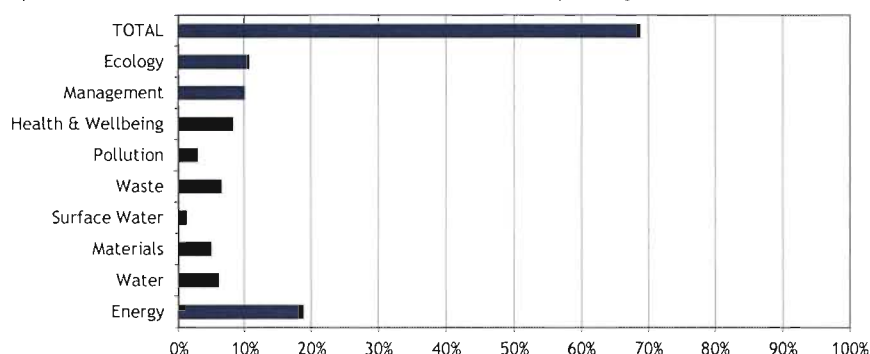

Graph 2: Predicted percentage of credits achievable: Total and by Category

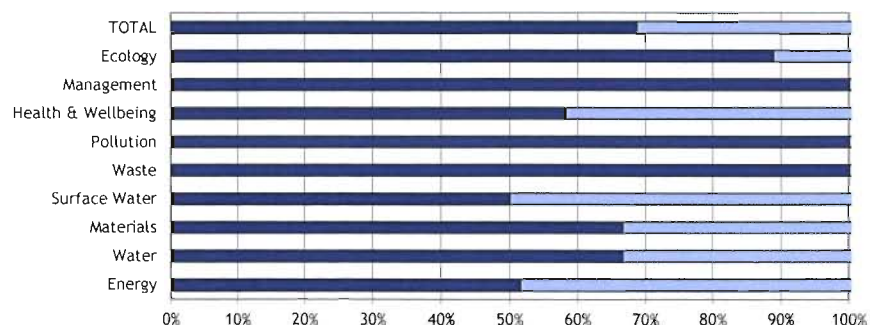

NOTE: The rating obtained by using this Pre Assessment Estimator is for guidance only. Predicted ratings may differ from those obtained through a formal assessment, which must be carried out by a licensed Code assessor.



CATEGORY 1 ENERGY		Overall Level: 4	Overall Score	68.70	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 51.61			Credits	Level		
Contribution to Overall % Score: 18.78 points			16.0 of 31 Credits	Level 4		
Ene 1 Dwelling Emission Rate	<p>Credits are awarded based on the percentage improvement of the Dwelling Emission Rate (DER) over the Target Emission Rate (TER) as calculated using SAP 2009. Minimum standards for each Code level apply. The Code energy calculator can be used to calculate a predicted score.</p> <div><div>Enter the predicted score _____</div><div>What is the predicted number of credits? <input type="text" value="3.0"/></div><div>OR Are zero net CO<sub>2</sub> emissions achieved? <input type="checkbox"/></div></div>	3.0 of 10 Credits	Level 4	Achievement of 25% reduction below Part L1A:2010 building regs is mandatory. Development incorporates central CHP system.		
Ene 2 Fabric Energy Efficiency	<p>Credits are awarded based on the Fabric Energy Efficiency (kWh/m<sup>2</sup>/yr) of the dwelling. Minimum standards apply at Code levels 5 and 6. The Code energy calculator can be used to calculate a predicted score.</p> <div><div>Enter the predicted score _____</div><div>Apartments, Mid-terrace <input checked="" type="radio"/></div><div>OR End terrace, Semi and Detached <input type="radio"/></div><div>OR Staggered Mid terrace <input type="radio"/></div><div>What is the predicted number of credits? <input type="text" value="3.0"/></div></div>	3.0 of 9 Credits	-	Apartment u-values would need to be significantly better than Part L 2010 limiting values. Credits assumed.		
Ene 3 Energy Display Devices	<p>Credits are awarded where a correctly specified Energy Display Device is installed monitoring electricity and/or primary heating fuel consumption.</p> <div><div>Select whether the EDD monitors electricity and/or fuel _____</div><div>None Specified <input type="radio"/></div><div>Primary Heating only <input type="radio"/></div><div>OR Electricity only <input type="radio"/></div><div>OR Electricity and primary heating fuel <input checked="" type="radio"/></div></div>	2 of 2 Credits	-	Appropriate Energy Display Device/s could be installed.		

Issue		Credits	Level	Assumptions Made	Evidence Required
Ene 4 Drying Space	<p>One credit is awarded for the provision of either internal or external secure drying space with posts and footings or fixings capable of holding 4m+ of drying line for 1-2 bed dwellings and 6m+ for dwellings with 3 bedrooms or greater.</p> <p>Will drying space meeting the criteria be provided? —————</p> <p>Yes <input checked="" type="radio"/></p> <p>OR No <input type="radio"/></p>	1 of 1 Credits	-	Appropriate drying fixings could be incorporated into bathroom design for required length of drying line. Bathrooms extract ventilation to be at least 30l/s.	
Ene 5 Energy Labelled White Goods	<p>Credits are awarded where each dwelling is provided with either information about the EU Energy Labelling Scheme, White Goods with ratings ranging from A+ to B or a combination of the previous according to the technical guide.</p> <p>Select the appropriate option below —————</p> <p>EU Energy labelling information <u>only</u> <input type="checkbox"/></p> <p>A+ rated appliances <input checked="" type="checkbox"/></p> <p>A rated washing machine and dishwasher <input checked="" type="checkbox"/></p> <p>B rated tumble dryer or washer dryer <input type="checkbox"/></p> <p>EU Energy labelling information provided <input checked="" type="checkbox"/></p>	2 of 2 Credits	-	All white goods need to be provided with required EU energy efficiency ratings.	
Ene 6 External Lighting	<p>Credits are awarded based on the provision of space lighting* with dedicated energy efficient fittings and security lighting fittings with appropriate control gear..</p> <p>Space Lighting —————</p> <p>None provided <input type="radio"/></p> <p>OR Non Code compliant lighting <input type="radio"/></p> <p>OR Code compliant lighting <input checked="" type="radio"/></p> <p>Security Lighting —————</p> <p>None provided <input type="radio"/></p> <p>OR Non Code compliant lighting <input type="radio"/></p> <p>OR Code compliant lighting and controls <input checked="" type="radio"/></p> <p>Dual lamp luminaires —————</p> <p>Compliant with both above criteria <input type="checkbox"/></p> <p>* Statutory safety lighting is not covered by this requirement</p>	2 of 2 Credits	-	Space and security lighting to be Code compliant.	

Issue		Credits	Level	Assumptions Made	Evidence Required
Ene 7 Low or Zero Carbon Technologies	<p>Credits are awarded where there is a 10% or 15% reduction in CO<sub>2</sub> emissions resulting from the use of low or zero carbon technologies.</p> <div> <p>Select % contribution made by low or zero carbon technologies</p> <div> <p>Less than 10% of demand <input type="radio"/></p> <p>OR 10% of demand or greater <input checked="" type="radio"/></p> <p>OR 15% of demand or greater <input type="radio"/></p> </div> </div>	1 of 2 Credits	-	Some apartments may achieve 2 credits	
Ene 8 Cycle Storage	<p>Credits are awarded where adequate, safe, secure and weather proof cycle storage is provided according to the Code requirements.</p> <div> <p>Fill in the development details below</p> <div> <p>Number of bedrooms: <input type="text" value="1"/></p> <p>Number of cycles stored per dwelling* <input type="text" value="0.5"/></p> </div> </div> <p>* if you have storage for 1 cycle per two dwellings insert 0.5 in number of cycles stored per dwelling</p>	1 of 2 Credits	-	One credit requires one space for every two 1-bed apartments, 1 space per 2 or 3-bed apartment and 2 spaces for every 4+ bed apartment. Two credits require one space for every 1-bed apartments, 2 spaces per 2 or 3-bed apartment and 4 spaces for every 4+ bed apartment.	
Ene 9 Home Office	<p>A credit is awarded for the provision of a home office. The location, space and services provided must meet the Code requirements.</p> <div> <p>Will there be provision for a Home Office? <input checked="" type="radio"/></p> <p>OR No <input type="radio"/></p> </div>	1 of 1 Credits	-	A suitable room with a window to be provided with two double power sockets, double telephone socket (or broadband) and sufficient space for a desk & chair and book case. For 1 and 2-bed apartments could be the living room unless open plan with the kitchen, for larger apartments cannot be the living room. Room must still be able to function for its original purpose. Room requires average daylight factor of 1.5%	

CATEGORY 2 WATER		Overall Level: 4		Overall Score 68.70		Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 66.66		Credits		Level			
Contribution to Overall Score: 6.00 points		4 of 6 Credits		Level 4			
Wat 1 Indoor Water Use	<p>Credits are awarded based on the predicted average household water consumption, calculated using the Code Water Calculator Tool. Minimum standards for each code level apply.</p> <div><p>Select the predicted water use / Mandatory Requirement</p><p>greater than 120 litres/ person/ day <input type="radio"/></p><p>OR ≤ less than 120 litres/ person/ day <input type="radio"/></p><p>OR ≤ less than 110 litres/ person/ day <input type="radio"/></p><p>OR ≤ less than 105 litres/ person/ day <input checked="" type="radio"/></p><p>OR ≤ less than 90 litres/ person/ day <input type="radio"/></p><p>OR ≤ less than 80 litres/ person/ day <input type="radio"/></p></div>	3 of 5 Credits	Level 3 AND Level 4	Apartments to be provided with required combination of low flow water fittings/devices and maybe grey water recycling systems. Minimum of 3 credits is a mandatory requirement.			
Wat 2 External Water Use	<p>A credit is awarded where a compliant system is specified for collecting rainwater for external irrigation purposes. Where no outdoor space is provided the credit can be achieved by default.</p> <div><p>Select the scenario that applies</p><p>No internal or communal outdoor space <input type="radio"/></p><p>OR Outdoor space with collection system <input checked="" type="radio"/></p><p>OR Outdoor space without collection system <input type="radio"/></p></div>	1 of 1 Credits	-	No individual or communal garden space or if only balconies are provided, the credit can be awarded by default otherwise a water butt up to 200L in volume is required.			

CATEGORY 3 MATERIALS		Overall Level: 4	Overall Score 68.70		
% of Section Credits Predicted: 66.66		Credits		Level	
Contribution to Overall Score: 4.80 points		16 of 24 Credits		All Levels	
				Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
Mat 1 Environmental Impact of Materials	<p><b>Mandatory Requirement:</b> At least three of the five key building elements must achieve a Green Guide 2008 Rating of A+ to D.</p> <p><b>Tradable Credits:</b> Points are awarded on a scale based on the Green Guide Rating of the specifications. The Code Materials Calculator can be used to predict a potential score.</p> <p>Enter the predicted Score</p> <p>Will the mandatory requirement be met? <input checked="" type="checkbox"/></p> <p>Enter the predicted score</p> <p>What is the predicted number of credits? <input type="text" value="10"/></p>	10 of 15 Credits	All Levels	<p>Roof, External walls, Internal walls, Upper &amp; Ground floors and Staircase: at least 3 of these elements require a minimum Green Guide rating of D.</p> <p>The area of each element and its Green guide rating is required.</p> <p>10 credits equate to all elements being A rated. 15 credits equate to all elements being A+ rated.</p>	
Mat 2 Responsible Sourcing of Materials - Basic Building Elements	<p>Credits are awarded where materials used in the basic building elements are responsibly sourced. The Code Materials Calculator can be used to predict a potential score.</p> <p>Enter the predicted Score</p> <p>What is the predicted number of credits? <input type="text" value="4"/></p>	4 of 6 Credits	-	<p>80% of the frame, ground floor, upper floors, roof, external &amp; internal walls, foundations/substructure and staircase would need to be sourced from suppliers with Environmental Management Systems such as ISO 14001. 100% of timber must be legally sourced.</p>	
Mat 3 Responsible Sourcing of Materials - Finishing Elements	<p>Credits are awarded where materials used in the finishing elements are responsibly sourced. The Code Materials Calculator can be used to predict a potential score.</p> <p>Enter the predicted Score</p> <p>What is the predicted number of credits? <input type="text" value="2"/></p>	2 of 3 Credits	-	<p>As above but usually easier as most finishing elements are timber based. Requires input from the team.</p>	

CATEGORY 4 SURFACE WATER RUN-OFF		Overall Level: 4	Overall Score 68.70		
% of Section Credits Predicted: 50.00%		Credits	Level		
Contribution to Overall Score: 1.10 points		2 of 4 Credits	All Levels		
				Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
Sur 1 Management of Surface Water Run-off from developments	<p><b>Mandatory Requirement:</b> Peak rate of run-off into watercourses is no greater for the developed site than it was for the pre-development site and that the additional predicted volume of rainwater discharge caused by the new development is entirely reduced as far as possible in accordance with the assessment criteria. Designing the drainage system to be able to cope with local drainage system failure. <b>Tradable Credits:</b> Where SUDS are used to improve water quality of the rainwater discharged or for protecting the quality of the receiving waters.</p> <div> Mandatory Requirement <div>Will the mandatory requirement be met? <input checked="" type="checkbox"/></div> </div> <div> Select the appropriate option <div> No SUDS <input type="checkbox"/>  No runoff into watercourses for the first 5 mm of rainfall <input type="checkbox"/>  Runoff from hard surfaces will receive an appropriate level of treatment <input type="checkbox"/> </div> </div>	0 of 2 Credits	All Levels	<p>Mandatory requirement that peak run off rate &amp; volume of run off are not increased.</p> <p>Typically difficult to achieve attenuation or SUDS treatment of any water collected on site.</p> <p>No credits assumed.</p>	
Sur 2 Flood Risk	<p>Credits are awarded where developments are located in areas of low flood risk or where in areas of medium or high flood risk appropriate measures are taken to prevent damage to the property and its contents in accordance with the Code criteria in the technical guide.</p> <div> Select the annual probability of flooding (from PPS25*) <div> Zone 1 - Low <input checked="" type="radio"/>  OR Zone 2 - Medium <input type="radio"/>  OR Zone 3 - High <input type="radio"/> </div> </div> <div> Select the appropriate option(s) <div> Low risk of flooding from FRA** <input checked="" type="checkbox"/>  All measures of protection are demonstrated in FRA <input type="checkbox"/>  Ground floor level and access routes are 600 mm above design flood level <input type="checkbox"/> </div> </div> <p>* Planning Policy Statement 25 - Planning and Flood Risk ** FRA - Flood Risk Assessment</p>	2 of 2 Credits	-	<p>Centre Point development situated in zone 1 as defined by PPS25 development.</p>	

CATEGORY 5 WASTE		Overall Level: 4	Overall Score 68.70		
% of Section Credits Predicted: 100.00%		Credits	Level	Assumptions Made	
Contribution to Overall Score: 6.40 points		8 of 8 Credits	All Levels	Evidence Required (The below cells can be formatted by assessors if required.)	
Was 1 Storage of non-recyclable waste and recyclable household waste	<p><b>Mandatory Requirement:</b> The space provided for waste storage should be sized to hold the larger of either all external containers provided by the Local Authority or the min capacity calculated from BS 5906. <u>Tradable Credits</u> are awarded for adequate internal and/ or external recycling facilities.</p> <div><div>Mandatory Requirement</div><div>Will the minimum space be provided and be accessible to disabled people?<input checked="" type="checkbox"/></div></div> <div><div>Internal Recyclable household waste storage</div><div>Where there is no external recyclable waste storage and no Local Authority collection scheme</div><div>Internal storage (capacity 60 litres)<input type="checkbox"/></div></div> <div><div>Local Authority collection Scheme</div><div>Post Collection sorting</div><div>Internal storage (capacity 30 litres)<input checked="" type="checkbox"/></div><div>Pre-collection sorting</div><div>Internal storage (3 separate bins, capacity 30 litres)<input type="checkbox"/></div></div> <div><div>External Storage, no Local Authority collection scheme</div><div>3 separate internal storage bins (capacity 30 litres)<input type="checkbox"/></div><div>AND</div><div>Houses</div><div>External Storage(capacity 180 litres)<input type="checkbox"/></div><div>Flats</div><div>Private recycling operator<input type="checkbox"/></div><div>3 or greater types of waste collected<input type="checkbox"/></div></div>	0 of 2 Credits		The mandatory requirement is relatively straight forward.	Type of dedicated internal recycling bin determined by the type of Local Authority collection scheme.
	4 of 4 Credits	All Levels	Need to comply with some Part M requirements.		
	0 of 4 Credits				



Issue		Credits	Level	Assumptions Made	Evidence Required
Was 2 Construction Site Waste Management	<p>A credit is awarded where a compliant SWMP is provided with targets and procedures to minimise construction waste. Credits are available where the SWMP include procedures and commitments for diverting either 50% or 85% of waste generated from landfill.</p> <div> <p>SWMP details</p> <p>Does the SWMP include:</p> <p>+ No SWMP <input type="radio"/></p> <p>+ SWMP with targets and procedures to minimise waste? <input type="radio"/></p> <p>+ SWMP with procedures to divert 50% of waste <input type="radio"/></p> <p>+ SWMP with procedures to divert 85% of waste <input checked="" type="radio"/></p> </div>	3 of 3 Credits		<p>Any construction project in England costing over £300,000 requires a SWMP.</p> <p>The SWMP must contain target benchmarks &amp; procedures to minimise construction waste.</p>	
Was 3 Composting	<p>A credit is awarded where individual home composting facilities are provided, or where a community/ communal composting service, either run by the Local Authority or overseen by a management plan is in operation.</p> <div> <p>Select the facilities available</p> <p>No composting facilities <input type="radio"/></p> <p>Individual composting facilities <input type="radio"/></p> <p>OR Communal/ community composting*? <input checked="" type="radio"/></p> <p>Local Authority <input checked="" type="checkbox"/></p> <p>OR Private with management plan <input type="checkbox"/></p> </div> <p>* including if an automated waste collection system is in place</p>	1 of 1 Credit	-	Camden run a kitchen waste collection scheme	

CATEGORY 6 POLLUTION		Overall Level: 4	Overall Score	68.70	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 100.00%		Credits	Level			
Contribution to Overall Score: 2.80 points		4 of 4 Credits	All Levels			
Pol 1 Global Warming Potential (GWP) of Insulants	<p>A credit is awarded where <u>all</u> insulating materials only use substances (in manufacture AND installation) that have a GWP of less than 5.</p> <div> <p>Select the most appropriate option</p> <p>All insulants have a GWP less than 5 <input checked="" type="radio"/></p> <p>OR Some insulants have a GWP of less than 5 <input type="radio"/></p> <p>OR No insulants have a GWP of less than 5 <input type="radio"/></p> </div>	1 of 1 Credits	-		Almost standard.	
Pol 2 NOx Emissions	<p>Credits are awarded on the basis of NOx emissions arising from the operation of the space and water heating system within the dwelling.</p> <div> <p>Select the most appropriate option</p> <p>Greater than 100 mg/kWh <input type="radio"/></p> <p>OR Less than 100 mg/kWh <input type="radio"/></p> <p>OR Less than 70 mg/kWh <input type="radio"/></p> <p>OR Less than 40 mg/kWh <input checked="" type="radio"/></p> <p>OR Class 4 boiler <input type="radio"/></p> <p>OR Class 5 boiler <input type="radio"/></p> <p>OR All space and hot water energy requirements are met by systems who do not produce NOx emissions <input type="radio"/></p> </div>	3 of 3 Credits	-		Will depend predominantly on the gas-fired CHP.	

CATEGORY 7 HEALTH & WELLBEING		Overall Level: 4	Overall Score 68.70		
% of Section Credits Predicted: 58.00%		Credits	Level	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
Contribution to Overall Score: 8.16 points		7 of 12 Credits	No level		
Hea 1 Daylighting	<p>Credits are awarded for ensuring key rooms in the dwelling have high daylight factors (DF) and a view of the sky.</p> <div>           Select the compliant areas —           <div> <u>Room</u>            Kitchen: Avg DF of at least 2% <input type="checkbox"/>            Living Room*: Avg DF of at least 1.5% <input type="checkbox"/>            Dining Room*: Avg DF of at least 1.5% <input type="checkbox"/>            Study*: Avg DF of at least 1.5% <input type="checkbox"/>            80% of working plane in all above rooms receive direct light from the sky? <input type="checkbox"/> </div> </div> <p>Any room used for Ene 9 Home Office must also achieve a min DF of 1.5%.</p>	0 of 3 Credits	-	<p>Will require review during detail design stage with the project team. Kitchens are often at the rear of the living room and are difficult to achieve 2% ADF.</p> <p>All rooms within the dwelling must achieve 80% of the view of sky. Penthouses should achieve this.</p> <p>No credits assumed.</p> <p>Calculations would be required.</p>	
Hea 2 Sound Insulation	<p>Credits are awarded where performance standards exceed those required in Building Regulations Part E. This can be demonstrated by carrying out pre-completion testing or through the use of Robust Details Limited.</p> <div>           Select a type of property —           <div>             Detached Property <input type="radio"/>              Attached Properties:              - Separating walls and floors only exist between non habitable spaces <input type="radio"/>              - Separating walls and floors exist between habitable spaces <input checked="" type="radio"/> </div> </div> <div>           Select a performance standard —           <div>             Performance standard not sought <input type="radio"/>              Airborne: 3db higher; Impact: 3dB lower <input type="radio"/>              OR Airborne: 5db higher; Impact: 5dB lower <input checked="" type="radio"/>              OR Airborne: 8db higher; Impact: 8dB lower <input type="radio"/> </div> </div>	3 of 4 Credits	-	<p>Assume airborne sound insulation values 5dB higher than Part E. Impact sound insulation values 5dB lower than Part E</p>	

Issue		Credits	Level	Assumptions Made	Evidence Required
Hea 3 Private Space	<p>A credit is awarded for the provision of an outdoor space that is at least partially private. The space must allow easy access to all occupants.</p> <div> <p>Will a private/ semi-private space be provided? _____</p> <p>Yes, private/semi-private space will be provided <input type="radio"/></p> <p>OR No private/semi-private space <input checked="" type="radio"/></p> </div>	0 of 1 Credits	-	<p>Each apartment needs at least 1.5m<sup>2</sup> / bedroom of private space to claim the credit.</p> <p>Worse case - no credits assumed.</p>	
Hea 4 Lifetime Homes	<p><u>Mandatory Requirement:</u> Lifetime Homes is mandatory when a dwelling is to achieve Code Level 6.</p> <p><u>Tradable credits:</u> Credits are awarded where the developer has implemented all of the principles of the Lifetime Homes scheme.</p> <div> <p>Mandatory Requirement _____</p> <p>Dwelling to achieve Code Level 6? <input type="checkbox"/></p> </div> <div> <p>Lifetime Homes Compliance _____</p> <p>All Lifetime Homes criteria will be met <input checked="" type="radio"/></p> <p>OR Exemption from LTH criteria 2/3 applied <input type="radio"/></p> <p>Credit not sought <input type="radio"/></p> </div>	4 of 4 Credits	No level	<p>Each dwelling has to comply with all 16 design criteria within Lifetime Homes to gain the 4 credits.</p> <p>Assume there is a requirement to implement with affordable housing.</p>	

CATEGORY 8 MANAGEMENT		Overall Level: 4	Overall Score 68.70	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 100.00%		Credits	Level		
Contribution to Overall Score: 10.00 points		9 of 9 Credits	All Levels		
Man 1 Home User Guide	<p>Credits are awarded where a simple guide is provided to each dwelling covering information relevant to the 'non-technical' home occupier, in accordance with the Code requirements.</p> <div><p>Tick the topics covered by the Home User Guide</p><div><p>Operational Issues? <input checked="" type="checkbox"/></p><p>Site and Surroundings? <input checked="" type="checkbox"/></p><p>Is available in alternative formats? <input checked="" type="checkbox"/></p></div></div>	3 of 3 Credits	-	<p>Needs input from all of design team.</p> <p>Requires a procedure whereby the home owner can obtain the User Guide in a different format such as foreign language / large print / Braille etc.</p>	
Man 2 Considerate Constructors Scheme	<p>Credits are awarded where there is a commitment to comply with best practice site management principles using either the Considerate Constructors Scheme or an alternative locally/ nationally recognised scheme.</p> <div><p>Select the appropriate scheme and score</p><div><p>No scheme used <input type="radio"/></p><p><u>Considerate Constructors</u></p><p>OR Best Practice: Score between 24 and 31.5 <input type="radio"/></p><p>OR Best Practice+: Score between 32 and 40 <input checked="" type="radio"/></p><p><u>Alternative Scheme*</u></p><p>OR Mandatory + 50% optional requirements <input type="radio"/></p><p>OR Mandatory + 80% optional requirements <input type="radio"/></p></div></div> <p>* In the first instance, contact a Code Service Provider if you are considering to use an alternative scheme.</p>	2 of 2 Credits	-	<p>CCS scheme has now changed.</p> <p>A minimum score of 35 out of 50 with a minimum score of 7 in each category is required to achieve 2 credits.</p>	
Man 3 Construction Site Impacts	<p>Credits are awarded where there is a commitment and strategy to operate site management procedures on site as following:</p> <div><p>Tick the Impacts that will be addressed</p><div><p><u>Monitor, report and set targets, where applicable, for:</u></p><p>- CO<sub>2</sub>/ energy use from site activities <input checked="" type="checkbox"/></p><p>- CO<sub>2</sub>/ energy use from site related transport <input type="checkbox"/></p><p>- water consumption from site activities <input checked="" type="checkbox"/></p><p><u>Adopt best practice policies in respect of:</u></p><p>- air (dust) pollution from site activities <input checked="" type="checkbox"/></p><p>- water (ground and surface) pollution on site <input type="checkbox"/></p><p><u>80% of site timber</u> is reclaimed, re-used or responsibly sourced <input checked="" type="checkbox"/></p></div></div>	2 of 2 Credits	-	<p>This is becoming standard. Have assumed 4 of the impacts will be monitored to achieve 2 credits. Which 4 to be decided.</p>	

Issue	Credits	Level	Assumptions Made	Evidence Required
Man 4 Security	<p>Credits are awarded for complying with Section 2 - Physical Security from Secured by Design - New Homes. An Architectural Liaison Officer (ALO), or alternative, needs to be appointed early in the design process and their recommendations incorporated.</p> <div data-bbox="280 379 763 475"> <p>Secured by Design Compliance _____</p> <p>Credit not sought <input type="radio"/></p> <p>OR Secured by Design Section 2 Compliance <input checked="" type="radio"/></p> </div>	<p>2 of 2 Credits</p>	<p>-</p>	<p>Assume at least section 2 of SBD will be achieved unless formal certification is required.</p>

CATEGORY 9 ECOLOGY		Overall Level: 4	Overall Score	68.70	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 88.00%			Credits	Level		
Contribution to Overall Score: 10.66 points			8 of 9 Credits	All Levels		
Eco 1 Ecological Value of Site	<p>One credit is awarded for developing land of inherently low value.</p> <p>Select the appropriate option</p> <p>Credit not sought <input type="radio"/></p> <p>OR Land has ecological value <input type="radio"/></p> <p>OR Land has low/ insignificant ecological value* <input checked="" type="radio"/></p> <p>* Low ecological value is determined either a) by using Checklist Eco 1 across the whole development site; or b) where a suitably qualified ecologist is appointed and can confirm or c) produces an independent ecological report of the site, that the construction zone is of low/ insignificant value; AND the rest of the development site will remain undisturbed by the works.</p>	1 of 1 Credits	-	Ecologist already appointed. Confirmed site is of low ecological value. May require another visit?		
Eco 2 Ecological Enhancement	<p>A credit is awarded where there is a commitment to enhance the ecological value of the development site.</p> <p>Tick the appropriate boxes</p> <p>Will a <i>Suitably Qualified Ecologist</i> be appointed to recommend appropriate ecological features? <input checked="" type="checkbox"/></p> <p>AND Will all key recommendations be adopted? <input checked="" type="checkbox"/></p> <p>AND 30% of other recommendations be adopted? <input checked="" type="checkbox"/></p>	1 of 1 Credits	-	Ecologist appointed		
Eco 3 Protection of Ecological Features	<p>A credit is awarded where there is a commitment to maintain and adequately protect features of ecological value.</p> <p>Type and protection of existing features</p> <p>Site with features of ecological value? <input type="radio"/></p> <p>OR Site of low ecological value (as Eco 1)? <input type="radio"/></p> <p>AND All* existing features potentially affected by site works are maintained and adequately protected? <input type="checkbox"/></p> <p>*If a suitably qualified ecologist has confirmed that a feature can be removed due to insignificant ecological value or poor health conditions, as long as the rest have been protected, then this box can be ticked.</p>	1 of 1 Credits	-	Ecologist appointed - nothing to protect.		
Issue		Credits	Level	Assumptions Made	Evidence Required	
Eco 4 Change of Ecological Value of Site	<p>Credits are awarded where the change in ecological value has been calculated in accordance with the Code requirements and is calculated to be:</p> <p>Change in Ecological Value</p> <p>Major negative change: fewer than -9 <input type="radio"/></p> <p>Minor negative change: between -9 and -3 <input type="radio"/></p> <p>OR Neutral: between -3 and +3 <input type="radio"/></p> <p>Minor enhancement: between +3 and +9 <input checked="" type="radio"/></p> <p>Major enhancement: greater than 9 <input type="radio"/></p>	3 of 4 Credits	-	A neutral effect on site ecology achieves 2 credits. Assumed will achieve an extra point for an increase of 3 species per hectare after development.		
Eco 5 Building Footprint	<p>Credits are awarded where the ratio of combined floor area of all dwellings on the site to their footprint is:</p> <p>Ratio of Net Internal Floor Area: Net Internal Ground Floor Area</p> <p>Credit Not Sought <input type="radio"/></p> <p>OR Houses: 2.5:1 OR Flats: 3:1 <input type="radio"/></p> <p>OR Houses: 3:1 OR Flats: 4:1 <input checked="" type="radio"/></p> <p>OR Houses &amp; Flats Weighted (2.5:1 &amp; 3:1) <input type="radio"/></p> <p>OR Houses &amp; Flats Weighted (3:1 &amp; 4:1) <input type="radio"/></p>	2 of 2 Credits		The advantage of high-rise!		



# Appendices

## Appendix B - BREEAM (Domestic Refurbishment)

106610/LA/120207 Issue 9

Centre Point		BREEAM Domestic Refurbishment 2012				
Category	Predicted Credits	Points after weighting	Available Credits	Issue	Title	Weighting Factor %
Energy	3		6	Improvement in Energy efficiency rating	Ene 01	43
						(1.48)
	3.5		4	Energy efficiency post refurbishment (M) (Need 2.5 for Excellent)	Ene 02	
	7		7	Primary energy demand	Ene 03	
	0		1	Drying Space	Ene 06	
	0		2	Renewable Technologies	Ene 04	
	2		2	Energy Labelled White Goods	Ene 05	
	1		2	Lighting	Ene 07	
	2		2	Energy Display Device	Ene 08	
	1		2	Cycle Storage	Ene 09	
	0		1	Home Office	Ene 10	
	19.5	28.91	29	Category 1 Totals		
Water	2		3	Internal Water Use (M) (Need 2 for Excellent)	Wat 01	11
	0		1	External Water Use	Wat 02	(2.2)
	1		1	Water Meter	Wat 03	
	3	6.60	5	Category 2 Totals		
Materials	18		25	Environmental Impact of materials	Mat 01	8
	8		12	Responsible sourcing of materials: Basic Elements (M)	Mat 02	(0.178)
	5		8	Insulation	Mat 03	
	31	5.51	45	Category 3 Totals		
Waste	1		2	Household Waste	Was 01	3
	2		3	Refurbishment Site Waste Management	Was 02	(0.60)
	3	1.80	5	Category 4 Totals		
Pollution						6
	0		3	Nitrogen Oxide Emissions	Pol 01	(0.75)
	2		3	Surface Water Runoff	Pol 02	
	2		2	Flooding (M) (Need 2 for Excellent)	Pol 03	
	4	3.00	8	Category 5 Totals		
Health & Wellbeing	0		2	Daylighting	Hea 01	17
	3		4	Sound Insulation	Hea 02	(1.42)
	0		1	Volatile Organic Compounds	Hea 03	
	2		2	Inclusive Design	Hea 04	
	2		2	Ventilation (M) (Need 1 for Excellent)	Hea 05	
	1		1	Safety (Need 1 for Excellent)	Hea 06	
	8	11.33	12	Category 6 Totals		
Management	3		3	Home User Guide	Man 01	12
						(1.09)
	2		2	Responsible Construction Practices	Man 02	
	1		1	Construction Site Impacts	Man 03	
	2		2	Security	Man 04	
	1		1	Protection & Enhancement of Ecological Features	Man 05	
	2		2	Project Management	Man 06	
	11	12.00	11	Category 7 Totals		
Innovation				1 Responsible Construction Practices	Man 02	Innovation
				1 Protection & Enhancement of Ecological Features	Man 05	
				1 Inclusive Design	Hea 04	
	0	0.00	4	1 Surface Water Runoff	Poi 02	
				Category 8 Totals		
Innovation	4		10	Innovation	Inn 01	10
	79.5	73.16	Assessment Totals			
(M) denotes issues with n LEVEL Excellent						

BREEAM:  
 Pass - 30  
 Good - 45  
 Very Good - 55  
 Excellent - 70  
 Outstanding - 85

# Appendices

## Appendix C - BREEAM (Retail)

106610/LA/120207 Issue 9

## Centre Point BREEAM NC 2011 (Pre-Assessment) RETAIL

Shell & Core Assessment  
Result 62.31% VERY GOOD  
+ Innovation Credits 64.31% VERY GOOD


BRE deems credit compliance influenced by fit-out spec /  
lease agreement with the incoming tenant



## Principal Action / Responsibility

## Principal Contractor

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought		Shopping List	Unlikely	% Each Credit Worth to Overall Score
Man 01	1	Sustainable Procurement	Principal Contractor to be appointed to undertake a thermographic survey of completed building and any defects uncovered are to be remediated	✓	1		0	0.545%
Man 02	2	Responsible Construction Practices	Will the Principal Contractor commit to achieving certification under the Considerate Constructors Scheme, And Score >12 points	✓	2		0	
Man 03	5	Construction Site Impacts	Site energy and water consumption to be metered/monitored	✓	5	0		
			Transport of construction materials and waste to/from site to be measured/monitored	✓				
			Timber to be sourced in accordance with the Government's Timber Procurement Policy	✓				
			Principal Contractor should operate a compliance Environmental Management System	✓				
The Principal Contractor should adopt best practice pollution prevention policies and procedures			✓					
Mat 03	3	Responsible Sourcing	Specification of responsibly sourced materials for key building elements	✓	2	✓	1	1.04%
Mat 04	1	Insulation	All building insulating materials to be responsibly sourced	✓	1		0	1.15%
Wst 01	4	Construction Waste Management	Resource efficiency via effective management and reduction of construction waste	✓	3	X	0	
TOTALS				11.24%		1.04%		

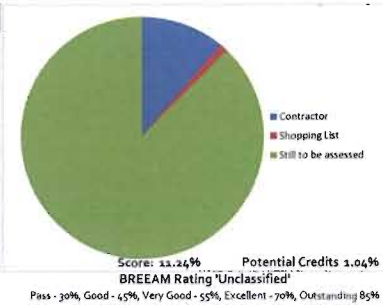

## Principal Action / Responsibility


## Structural Engineer

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought	Shopping List	Unlikely	% Each Credit Worth to Overall Score
Wst 02	1	Recycled Aggregates	Specification of recycled and secondary aggregates, reducing the demand for virgin materials. >15% by weight or volume of the total high-grade aggregate specified for the development	✗	1	0	1.04%
TOTALS				1.04%	0.00%		

## Principal Action / Responsibility

## Ecological Consultant / (Client)

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought		Shopping List	Unlikely	% Each Credit Worth to Overall Score
LE 01	2	Site Selection	Ecologist confirms that at least 75% of the proposed development's footprint will be located on previously developed land	✓	1		0	1.00%
LE 02	1	Ecological Value of the Site & Protection of Ecological Features	Confirmation that the site was deemed significantly contaminated	✗	0		0	
			Ecologist confirms that the land is defined as 'land of low ecological value'	✓	1	0		
			Ecologist & client confirm that all features of ecological value surrounding the construction zone / site boundary are suitably protected	✓	1	0		
LE 03	2	Mitigating Ecological Impact	Ecologist confirms that there has been no negative change or improvement in plant species richness due to the development	✓	1	0		
LE 04	1	Enhancing Site Ecology	Confirmation that a suitably qualified Ecologist is appointed					
			Confirmation from the client that the ecologist's recommendations are implemented	✓	1	1		
			Confirmation that the ecological value of the site has increased. >6 species gain Credits. <60% Species loss Credits	✓				
LE 05	2	Long Term Impact on Biodiversity	Ecologist confirms that all relevant UK and EU legislation relating to protection and enhancement of ecology has been complied with during the design and construction process	✓	2	0		
			A landscape and habitat management plan, appropriate to the site, is produced covering at least the first five years after project completion. This should be handed to the building occupants and includes: Management of any protected features on site. Management of any new, existing or enhanced habitats. A reference to the current of future site level or local Biodiversity Action Plan.	✓		0		
			TOTALS				8.00%	1.00%

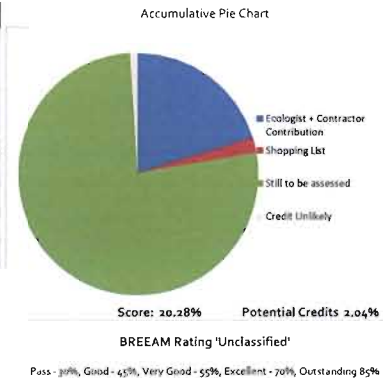


Principal Action / Responsibility  
Services Consultant

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credits Sought	Shopping List	Unlikely	% Each Credit Worth to Overall Score
Hea 01	2	Visual Comfort	Confirmation that daylighting, views out, internal blinds and internal lighting is in compliance with BREEAM requirements	x	0	✓	2
Hea 02	2	Indoor Air Quality	Production of an air quality plan & confirmation of air intake and exhaust locations which should be further than BRE stated criteria	x	0	✓	2
Hea 03	2	Thermal Comfort	Confirmation that the occupier spaces have a degree of operable windows to provide adequate natural ventilation in accordance with CIBSE guidelines	x	0	✓	2
Hea 04	2	Water Quality	Confirmation that dynamic thermal modelling will be carried out	✓	2		0
Hea 05	2	Water Quality	Confirmation that the modelling will inform the development of a thermal zoning and control strategy	✓	2		0
Hea 06	2	Water Quality	Confirmation that all water systems be design to comply with the relevant HSE Approved Code of Practice and Guidance. If humidifying, failure humidification specified. Wholesome supply of accessible clean and fresh drinking water to be available for the building user	✓	2		0
Enr 01	15	Reduction of CO <sub>2</sub> Emissions	Dynamic Thermal Modelling results using approved software to indicate a 1% reduction against the national building Target Emission Rate	✓	6		0
Enr 02	2	Energy Monitoring	Confirmation that a BMS or sub-meters be specified to monitor energy use from major building services systems	✓	2		0
Enr 03	5	Low and Zero Carbon Technology	Confirmation of a feasibility study into renewable & low carbon technologies	✓	5		0
Enr 04	5	Low and Zero Carbon Technology	Confirmation of the percentage of carbon reduced due to renewable and/or low carbon technologies	✓	5		0
Enr 05	5	Low and Zero Carbon Technology	1 Credits = 20% reduction	✓	5		0
Enr 06	5	Low and Zero Carbon Technology	2 Credits = 40% reduction	✓	5		0
Enr 07	5	Low and Zero Carbon Technology	3 Credits = 60% reduction (Innovative Credit)	✓	5		0
Enr 08	5	Low and Zero Carbon Technology	Exemplary level = 80% reduction (Innovative Credit)	✓	5		0
Enr 09	5	Low and Zero Carbon Technology	Confirmation of the adoption of 'Free Cooling' technology	✓	5		0
Enr 10	2	Energy Efficient Transportation Systems	Confirmation that a transportation system analysis has been carried out to optimise number and size of lifts. Also that energy efficient features proposed under the BREEAM criteria have been adopted (e.g. Regenerative Unit, PIRs)	✓	2		0
Wat 01	5	Water Consumption	Confirmation of any rainwater harvesting or grey water recycling	✓	2	✓	3
Wat 02	2	Water Monitoring	Water efficient fittings to be agreed with architect	✓	2		0
Wat 03	2	Water Monitoring	Confirmation that there will be a water meter installed on the mains water supply to the building. Metering to be included to relevant plant items. The water meters to have a pulse output and be connected to the BMS	✓	2		0
Wat 04	2	Water Monitoring	Sanitary supply shut off valves to all toilets	✓	2		0
Wat 05	2	Water Leak Detection	Confirmation that a mains water leak detection system be installed on the building's water supply	✓	2		0
Wat 06	2	Water Efficient Equipment	Confirmation that irrigation for ecology will be via rainwater harvesting	✓	2		0
Pol 01	2	Impact of Refrigerants	Confirmation that the refrigerant specified will have a global warming potential of less than 50	x	0		✓
Pol 02	2	Impact of Refrigerants	State the target range of Direct Effect Life Cycle CO <sub>2</sub> eq. emissions	x	0		✓
Pol 03	2	Impact of Refrigerants	Will a suitable refrigerant leak detection system and containment system be specified	✓	2		✓
Pol 04	2	NDx Emissions	Calculate the target/maximum Nox emission level for the space heating/cooling system	x	2		✓
Pol 05	2	NDx Emissions	Calculate the target/maximum Nox emission level for the water heating system	x	2		✓
Pol 06	5	Surface Water Run Off	Confirmation that the site is in an area with low annual probability of flooding	✓	5		1
Pol 07	5	Surface Water Run Off	Also, that a compliant flood risk assessment will be carried out	✓	5		1
Pol 08	5	Surface Water Run Off	That the site meets the BREEAM criteria for peak rate surface water run off	✓	5		1
Pol 09	5	Surface Water Run Off	Surface water run off attenuation and/or limiting discharge is designed	✓	5		1
Pol 10	5	Surface Water Run Off	Site has been designed to minimise watercourse pollution	✓	5		1

TOTALS 18.90% 6.78%

Accumulative Pie Chart

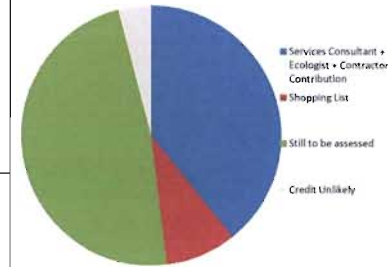

Score: 39.18% Potential Credits 8.82%

BREEAM Rating 'Pass'

Pass - 30%, Good - 45%, Very Good - 55%, Excellent - 70%, Outstanding 85%


## Principal Action / Responsibility

## Architect

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought	Shopping List	Unlikely	% Each Credit Worth to Overall Score
Tran 01	5	Public Transport Accessibility	Site plan with transport node distances from building entrance annotated in metres. Transport node timetables to indicate frequency of service etc..	✓	5	0	0.89%
Tran 02	1	Proximity to Amenities	Marked up site plan highlighting the location and type of amenities. The route to the amenities. Distance travelled to those amenities. The building should have 8 of the following amenities within 500m to award the credit: (Grocery shop or food outlet, Post box, Cash Machine, Pharmacy, GP surgery/medical centre, Leisure/sport centre, Outdoor open public access area, Public house, Community Centre, Place of worship) Architect to provide evidence that the acceptable number of compliant cycle spaces and also compliant facilities will be provided. i.e. showers, changing facilities etc..	✓	1	0	
Tran 03	1	Cyclist Facilities	Architect to provide evidence that the acceptable number of compliant cycle spaces and also compliant facilities will be provided. i.e. showers, changing facilities etc..	✓	0	2	
Tran 04	0	Maximum Car Parking Capacity	Architect to make known the number of car parking facilities being provided by way of drawings or documentation. The number should not exceed a person per 8 businesses.	n/a	0	0	
Mat 01	5	Life Cycle Impacts	Confirmation to be provided of the materials proposed and their embodied impact as defined within the 'Green Guide to Specification'. External walls, windows, roof, upper floor slab construction, internal walls & floor finishes/covers to be assessed.	✓	2	3	1.04%
Mat 02	1	Hard Landscaping and Boundary Protection	Evidence to be provided that greater than or equal to 80% of all external hard landscaping and boundary protection achieve a Green Guide A or A+ rating.	✓	0	0	
Mat 04	1	Insulation	Any new insulation specified for use within external walls, ground floor and roof should generally be an 'A' rated material as defined within the 'Green Guide to Specification'.	✓	1	0	
Mat 05	1	Designing for Robustness	Architect to provide evidence that suitable durability/protection measures have been specified and installed to vulnerable areas of the building.	✓	1	0	
Wst 03	1	Operational Waste	Architect to provide evidence that there is dedicated space (s) to cater for the segregation and storage of operational recyclable waste volumes generated. A minimum of 5m² for buildings <5000m². An additional 5m² per 5000m² of net floor area where catering is provided (with an additional minimum of 5m² for buildings >5000m²).	✓	1	0	1.04%

TOTALS 11.59% 4.91%

Accumulative Pie Chart

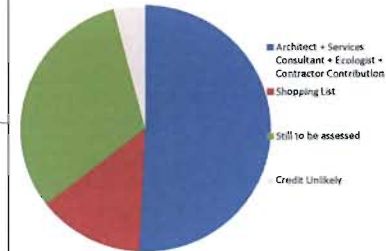

Score: 50.77% Potential Credits 13.73%

BREEAM Rating 'Very Good'

Pass - 30%, Good - 45%, Very Good - 55%, Excellent - 70%, Outstanding 85%


## Principal Action / Responsibility

## Client

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought	Shopping List	Unlikely	% Each Credit Worth to Overall Score
Man 01	5	Sustainable Procurement	The client confirms that from RIBA Stage B (Design Brief) or equivalent the client, building occupier, design team and contractor are involved in contributing to the decision making process for the project. At a minimum this includes meeting to identify and define their roles, responsibilities and contributions during design, construction, Commissioning and handover upto occupation (Stage L). Also confirmation that a schedule of training is identified for relevant building occupiers including the building users guide, clear design strategy, installed system maintenance, operation, replacement and repair and training responsibilities. Appointment of a BREEAM AP from RIBA Stage C through to RIBA Stage L who will attend key client progress meetings. Client appoints a member of the design team to oversee Commissioning. All commissioning is to be carried out in line with current Building Regulations, BSRIA and CIBSE Guidelines.	✓	3	0	0.541%
Man 04	3	Stakeholder Participation	During preparation of the brief, all relevant parties and relevant bodies are identified and consulted with by the design team. (Relevant bodies are - Actual intended building users, representative consultation group from the existing community, existing partnerships and networks that have knowledge and experience from existing buildings of the same type, potential users of any shared facilities e.g. operators of clubs and community groups). A consultation plan should have been prepared and includes a timescale and methods of consultation for all relevant parties/bodies and how the relevant parties will be kept informed about progress. Consultation feedback has been given with suggestions made, including how the results of the consultation process have influenced the proposed design. The project team ensures that through consultation and the resulting measures taken any areas of features of historic/heritage value are protected. Confirmation that the building is designed to be fit for purpose (appropriate and accessible by all potential users. Hence, development of an access statement in line with the CIBSE publication 'Design & Access Statements, How to write, read and use them', based on the principles of inclusive design. Confirmation that a 'Building Users Guide' for the non-technical facilities manager, building staff and users is commissioned.	✓	1	0	
				✓	1	0	
				✓	1	0	
Misc 06	0	Speculative Floor and Ceiling Finishes	Where the future occupant is not known, specify upper floor finishes and ceiling finishes are installed in a show area only.	n/a	0	0	1.07%

TOTALS 3.27% 0.008%

Accumulative Pie Chart

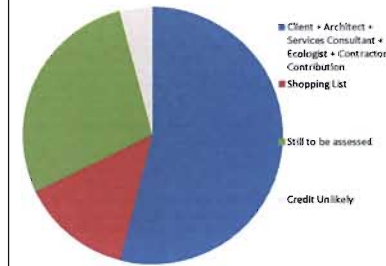

Score: 54.04% Potential Credits 13.73%

BREEAM Rating 'Very Good'

Pass - 30%, Good - 45%, Very Good - 55%, Excellent - 70%, Outstanding 85%




Principal Action / Responsibility  
Specialists / Others

Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought	Shopping List	Unlikely	% Each Credit Worth to Overall Score
Man 05	1	Life Cycle Cost & Service Life Planning (Cost Consultant)	A Life Cycle Cost analysis should be undertaken at Stage C / D A strategic and system level Life Cycle Cost Analysis is undertaken A technical design Life Cycle Cost Analysis is undertaken Stages D / E	✓	3	0	0.545%
Hea 05	2	Acoustic Performance (Acoustic Consultant)	The suitably qualified acoustic consultant needs to provide evidence/calculations which show compliance with the relevant BREEAM criteria Confirmation should be provided which shows compliance with the BREEAM criteria in respect to cycle lane & pedestrian access routes. Compulsory lighting levels to these routes and the designated goods delivery are not directly accessed through general parking areas and do not cross or share pedestrian and cyclist routes	✓	2	0	1.00%
Hea 06	2	Safety and Security (Security Consultant)	Consultation with a suitably qualified security consultant should have taken place at RIBA Stage C. The final design should reflect the recommendations/solutions and built to conform to either, Secured by Design and/or Safer Parking (SP) Scheme External light fittings and controls to be in accordance with BREEAM criteria. Efficacy and either daylight sensing and/or timed control to prevent lighting being on during daylight hours	✗	1	1	0.66%
Enr 03	1	External Lighting (Lighting Specialist)	A feasibility study including a Life Cycle Assessment of the carbon impact of the chosen Low or Zero Carbon system (s) is undertaken accounting for its embodied carbon emissions and operational carbon savings and emissions, and this method of supply results in a reduction in life cycle CO <sub>2</sub> emissions >20%	✓	1	0	0.89%
Enr 04	1	Low & Zero Carbon Technologies	Copy of a compliant transport plan based on site specific travel survey / assessment having been developed	✓	1	0	0.77%
Tri 05	1	Travel Plan (Architect Sub-Consultant)	Confirmation to be provided that external lighting is designed in compliance with the B.E. Guidance notes for the reduction of Obtrusive Light, 2003. Noise impact assessment to be carried out and acoustic consultant recommendations on attenuation measures to be adopted	✓	1	0	0.77%
Pol 04	1	Reduction of Night Time Light Pollution (Lighting Specialist)		✓	1	0	
Pol 05	1	Noise Attenuation (Acoustic Consultant)		✓	1	0	

TOTALS 6.96% 1.00%

Accumulative Pie Chart

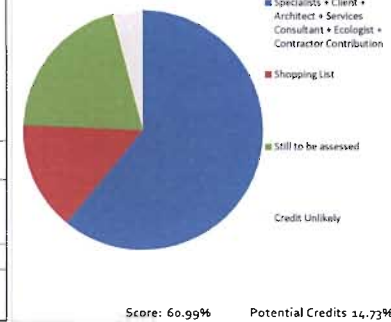

BREEAM Rating 'Very Good'


Pass - 30%, Good - 45%, Very Good - 55%, Excellent - 70%, Outstanding 85%

Principal Action / Responsibility  
Incoming Tenants

Incoming Tenants							% Each Credit Worth to Overall Score	
Credit Ref	No. Credits	Title	Credit Criteria / Question	Credit/s Sought	Shopping List	Unlikely	Tenancy Agreement	Green Building Guide
Man 01	2	Sustainable Procurement	Personal commissioning to be undertaken to ensure that building services systems are operating as designed and at peak efficiencies. Defects to be actioned as found	✗	0	✓	2	0.545%
			Water/energy consumption data to be recorded for at least 12 months after occupation. Analysis against expected design data. Analyse any discrepancies with a view of adjusting systems if not operating as expected/designed. Contract in place to provide aftercare support for the building occupants - Training of key systems. On-site attendance on a weekly basis for at least 4 weeks after handover. Longer term after care e.g. a helpline or nominated individual to support building users for at least the first 12 months of occupation					
			Innovation - Commitment or contract for the facilities manager or equivalent to undertake at quarterly intervals for the first 3 years after occupation					
			- Collect the occupant satisfaction, energy and water consumption data					
			- Use data to check the building is performing as expected, making adjustments as necessary					
Man 04	1	Stakeholder Participation	- Set targets for reducing water and energy consumption and monitor progress	✗	0	✓	0	n/a
			- Feedback any 'lessons learned' to the design team and developer					
Hea 01	1	Visual Comfort	- Provision of the actual annual building energy, water consumption and occupant satisfaction data to the BBE Commitment is made to carry out a Post Occupancy Evaluation one year after building occupation, to gain building performance feedback. This should be carried out by an independent third party	✗	0	✓	2	1.00%
Hea 02	1	Indoor Air Quality	Confirmation that all fluorescent lamps be fitted with high frequency ballasts All internal and external lighting be specified in accordance with the relevant CIBSE Guide/British Standards Internal blinds or curtains be fitted to prevent glare on all facades Confirmation that the relevant products be specified to meet the emission levels for Volatile Organic Compounds	✗	0	✓	2	0.545%
Enr 05	2	Energy Efficient Cold Storage	And that post construction, formaldehyde and total VOC levels are measured Confirmation that the refrigeration system be designed, installed and commissioned in accordance with BREEAM criteria That the refrigeration system demonstrate a saving in indirect greenhouse gas emissions That the refrigeration system be a type described as a 'Future Technology' in the Refrigeration Road Map	✗	0	✓	2	0.66%
Enr 08	1	Energy Efficient Equipment	Confirmation that fridges (white goods) are all recommended by the Energy Savings Trust website Confirmation where a kitchen and catering facilities has incorporated at least one energy efficiency measure outlined in each of the following sections of CIBSE Guide TM19, Sections 8.9, 11.14, 11.15, 11.16, 11.17	✗	2	✓	0	0.35%

TOTALS 1.32% 3.38%

Accumulative Pie Chart

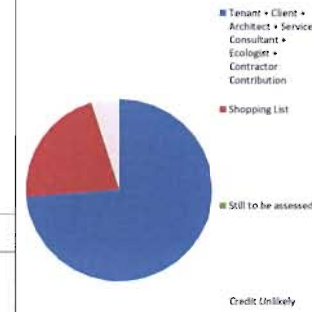

BREEAM Rating 'Very Good'

Note: Excellent can be sought if 'Incoming Tenant' commits to certain credit criteria and other 'shopping list' credits are targeted and satisfied

#### Credits also influenced by the Incoming Tenant

Hea 03	3	Thermal Comfort	Confirmation that dynamic thermal modelling will be carried out Confirmation that the modelling will inform the development of a thermal zoning and control strategy	All Credits Assessed above within the 'Shell & Core' section. The BRE deem these credits to be influenced by the 'fit-out' hence, careful consideration should be given to these credits
Hea 04	3	Water Quality	Confirmation that all water systems be design to comply with the relevant HSE Approved Code of Practice and Guidance, if humidifying, false air humidification specified. Wholesome supply of accessible clean and fresh drinking water to be provided for the building user	
Ene 03	15	Reduction of CO <sub>2</sub> Emissions	Dynamic Thermal Modelling results using approved software to indicate a % reduction against the national building Target Emission Rate	
Ene 02	3	Energy Monitoring	Confirmation that a BMS or sub-meters be specified to monitor energy use from major building services systems	
Ene 04	5	Low and Zero Carbon Technology	Confirmation of a feasibility study into renewable & low carbon technologies Confirmation of the percentage of carbon reduced due to renewable and/or low carbon technologies 3 Credits = 30% reduction 1 Credit = 10% reduction Exemplary level = 30% reduction (Innovative Credit) Confirmation of the adoption of 'Free Cooling' technology	
Ene 06	2	Energy Efficient Transportation Systems	Confirmation that a transportation system analysis has been carried out to optimise number and size of lifts. Also that energy efficient features proposed under the BREEAM criteria have been adopted (e.g. Regenerative Unit, PHS)	
Ene 08	4	Energy Efficient Equipment	Confirmation that the swimming pool has an automatic or semi-automatic pool cover	
Wat 03	5	Water Consumption	Confirmation of any rainwater harvesting or grey water recycling Water efficient fittings to be agreed with architect	
Wat 04	3	Water Monitoring	Confirmation that there will be a water meter installed on the mains water supply to the building. Metering to be included to relevant plant items. The water meters to have a pulse output and be connected to the BMS Sewerage supply shut off valves to all toilets	
Wat 05	3	Water Leak Detection	Confirmation that a mains water leak detection system be installed on the building's water supply Confirmation that the refrigerant specified will have a global warming potential of less than 10	
Pol 03	3	Impact of Refrigerants	State the target range of Direct Effect Life Cycle CO <sub>2</sub> eq. emissions Will a suitable refrigerant leak detection system and containment system be specified	
Pol 02	3	NO <sub>x</sub> Emissions	Calculate the target/maximum NO <sub>x</sub> emission level for the space heating/cooling system Calculate the target/maximum NO <sub>x</sub> emission level for the water heating system	
Ene 09	3	Drying Space	Confirmation of internal/external drying space for items of clothing/shoes	
Tra 03	3	Cyclist Facilities	Architect to provide evidence that the acceptable number of compliant cycle spaces and also compliant facilities will be provided. i.e. showers, changing facilities etc.	
Tra 04	3	Maximum Car Parking Capacity	Architect to make known the number of car parking facilities being provided by way of drawings or documentation. The number should not exceed 2 person per 8 building users	
Mat 04	3	Insulation	Any new insulation specified for use within external walls, ground floor and roof should generally be an 'M' rated material as defined within the 'Green Guide to Specification'	
Mat 05	3	Designing for Robustness	Architect to provide evidence that suitable durability/protection measures have been specified and installed to vulnerable areas of the building	
Wat 03	3	Operational Waste	Architect to provide evidence that there is dedicated space (2 to cater for the segregation and storage of operational recyclable waste volumes generated. A minimum of 50m <sup>3</sup> for buildings >3000m <sup>2</sup> . An additional 20m <sup>3</sup> per 1000m <sup>2</sup> of net floor area where catering is provided (with an additional minimum of 50m <sup>3</sup> for buildings >3000m <sup>2</sup> )	
Ene 03	3	External Lighting (Lighting Specialist)	External light fittings and controls to be in accordance with BREEAM criteria. Efficiency and either daylight sensing and/or timed control to prevent lighting being on during daylight hours	
Pol 04	3	Reduction of Night Time Light Pollution (Lighting Specialist)	Confirmation to be provided that external lighting is designed in compliance with the S.E. Guidance notes for the reduction of Obtrusive Light, 2010	
Pol 05	3	Noise Attenuation (Acoustic Consultants)	Noise impact assessment to be carried out and acoustic consultant recommendations on attenuation measures to be adopted	

#### Innovation Credits Targetted

Man 04	3	Sustainable Procurement	No	0
Man 03	3	Responsible Construction	Yes	1
Hea 03	3	Visual Comfort	No	0
Ene 03	3	CO <sub>2</sub> Emission Reduction	No	0
Ene 04	3	Low & Zero Carbon	No	0
Ene 05	3	Energy Efficiency Cold Storage	No	0
Wat 03	3	Water Consumption	Yes	0
Mat 03	3	Life Cycle Impacts	No	0
Mat 03	3	Responsible Sourcing	No	0
Wat 04	3	Construction Waste Management	Yes	1
Wat 04	3	Recycled Aggregates	No	0

Total Innovation Credits 2%






# Appendices

## Appendix D - Energy Schematic

106610/LA/120207 Issue 9

# Centre Point Energy Strategy

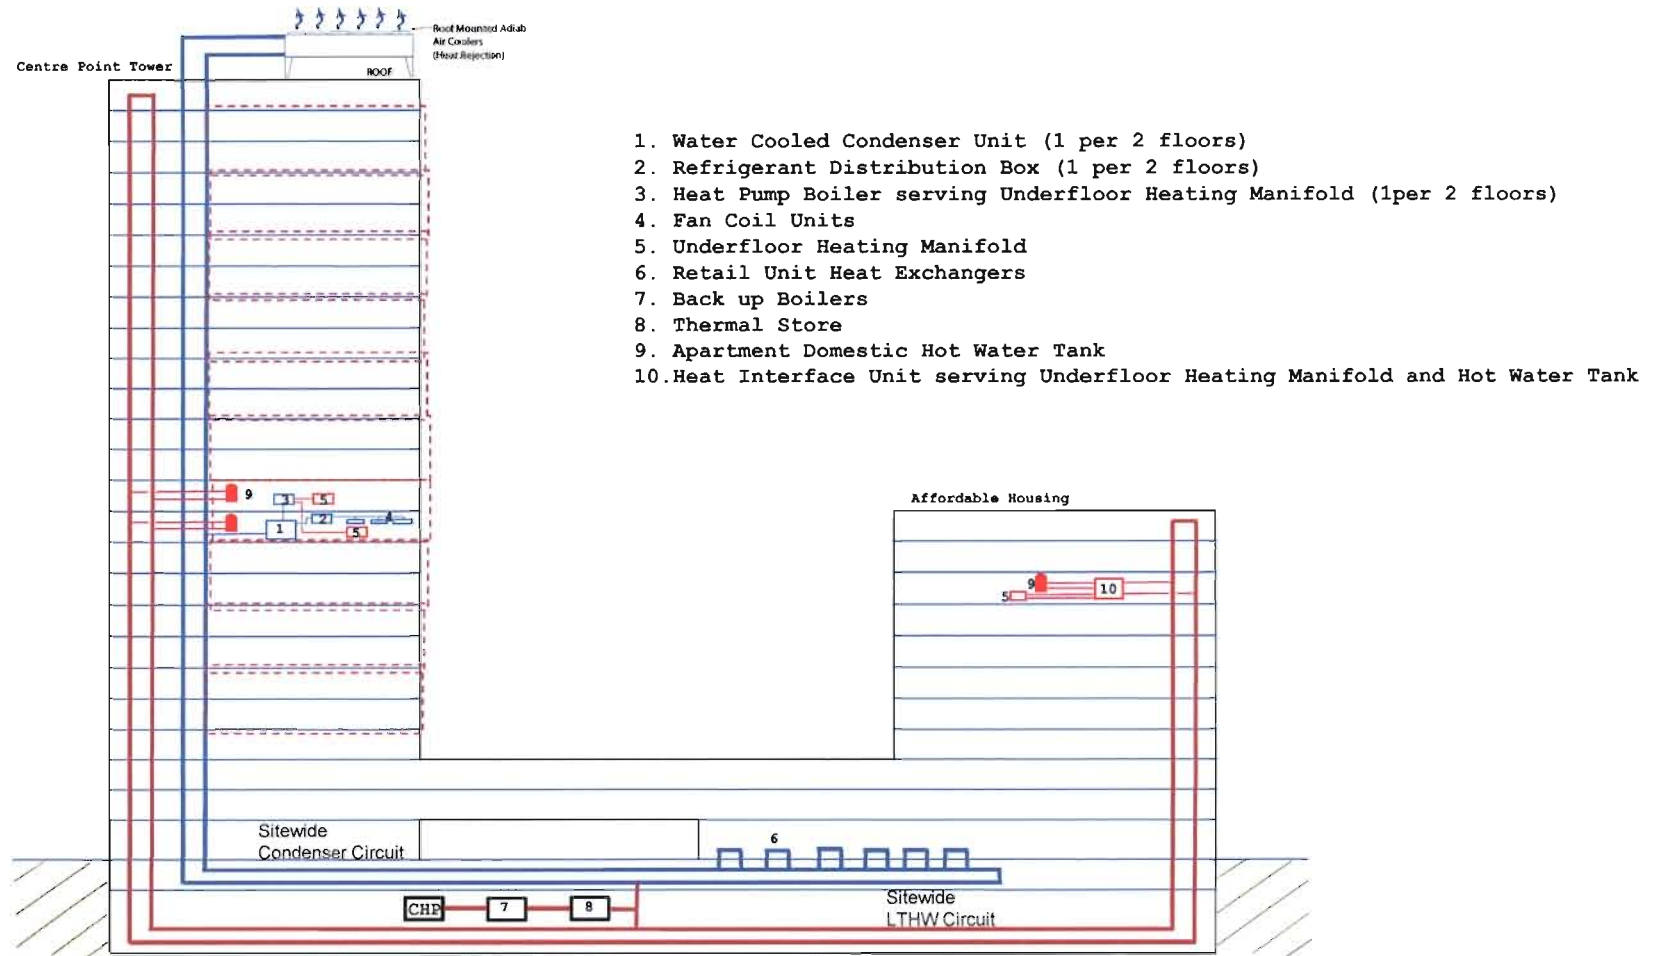

# Appendices

## Appendix E - CHP Analysis

106610/LA/120207 Issue 9

# CHP Analysis

**Centre Point**

106610/LA/130221  
Revision 01

Issue	Date	Reason for Issue	Prepared		Checked		Approved	
01	February 2013	For comment	LA		SC		NDB	
02	March 2013	Incorporating comments from team	LA	27/03	SC	27/03	NDB	27/03

CHP Analysis  
106610/LA/130221  
Revision 01

Grontmij  
1 Bath Road  
Maidenhead  
Berkshire  
SL6 4AQ

+44 (0)1628 623 423  
building.services@grontmij.co.uk  
grontmij.co.uk/buildingservices

© Grontmij 2013 This document is a Grontmij confidential document; it may not be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording or otherwise disclosed in whole or in part to any third party without our express prior written consent. It should be used by you and the permitted discloses for the purpose for which it has been submitted and for no other.

Registered Office: Grontmij Limited, Grove House, Mansion Gate Drive, Leeds, LS7 4DN. Company Registration No 2888385

value beyond engineering

## Contents

1.	Executive Summary .....	4
2.	Loads Serviced .....	5
2.1	Typical Winter Day Loads .....	6
2.2	Typical Midseason Day Loads .....	7
2.3	Typical Summer Day Loads .....	8
3.	CHP Operation .....	9
4.	Thermal Storage Operation .....	10

## 1. Executive Summary

A Combined Heat & Power (CHP) unit is proposed for Centre Point. A detailed study has been undertaken to establish the likely performance of the unit. The results of this study are presented in this report.

Load profiling has been conducted to establish the optimal size and running patterns of the CHP. In addition, a thermal storage vessel will enable the CHP to run for extended hours by acting as a load on the CHP during low building load conditions. During high building load conditions, the thermal storage will then revert to acting as a boiler, injecting heat into the building when conditions require.

After detailed study of thermal loads, it is proposed that the following CHP unit will be most suitable to the application:

- Electrical output, kWe = 105kW
- Thermal output, kWth = 146kW
- Electrical efficiency = 32.7%
- Thermal efficiency = 45.5%
- Overall efficiency = 78.2%
- Heat-to-power ratio = 1.39

One number cylindrical water thermal storage tanks with height 3.0m and diameter 3.0m will provide thermal storage of approximately 500kWh.

2.

## Loads Serviced

Direct servicing of loads by the CHP via LTHW circuits will apply to the following loads:

- Domestic Hot Water: residential units in Centre Point Tower and the Pub site; the leisure pool facilities; and the A1 retail areas
- Air Heating: residential public spaces on ground floor; the Leisure pool facilities
- Space Heating: Leisure pool facilities

Indirect servicing of loads by the CHP via condenser water-loop circuits will apply to the following loads:

- Air Heating: A1 retail units
- Space Heating: residential units in Centre Power Tower and The Pub site; and A1 retail units



## 2.1 Typical Winter Day Loads

Various sources of heat demand are considered for a typical winter day. These are displayed here grouped by area type, and by load type.

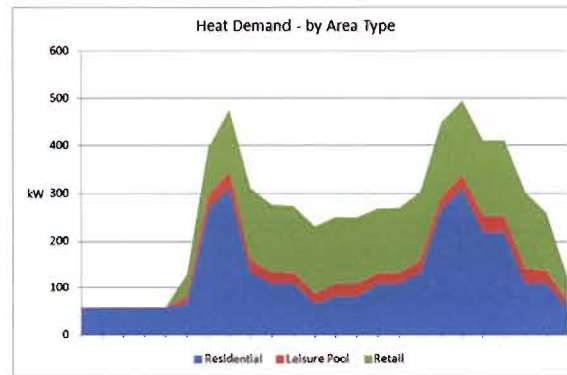


Fig 2.1.1

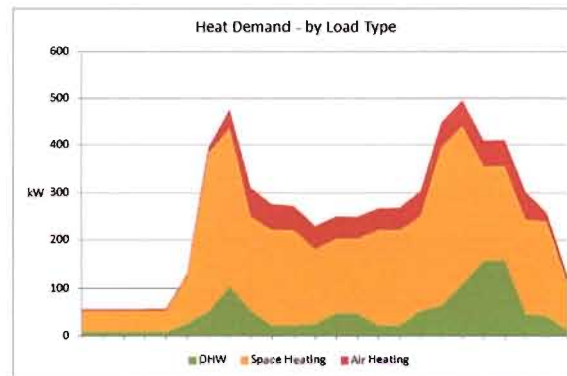


Fig 2.1.2

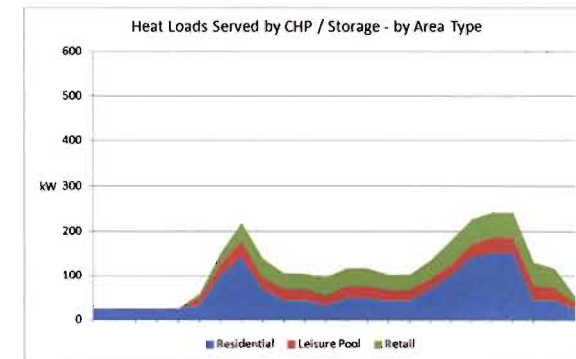


Fig 2.1.3

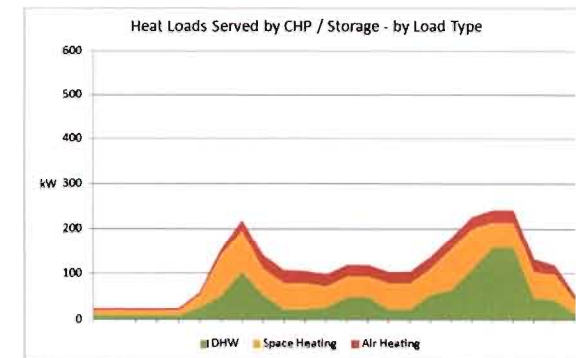


Fig 2.1.4

Not all the heat loads opposite will be served by the CHP alone, since the condenser water loop circuit will allow for the efficient transfer of unwanted heat from one part of the development (e.g. retail space) to another part of the development where heat is required (e.g. residential space heating). The following indicates the loads which the CHP will be expected to serve.

## 2.2 Typical Midseason Day Loads

Various sources of heat demand are considered for a typical midseason day. These are displayed here grouped by area type, and by load type.

As in winter, not all the heat loads opposite will be served by the CHP alone, since the condenser water loop circuit will allow for the efficient transfer of unwanted heat from one part of the development (e.g. retail space) to another part of the development where heat is required (e.g. residential space heating). The following indicates the loads which the CHP will be expected to serve.

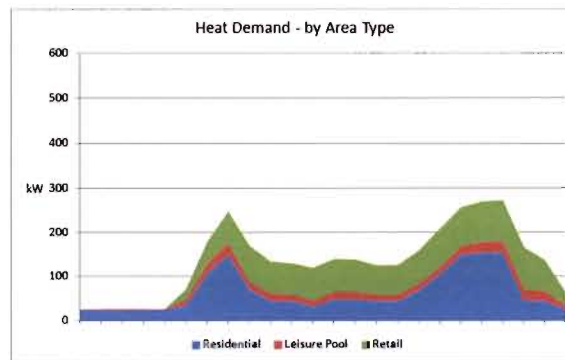


Fig 2.2.1

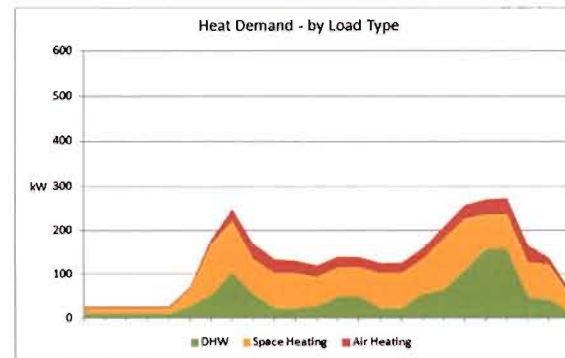


Fig 2.2.2

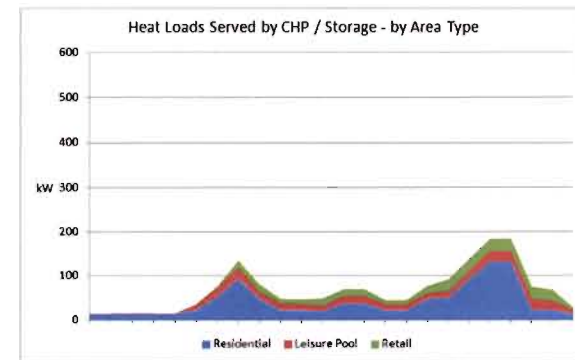


Fig 2.2.3

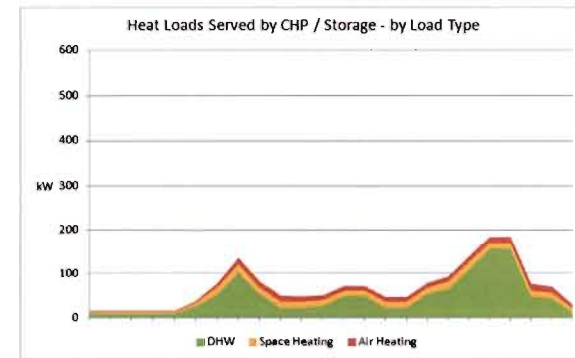


Fig 2.2.4

## 2.3 Typical Summer Day Loads

Various sources of heat demand are considered for a typical summer day. These are displayed here grouped by area type, and by load type.

As in winter and midseason, not all the heat loads opposite will be served by the CHP alone, since the condenser water loop circuit will allow for the efficient transfer of unwanted heat from one part of the development (e.g. retail space) to another part of the development where heat is required (e.g. residential space heating). The following indicates the loads which the CHP will be expected to serve.

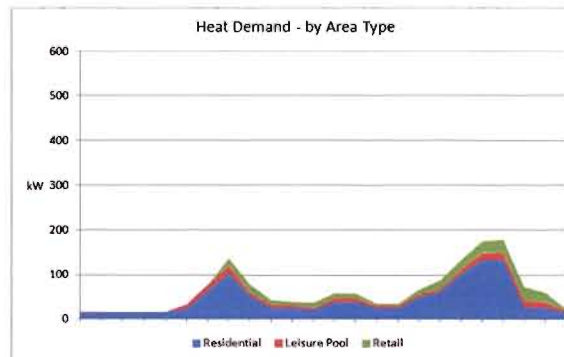


Fig 2.3.1

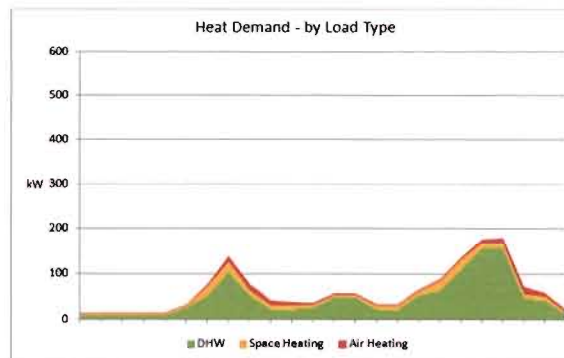


Fig 2.3.2

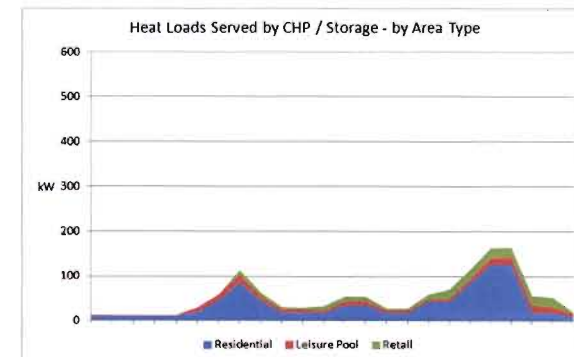


Fig 2.3.3

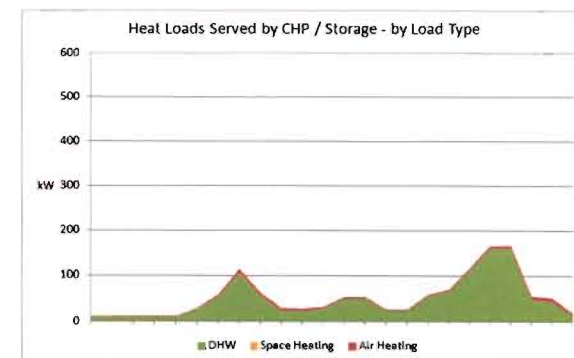


Fig 2.3.4

3.

### CHP Operation

The energy centre at Centre Point will utilise a CHP unit in combination with thermal storage. This will enable the CHP plant to continue running for longer during times of low load, with its heat output being stored in large buffer vessels that discharge heat, via heat exchangers, to service loads during times of high demand. The available load that the CHP/storage tanks service will vary throughout the year. Hence, the operating hours of the CHP will vary accordingly. The following is the expected operating hours of the CHP.

Season	Hours of Operation	Total
Winter	05:00 – 00:00	19
Midseason	12:00 – 21:00	9
Summer	14:00 – 21:00	7
All Year	-	4,005

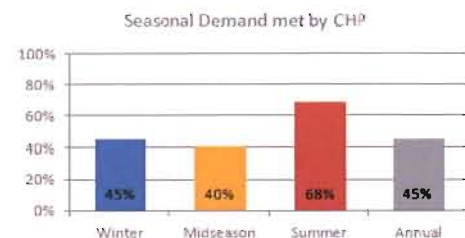


Fig 3.1

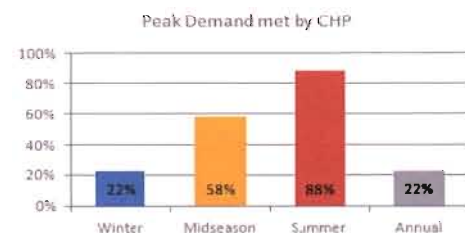


Fig 3.2

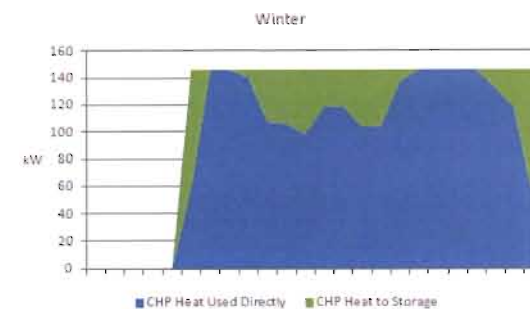


Fig 3.3

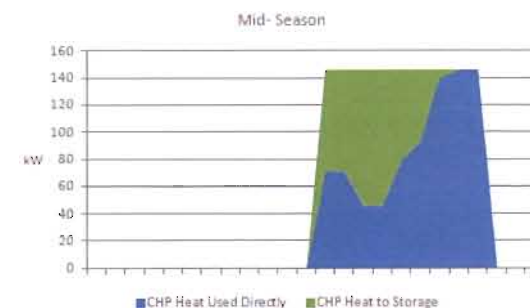


Fig 3.4

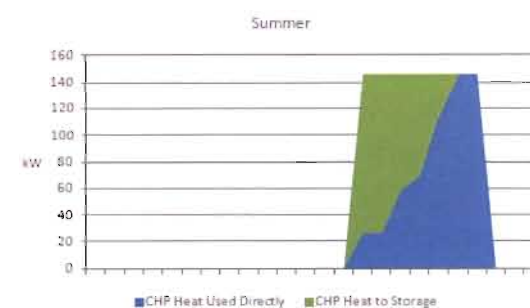


Fig 3.5

4.

### Thermal Storage Operation

Further analysis is concentrated on optimising the size of the CHP thermal storage tank. This storage will operate as an additional boiler in times of high heat demand, thereby supplementing the heat output from the CHP unit. In times of low heat demand, the CHP will continue running and 'recharging' the thermal storage in readiness for periods of high heat demand.

Analysis indicates one number storage tank will be required, with a water storage volume of 21m<sup>3</sup> (cylindrical tank approximately 3.0m high and 3.0m diameter). Operating with a delta T of 20degC between flow and return temperatures), this tank will have a thermal store capacity of 500kWh.

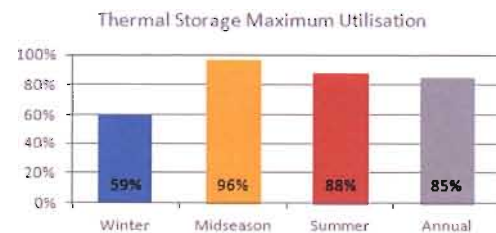


Fig 4.1

The charts opposite indicate the storage tank behaviour during typical operation.

The green areas indicate the heat in storage across each of the day types.

The blue lines indicate the cumulative heat delivered to storage across each of the day types. Note heat is only delivered to storage when the CHP is on and running at a thermal surplus – i.e. when the CHP heat output is not meeting the instantaneous loads directly.

The red lines indicate the cumulative heat extracted from storage across each of the day types. Note heat is only extracted from storage when there is storage heat available for discharge, and when the CHP is not delivering heat to storage.

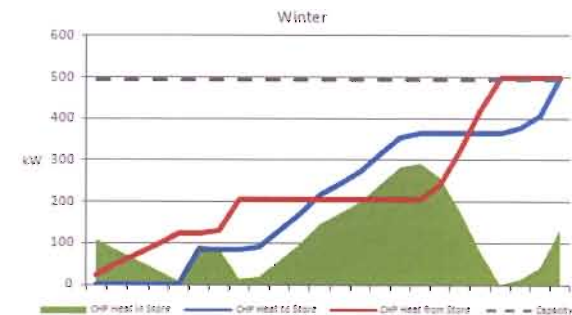


Fig 4.2

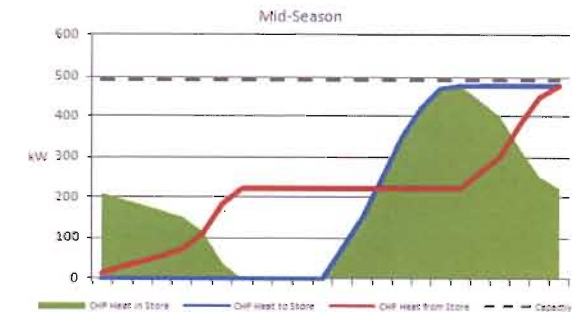


Fig 4.3

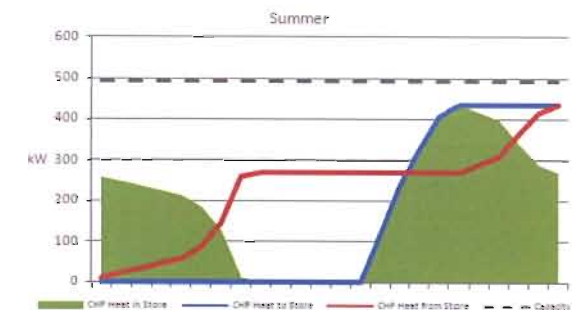


Fig 4.4