



Typical Catch Pit (CP) Detail
Scale 1:20

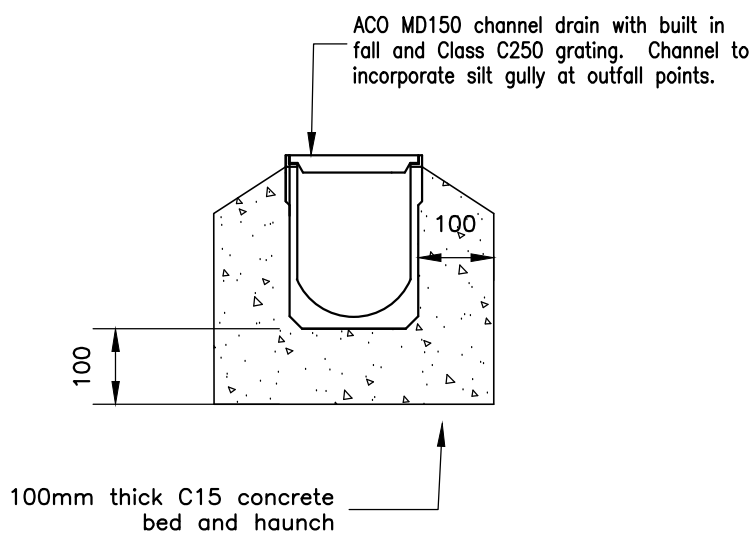


Typical Channel Drain
Scale 1:10

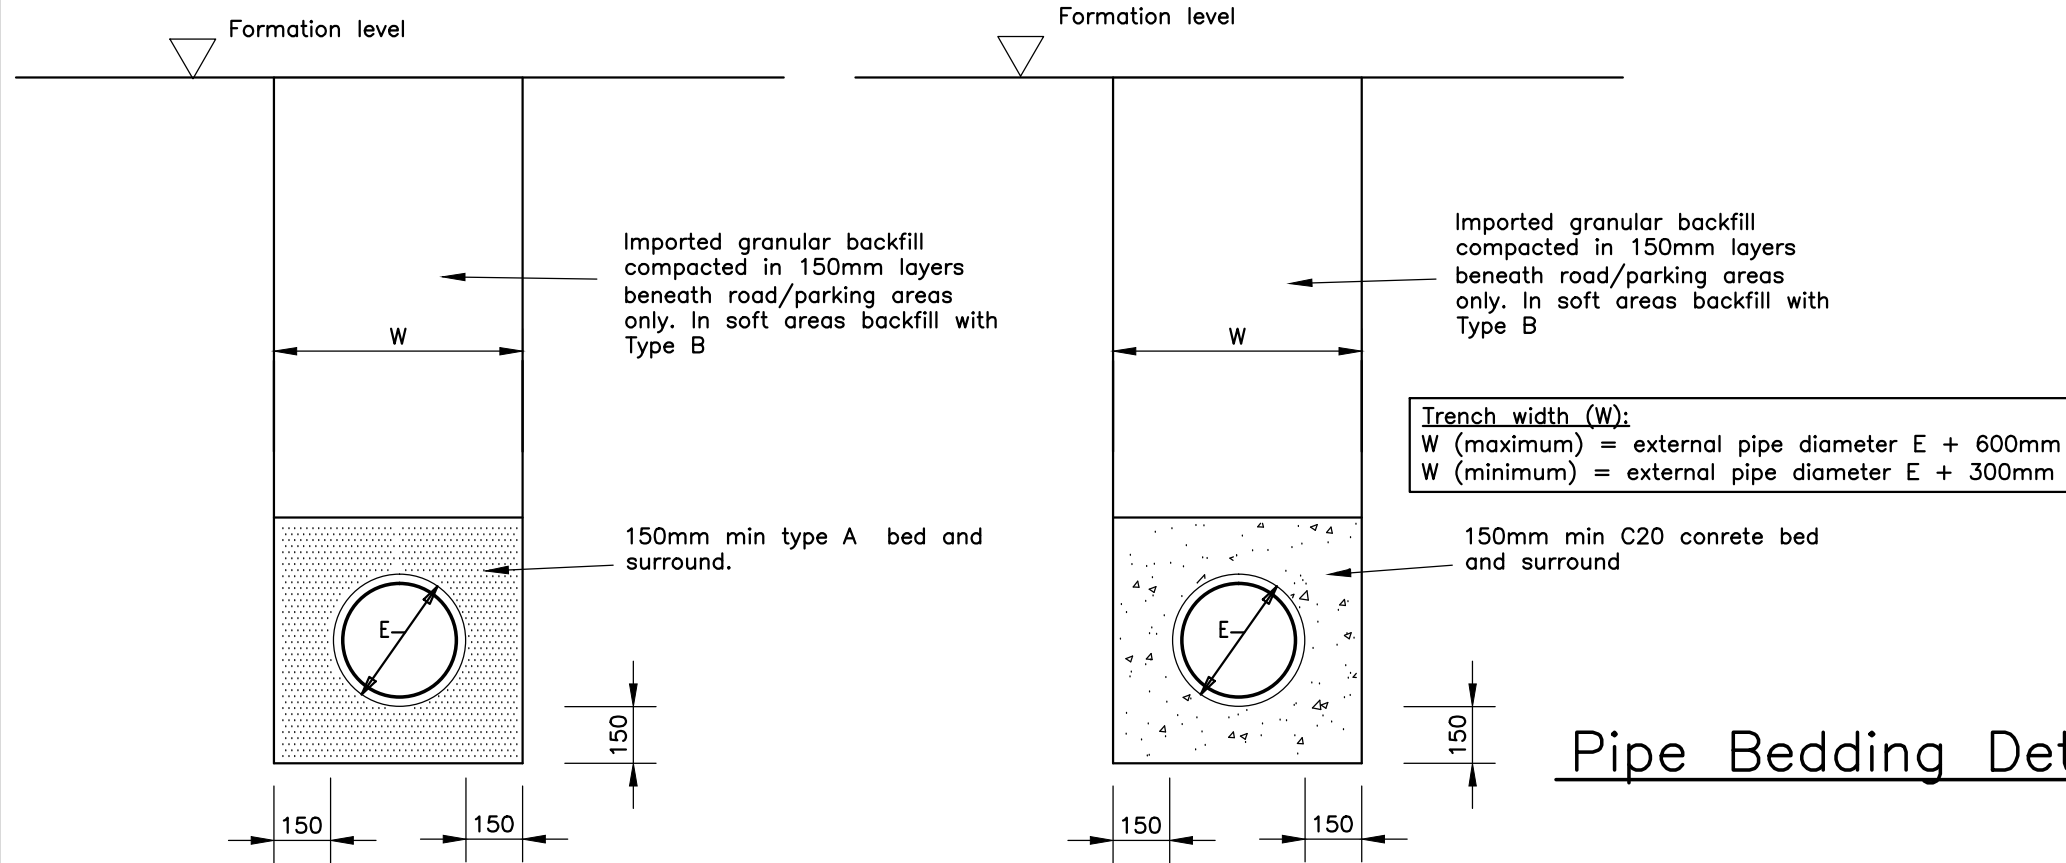


Class S Bedding
1:20


Concrete Bed and Surround
1:20

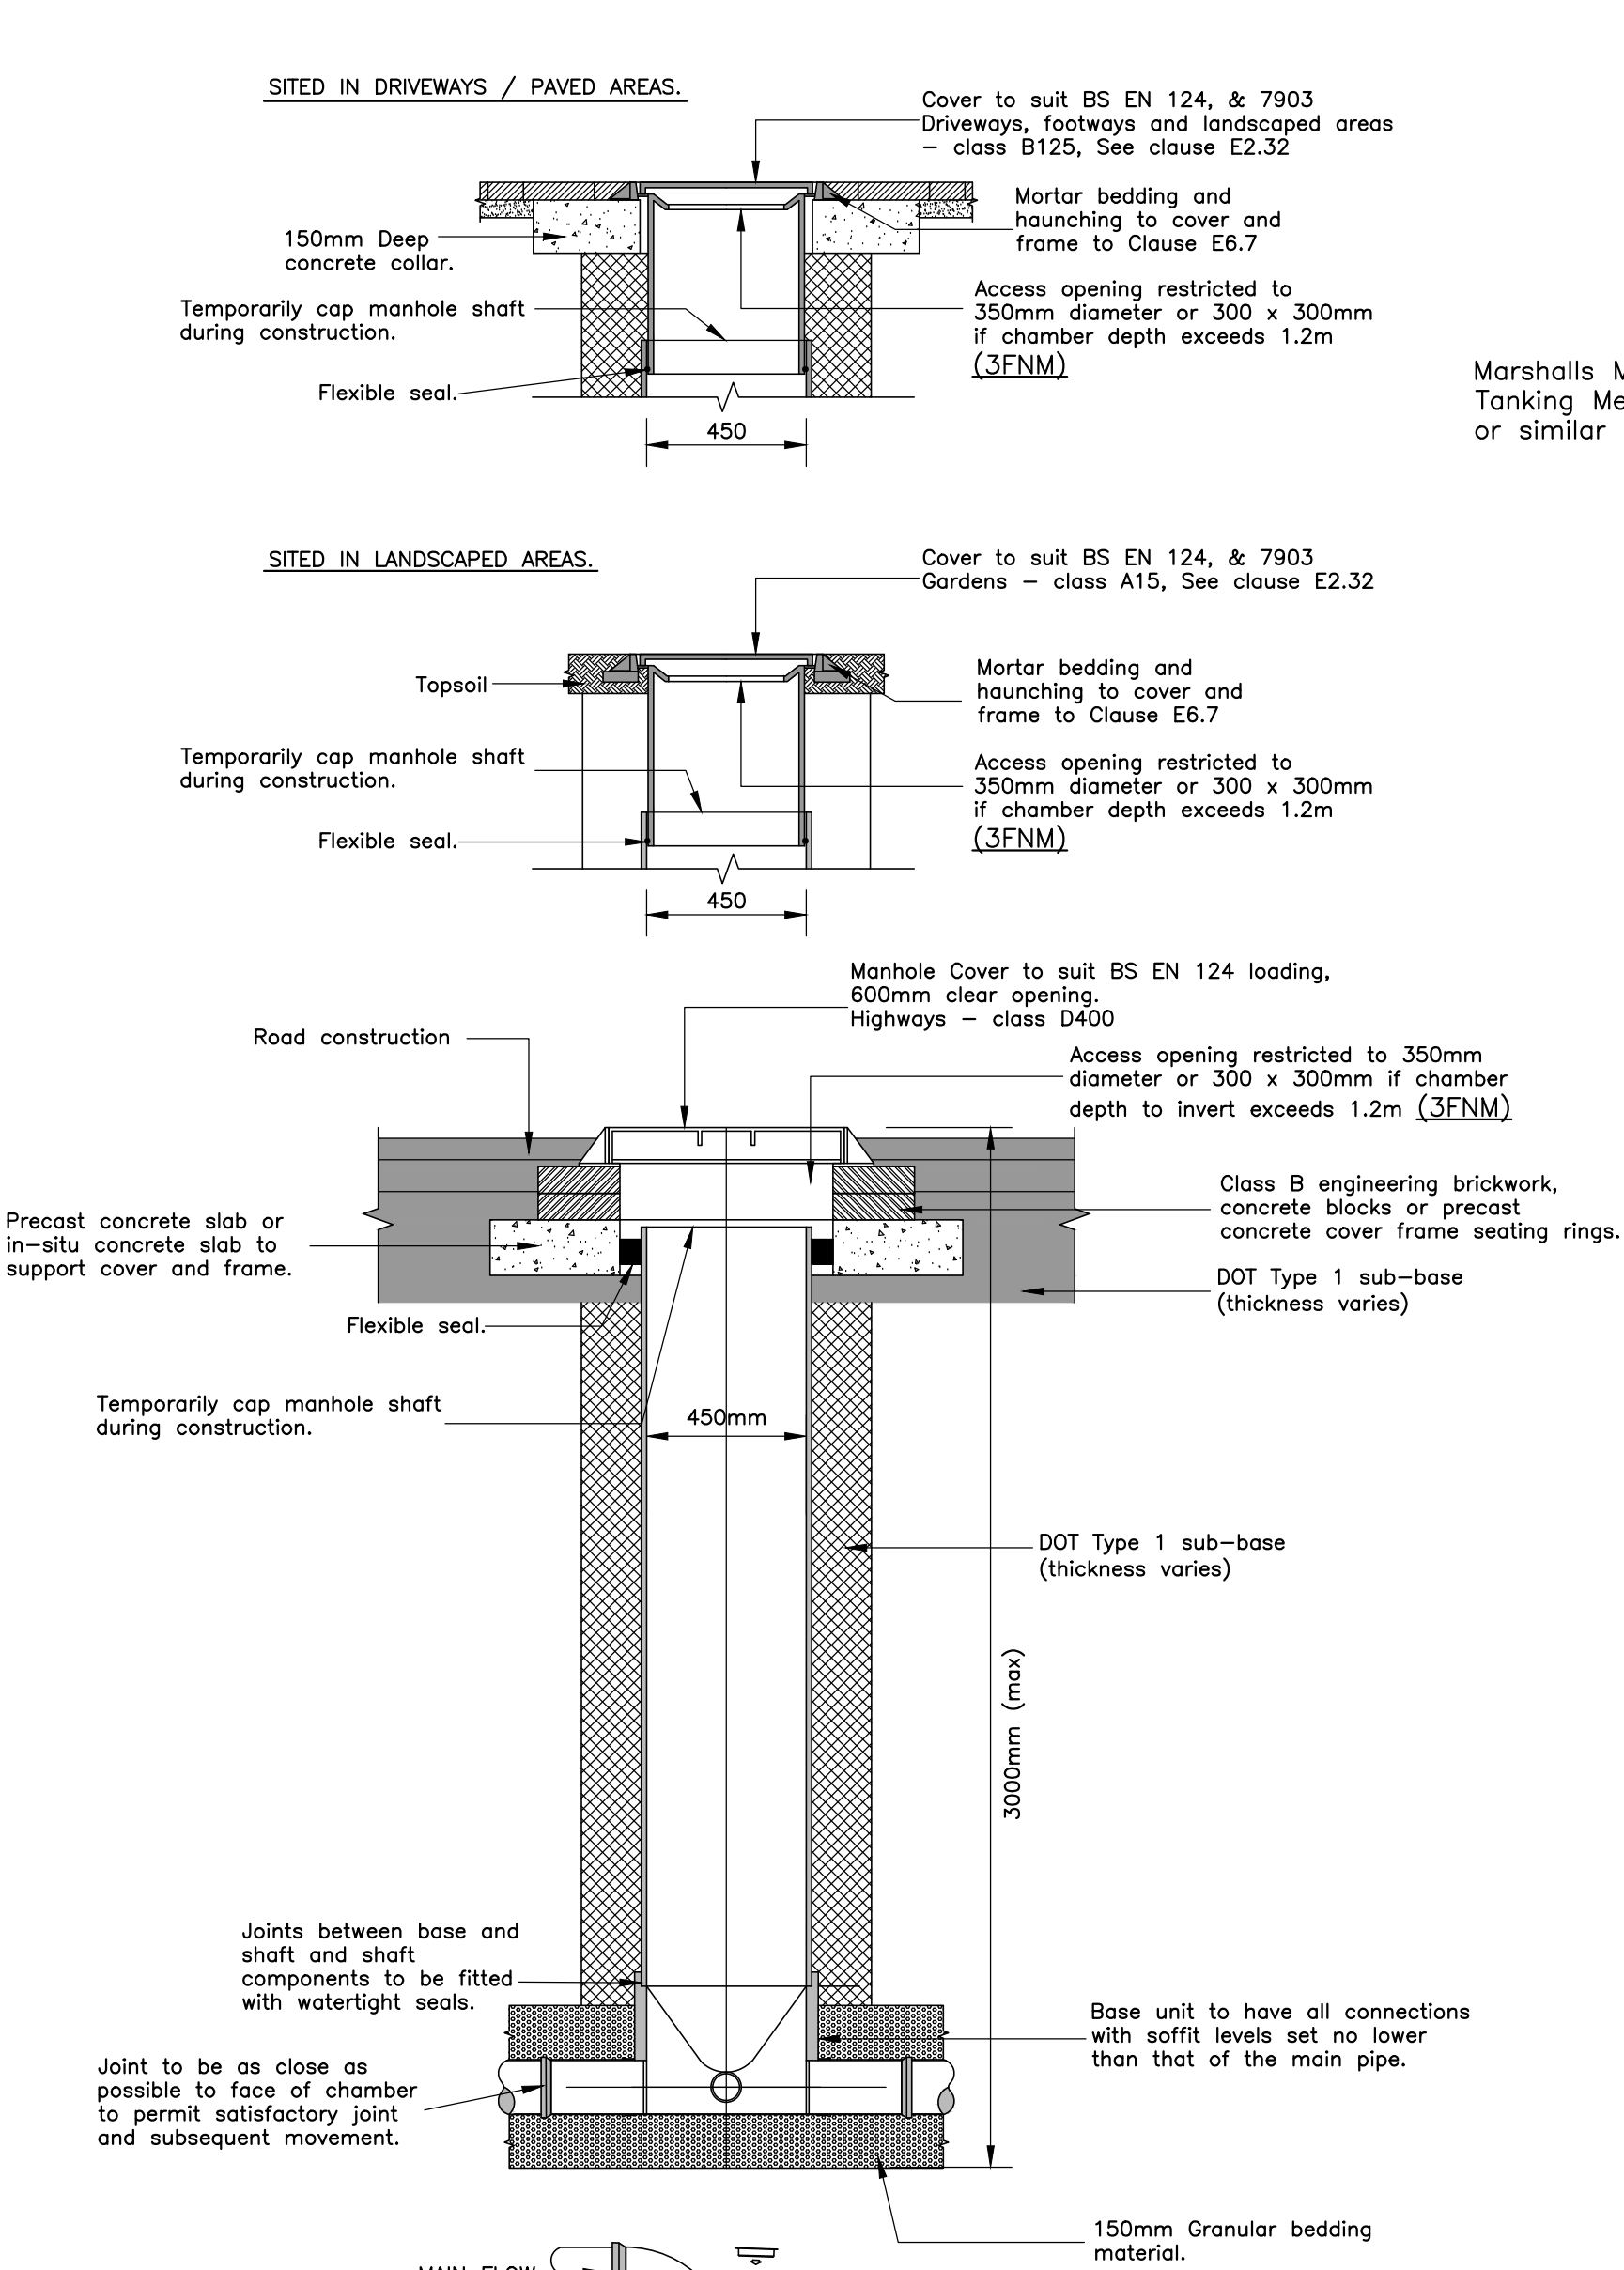


Typical Type 3F Chamber Detail
Scale 1:20

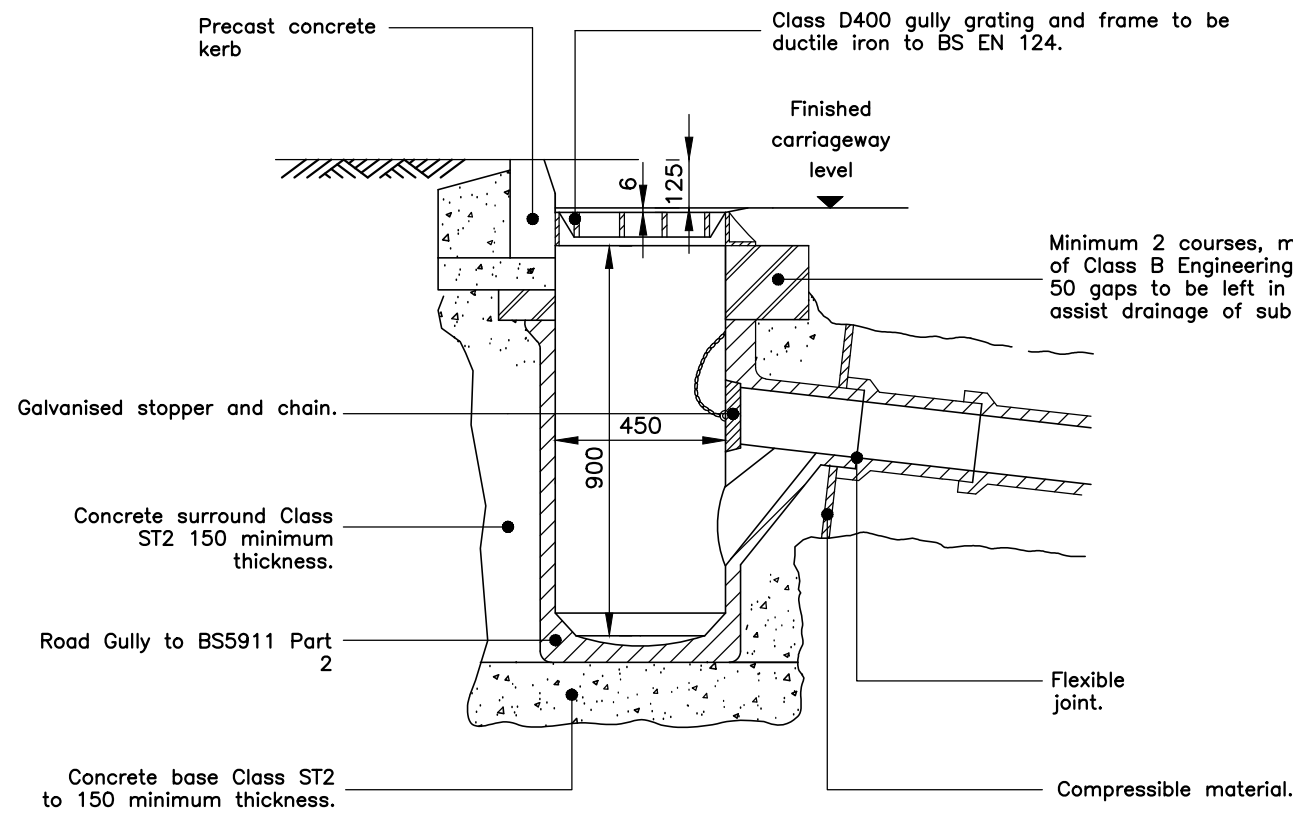

Precast Concrete Highway Gully
Scale 1:20

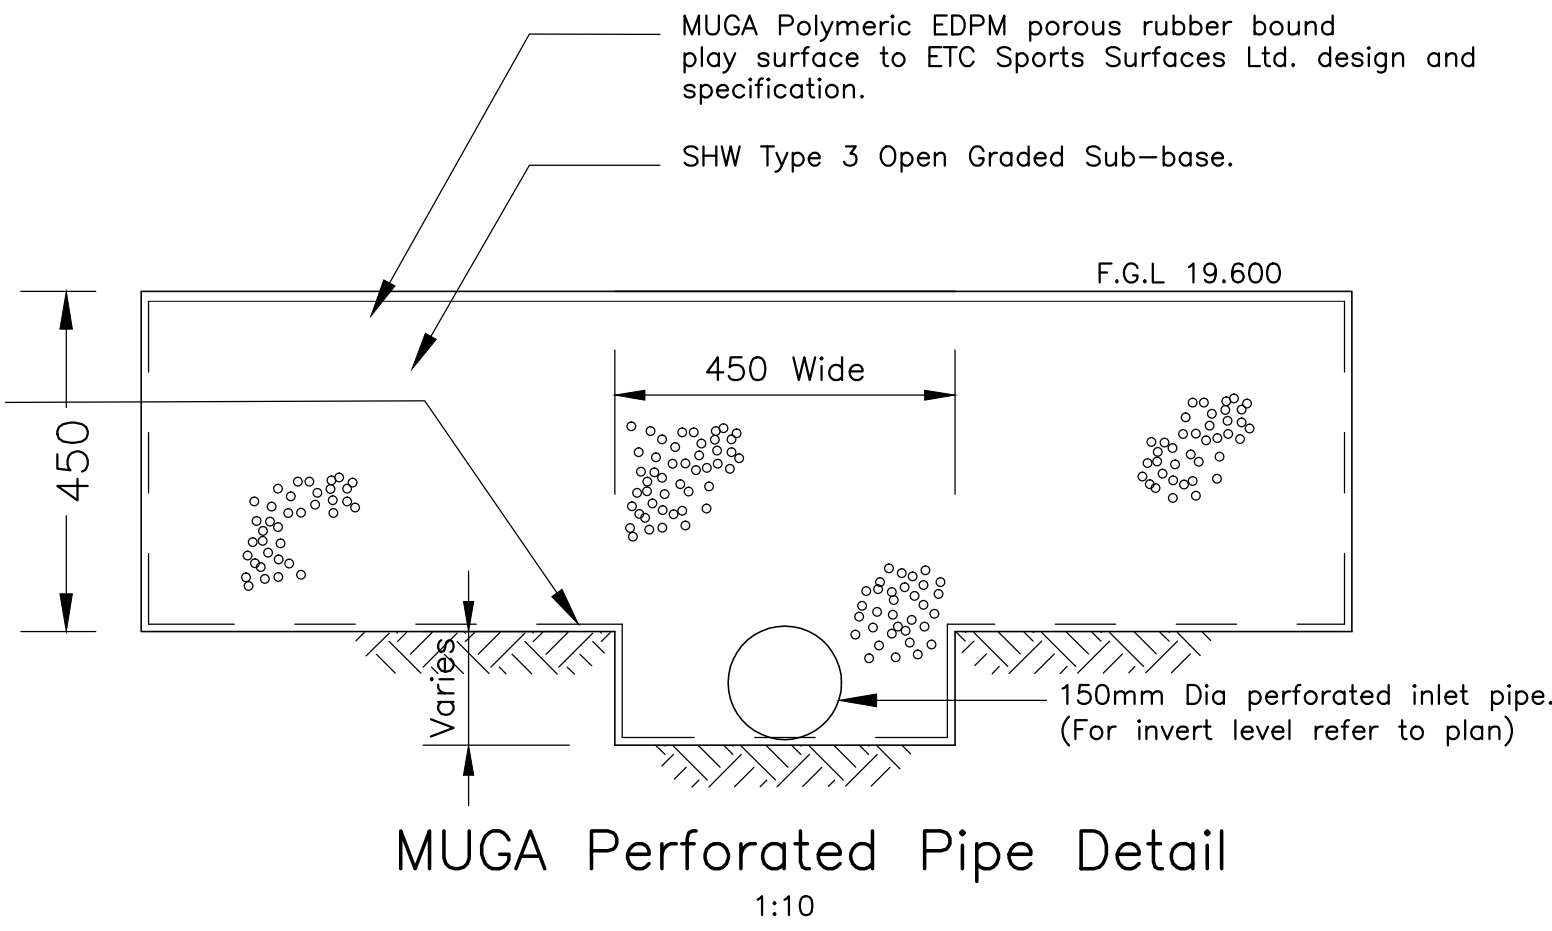

Trapped Yard Gully to Private Drives, Footpaths and Parking Areas
1:20

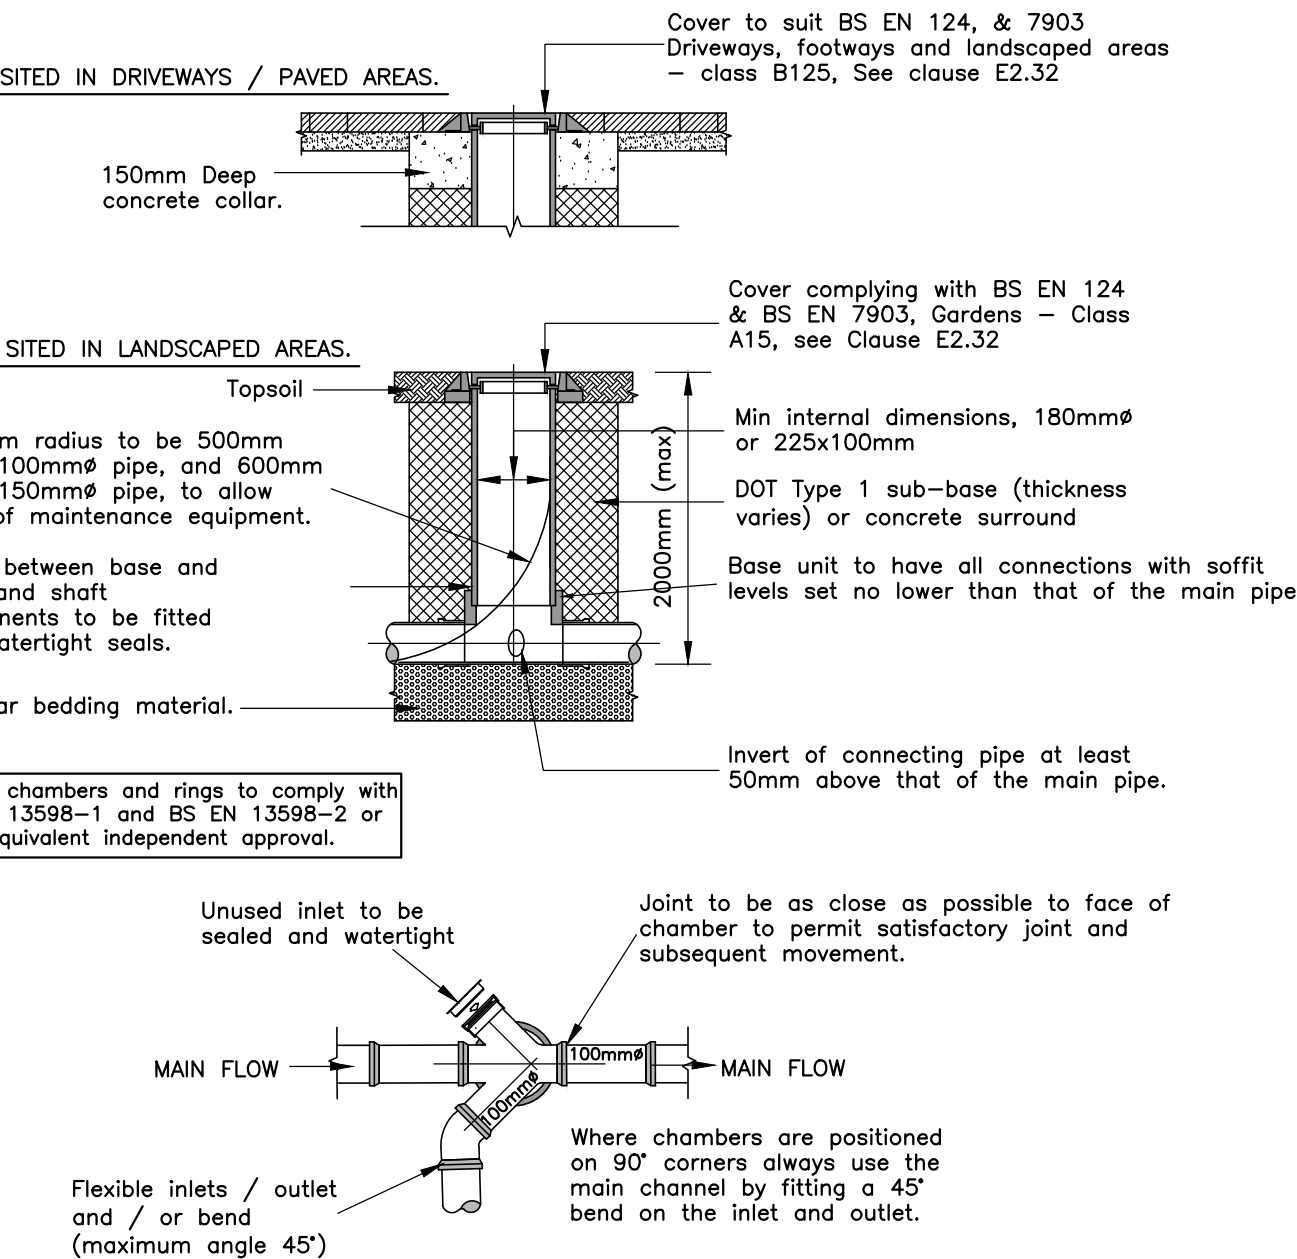

Typical Type 4F Chamber Detail
Scale 1:20

- Notes:
1. This drawing shall be read in conjunction with all relevant engineers drawings. Any discrepancies found between information shown on this or any other drawing shall be Reported to the Walkers Associates engineer immediately and prior to works commencing on site.
 2. Type A granular bedding shall consist of 14mm single sized pea shingle to TABLE 1 of BS 882 part 2 1973.
 3. Selected fill type B shall consist of uniform readily compactable material free from tree roots, vegetable matter, building rubbish and frozen soil and excluding clay lumps retained on a 75mm sieve and stones larger than the maximum size permitted on any adjacent type a bedding material.
 4. Where concrete bed and surround is specified joint filler should be provided AT every joint. The filler may be expanded polystyrene 25mm thick or flexcell cut to the shape of the bed and surrounded and such that the ingress of concrete into the pipe is prevented.
 5. To allow for possible differential movement a flexible joint must be incorporated in each section of pipeline within 150mm of where it enters a building or connects with a manhole, wall or other structure:- see manufacturers instructions
 6. All pipework generally to be bedded as follows
 - (i) Under vehicular areas where cover is less than 900mm under pedestrian areas where cover is less than 600mm } concrete bed and surround.
 - (ii) Under vehicular areas, pedestrian areas where depths given in (i) are exceeded; } class S bedding.
 7. All private pipework shall be either vitrified clay, concrete or UPVC to BS 65, 5911 and BS EN 1401 respectively. ERs required to confirm specification.
 8. All concrete at or below ground level on site shall be able to withstand class 2 sulphate concentrations in accordance with BRE digest 363
 9. SVPs that have fallen vertically for more than 3 storeys should have a 750mm distance between invert of last connection and invert of the bend.

A	04/07/14	Additional details added.		AB	
REV	DATE	AMENDMENT		BY	CHKD
STATUS		TENDER			
PROJECT					
BOURNE ESTATE LONDON					
CLIENT					
Higgins					
DRAWING					
TYPICAL DRAINAGE CONSTRUCTION DETAILS SHEET 1					
DATE 07.05.14		DRAWN BY		DMP	
SCALES (@A1)- AS SHOWN		CHECKED BY			
DRG		C6475 - CE5			
NO.		A			
					
Address		13 Capricorn Centre Cranes Farm Road Basildon Essex SS14 3JJ			
Tel		01268 530 500			
Fax		01268 28 66 28			
Web		www.walker-associates.co.uk			