


PILING

1. ALL PILING OPERATIONS ARE TO BE IN ACCORDANCE WITH BS 8004 : 1986 & BS 8110, AND ANY RELEVANT SPECIFICATIONS FOR PILING WORKS AND THE INSTITUTION OF CIVIL ENGINEERS.
2. ALL PILES TO BE MINIMUM 300 DIAMETER, MAXIMUM 450 DIAMETER.
3. ALL PILES TO BE REINFORCED WITH MINIMUM 4H16'S AND RE SPREADS FOR A LENGTH THAT GIVES ACCEPTABLE ANCHORAGE THAT SUITS THE PREVAILING SOIL CONDITIONS.
4. PILE REINFORCEMENT SHALL PROTECT THE GREATER OF 600mm OR 40BAR DIAMETERS ABOVE PILE CUT OFF LEVEL, AND SHALL BE BENT OVER INTO GROUND BEAM / PILE CAP AS SHOWN.
5. THE ENGINEER SHALL BE ADVISED IMMEDIATELY OF ANY PILE DISPLACEMENT, ON PLAN, OF GREATER THAN PLUS OR MINUS 75mm.
6. PILE DESIGN TO BE IN ACCORDANCE WITH BS 8004. PILES TO BE DESIGNED FOR A FACTOR OF SAFETY OF 3.0 FOR ALL PILES. ALL PILES TO BE DESIGNED TO RESIST ALL FACTOR OF SAFETY ON COMPRESSION LOADS ONLY WITH A TESTING REGIME CONFIRMED BY BUILDING CONTROL.
7. SPECIFIC PILES ARE TO BE SUBJECTED TO A PROOF LOAD TEST, IN ORDER TO VERIFY THAT WORKING LOAD SETTLEMENT IS WITHIN ALLOWABLE LIMITS, ALL IN ACCORDANCE WITH THE INSTITUTION OF CIVIL ENGINEER PILING SPECIFICATION.
8. ALL PILES ARE TO BE INTEGRITY TESTED TO ENSURE THEY ARE FREE OF ANY SIGNIFICANT DEFECT.
9. A MINIMUM OF 2 CONCRETE TEST CUBES ARE TO BE TAKEN DAILY FROM EACH CONCRETE MIX IN USE THAT DAY, FOR GRUSHING AT 7 AND 28 DAYS.
10. FOR DETAILS OF EXISTING SOIL CONDITIONS REFER TO THE GROUND INVESTIGATION REPORT 51311/1/3 DATED FEBRUARY 2014 BY REC (RESOURCE & ENVIRONMENTAL CONSULTANTS LTD).
11. CONCRETE IN PILES TO BE CLASS DC-4 (DESIGN SULPHATE CLASS DS-4, AECI CLASS AC-4).

GENERAL NOTES

1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THE STABILITY OF THE WORKS AND ADJOINING STRUCTURES, WORKS AND SERVICES AT ALL STAGES OF CONSTRUCTION.
 2. THIS DRAWING SHALL NOT BE SCALED, WRITTEN DIMENSIONS ONLY ARE TO BE USED.
 3. THIS DRAWING IS TO BE USED IN CONJUNCTION WITH ALL RELATED DRAWINGS AND SPECIFICATIONS.
 4. REFER TO ARCHITECTS DRAWINGS FOR DETAILS OF FINISHES, D.T.'S AND D.P.'S.
 5. THE MAIN CONTRACTOR SHALL CHECK AND CONFIRM ALL DIMENSIONS PRIOR TO COMMENCEMENT OF THE WORKS.
 6. THE NOTES AND DETAILS SHOWN ON THIS DRAWING RELATE TO STRUCTURAL REQUIREMENTS ONLY, RELEVANT DETAILS AND OTHER REQUIREMENTS SHALL BE RESPONSIBLE TO THE CONTRACTOR. THE CONTRACTOR SHALL BE RESPONSIBLE TO WHERE CONFLICT OCCURS THIS SHOULD BE BROUGHT TO THE ATTENTION OF WALKER ASSOCIATES PRIOR TO CONSTRUCTION.
- SUBSTRUCTURE CONCRETE**
1. ALL CONCRETE MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH BS 8110, AND WALKER ASSOCIATES 'SPECIFICATION FOR REINFORCED CONCRETE'.
 2. ALL CONCRETE IN PILE CAPS, BEAMS, SLABS, COLUMNS AND WALLS TO BE A MINIMUM GRADE C40 WITH A MINIMUM 28 DAY STRENGTH OF 40N/mm² USING 20mm MAX AGGREGATE.
 3. ALL REINFORCED ELEMENTS TO BE CAST ON 50mm C20 CONCRETE BLINDING.
 4. ALL CONCRETE WITHIN THE GROUND TO BE CLASS DC-1 (DESIGN SULPHATE CLASS DS-1, AECI CLASS AC-1). PILES NOT INCLUDED, REFER TO SPECIFIC NOTES.
 5. ALL STRUCTURAL CONCRETE TO BE MECHANICALLY BRANDED.

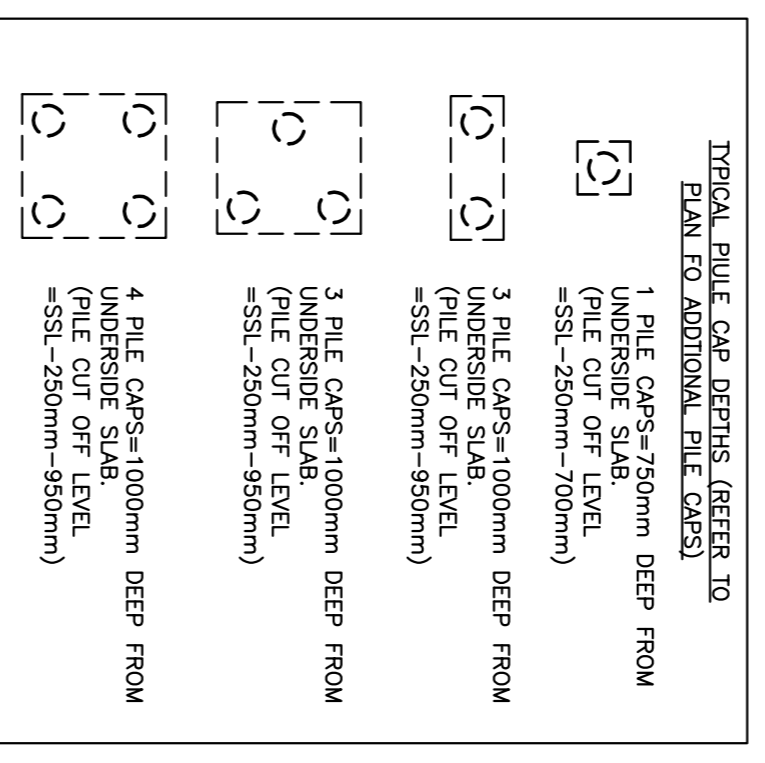

ALL CONTIGUOUS PILES ARE TO BE DESIGNED FOR A 150KN S.W.L & TENSION OF -25KN UNLESS NOTED OTHERWISE

ALL CONTIGUOUS PILES TO BE DESIGNED FOR TEMPORARY FREE CANTILEVER DURING CONSTRUCTION, TOP PROPPED IN PERMANENT CONSTRUCTION

NOTE! COLUMNS AND WALLS TO BE CENTRAL UNDER CONTIGUOUS PILED WALL/CAPPING BEAM

ALL PILES DESIGNED FOR A HORIZONTAL LOAD OF 10KN UNLESS NOTED OTHERWISE

(450KN) DENOTES VERTICAL U.N.O (-450KN) DENOTES TENSION U.N.O (H=450KN) DENOTES HORIZONTAL U.N.O LOADINGS INDICATIVE, REFER TO PLAN FOR EXACT LOADINGS

NOTE!
ALL COLUMNS TO BE 600X200 UNLESS NOTED OTHERWISE

ALL CONCRETE WALLS TO BE 200 THICK UNLESS NOTED OTHERWISE

REV	DATE	AMENDMENT	BY	CHKD

PROJECT: **TENDER**

PROJECT: **Bourne Estate**

CLIENT: **Higgins CONSTRUCTION**

DRAWING: **Block 1**

Basement Floor Plan

General Arrangement

Sheet 2 of 2

DATE: June 14
DRAWN BY: DWJ
CHECKED BY:

NO.: **6475/1/B1.1**

walkersassociates CONSULTING LIMITED

Address: 13 Corporation Centre, Bourne Estate, Bourne, East of Angles, Essex SS14 3JU
Tel: 01288 520 800
Fax: 01288 26 66 28
Web: www.walkersassociates.co.uk