




SECTION AA

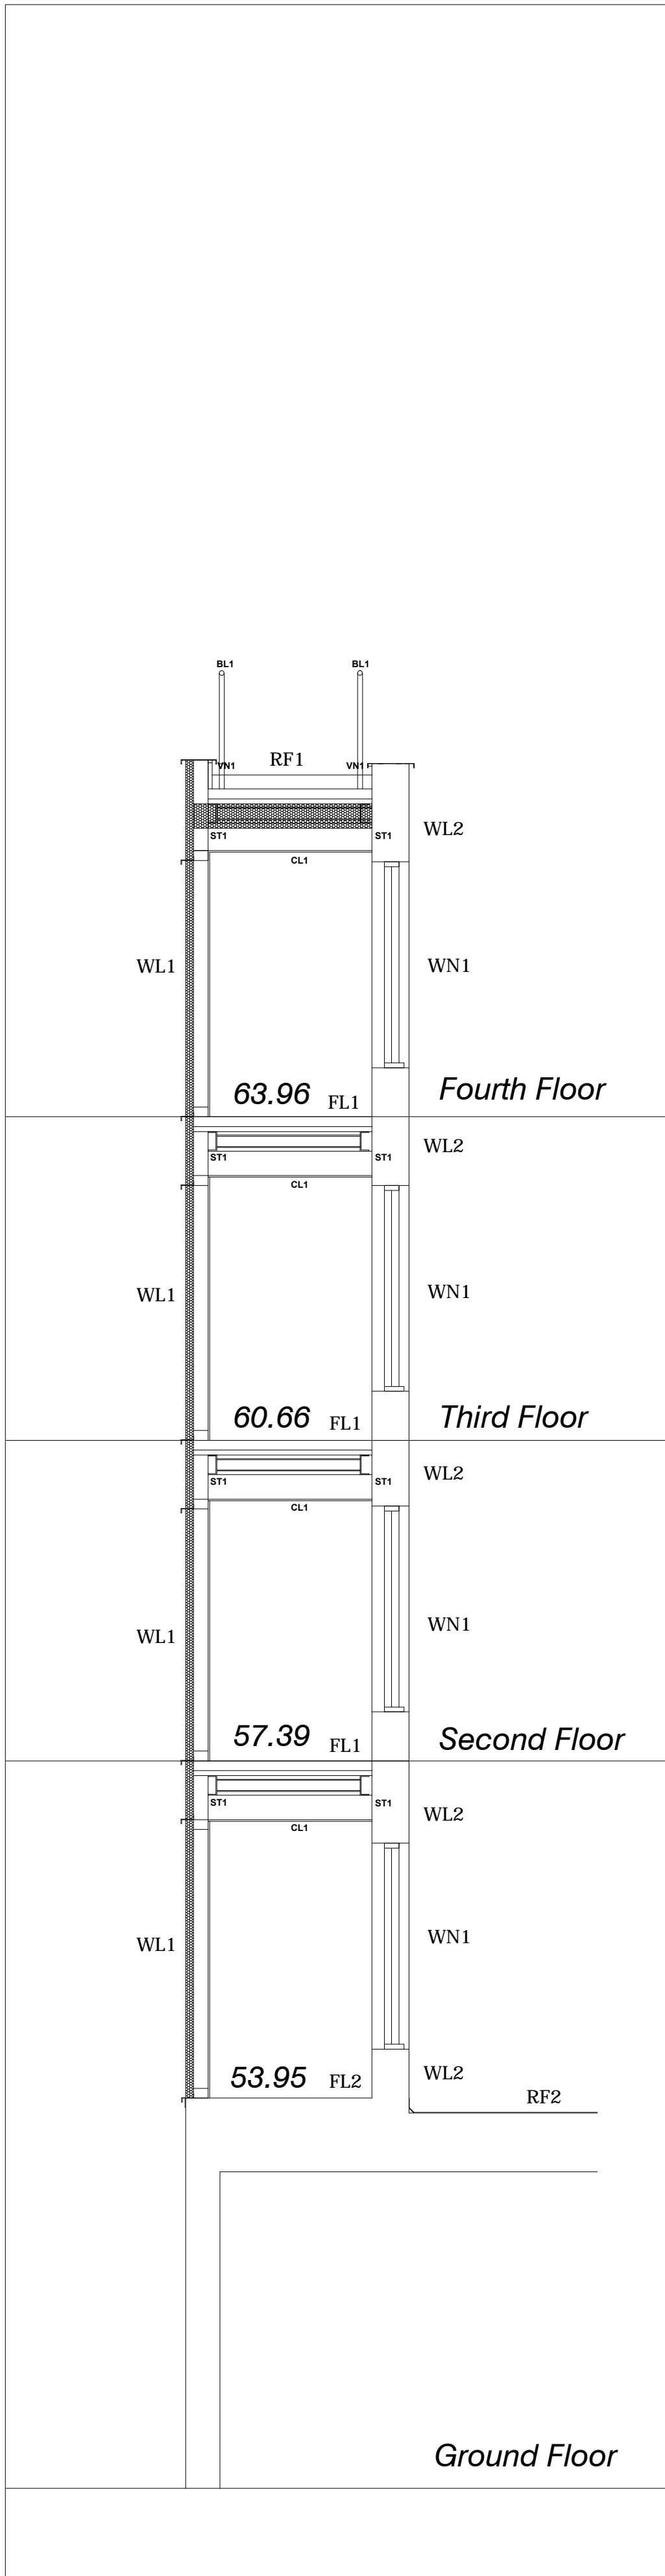


SECTION BB

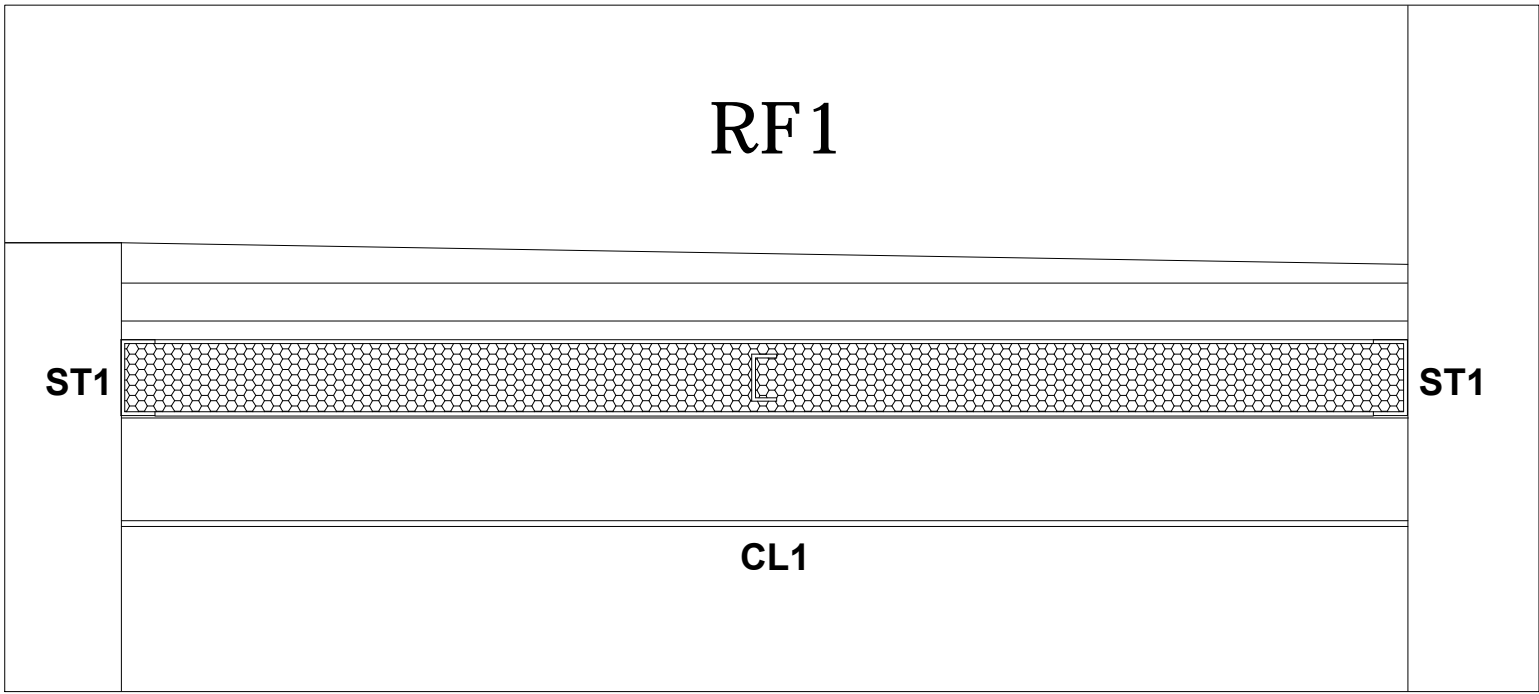


DETAIL SECTION AA- ROOF

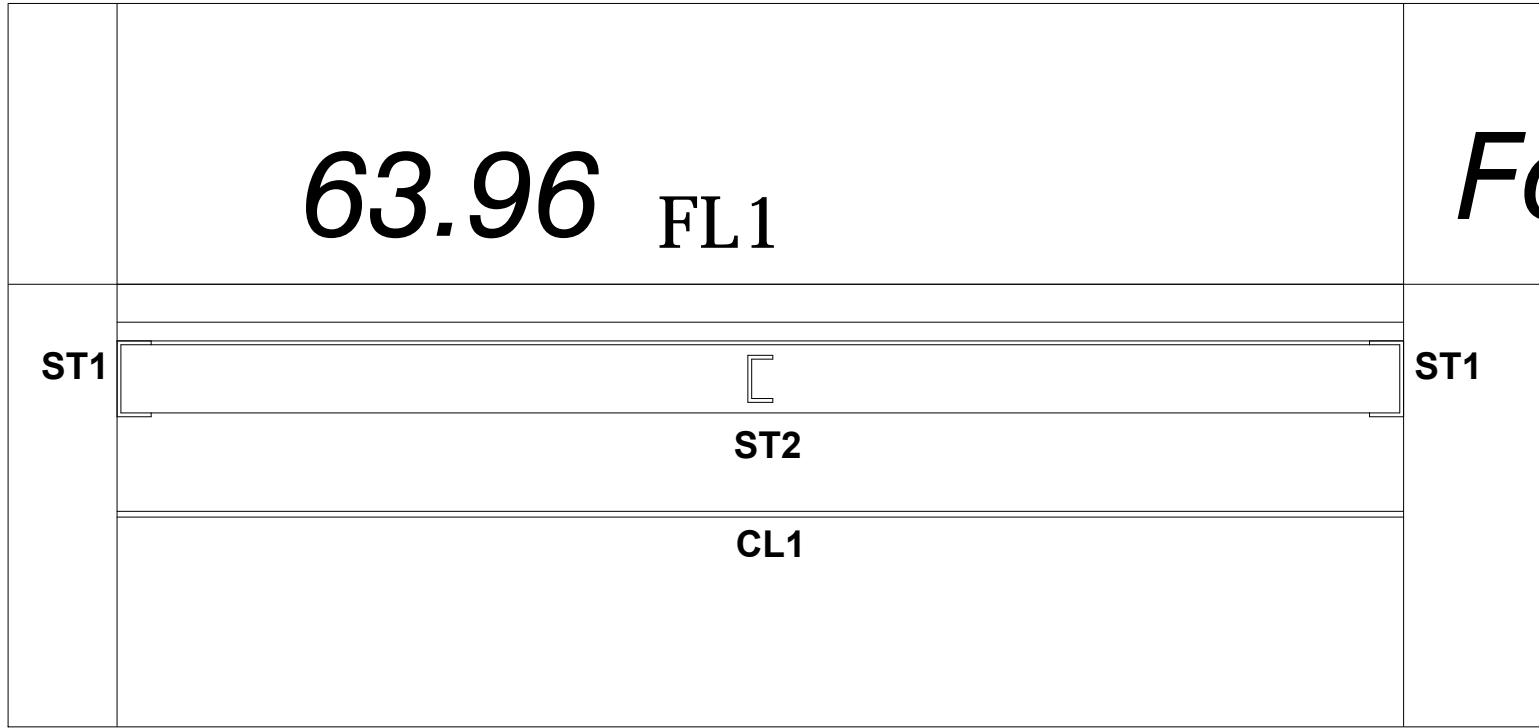


DETAIL SECTION AA- INTERMEDIATE FLOOR

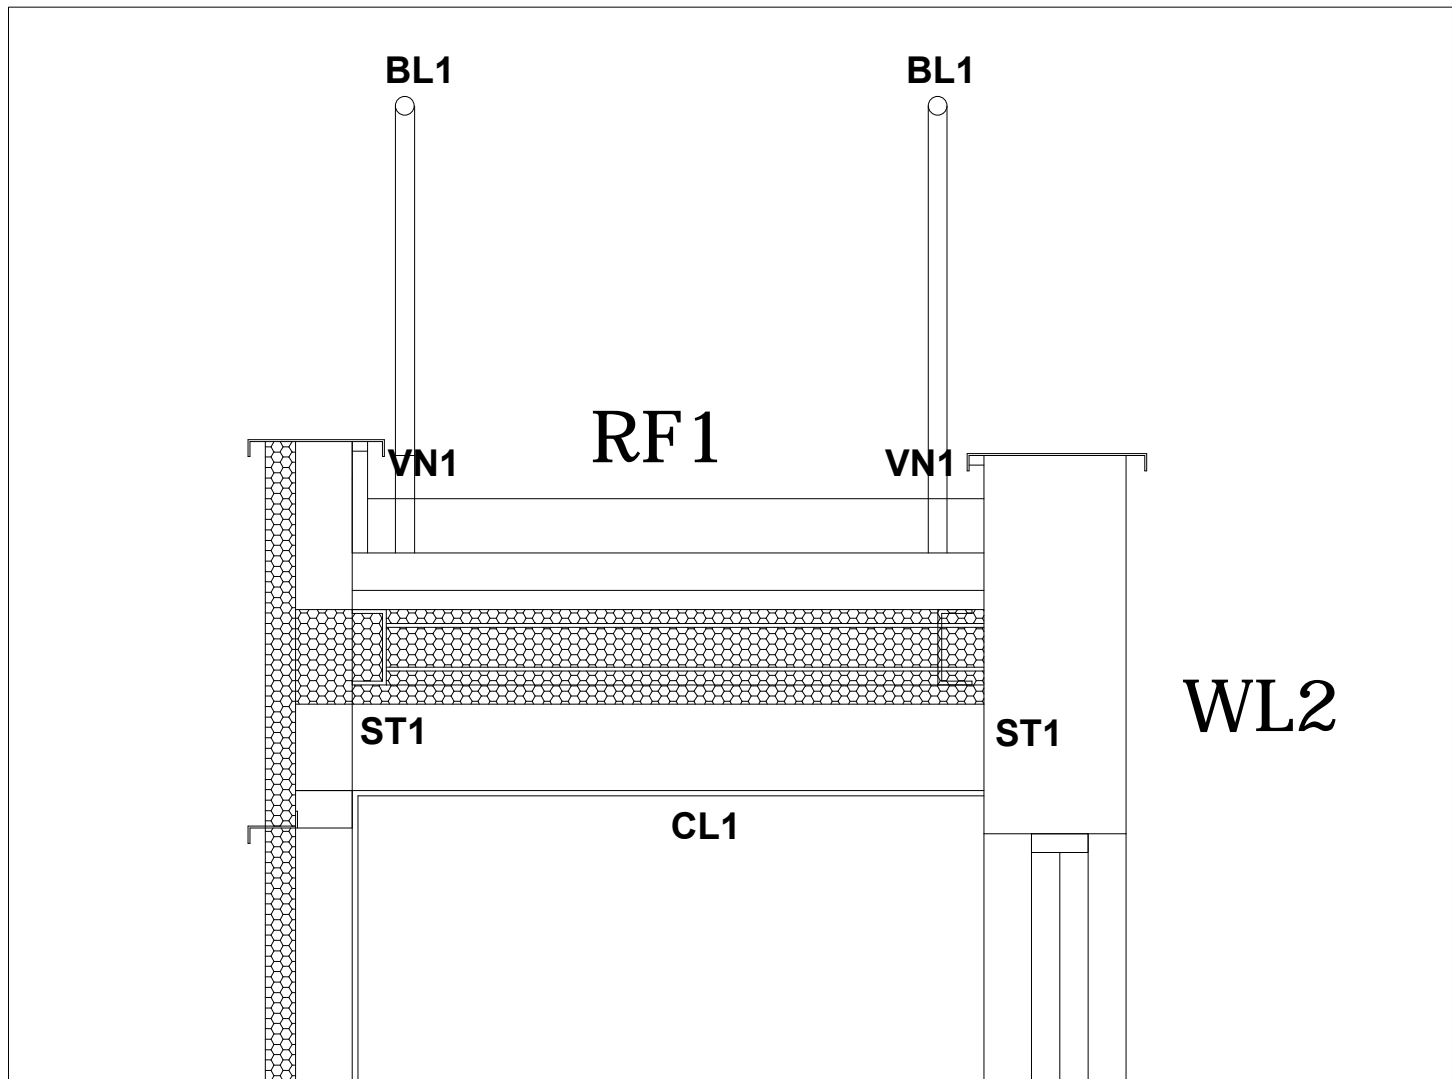


DETAIL SECTION BB - ROOF

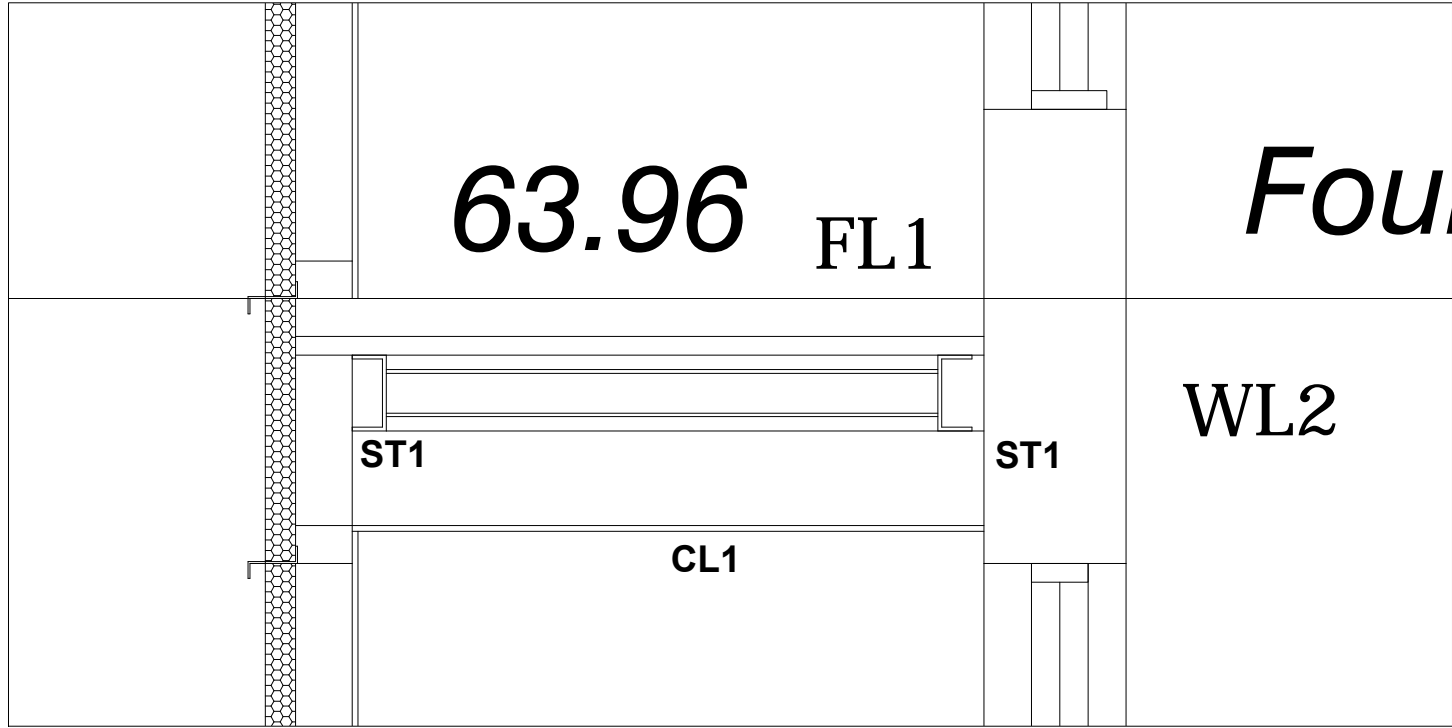

DETAIL SECTION BB- INTERMEDIATE FLOOR

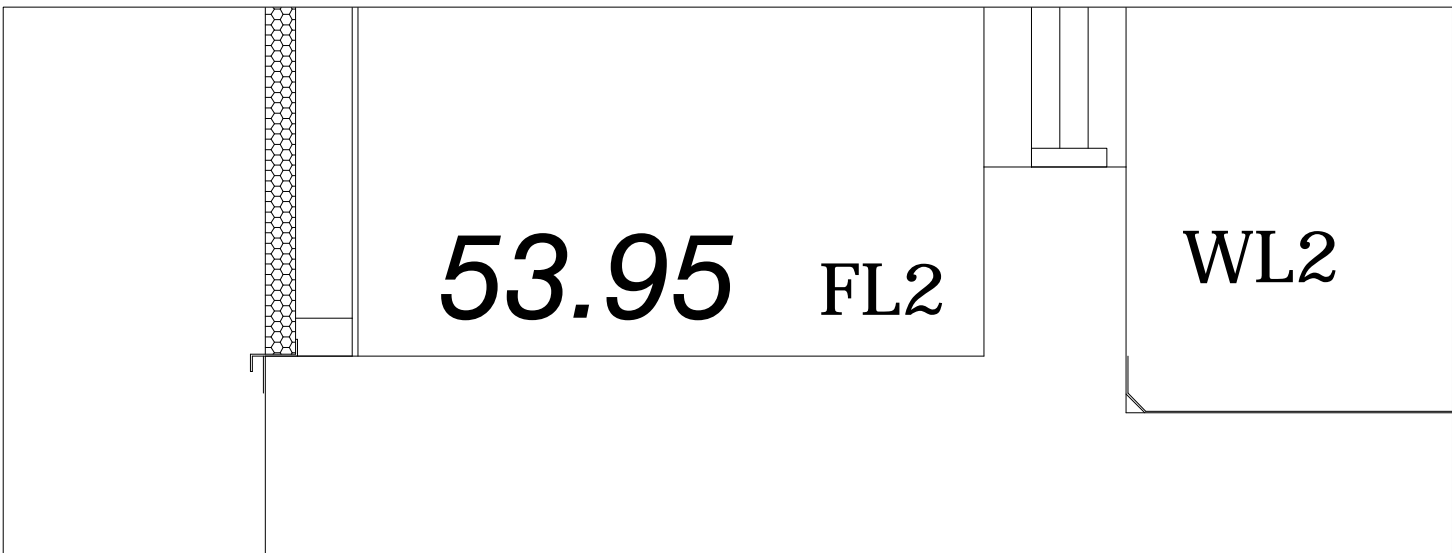

DETAIL ON SECTION BB FIRST FLOOR

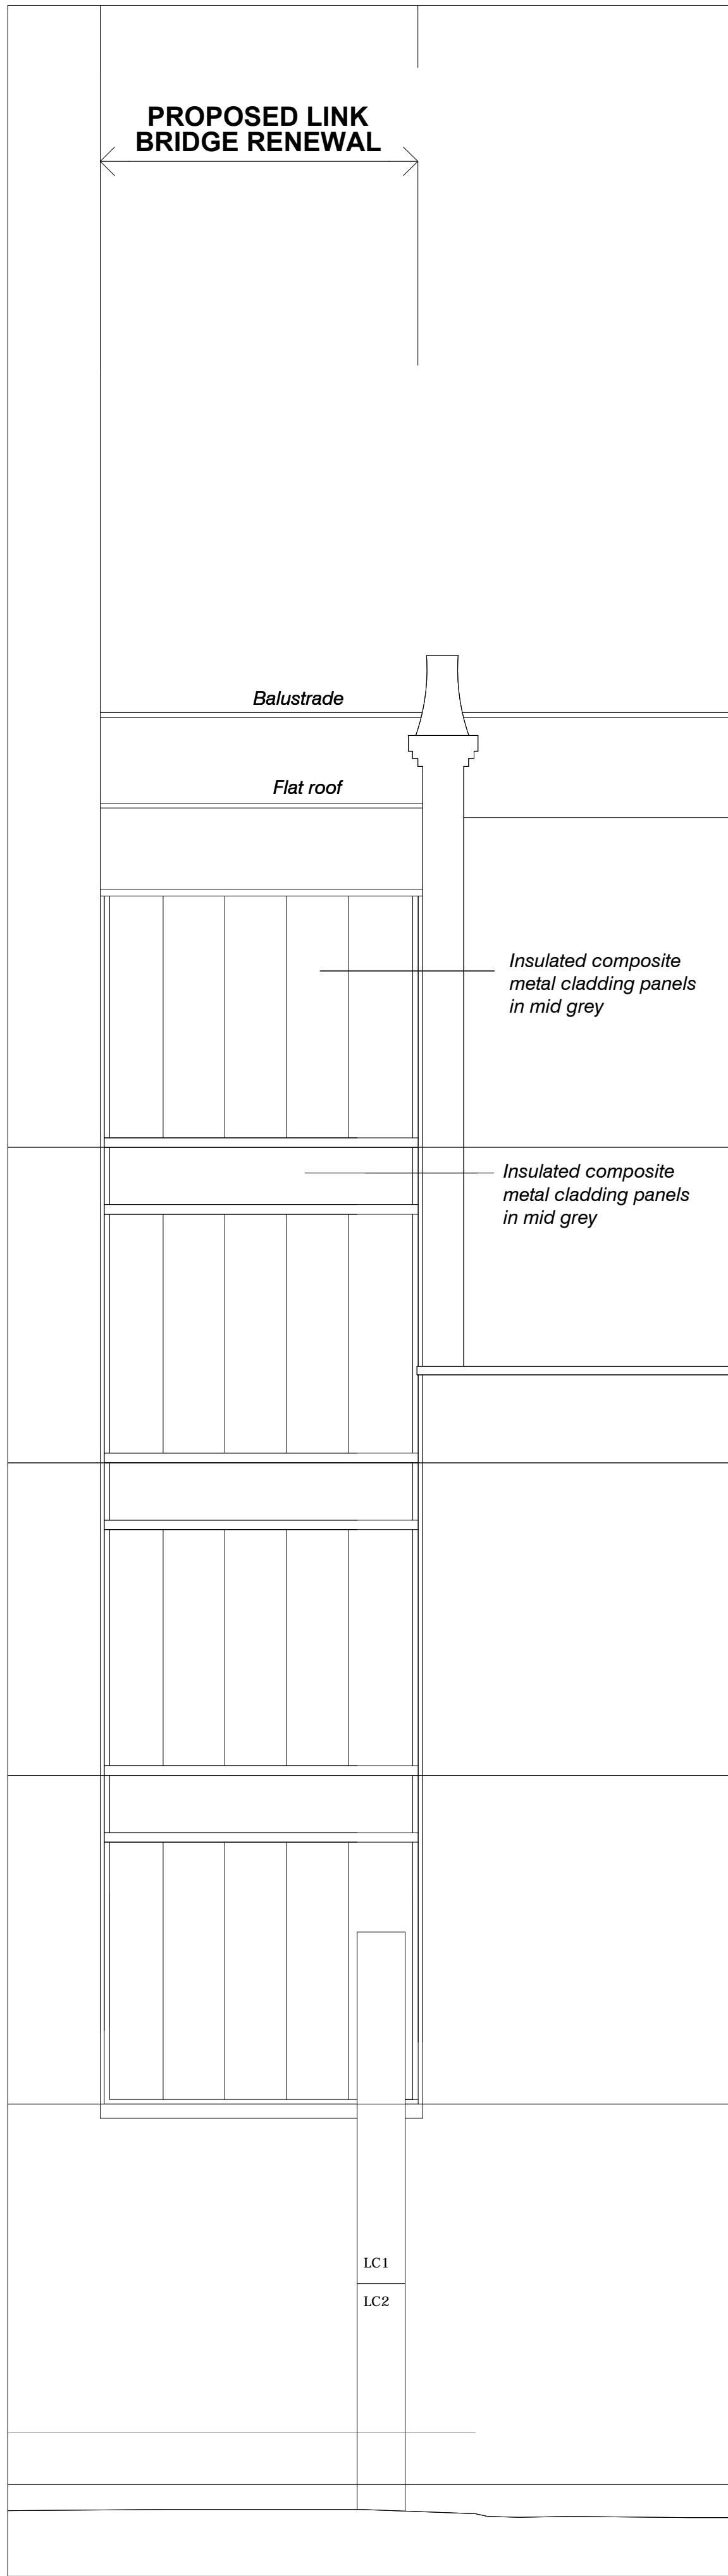

REAR ELEVATION -(WALL CLADDING)

GENERAL NOTES

© This drawing remains the copyright of Unwin Jones Partnership. DO NOT SCALE from this drawing. If in doubt ask. If you have received this drawing electronically in PDF format it may not be to the correct scale when printed, and is not to be used for measurement purposes.

RF1 - CONSTRUCT NEW ROOF COMPRISING ASPHALTE TO MATCH EXISTING ON MIN 50 SCREED TO 140 FALL TO EXISTING RW OUTLET ON CONCRETE INFILLED PROFILED METAL DECK ON STEELWORK TO STRUCTURAL ENGINEERS DESIGN.
250mm MINERAL WOOL BELOW METAL DECK WITH 500g POLYTHENE VAPOUR BARRIER BENEATH.

RF2 - EXISTING ROOF TO REMAIN.

WL1 - CONSTRUCT NEW WALL COMPRISING 80mm COMPOSITE INSULATED METAL CLADDING PANELS ON METAL FRAME LINED INTERNALLY WITH 12.5mm PLASTERBOARD AND SKIM.

WL2 - CONSTRUCT NEW INSULATED CAVITY WALLS COMPRISING CONCRETE BLOCK INNER LEAF TO STRUCTURAL ENGINEERS DESIGN, CAVITY PARTIALLY FILLED WITH INSULATION AND 100 FACING BRICK OUTER LEAF.

FL1 - CONSTRUCT NEW FLOORS AT SECOND, THIRD AND FOURTH FLOOR LEVELS COMPRISING MESH REINFORCED CONCRETE SLAB ON PROFILED METAL DECK SUPPORTED OFF PYS BETWEEN EDGE STEELS TO STRUCTURAL ENGINEER'S DESIGN.

FL2 - EXISTING FLOOR TO REMAIN

RW1 - EXISTING RAINWATER ROOF OUTLETS AND DOWNPIPES TO BE MAINTAINED AND DIVERTED AND RECONNECTED IF NECESSARY

BL1 - NEW BALUSTRADE 1100 HIGH TO COMPLY WITH PART K OF BUILDING REGULATIONS.

DP1 - CUT IN VERTICAL DPC AT JUNCTION OF NEW WALL CLADDING/CURTAIN WALLING WITH EXISTING MASONRY WALLS WHERE SHOWN.

ST1 - 200 x 90 x 30 PFC (SEE STRUCTURAL ENGINEER'S DRAWINGS)

ST2 - 125 x 65 x 14.8 PFC (SEE STRUCTURAL ENGINEER'S DRAWINGS)

CL1 - SUSPENDED CEILING TILES

VN1 - PROVIDE 25mm INSECT PROOF CONTINUOUS CROSS VENTILATION TO ROOF VOID ABOVE INSULATION LEVEL

LC1 - INSTALL NEW LAUNDRY CHUTE WHERE SHOWN.


LC2 - RECONNECT NEW CHUTE TO EXISTING WHERE SHOWN.

WN1 - NEW DOUBLE GLAZED ALUMINIUM FRAMED WINDOWS. LAMINATED SAFETY GLASS TO BE USED IN ANY PANELS WITHIN 800mm OF FINISHED FLOOR LEVEL, IN DOORS AND WITHIN 300mm OF DOORS.

REVISIONS
A 22.04.2014. GENERAL UPDATE
B 23.04.2014. LAUNDRY CHUTE ALTERED.
C 18.12.2014. SECTION ALTERED TO SHOW WINDOWS IN FACING BRICK

THISTLE BLOOMSBURY PARK

LINK BRIDGE
DETAILS

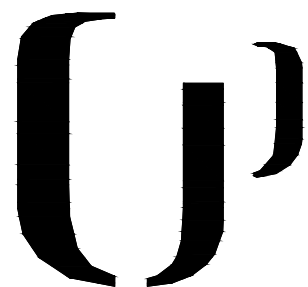

DRAWN: SCALE: 1:50 - 1:20
DATE: 04. 2014 DRAWING No: 2506/LB/03C
UNWIN JONES PARTNERSHIP
Bridge Lane Studio, Caldwgate, Carlisle, Cumbria, CA2 5SS • 01228 528266 • architects@ujp.co.uk • www.ujp.co.uk