


N.B. Trees and spreads shown indicatively, NO trees require removal as a result of the proposed.

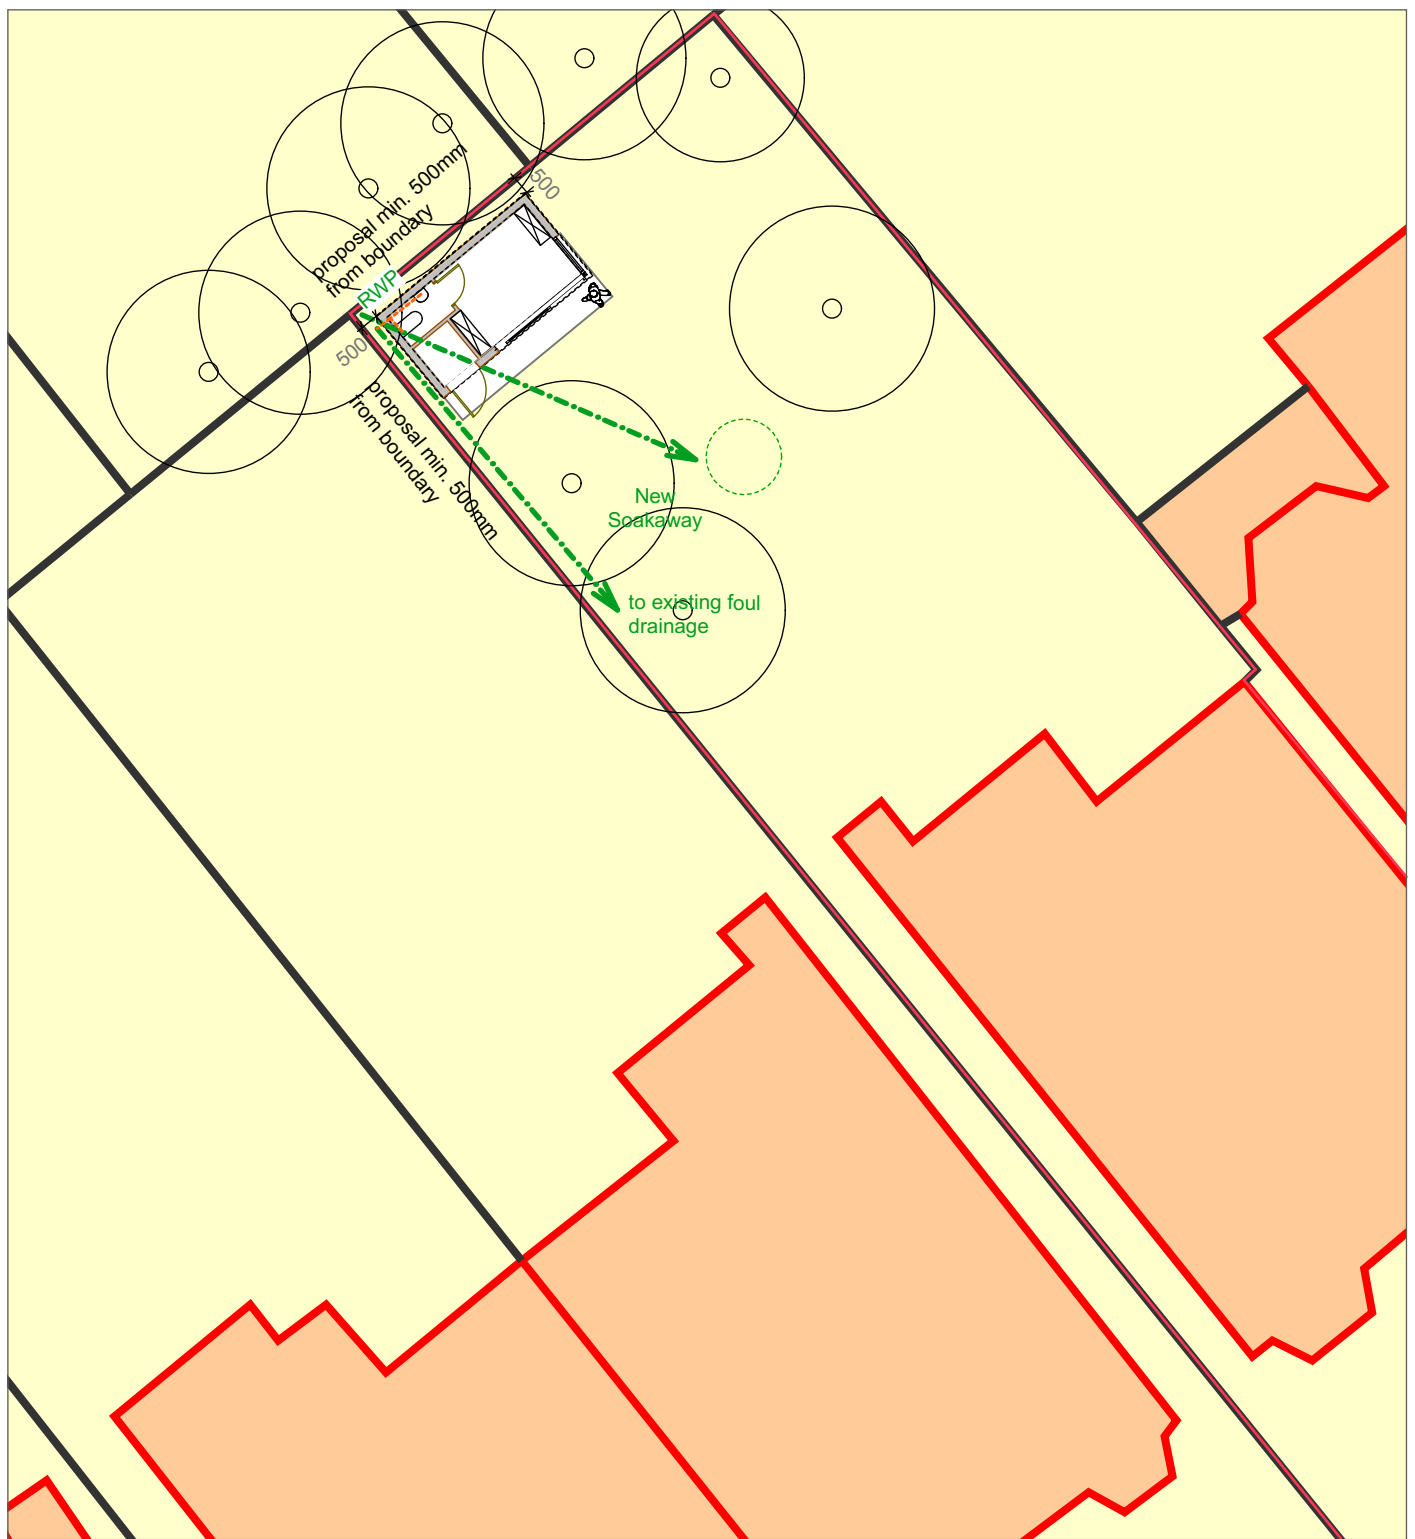

Foul Water discharged along min. 100mm internal diameter pipe at min. 1.80 falls into existing man hole via new 450mm inspection chamber. Exact location to be determined on site.

Storm water to discharge to new soakaway: minimum 5000mm from any building and/ or boundary and designed in accordance with BRE 365 OR ALTERNATIVELY to existing storm systems. Details confirmed onsite.

Site Plan- 1:200 (at A3)

