





NOTES

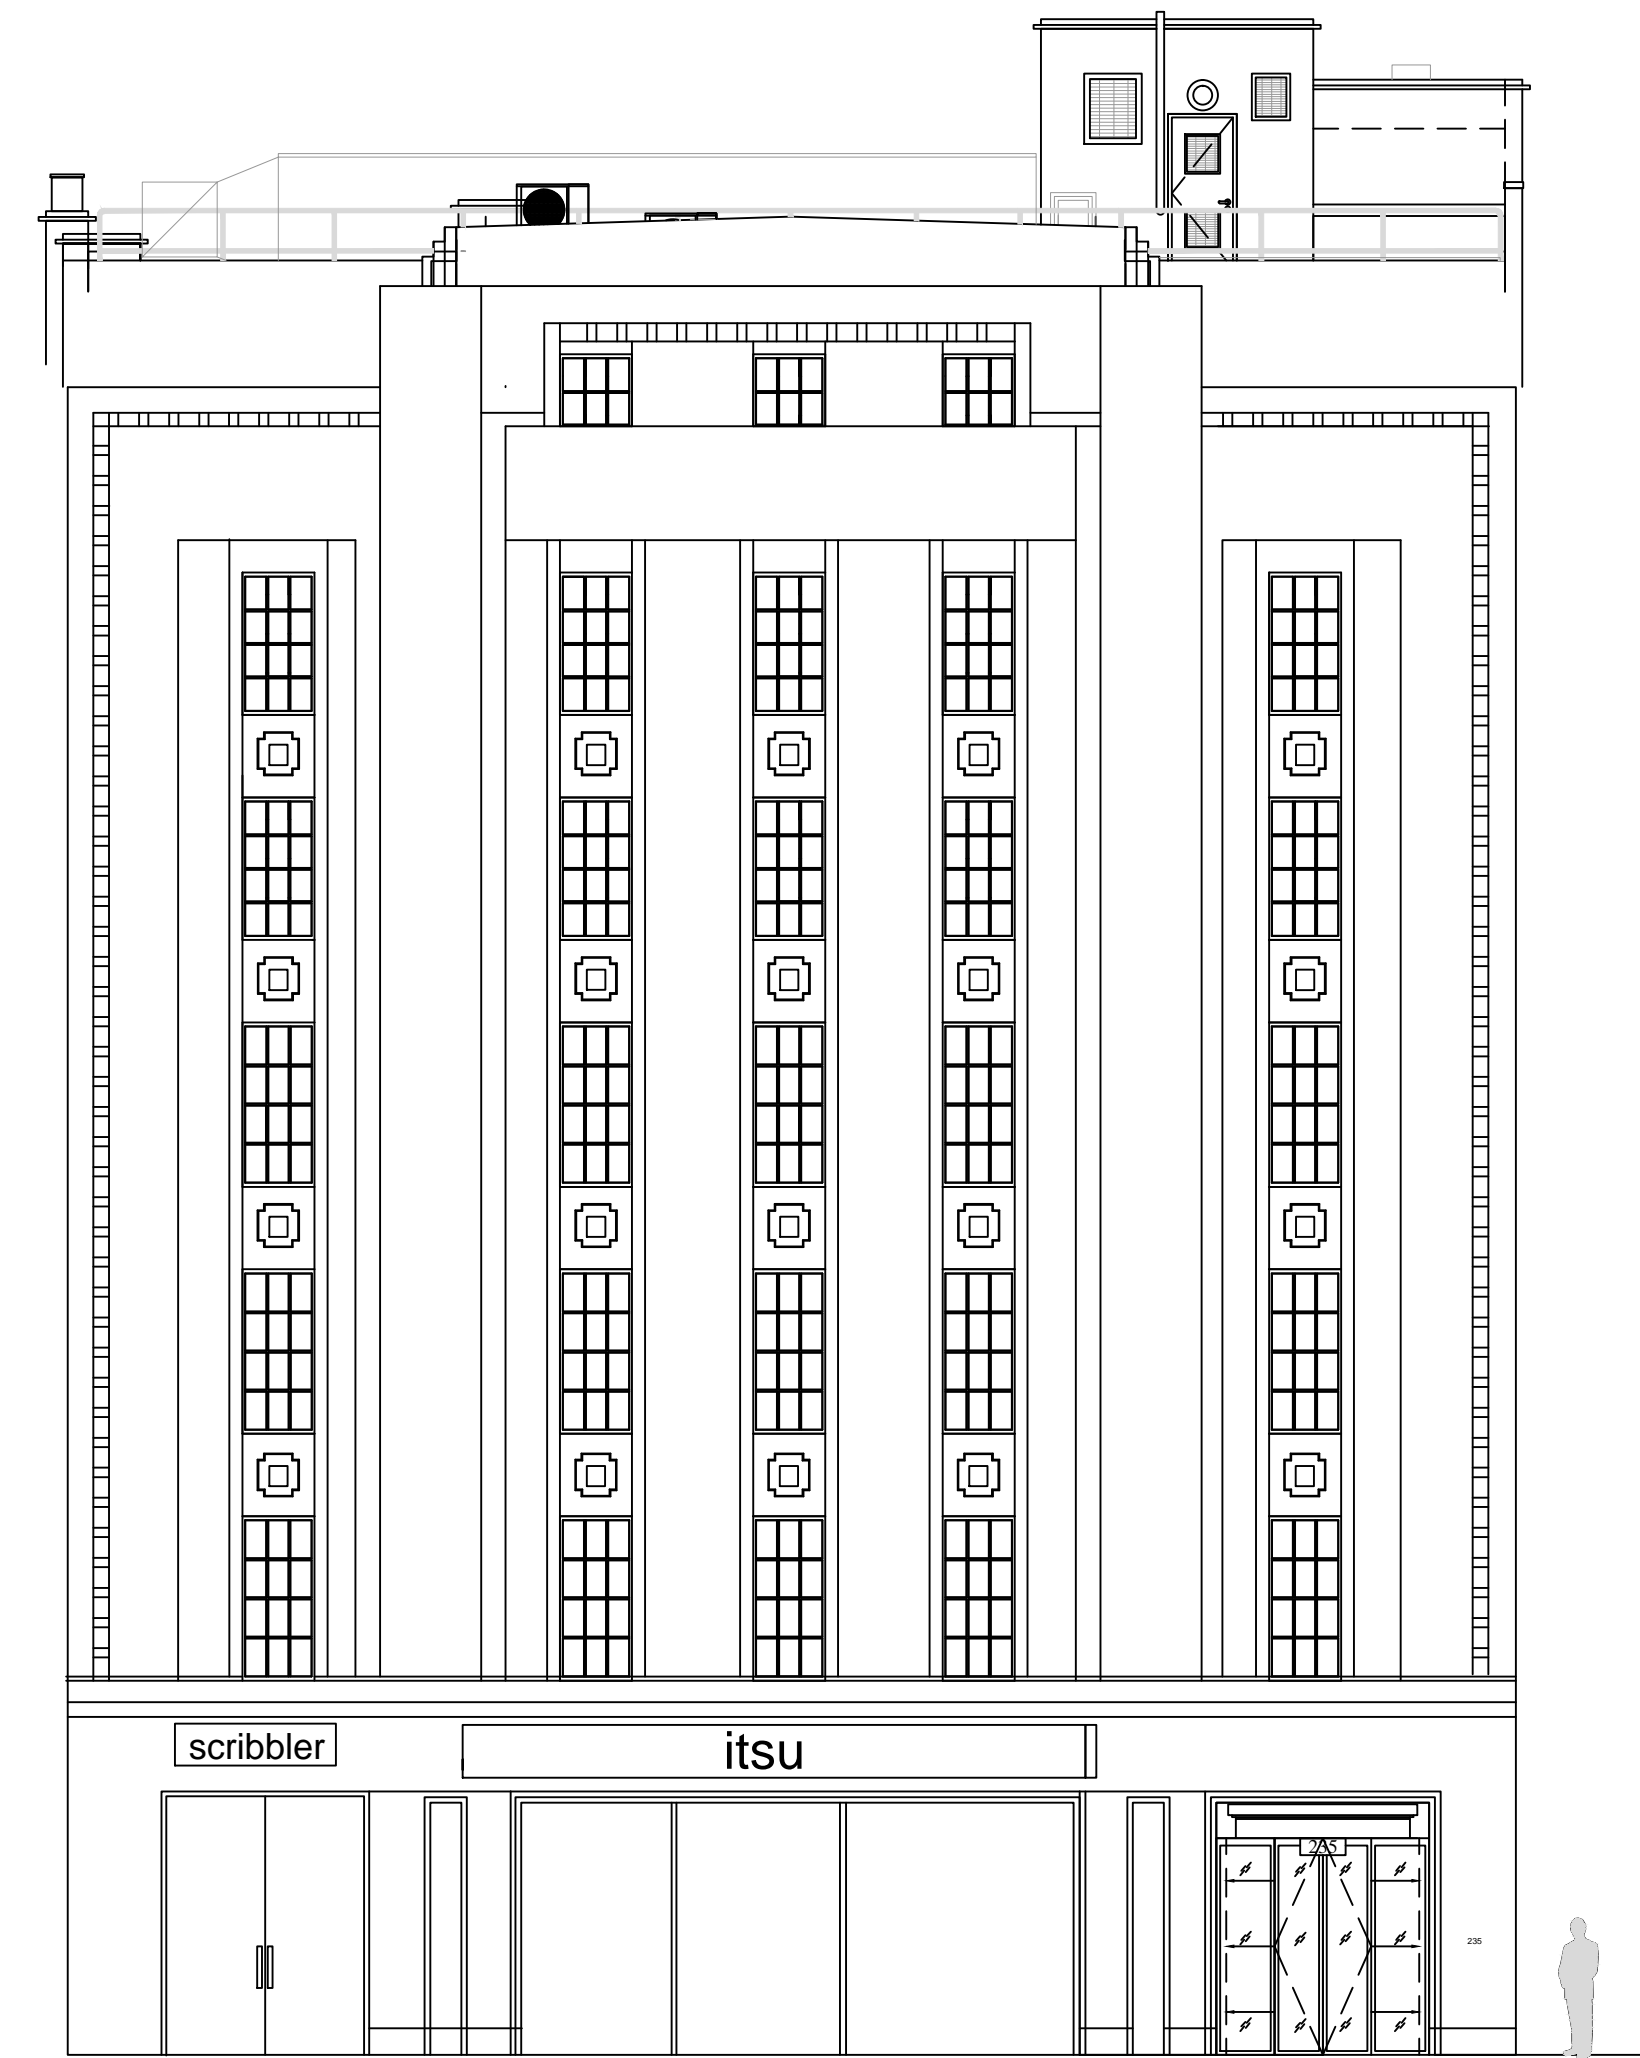

PROPOSED FRONT ELEVATION
Scale 1:100 @ A1

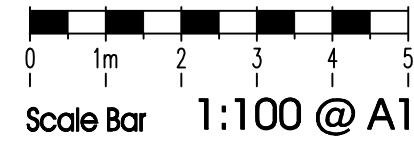

PROPOSED ROOF ELEVATION AA'
Scale 1:50 @ A1

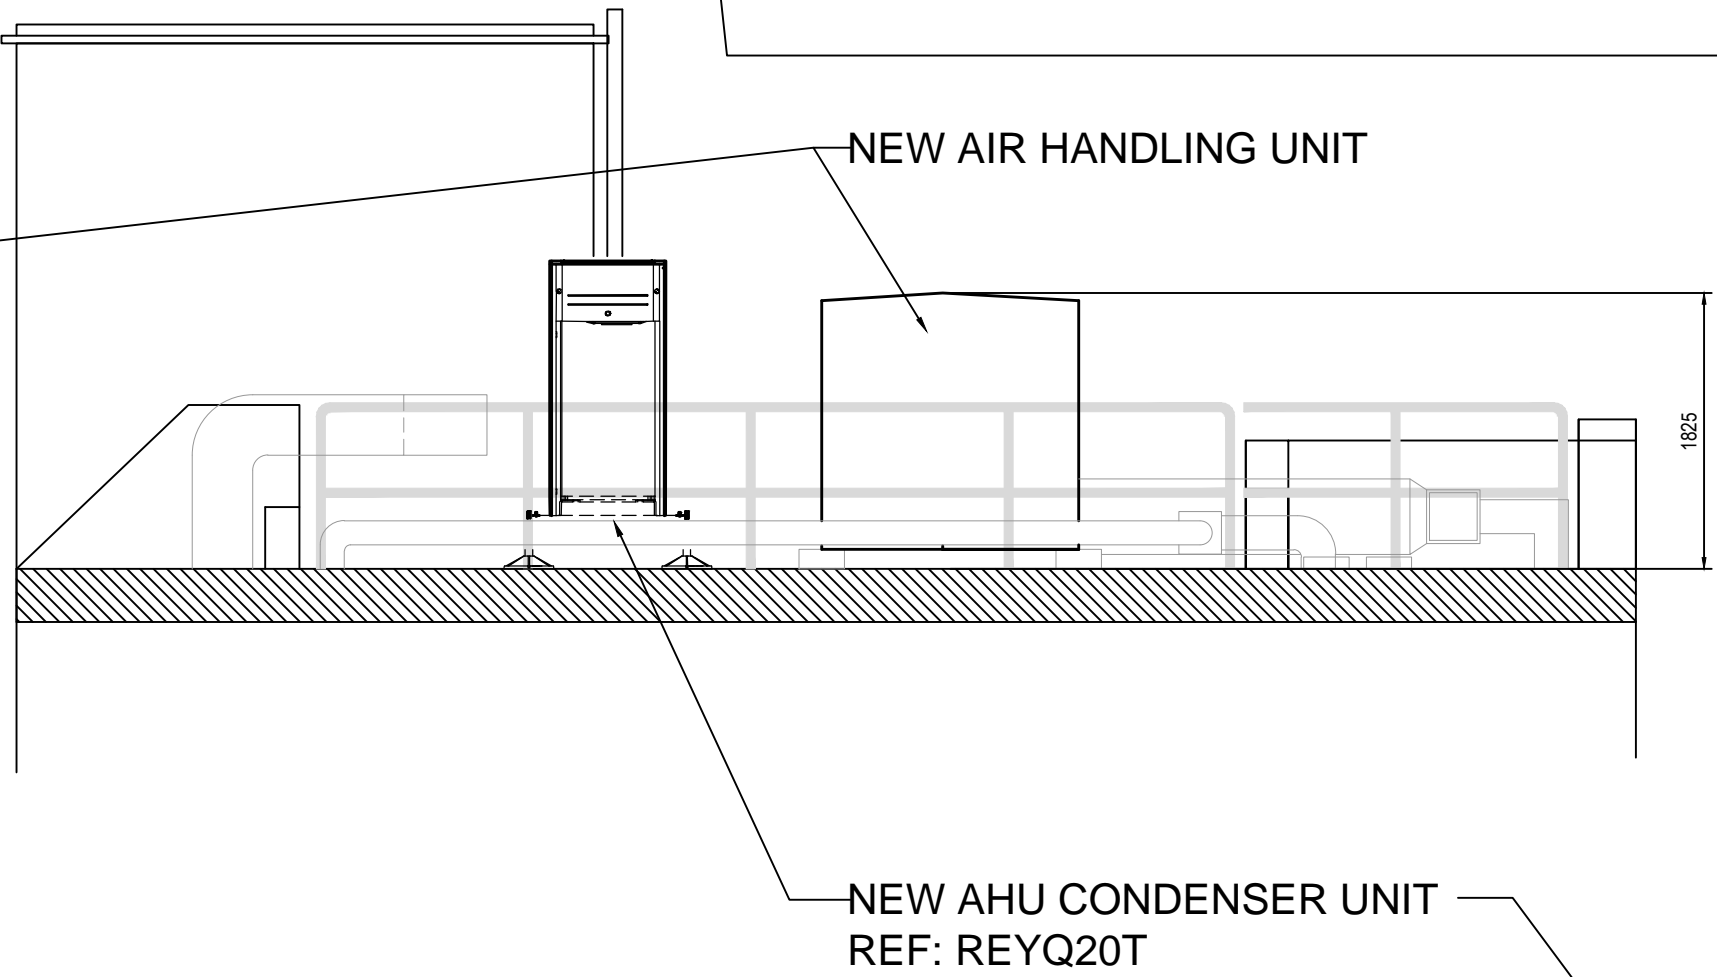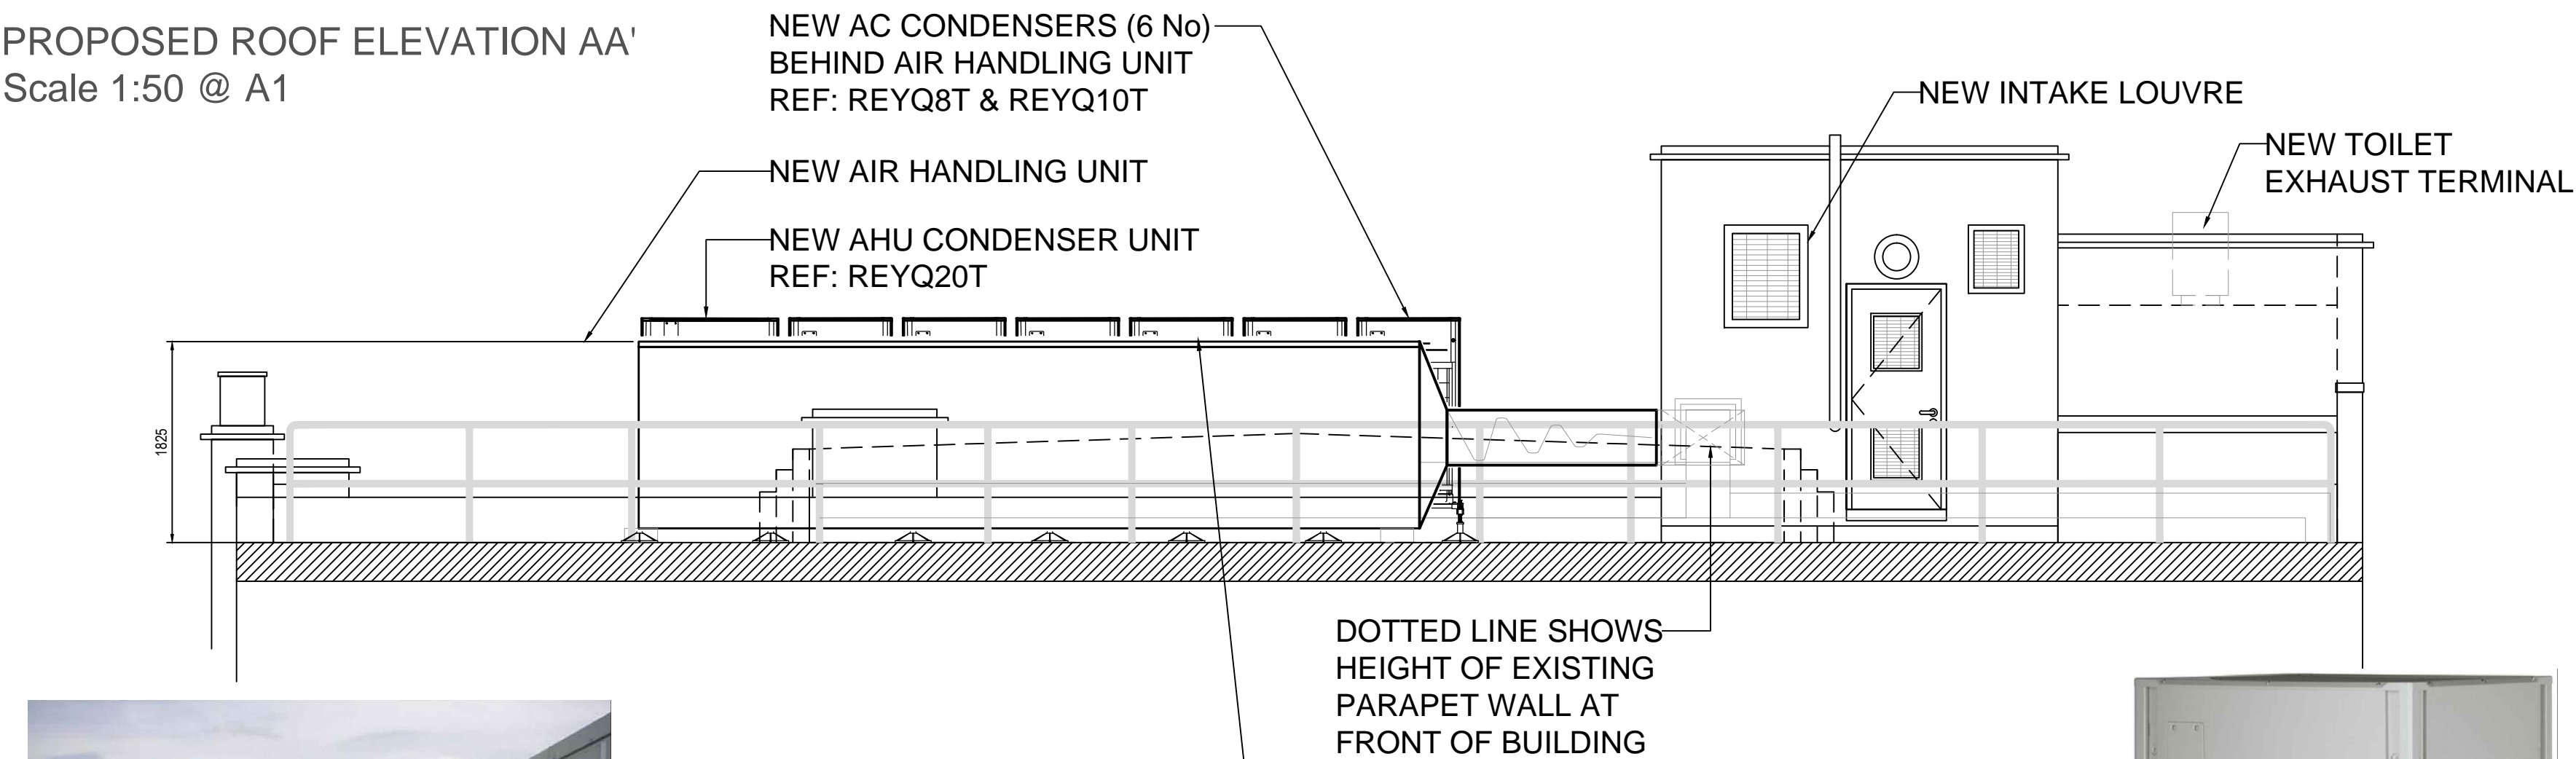

PROPOSED ROOF ELEVATION BB'
Scale 1:50 @ A1



PROPOSED CONDENSERS FOR THE NEW VRF EQUIPMENT:

SYSTEM (Floor Served)	QTY	Daikin (Model Reference)	Height (mm)	Width (mm)	Depth (mm)	Sound Pressure (dBA)	Colour
System 1	1	REYQ10T7Y1B	1685	930	765	58	Daikin White
System 2	1	REYQ10T7Y1B	1685	930	765	58	Daikin White
System 3	1	REYQ10T7Y1B	1685	930	765	58	Daikin White
System 4	1	REYQ10T7Y1B	1685	930	765	58	Daikin White
System 5	1	REYQ8T7Y1B	1685	930	765	58	Daikin White
System 6	1	REYQ8T7Y1B	1685	930	765	58	Daikin White
AHU DX Unit	1	RYYQ20T7Y1B	1685	1240	765	60	Daikin White

NEW AIR HANDLING UNIT BY DELAIR:

QTY	DELAIR Model Reference	Height (mm)	Width (mm)	Depth (mm)	Colour
1	MA50 / 8 / S	1825	7050	1700	Goosewing Grey

NOTES:
1) THE EXISTING 12 No CONDENSER UNITS ARE TO BE REMOVED AND REPLACED WITH 6 No UNITS TO SERVE THE FLOORS WITH ADDITIONAL 1 No CONDENSER INSTALLED (TO SERVE THE AIR HANDLING UNIT AT ROOF LEVEL). NB NET REDUCTION OF 5 CONDENSER UNITS

1	27-05-15	RE-ISSUED FOR APPROVAL
0	22.05.15	ISSUED FOR APPROVAL
Rev:	Date:	Description:

Direct Cooling Services U.K.
Air Conditioning - Refrigeration - Associated Services

200 Hockley Road, Rayleigh, Essex SS6 8ET
Tel: 01268 777667 Fax: 01268 777545
email: directcoolingservices@btconnect.com

Project:
235 HIGH HOLBORN
LONDON
WC1V 7DN

Drawing Title:
PROPOSED
ROOF EQUIPMENT
ROOF LEVEL

Scale:	As Shown	Date:	20.05.15
Drawn:	codservices.com	Checked:	M.B.
Drawing Status:	APPROVAL	Revision:	1
Drawing No.	R.MH.02		

