



24 m
22 m
20 m
18 m
16 m
14 m
12 m
10 m
8 m
6 m
4 m
2 m
0 m

ROOF PLAN - PROPOSED

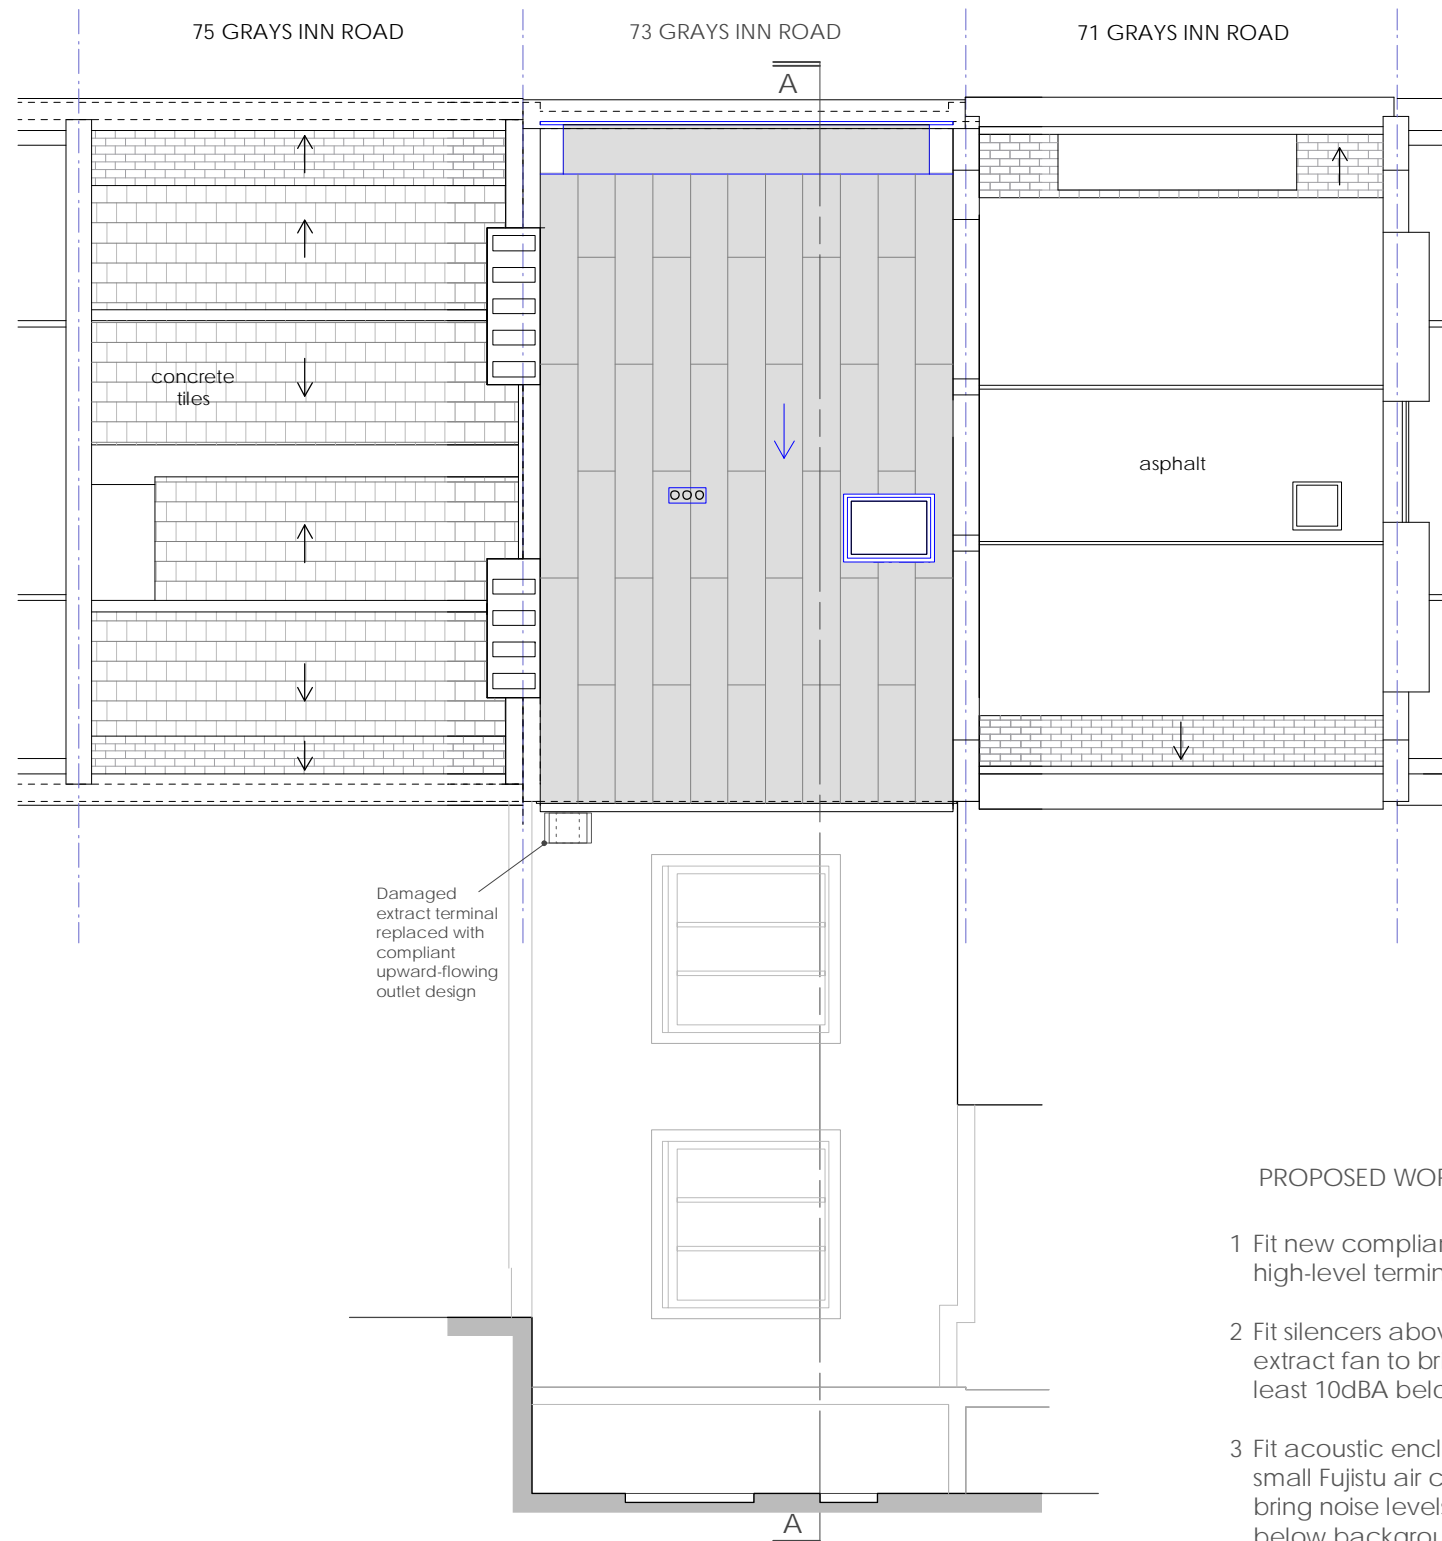

LOW LEVEL ROOF PLAN - PROPOSED

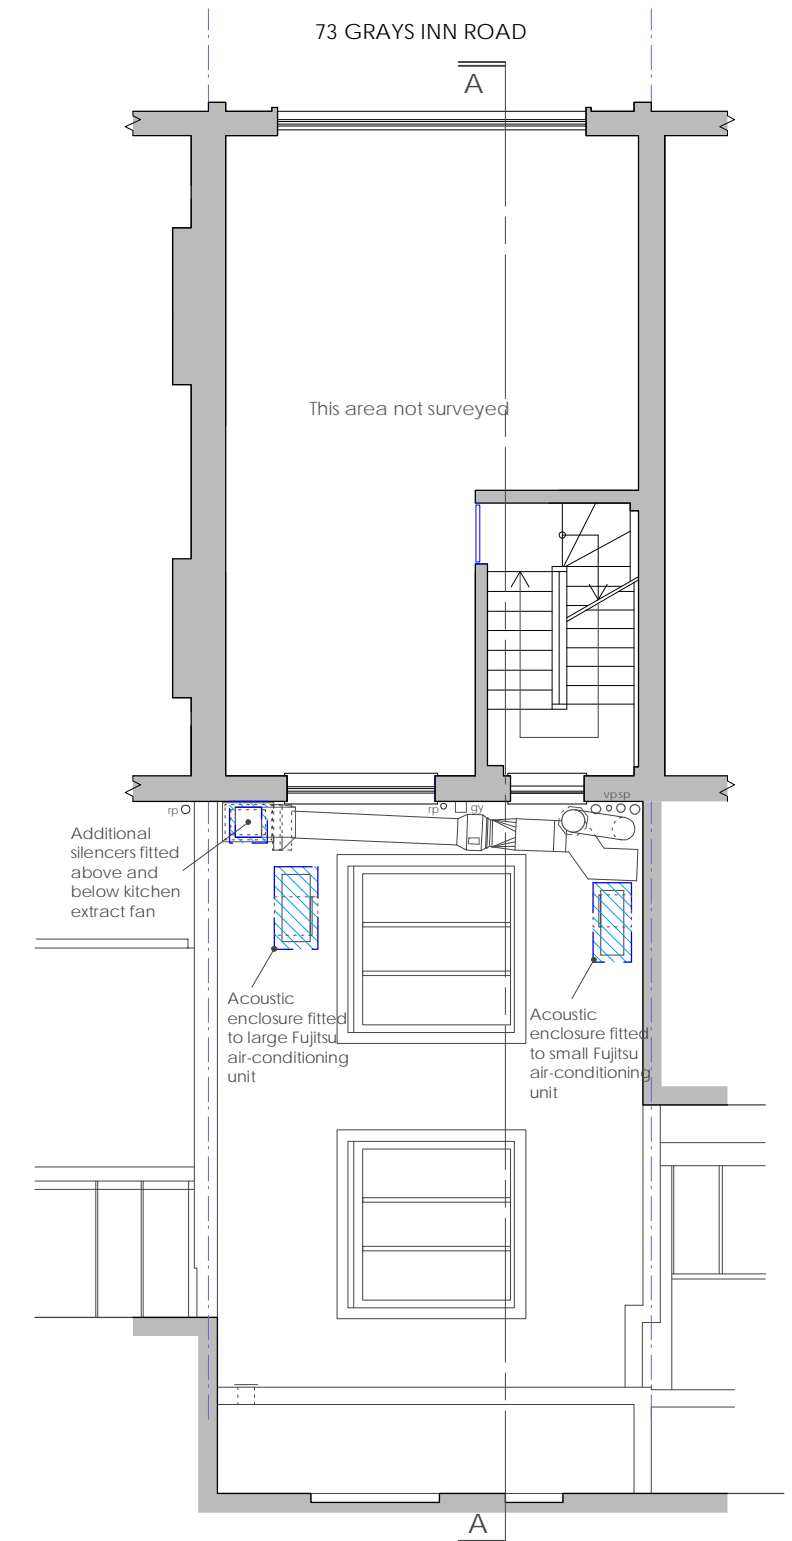

PROPOSED WORKS

- 1 Fit new compliant, upward flowing, high-level terminal to kitchen extract.
- 2 Fit silencers above and below kitchen extract fan to bring noise levels to at least 10dBA below background noise.
- 3 Fit acoustic enclosures to large and small Fujitsu air conditioning units to bring noise levels to at least 10dBA below background noise levels.