

**CAVITY TRAY AND TAPERED** WEEPHOLES (CAVITY TRAYS "BEAK WEEP" SHOWN) AT MAX. 450mm C/C'S WALL TYPE VARIES (D-TY-WT1 SHOWN): REFER TO GA-P FRAMING CRAMP (E.G SDV TYPE -HEIGHT ADJUSTABLE FRAME CRAMP). REFER TO D-TY FOR NOTES ON WALL TIES ALL FIXINGS THROUGH MEMBRANE TO BE FULLY SEALED RIGID EXTRUDED POLYSTYRENE INSULATION (E.G. DOW STYROFOAM™) BELOW DPC/CAVITY TRAY TO TIGHTLY FILL CAVITY BIN STORE DPC TO BE TAKEN 150mm MINIMUM ABOVE F.L BIKE STORE (Refer to GA-P) FOR SKIRTING BOARDS REFER TO NOTES FOR DETAILS D-J-405 &406 10mm GAP FOR PERIMETER ACOUSTIC SEAL (E.G. GYPROC SEALANT) SEALANT (E.G. MASTIC) ISOLATION EDGE STRIP (E.G. 18MM ISOLATION EDGE STRIP (E.G. MINIMUM -THICK POLYETHYLENE FOAM) 10MM THICK POLYETHYLENE FOAM) FLOOR TYPE FT1 (REFER TO D-TY-FT1) FLOOR TYPE FT3 (REFER TO D-TY-FT3) — F.L. (Refer to GA-P & GA-E) VISQUEEN SELF ADHESIVE TANKING falls 1:60 (TBC) MEMBRANE LAPPED WITH DPM S.S.L. (Refer to GA-P & GA-E) 300 overlap to DPM 1200 GAUGE DPM (E.G. VISQUEEN PIFA STANDARD) TO BE LAPPED WITH DPC / TANKING MEMBRANE BY A MINIMUM OF 150mm (300mm LAPS SHOWN) 50mm FULL FILL INSULATION (E.G. KNAUF "CROWN DRITHERM") 300mm LAPS TO DPM -(SEE OPPOSITE NOTE) SHARP SAND BLINDING TBC BY S.E. OPTION FOR HIGHLY INSULATING LOAD 10mm ISOLATION JOINT, AS S.E. DETAILS BEARING STARTER BLOCK (E.G. MARMOX (E.G. TO BE FILLED WITH "MIOTHENE 70" "THERMOBLOCK) COMPRESSIBLE FILLER) NOMINAL 6MM VISQUEEN "PROTECTION AND DRAIN BOARD" FROST RESISTANT CONCRETE BLOCKS BELOW GROUND VISQUEEN SELF ADHESIVE TANKING MEMBRANE LAPPED WITH DPM STRUCTURAL FOOTING IN ACCORDANCE WITH S.E. DETAILS: REFER TO S.E. DETAIL 12-0083/C/151 SECTION A-A (REVISION C3)


DETAIL - D-J-403 - Bin/Bike Store / Apartment block - Step in slab


NOTE: THIS DETAIL IS TO BE READ IN

CONJUNCTION WITH S.E. DETAIL 12-0083/C/151 SECTION A-A (REVISION C3) NOTE: THIS DETAIL IS TO BE READ IN

CONJUNCTION WITH DETAIL D-J-103 & 413

DETAIL - D-J-402 - Block B1 - Party wall - Step in ground floor slab

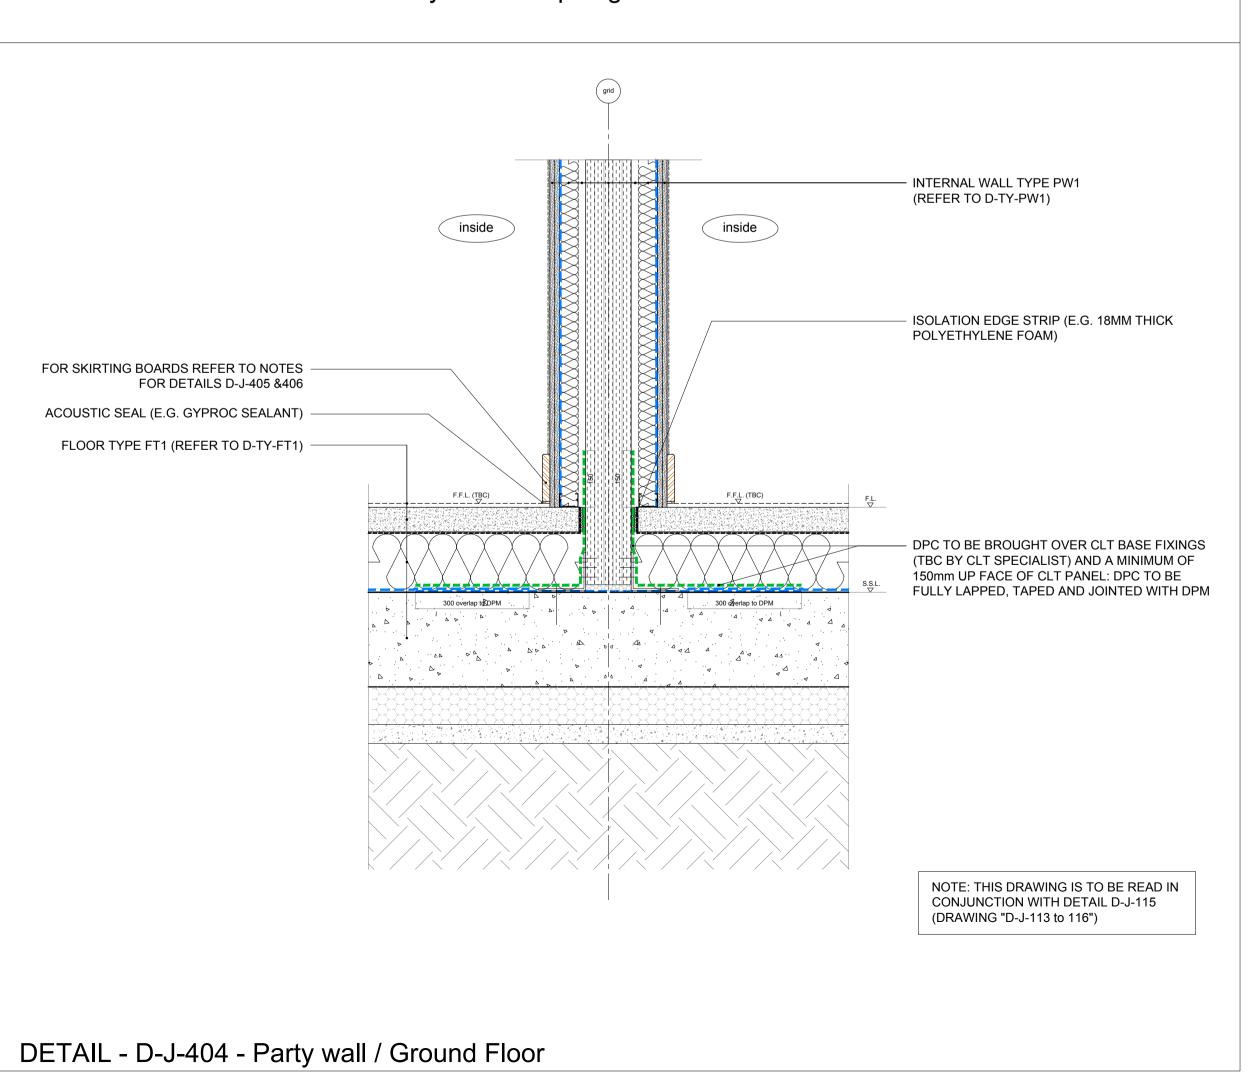

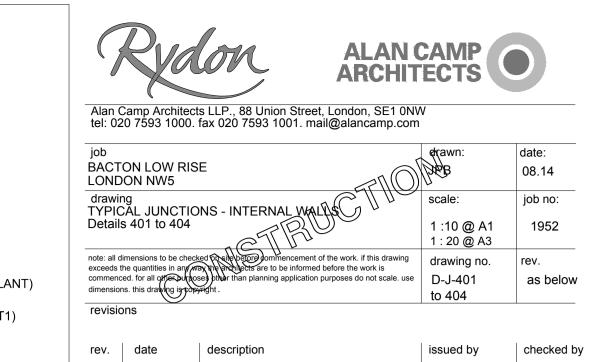

Issued for construction

Updates in responce to KCA

comments dated 14.11.14

GW

GW

JPB