

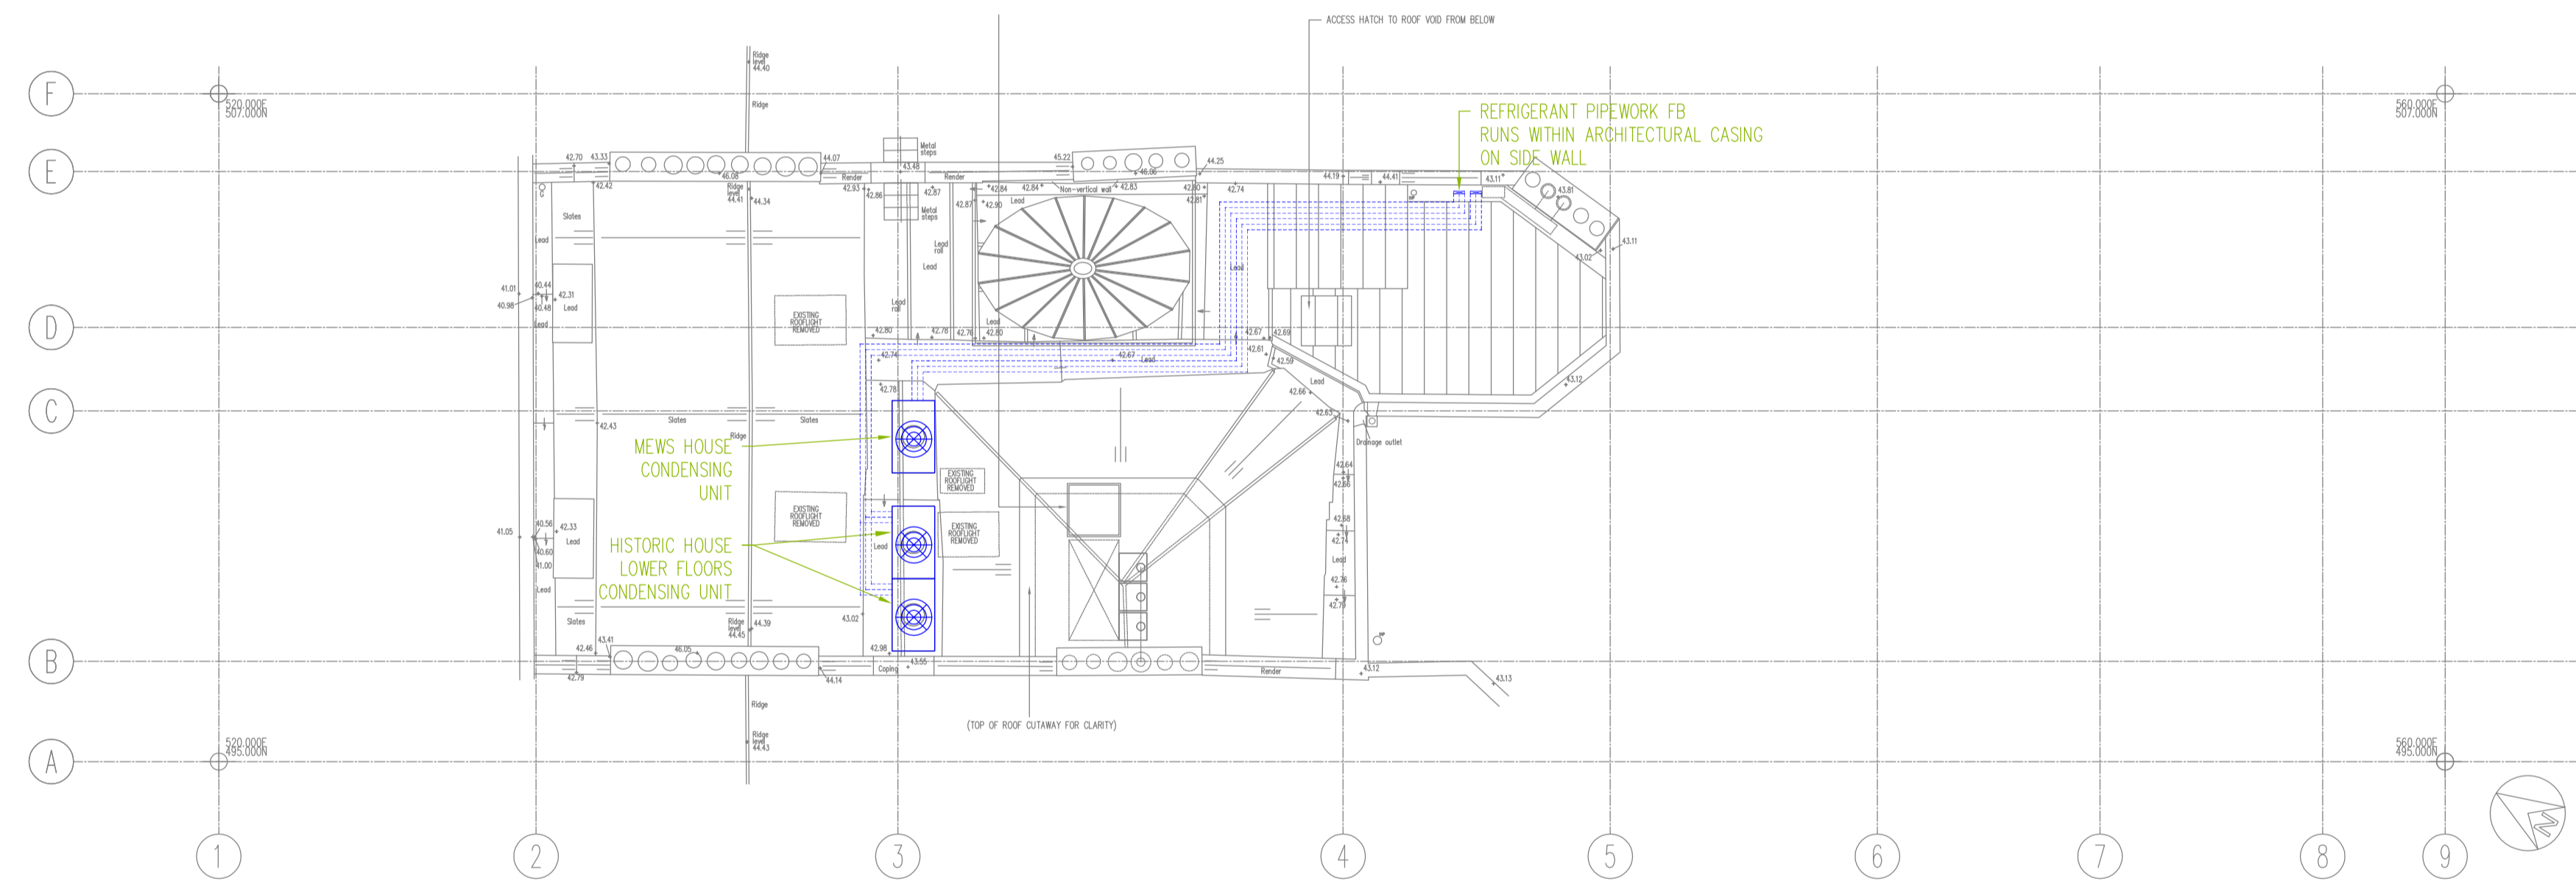


- NOTES:**
- The drawing does not necessarily show all the information needed to interpret the design intent or the construction details.
 - The drawing contains information from more than one source and must be read in conjunction with all relevant specifications.
 - Any apparent drafting errors and differences between other drawings and specifications shall be brought to our attention.
 - Xref Reference - BDP Dwg No. P2005698/15/AP026_Rev D
BDP Dwg No. P2005698/15/AP027_Rev C

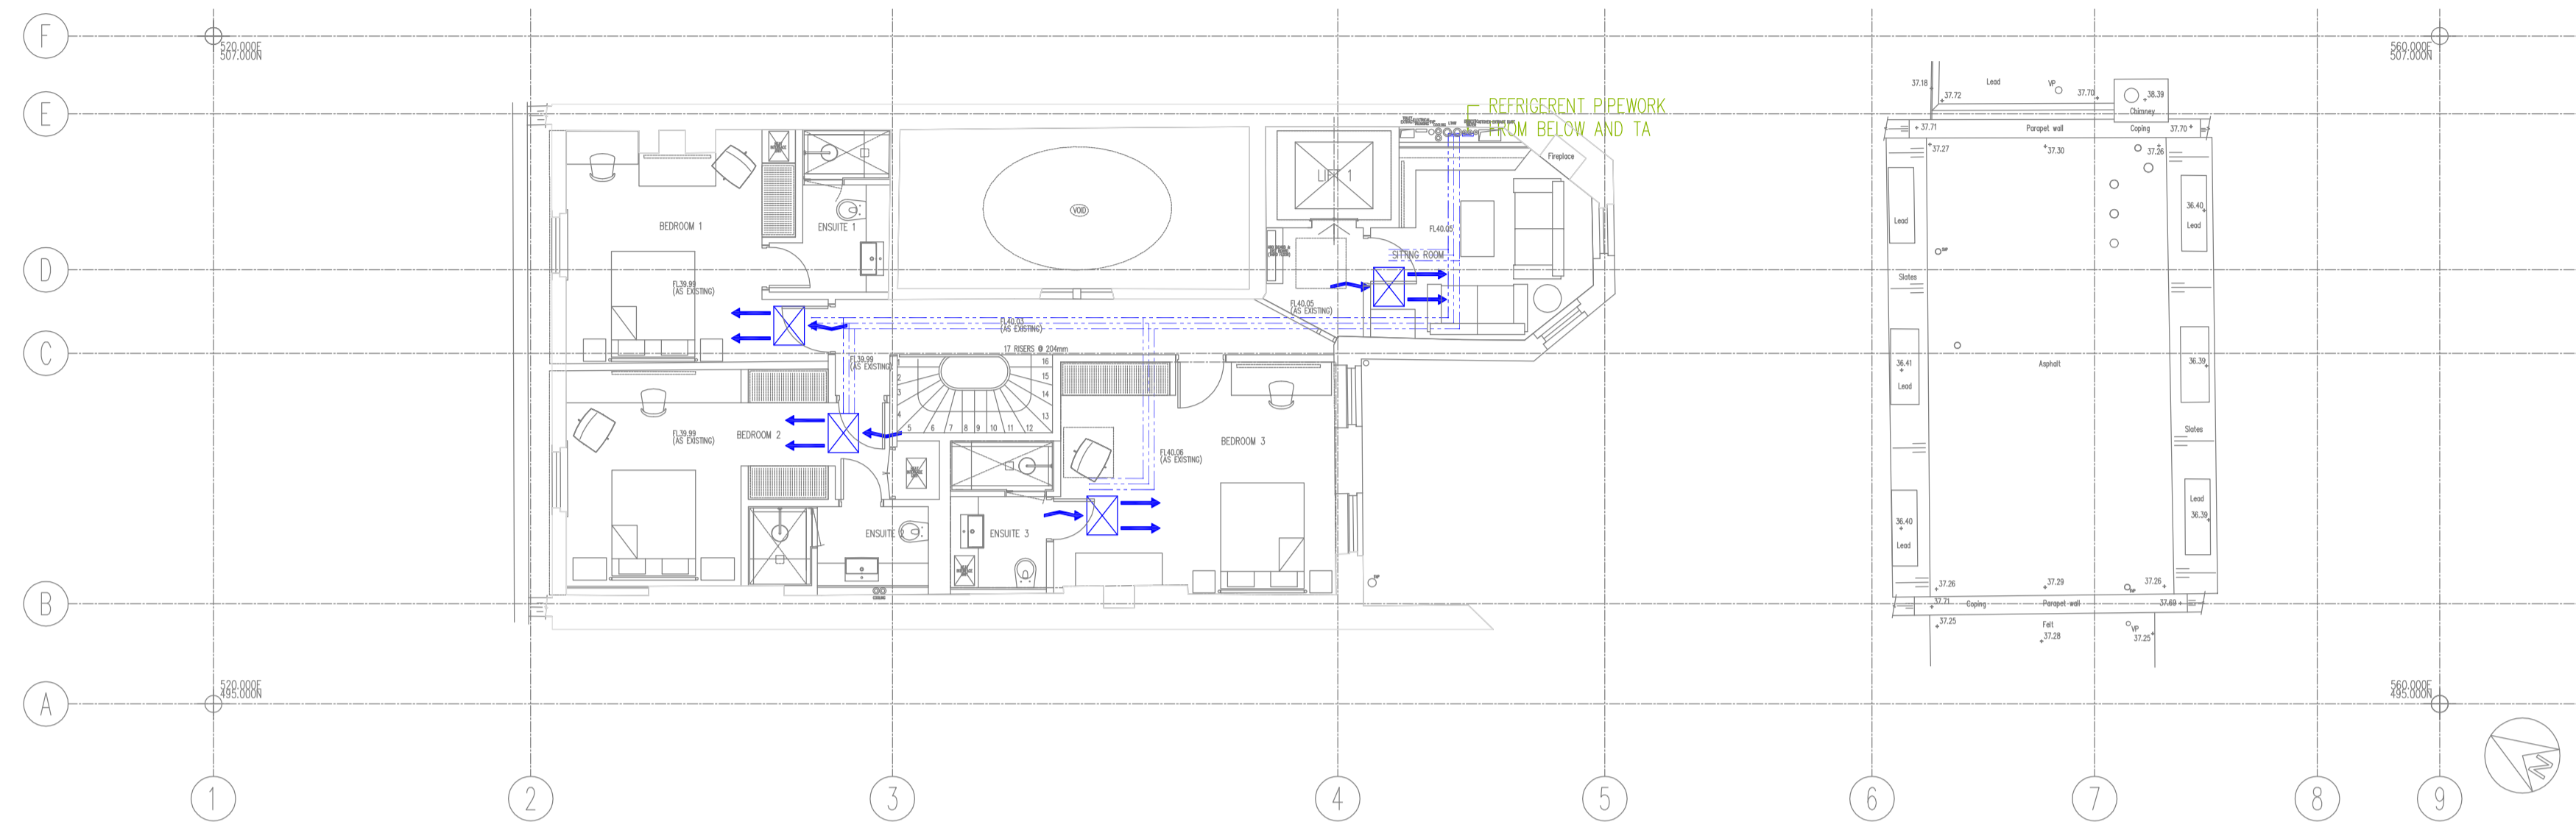

- KEY**
- SLIMLINE CEILING CONCEALED FAN COIL UNIT
 - VERTICAL CONCEALED FAN COIL UNIT WITHIN JOINERY (LOW LEVEL RETURN AIR HIGH LEVEL DISCHARGE)
 - REFRIGERANT PIPEWORK IN CEILING JOIST ZONE
 - REFRIGERANT PIPEWORK IN FLOOR JOIST ZONE

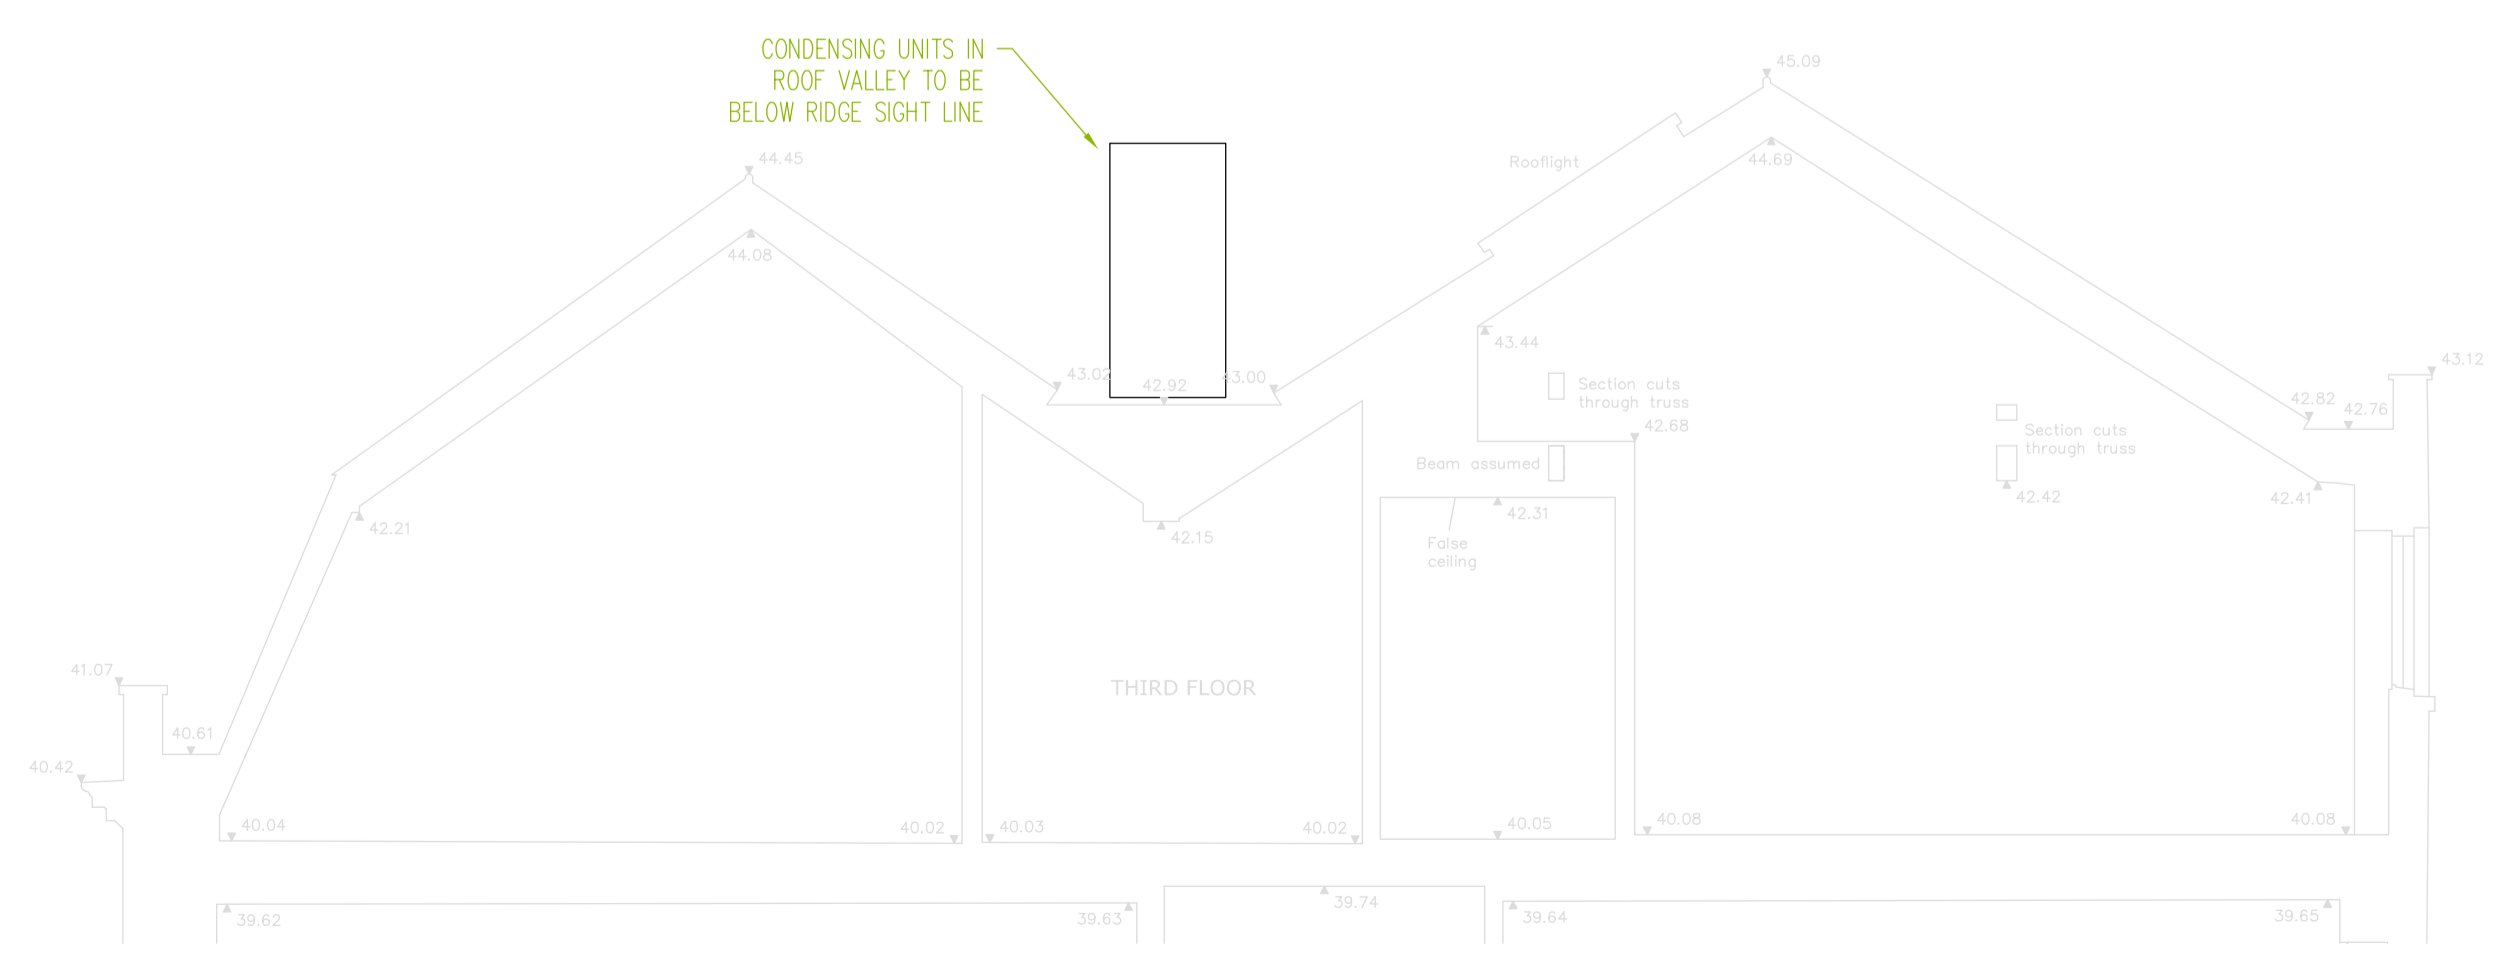

C	NOTATION UPDATED FOLLOWING COMMENTS	TS	TW	JUN'15
B	XREF UPDATED	TS	TW	JUN'15
A	PLANNING ISSUE	PC	MJ	AUG 13
P2	STAGE C	PC	MJ	JUNE 13

Revisions

Architect **BDP.**

Client

PLANNING

HOARE LEA

BIRMINGHAM
BRISTOL
CAMBRIDGE
CARDIFF
ISLE OF MAN
LEEDS
LONDON
MANCHESTER
OXFORD
PLYMOUTH
POOLE

Project Title
**42 BEDFORD SQUARE
LONDON**

Drawing Title
**Third and Fourth Floor
Comfort Cooling Layout**

Project No	Drawn & Checked by	Reviewed by
26/01045	PC	MJ
Date	Scale	Issuing Office
May 13	1:100@ A1	Cambridge

DRAWING NUMBER								
Project Code	Org.	Zone	Level	Type	Role	Class.	Number	Rev.
2601045	HL	XX	03	SK	M	550	0018	C