# C113.1
ROOF DETAILS: PASSIVE
VENT TERMINAL

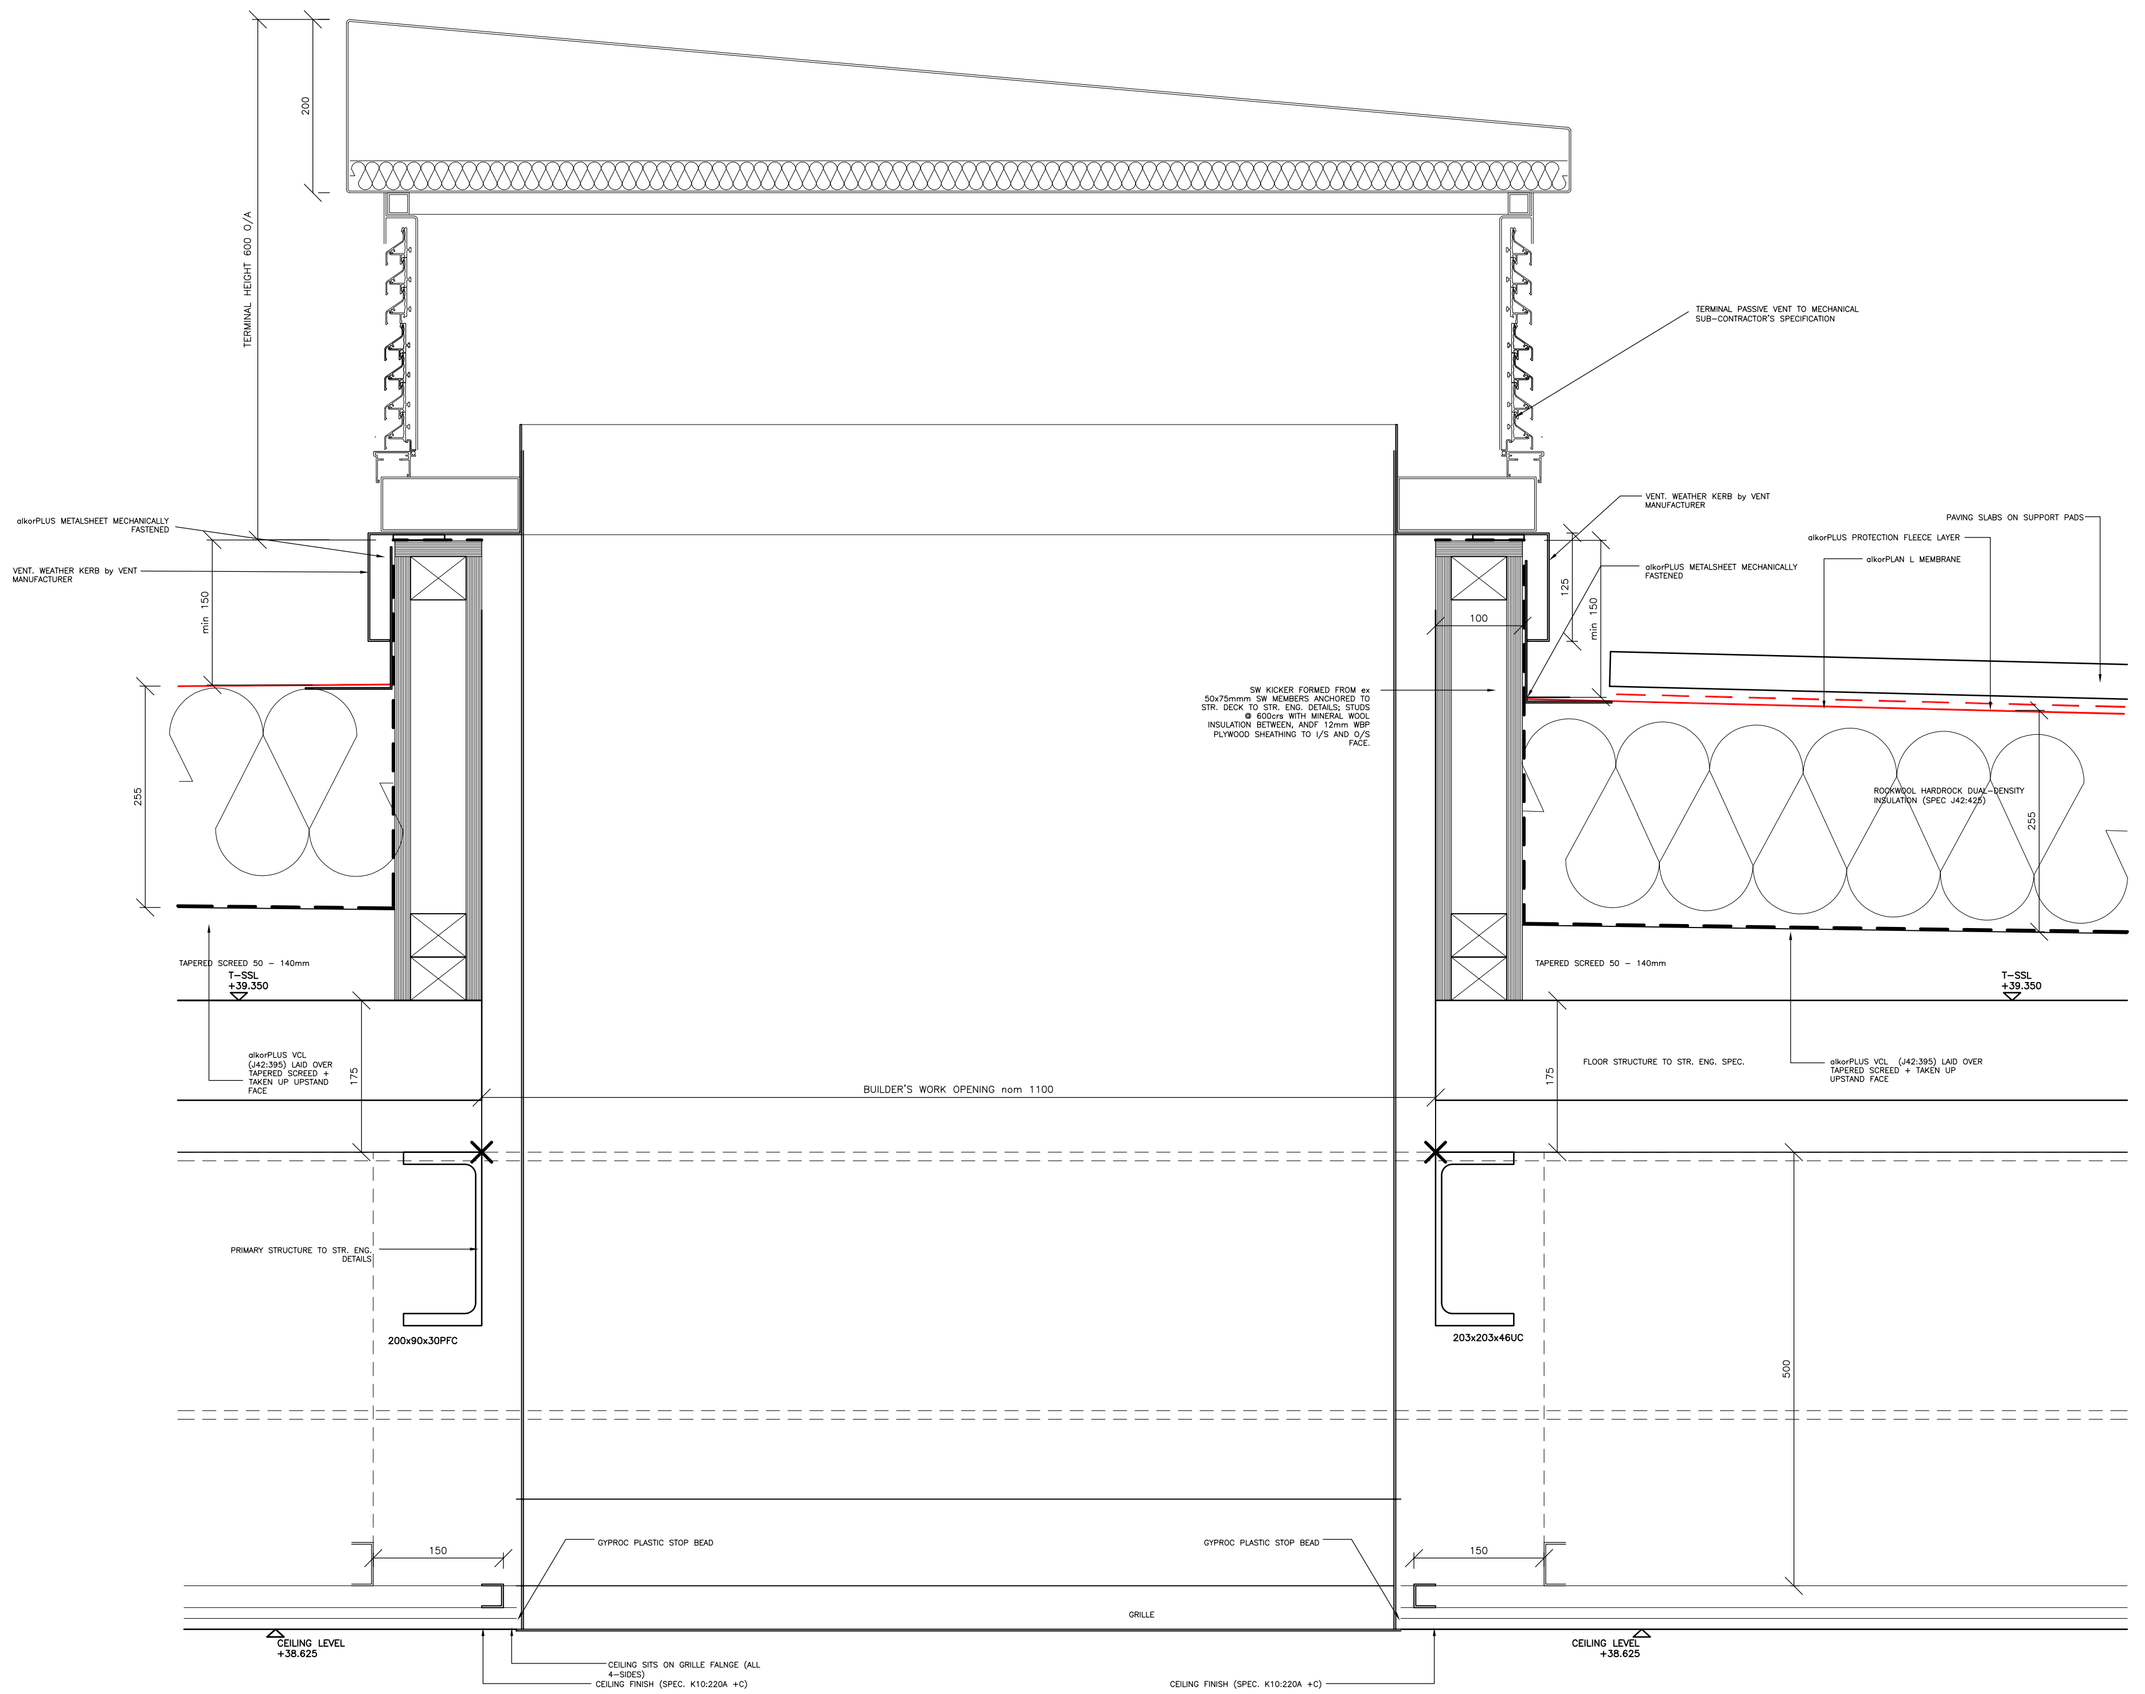


REFER TO DWG 2684B272

## Revisions

| | |
|---|---|
| ISSUED FOR BILLING<br>NJB | A<br>02.10.14 |
| ISSUED FOR BILLING (NO CHANGES)<br>NJB | B<br>13.10.14 |
| ISSUED FOR TENDER<br>Date 08.12.14 Checked CD | |
| ISSUED FOR CONSTRUCTION<br>YK | C<br>28.04.15 |
| ISSUED FOR CONSTRUCTION<br>Date 28.04.15 Checked CD | |
| SLAB THICKNESS AMENDED TO 175MM<br>CD | D<br>12.06.15 |

PLANNING SCHEME

CURRENT GA PLANS

**Note**
Do not scale from this drawing.
All dimensions to be checked on site.
Report any discrepancies to the Architect.

2684 C113 D

THE CAVENDISH SCHOOL
NEW HALL AND CLASSROOM BLOCK

CONSTRUCTION SECTION DETAILS

| | |
|---|---|
| Scale 1:5@A1 | Checked |
| Date SEP 14 | Drawn NJB |


BH&M
BARNSLEY HEWETT & MALLINSON
CHARTERED ARCHITECTS
1 White Hart Lane, London SW13 0RA
Telephone: 0181 878 4667 Fax: 0181 878 8907
e-mail mail@bhmltd.co.uk http://www.bhmltd.co.uk


N:\2684\2684C\DG\C127.dwg, 2684C113, 12/06/2015 16:56:11, cd, PDFCreator, A1, 1:1