


Reed Dragon court Condensing Units

Positioned with a gap of 300mm between back of condensing and plant room wall.

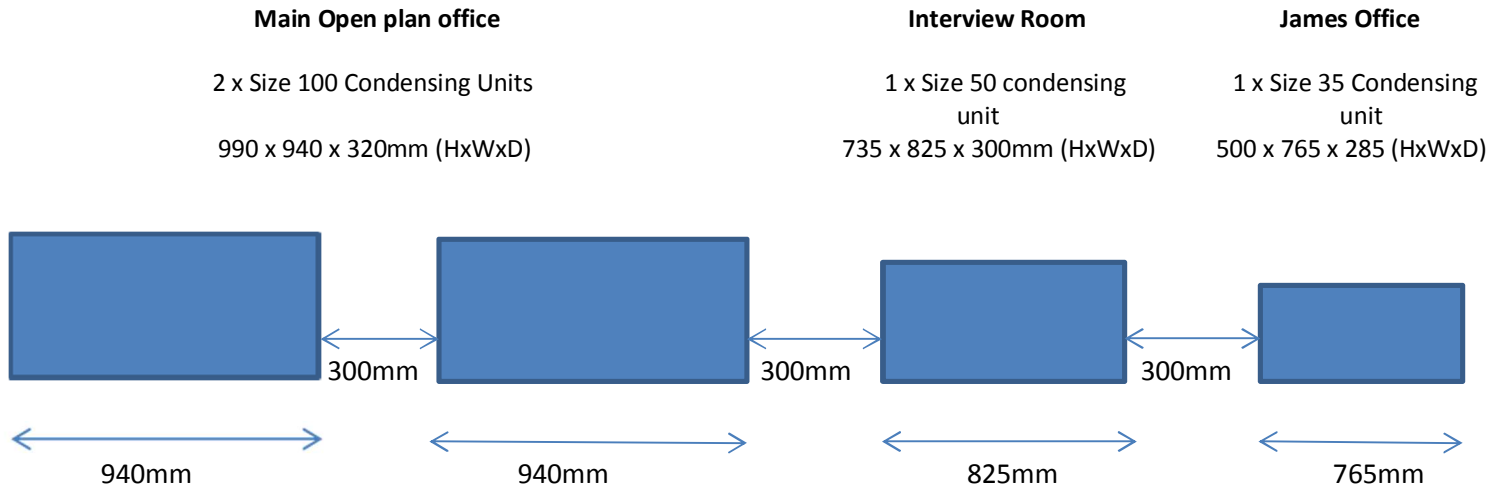

Units mounted on Anti-vibration blocks. Pipework penetrates through plant at low level to outside where it connects to condensing units