


LUMINAIRE SCHEDULE							
Symbol	Label	Qty	Catalog Number	Description	Lamp	File	Lumens LLF
	A	6	DSX1.L094.AY	DSX-1 ASYMMETRIC DISTRIBUTION, COLUMN MOUNTED AT 6m	NICHIA 219 4000K	DSX1.L094.AY .ies	Absolute 0.85
	AA	5	DSX1.L094.AY	TWIN DSX-1 ASYMMETRIC DISTRIBUTION, COLUMN MOUNTED AT 6m	NICHIA 219 4000K	DSX1.L094.AY .ies	Absolute 0.85
	B	8	PSE.L094.SY.PFL	PRISMASHIELD ELITE-SOFFIT MOUNTED AS SHOWN	LED C.9000Lm at 4000K	PSE.L094.SY.PFL.IES	Absolute 0.85




STATISTICS						
Description	Symbol	Avg	Max	Min	Min/Max	Min/Avg
Car Park		21 lux	47 lux	8 lux	0.17	0.38
Open Roadway		16 lux	52 lux	5 lux	0.10	0.31
Undercroft		148 lux	356 lux	53 lux	0.15	0.36

- NOTES**
- Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, v every effort is made to ensure we interpret the design specification accurately.
  - All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone.
  - In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).
  - Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.
  - Queries regarding this drawing should be addressed to David Goodchild on (07793) 041599 or dgoodchild@holophane.co.uk.
  - All calculations are maintained at 2,000 hours.
  - The contour lines on the 3-D view represent 5 lux from source.
  - All dimensions are approximate and final design checks should be made prior to order.
  - Room reflectances are assumed at 70:50:20.

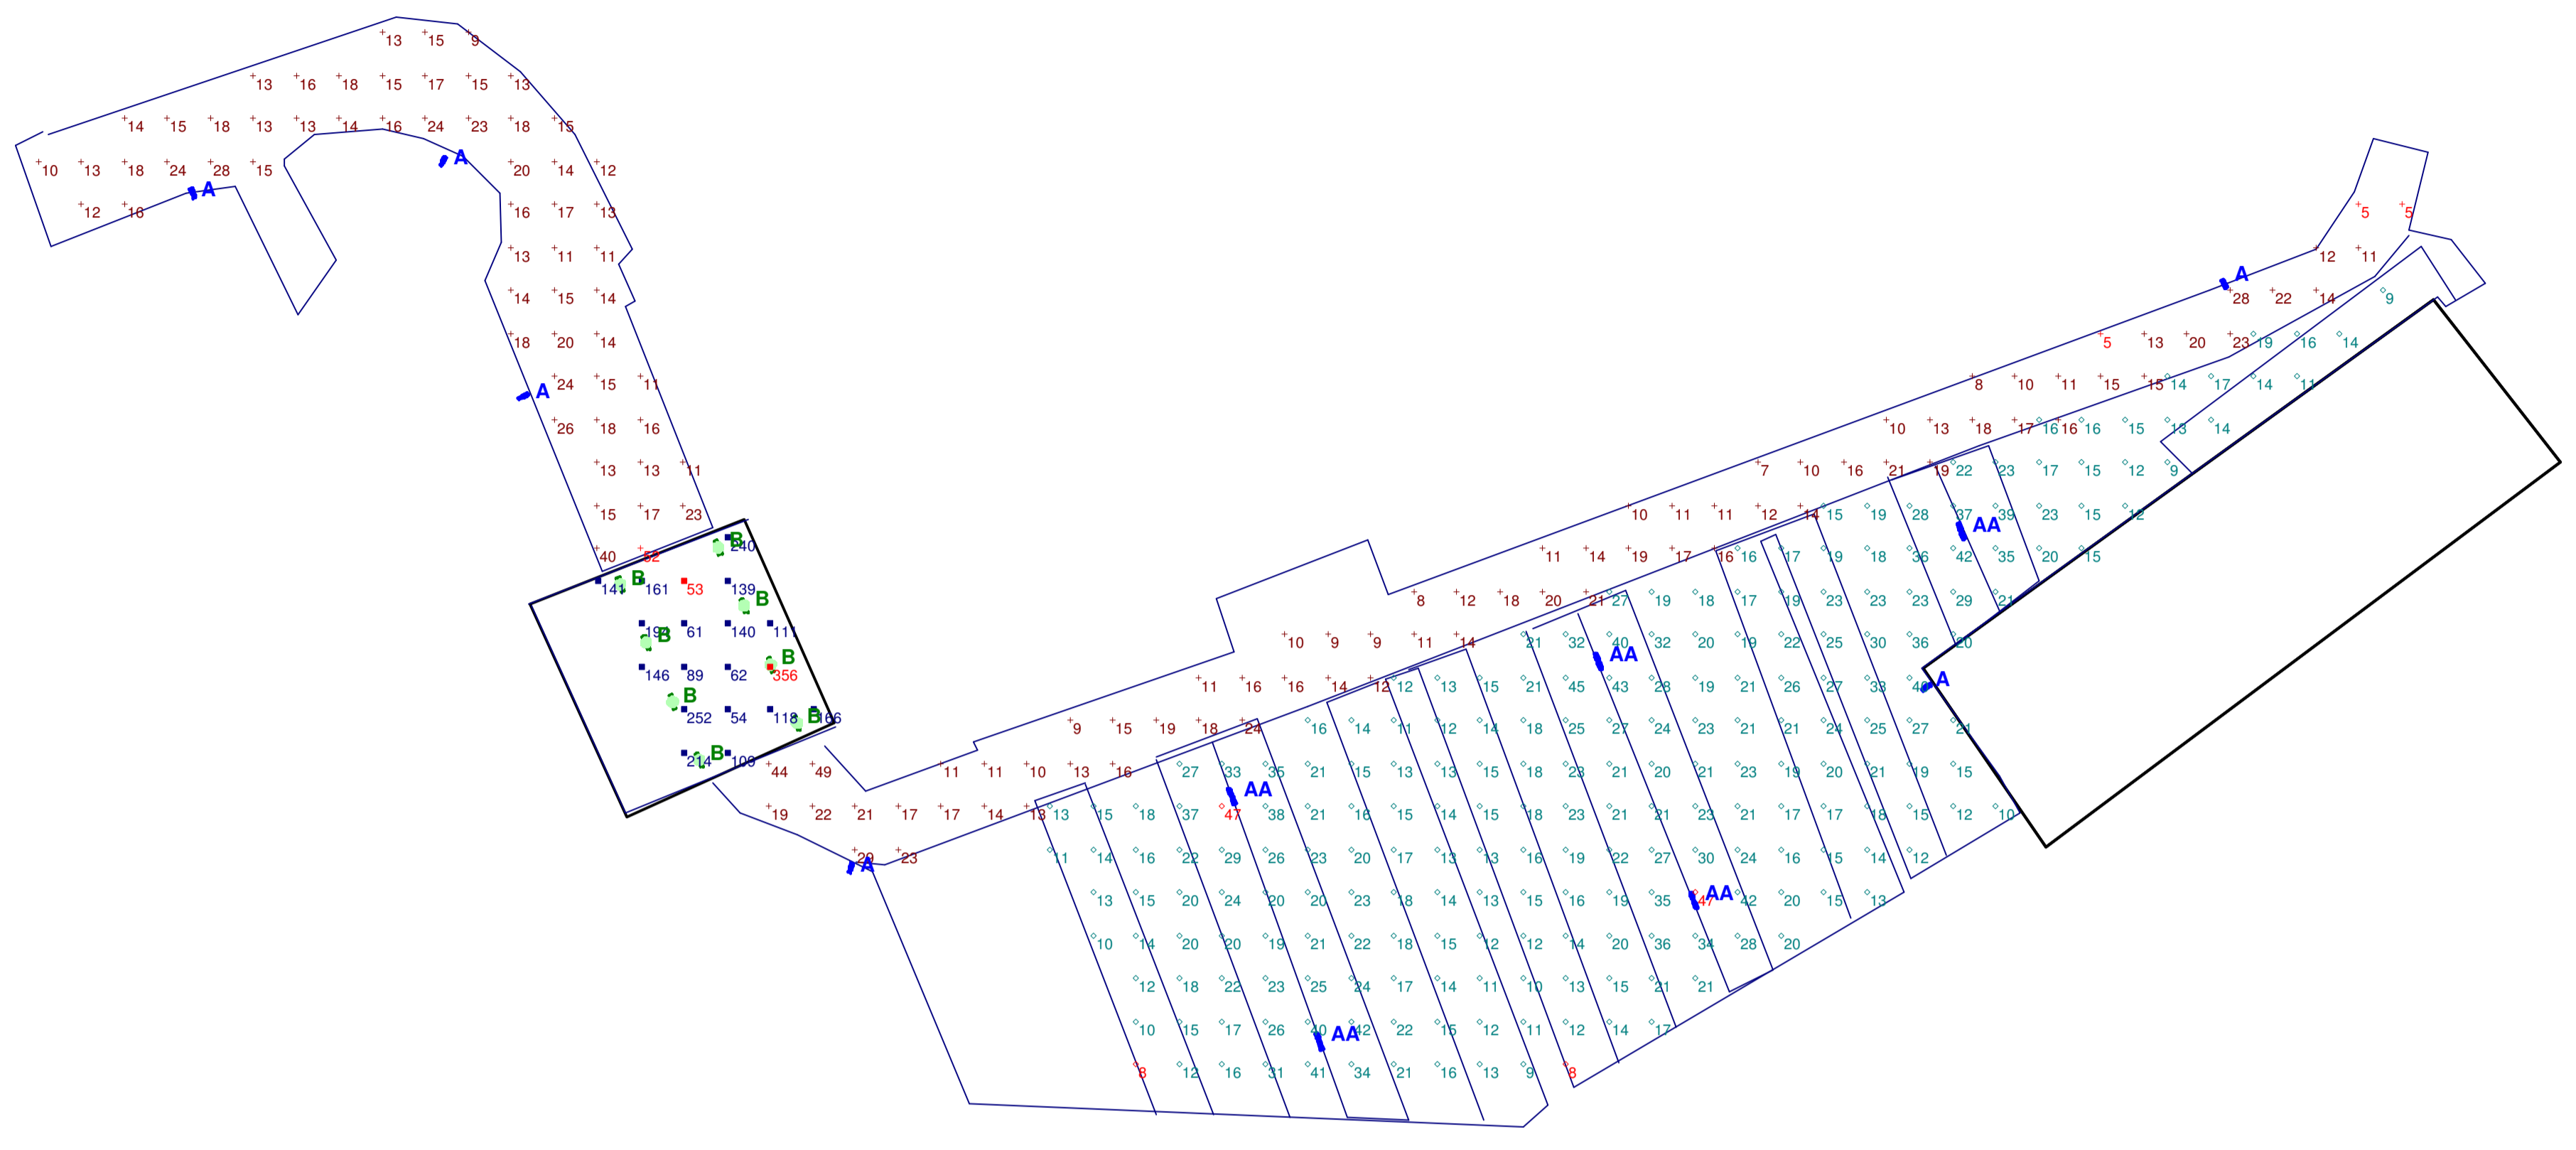

Plan View  
Scale 1:500

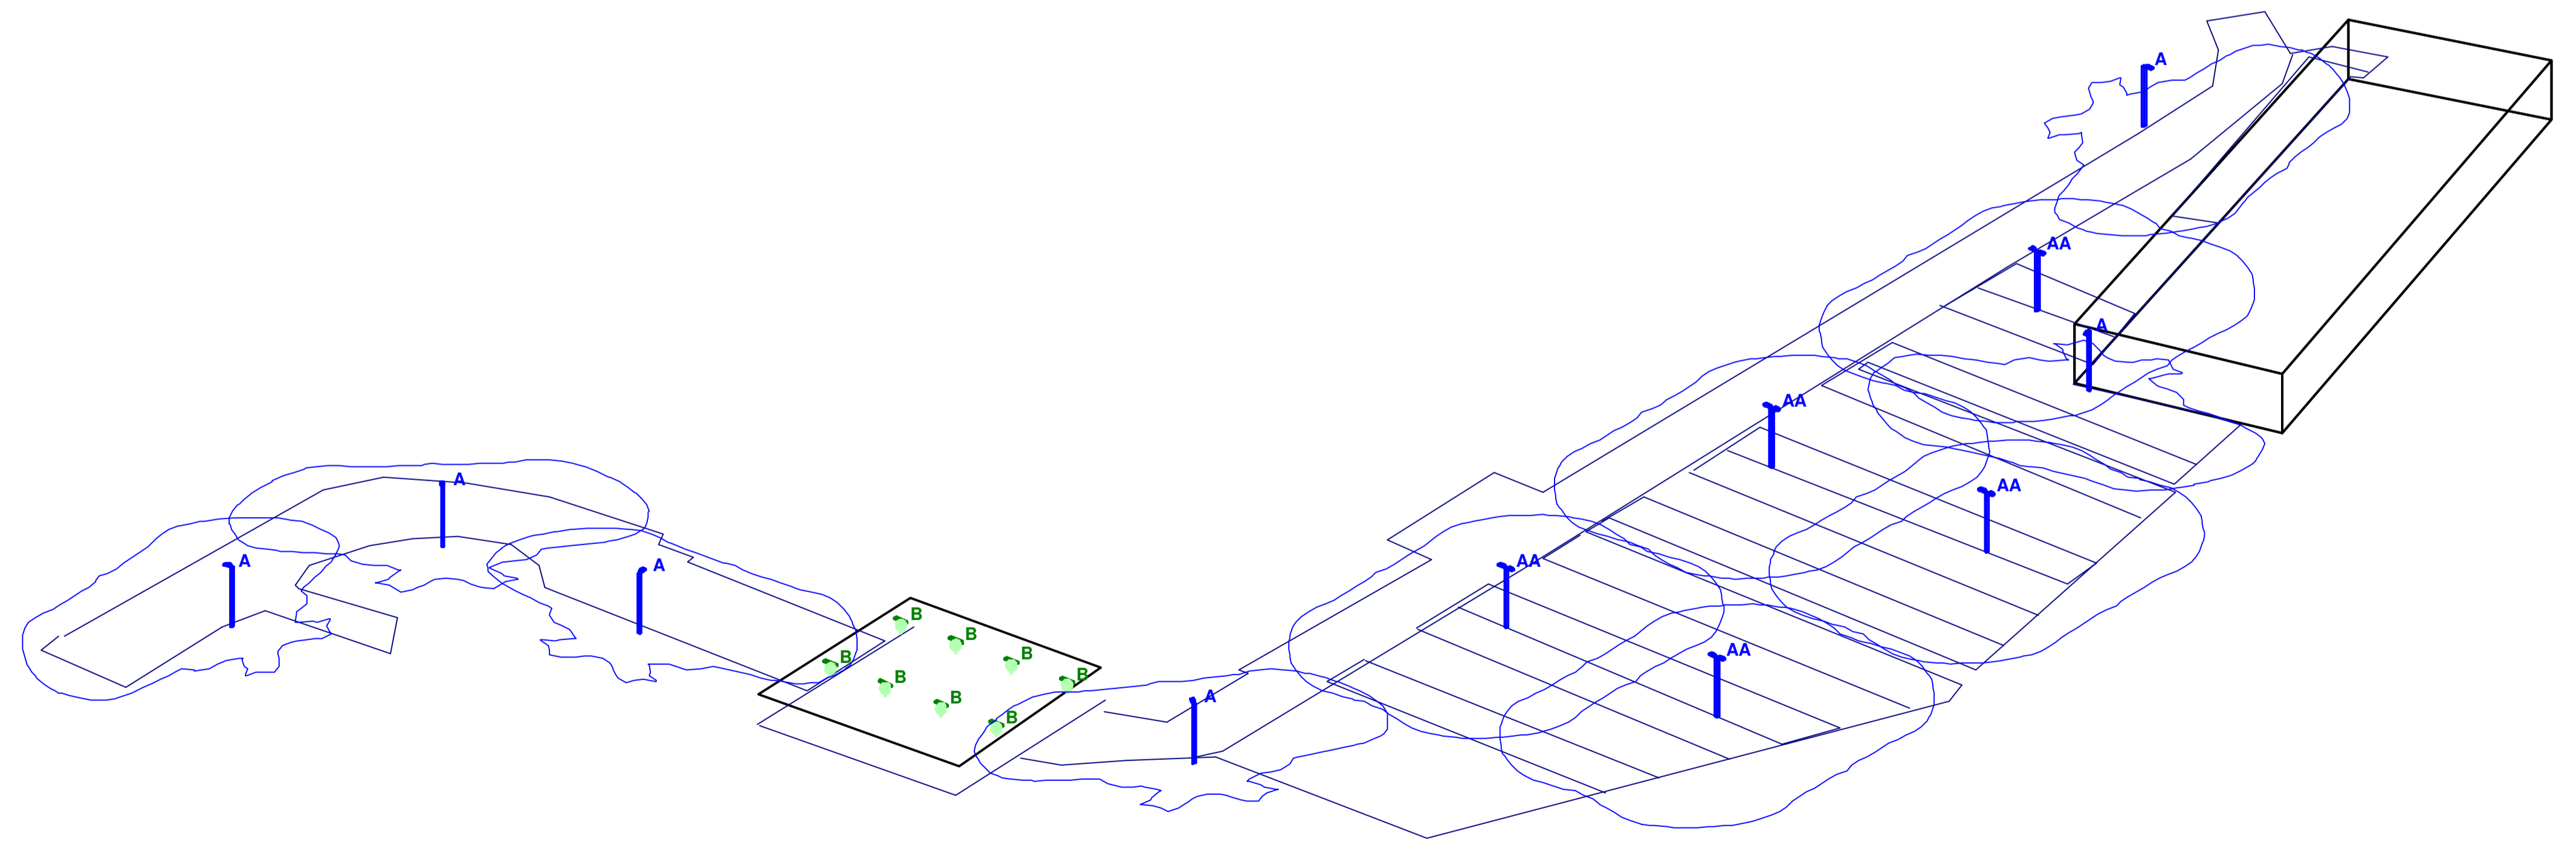

Southwest View  
Not to Scale