



BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
Sample Number: -  
Depth (m): 2.50

Description:  
Firm brown fine sandy CLAY rare  
iron and black staining

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.9
Diameter (mm):	102.4
Moisture Content (%):	27
Bulk Density (Mg/m <sup>3</sup> ):	1.97
Dry Density (Mg/m <sup>3</sup> ):	1.55
Test details	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	1.9
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	50
Strain at failure (%):	16.3
Maximum Deviator Stress (kPa):	139
Shear Stress $\sigma_c$ (kPa):	69
Mode of failure:	



Checked and  
Approved  
Initials:  
*JS*  
Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**




**GEOLABS®**

**BS1377 : Part 7 : Clause 8 : 1990**  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
 Sample Number: -  
 Depth (m): 4.50

Description:  
 Firm brown CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.7
Diameter (mm):	103.1
Moisture Content (%):	27
Bulk Density (Mg/m³):	1.97
Dry Density (Mg/m³):	1.55
Test details	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	2.2
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	90
Strain at failure (%):	19.8
Maximum Deviator Stress (kPa):	147
Shear Stress $\tau_c$ (kPa):	73
Mode of failure:	

Orientation and  
position of sample



**Checked and  
Approved**

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**




**GEOLABS®**

BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
Sample Number: -  
Depth (m): 7.50

Description:  
Firm dark grey fine sandy silty CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.7
Diameter (mm):	103.0
Moisture Content (%):	23
Bulk Density (Mg/m³):	2.04
Dry Density (Mg/m³):	1.65
<b>Test details</b>	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	2.1
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	150
Strain at failure (%):	18.8
Maximum Deviator Stress (kPa):	186
Shear Stress $\sigma_v$ (kPa):	93
Mode of failure:	

Orientation and  
position of sample



Checked and  
Approved

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**



**GEOLABS®**




**BS1377 : Part 7 : Clause 8 : 1990**  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
 Sample Number: -  
 Depth (m): 10.50

Description:  
 Firm to stiff dark grey silty CLAY with rare  
 coarse claystone

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.9
Diameter (mm):	102.4
Moisture Content (%):	33
Bulk Density (Mg/m³):	2.05
Dry Density (Mg/m³):	1.54
<b>Test details</b>	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	0.8
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	210
Strain at failure (%):	12.4
Maximum Deviator Stress (kPa):	160
Shear Stress $\tau_c$ (kPa):	80
Mode of failure:	

Orientation and  
position of sample



Checked and  
Approved

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**



**GEOLABS®**




BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
 Sample Number: -  
 Depth (m): 13.50

Description:  
 Stiff dark grey brown silty CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.5
Diameter (mm):	102.7
Moisture Content (%):	28
Bulk Density (Mg/m³):	2.02
Dry Density (Mg/m³):	1.58
<b>Test details</b>	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	1.3
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	270
Strain at failure (%):	9.4
Maximum Deviator Stress (kPa):	259
Shear Stress $C_u$ (kPa):	129
Mode of failure:	

Orientation and  
position of sample



Checked and  
Approved

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**




**GEOLABS®**


BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
 Sample Number: -  
 Depth (m): 16.50

Description:  
 Stiff fissured dark grey silty CLAY with  
 rare shell fragments

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.5
Diameter (mm):	103.0
Moisture Content (%):	30
Bulk Density (Mg/m <sup>3</sup> ):	1.98
Dry Density (Mg/m <sup>3</sup> ):	1.52
<b>Test details</b>	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	0.4
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	330
Strain at failure (%):	6.0
Maximum Deviator Stress (kPa):	272
Shear Stress $\sigma_v$ (kPa):	136
Mode of failure:	



**Checked and  
Approved**

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**




**GEOLABS®**

BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**

Borehole Number: 1  
Sample Number: -  
Depth (m): 19.50

Description:  
Very stiff fissured dark grey CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.5
Diameter (mm):	103.0
Moisture Content (%):	25
Bulk Density (Mg/m <sup>3</sup> ):	2.04
Dry Density (Mg/m <sup>3</sup> ):	1.63
Test details	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	1.1
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	390
Strain at failure (%):	7.4
Maximum Deviator Stress (kPa):	313
Shear Stress $\tau_c$ (kPa):	157
Mode of failure:	

Orientation and  
position of sample



Checked and  
Approved

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**



**GEOLABS®**




BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**


Borehole Number: 1  
 Sample Number: -  
 Depth (m): 22.50

Description:  
 Very stiff dark grey silty CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.8
Diameter (mm):	102.5
Moisture Content (%):	27
Bulk Density (Mg/m <sup>3</sup> ):	2.01
Dry Density (Mg/m <sup>3</sup> ):	1.58
Test details	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	0.5
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	450
Strain at failure (%):	6.9
Maximum Deviator Stress (kPa):	322
Shear Stress $\sigma_v$ (kPa):	161
Mode of failure:	

Orientation and  
position of sample



Checked and  
Approved

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**



**GEOLABS®**

Test Report by GEOLABS Limited Bucknalls Lane, Garston, Watford, Hertfordshire, WD25 9XX

Authorised Signatories: J R Masters (Qual Mgr) C F Wallace (Tech Mgr) G J Corio (Tech Mgr) J Sturges (Tech Mgr) Simon Burke (Snr Tech) J J M Powell (Tech Dir)

Client: Geotechnical & Environmental Associates Limited, Tyltenganger House, Courteen Road, St Albans, Hertfordshire AL4 6PG

© GEOLABS LIMITED


(Ref:673.386748) Page 1 of 1  
 GEOLABS®

BS1377 : Part 7 : Clause 8 : 1990  
**Quick Undrained Triaxial Test**


Borehole Number: 1  
 Sample Number: -  
 Depth (m): 25.50

Description:  
 Stiff fissured dark grey CLAY

**Single Stage Specimen**

Specimen details	Single Specimen
Specimen condition:	Undisturbed
Length (mm):	201.6
Diameter (mm):	102.8
Moisture Content (%):	28
Bulk Density (Mg/m³):	1.97
Dry Density (Mg/m³):	1.54
<b>Test details</b>	
Latex membrane thickness (mm):	0.3
Membrane correction (kPa):	0.4
Axial displacement rate (%/min):	2.0
Cell pressure (kPa):	500
Strain at failure (%):	2.2
Maximum Deviator Stress (kPa):	197
Shear Stress $C_u$ (kPa):	99
Mode of failure:	

Orientation and  
position of sample



**Checked and  
Approved**

Initials:

*JS*

Date: 10/05/2011

Project Number:

**GEO / 16816**

Project Name:

**GREENAWAY GARDENS**

**Job Number: J11069**



**GEOLABS®**


**Site** 3 Greenaway Gardens, London NW3

**Client** Ms Suthinee Srisethi

**Engineer** MA Engineers

**Job Number**  
J11069

**Sheet**  
1 / 1

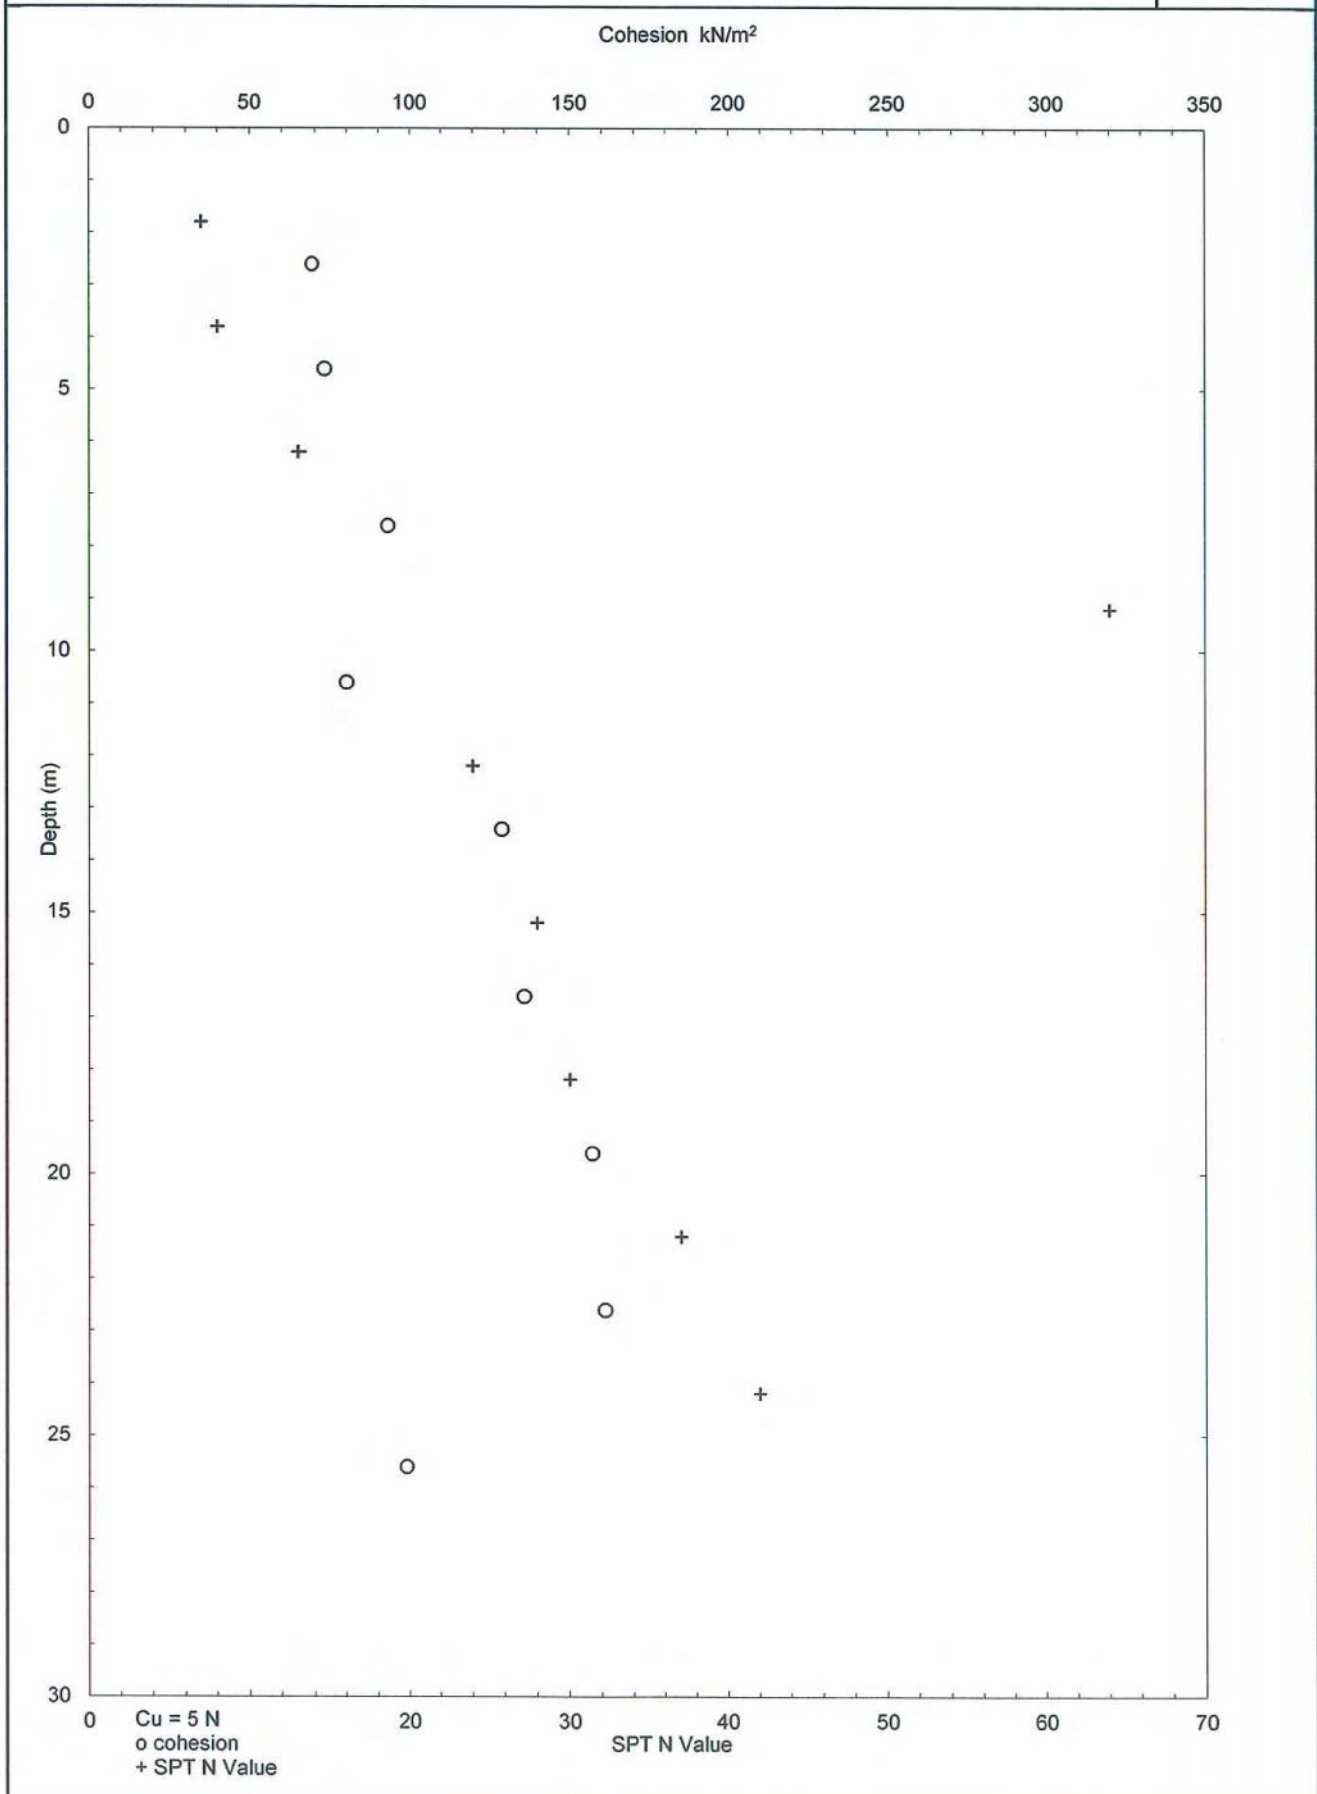



# LABORATORY TEST REPORT

Results of analysis of 6 samples  
received 20 April 2011

J11069 - Greenaway Gardens

Report Date  
04 May 2011

Login Batch No

Chemtest LIMS ID

Sample ID

Sample No

Sampling Date

Depth

Matrix

SOP ↓ Determinand ↓

Units ↓

\*

CAS No ↓

136053

		AF97767	AF97768	AF97769	AF97770	AF97771	AF97772
		BH3	BH4	BH5	BH5	TP2	TP3
19/04/2011		19/04/2011	19/04/2011	19/04/2011	19/04/2011	19/04/2011	19/04/2011
0.1m		0.1m	0.3m	0.3m	0.9m	0.5m	0.2m
SOIL		SOIL	SOIL	SOIL	SOIL	SOIL	SOIL
2300 Cyanide (total)	57125	<0.50	<0.50	<0.50	<0.50	<0.50	<0.50
	18496258	2.9	17	1.0	5.0	4.5	2.2
		<0.20	<0.20	<0.20	5.3	0.73	0.77
	16887006	<0.010	<0.010	<0.010	0.040	0.026	<0.010
	14808798	<100	<100	<100	2400	7200	<100
	7440382	13	13	4.6	35	9.5	3.7
	7440439	0.12	0.11	<0.10	<0.10	<0.10	<0.10
	7440473	8.9	22	6.9	54	23	12
	7440508	5.4	8.3	<5.0	84	7.1	<5.0
	7439976	<0.10	<0.10	<0.10	1.1	<0.10	<0.10
	7440020	10	18	5.6	26	21	7.7
	7439921	62	10	<5.0	2700	23	6.4
	7782492	<0.20	<0.20	<0.20	<0.20	<0.20	<0.20
	7440666	19	33	<10	150	29	<10
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
2676 TPH >C5-C6		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
2700 Total Petroleum Hydrocarbons		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
		<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
Naphthalene	91203	0.27	<0.1	0.54	70	48	160
	208968	0.57	<0.1	0.17	8.1	40	120
	83329	1.3	<0.1	0.2	19	26	74
	86737	0.11	<0.1	<0.1	13	34	87

# LABORATORY TEST REPORT

Results of analysis of 6 samples  
received 20 April 2011

J11069 - Greenaway Gardens

Report Date  
04 May 2011

136053									
AF97767	AF97768	AF97769	AF97770	AF97771	AF97772				
BH3	BH4	BH5	BH5	TP2	TP3				
19/04/2011	19/04/2011	19/04/2011	19/04/2011	19/04/2011	19/04/2011				
0.1m	0.3m	0.3m	0.9m	0.5m	0.2m				
SOIL	SOIL	SOIL	SOIL	SOIL	SOIL				
2700	Phenanthrene	85018	M	0.18	< 0.1	0.14	26	98	200
	Anthracene	120127	M	1.5	< 0.1	< 0.1	8.1	52	84
	Fluoranthene	206440	M	< 0.1	< 0.1	< 0.1	26	77	84
	Pyrene	129000	M	< 0.1	< 0.1	< 0.1	31	52	89
	Benzo[a]anthracene	56553	M	< 0.1	< 0.1	< 0.1	19	23	33
	Chrysene	218019	M	< 0.1	< 0.1	< 0.1	22	27	31
	Benzo[b]fluoranthene	205992	M	< 0.1	< 0.1	< 0.1	16	17	16
	Benzo[k]fluoranthene	207089	M	< 0.1	< 0.1	< 0.1	14	15	19
	Benzo[a]pyrene	50328	M	< 0.1	< 0.1	< 0.1	23	18	25
	Dibenzo[a,h]anthracene	53703	M	< 0.1	< 0.1	< 0.1	2.3	4.6	4.3
	Indeno[1,2,3-cd]pyrene	193395	M	< 0.1	< 0.1	< 0.1	10	11	10
	Benzo[g,h,i]perylene	191242	M	< 0.1	< 0.1	< 0.1	13	11	10
	Total (of 16) PAHs		M	3.9	< 2	< 2	320	550	1000
2920	Phenols (total)		N	<0.3	<0.3	<0.3	<0.3	<0.3	<0.3
2010	pH		M	8.8	8.6	8.4	8.0	7.9	8.9
2030	Moisture		n/a	24.7	24.5	18.4	20.1	16.1	17.7
	Stones content (>50mm)		n/a	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02
2140	Soil colour		n/a	brown	brown	brown	brown	brown	brown
	Soil texture		n/a	sand	clay	sand	clay	sand	sand
	Other material		n/a	stones, roots	stones	stones	stones, roots	stones, roots	stones, roots



Site	3 Greenaway Gardens, London NW3	Job Number J11069
Client	Ms Suthinee Srisethi	Sheet 1 / 1
Engineer	MA Engineers	

**Proposed End Use Residential with plant uptake**
**Soil pH 8**
**Soil Organic Matter content % 2.5**

Contaminant	Guideline Value mg/kg	Data Source	Contaminant	Guideline Value mg/kg	Data Source
<b>Metals</b>			<b>Anions</b>		
Arsenic	32	SGV	Soluble Sulphate	0.5 g/l	Structures
Cadmium	10	SGV	Sulphide	50	Structures
Chromium (III)	3000	LQM/CIEH	Chloride	400	Structures
Chromium (VI)	4.3	LQM/CIEH	<b>Others</b>		
Copper	2,330	LQM/CIEH	Organic Carbon	6	Methanogenic potential
Lead	450	withdrawn SGV	Total Cyanide	140	WRAS
Elemental Mercury	1	SGV	Total Mono Phenols	290	SGV
Inorganic Mercury	170	SGV	<b>PAH</b>		
Nickel	130	LQM/CIEH	Naphthalene	3.70	LQM/CIEH
Selenium	350	SGV	Acenaphthylene	400	LQM/CIEH
Zinc	3,750	LQM/CIEH	Acenaphthene	480	LQM/CIEH
<b>Hydrocarbons</b>			Fluorene	380	LQM/CIEH
Benzene	0.18	SGV	Phenanthrene	200	LQM/CIEH
Toluene	320	SGV	Anthracene	4,900	LQM/CIEH
Ethyl Benzene	180	SGV	Fluoranthene	460	LQM/CIEH
Xylene	120	SGV	Pyrene	1,000	LQM/CIEH
Aliphatic C5-C6	55	LQM/CIEH	Benzo(a) Anthracene	4.7	LQM/CIEH
Aliphatic C6-C8	160	LQM/CIEH	Chrysene	8	LQM/CIEH
Aliphatic C8-C10	46	LQM/CIEH	Benzo(b) Fluoranthene	6.5	LQM/CIEH
Aliphatic C10-C12	230	LQM/CIEH	Benzo(k) Fluoranthene	9.6	LQM/CIEH
Aliphatic C12-C16	1700	LQM/CIEH	Benzo(a) pyrene	0.94	LQM/CIEH
Aliphatic C16-C35	64,000	LQM/CIEH	Indeno(1 2 3 cd) Pyrene	3.9	LQM/CIEH
Aromatic C6-C7	See Benzene	LQM/CIEH	Dibenzo(a h) Anthracene	0.86	LQM/CIEH
Aromatic C7-C8	See Toluene	LQM/CIEH	Benzo (g h i) Perylene	46	LQM/CIEH
Aromatic C8-C10	65	LQM/CIEH	<b>Total PAH</b>	<b>6.3</b>	<b>B(a)P / 0.15</b>
Aromatic C10-C12	160	LQM/CIEH	<b>Chlorinated Solvents</b>		
Aromatic C12-C16	310	LQM/CIEH	1,1,1 trichloroethane (TCA)	12.9	LQM/CIEH
Aromatic C16-C21	480	LQM/CIEH	tetrachloroethane (PCA)	2.1	LQM/CIEH
Aromatic C21-C35	1100	LQM/CIEH	tetrachloroethene (PCE)	2.1	LQM/CIEH
PRO (C <sub>5</sub> -C <sub>10</sub> )	646	Calc	trichloroethene (TCE)	0.22	LQM/CIEH
DRO (C <sub>12</sub> -C <sub>28</sub> )	66,490	Calc	1,2-dichloroethane (DCA)	0.008	LQM/CIEH
Lube Oil (C <sub>28</sub> -C <sub>44</sub> )	65,100	Calc	vinyl chloride (Chloroethene)	0.00064	LQM/CIEH
TPH	500	Trigger for speciated testing	tetrachloromethane (Carbon tetra)	0.039	LQM/CIEH
			trichloromethane (Chloroform)	1.3	LQM/CIEH

**Notes**

Concentrations measured below the above values may be considered to represent 'uncontaminated conditions' which do not pose a risk to human health. Concentrations measured in excess of these values indicate a potential risk, and thus require further, site specific risk assessment.

SGV - Soil Guideline Value, derived from the CLEA model and published by Environment Agency 2009

withdrawn SGV - Former SGV, derived from the CLEA 2000 model and published by DEFRA pending confirmation of new approach to modeling lead

LQM/CIEH - Generic Assessment Criteria for Human Health Risk Assessment 2nd edition (2009) derived using CLEA 1.04 model 2009

Calc - sum of nearest available carbon range specified including BTEX for PRO fraction

B(a)P / 0.15 - GEA experience indicates that Benzo(a) pyrene (one of the most common and most carcinogenic of the PAHs) rarely exceeds 15% of the total PAH concentration, hence this Total PAH threshold is regarded as being conservative



# Envirocheck<sup>®</sup> Report:

## Datasheet

### Order Details:

**Order Number:**

35018083\_1\_1

**Customer Reference:**

J11069

**National Grid Reference:**

525820, 185500

**Slice:**

A

**Site Area (Ha):**

0.12

**Search Buffer (m):**

1000

### Site Details:

3 Greenaway Gardens  
LONDON  
NW3 7DJ

### Client Details:

Mr S Branch  
GEA Ltd  
Tyttenhanger House  
Corsers Road  
St Albans  
Herts  
AL4 0PG

### Prepared For:

Ms Suthinee Srisethi

Report Section	Page Number
Summary	-
Agency & Hydrological	1
Waste	5
Hazardous Substances	-
Geological	7
Industrial Land Use	8
Sensitive Land Use	-
Data Currency	22
Data Suppliers	28
Useful Contacts	29

## Introduction

The Environment Act 1995 has made site sensitivity a key issue, as the legislation pays as much attention to the pathways by which contamination could spread, and to the vulnerable targets of contamination, as it does the potential sources of contamination. For this reason, Landmark's Site Sensitivity maps and Datasheet(s) place great emphasis on statutory data provided by the Environment Agency and the Scottish Environment Protection Agency; it also incorporates data from Natural England (and the Scottish and Welsh equivalents) and Local Authorities; and highlights hydrogeological features required by environmental and geotechnical consultants. It does not include any information concerning past uses of land. The datasheet is produced by querying the Landmark database to a distance defined by the client from a site boundary provided by the client.

In the attached datasheet the National Grid References (NGRs) are rounded to the nearest 10m in accordance with Landmark's agreements with a number of Data Suppliers.

## Copyright Notice

© Landmark Information Group Limited 2011. The Copyright on the information and data and its format as contained in this Envirocheck® Report ("Report") is the property of Landmark Information Group Limited ("Landmark") and several other Data Providers, including (but not limited to) Ordnance Survey, British Geological Survey, the Environment Agency and Natural England, and must not be reproduced in whole or in part by photocopying or any other method. The Report is supplied under Landmark's Terms and Conditions accepted by the Customer. A copy of Landmark's Terms and Conditions can be found with the Index Map for this report. Additional copies of the Report may be obtained from Landmark, subject to Landmark's charges in force from time to time. The Copyright, design rights and any other intellectual rights shall remain the exclusive property of Landmark and /or other Data providers, whose Copyright material has been included in this Report.

## Natural England Copyright Notice

Site of Special Scientific Interest, National Nature Reserve, Ramsar, Special Protection Area, Special Conservation Area, Marine Nature Reserve data (derived from Ordnance Survey 1:10000 raster) is provided by, and used with the permission of, Natural England who retain the copyright and Intellectual Property Rights for the data.

## Ove Arup Copyright Notice

The Data provided in this report was obtained on Licence from Ove Arup & Partners Limited (for further information, contact [mining.review@arup.com](mailto:mining.review@arup.com)). No reproduction or further use of such Data is to be made without the prior written consent of Ove Arup & Partners Limited. The information and data supplied in the product are derived from publicly available records and other third party sources and neither Ove Arup & Partners nor Landmark warrant the accuracy or completeness of such information or data.

## Peter Brett Associates Copyright Notice

The cavity data presented has been extracted from the PBA enhanced version of the original DEFRA national cavity databases. PBA/DEFRA retain the copyright & intellectual property rights in the data. Whilst all reasonable efforts are made to check that the information contained in the cavity databases is accurate we do not warrant that the data is complete or error free. The information is based upon our own researches and those collated from a number of external sources and is continually being augmented and updated by PBA. In no event shall PBA/DEFRA or Landmark be liable for any loss or damage including, without limitation, indirect or consequential loss or damage arising from the use of this data.

## Radon Potential dataset Copyright Notice

Information supplied from a joint dataset compiled by The British Geological Survey and the Health Protection Agency.

## Report Version v47.0

Data Type	Page Number	On Site	0 to 250m	251 to 500m	501 to 1000m (*up to 2000m)
<b>Agency &amp; Hydrological</b>					
Contaminated Land Register Entries and Notices					
Discharge Consents	pg 1				3
Enforcement and Prohibition Notices					
Integrated Pollution Controls					
Integrated Pollution Prevention And Control					
Local Authority Integrated Pollution Prevention And Control					
Local Authority Pollution Prevention and Controls	pg 1			4	12
Local Authority Pollution Prevention and Control Enforcements					
Nearest Surface Water Feature					
Pollution Incidents to Controlled Waters					
Prosecutions Relating to Authorised Processes					
Prosecutions Relating to Controlled Waters					
Registered Radioactive Substances					
River Quality					
River Quality Biology Sampling Points					
River Quality Chemistry Sampling Points					
Substantiated Pollution Incident Register					
Water Abstractions	pg 4				(*1)
Water Industry Act Referrals					
Groundwater Vulnerability	pg 4	Yes	n/a	n/a	n/a
Bedrock Aquifer Designations	pg 4	Yes	n/a	n/a	n/a
Superficial Aquifer Designations			n/a	n/a	n/a
Source Protection Zones					
Extreme Flooding from Rivers or Sea without Defences				n/a	n/a
Flooding from Rivers or Sea without Defences				n/a	n/a
Areas Benefiting from Flood Defences				n/a	n/a
Flood Water Storage Areas				n/a	n/a
Flood Defences				n/a	n/a
<b>Waste</b>					
BGS Recorded Landfill Sites					
Historical Landfill Sites	pg 5				1
Integrated Pollution Control Registered Waste Sites					
Licensed Waste Management Facilities (Landfill Boundaries)					
Licensed Waste Management Facilities (Locations)					
Local Authority Recorded Landfill Sites					
Registered Landfill Sites					
Registered Waste Transfer Sites	pg 5				3
Registered Waste Treatment or Disposal Sites	pg 6				1



Data Type	Page Number	On Site	0 to 250m	251 to 500m	501 to 1000m (*up to 2000m)
<b>Hazardous Substances</b>					
Control of Major Accident Hazards Sites (COMAH)					
Explosive Sites					
Notification of Installations Handling Hazardous Substances (NIHHS)					
Planning Hazardous Substance Consents					
Planning Hazardous Substance Enforcements					
<b>Geological</b>					
BGS Recorded Mineral Sites					
BGS 1:625,000 Solid Geology	pg 7	Yes	n/a	n/a	n/a
Brine Compensation Area			n/a	n/a	n/a
Coal Mining Affected Areas			n/a	n/a	n/a
Mining Instability			n/a	n/a	n/a
Man-Made Mining Cavities					
Natural Cavities					
Non Coal Mining Areas of Great Britain				n/a	n/a
Potential for Collapsible Ground Stability Hazards				n/a	n/a
Potential for Compressible Ground Stability Hazards				n/a	n/a
Potential for Ground Dissolution Stability Hazards				n/a	n/a
Potential for Landslide Ground Stability Hazards	pg 7	Yes	Yes	n/a	n/a
Potential for Running Sand Ground Stability Hazards	pg 7	Yes	Yes	n/a	n/a
Potential for Shrinking or Swelling Clay Ground Stability Hazards	pg 7	Yes		n/a	n/a
Radon Potential - Radon Affected Areas			n/a	n/a	n/a
Radon Potential - Radon Protection Measures			n/a	n/a	n/a
<b>Industrial Land Use</b>					
Contemporary Trade Directory Entries	pg 8		10	13	139
Fuel Station Entries	pg 21			1	2

Data Type	Page Number	On Site	0 to 250m	251 to 500m	501 to 1000m (*up to 2000m)
<b>Sensitive Land Use</b>					
Areas of Adopted Green Belt					
Areas of Unadopted Green Belt					
Areas of Outstanding Natural Beauty					
Environmentally Sensitive Areas					
Forest Parks					
Local Nature Reserves					
Marine Nature Reserves					
National Nature Reserves					
National Parks					
Nitrate Sensitive Areas					
Nitrate Vulnerable Zones					
Ramsar Sites					
Sites of Special Scientific Interest					
Special Areas of Conservation					
Special Protection Areas					

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
1	<b>Discharge Consents</b> Operator: Thames Water Utilities Ltd Property Type: Reservoir/Borehole Site Location: Kidderpore Authority: Environment Agency, Thames Region Catchment Area: Not Supplied Reference: Temp.0165 Permit Version: 1 Effective Date: 15th September 1989 Issued Date: 15th September 1989 Revocation Date: 5th October 2000 Discharge Type: Trade Effluent Discharge: Freshwater Stream/River Environment: Receiving Water: River Thames <b>Status: Authorisation revokedRevoked</b> Positional Accuracy: Located by supplier to within 100m	A17SE (NW)	565	1	525400 185900
2	<b>Discharge Consents</b> Operator: Thames Water Utilities Ltd Property Type: Reservoir/Borehole Site Location: Hampstead Authority: Environment Agency, Thames Region Catchment Area: Not Supplied Reference: Temp.0140 Permit Version: 1 Effective Date: 15th September 1989 Issued Date: 15th September 1989 Revocation Date: 5th October 2000 Discharge Type: Trade Effluent Discharge: Freshwater Stream/River Environment: Receiving Water: River Thames <b>Status: Authorisation revokedRevoked</b> Positional Accuracy: Located by supplier to within 100m	A19SW (NE)	686	1	526200 186100
3	<b>Discharge Consents</b> Operator: Thames Water Utilities Ltd Property Type: Reservoir/Borehole Site Location: Shoot Up Hill Authority: Environment Agency, Thames Region Catchment Area: Not Supplied Reference: Temp.0234 Permit Version: 1 Effective Date: 15th September 1989 Issued Date: 15th September 1989 Revocation Date: 5th October 2000 Discharge Type: Trade Effluent Discharge: Freshwater Stream/River Environment: Receiving Water: River Thames <b>Status: Authorisation revokedRevoked</b> Positional Accuracy: Located by supplier to within 100m	A11NE (W)	989	1	524800 185500
4	<b>Local Authority Pollution Prevention and Controls</b> Name: Cottontail Cleaners Location: 509 Finchley Road, London, Nw3 7bb Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC19 Dated: 5th February 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A12SE (W)	333	2	525456 185484
4	<b>Local Authority Pollution Prevention and Controls</b> Name: Cottontail Cleaners Location: 509 Finchley Road, London, Nw3 7bb Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC48 Dated: 1st January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Manually positioned to the address or location	A12SE (W)	335	2	525454 185484



Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
4	<b>Local Authority Pollution Prevention and Controls</b> Name: The London Dry Cleaning Company Location: 519a Finchley Road, London, Nw3 7bb Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC51 Dated: 1st March 2008 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Manually positioned to the address or location	A12NE (W)	358	2	525432 185511
5	<b>Local Authority Pollution Prevention and Controls</b> Name: Sparkle Dry Cleaning Location: 329 West End Lane, London, Nw6 1rs Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC34 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A12SE (SW)	495	2	525385 185205
6	<b>Local Authority Pollution Prevention and Controls</b> Name: Shamrock Express Cleaners Location: 210 West End Lane, London, Nw6 1uu Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC33 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A8NW (SW)	517	2	525517 185048
7	<b>Local Authority Pollution Prevention and Controls</b> Name: Perkins Dry Cleaners Location: 40 Heath Street, London, Nw3 6te Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC9 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A14NW (E)	568	2	526374 185724
8	<b>Local Authority Pollution Prevention and Controls</b> Name: Janets Hand Laundry Ltd Location: 281a Finchley Road, London, Nw3 6nd Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC14 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A9NW (SE)	655	2	526167 184924
8	<b>Local Authority Pollution Prevention and Controls</b> Name: Hampstead Express Dry Cleaning Location: 279a Finchley Road, London, Nw3 6lt Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC6 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A9NW (SE)	679	2	526178 184902
9	<b>Local Authority Pollution Prevention and Controls</b> Name: Madame George Dry Cleaners Location: 227 West End Lane, London, Nw6 1xj Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC15 Dated: 12th January 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A8NW (SW)	670	2	525499 184882

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
10	<b>Local Authority Pollution Prevention and Controls</b> Name: Texaco Location: 63 Fortune Green, LONDON, NW6 1DR Authority: London Borough of Camden, Pollution Projects Team Permit Reference: Not Given Dated: 16th September 1998 Process Type: Local Authority Air Pollution Control Description: PG1/14 Petrol filling station <b>Status: Authorisation revoked</b> Positional Accuracy: Manually positioned to the address or location	A12NW (W)	714	2	525083 185596
10	<b>Local Authority Pollution Prevention and Controls</b> Name: Fortune Green Filling Station (Texaco) Location: 63 Fortune Green Road, LONDON, NW6 1DR Authority: London Borough of Camden, Pollution Projects Team Permit Reference: Not Given Dated: 24th June 1998 Process Type: Local Authority Air Pollution Control Description: PG1/14 Petrol filling station <b>Status: Authorised</b> Positional Accuracy: Manually positioned to the address or location	A12NW (W)	714	2	525083 185596
11	<b>Local Authority Pollution Prevention and Controls</b> Name: Cotton Club Dry Cleaners Location: 57 Mill Lane, London, Nw6 1nb Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC19 Dated: 5th February 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A12SW (W)	719	2	525119 185231
12	<b>Local Authority Pollution Prevention and Controls</b> Name: Esso Tower Service Station Location: 617 Finchley Road, LONDON, NW3 7BS Authority: London Borough of Camden, Pollution Projects Team Permit Reference: Not Given Dated: 1st December 1999 Process Type: Local Authority Air Pollution Control Description: PG1/14 Petrol filling station <b>Status: Authorised</b> Positional Accuracy: Automatically positioned to the address	A17SW (NW)	908	2	525052 186022
12	<b>Local Authority Pollution Prevention and Controls</b> Name: Tower Service Station Location: 617 Finchley Road, Fortune Green, London, NW3 7BS Authority: London Borough of Barnet, Environmental Health Department Permit Reference: PPC53 Dated: 1st January 1999 Process Type: Local Authority Pollution Prevention and Control Description: PG1/14 Petrol filling station <b>Status: Permitted</b> Positional Accuracy: Manually positioned to the address or location	A17SW (NW)	909	3	525052 186022
13	<b>Local Authority Pollution Prevention and Controls</b> Name: Is Dry Cleaners Location: 6 Canfield Gardens, London, Nw6 3bs Authority: London Borough of Camden, Pollution Projects Team Permit Reference: PPC/DC18 Dated: 5th February 2007 Process Type: Local Authority Pollution Prevention and Control Description: PG6/46 Dry cleaning <b>Status: Permitted</b> Positional Accuracy: Located by supplier to within 10m	A9SW (SE)	929	2	526257 184662
14	<b>Local Authority Pollution Prevention and Controls</b> Name: William J Humpage Location: 12-13 West Hampstead Mews, LONDON, NW6 3BB Authority: London Borough of Camden, Pollution Projects Team Permit Reference: Not Given Dated: Not Supplied Process Type: Local Authority Air Pollution Control Description: Part B process (no specific reference) <b>Status: Application Withdrawn</b> Positional Accuracy: Manually positioned to the address or location	A8SW (S)	964	2	525567 184544
	<b>Nearest Surface Water Feature</b> None				

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
	<b>Water Abstractions</b> Operator: London Borough Of Camden Licence Number: 28/39/39/0219 Permit Version: 1 Location: Swiss Cottage Open Space- Borehole Authority: Environment Agency, Thames Region Abstraction: Municipal Grounds: Spray Irrigation - Direct Abstraction Type: Water may be abstracted from a single point Source: Groundwater Daily Rate (m3): Not Supplied Yearly Rate (m3): Not Supplied Details: Swiss Cottage Open Space, Winchester Road, London. Authorised Start: 01 January Authorised End: 31 December Permit Start Date: 1st April 2008 Permit End Date: Not Supplied Positional Accuracy: Located by supplier to within 10m	A4NE (SE)	1543	1	526800 184280
	<b>Groundwater Vulnerability</b> Soil Classification: Soils of High Leaching Potential (U) - Soil information for restored mineral workings and urban areas is based on fewer observations than elsewhere. A worst case vulnerability classification (H) assumed, until proved otherwise Map Sheet: Sheet 39 West London Scale: 1:100,000	A13SE (NE)	0	1	525821 185497
	<b>Groundwater Vulnerability</b> Soil Classification: Not classified Map Sheet: Sheet 39 West London Scale: 1:100,000	A13SW (S)	0	1	525817 185482
	<b>Drift Deposits</b> None				
	<b>Bedrock Aquifer Designations</b> Aquifer Desination: Secondary Aquifer - A	A13SE (NE)	0	4	525821 185497
	<b>Superficial Aquifer Designations</b> No Data Available				
	<b>Extreme Flooding from Rivers or Sea without Defences</b> None				
	<b>Flooding from Rivers or Sea without Defences</b> None				
	<b>Areas Benefiting from Flood Defences</b> None				
	<b>Flood Water Storage Areas</b> None				
	<b>Flood Defences</b> None				

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
15	<b>Historical Landfill Sites</b> Licence Holder: Not Supplied Location: London NW6 Name: Canfield Place Operator Location: Not Supplied Boundary Accuracy: As Supplied Provider Reference: EAHLD12043 First Input Date: Not Supplied Last Input Date: Not Supplied Specified Waste: Not Supplied Type: EA Waste Ref: Not Supplied Regis Ref: Not Supplied WRC Ref: Not Supplied BGS Ref: Not Supplied Other Ref: DON009	A8SE (S)	705	1	526028 184811
	<b>Local Authority Landfill Coverage</b> Name: London Borough of Camden - Has no landfill data to supply		0	6	525821 185497
	<b>Local Authority Landfill Coverage</b> Name: London Borough of Barnet - Has supplied landfill data		861	7	525473 186298
16	<b>Registered Waste Transfer Sites</b> Licence Holder: L.B. of Camden Licence Reference: DL137 Site Location: 152 West End Lane, CAMDEN, London, NW6 Operator Location: Old Town Hall, Haverstock Hill, CAMDEN, London, NW3 4QP Authority: Environment Agency - Thames Region, North East Area Site Category: Transfer Max Input Rate: Very Small (Less than 10,000 tonnes per year) Waste Source: No known restriction on source of waste Restrictions: Licence Status: Licence lapsed/cancelled/defunct/not applicable/surrenderedCancelled Dated: 1st August 1983 Preceded By: Not Given Licence: Superseded By: Not Given Licence: Positional Accuracy: Manually positioned to the road within the address or location Boundary Quality: Not Supplied Authorised Waste: Asbestos Elect.Capacitors Cont'G Pcb Fluid Prohibited Waste: Biodegradable/Putrescible Waste Clinical Wastes Notifiable Wastes Special Wastes	A8SW (S)	741	1	525530 184790
17	<b>Registered Waste Transfer Sites</b> Licence Holder: P B Donoghue Licence Reference: DL140 Site Location: BR Goods Yard at 269 Finchley Road, CAMDEN, London, NW3 Operator Location: As Site Address Authority: Environment Agency - Thames Region, North East Area Site Category: Transfer Max Input Rate: Medium (Equal to or greater than 25,000 and less than 75,000 tonnes per year) Waste Source: No known restriction on source of waste Restrictions: Licence Status: Licence lapsed/cancelled/defunct/not applicable/surrenderedCancelled Dated: 1st February 1992 Preceded By: DL140 Licence: Superseded By: Not Given Licence: Positional Accuracy: Manually positioned to the address or location Boundary Quality: Not Supplied Authorised Waste: Lwra Cat. A = Inert Wastes Lwra Cat. Bi Gen.Non-Putresc Max.Waste Permitted By Licence-Stated Prohibited Waste: Clinical - As In Coll/Disp.Regis Of '88 Liquid/Slurry/Sludge Wastes Poisonous, Noxious, Polluting Wastes Special Wastes Waste N.O.S.	A9SW (SE)	798	1	526200 184780



Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
17	<b>Registered Waste Transfer Sites</b> Licence Holder: P B Donoghue Licence Reference: DL140 Site Location: BR Goods Yard, 269 Finchley Road, CAMDEN, London, NW3 Operator Location: As Site Address Authority: Environment Agency - Thames Region, North East Area Site Category: Transfer Max Input Rate: Medium (Equal to or greater than 25,000 and less than 75,000 tonnes per year) Waste Source: No known restriction on source of waste Restrictions: Licence Status: Record supersededSuperseded Dated: 1st August 1983 Preceded By: Not Given Licence: Superseded By: DL140 Licence: Positional Accuracy: Manually positioned to the address or location Boundary Quality: Not Supplied Authorised Waste: Commercial Waste Construction Ind. Wastes Max.Waste Permitted By Licence(Stated) Prohibited Waste: Clinical Waste -Clause 2 & 4 Hsc 1982 Notifiable Wastes Putrescible Waste Special Wastes	A9SW (SE)	798	1	526200 184780
18	<b>Registered Waste Treatment or Disposal Sites</b> Licence Holder: T H Beardon & Son Ltd Licence Reference: DL359 Site Location: Unit 3 Liddell Road, Maygrove Road, CAMDEN, London, NW6 2EW Operator Location: 9 Cleveland Gardens, WORCESTER PARK, Surrey, DT4 7JJ Authority: Environment Agency - Thames Region, North East Area Site Category: Scrapyard Max Input Rate: Very Small (Less than 10,000 tonnes per year) Waste Source: No known restriction on source of waste Restrictions: Licence Status: Licence lapsed/cancelled/defunct/not applicable/surrenderedCancelled Dated: 1st November 1991 Preceded By: Not Given Licence: Superseded By: Not Given Licence: Positional Accuracy: Manually positioned to the address or location Boundary Quality: Not Supplied Authorised Waste: Alum/Brass/Copper/Tin/Zinc/Lead+Alloys Electric Cable & Tyres Intact Lead/Acid Batteries Light Non-Ferrous Metals Lwra Cat Bii Gen. Scrap Metal Namely Max.Waste Permitted By Licence-Stated Stainless Steel Unsorted Metal Scrap Prohibited Waste: Clinical - As In Coll/Disp.Reg. Of '88 Liquid/Sludge Wastes Poisonous, Noxious, Polluting Wastes Special Wastes N.O.S. Tyres Waste Containing Cfc	A7SE (SW)	886	1	525210 184820

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
	<b>BGS 1:625,000 Solid Geology</b> Description: London Clay	A13SE (NE)	0	4	525821 185497
	<b>Coal Mining Affected Areas</b> In an area which may not be affected by coal mining				
	<b>Non Coal Mining Areas of Great Britain</b> No Hazard				
	<b>Potential for Collapsible Ground Stability Hazards</b> No Hazard				
	<b>Potential for Compressible Ground Stability Hazards</b> Hazard Potential: No Hazard Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497
	<b>Potential for Ground Dissolution Stability Hazards</b> No Hazard				
	<b>Potential for Landslide Ground Stability Hazards</b> Hazard Potential: Very Low Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497
	<b>Potential for Landslide Ground Stability Hazards</b> Hazard Potential: Low Source: British Geological Survey, National Geoscience Information Service	A13SW (S)	104	4	525800 185375
	<b>Potential for Running Sand Ground Stability Hazards</b> Hazard Potential: Very Low Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497
	<b>Potential for Running Sand Ground Stability Hazards</b> Hazard Potential: No Hazard Source: British Geological Survey, National Geoscience Information Service	A13SE (S)	29	4	525821 185450
	<b>Potential for Running Sand Ground Stability Hazards</b> Hazard Potential: Low Source: British Geological Survey, National Geoscience Information Service	A13NE (N)	192	4	525900 185700
	<b>Potential for Shrinking or Swelling Clay Ground Stability Hazards</b> Hazard Potential: Moderate Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497
	<b>Potential for Shrinking or Swelling Clay Ground Stability Hazards</b> Hazard Potential: No Hazard Source: British Geological Survey, National Geoscience Information Service	A13NE (N)	192	4	525900 185700
	<b>Radon Potential - Radon Affected Areas</b> Affected Area: The property is in a lower probability radon area, as less than 1% of homes are above the action level Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497
	<b>Radon Potential - Radon Protection Measures</b> Protection Measure: No radon protective measures are necessary in the construction of new dwellings or extensions Source: British Geological Survey, National Geoscience Information Service	A13SE (NE)	0	4	525821 185497

Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
19	<b>Contemporary Trade Directory Entries</b> Name: All Rubbish Cleared Location: Redington Rd, London, NW3 7QX Classification: Rubbish Clearance <b>Status: Active</b> Positional Accuracy: Manually positioned to the road within the address or location	A13NE (NE)	194	-	525919 185694
20	<b>Contemporary Trade Directory Entries</b> Name: Maximus Property Services Ltd Location: 459, Finchley Road, LONDON, NW3 6HN Classification: Cleaning Services - Domestic <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	210	-	525683 185306
20	<b>Contemporary Trade Directory Entries</b> Name: Curtains & Blinds Location: 459, Finchley Road, London, NW3 6HN Classification: Blinds, Awnings & Canopies <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	210	-	525683 185306
20	<b>Contemporary Trade Directory Entries</b> Name: Global Medical Trading Ltd Location: A, 338, West End Lane, London, NW6 1LN Classification: Chemicals - Distributors & Wholesalers <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	219	-	525661 185312
20	<b>Contemporary Trade Directory Entries</b> Name: Look New Location: 334, West End Lane, London, NW6 1LN Classification: Dry Cleaners <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	227	-	525653 185309
21	<b>Contemporary Trade Directory Entries</b> Name: Five Star Location: 469, Finchley Road, London, NW3 6HS Classification: Dry Cleaners <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	216	-	525635 185340
21	<b>Contemporary Trade Directory Entries</b> Name: Jav'S 5 Star Dry Cleaners Location: 469, Finchley Road, London, NW3 6HS Classification: Dry Cleaners <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	216	-	525635 185340
21	<b>Contemporary Trade Directory Entries</b> Name: Classic Cleaners Location: 475, Finchley Road, London, NW3 6HS Classification: Dry Cleaners <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	217	-	525623 185351
21	<b>Contemporary Trade Directory Entries</b> Name: Nineteen (Uk) Ltd Location: 369, West End Lane, London, NW6 1LP Classification: Telecommunications Equipment & Systems <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	229	-	525627 185329
21	<b>Contemporary Trade Directory Entries</b> Name: Carmel Garage Location: 322, West End Lane, London, NW6 1LN Classification: Garage Services <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A13SW (SW)	249	-	525630 185299
22	<b>Contemporary Trade Directory Entries</b> Name: Finchley Road Audi Location: 278 Finchley Road, London, NW3 6LT Classification: Car Dealers <b>Status: Active</b> Positional Accuracy: Manually positioned to the road within the address or location	A13SW (W)	253	-	525540 185450
23	<b>Contemporary Trade Directory Entries</b> Name: Plumbright Services Location: 47, Studholme Court, Finchley Road, London, NW3 7AE Classification: Boilers - Servicing, Replacements & Repairs <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A13NW (W)	325	-	525484 185603



Map ID	Details	Quadrant Reference (Compass Direction)	Estimated Distance From Site	Contact	NGR
82	<b>Contemporary Trade Directory Entries</b> Name: Disc To Print Location: 25, Liddell Road, London, NW6 2EW Classification: Printers <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A7SW (SW)	960	-	525130 184793
82	<b>Contemporary Trade Directory Entries</b> Name: Tape House Location: 24, Liddell Road, London, NW6 2EW Classification: Distribution Services <b>Status: Active</b> Positional Accuracy: Manually positioned to the address or location	A7SW (SW)	964	-	525122 184795
83	<b>Contemporary Trade Directory Entries</b> Name: Motor Works Location: A, 1, Glastonbury Street, London, NW6 1QJ Classification: Garage Services <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A7NW (SW)	968	-	524940 185025
84	<b>Contemporary Trade Directory Entries</b> Name: Fat Cat International Ltd Location: 20, Liddell Road, London, NW6 2EW Classification: Record, Tape & CD Manufacturers & Wholesalers <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A7SW (SW)	981	-	525092 184801
85	<b>Contemporary Trade Directory Entries</b> Name: Chamber Engineering Ltd Location: 35, Gondar Gardens, London, NW6 1EP Classification: Metal Products - Fabricated <b>Status: Active</b> Positional Accuracy: Automatically positioned to the address	A11SE (W)	990	-	524802 185418
86	<b>Contemporary Trade Directory Entries</b> Name: Cross Weir Ltd Location: Barkat House, 116-118, Finchley Road, London, NW3 5HT Classification: Valve Manufacturers & Suppliers <b>Status: Inactive</b> Positional Accuracy: Automatically positioned to the address	A9SW (SE)	999	-	526376 184647
87	<b>Fuel Station Entries</b> Name: Cavendish Motors Location: West End Lane, LONDON, Greater London, NW6 1XF Brand: OBSOLETE Premises Type: Not Applicable <b>Status: Obsolete</b> Positional Accuracy: Manually positioned to the road within the address or location	A12SE (SW)	478	-	525412 185197
88	<b>Fuel Station Entries</b> Name: Fortune Green Service Station Location: 63-65 Fortune Green Road, Fortune Green, LONDON, NW6 1DR Brand: Texaco Premises Type: Not Applicable <b>Status: Obsolete</b> Positional Accuracy: Manually positioned to the road within the address or location	A12NW (W)	687	-	525113 185609
89	<b>Fuel Station Entries</b> Name: The Tower Service Station Location: 617, Finchley Road, London, NW3 7BS Brand: ESSO Premises Type: Petrol Station <b>Status: Open</b> Positional Accuracy: Automatically positioned to the address	A17SW (NW)	908	-	525052 186022