


6 Nutley Terrace  
London

Energy Efficiency Statement and  
Code for Sustainable Homes Pre-assessment

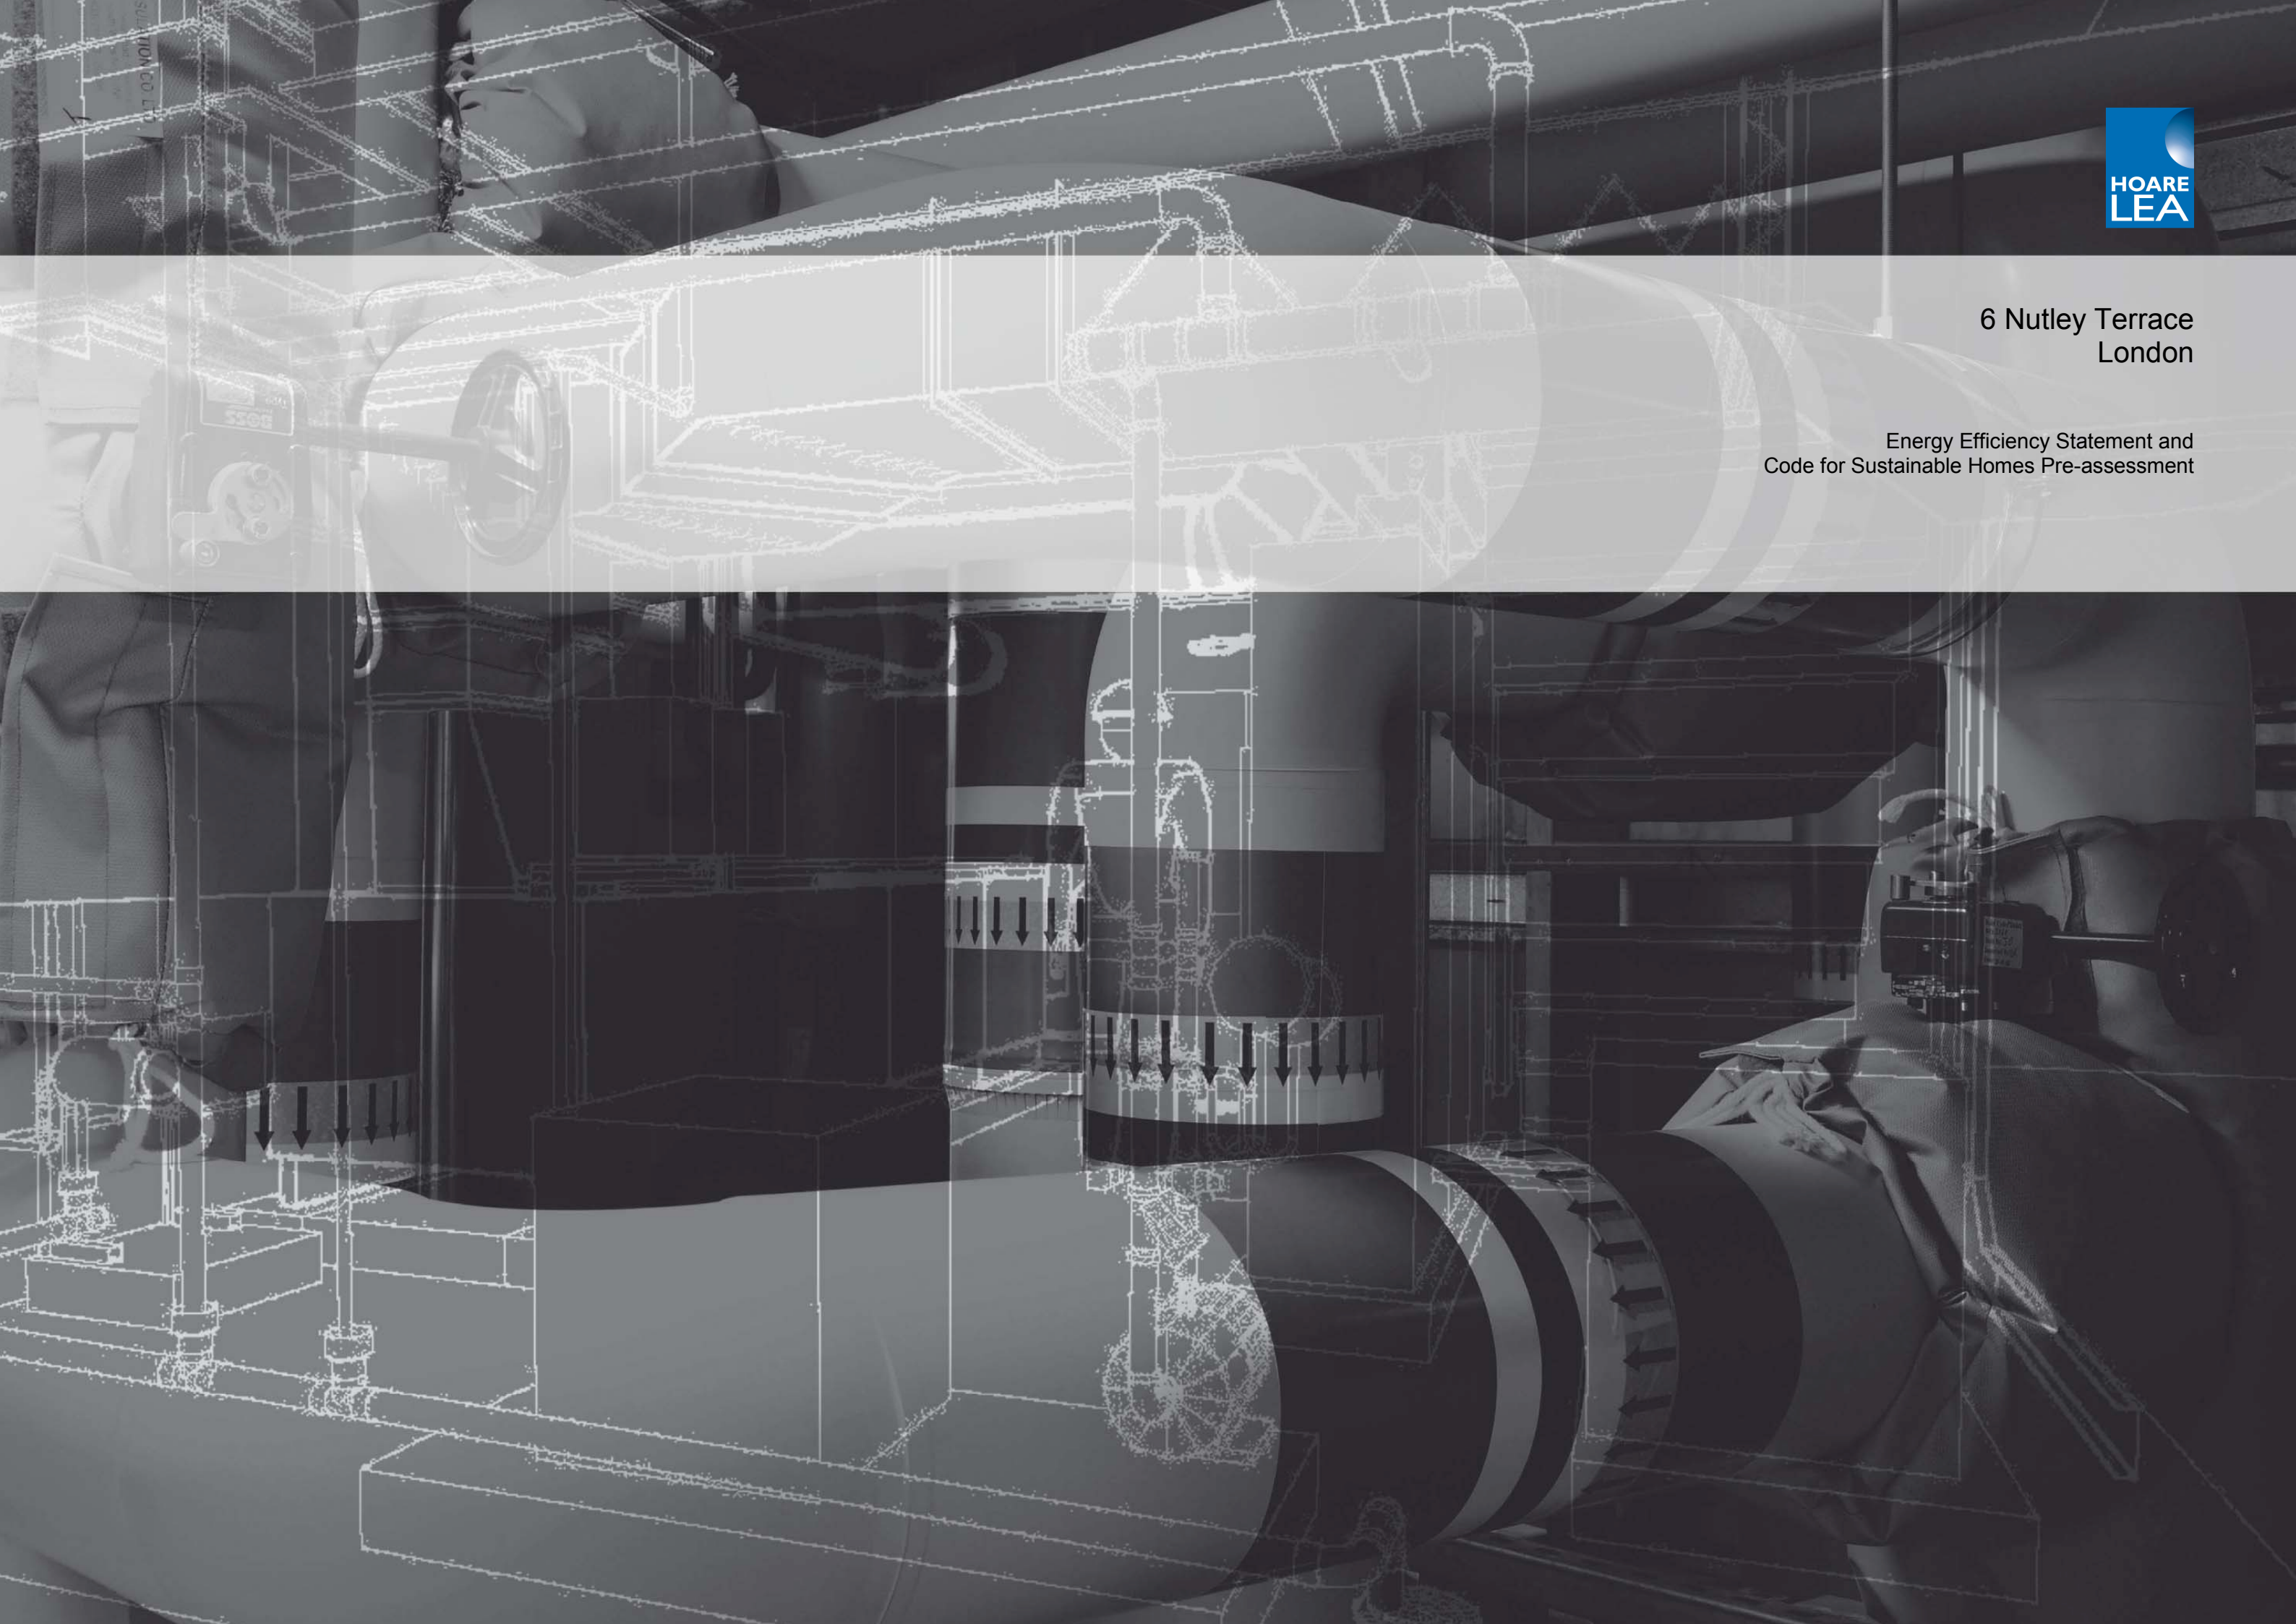

**Audit Sheet**

Revision	Description	Date	Issued by	Reviewed by
-	Draft for Comment	Nov 2011	C Parkin	
02	For Planning	Feb 2012	C Parkin	C Dougan

This report is provided for the stated purposes and for the sole use of the named Client. It will be confidential to the Client and the client's professional advisers. Hoare Lea accepts responsibility to the Client alone that the report has been prepared with the skill, care and diligence of a competent engineer, but accepts no responsibility whatsoever to any parties other than the Client. Any such parties rely upon the report at their own risk. Neither the whole nor any part of the report nor reference to it may be included in any published document, circular or statement nor published in any way without Hoare Lea's written approval of the form and content in which it may appear.



Contents

1.0	Executive Summary	2
2.0	Introduction	3
3.0	Summary of Key Points from Camden Sustainability Supplementary Planning Guidance	3
4.0	Summary of Key Points from Part L1A 2010	3
4.1	Achievement of Compliance	3
4.2	Fabric Performance	3
4.3	Fixed Building Services Performance	4
5.0	Proposed Measures to meet Camden Sustainability Policies and Part L1A 2010	5
5.1	Software Modelling	5
5.2	Fabric Performance	5
5.3	Fixed Building Services Performance	5
5.4	Air Source Heat Pumps ( <i>be green</i> )	5
5.5	Headline Camden Policies	5
6.0	Part L1A 2010 Results	6
6.1	Criterion 1	6
6.2	Criterion 2	6
6.3	Criterion 3	6
	Appendix A – Part L1A Building Regulations Compliance Report & SAP Worksheet	7
	Appendix B – Code for Sustainable Homes Pre-assessment	8

## 1.0 Executive Summary

To meet the requirements of the London Borough of Camden planning policies relating to energy and sustainability and to meet the requirements of the Building Regulation Approved Document Part L1A 2010 the following measures are proposed:

- Enhanced building fabric performance – U-values and air tightness
- Enhanced buildings services performance – high efficiency equipment and low energy lighting
- Use of air source heat pumps and underfloor heating

Use of micro-CHP has been shown not to be effective on this development.

The proposed measures result in the following outcomes:

- A minimum of 25% CO2 reduction compared to a Part L 2010 compliant dwelling
- More than 20% CO2 reduction due to the use of ASHPs when compared to the same building being heated by direct electric heating and when taking into account regulated and unregulated energy uses.
- Dwellings that can work with natural ventilation and maintain occupant comfort
- Code for Sustainable Homes (CSH) Level 3 compliance with a minimum of 50% of the energy credits achievable

In addition to the energy credits it is proposed that approximately 65% of the CSH Water credits are achievable, 50% of the Materials credits and 75% of the Waste credits. The full CSH pre-assessment is appended to this document. The pre-assessment demonstrates one possible route to achieving CSH Level 3 and a minimum of 50% of credits in the Energy, Water, Materials and Waste sections.



## 2.0 Introduction

This report has been prepared to provide a summary of the energy efficiency measures for the proposed 6 Nutley Terrace development. It is intended to address the London Borough of Camden's policies relating to climate change and sustainable design and construction, specifically CS 13 – Tackling Climate Change through Promoting Higher Environmental Standards and DP22 – Promoting Sustainable Design and Construction. It is also written with the requirements of the Camden Supplementary Planning Guidance document in mind.

## 3.0 Summary of Key Points from Camden Sustainability Supplementary Planning Guidance

The list below gives the headline requirements of the Camden sustainability planning guidance relating to energy:

- Follow the “*be lean, be clean, be green*” approach
- Account for regulated and unregulated energy using modelled or benchmark data for minor developments
- Demonstrate via modelling that overheating is not an issue
- Demonstrate that natural ventilation has been considered in the design
- Connect to existing district heating networks or provide CHP onsite
- Aim to achieve a 20% CO<sub>2</sub> reduction from renewables
- Aim to achieve 50% of energy credits under the Code for Sustainable Homes

## 4.0 Summary of Key Points from Part L1A 2010

Part L1A 2010 gives five criteria by which a development must provide evidence of compliance (refer to table below). Note that Criteria 4 and 5 will be evidenced at the construction/completion stage. This report addresses steps taken to improve the design in order to meet Criterion 1, 2 and 3.

<b>CRITERION 1:</b>	<i>“The calculated rate of CO<sub>2</sub> emissions from the dwelling (the Dwelling Emission Rate, DER) must not be greater than the Target Emission Rate, TER)”</i>
<b>CRITERION 2:</b>	<i>“The performance of the building fabric and the fixed building services [heating, hot water and fixed lighting systems] should achieve reasonable overall standards of energy efficiency”</i>
<b>CRITERION 3:</b>	<i>“The dwelling has appropriate passive control measures to limit the effect of solar gains on indoor temperatures in summer, regardless of whether or not the dwelling has mechanical cooling.”</i>
<b>CRITERION 4:</b>	<i>“The performance of the dwelling, as built, is consistent with the DER”</i>
<b>CRITERION 5:</b>	<i>“The necessary provisions for energy efficient operation of the dwelling should be put in place.”</i>

## 4.1 Achievement of Compliance

Some additional information on how to meet each criterion is provided below:

### Criterion 1

To pass Criterion 1, the Dwelling Emission Rate (DER) must be less than the Target Emissions Rate (TER), i.e. DER < TER.

The development aims to demonstrate a good level of energy efficiency that will reduce carbon emissions due to heating, hot water generation, lighting, fans and pumps.

### Criterion 2

To pass Criterion 2 the minimum performance standards set out in the Approved Documents and supporting documentation must be met or exceeded. These are set out in Sections 4.2 and 4.3.

### Criterion 3

To pass Criterion 3, the dwelling must have less than a “High” risk of high internal temperatures. The table below shows the range of possible outcomes ranging from “Not Significant” to “High”.

T <sub>threshold</sub>	Likelihood of high internal temperature in hot weather
<20.5°C	Not significant
≤ 20.5°C and <22°C	Slight
≤ 22.0°C and <22°C	Medium
≥ 23.5°C	High

## 4.2 Fabric Performance

The limiting standards from the approved documents relating to building fabric are shown in the table below:

Element	Approved Document L1A 2010 Table 2	Approved Document C 2004
	Maximum area-weighted average U-value (W/m <sup>2</sup> .K)	Absolute Maximum U-value (W/m <sup>2</sup> .K)
Roof	0.20	0.35
Wall	0.30	0.7
Ground Floor	0.25	0.7
Party Wall	0.2	No limit
Windows, roof windows, glazed rooflights, curtain walling and pedestrian doors	2.0	No limit

Other limiting standards are:

1. Air permeability – shall be  $<10 \text{ m}^3/\text{hr.m}^2 @ 50\text{Pa}$
2. Thermal bridging – *“the building fabric should be constructed such that there are no reasonably avoidable thermal bridges”.*

#### 4.3 Fixed Building Services Performance

The limiting standards from the approved documents and supporting documents relating to building services are shown below:

Plant Item	Criteria
Air Source Heat Pumps (space heating)	COP > 2.2
Air Source Heat Pumps (DHW)	COP > 2.0
Air Source Heat Pumps	Seasonal Performance Factor > 2.7
Air Source Heat Pumps (cooling)	EER > 2.4
Ventilation unit (MVHR) Specific Fan Power	<1.5W//s
MVHR heat recovery efficiency	>70%

Minimum efficiency standards also apply to domestic lighting installations.

For fixed internal lighting these are:

1. At least 75% of frequently used light fittings shall be low energy type.
2. Low energy lights shall have an efficacy >45 lumens per circuit Watt

For fixed external lighting these are:

1. External lighting with automatic presence and daylight control shall have a lamp capacity of <100 Watts
2. External lighting with automatic presence and manual control shall have an efficacy >45 lumens per circuit Watt

## 5.0 Proposed Measures to meet Camden Sustainability Policies and Part L1A 2010

The following section summarises the proposed energy efficiency strategy.

### 5.1 Software Modelling

A sample SAP assessment (using NHER software Plan Assessor Version v5.2) has been carried out on the proposed development. The results are contained within the Appendices.

### 5.2 Fabric Performance

To reduce energy demand by passive means (*be lean*) the building fabric performance will significantly exceed the requirements of Part L1A 2010.

The values in the table below are those currently proposed.

Element	U-value (W/m <sup>2</sup> .K)
Roof	0.13
External Wall	0.18
Ground Floor	0.18
Party Wall	N/A
Windows and glazed rooflights	1.5

Air permeability target construction value of shall be < 3.5 m<sup>3</sup>/hr.m<sup>2</sup> @ 50Pa to achieve a maximum of 5 m<sup>3</sup>/hr.m<sup>2</sup> @ 50Pa.

It is assumed that quality assured accredited construction details to limit the effects of thermal bridging will not be employed. Refer to "*Limiting thermal bridging and air leakage: robust construction details for dwellings and similar buildings*", TSO, 2001 for such details. The default thermal bridge y-value of 0.15 is therefore assumed.

All windows are assumed to be fully openable and provide (as a minimum) single sided ventilation to assist in reducing summertime temperatures. Glazing areas are limited to reduce overheating risk and to reduce heat loss.

A medium [thermal] weight structure is assumed.

## 5.3 Fixed Building Services Performance

To further reduce energy demand by active means (*be lean*) the building services performance will significantly exceed the requirements of Part L1A 2010.

The following plant criteria are proposed:

Plant Item	Proposed Design
Air Source Heat Pumps (space heating)	COP > 2.8
Air Source Heat Pumps (DHW)	COP > 2.2
Air Source Heat Pumps	Seasonal Performance Factor > 3.0
Air Source Heat Pumps (cooling)	EER > 2.8
Ventilation unit (MVHR) Specific Fan Power	< 0.7W//s
MVHR heat recovery efficiency	>85%

In addition, the MVHR unit will be SAP Appendix Q registered.

Lighting is assumed to meet the minimum standards.

## 5.4 Air Source Heat Pumps (*be green*)

Air source heat pumps are proposed as an appropriate renewable technology for this development. The ASHPs will be linked to an underfloor heating system which shall run at low temperature appropriate for use with ASHPs. This is an efficient means of providing space heating and provides a comfortable living environment by the use of a radiant heating source.

A comparison with gas fired boilers using the SAP assessment software was undertaken and ASHPs were shown to be considerably more efficient – even when providing water at high temperatures for domestic hot water use.

## 5.5 Headline Camden Policies

The sections above outline the proposed "*be lean, be clean, be green*" approach.

As this is a minor development a full energy assessment listing out baseline energy demand, reductions due to each technology and a full estimation of unregulated emissions has not been undertaken.

Overheating is addressed under Part L Criterion 3 below.

The main living areas of House 6B will be provided with comfort cooling due to market expectation. However, occupants will always have the choice of using natural ventilation as an alternative. Designing an appropriate, low energy cooling system into the scheme at an early stage will avoid occupants retrofitting inefficient systems at a later date. As can be seen in the SAP worksheet results, CO<sub>2</sub> emissions due to cooling are negligible.



There are no district networks in the local area which can be feasibly connected to and the site is not appropriate for a Strategic Site to support large scale CHP units to feed a wider district network.

An assessment has been made of micro-CHP units. However, the CO2 reduction benefit of installing these units is very limited. This is due to the mismatch between the high thermal output from the micro-CHP units and the low heat load of each house which leads to the units operating inefficiently. CHP is therefore not appropriate for this development.

The use of ASHPs will contribute to a significant reduction in CO2 emissions – exceeding 20% when taking into account regulated and unregulated energy. This figure has been estimated from the SAP software by establishing the difference in CO2 emissions between a direct electric system and the ASHP system.

The proposed measures results in a DER approximately 35% lower than the TER (see Appendices).

## **6.0 Part L1A 2010 Results**

See the Appendices for the building regulations compliance reports.

### **6.1 Criterion 1**

The area weighted TER is 14.46 kgCO<sub>2</sub>/m<sup>2</sup>/yr  
The area weighted DER is 23.13 kgCO<sub>2</sub>/m<sup>2</sup>/yr

The building is therefore in compliance with the requirements for Part L1A criterion 1.

### **6.2 Criterion 2**

All of the fabric and building services performance standards are shown in the previous sections to be met or exceeded.

The building is therefore in compliance with the requirements for Part L1A criterion 2.

### **6.3 Criterion 3**

The house assessed has an overheating risk of “Not Significant”. Therefore the building is compliance with the requirements for Part L1A criterion 3. This also satisfies the Camden policy on preventing overheating and demonstrates that the building can be comfortably occupied without the need for comfort cooling.



6 Nutley Terrace

Energy Efficiency Statement &  
Code for Sustainable Homes Pre-assessment



---


**Appendix A – Part L1A Building Regulations Compliance Report & SAP Worksheet**

This design draft submission provides evidence towards compliance with Part L of the Building Regulations, in accordance with Appendix A of AD L1A. It has been carried out using Approved SAP software. It has been prepared from plans and specifications and may not reflect the 'as built' property. This report covers only items included within the SAP and is not a complete report of regulations compliance.

Assessor name	Mrs Vicki Limbrick	Assessor number	5907
Client		Last modified	15/11/2011
Address	6B Nutley Terrace 6B, London, NM3* **		

Check	Evidence	Produced by	OK?																		
<b>Criterion 1: predicted carbon dioxide emission from proposed dwelling does not exceed the target</b>																					
TER (kg CO <sub>2</sub> /m <sup>2</sup> .a)	Fuel = Electricity Fuel factor = 1.47 TER = 23.13	Authorised SAP Assessor																			
DER for dwelling as designed (kg CO <sub>2</sub> /m <sup>2</sup> .a)	DER = 14.46	Authorised SAP Assessor																			
Are emissions from dwelling as designed less than or equal to the target?	DER 14.46 < TER 23.13	Authorised SAP Assessor	Passed																		
<b>Criterion 2: the performance of the building fabric and the heating, hot water and fixed lighting systems should be no worse than the design limits</b>																					
<b>Fabric U-values</b>																					
Are all U-values better than the design limits in Table 2?	<table border="1"> <thead> <tr> <th>Element</th> <th colspan="2">Weighted average Highest</th> </tr> </thead> <tbody> <tr> <td>Wall</td> <td>0.18 (max 0.30)</td> <td>0.18 (max 0.70)</td> </tr> <tr> <td>Party wall</td> <td>0.00 (max 0.20)</td> <td>N/A</td> </tr> <tr> <td>Floor</td> <td>0.18 (max 0.25)</td> <td>0.18 (max 0.70)</td> </tr> <tr> <td>Roof</td> <td>0.13 (max 0.20)</td> <td>0.13 (max 0.35)</td> </tr> <tr> <td>Openings</td> <td>1.50 (max 2.00)</td> <td>1.50 (max 3.30)</td> </tr> </tbody> </table>	Element	Weighted average Highest		Wall	0.18 (max 0.30)	0.18 (max 0.70)	Party wall	0.00 (max 0.20)	N/A	Floor	0.18 (max 0.25)	0.18 (max 0.70)	Roof	0.13 (max 0.20)	0.13 (max 0.35)	Openings	1.50 (max 2.00)	1.50 (max 3.30)	Authorised SAP Assessor	Passed
Element	Weighted average Highest																				
Wall	0.18 (max 0.30)	0.18 (max 0.70)																			
Party wall	0.00 (max 0.20)	N/A																			
Floor	0.18 (max 0.25)	0.18 (max 0.70)																			
Roof	0.13 (max 0.20)	0.13 (max 0.35)																			
Openings	1.50 (max 2.00)	1.50 (max 3.30)																			
<b>Thermal bridging</b>																					
How has the loss from thermal bridges been calculated?	Thermal bridging calculated using default y-value of 0.15	Authorised SAP Assessor																			
<b>Heating and hot water systems</b>																					
Does the efficiency of the heating systems meet the minimum value set out in the Domestic Heating Compliance Guide?	Main heating system: Electricity, Heat pump - wet system Air-to-water  Secondary heating system: None	Authorised SAP Assessor																			
Does the insulation of the hot water cylinder meet the standards set out in the Domestic Heating Compliance Guide?	Cylinder volume = 260.00 litres Declared cylinder loss = 2.50kWh/day Maximum permitted cylinder loss = 2.62kWh/day Primary hot water pipes are insulated	Authorised SAP Assessor	Passed																		
Do controls meet the minimum controls provision set out in the Domestic Heating Compliance Guide?	Space heating control: Time and temperature zone control  Hot water control: No boiler interlock (main system 1) Cylinder thermostat Separate water control	Authorised SAP Assessor	Passed																		

Check	Evidence	Produced by	OK?
<b>Fixed internal lighting</b>			
Does fixed internal lighting comply with paragraphs 42 to 44?	Schedule of installed fixed internal lighting Standard lights = 4 Low energy lights = 12  Percentage of low energy lights = 75 % Minimum = 75 %	Authorised SAP Assessor	Passed
<b>Criterion 3: the dwelling has appropriate passive control measures to limit solar gains</b>			
Does the dwelling have a strong tendency to high summertime temperatures?	Overheating risk (June) = Not significant Overheating risk (July) = Not significant Overheating risk (August) = Not significant Region = Thames Thermal mass parameter = 250.00 Ventilation rate in hot weather = 5.00 ach Blinds/curtains = None	Authorised SAP Assessor	Passed
<b>Criterion 4: the performance of the dwelling, as designed, is consistent with the DER</b>			
Design air permeability (m <sup>3</sup> /(h.m <sup>2</sup> ) at 50Pa)	Design air permeability = 5.00 Max air permeability = 10.00	Authorised SAP Assessor	Passed
Mechanical ventilation system Specific fan power (SFP)	Mechanical ventilation with heat recovery: SFP = 0.70 W/(litre/sec) Max SFP = 1.5 W/(litre/sec) Heat recovery efficiency = 89.00 % Min heat recovery efficiency = 70.00 %	Authorised SAP Assessor	Passed
Have the key features of the design been included (or bettered) in practice?	The following walls/wall have a U-value less than 0.2W/m <sup>2</sup> K: <ul style="list-style-type: none"> <li>• Basement (0.18)</li> <li>• Party (0.00)</li> <li>• External (0.18)</li> </ul> The following floors/floor have a U-value less than 0.2W/m <sup>2</sup> K: <ul style="list-style-type: none"> <li>• Floor 1 (0.18)</li> </ul> Space cooling is specified	Authorised SAP Assessor	

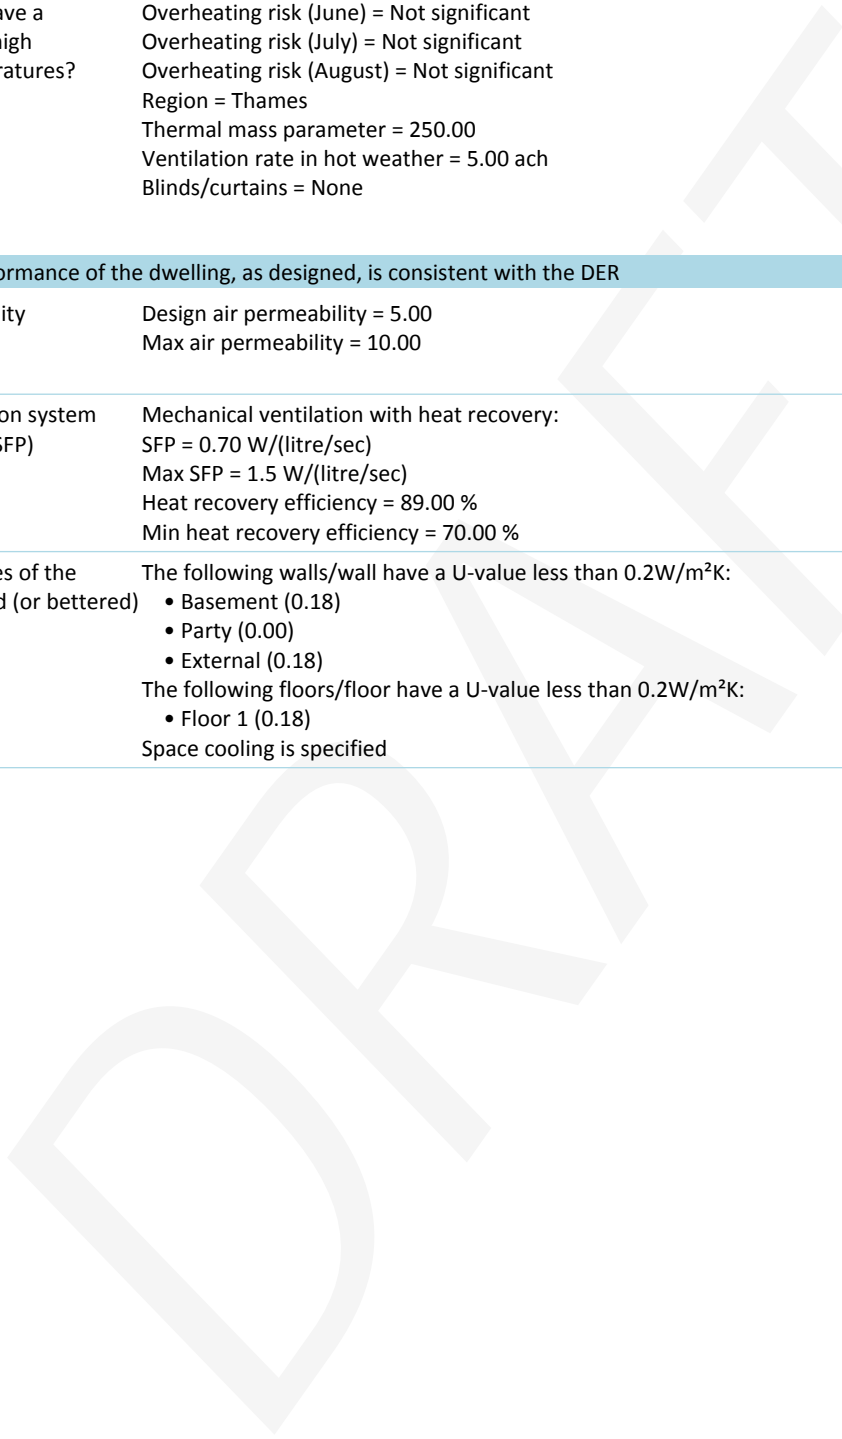

This design submission has been carried out using Approved SAP software. It has been prepared from plans and specifications and may not reflect the property as constructed.

Assessor name	Mrs Vicki Limbrick	Assessor number	5907
Client		Last modified	15/11/2011
Address	6B Nutley Terrace 6B, London, NM3* **		

### 1. Overall dwelling dimensions

	Area (m <sup>2</sup> )		Average storey height (m)		Volume (m <sup>3</sup> )
Lowest occupied	186.50 (1a)	x	2.70 (2a)	=	503.55 (3a)
+1	142.50 (1b)	x	2.70 (2b)	=	384.75 (3b)
+2	126.00 (1c)	x	2.70 (2c)	=	340.20 (3c)
+3	93.30 (1d)	x	2.50 (2d)	=	233.25 (3d)
Total floor area	(1a) + (1b) + (1c) + (1d)...(1n) =		548.30 (4)		
Dwelling volume			(3a) + (3b) + (3c) + (3d)...(3n) =		1461.75 (5)

### 2. Ventilation rate

			m <sup>3</sup> per hour
Number of chimneys	0	x 40 =	0 (6a)
Number of open flues	0	x 20 =	0 (6b)
Number of intermittent fans	0	x 10 =	0 (7a)
Number of passive vents	0	x 10 =	0 (7b)
Number of flueless gas fires	0	x 40 =	0 (7c)

			Air changes per hour
Infiltration due to chimneys, flues, fans, PSVs	(6a) + (6b) + (7a) + (7b) + (7c) =		0 ÷ (5) = 0.00 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Air permeability value, q <sub>50</sub> , expressed in cubic metres per hour per square metre of envelope area	5.00 (17)
--	-----------

If based on air permeability value, then (18) = [(17) ÷ 20] + (8), otherwise (18) = (16)	0.25 (18)
--	-----------

Air permeability value applies if a pressurisation test has been done, or a design or specified air permeability is being used

Number of sides on which dwelling is sheltered	1 (19)
--	--------

Shelter factor	1 - [0.075 x (19)] =	0.92 (20)
----------------	----------------------	-----------

Adjusted infiltration rate	(18) x (20) =	0.23 (21)
----------------------------	---------------	-----------

Infiltration rate modified for monthly wind speed:

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7 (22)m	5.40	5.10	5.10	4.50	4.10	3.90	3.70	3.70	4.20	4.50	4.80	5.10
	Σ(22)1...12 =											54.10 (22)

Wind Factor (22a)m = (22)m ÷ 4

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(22a)m	1.35	1.27	1.27	1.12	1.02	0.98	0.92	0.92	1.05	1.12	1.20	1.27
	Σ(22a)1...12 =											13.52 (22a)

Adjusted infiltration rate (allowing for shelter and wind speed) = (21) x (22a)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(22b)m	0.31	0.29	0.29	0.26	0.24	0.23	0.21	0.21	0.24	0.26	0.28	0.29
	Σ(22b)1...12 =											3.13 (22b)

Calculate effective air change rate for the applicable case:

If mechanical ventilation: air change rate through system 0.50 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)), otherwise (23b) = (23a) 0.50 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 75.65 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR)  $(22b)m + (23b) \times [1 - (23c) \div 100] =$

(24a)m 

0.43	0.42	0.42	0.38	0.36	0.35	0.34	0.34	0.36	0.38	0.40	0.42
------	------	------	------	------	------	------	------	------	------	------	------

 (24a)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m 

0.43	0.42	0.42	0.38	0.36	0.35	0.34	0.34	0.36	0.38	0.40	0.42
------	------	------	------	------	------	------	------	------	------	------	------

 (25)

### 3. Heat losses and heat loss parameter

The  $\kappa$ -value is the heat capacity per unit area, see Table 1e.

Element	Gross Area, m <sup>2</sup>	Openings, m <sup>2</sup>	Net area A, m <sup>2</sup>	U-value, W/m <sup>2</sup> K	A x U, W/K	$\kappa$ -value, kJ/m <sup>2</sup> .K	A x $\kappa$ , kJ/K
Window*			70.10	1.42	99.20	N/A	N/A
Roof window*			2.20	1.42	3.11	N/A	N/A
Basement floor			186.50	0.18	33.57	N/A	N/A
Basement wall			134.03	0.18	24.13	N/A	N/A
Party Wall			25.38	0.00	0.00	N/A	N/A
External wall			347.92	0.18	62.63	N/A	N/A
Roof			196.50	0.13	25.54	N/A	N/A
Total area of external elements $\sum A$ , m <sup>2</sup>			937.25				(31)

\* for windows and roof windows, effective window U-value is calculated using formula  $1/[(1/U_{Value})+0.04]$  paragraph 3.2

Fabric heat loss, W/K =  $\sum(A \times U)$  (26)...(30) + (32) = 248.18 (33)

Heat capacity Cm =  $\sum(A \times \kappa)$  (28)...(30) + (32) + (32a)...(32e) = N/A (34)

Thermal mass parameter (TMP) in kJ/m<sup>2</sup>K Calculated separately = 250.00 (35)

Thermal bridges:  $\sum(L \times \Psi)$  calculated using Appendix K 140.59 (36)

if details of thermal bridging are not known then (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 388.76 (37)

Ventilation heat loss calculated monthly  $0.33 \times (25)m \times (5)$

(38)m 

209.32	200.96	200.96	184.22	173.07	167.49	161.91	161.91	175.86	184.22	192.59	200.96
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

 (38)

Heat transfer coefficient, W/K (37)m + (38)m

(39)m 

598.09	589.72	589.72	572.99	561.83	556.26	550.68	550.68	564.62	572.99	581.35	589.72
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

Average =  $\sum(39)1...12/12 = 573.22$  (39)

Heat loss parameter (HLP), W/m<sup>2</sup>K (39)m ÷ (4)

(40)m 

1.09	1.08	1.08	1.05	1.02	1.01	1.00	1.00	1.03	1.05	1.06	1.08
------	------	------	------	------	------	------	------	------	------	------	------

Average =  $\sum(40)1...12/12 = 1.05$  (40)

### 4. Water heating energy requirement

kWh/year

Assumed occupancy, N 3.45 (42)

If TFA > 13.9, N =  $1 + 1.76 \times [1 - \exp(-0.000349 \times (TFA - 13.9)^2)] + 0.0013 \times (TFA - 13.9)$

If TFA ≤ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average =  $(25 \times N) + 36$  116.25 (43)

Annual average hot water usage has been reduced by 5% if the dwelling is designed to achieve a water use target of not more than 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)												
(44)m	127.87	123.22	118.57	113.92	109.27	104.62	104.62	109.27	113.92	118.57	123.22	127.87

$\sum(44)1...12 = 1395.00$  (44)



Energy content of hot water used - calculated monthly =  $4.190 \times Vd_m \times nm \times Tm/3600$  kWh/month (see Tables 1b, 1c 1d)

(45)m	190.09	166.25	171.56	149.57	143.51	123.84	114.76	131.69	133.26	155.30	169.52	184.09	
	$\Sigma(45)1...12 =$											1833.43	(45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

For community heating include distribution loss whether or not hot water tank is present

Distribution loss  $0.15 \times (45)m$

(46)m	28.51	24.94	25.73	22.44	21.53	18.58	17.21	19.75	19.99	23.30	25.43	27.61
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day):

2.50 (47)

Temperature factor from Table 2b

0.54 (48)

Energy lost from water storage, kWh/day (47) x (48)

1.35 (49)

Enter (49) or (54) in (55)

1.35 (55)

Water storage loss calculated for each month = (55) x (41)m

(56)m	41.85	37.80	41.85	40.50	41.85	40.50	41.85	41.85	40.50	41.85	40.50	41.85
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

If cylinder contains dedicated solar storage, = (56)m x [(50) - (H11)] ÷ (50), else = (56)m where (H11) is from Appendix H

(57)m	41.85	37.80	41.85	40.50	41.85	40.50	41.85	41.85	40.50	41.85	40.50	41.85
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

Primary circuit loss (annual) from Table 3

360.00 (58)

Primary circuit loss for each month (58) ÷ 365 x (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m	30.58	27.62	30.58	29.59	30.58	29.59	30.58	30.58	29.59	30.58	29.59	30.58
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

Combi loss for each month from Table 3a, 3b or 3c (enter '0' if not a combi boiler)

(61)m	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-------	------	------	------	------	------	------	------	------	------	------	------	------

Total heat required for water heating calculated for each month  $0.85 \times (45)m + (46)m + (57)m + (59)m + (61)m$

(62)m	262.51	231.67	243.98	219.66	215.94	193.93	187.18	204.11	203.35	227.73	239.61	256.52
-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

Solar DHW input calculated using Appendix H (negative quantity) ('0' entered if no solar contribution to water heating)

(63)m	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-------	------	------	------	------	------	------	------	------	------	------	------	------

$\Sigma(63)1...12 =$  0.00 (63)

Output from water heater for each month, kWh/month (62)m + (63)m

(64)m	262.51	231.67	243.98	219.66	215.94	193.93	187.18	204.11	203.35	227.73	239.61	256.52
-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

$\Sigma(64)1...12 =$  2686.18 (64)

if (64)m < 0 then set to 0

Heat gains from water heating, kWh/month  $0.25 \times [0.85 \times (45)m + (61)m] + 0.8 \times [(46)m + (57)m + (59)m]$

(65)m	121.14	107.61	114.98	105.80	105.66	97.25	96.10	101.73	100.38	109.58	112.44	119.15
-------	--------	--------	--------	--------	--------	-------	-------	--------	--------	--------	--------	--------

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

## 5. Internal gains (see Table 5 and 5a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Metabolic gains (Table 5), Watts												
(66)m	207.28	207.28	207.28	207.28	207.28	207.28	207.28	207.28	207.28	207.28	207.28	207.28
Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5												
(67)m	191.74	170.30	138.50	104.85	78.38	66.17	71.50	92.94	124.74	158.39	184.86	197.07
Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5												
(68)m	951.88	961.76	936.87	883.88	816.98	754.12	712.12	702.24	727.13	780.12	847.01	909.88
Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5												
(69)m	59.18	59.18	59.18	59.18	59.18	59.18	59.18	59.18	59.18	59.18	59.18	59.18
Pumps and fans gains (Table 5a)												
(70)m	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
Losses e.g. evaporation (negative values) (Table 5)												
(71)m	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19	-138.19
Water heating gains (Table 5)												
(72)m	162.83	160.14	154.55	146.95	142.01	135.07	129.16	136.73	139.42	147.28	156.16	160.15

Total internal gains (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m	1444.73	1430.47	1368.19	1273.95	1175.66	1093.63	1051.06	1070.18	1129.57	1224.07	1326.31	1405.37	(73)
-------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	------

## 6. Solar gains

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Rows (74) to (82) are used 12 times, one for each month, repeating as needed if there is more than one window type.

Details for month of January and annual totals are shown below:

	Access factor Table 6d		Area m <sup>2</sup>		Solar flux W/m <sup>2</sup>		g Specific data or Table 6b		FF Specific data or Table 6c	=	Gains (W)	
North	0.54	x	5.75	x	10.73	x 0.9 x	0.65	x	0.70	=	13.64	(74)
North	0.77	x	16.95	x	10.73	x 0.9 x	0.65	x	0.70	=	57.33	(74)
East	0.77	x	3.60	x	19.87	x 0.9 x	0.65	x	0.70	=	22.56	(76)
South	0.54	x	10.00	x	47.32	x 0.9 x	0.65	x	0.70	=	104.65	(78)
South	1.00	x	26.80	x	47.32	x 0.9 x	0.65	x	0.70	=	519.35	(78)
West	0.54	x	2.50	x	19.87	x 0.9 x	0.65	x	0.70	=	10.99	(80)
West	0.77	x	4.50	x	19.87	x 0.9 x	0.65	x	0.70	=	28.20	(80)
Rooflights	1.00	x	2.20	x	26.00	x 0.9 x	0.65	x	0.70	=	23.42	(82)

Solar gains in watts, calculated for each month  $\Sigma(74)m \dots (82)m$

(83)m	780.13	1320.75	1739.05	2166.66	2445.68	2533.90	2460.90	2229.43	1923.48	1495.82	933.27	668.20	(83)
-------	--------	---------	---------	---------	---------	---------	---------	---------	---------	---------	--------	--------	------

Total gains - internal and solar (73)m + (83)m

(84)m	2224.86	2751.22	3107.24	3440.61	3621.34	3627.53	3511.96	3299.62	3053.04	2719.89	2259.58	2073.58	(84)
-------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	------

## 7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1(°C)

21.00	(85)
-------	------

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains for living area, $\eta_{1,m}$ (see Table 9a)													
(86)m	1.00	1.00	1.00	0.99	0.96	0.84	0.62	0.66	0.92	0.99	1.00	1.00	(86)

Mean internal temp of living area T1 (steps 3 to 7 in Table 9c)

(87)m	19.96	20.08	20.26	20.47	20.72	20.88	20.94	20.94	20.82	20.54	20.18	19.98	(87)
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Temperature during heating periods in the living area from Table 9, Th2(°C)

(88)m	20.01	20.02	20.02	20.05	20.06	20.07	20.08	20.08	20.06	20.05	20.04	20.02	(88)
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Utilisation factor for gains for rest of dwelling  $\eta_{2,m}$  (see Table 9a)

(89)m	1.00	1.00	1.00	0.98	0.93	0.76	0.49	0.52	0.87	0.99	1.00	1.00	(89)
-------	------	------	------	------	------	------	------	------	------	------	------	------	------

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m	18.59	18.78	19.05	19.38	19.74	19.95	20.01	20.01	19.87	19.47	18.94	18.64	(90)
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Living area fraction

fLA	87.50	÷ (4) =	0.16	(91)
-----	-------	---------	------	------

Mean internal temperature for the whole dwelling  $fLA \times T1 + (1 - fLA) \times T2$

(92)m	18.81	18.99	19.24	19.55	19.89	20.10	20.16	20.15	20.03	19.64	19.14	18.86	(92)
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m	18.81	18.99	19.24	19.55	19.89	20.10	20.16	20.15	20.03	19.64	19.14	18.86	(93)
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

## 8. Space heating requirement

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that tim = (93)m and recalculate the utilisation factor for gains using Table 9a													
Utilisation factor for gains, $\eta_m$													
(94)m	1.00	1.00	0.99	0.98	0.93	0.77	0.50	0.53	0.87	0.98	1.00	1.00	(94)

Useful gains,  $\eta_m G_m$ , W = (94)m x (84)m

(95)m	2223.45	2745.80	3088.39	3377.41	3361.54	2782.89	1772.67	1765.17	2653.65	2676.12	2256.17	2072.54	(95)
-------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	------

Monthly average external temperature from Table 8

(96)m	4.50	5.00	6.80	8.70	11.70	14.60	16.90	16.90	14.30	10.80	7.00	4.90	(96)
-------	------	------	------	------	-------	-------	-------	-------	-------	-------	------	------	------

Heat loss rate for mean internal temperature, Lm, W

(97)m	8558.90	8249.49	7338.30	6218.13	4604.11	3058.51	1793.12	1792.34	3232.77	5066.85	7058.17	8230.12	(97)
-------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	---------	------

Space heating requirement for each month, kWh/month = 0.024 x [(97)m - (95)m] x (41)m

(98)m	4713.57	3698.48	3161.93	2045.31	924.47	0.00	0.00	0.00	0.00	1778.70	3457.43	4581.24
-------	---------	---------	---------	---------	--------	------	------	------	------	---------	---------	---------

Total per year (kWh/year) =  $\sum(98)1...5, 10...12 = 24361.15$  (98)

Space heating requirement in kWh/m<sup>2</sup>/year

(98) ÷ (4) = 44.43 (99)

### 8c. Space cooling requirement

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
--	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Calculated for June, July and August. See Table 10b.

Heat loss rate Lm (calculated using 24°C internal temperature and external temperature from Table 10)

(100)m	0.00	0.00	0.00	0.00	0.00	4783.80	3414.20	3414.20	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	---------	---------	---------	------	------	------	------

Utilisation factor for loss,  $\varnothing$ m

(101)m	0.00	0.00	0.00	0.00	0.00	0.77	0.90	0.87	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	------	------	------	------	------	------	------

Useful loss,  $\varnothing$ mLm (Watts) = (100)m x (101)m

(102)m	0.00	0.00	0.00	0.00	0.00	3676.09	3059.03	2981.74	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	---------	---------	---------	------	------	------	------

Gains (internal gains as for heating except that column (A) of Table 5 is always used; solar gains calculated for applicable weather region based on Table 10, not Table 6a)

(103)m	0.00	0.00	0.00	0.00	0.00	4043.59	3864.43	3628.93	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	---------	---------	---------	------	------	------	------

Space cooling requirement for the month, whole dwelling, continuous (kWh) = 0.024 x [(103)m - (102)m] x (41)m

set (104)m to zero if (104)m < 3 x (98)m with (98)m with (98)m calculated using weather data from Table 10

(104)m	0.00	0.00	0.00	0.00	0.00	264.60	599.22	481.51	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	--------	--------	--------	------	------	------	------

Total =  $\sum(104)6...8 = 1345.33$  (104)

Cooled fraction

fc = cooled area ÷ (4) = 0.18 (105)

Intermittency factor (Table 10b)

(106)m	0.00	0.00	0.00	0.00	0.00	0.25	0.25	0.25	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	------	------	------	------	------	------	------

Total =  $\sum(106)6...8 = 0.75$  (106)

Space cooling requirement for month = (104)m x (105) x (106)m

(107)m	0.00	0.00	0.00	0.00	0.00	12.06	27.32	21.95	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	-------	-------	-------	------	------	------	------

Total =  $\sum(107)6...8 = 61.34$  (107)

Space cooling requirement in kWh/m<sup>2</sup>/year

(107) ÷ (4) = 0.11 (108)

### 9a. Energy Requirements - Individual heating systems including micro-CHP

Space heating:

Fraction of space heating from secondary/supplementary system (Table 11)

0.00 (201)

Fraction of space heating from main system(s) 1 - (201)

1.00 (202)

Fraction of main heating from main system 2

0.00 (203)

Fraction of total space heat from main system 1 (202) x [1 - (203)]

1.00 (204)

Fraction of total space heat from main system 2 (202) x (203)

0.00 (205)

Efficiency of main space heating system 1 (%)

250.00 (206)

(from database or Table 4a/4b, adjusted where appropriate by the amount shown in the 'space efficiency adjustment' column of Table 4c)

Cooling System Energy Efficiency Ratio (see Table 10c)

3.78 (209)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
--	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Space heating requirement, kWh/month (as calculated above)

(98)m	4713.57	3698.48	3161.93	2045.31	924.47	0.00	0.00	0.00	0.00	1778.70	3457.43	4581.24
-------	---------	---------	---------	---------	--------	------	------	------	------	---------	---------	---------

Space heating fuel (main heating system 1), kWh/month = (98)m x (204) x 100 ÷ (206)

(211)m	1885.43	1479.39	1264.77	818.13	369.79	0.00	0.00	0.00	0.00	711.48	1382.97	1832.50
--------	---------	---------	---------	--------	--------	------	------	------	------	--------	---------	---------

Total per year (kWh/year) =  $\sum(211)1...5, 10...12 = 9744.46$  (211)

Water heating:

Output from water heater, kWh/month (calculated above)

(64)m	262.51	231.67	243.98	219.66	215.94	193.93	187.18	204.11	203.35	227.73	239.61	256.52
-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

$\sum(64)1...12 = 2686.18$  (64)

Efficiency of water heater per month

(217)m	250.00	250.00	250.00	250.00	250.00	250.00	250.00	250.00	250.00	250.00	250.00	250.00
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

Fuel for water heating, kWh/month = (64)m x 100 ÷ (217)m

(219)m	105.01	92.67	97.59	87.86	86.38	77.57	74.87	81.64	81.34	91.09	95.84	102.61
--------	--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	--------

Total per year (kWh/year) =  $\sum(219)1...12 =$  1074.47 (219)

### Space cooling

Space cooling fuel, kWh/month (107)m ÷ (209)

(221)m	0.00	0.00	0.00	0.00	0.00	3.19	7.23	5.81	0.00	0.00	0.00	0.00
--------	------	------	------	------	------	------	------	------	------	------	------	------

Total per year (kWh/year) =  $\sum(221)6...8 =$  16.23 (221)

### Annual Totals Summary:

Space heating fuel used, main system 1

kWh/year 9744.46 (211)

Water heating fuel used

1074.47 (219)

Space cooling fuel used

16.23 (221)

### Electricity for pumps, fans and electric keep-hot (Table 4f):

mechanical ventilation fans - balanced, extract or positive input from outside	<span style="border: 1px solid black; padding: 2px;">1747.67</span>	(230a)
warm air heating system fans	<span style="border: 1px solid black; padding: 2px;">0.00</span>	(230b)
central heating pump	<span style="border: 1px solid black; padding: 2px;">130.00</span>	(230c)
oil boiler pump	<span style="border: 1px solid black; padding: 2px;">0.00</span>	(230d)
boiler flue fan	<span style="border: 1px solid black; padding: 2px;">0.00</span>	(230e)
maintaining electric keep-hot facility for gas combi boiler	<span style="border: 1px solid black; padding: 2px;">0.00</span>	(230f)
pump for solar water heating	<span style="border: 1px solid black; padding: 2px;">0.00</span>	(230g)
<b>Total electricity for the above</b>	<b><math>\sum(230a)...(230g)</math> <span style="border: 1px solid black; padding: 2px;">1877.67</span></b>	<b>(231)</b>

### Electricity for lighting (calculated in Appendix L):

1354.48 (232)

#### 10a. Fuel costs - Individual heating systems including micro-CHP

	Fuel kWh/year		Fuel price (Table 12)		Fuel cost £/year
Space heating - main system 1	<span style="border: 1px solid black; padding: 2px;">9744.46</span>	x	<span style="border: 1px solid black; padding: 2px;">11.46</span>	x 0.01 =	<span style="border: 1px solid black; padding: 2px;">1116.72</span> (240)
Water heating cost (other fuel)	<span style="border: 1px solid black; padding: 2px;">1074.47</span>	x	<span style="border: 1px solid black; padding: 2px;">11.46</span>	x 0.01 =	<span style="border: 1px solid black; padding: 2px;">123.13</span> (247)
Space cooling	<span style="border: 1px solid black; padding: 2px;">16.23</span>	x	<span style="border: 1px solid black; padding: 2px;">11.46</span>	x 0.01 =	<span style="border: 1px solid black; padding: 2px;">1.86</span> (248)
Pumps, fans and electric keep-hot	<span style="border: 1px solid black; padding: 2px;">1877.67</span>	x	<span style="border: 1px solid black; padding: 2px;">11.46</span>	x 0.01 =	<span style="border: 1px solid black; padding: 2px;">215.18</span> (249)
Energy for lighting	<span style="border: 1px solid black; padding: 2px;">1354.48</span>	x	<span style="border: 1px solid black; padding: 2px;">11.46</span>	x 0.01 =	<span style="border: 1px solid black; padding: 2px;">155.22</span> (250)
Additional standing charges (Table 12)					<span style="border: 1px solid black; padding: 2px;">0.00</span> (251)
<b>Total energy cost</b>				<b>(240)...(242) + (245)...(254)</b>	<b><span style="border: 1px solid black; padding: 2px;">1612.11</span> (255)</b>

#### 11a. SAP rating - Individual heating systems including micro-CHP

Energy cost deflator (Table 12)			<span style="border: 1px solid black; padding: 2px;">0.47</span>	(256)
Energy cost factor (ECF)			$[(255) \times (256)] \div [(4) + 45.0] =$	<span style="border: 1px solid black; padding: 2px;">1.28</span> (257)
SAP value			<span style="border: 1px solid black; padding: 2px;">82.18</span>	
SAP rating			<span style="border: 1px solid black; padding: 2px;">82</span>	(258)
SAP band			<span style="border: 1px solid black; padding: 2px;">B</span>	

#### 12a. Carbon dioxide emissions - Individual heating systems including micro-CHP

	Energy kWh/year		Emissions Factor		Emissions (kgCO2/year)
Space heating - main system 1	<span style="border: 1px solid black; padding: 2px;">9744.46</span>	x	<span style="border: 1px solid black; padding: 2px;">0.517</span>	=	<span style="border: 1px solid black; padding: 2px;">5037.89</span> (261)
Water heating	<span style="border: 1px solid black; padding: 2px;">1074.47</span>	x	<span style="border: 1px solid black; padding: 2px;">0.517</span>	=	<span style="border: 1px solid black; padding: 2px;">555.50</span> (264)
Space and water heating				<b>(261) + (262) + (263) + (264) =</b>	<b><span style="border: 1px solid black; padding: 2px;">5593.39</span> (265)</b>
Space cooling	<span style="border: 1px solid black; padding: 2px;">16.23</span>	x	<span style="border: 1px solid black; padding: 2px;">0.517</span>	=	<span style="border: 1px solid black; padding: 2px;">8.39</span> (266)
Pumps, fans and electric keep-hot	<span style="border: 1px solid black; padding: 2px;">1877.67</span>	x	<span style="border: 1px solid black; padding: 2px;">0.517</span>	=	<span style="border: 1px solid black; padding: 2px;">970.75</span> (267)

Lighting	1354.48	x	0.517	=	700.27	(268)
Total carbon dioxide emissions					$\Sigma(261)\dots(271) =$	7272.80 (272)
Dwelling carbon dioxide emissions rate					$(272) \div (4) =$	13.26 (273)
EI value						83.57
EI rating (see section 14)						84 (274)
EI band						B

### 13a. Primary energy - Individual heating systems including micro-CHP

	Energy kWh/year		Primary Energy Factor		Primary Energy	
Space heating - main system 1	9744.46	x	2.92	=	28453.83	(261*)
Water heating	1074.47	x	2.92	=	3137.46	(264*)
Space and water heating				$(261*) + (262*) + (263*) + (264*) =$	31591.29	(265*)
Space cooling	16.23	x	2.92	=	47.38	(266*)
Pumps, fans and electric keep-hot	1877.67	x	2.92	=	5482.79	(267*)
Lighting	1354.48	x	2.92	=	3955.08	(268*)
Total primary energy kWh/year				$\Sigma(261*)\dots(271*) =$	41076.54	(272*)
Primary energy kWh/m <sup>2</sup> /year				$(272*) \div (4) =$	74.92	(273*)

DRAFT





---

**Appendix B – Code for Sustainable Homes Pre-assessment**



**Results**

<b>Development Name:</b>	Nutley Terrace
<b>Dwelling Description:</b>	Single Dwelling - Detached House
<b>Name of Company:</b>	Hoare Lea Consulting Engineers
<b>Code Assessor's Name:</b>	
<b>Company Address:</b>	Hoare Lea Consulting Engineers
<b>Notes/Comments:</b>	


**PREDICTED RATING - CODE LEVEL: 3**

**Mandatory Requirements:** All Levels


**% Points:** 60.15% - Code Level: 3

**Breakdown:** Energy - Code Level: 4  
Water - Code Level: 4

Graph 1: Predicted contribution of individual sections to the total score and percentage of total achievable score

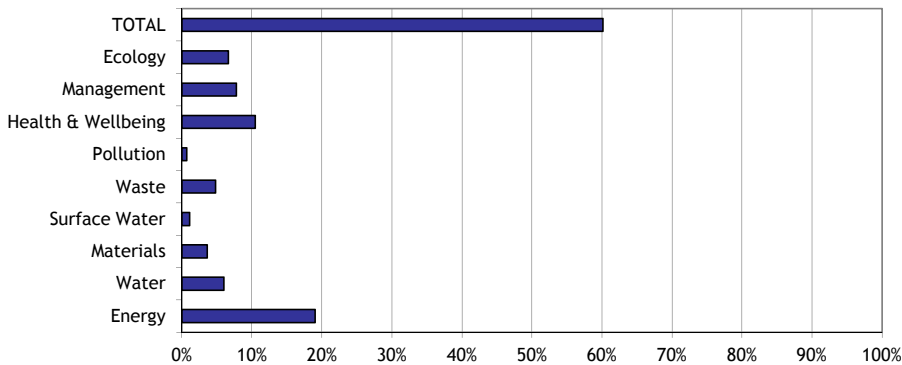

Graph 2: Predicted percentage of credits achievable: Total and by Category

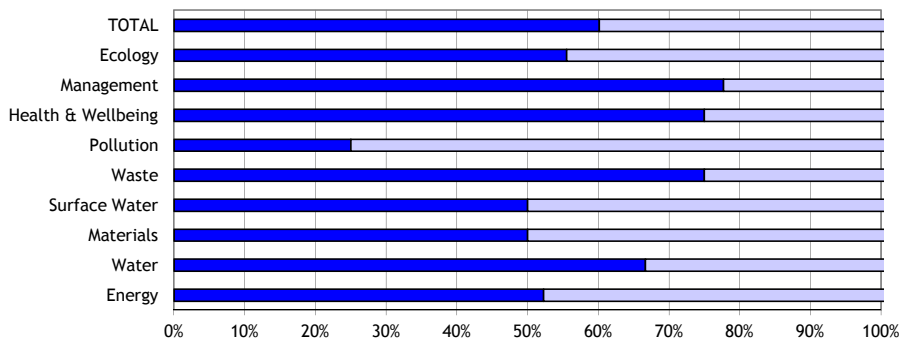

NOTE: The rating obtained by using this Pre Assessment Estimator is for guidance only. Predicted ratings may differ from those obtained through a formal assessment, which must be carried out by a licensed Code assessor.

CATEGORY 1 ENERGY		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 52.25		Credits	Level			
Contribution to Overall % Score: 19.02 points		16.2 of 31 Credits	Level 4			
Ene 1 Dwelling Emission Rate	<p>Credits are awarded based on the percentage improvement of the Dwelling Emission Rate (DER) over the Target Emission Rate (TER) as calculated using SAP 2009. Minimum standards for each Code level apply. The Code energy calculator can be used to calculate a predicted score.</p> <p>Enter the predicted score _____</p> <p>What is the predicted number of credits? <input type="text" value="4.1"/></p> <p>OR Are zero net CO<sub>2</sub> emissions achieved? <input type="checkbox"/></p>	4.1 of 10 Credits	Level 4			
Ene 2 Fabric Energy Efficiency	<p>Credits are awarded based on the Fabric Energy Efficiency (kWh/m<sup>2</sup>/yr) of the dwelling. Minimum standards apply at Code levels 5 and 6. The Code energy calculator can be used to calculate a predicted score.</p> <p>Enter the predicted score _____</p> <p>Apartments, Mid-terrace <input type="radio"/></p> <p>OR End terrace, Semi and Detached <input checked="" type="radio"/></p> <p>OR Staggered Mid terrace <input type="radio"/></p> <p>What is the predicted number of credits? <input type="text" value="3.1"/></p>	3.1 of 9 Credits	-			
Ene 3 Energy Display Devices	<p>Credits are awarded where a correctly specified Energy Display Device is installed monitoring electricity and/or primary heating fuel consumption.</p> <p>Select whether the EDD monitors electricity and/or fuel _____</p> <p>None Specified <input type="radio"/></p> <p>Primary Heating only <input type="radio"/></p> <p>OR Electricity only <input type="radio"/></p> <p>OR Electricity and primary heating fuel <input checked="" type="radio"/></p>	2 of 2 Credits	-			

Issue		Credits	Level	Assumptions Made	Evidence Required
Ene 4 Drying Space	<p>One credit is awarded for the provision of either internal or external secure drying space with posts and footings or fixings capable of holding 4m+ of drying line for 1-2 bed dwellings and 6m+ for dwellings with 3 bedrooms or greater.</p> <p>Will drying space meeting the criteria be provided? _____</p> <p>Yes <input checked="" type="radio"/></p> <p>OR No <input type="radio"/></p>	1 of 1 Credits	-		
Ene 5 Energy Labelled White Goods	<p>Credits are awarded where each dwelling is provided with either information about the EU Energy Labelling Scheme, White Goods with ratings ranging from A+ to B or a combination of the previous according to the technical guide.</p> <p>Select the appropriate option below _____</p> <p>EU Energy labelling information only <input type="checkbox"/></p> <p>A+ rated appliances <input type="checkbox"/></p> <p>A+, A and B rated appliances <input type="checkbox"/></p> <p>Combination of compliant rated white goods with EU Energy Labelling Scheme <input checked="" type="checkbox"/></p>	2 of 2 Credits	-		
Ene 6 External Lighting	<p>Credits are awarded based on the provision of space lighting* with dedicated energy efficient fittings and security lighting fittings with appropriate control gear..</p> <p>Space Lighting _____</p> <p>None provided <input type="radio"/></p> <p>OR Non Code compliant lighting <input type="radio"/></p> <p>OR Code compliant lighting <input checked="" type="radio"/></p> <p>Security Lighting _____</p> <p>None provided <input type="radio"/></p> <p>OR Non Code compliant lighting <input type="radio"/></p> <p>OR Code compliant lighting and controls <input checked="" type="radio"/></p> <p>Dual lamp luminaires _____</p> <p>Compliant with both above criteria <input type="checkbox"/></p>	2 of 2 Credits	-		

\* Statutory safety lighting is not covered by this requirement

Issue		Credits	Level	Assumptions Made	Evidence Required
Ene 7 Low or Zero Carbon Technologies	Credits are awarded where there is a 10% or 15% reduction in CO <sub>2</sub> emissions resulting from the use of low or zero carbon technologies.  Select % contribution made by low or zero carbon technologies Less than 10% of demand <input checked="" type="radio"/> OR 10% of demand or greater <input type="radio"/> OR 15% of demand or greater <input type="radio"/>	0 of 2 Credits	-		
Ene 8 Cycle Storage	Credits are awarded where adequate, safe, secure and weather proof cycle storage is provided according to the Code requirements.  Fill in the development details below Number of bedrooms: <input type="text" value="4"/> Number of cycles stored per dwelling* <input type="text" value="2.0"/>  <small>* if you have storage for 1 cycle per two dwellings insert 0.5 in number of cycles stored per dwelling</small>	1 of 2 Credits	-		
Ene 9 Home Office	A credit is awarded for the provision of a home office. The location, space and services provided must meet the Code requirements.  Will there be provision for a Home Office? Yes <input checked="" type="radio"/> OR No <input type="radio"/>	1 of 1 Credits	-		



CATEGORY 2 WATER		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 66.66		Credits	Level	4 of 6 Credits		
Contribution to Overall Score: 6.00 points						
Wat 1 Indoor Water Use	<p>Credits are awarded based on the predicted average household water consumption, calculated using the Code Water Calculator Tool. Minimum standards for each code level apply.</p> <p>Select the predicted water use / Mandatory Requirement</p> <ul style="list-style-type: none"> <li>greater than 120 litres/ person/ day <input type="radio"/></li> <li>OR ≤ less than 120 litres/ person/ day <input type="radio"/></li> <li>OR ≤ less than 110 litres/ person/ day <input type="radio"/></li> <li>OR ≤ less than 105 litres/ person/ day <input checked="" type="radio"/></li> <li>OR ≤ less than 90 litres/ person/ day <input type="radio"/></li> <li>OR ≤ less than 80 litres/ person/ day <input type="radio"/></li> </ul>	3 of 5 Credits	Level 3 AND Level 4			
Wat 2 External Water Use	<p>A credit is awarded where a compliant system is specified for collecting rainwater for external irrigation purposes. Where no outdoor space is provided the credit can be achieved by default.</p> <p>Select the scenario that applies</p> <ul style="list-style-type: none"> <li>No internal or communal outdoor space <input type="radio"/></li> <li>OR Outdoor space with collection system <input checked="" type="radio"/></li> <li>OR Outdoor space without collection system <input type="radio"/></li> </ul>	1 of 1 Credits	-			

CATEGORY 3 MATERIALS		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 50.00		Credits	Level			
Contribution to Overall Score: 3.60 points		12 of 24 Credits	All Levels			
Mat 1 Environmental Impact of Materials	<p><b>Mandatory Requirement:</b> At least three of the five key building elements must achieve a Green Guide 2008 Rating of A+ to D.</p> <p><b>Tradable Credits:</b> Points are awarded on a scale based on the Green Guide Rating of the specifications. The Code Materials Calculator can be used to predict a potential score.</p> <p>Mandatory Requirement _____ Will the mandatory requirement be met? <input checked="" type="checkbox"/></p> <p>Enter the predicted score _____ What is the predicted number of credits? <input type="text" value="8"/></p>	8 of 15 Credits	All Levels			
Mat 2 Responsible Sourcing of Materials - Basic Building Elements	<p>Credits are awarded where materials used in the basic building elements are responsibly sourced. The Code Materials Calculator can be used to predict a potential score.</p> <p>Enter the predicted Score _____ What is the predicted number of credits? <input type="text" value="3"/></p>	3 of 6 Credits	-			
Mat 3 Responsible Sourcing of Materials - Finishing Elements	<p>Credits are awarded where materials used in the finishing elements are responsibly sourced. The Code Materials Calculator can be used to predict a potential score.</p> <p>Enter the predicted Score _____ What is the predicted number of credits? <input type="text" value="1"/></p>	1 of 3 Credits	-			

CATEGORY 4 SURFACE WATER RUN-OFF		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 50.00%		Credits	Level			
Contribution to Overall Score: 1.10 points		2 of 4 Credits	All Levels			
Sur 1 Management of Surface Water Run-off from developments	<p><b>Mandatory Requirement:</b> Peak rate of run-off into watercourses is no greater for the developed site than it was for the pre-development site and that the additional predicted volume of rainwater discharge caused by the new development is entirely reduced as far as possible in accordance with the assessment criteria. Designing the drainage system to be able to cope with local drainage system failure. <b>Tradable Credits:</b> Where SUDS are used to improve water quality of the rainwater discharged or for protecting the quality of the receiving waters.</p> <p><b>Mandatory Requirement</b> _____ Will the mandatory requirement be met? <input checked="" type="checkbox"/></p> <p><b>Select the appropriate option</b> _____</p> <p>No SUDS <input type="checkbox"/></p> <p>No runoff into watercourses for the first 5 mm of rainfall <input type="checkbox"/></p> <p>Runoff from hard surfaces will receive an appropriate level of treatment <input type="checkbox"/></p>	0 of 2 Credits	All Levels			
Sur 2 Flood Risk	<p>Credits are awarded where developments are located in areas of low flood risk or where in areas of medium or high flood risk appropriate measures are taken to prevent damage to the property and its contents in accordance with the Code criteria in the technical guide.</p> <p><b>Select the annual probability of flooding (from PPS25*)</b> _____</p> <p>Zone 1 - Low <input checked="" type="radio"/></p> <p>OR Zone 2 - Medium <input type="radio"/></p> <p>OR Zone 3 - High <input type="radio"/></p> <p><b>Select the appropriate option(s)</b> _____</p> <p>Low risk of flooding from FRA** <input checked="" type="checkbox"/></p> <p>All measures of protection are demonstrated in FRA <input type="checkbox"/></p> <p>Ground floor level and access routes are 600 mm above design flood level <input type="checkbox"/></p>	2 of 2 Credits	-			

\* Planning Policy Statement 25 - Planning and Flood Risk

\*\* FRA - Flood Risk Assessment

CATEGORY 5 WASTE		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 75.00%		Credits	Level			
Contribution to Overall Score: 4.80 points		6 of 8 Credits	All Levels			
Was 1 Storage of non-recyclable waste and recyclable household waste	<p><b>Mandatory Requirement:</b> The space provided for waste storage should be sized to hold the larger of either all external containers provided by the Local Authority or the min capacity calculated from BS 5906. <u>Tradable Credits</u> are awarded for adequate internal and/ or external recycling facilities.</p> <p><b>Mandatory Requirement</b></p> <p>Will the minimum space be provided and be accessible to disabled people? <input checked="" type="checkbox"/></p> <p><b>Internal Recyclable household waste storage</b></p> <p>Where there is no external recyclable waste storage and no Local Authority collection scheme</p> <p>Internal storage (capacity 60 litres) <input type="checkbox"/></p> <p><b>Local Authority collection Scheme</b></p> <p>Post Collection sorting Internal storage (capacity 30 litres) <input type="checkbox"/></p> <p>Pre-collection sorting Internal storage (3 separate bins, capacity 30 litres) <input checked="" type="checkbox"/></p> <p><b>External Storage, no Local Authority collection scheme</b></p> <p>3 separate internal storage bins (capacity 30 litres) <input type="checkbox"/></p> <p><b>AND</b></p> <p>Houses External Storage(capacity 180 litres) <input type="checkbox"/></p> <p>Flats <input type="checkbox"/></p> <p>Private recycling operator <input type="checkbox"/></p> <p>3 or greater types of waste collected <input type="checkbox"/></p>	<p><b>0 of 2 Credits</b></p> <p><b>4 of 4 Credits</b></p> <p><b>0 of 4 Credits</b></p>	<p><b>All Levels</b></p>			

Issue	Credits	Level	Assumptions Made	Evidence Required
<p>Was 2 Construction Site Waste Management</p>	<p>A credit is awarded where a compliant SWMP is provided with targets and procedures to minimise construction waste. Credits are available where the SWMP include procedures and commitments for diverting either 50% or 85% of waste generated from landfill.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p>SWMP details</p> <p>Does the SWMP include:</p> <p>+ No SWMP <input type="radio"/></p> <p>+ SWMP with targets and procedures to minimise waste? <input checked="" type="radio"/></p> <p>+ SWMP with procedures to divert 50% of waste <input type="radio"/></p> <p>+ SWMP with procedures to divert 85% of waste <input type="radio"/></p> </div> <p style="text-align: center; margin-top: 10px;"><b>1 of 3 Credits</b></p>			
<p>Was 3 Composting</p>	<p>A credit is awarded where individual home composting facilities are provided, or where a community/ communal composting service, either run by the Local Authority or overseen by a management plan is in operation.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p>Select the facilities available</p> <p>No composting facilities <input type="radio"/></p> <p>Individual composting facilities <input checked="" type="radio"/></p> <p>OR Communal/ community composting*? <input type="radio"/></p> <p style="padding-left: 20px;">Local Authority <input type="checkbox"/></p> <p style="padding-left: 20px;">OR Private with management plan <input type="checkbox"/></p> </div> <p style="text-align: center; margin-top: 10px;"><b>1 of 1 Credit</b></p>	-		

\* including if an automated waste collection system is in place

CATEGORY 6 POLLUTION		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 25.00%		Credits	Level			
Contribution to Overall Score: 0.70 points		1 of 4 Credits	All Levels			
Pol 1 Global Warming Potential (GWP) of Insulants	<p>A credit is awarded where <u>all</u> insulating materials only use substances (in manufacture AND installation) that have a GWP of less than 5.</p> <p>Select the most appropriate option</p> <p>All insulants have a GWP less than 5 <input checked="" type="radio"/></p> <p>OR Some insulants have a GWP of less than 5 <input type="radio"/></p> <p>OR No insulants have a GWP of less than 5 <input type="radio"/></p>	1 of 1 Credits	-			
Pol 2 NOx Emissions	<p>Credits are awarded on the basis of NOx emissions arising from the operation of the space and water heating system within the dwelling.</p> <p>Select the most appropriate option</p> <p>Greater than 100 mg/kWh <input checked="" type="radio"/></p> <p>OR Less than 100 mg/kWh <input type="radio"/></p> <p>OR Less than 70 mg/kWh <input type="radio"/></p> <p>OR Less than 40 mg/kWh <input type="radio"/></p> <p>OR Class 4 boiler <input type="radio"/></p> <p>OR Class 5 boiler <input type="radio"/></p> <p>OR All space and hot water energy requirements are met by systems who do not produce NOx emissions <input type="radio"/></p>	0 of 3 Credits	-			

CATEGORY 7 HEALTH & WELLBEING		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)															
% of Section Credits Predicted: 75.00%		Credits	Level																		
Contribution to Overall Score: 10.50 points		9 of 12 Credits	No Level																		
Hea 1 Daylighting	<p>Credits are awarded for ensuring key rooms in the dwelling have high daylight factors (DF) and a view of the sky.</p> <p>Select the compliant areas</p> <table border="1"> <tr> <td><u>Room</u></td> <td></td> </tr> <tr> <td>Kitchen: Avg DF of at least 2%</td> <td><input type="checkbox"/></td> </tr> <tr> <td>Living Room*: Avg DF of at least 1.5%</td> <td><input type="checkbox"/></td> </tr> <tr> <td>Dining Room*: Avg DF of at least 1.5%</td> <td><input type="checkbox"/></td> </tr> <tr> <td>Study*: Avg DF of at least 1.5%</td> <td><input type="checkbox"/></td> </tr> <tr> <td>80% of working plane in all above rooms receive direct light from the sky?</td> <td><input type="checkbox"/></td> </tr> </table> <p>Any room used for Ene 9 Home Office must also achieve a min DF of 1.5%.</p>	<u>Room</u>		Kitchen: Avg DF of at least 2%	<input type="checkbox"/>	Living Room*: Avg DF of at least 1.5%	<input type="checkbox"/>	Dining Room*: Avg DF of at least 1.5%	<input type="checkbox"/>	Study*: Avg DF of at least 1.5%	<input type="checkbox"/>	80% of working plane in all above rooms receive direct light from the sky?	<input type="checkbox"/>	0 of 3 Credits	-						
<u>Room</u>																					
Kitchen: Avg DF of at least 2%	<input type="checkbox"/>																				
Living Room*: Avg DF of at least 1.5%	<input type="checkbox"/>																				
Dining Room*: Avg DF of at least 1.5%	<input type="checkbox"/>																				
Study*: Avg DF of at least 1.5%	<input type="checkbox"/>																				
80% of working plane in all above rooms receive direct light from the sky?	<input type="checkbox"/>																				
Hea 2 Sound Insulation	<p>Credits are awarded where performance standards exceed those required in Building Regulations Part E. This can be demonstrated by carrying out pre-completion testing or through the use of Robust Details Limited.</p> <p>Select a type of property</p> <table border="1"> <tr> <td>Detached Property</td> <td><input checked="" type="radio"/></td> </tr> <tr> <td>Attached Properties:</td> <td></td> </tr> <tr> <td>- Separating walls and floors only exist between non habitable spaces</td> <td><input type="radio"/></td> </tr> <tr> <td>- Separating walls and floors exist between habitable spaces</td> <td><input type="radio"/></td> </tr> </table> <p>Select a performance standard</p> <table border="1"> <tr> <td>Performance standard not sought</td> <td><input checked="" type="radio"/></td> </tr> <tr> <td>Airborne: 3db higher; Impact: 3dB lower</td> <td><input type="radio"/></td> </tr> <tr> <td>OR Airborne: 5db higher; Impact: 5dB lower</td> <td><input type="radio"/></td> </tr> <tr> <td>OR Airborne: 8db higher; Impact: 8dB lower</td> <td><input type="radio"/></td> </tr> </table>	Detached Property	<input checked="" type="radio"/>	Attached Properties:		- Separating walls and floors only exist between non habitable spaces	<input type="radio"/>	- Separating walls and floors exist between habitable spaces	<input type="radio"/>	Performance standard not sought	<input checked="" type="radio"/>	Airborne: 3db higher; Impact: 3dB lower	<input type="radio"/>	OR Airborne: 5db higher; Impact: 5dB lower	<input type="radio"/>	OR Airborne: 8db higher; Impact: 8dB lower	<input type="radio"/>	4 of 4 Credits	-		
Detached Property	<input checked="" type="radio"/>																				
Attached Properties:																					
- Separating walls and floors only exist between non habitable spaces	<input type="radio"/>																				
- Separating walls and floors exist between habitable spaces	<input type="radio"/>																				
Performance standard not sought	<input checked="" type="radio"/>																				
Airborne: 3db higher; Impact: 3dB lower	<input type="radio"/>																				
OR Airborne: 5db higher; Impact: 5dB lower	<input type="radio"/>																				
OR Airborne: 8db higher; Impact: 8dB lower	<input type="radio"/>																				



Issue	Credits	Level	Assumptions Made	Evidence Required
<p>Hea 3 Private Space</p> <p>A credit is awarded for the provision of an outdoor space that is at least partially private. The space must allow easy access to all occupants.</p> <p>Will a private/ semi-private space be provided? _____</p> <p>Yes, private/semi-private space will be provided <input checked="" type="radio"/></p> <p>OR No private/semi-private space <input type="radio"/></p>	1 of 1 Credits	-		
<p>Hea 4 Lifetime Homes</p> <p><u>Mandatory Requirement:</u> Lifetime Homes is mandatory when a dwelling is to achieve Code Level 6.</p> <p><u>Tradable credits:</u> Credits are awarded where the developer has implemented all of the principles of the Lifetime Homes scheme.</p> <p>Mandatory Requirement _____</p> <p>Dwelling to achieve Code Level 6? <input type="checkbox"/></p> <p>Lifetime Homes Compliance _____</p> <p>All Lifetime Homes criteria will be met <input checked="" type="radio"/></p> <p>OR Exemption from LTH criteria 2/3 applied <input type="radio"/></p> <p>Credit not sought <input type="radio"/></p>	4 of 4 Credits	No level		

CATEGORY 8 MANAGEMENT		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 77.00%		Credits	Level			
Contribution to Overall Score: 7.77 points		7 of 9 Credits	All Levels			
Man 1 Home User Guide	<p>Credits are awarded where a simple guide is provided to each dwelling covering information relevant to the 'non-technical' home occupier, in accordance with the Code requirements.</p> <p>Tick the topics covered by the Home User Guide</p> <p>Operational Issues? <input checked="" type="checkbox"/></p> <p>Site and Surroundings? <input checked="" type="checkbox"/></p> <p>Is available in alternative formats? <input checked="" type="checkbox"/></p>	3 of 3 Credits	-			
Man 2 Considerate Constructors Scheme	<p>Credits are awarded where there is a commitment to comply with best practice site management principles using either the Considerate Constructors Scheme or an alternative locally/nationally recognised scheme.</p> <p>Select the appropriate scheme and score</p> <p>No scheme used <input type="radio"/></p> <p><u>Considerate Constructors</u> <input checked="" type="radio"/></p> <p>OR Best Practice: Score between 24 and 31.5 <input checked="" type="radio"/></p> <p>OR Best Practice+: Score between 32 and 40 <input type="radio"/></p> <p><u>Alternative Scheme*</u></p> <p>OR Mandatory + 50% optional requirements <input type="radio"/></p> <p>OR Mandatory + 80% optional requirements <input type="radio"/></p> <p>* In the first instance, contact a Code Service Provider if you are considering to use an alternative scheme.</p>	1 of 2 Credits	-			
Man 3 Construction Site Impacts	<p>Credits are awarded where there is a commitment and strategy to operate site management procedures on site as following:</p> <p>Tick the impacts that will be addressed</p> <p><u>Monitor, report and set targets, where applicable, for:</u></p> <p>- CO<sub>2</sub>/ energy use from site activities <input checked="" type="checkbox"/></p> <p>- CO<sub>2</sub>/ energy use from site related transport <input checked="" type="checkbox"/></p> <p>- water consumption from site activities <input type="checkbox"/></p> <p><u>Adopt best practice policies in respect of:</u></p> <p>- air (dust) pollution from site activities <input type="checkbox"/></p> <p>- water (ground and surface) pollution on site <input type="checkbox"/></p> <p><u>80% of site timber</u> is reclaimed, re-used or responsibly sourced <input checked="" type="checkbox"/></p>	1 of 2 Credits	-			

Issue	Credits	Level	Assumptions Made	Evidence Required
<p>Man 4 Security</p> <p>Credits are awarded for complying with Section 2 - Physical Security from Secured by Design - New Homes. An Architectural Liaison Officer (ALO), or alternative, needs to be appointed early in the design process and their recommendations incorporated.</p> <div data-bbox="259 368 763 464" style="border: 1px solid black; padding: 5px;"> <p>Secured by Design Compliance _____</p> <p>Credit not sought <input type="radio"/></p> <p>OR Secured by Design Section 2 Compliance <input checked="" type="radio"/></p> </div>	2 of 2 Credits	-		

CATEGORY 9 ECOLOGY		Overall Level: 3	Overall Score	60.15	Assumptions Made	Evidence Required (The below cells can be formatted by assessors if required.)
% of Section Credits Predicted: 55.00%		Credits	Level			
Contribution to Overall Score: 6.66 points		5 of 9 Credits	All Levels			
Eco 1 Ecological Value of Site	<p>One credit is awarded for developing land of inherently low value.</p> <p>Select the appropriate option</p> <p>Credit not sought <input type="radio"/></p> <p>OR Land has ecological value <input checked="" type="radio"/></p> <p>OR Land has low/ insignificant ecological value* <input type="radio"/></p> <p>* Low ecological value is determined either a) by using Checklist Eco 1 across the whole development site; or b) where an suitably qualified ecologist is appointed and can confirm or c) produces an independent ecological report of the site, that the construction zone is of low/ insignificant value; AND the rest of the development site will remain undisturbed by the works.</p>	0 of 1 Credits	-			
Eco 2 Ecological Enhancement	<p>A credit is awarded where there is a commitment to enhance the ecological value of the development site.</p> <p>Tick the appropriate boxes</p> <p>Will a <i>Suitably Qualified Ecologist</i> be appointed to recommend appropriate ecological features? <input checked="" type="checkbox"/></p> <p>AND Will all key recommendations be adopted? <input checked="" type="checkbox"/></p> <p>AND 30% of other recommendations be adopted? <input checked="" type="checkbox"/></p>	1 of 1 Credits	-			
Eco 3 Protection of Ecological Features	<p>A credit is awarded where there is a commitment to maintain and adequately protect features of ecological value.</p> <p>Type and protection of existing features</p> <p>Site with features of ecological value? <input checked="" type="radio"/></p> <p>OR Site of low ecological value (as Eco 1)? <input type="radio"/></p> <p>AND All* existing features potentially affected by site works are maintained and adequately protected? <input checked="" type="checkbox"/></p> <p>*If a suitably qualified ecologist has confirmed that a feature can be removed due to insignificant ecological value or poor health conditions, as long all the rest have been protected, then this box can be ticked.</p>	1 of 1 Credits	-			

Issue	Credits	Level	Assumptions Made	Evidence Required	
Eco 4 Change of Ecological Value of Site	Credits are awarded where the change in ecological value has been calculated in accordance with the Code requirements and is calculated to be:				
<div style="border: 1px solid black; padding: 5px;"> <p>Change in Ecological Value _____</p> <p>Major negative change: fewer than -9 <input type="radio"/></p> <p>Minor negative change: between -9 and -3 <input type="radio"/></p> <p>OR Neutral: between -3 and +3 <input checked="" type="radio"/></p> <p>Minor enhancement: between +3 and +9 <input type="radio"/></p> <p>Major enhancement: greater than 9 <input type="radio"/></p> </div>		2 of 4 Credits	-		
Eco 5 Building Footprint	Credits are awarded where the ratio of combined floor area of all dwellings on the site to their footprint is:				
<div style="border: 1px solid black; padding: 5px;"> <p>Ratio of Net Internal Floor Area: Net Internal Ground Floor Area _____</p> <p>Credit Not Sought <input type="radio"/></p> <p>OR Houses: 2.5:1 OR Flats: 3:1 <input checked="" type="radio"/></p> <p>OR Houses: 3:1 OR Flats: 4:1 <input type="radio"/></p> <p>OR Houses &amp; Flats Weighted (2.5:1 &amp; 3:1) <input type="radio"/></p> <p>OR Houses &amp; Flats Weighted (3:1 &amp; 4:1) <input type="radio"/></p> </div>		1 of 2 Credits			