

APPENDIX G –Ground Investigation Factual Reports (GEA, CONCEPT)

Factual Ground Investigation Report

**Denmark Street South
4 Flitcroft Street
London
WC2H 8DJ**

Client Consolidated Development Limited




Engineer Engenuiti

J12236

December 2012



Document Control

Project title	Denmark Street South, 4 Flitcroft Street, London, WC2H 8DJ		Project ref	J12236
Report prepared by	Hannah Dashfield BEng FGS 			
Report checked and approved for issue by	Steve Branch BSc MSc CGeol FGS FRGS MIEEnvSc 			
Issue No	Status	Date	Approved for Issue	
1	Final	23 November 2012		
2	Final (amended)	28 November 2012		
3	Final (amended)	5 December 2012		

This report has been issued by the GEA office indicated below. Any enquiries regarding the report should be directed to the office indicated or to Steve Branch in our Herts office.

- Hertfordshire tel 01727 824666 mail@gea-ltd.co.uk
- Nottinghamshire tel 01509 674888 midlands@gea-ltd.co.uk

Geotechnical & Environmental Associates Limited (GEA) disclaims any responsibility to the Client and others in respect of any matters outside the scope of this work. This report has been prepared with reasonable skill, care and diligence within the terms of the contract with the Client and taking account of the manpower, resources, investigation and testing devoted to it in agreement with the Client. This report is confidential to the Client and GEA accepts no responsibility of whatsoever nature to third parties to whom this report or any part thereof is made known, unless formally agreed beforehand. Any such party relies upon the report at their own risk. This report may provide advice based on an interpretation of legislation, guidance notes and codes of practice. GEA does not however provide legal advice and if specific legal advice is required a lawyer should be consulted.

© Geotechnical & Environmental Associates Limited 2012

CONTENTS

EXECUTIVE SUMMARY

1.0	INTRODUCTION	1
1.1	Proposed Development	1
1.2	Purpose of Work	1
1.3	Scope of Work	1
1.4	Limitations	1
2.0	THE SITE	2
2.1	Site Description	2
2.2	Other Information	2
3.0	EXPLORATORY WORK	2
3.1	Sampling Strategy	3
4.0	GROUND CONDITIONS	3
4.1	Made Ground	3
4.2	Lynch Hill Gravel	3
4.3	London Clay	4
4.4	Groundwater	4
4.5	Existing Foundations	5

APPENDIX

EXECUTIVE SUMMARY

This executive summary contains an overview of the key findings and conclusions. No reliance should be placed on any part of the executive summary until the whole of the report has been read. Other sections of the report may contain information that puts into context the findings that are summarised in the executive summary.

BRIEF

This report describes the findings of a site investigation carried out by Geotechnical and Environmental Associates Limited (GEA) on the instructions of Engenuiti, on behalf of Consolidated Developments Limited, with respect to the extension of the existing basement beneath the courtyard mews, extending to a depth of between 3.5 m and 4.0 m. The purpose of the investigation has been to determine the ground conditions and engineering properties and to establish the groundwater regime. Interpretation of the findings of the investigation by GEA was not required.

SITE DESCRIPTION

The site is located in the London Borough of Camden, approximately 160 m to the south of Tottenham Court Road London Underground station. It is irregular in shape, measuring approximately 20 m north-south by 30 m east-west and is bounded on four sides by buildings that front onto Denmark Street to the north, Flitcroft Street to the east and south and Charing Cross Road to the west. The site is gently sloping down to the southwest and is currently occupied by a mews style courtyard, covered in brick paving, surrounded by buildings that comprise predominantly three – storey to five-storey buildings with partial and single level basements, currently used as commercial space. The first floor extends over the driveway along the southern boundary of the site, allowing vehicular access to the site from Flitcroft Street. The site is devoid of vegetation.

GROUND CONDITIONS

The boreholes encountered a significant thickness of made ground, underlain by Lynch Hill Gravel, overlying the London Clay, which was proved to the full depth investigated.

The made ground extended to depths of between 2.20 m and 4.50 m and generally comprised greyish brown sandy clay with occasional fragments of brick, clinker, ash, pottery, wood and chalk. The Lynch Hill Gravel generally comprised a variable sequence of sand and gravel and extended to depths of between 4.80 m and 5.77 m. The London Clay was proved to the maximum depth investigated of 6.0 m.

Groundwater was encountered during drilling at depths of between 3.9 m and 4.8 m. Subsequent groundwater monitoring visits measured groundwater at depths of between 3.66 m and 4.40 m.

Trial Pit Nos 1, 2, 3 and 4 found that the existing buildings are bearing at depths of between 1.16 m and 2.46 m on made ground or gravelly sand of the Lynch Hill Gravel. The extent of the footings in Trial Pit Nos 5, 7 and 8 was not proved due to obstructions and Trial Pit No 6 was terminated at a depth of 0.6 m due to a significant amount of loose fill.

1.0 INTRODUCTION

Geotechnical and Environmental Associates Limited (GEA) have been commissioned by Engenuiti, on behalf of Consolidated Developments Limited, to carry out a ground investigation at Denmark Street South, 4 Flitcroft Street, London, WC2H 8DJ. Interpretation of the findings of the investigation by GEA was not required and this report therefore simply presents the factual data obtained from the investigation.

1.1 Proposed Development

It is understood that it is proposed to extend the existing basement of No 4 Flitcroft Street by constructing a single level basement beneath the courtyard mews, extending to a depth of between 3.5 m and 4.0 m.

1.2 Purpose of Work

The principal technical objectives of the work carried out were as follows:

- to determine the ground conditions and their engineering properties; and
- to determine the groundwater conditions.

1.3 Scope of Work

In order to meet the above objectives, a ground investigation was carried out, which comprised, in summary, the following activities:

- three open-drive sampler boreholes advanced to depths of 6.0 m;
- standard penetration tests (SPTs), carried out at regular intervals in the boreholes, to provide quantitative data on the strength of the soils;
- the installation of three groundwater monitoring standpipes in the boreholes to depths of between 5.2 m and 6.0 m and two subsequent groundwater monitoring visits;
- eight hand-dug trial pits excavated to investigate the configuration of existing foundations;
- laboratory testing of selected soil samples for geotechnical purposes; and
- provision of a factual report presenting the above data.

1.4 Limitations

The conclusions and recommendations made in this report are limited to those that can be made on the basis of the investigation. The results of the work should be viewed in the context of the range of data sources consulted, the number of locations where the ground was sampled and the number of soil, gas or groundwater samples tested; no liability can be accepted for information in other data sources or conditions not revealed by the sampling or testing. Any comments made on the basis of information obtained from the client or other third parties are given in good faith on the assumption that the information is accurate; no

independent validation of such information has been made by GEA.

2.0 THE SITE

2.1 Site Description

The site is located in the London Borough of Camden, approximately 160 m to the south of Tottenham Court Road London Underground station. It is irregular in shape, measuring approximately 20 m north-south by 30 m east-west and is bounded on four sides by buildings that front onto Denmark Street to the north, Flitcroft Street to the east and south and Charing Cross Road to the west.

The site is gently sloping down to the southwest and the courtyard varies from approximately 24.5 m OD to 24 m OD and is currently occupied by a mews style courtyard, covered in brick paving, surrounded by buildings that comprise predominantly three to five storey buildings with partial and single level basements, currently used as commercial space. The first floor extends over the driveway along the southern boundary of the site, allowing vehicular access to the site from Flitcroft Street. The site is devoid of vegetation.

2.2 Other Information

The British Geological Survey (BGS) map of the area (Sheet 256) indicates the site to be underlain by Lynch Hill Gravel overlying London Clay.

Tunnels for Crossrail will pass to the north and south of the site and once the development proposals are finalised contact should be made with Crossrail with regard to the construction method of the new basement.

London Underground Limited has confirmed that it has no assets within 50 m of the site. A copy of the correspondence is included in the appendix.

The consulting engineers provided a report (ref 36237-001, dated June 2008) undertaken by STATS for a ground investigation carried out on Denmark Place, located approximately 60 m to the north of the site. The investigation comprised two boreholes advanced to depths of 54.0 m and 63.5 m by means of a rotary rig. The boreholes encountered made ground to depths of 3.5 m and 4.4 m, underlain by River Terrace Deposits to a depth of 6.0 m, which in turn was underlain by the London Clay proved to a depth of 30.25 m, underlain by the Lambeth Group to depth of 48.8 m, underlain by the Thanet Sand to a depth of 52.8 m, overlying the Upper Chalk, proved to the maximum depth investigated. Groundwater was encountered at depths of 5.6 m and 5.0 m during drilling within the River Terrace Deposits and measured at depths of between 4.73 m and 4.88 m on subsequent groundwater monitoring visits.

3.0 EXPLORATORY WORK

The scope of the works was specified by the consulting engineers. In order to meet the objectives described in Section 1.2. Three boreholes were drilled to a depth of 6.0 m using an open-drive lined percussive sampler rig. Standard penetration tests (SPTs) were carried out in the boreholes to provide quantitative data on the strength of soils encountered.

A groundwater monitoring standpipe was installed in each of the three boreholes to depths of 5.2 m, 5.85 m and 6.0 m, and the standpipes have been monitored on two occasions to date, over a period of approximately six weeks.

In addition, eight trial pits were manually excavated to depths of between 0.47 m and 2.6 m in order to expose and to allow the inspection of the existing foundations.

A selection of the disturbed samples recovered from the boreholes and trial pits was submitted to a soil mechanics laboratory for a programme of geotechnical testing.

All of the field work was carried out under the supervision of a geotechnical engineer from GEA.

The borehole and trial pit records and results of the geotechnical laboratory testing are enclosed, together with a site plan indicating the exploratory positions.

The fieldwork was carried out in the courtyard area and at lower ground floor level of No 4 Flitcroft Street, which is approximately 1.4 m lower than the courtyard area.

3.1 Sampling Strategy

The borehole and trial pit locations were specified by the consulting engineers and positioned on site by GEA to avoid known services.

Laboratory geotechnical classification and strength tests were undertaken on samples of the natural soil.

Contamination testing did not form part of the project brief.

4.0 GROUND CONDITIONS

The investigation encountered a significant thickness of made ground, underlain by Lynch Hill Gravel, overlying the London Clay, which was proved to the full depth investigated of 6.0 m.

4.1 Made Ground

The made ground extended to depths of between 2.20 m and 4.50 m in Boreholes Nos 1 to 3 and Trial Pit Nos 3 and 4. The full thickness of the made ground was not proved at the other exploratory locations.

The made ground generally comprised greyish brown sandy clay with occasional fragments of brick, clinker, ash, pottery, wood and chalk. In Trial Pit No 6, the made ground predominantly comprised whole bricks and half bricks.

No significant evidence of contamination was noted within the soils during the fieldwork, apart from the presence of extraneous fragments of charcoal and clinker.

4.2 Lynch Hill Gravel

The Lynch Hill Gravel generally comprised a variable sequence of light orange-brown and

brown gravelly sand, sandy gravel and sand and gravel and extended to depths of between 4.80 m and 5.77 m. However, directly beneath the made ground in Borehole No 3 light greenish grey sand and gravel was encountered to a depth of 3.7 m, underlain by a layer of soft dark grey mottled black and greenish grey sandy silt which extended to a depth of 4.8 m.

SPTs indicate the Lynch Hill Gravel to be very dense and dense.

No visual or olfactory evidence of contamination was noted in these soils.

4.3 London Clay

The London Clay was proved to the full depth investigated of 6.0 m and generally comprised stiff brown mottled grey fissured silty clay with occasional partings of orange-brown fine sand and silt with rare carbonaceous material. However in Borehole No 3, the London Clay initially comprised variably soft to stiff orange-brown silty clay which extended to a depth of 5.45 m and was underlain by stiff dark grey fissured silty clay.

The results of laboratory testing indicate the clay to be of moderate and high volume change potential.

4.4 Groundwater

Groundwater was encountered during drilling at depths of between 3.9 m and 4.8 m.

Monitoring of the standpipes has subsequently been carried out on two occasions, approximately two weeks and six weeks after installation. The results of the monitoring visits are shown in the table below.

Date	Borehole No	Depth to water (m)
16/10/2012	1	4.40
	2	4.21
	3	3.72
08/11/2012	1	4.35
	2	4.20
	3	3.66

4.5 Existing Foundations

Trial Pit Nos 1, 2, 3 and 4 found that the existing buildings are founded at depths of between 1.16 m and 2.46 m on made ground or gravelly sand of the Lynch Hill Gravel.

Trial Pit No 5 was terminated at a depth of 0.47 m due to a basement ceiling. It is now known that the existing basement at that location extends outside the footprint of the building structure.

Trial Pit No 6 was excavated to a depth of 0.6 m but due to the loose nature of the fill material at this location it was not possible to continue the pit manually.

The extent of the footing encountered in Trial Pit No 7 has not been proved due to a layer of concrete at a depth of 0.7 m. Probing with a 'Hilti' drill at two locations within the trial pit indicate the concrete to extend to a depth of a least 1.2 m at which depth there appears to be a metal obstruction. Further investigations in the form of a single core, drilled using a concrete corer was carried out approximately 1.5 m from the southern elevation of No 4 Flitcroft Street. The core was terminated at a depth of 0.75 m due to snagging and it was not possible to continue the core.

Trial Pit No 8 was abandoned at a depth of 0.1 m due to the presence of a drain.

A copy of the trial pit records and photographs are included in the appendix.

APPENDIX

Borehole Records

SPT results

Trial Pit Records

Geotechnical Test Results

Site Plan



Geotechnical & Environmental Associates

Tythenhanger House
Coursers Road
St Albans
AL4 0PG

Site
Denmark Street South, 4 Flitcroft Street, London, WC2H 8DJ

Number
BH 1

Excavation Method Open-drive sampler	Dimensions	Ground Level (mOD)	Client Consolidated Developments Limited	Job Number J12236
	Location	Dates 05/10/2012	Engineer Engenuiti	Sheet 1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
					(0.07)	Paving slab		
					0.07			
					(0.16)	Concrete		
					0.23			
					(0.77)	MADE GROUND (bricks with rare fragments of chalk and charcoal)		
1.00-1.45	CPT N=7	2,2/2,2,1,2			1.00	MADE GROUND (greyish brown sand with rare gravel and occasional fragments of ash, brick, charcoal, chalk and concrete)		
1.40	D1				(0.60)			
					1.60	MADE GROUND (bricks including whole bricks and fragments of brick)		
2.00-2.45	CPT N=8	3,3/1,3,3,1			(0.60)			
2.40	D2				2.20	MADE GROUND (greyish brown sand with abundant fragments of brick, charcoal and concrete)		
					(0.50)			
3.00-3.31	CPT 54/160	10,15/24,26,4			2.70	Brown gravelly SAND. Gravel is fine to coarse subangular to subrounded and sand is medium		
3.00	D3				(0.20)			
					2.90	Very dense brown SAND and GRAVEL. Sand is fine to coarse. Gravel is fine to coarse subangular to subrounded		
3.50	D4				(0.70)			
3.70	D5				3.60	Brown gravelly SAND. Gravel is fine to medium angular and sand is medium to coarse		
					(0.20)			
4.00-4.45	CPT N=44	5,7/10,10,11,13			3.80	Dense light orange-brown medium SAND with very rare fine angular gravel		
4.00	D6				(0.90)			
4.50	D7				4.70	Light orange-brown gravelly SAND. Gravel is fine to coarse subangular and sand is fine to coarse		
		Water strike(1) at 4.75m.			(1.07)			
5.00	D8				5.77	Stiff brown mottled grey fissured silty CLAY with occasional partings of orange-brown fine sand and silt with rare carbonaceous material		
5.50	D9				(0.23)			
6.00	D10				6.00	Complete at 6.00m		

Remarks Cased to 3.0 m Standpipe installed to a depth of 5.2 m Groundwater measured at a depth of 4.4 m on 16/10/2012 and 4.35 m on 08/11/2012	Scale (approx)	Logged By
	1:50	HD
	Figure No. J12236.BH 1	

Excavation Method Open-drive sampler	Dimensions	Ground Level (mOD)	Client Consolidated Developments Limited	Job Number J12236
	Location	Dates 05/10/2012	Engineer Engenuiti	Sheet 1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
0.90	D1				(0.07) 0.07 (0.20) 0.27 (0.73)	Paving slab Concrete MADE GROUND (greyish brown clayey silty fine sand with rare gravel, abundant fragments of brick and charcoal and rare glass) Poor recovery to 1.0 m		
1.50	D2				1.00 (1.10)	MADE GROUND (brickwork)		
2.50	D3				2.10 (1.30)	MADE GROUND (dark brownish grey clayey silty sand with rare gravel, occasional fragments of charcoal, glass and claypipes)		
3.30	D4				3.40 (0.50)	MADE GROUND (light orange-brown mottled grey sand with abundant brick and rare fragments of charcoal)		
3.70	D5				3.90 (0.35)	MADE GROUND (bricks including whole bricks and fragments of brick)		
4.00	D6				4.25 (0.15) 4.40 (0.25)	Light orange-brown fine to medium SAND with very rare fine angular gravel		
4.40	D7				4.40	Light orange-brown gravelly SAND. Sand is fine to coarse and gravel is fine to coarse subangular		Σ1
4.50	D8				(0.25)			
4.80	D9	Water strike(1) at 4.80m.			4.65 (1.05)	Dense light orange-brown SAND and GRAVEL with rare cobbles. Sand is fine to coarse and gravel is fine to coarse subangular		
5.00-5.45	CPT N=40	3.7/10,10,10,10						
5.50	D10				5.70 (0.30)	Stiff brown mottled grey fissured silty CLAY with occasional partings of orange-brown fine sand and silt and rare carbonaceous material		
5.90	D11				6.00	Complete at 6.00m		

Remarks Cased to 4.8 m Standpipe installed to a depth of 5.85 m Groundwater measured at a depth of 4.21 m on 16/10/2012 and 4.20 m on 08/11/2012	Scale (approx)	Logged By
	1:50	HD
	Figure No. J12236.BH 2	



Geotechnical & Environmental Associates

Tyttenhanger House
Coursers Road
St Albans
AL4 0PG

Site
Denmark Street South, 4 Filcroft Street, London, WC2H 8DJ

Number
BH 3

Excavation Method Open-drive sampler	Dimensions	Ground Level (mOD)	Client Consolidated Developments Limited	Job Number J12236
	Location	Dates 05/10/2012	Engineer Engenuiti	Sheet 1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
0.50	D1				(0.07) 0.07 (0.08) 0.13 (0.09) 0.22 (0.03) 0.25 (0.15) 0.40 (0.30) 0.70 (1.20)	Paving slab Concrete Granite cobbles Concrete Sub-base (sand and gravel) MADE GROUND (greyish brown slightly clayey silty sand with rare gravel and occasional fragments of brick and charcoal)		
1.95 2.00-2.45	D2 CPT N=5		1,2/1,1,2,1		1.90	MADE GROUND (bricks including whole bricks and fragments of brick) MADE GROUND (grey sandy silt with occasional partings of white fine sand with occasional fragments of brick, wood and charcoal. Layer of brick between a depth of 2.7 m and 2.8 m)		
2.50	D3				(2.35)			
3.50	D4		Water strike(1) at 3.90m.					Σ1
4.60 4.75 4.85 4.95	D5 D6 D7 D8				4.25 (0.25) 4.50 (0.20) 4.70 (0.10) 4.80 (0.65)	MADE GROUND (dark grey silt with occasional fragments of fine brick). Organic odour noted Light greenish grey SAND and GRAVEL. Sand is fine to coarse and gravel is fine to coarse subangular to subrounded Soft dark grey mottled black and greenish grey sandy SILT		
5.20	D9				5.45	Variably soft to stiff orange-brown silty CLAY. Claystone encountered at a depth of 5.2 m		
5.80	D10				(0.55) 6.00	Stiff dark grey fissured silty CLAY Complete at 6.00m		

Remarks Cased to 5.0 m Standpipe installed to a depth of 6.0 m Groundwater measured at a depth of 3.72 m on 16/10/2012 and 3.66 m on 08/11/2012	Scale (approx)	Logged By
	1:50	HD
Figure No. J12236.BH 3		



Site : Denmark Street South, 4 Flitcroft Street, London, WC2H 8DJ

Client : Consolidated Developments Limited

Engineer: Engenuiti

Job Number

J12236

Sheet

1 / 1

Borehole Number	Base of Borehole (m)	End of Seating Drive (m)	End of Test Drive (m)	Test Type	Seating Blows per 75mm		Blows for each 75mm penetration				Result	Comments
					1	2	1	2	3	4		
BH 1	1.00	1.15	1.45	CPT	2	2	2	2	1	2	N=7	
BH 1	2.00	2.15	2.45	CPT	3	3	1	3	3	1	N=8	
BH 1	3.00	3.15	3.31	CPT	10	15	24	26	4		54/160mm	Refusal
BH 1	4.00	4.15	4.45	CPT	5	7	10	10	11	13	N=44	
BH 2	5.00	5.15	5.45	CPT	3	7	10	10	10	10	N=40	
BH 3	2.00	2.15	2.45	CPT	1	2	1	1	2	1	N=5	

Excavation Method
Manual

Dimensions (mm)
800 x 600 x 1300

Ground Level (mOD)

Client
Consolidated Developments Limited

**Job
Number**
J12236


Location

Dates
05/10/2012


Engineer
Engenuiti

Sheet
1/22

PLAN

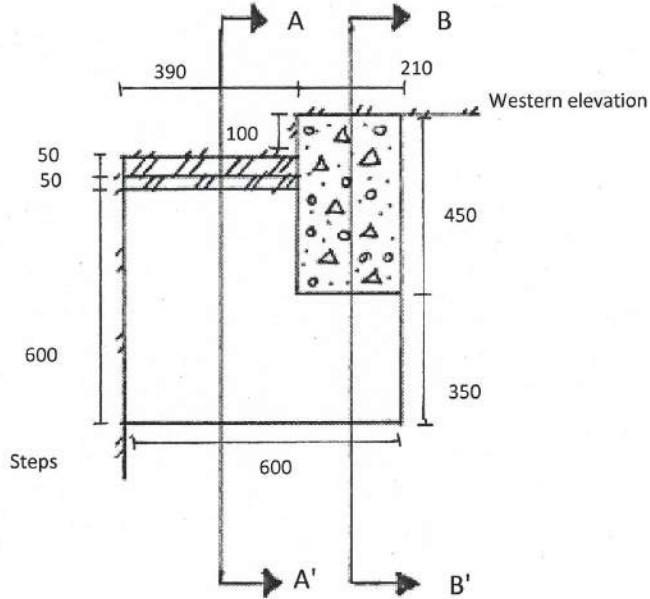

SECTION A - A'

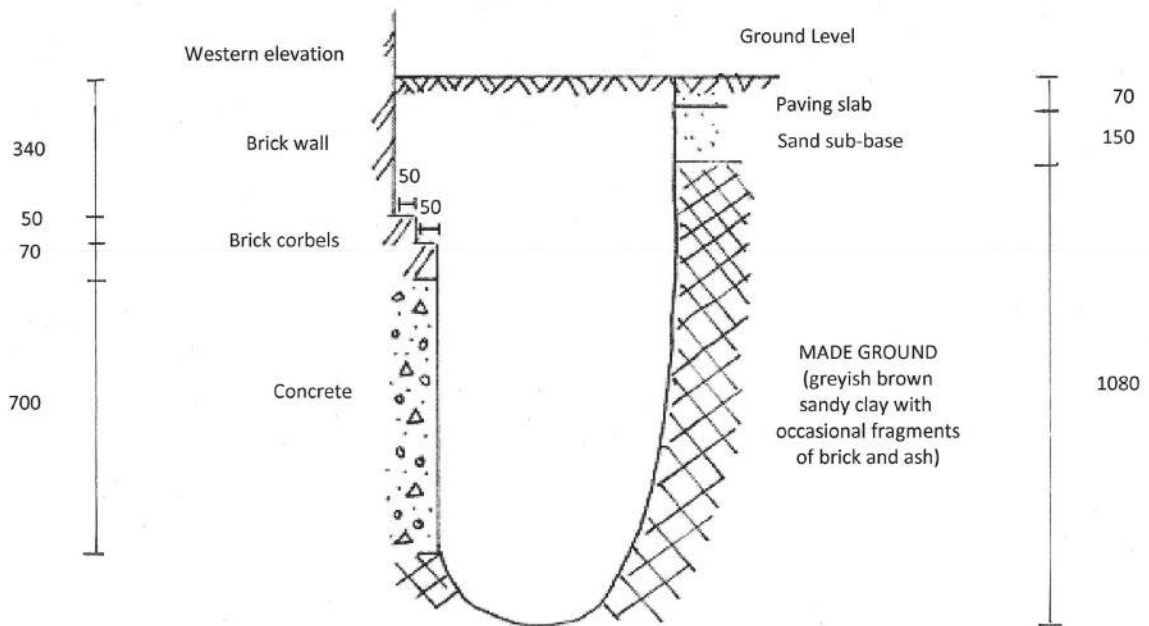

Remarks:

All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20

Logged by:
HD

Excavation Method
Manual

Dimensions (mm)
800 x 600 x 1300

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
05/10/2012

Engineer
Engenuiti

Sheet
2/22

SECTION B - B'

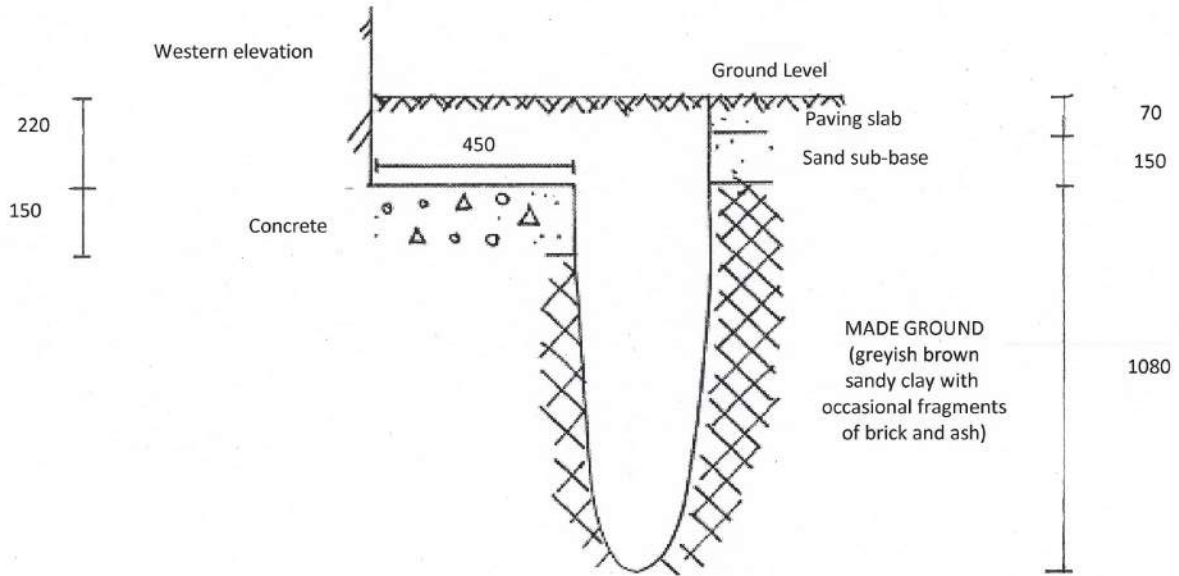

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20
Logged by:
HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
3/22



View of footings encountered in Trial Pit No 1, looking east

Excavation Method
Manual

Dimensions
600 x 800 x 1500

Ground Level (mOD)

Client
Consolidated Developments Limited

**Job
Number**
J12236


Location

Dates
04/10/2012


Engineer
Engenuiti

Sheet
4/22

PLAN

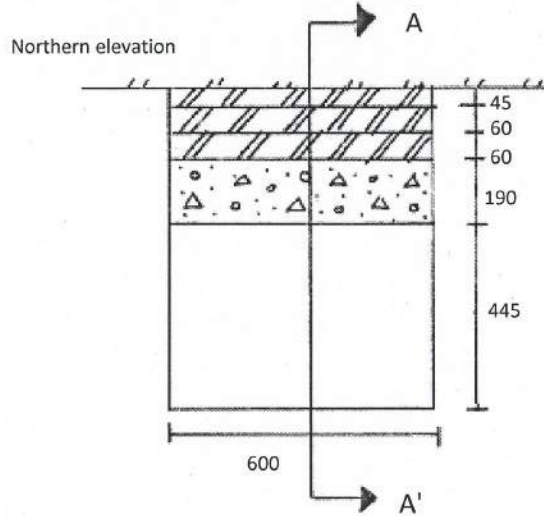

SECTION A - A'

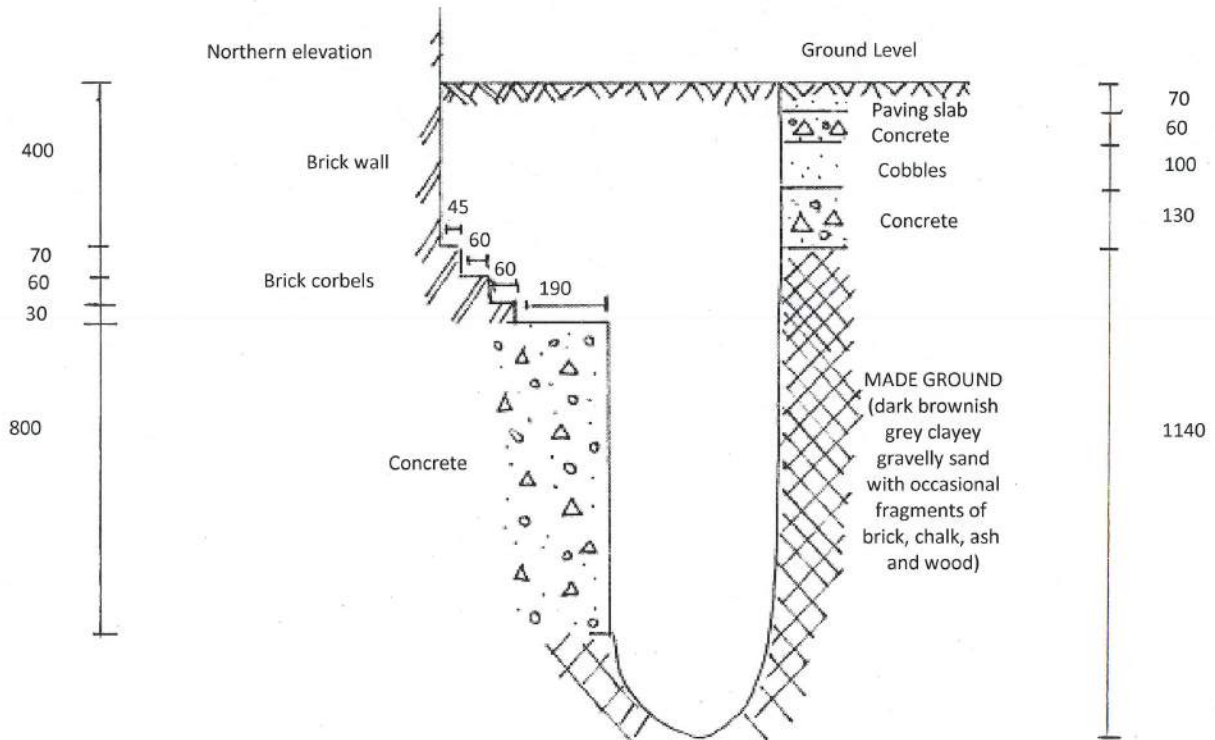

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20
Logged by:
HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number

J12236

Sheet

5/22



View of the footings encountered in Trial Pit No 2, looking south

Excavation Method
Manual

Dimensions
1200 x 700 x 2600

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
04/10/2012

Engineer
Engenuiti

Sheet
6/22

PLAN

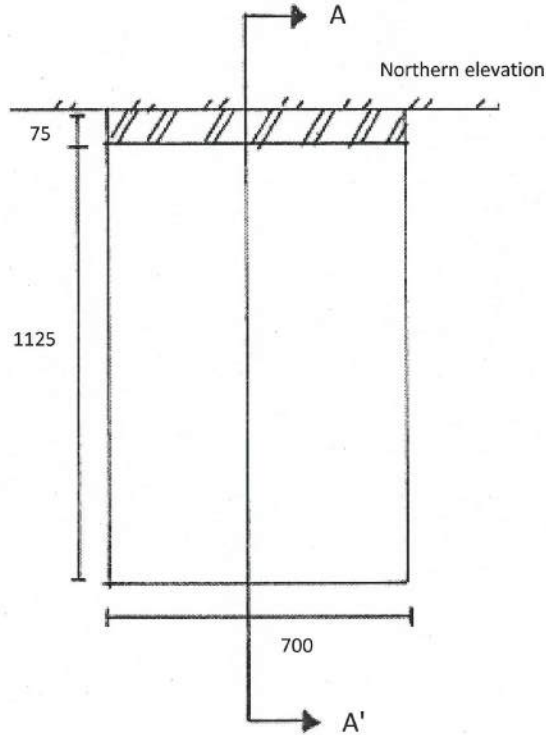

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20
Logged by:
HD

Excavation Method
Manual

Dimensions (mm)
1200 x 700 x 2600

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
04/10/2012

Engineer
Engenuiti

Sheet
7/22

SECTION A - A'

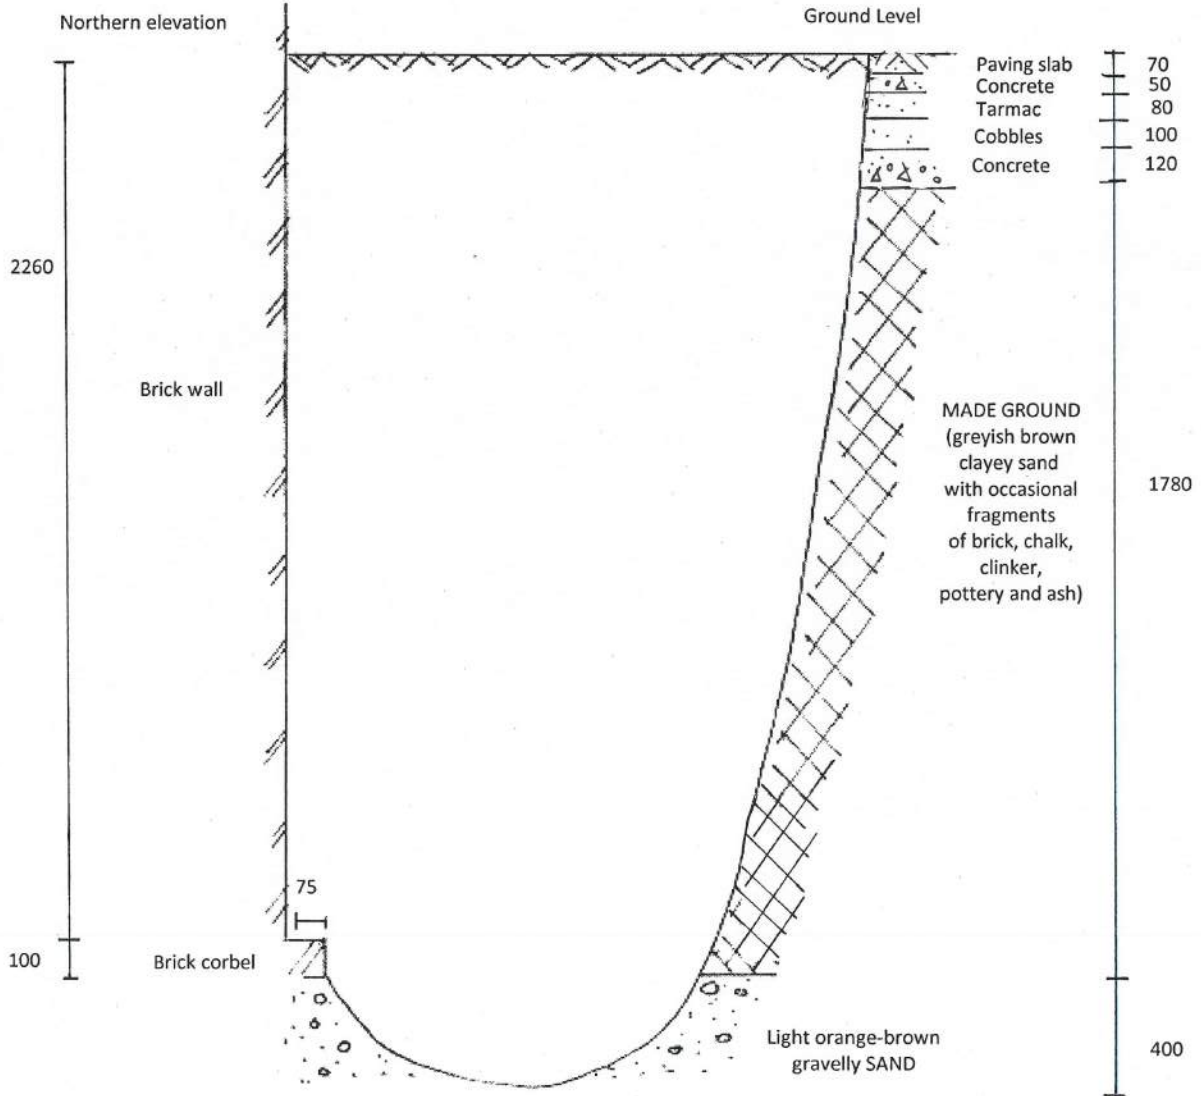

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20

Logged by:
HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job

Number

J12236

Sheet

8/22



View of the footings encountered in Trial Pit No 3, looking south

Excavation Method
Manual

Dimensions (mm)
1700 x 1200 x 2600

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236

Location


Dates
04/10/2012

Engineer
Engenuiti

Sheet
9/22

SECTION A - A'

Southern elevation

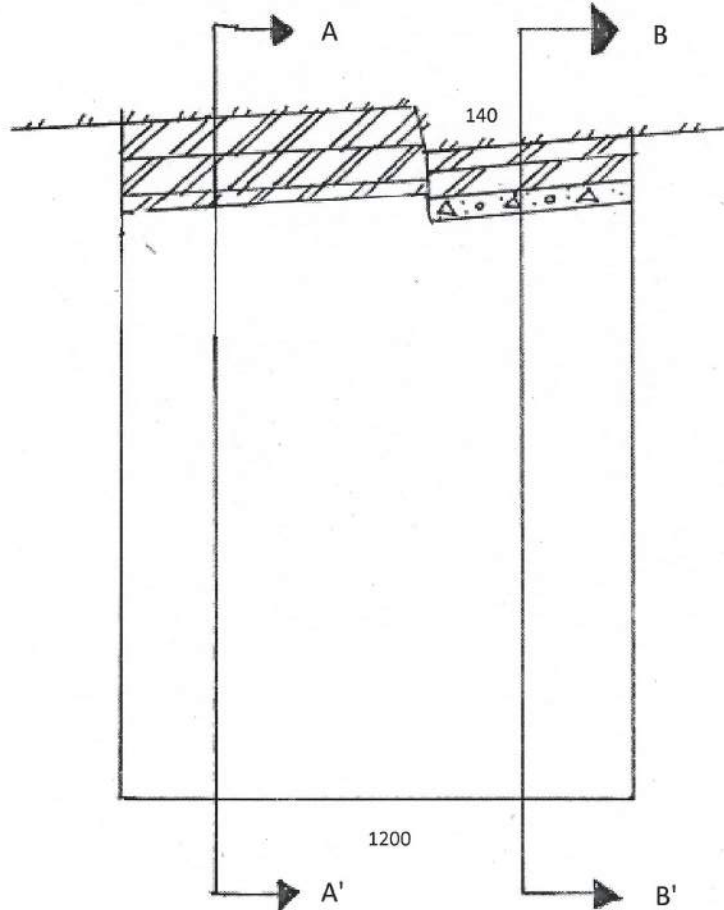

Remarks:

All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20

Logged by:
HD

Excavation Method
Manual

Dimensions
1700 x 1200 x 2600

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
04/10/2012

Engineer
Engenuiti

Sheet
10/22

SECTION A - A'

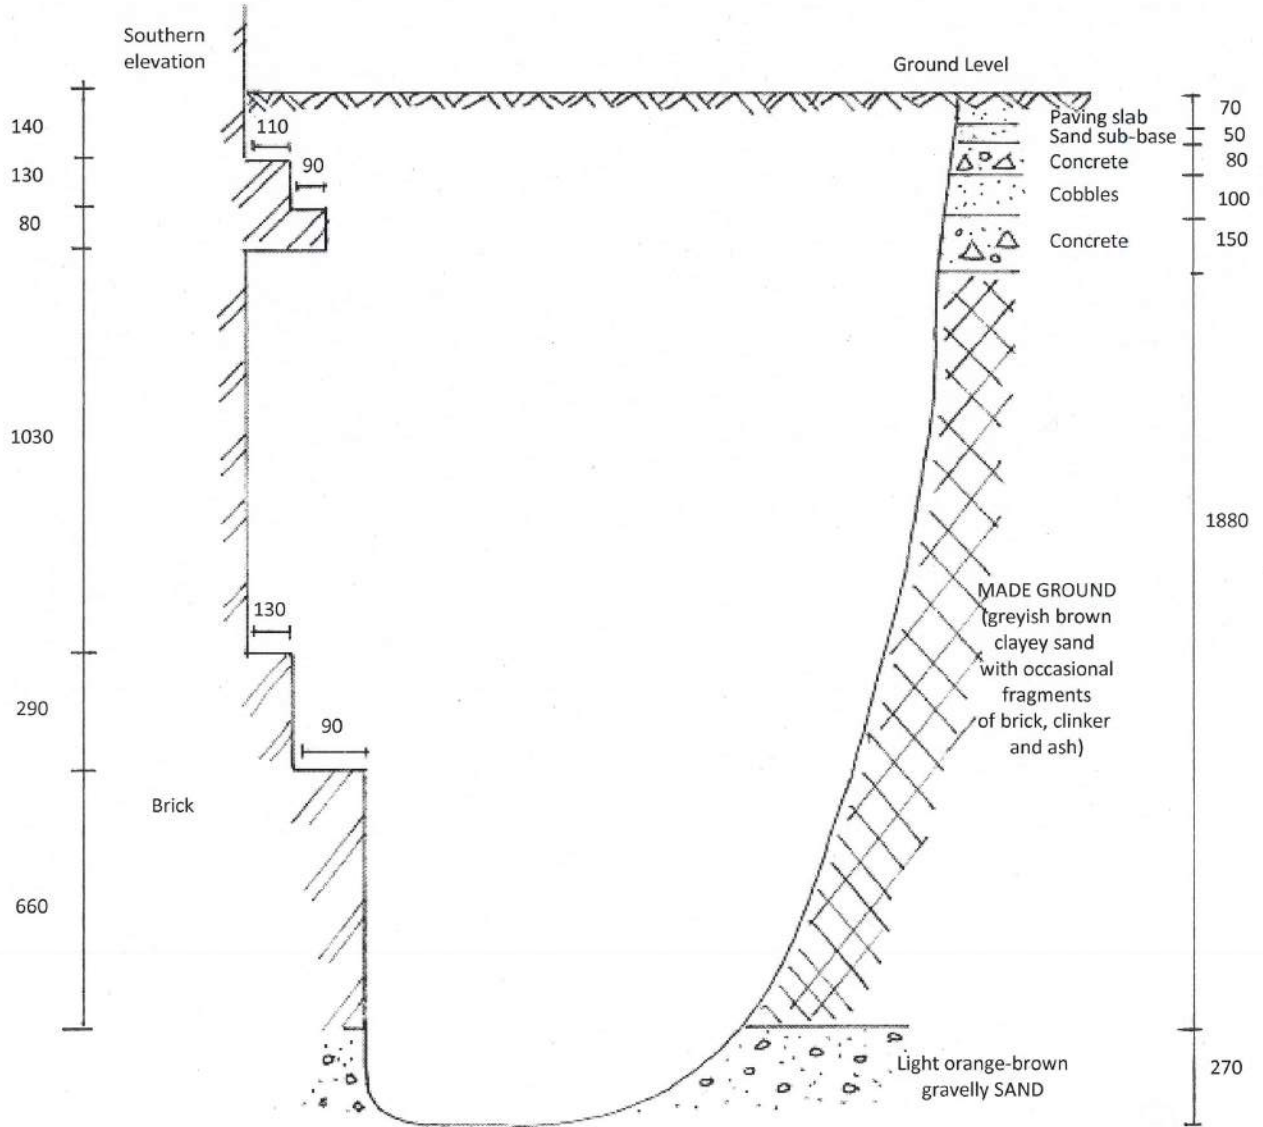

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:

1:20

Logged by:

HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
12/22



View of the footings encountered in Trial Pit No 4, looking northeast

Excavation Method
Manual

Dimensions (mm)
1900 x 1100 x 470

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
09/10/2012

Engineer
Engenuiti

Sheet
13/22

PLAN

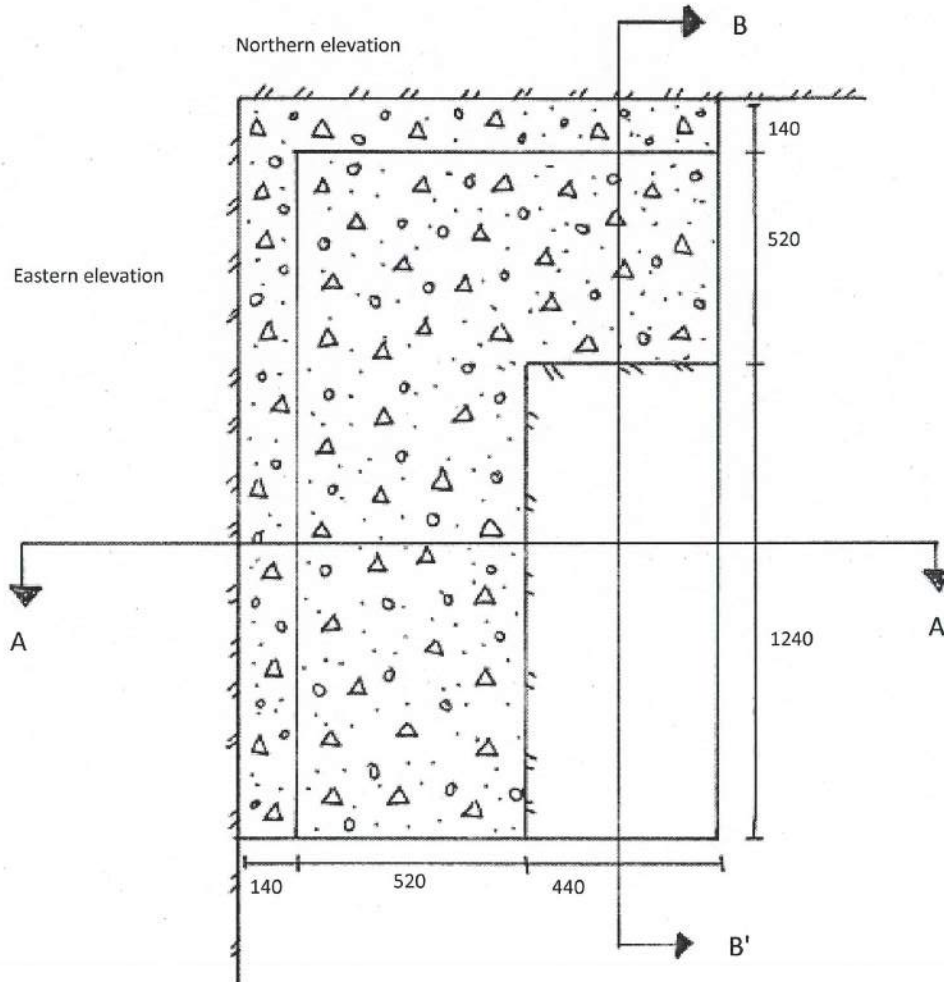

Remarks:
All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20
Logged by:
HD

Excavation Method
Manual

Dimensions (mm)
1900 x 1100 x 470

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
09/10/2012


Engineer
Engenuiti

Sheet
14/22

SECTION A - A'

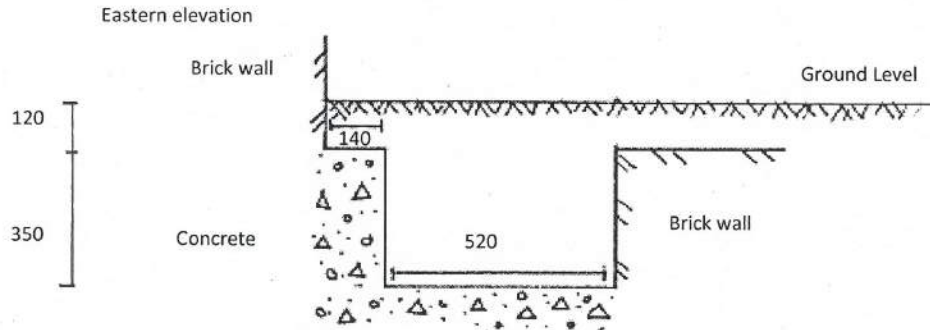

SECTION B - B'

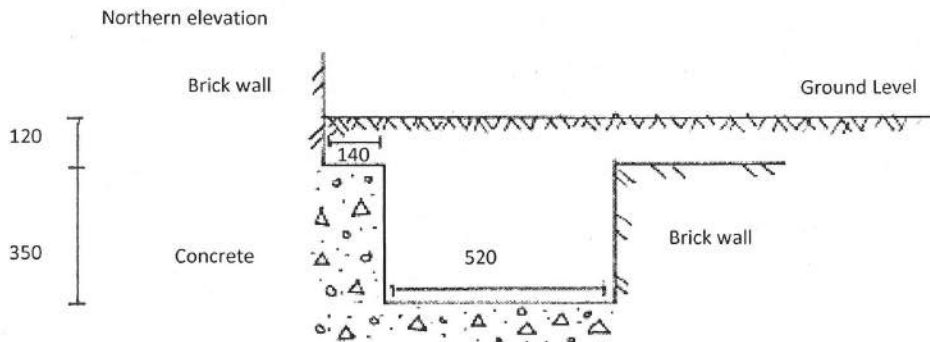

Remarks:

All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:20

Logged by:
HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
15/22



View of the findings encountered in Trial Pit No 5, looking northwest

Excavation Method
Manual

Dimensions
1800 x 900 x 600

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
09/10/2012

Engineer
Engenuiti

Sheet
16/22

PLAN

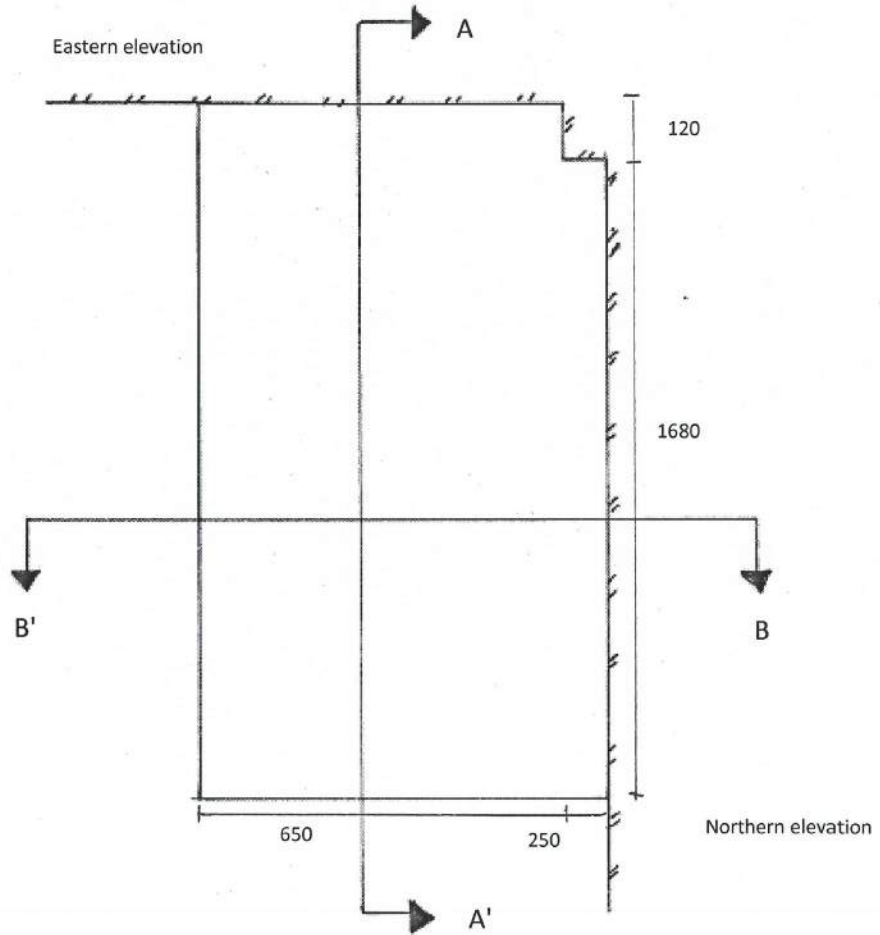

Remarks:

All dimensions in millimetres

Sides of trial pit did not remain stable during excavation - not possible to install shoring to continue pit

Groundwater not encountered

Scale:

1:20

Logged by:

HD

Excavation Method
Manual

Dimensions
1800 x 900 x 600

Ground Level (mOD)

Client
Consolidated Developments Limited

**Job
Number**
J12236


Location

Dates
09/10/2012


Engineer
Engenuiti

Sheet
17/22

SECTION A - A'

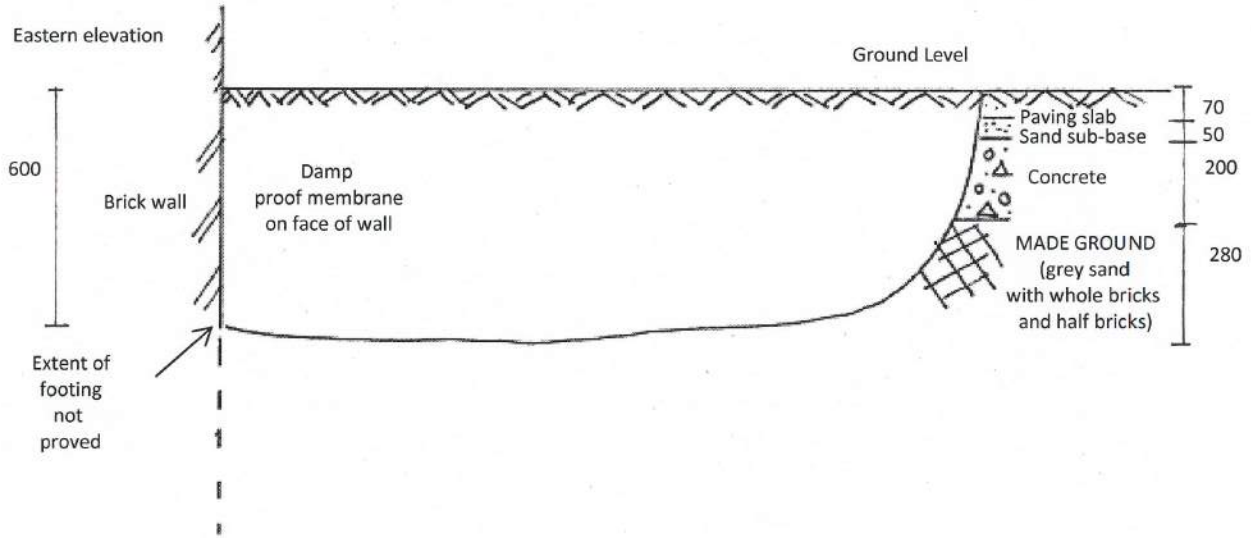

SECTION B - B'

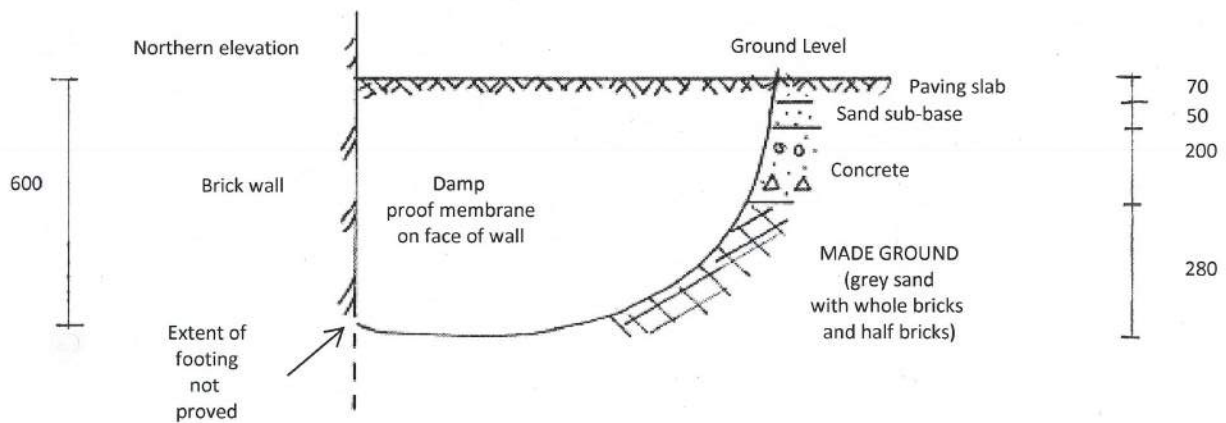

Remarks:

All dimensions in millimetres

Sides of trial pit did not remain stable during excavation - not possible to install shoring to continue pit

Groundwater not encountered

Scale:

1:20

Logged by:

HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Job Number
J12236

Client Consolidated Developments Limited

Sheet
18/22

Engineer Engenuiti



View of the findings encountered in Trial Pit No 6, looking north

Excavation Method
Manual

Dimensions (mm)
700 x 600 x 700

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
16/10/2012


Engineer
Engenuiti

Sheet
19/22

PLAN

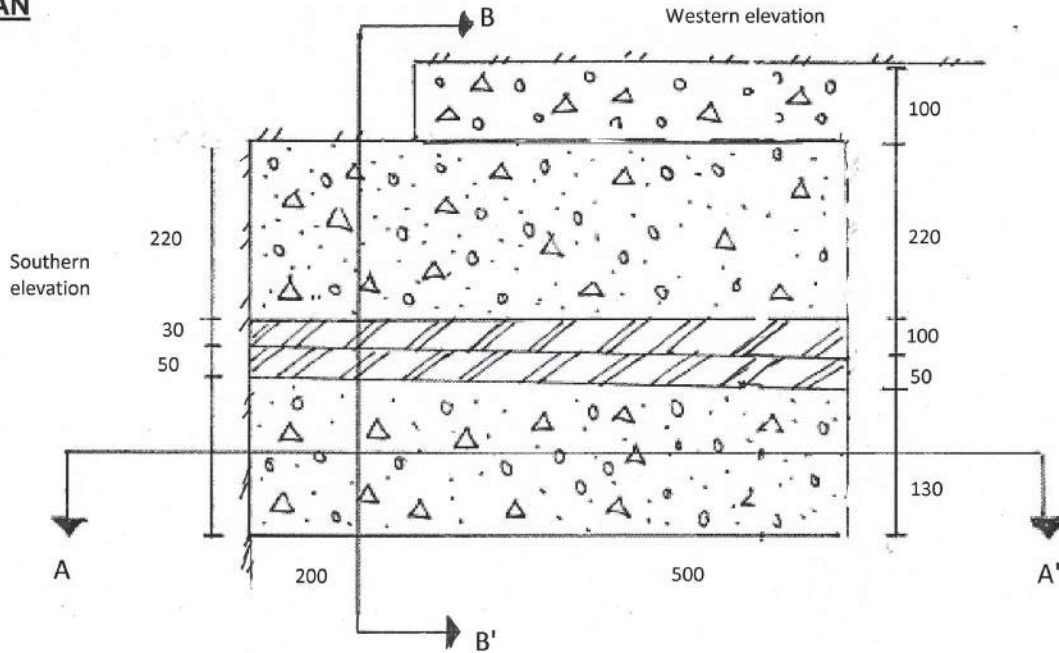

SECTION A - A'

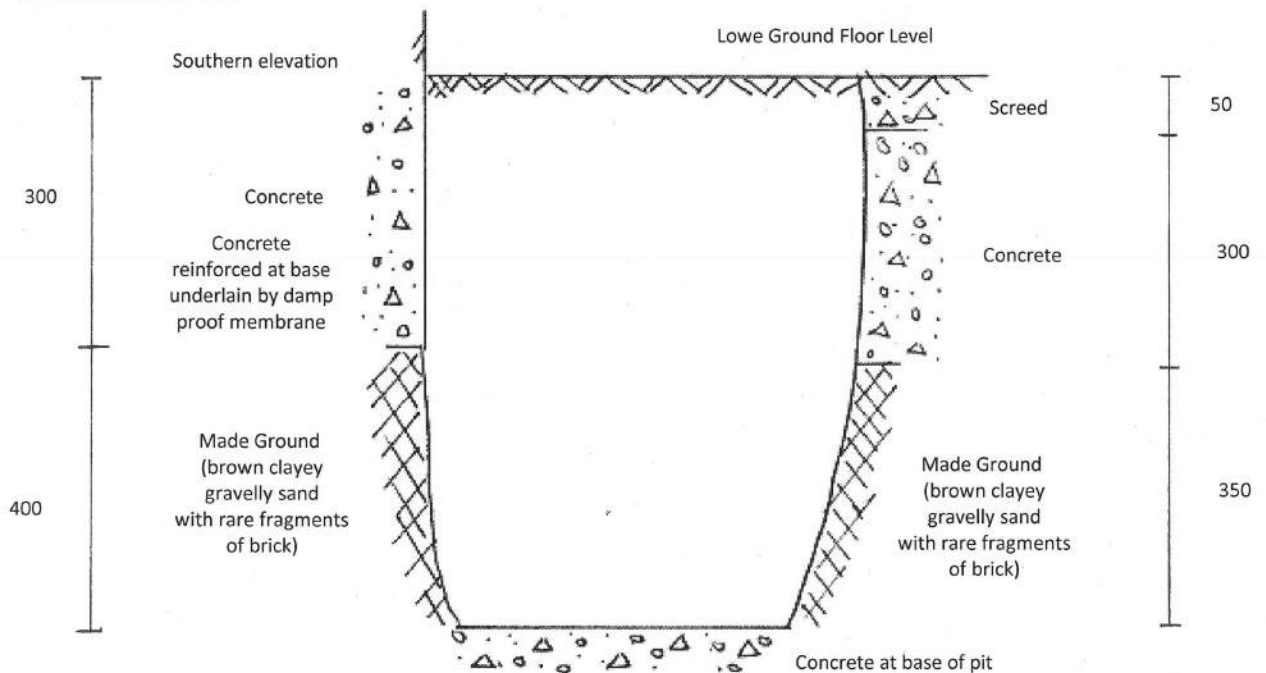

Note: Two probes through base of concrete were carried out using a hilti drill and the concrete is at least 500 mm thick, underlain by an obstruction, possibly metal

Remarks:

All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:10

Logged by:
HD

Excavation Method
Manual

Dimensions (mm)
700 x 600 x 700

Ground Level (mOD)

Client
Consolidated Developments Limited

Job Number
J12236


Location

Dates
16/10/2012

Engineer
Engenuiti

Sheet
20/22

SECTION B - B'

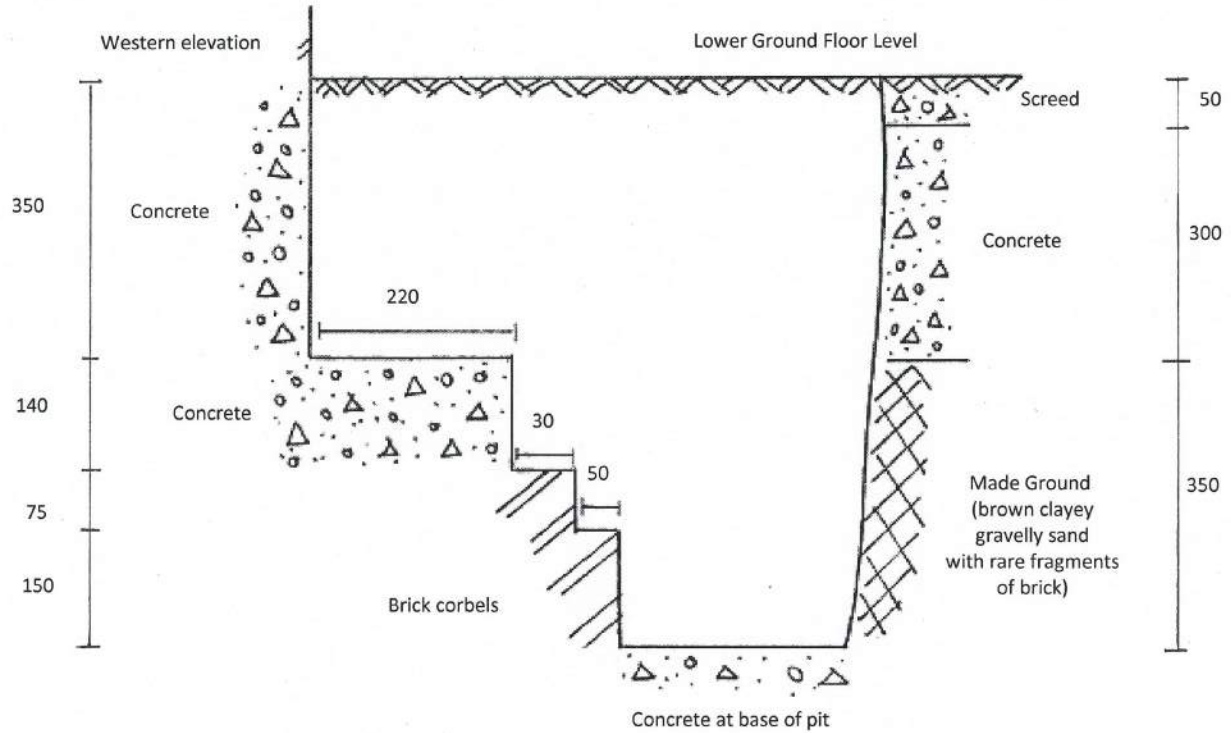

Note: Two probes through base of concrete were carried out using a hilti drill and the concrete is at least 500 mm thick, underlain by an obstruction, possibly metal

Remarks:

All dimensions in millimetres
Sides of trial pit remained stable during excavation
Groundwater not encountered

Scale:
1:10

Logged by:
HD

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
21/22



View of the findings encountered in Trial Pit No 7, looking southeast

Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
22/22



View of the findings encountered in Trial Pit No 8, looking south

PROJECT NAME	CHATEAU DENMARK. 4 FLITCROFT STREET WC2H 8DJ		Date	01/11/2012
	Job Number: J12236		Approved	<i>Simon Burke</i>
	PROJECT NO:	GEO / 18891	Page	1 of 1

Sample details				Description	Classification Tests					Density Tests		Undrained Triaxial Compression Tests			Chemical Tests			Other tests and comments
Borehole No.	Depth (m)	No.	Type		MC (%)	LL (%)	PL (%)	PI (%)	<425 mic (%)	Bulk (Mg/m³)	Dry (Mg/m³)	Cell Pressure (kPa)	Deviator Stress (kPa)	Shear Stress (kPa)	pH	2:1 W/S SO4 (g/l)	Ground Water SO4 (g/l)	
BH1	2.40	D2	D												8.3	0.89		
BH1	3.50	D4	D	Brown silty sandy GRAVEL													Particle Size Distribution	
BH1	5.00	D8	D	Brown gravelly SAND													Particle Size Distribution	
BH1	6.00	D10	D	Dark orange brown slightly fine sandy silty CLAY	27	65	25	40	100									
BH2	3.30	D4	D												7.8	0.64		
BH2	4.40	D7	D	Brown SAND with rare fine to medium gravel													Particle Size Distribution	
BH2	5.90	D11	D	Dark greyish brown mottled orange silty CLAY	30	65	27	38	100									
BH3	3.50	D4	D												9.0	0.34		
BH3	4.75	D6	D	Brown sandy GRAVEL													Particle Size Distribution	
BH3	4.95	D8	D	Orange brown slightly fine sandy silty CLAY with black staining	48	73	31	42	100									
BH3	5.20	D9	D												8.3	1.00		
BH3	5.80	D10	D	Dark greyish brown silty CLAY	28	71	26	45	100									

SUMMARY OF GEOTECHNICAL TESTING



Determination of Particle Size Distribution


Borehole Number: BH1
 Sample Number: D4
 Depth (m): 3.50

Description:
 Brown silty sandy GRAVEL

BS1377 : Part 2 : Clause 9.2 : 1990 Wet Sieving Method

SIEVE	
Sieve	% pass
200 mm	100
125 mm	100
90 mm	100
75 mm	100
63 mm	100
50 mm	100
37.5 mm	100
28 mm	100
20 mm	94
14 mm	81
10 mm	70
6.3 mm	59
5 mm	54
3.35 mm	48
2 mm	42
1.18 mm	38
600 µm	32
425 µm	23
300 µm	15
212 µm	11
150 µm	8
63 µm	6

CLAY	SILT			SAND			GRAVEL			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	

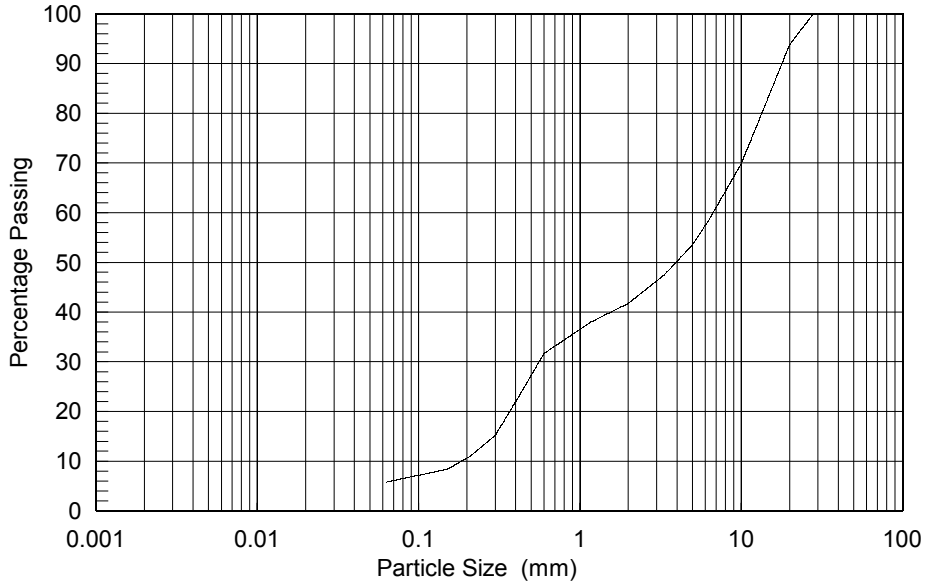

Particle Proportions	
Cobbles	0.0 %
Gravel	58.3 %
Sand	36.0 %
Silt & Clay	5.8 %

Checked and Approved

Initials: **SB**
 Date: 01/11/2012

Project Number:

GEO / 18891

Project Name:

CHATEAU DENMARK. 4 FLITCROFT STREET WC2H 8DJ

Job Number: J12236



GEOLABS®

Determination of Particle Size Distribution

Borehole Number: BH1
 Sample Number: D8
 Depth (m): 5.00


Description:
 Brown gravelly SAND

Insufficient material supplied to be representative in accordance with BS1377 requirements.

BS1377 : Part 2 : Clause 9.3 : 1990 Dry Sieving Method

SIEVE	
Sieve	% pass
200 mm	100
125 mm	100
90 mm	100
75 mm	100
63 mm	100
50 mm	100
37.5 mm	100
28 mm	100
20 mm	90
14 mm	86
10 mm	81
6.3 mm	77
5 mm	74
3.35 mm	73
2 mm	71
1.18 mm	70
600 µm	65
425 µm	45
300 µm	17
212 µm	8
150 µm	5
63 µm	2

CLAY	SILT			SAND			GRAVEL			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	

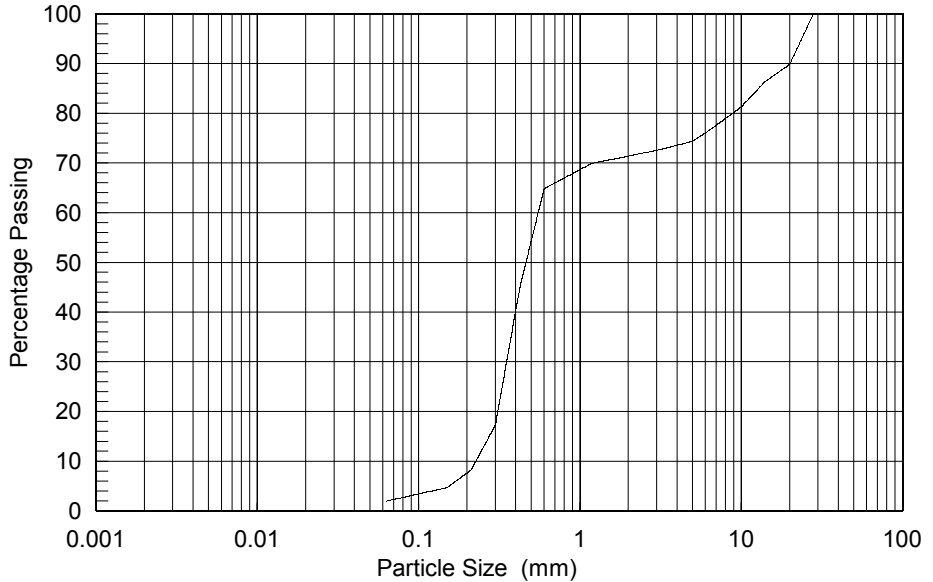

Particle Proportions	
Cobbles	0.0 %
Gravel	28.6 %
Sand	69.4 %
Silt & Clay	2.0 %

Checked and Approved

Initials:

SB

Date: 01/11/2012

Project Number:

GEO / 18891

Project Name:

CHATEAU DENMARK. 4 FLITCROFT STREET WC2H 8DJ

Job Number: J12236



GEOLABS®

Determination of Particle Size Distribution


Borehole Number: BH2
 Sample Number: D7
 Depth (m): 4.40

Description:
 Brown SAND with rare fine to medium gravel

BS1377 : Part 2 : Clause 9.3 : 1990 Dry Sieving Method

SIEVE	
Sieve	% pass
200 mm	100
125 mm	100
90 mm	100
75 mm	100
63 mm	100
50 mm	100
37.5 mm	100
28 mm	100
20 mm	100
14 mm	99
10 mm	98
6.3 mm	97
5 mm	97
3.35 mm	96
2 mm	96
1.18 mm	95
600 µm	93
425 µm	86
300 µm	73
212 µm	46
150 µm	14
63 µm	3

CLAY	SILT			SAND			GRAVEL			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	

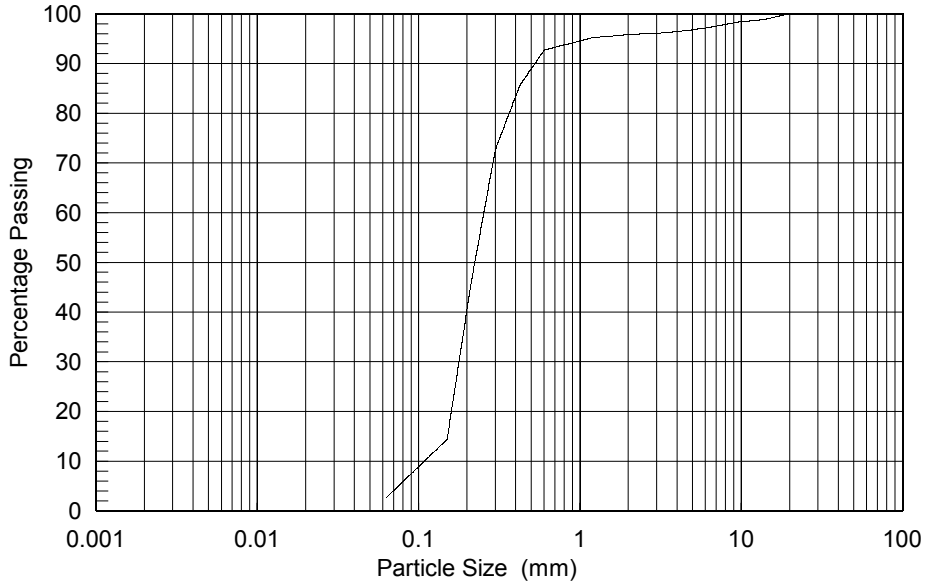

Particle Proportions	
Cobbles	0.0 %
Gravel	4.1 %
Sand	93.2 %
Silt & Clay	2.7 %

Checked and Approved

Initials: **SB**
 Date: 01/11/2012

Project Number:

GEO / 18891

Project Name:

CHATEAU DENMARK. 4 FLITCROFT STREET WC2H 8DJ

Job Number: J12236



GEOLABS®

Determination of Particle Size Distribution

Borehole Number: BH3
 Sample Number: D6
 Depth (m): 4.75


Description:
 Brown sandy GRAVEL

Insufficient material supplied to be representative in accordance with BS1377 requirements.

BS1377 : Part 2 : Clause 9.3 : 1990 Dry Sieving Method

SIEVE	
Sieve	% pass
200 mm	100
125 mm	100
90 mm	100
75 mm	100
63 mm	100
50 mm	100
37.5 mm	100
28 mm	100
20 mm	86
14 mm	62
10 mm	48
6.3 mm	36
5 mm	34
3.35 mm	31
2 mm	30
1.18 mm	27
600 µm	22
425 µm	16
300 µm	9
212 µm	5
150 µm	3
63 µm	2

CLAY	SILT			SAND			GRAVEL			COBBLES
	Fine	Medium	Coarse	Fine	Medium	Coarse	Fine	Medium	Coarse	

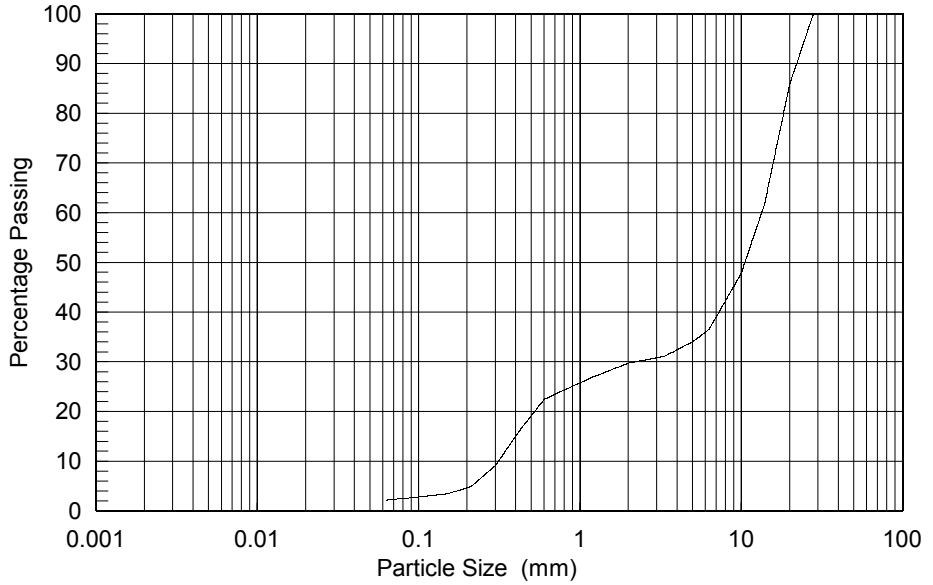

Particle Proportions	
Cobbles	0.0 %
Gravel	70.3 %
Sand	27.6 %
Silt & Clay	2.2 %

Checked and Approved

Initials:

SB

Date: 01/11/2012

Project Number:

GEO / 18891

Project Name:

CHATEAU DENMARK. 4 FLITCROFT STREET WC2H 8DJ

Job Number: J12236



GEOLABS®

Date 01 October 2012
Our Ref 20878-SI-5-011012
Your Ref

To Hannah Dashfield
Geotechnical and Environmental Associates
Hannah@gea-ltd.co.uk



London Underground Limited

Hello Hannah,

4 Flitcroft Street, London, WC2H 8DJ

Thank you for your communication of 28th September 2012.

I can confirm that London Underground has no assets within 50 metres of your site as shown on the plan you provided.

Should you have any further enquiries, please do not hesitate to contact me.

Shahina Inayathusein
Information Manager
LUL Infrastructure Protection
E-mail: Locationenquiries@tube.tfl.gov.uk
Tel: 020 7918 0016

Hannah Dashfield

From: Location Enquiries <SMBLocationEnquiries@tfl.gov.uk>
Sent: 01 October 2012 11:45
To: Hannah Dashfield
Subject: RE: London Underground asset location enquiries - Flitcroft Street
Attachments: SI-5-011012 4 Flitcroft Street, London, WC2H 8DJ.pdf

London Underground Infrastructure Protection response to your communication attached.

Kind regards

Shahina Inayathusein
Information Manager
locationenquiries@tube.tfl.gov.uk
Tel: 0207 918 0016
Auto: 40016

From: Hannah Dashfield [<mailto:Hannah@gea-ltd.co.uk>]
Sent: 28 September 2012 10:00
To: Location Enquiries
Cc: Steve Branch
Subject: London Underground asset location enquiries - Flitcroft Street
Importance: High

Shahina,

Our client is proposing to construct a single level basement. We understand the Northern Line to be close to the location of this site. Would you be able to provide details of the location / depth of tunnels and any exclusion zones affecting our site as we are carrying out a 10 m deep borehole next week.

Site Address: Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ
NGR: 529929, 181233
(See attached site location plan)

Please confirm when we should expect to receive some information from you.

Let me know if you require any further information.

Regards,


Hannah Dashfield

Geotechnical & Environmental Associates
Tyttenhanger House
Coursers Road
St Albans
Herts AL4 0PG

tel 01727 824666
fax 01727 824777
email mail@gea-ltd.co.uk
web www.gea-ltd.co.uk



The contents of this email and any files transmitted with it are confidential and intended solely for the use of the individual or entity to whom it is addressed. If you are not the intended recipient of this email you may not copy, forward, disclose or otherwise use it or part of it in any form whatsoever. If you have received this email in error please contact the sender immediately. The views herein do not necessarily represent those of the company.

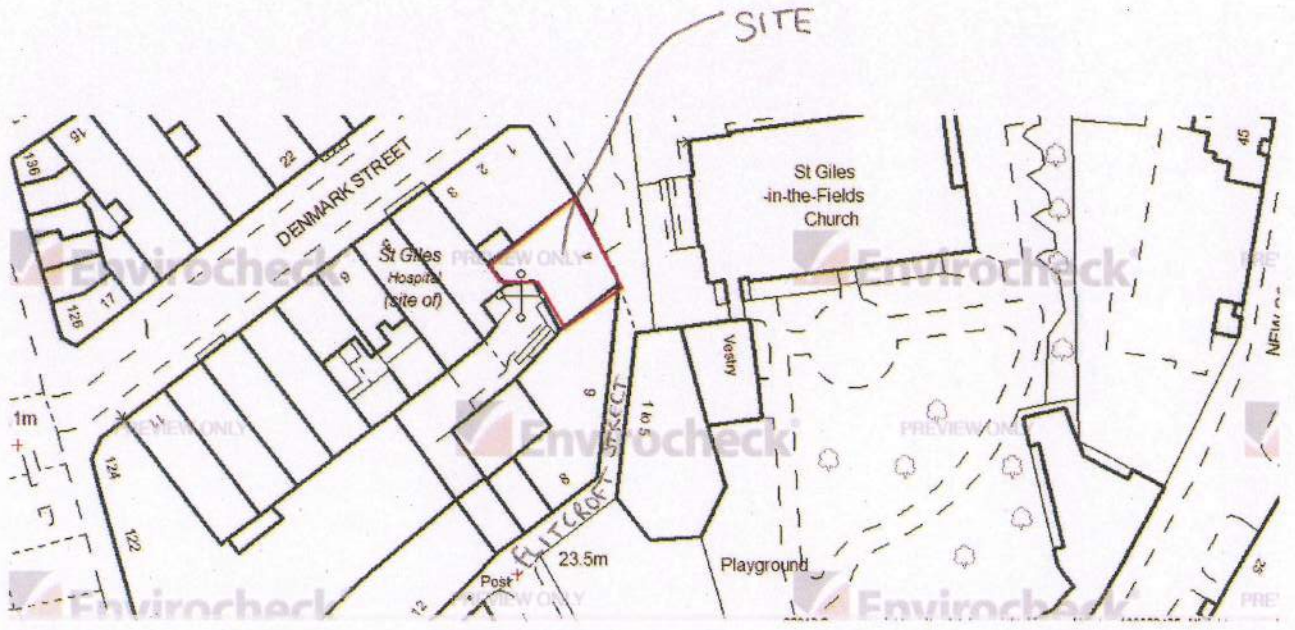


Site Chateau Denmark, 4 Flitcroft Street, London, WC2H 8DJ

Client Consolidated Developments Limited

Engineer Engenuiti

Job Number
J12236

Sheet
1 / 1

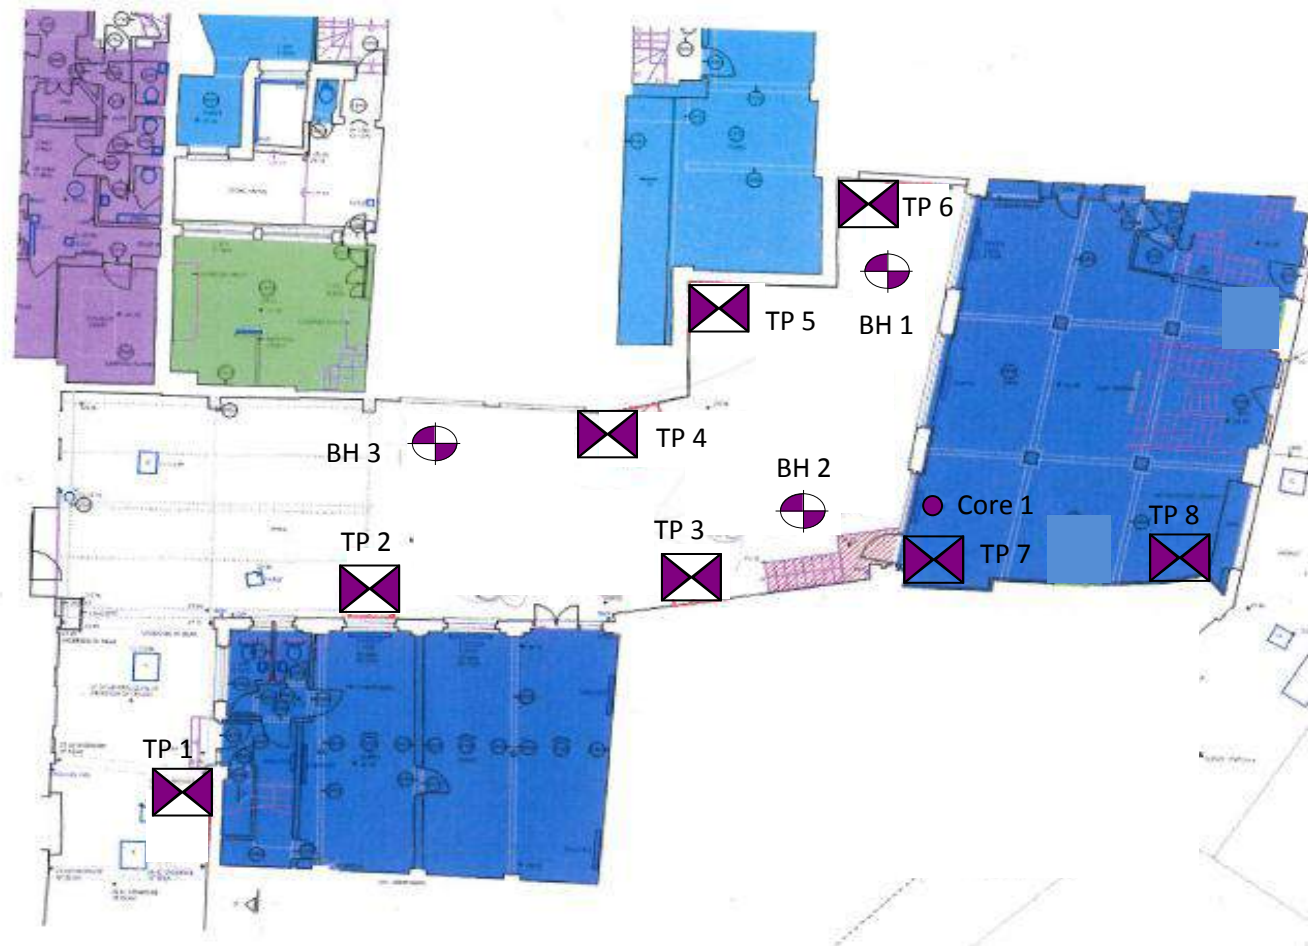

NOTE: NOT TO SCALE

Geotechnical & Environmental Associates (GEA) is an engineer-led and client-focused independent specialist providing a complete range of geotechnical and contaminated land investigation, analytical and consultancy services to the property and construction industries.

We have offices at

Tythenhanger House
Coursers Road
St Albans
AL4 0PG
tel 01727 824666
mail@gea-ltd.co.uk



Church Farm
Gotham Road
Kingston on Soar
Notts
NG11 0DE
tel 01509 674888
midlands@gea-ltd.co.uk



Enquiries can also be made on-line at www.gea-ltd.co.uk where information can be found on all of the services that we offer.

SITE INVESTIGATION REPORT

St Giles Circus

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

CONCEPT

ISSUE 02

CONCEPT

T

CONCEPT

CONCEPT

SITE INVESTIGATION REPORT

St Giles Circus

Prepared for: Consolidated Developments Limited




Concept: 14/2669 FR 02

20/03/2015

Unit 8, Warple Mews,
Warple Way
London W3 0RF
Tel: 020 8811 2880
Fax: 020 8811 2881
e-mail: si@conceptconsultants.co.uk
www.conceptconsultants.co.uk

DOCUMENT ISSUE REGISTER

Job Title:	St Giles Circus
Job Number:	14/2669
Document Type:	Factual Site Investigation Report

Document Ref:	Status/Issue No.	Date	Amendment Record (Detail)			
14/2669/FR-01	Issue 01	16/02/2015				
			Prepared By:	Checked By:	Approved By:	
			Name	O Savvidou	D Seeley	M Dedic
			Signature			
14/2669/FR-02	Issue 02	20/03/2015	Updated with site plan, trial pit sketches and laboratory test results			
			Prepared By:	Checked By:	Approved By:	
			Name	O Savvidou	D Seeley	M Dedic
			Signature			
			Prepared By:	Checked By:	Approved By:	
			Name			
			Signature			
			Prepared By:	Checked By:	Approved By:	
			Name			
			Signature			

CONCEPT SITE INVESTIGATIONS

Unit 8, Warple Mews, Warple Way, London W3 0RF
 Tel: 020 8811 2680 Fax: 020 8811 2681
 e-mail: si@conceptconsultants.co.uk

CONTENTS

- 1. PROJECT PARTICULARS**
- 2. PURPOSE AND SCOPE OF WORKS**
- 3. DESCRIPTION OF WORKS**
- 4. DRILLING METHODS**
 - 4.1 Inspection Pits**
 - 4.2 Cable Percussion Drilling**
 - 4.2.1 Sampling and Testing during Cable Percussion Drilling**
 - 4.3 Rotary Drilling**
 - 4.3.1 Sampling and Testing during Rotary Drilling**
 - 4.4 Dynamic Sampling and Hand Held Boreholes**
 - 4.5 Hand Excavated Trial Pits**
 - 4.6 Standpipe Installations**
 - 4.7 Instrumentation Monitoring**
 - 4.8 Logging / Laboratory Testing**
 - 4.9 Setting Out**
- 5. GEOLOGICAL GROUND PROFILE**
- 6. SITE LOCATION PLAN**
- 7. EXPLORATORY HOLE LOCATION PLANS**

- 8. CABLE PERCUSSION AND ROTARY BOREHOLE LOGS**

- 9. DYNAMIC SAMPLER & HAND HELD BOREHOLE LOGS**

- 10. TRIAL PIT SKETCHES**

- 11. INSTRUMENTATION MONITORING RESULTS**

- 12. GEOTECHNICAL LABORATORY TEST RESULTS**

- 13. CHEMICAL TEST RESULTS**

- 14. PHOTOGRAPHS**

1. PROJECT PARTICULARS

Site Location:	St Giles Circus
Client	Consolidated Developments Limited
Client's Representative:	GVA Second London Wall
Fieldwork:	28/10/2014 – 11/01/2015
Laboratory Work:	12/12/2014 – 20/03/2015

2. PURPOSE AND SCOPE OF WORKS

The purpose of the ground investigation is to provide information on the nature and extent of the ground, gas and groundwater contamination of the site, obtain samples for geotechnical and environmental testing, explore the shallow foundations of the existing buildings and to determine existing services information to inform the design of temporary works.

The site is situated in the area of St. Giles Circus. It comprises various properties to the north and south of Denmark Street and as the property at 71 Endell Street, located approximately 200m to the east of Denmark Street. The site is mostly consists of four to six storey Victorian buildings, currently occupied by a mix of uses including offices, shops and residences.

The scope of the works comprised the following:

- 4 No. Cable Percussion Boreholes to a maximum depth of 30.35m;
- 2 No. Rotary "Geobor S" Boreholes follow from Cable Percussion to a maximum depth of 55.30m;
- 15 No. Dynamic Sampling and Hand Held Boreholes to a maximum of depth of 6.00m;
- 25 No. Hand Excavated Trial Pits to a maximum depth of 2.15m;
- Logging and Photographing;
- Instrumentation Monitoring;
- Geotechnical and Chemical Laboratory Testing.

Table 1 – Exploratory Hole List to the North of Denmark Street

Hole ID	Hole Type	Depth (m)	Location	Hole ID	Hole Type	Depth (m)	Location
PB01	CP/R	55.30	GL	TP21-3	TP	2.10	B
PB01A	CP	1.60	GL	TP21-4	TP	1.00	B
PB01B	CP	1.28	GL	TP23-1	TP	2.15	B
PB02	CP/R	55.20	GL	TP23-2	TP	2.05	GL
WS01	HH	1.40	B	TP26-1	TP	1.10	B
WS02	WLS	3.70	B	TP26-2	TP	1.95	GL
WS03	WLS	4.00	B	TP26-3	TP	1.57	GL

Hole ID	Hole Type	Depth (m)	Location	Hole ID	Hole Type	Depth (m)	Location
WS04	WLS	3.00	B	TP26-4	TP	1.50	GL
WS05	WLS	3.70	B	TP55-1	TP	0.48	GL
WS06	WLS	3.70	B	TP55-2	TP	1.05	B
WS07	WLS	4.00	B	TP56-1	TP	1.00	B
WS08	WLS	1.20	B	TP58-1	TP	1.02	B
WS09	HH	1.20	B	TPG-1	TP	1.50	GL
WS10	WLS	4.00	B	TPG-2	TP	1.50	GL
TP19-1	TP	1.25	GL	TPG-3	TP	1.50	GL
TP20-1	TP	1.95	GL	TPG-4	TP	1.50	GL
TP21-1	TP	1.60	B	TPG-5	TP	1.50	GL
TP21-2	TP	1.60	B	TPG-6	TP	1.50	GL

Table 2 – Exploratory Hole List to the South of Denmark Street

Hole ID	Hole Type	Depth (m)	Location
PB04	CP	55.30	GL
PB05	CP	1.60	GL
WS13	WLS	3.70	B
WS14	WLS	6.00	B
WS15	WLS	4.50	B
TP6-1	TP	1.35	B
TP6-2	TP	1.50	B
TP6-3	TP	1.40	B

Table 3 – Exploratory Hole List at 71 Endell Street

Hole ID	Hole Type	Depth (m)	Location
WS22	WLS	3.00	B
WS23	WLS	3.20	B

Key:

- CP – Cable Percussion Borehole
- CP/R – Rotary Borehole follow from Cable Percussion
- WLS – Dynamic Sampling Borehole
- HH – Hand Held Borehole
- TP – Hand Excavated Trial Pit
- GL – Ground Level
- B – Basement Level

3. DESCRIPTION OF WORKS

The works were carried out in accordance with the Engenuiti site investigation specification referenced: 029-SPEC-003 Rev.C1 dated 30 September 2014 and with the LBH Wembley geoenvironmental investigation specification referenced: LBH4059a Rev 1, dated June 2014. They followed the recommendations set out in BS EN 1997 Parts 1 & 2.

The approximate centre of the site is located at National Grid Reference 529877E, 181289N. The site is situated north and south of Denmark Street, with Charing Cross Road to the west and High Holborn to the east.

The locations of all exploratory holes are shown in the Exploratory Hole Location Plan presented in Section 7 of this report.

4. DRILLING METHODS

4.1 Inspection Pits

Inspection pits were hand excavated 1.20m depth at all borehole locations prior to boring commencing. Where present the surface concrete/asphalt was broken out using a hydraulic breaker.

4.2 Cable Percussion Drilling

4 No. Cable Percussion Boreholes (PB01-PB02 and PB04-PB05) were drilled to a maximum depth of 30.35m below ground level using 200mm diameter equipment as appropriate. PB01A and PB01B were aborted at 1.60m and 1.28m respectively due to presence of concrete obstruction.

4.2.1 Sampling and Testing during Cable Percussion Drilling

Bulk samples were taken at regular intervals in the Made Ground and thereafter at each change in strata. Standard thin wall undisturbed 102mm nominal diameter (UT100) samples were taken using a down-hole sliding hammer in cohesive materials where the strata was deemed to be below a stiffness likely to cause loss of recovery or deformation of the shoe.

Standard Penetration Tests (SPT) were carried out at specified intervals or as otherwise instructed by the Engineer. The resulting SPT "N" blowcount values are presented in the relevant borehole records. Where an SPT using a split spoon sampler was not possible, due to the granular nature of the material, a solid cone was used.

Small, disturbed samples were retrieved from the cutting shoe of the U100 sampler, the SPT split spoon sampler and at intervals specified by the Engineer.

Environmental samples (tubs, jars and vials) were taken for chemical analysis in the Made Ground and where visual or olfactory evidence of contamination was noted or as instructed by the Engineer.

The cable percussion borehole logs are presented in Section 8 of this report.

4.3 Rotary Drilling

2 No. Geobor-S wire line Rotary Borehole (PB01 and PB02) follow on from Cable Percussion boreholes (3.30m and 8.00m respectively) were drilled to a maximum depth of 55.30m using Massenza MI8 track mounted rig with water and polymer flush as required.

The Geobor-S borehole was drilled using "PCD" sized 146mm diameter equipment and water/polymer flush. Near-continuous samples were recovered in core runs nominally 1.50m long within plastic liners, sealed at each end after recovery and stored in wooden core boxes. The liners were transported to the Concept's laboratory for logging.

The rotary borehole log is presented in Section 8 in combination with the cable percussion borehole logs.

4.3.1 Sampling and Testing during Rotary Drilling

The core liners were opened, logged and photographed in detail. Selected sub-samples of core were taken at various intervals. The sub-cores were wrapped in layers of hessian and polythene.

4.4 Dynamic Sampling and Hand Held Boreholes

13 No. Dynamic Sampling Boreholes (WS02-WS23) were carried out internally within the properties to a maximum of depth of 6.00m using a modular drive-tube sampling rig which was carried into the buildings and rebuilt at the exploratory hole locations.

2 No. Hand Held Boreholes (WS01 and WS09) were carried out to a maximum depth of 1.40m below slab level using a hand held sampler rig, due to further space restrictions.

All concrete slabs were diamond cored and hand excavated inspection pits were carried out to 1.20m depth prior to boring commencing.

Boreholes WS01, WS02, WS04, WS05, WS06, WS08, WS09, WS13, WS15, WS22 and WS23 were aborted at various depth due to refusals.

Semi-rigid plastic core liners were recovered from each borehole location. The excavated soil was logged and plastic tubs, borosilicate jars and vial samples were collected for chemical analysis. Bulk samples were also retrieved for soils analysis.

The borehole logs are presented in Section 9 of this report.

4.5 Hand Excavated Trial Pits

25 No Trial Pits (refer to Tables 1, 2 and 3) were hand excavated to a maximum depth of 2.15m to investigate and identify the extent of the footing of the buildings and additionally in TPG1-6 to locate services existing services.

The trial pit sketches are presented in Section 10 of this report.

4.6 Standpipe Installations

Monitoring wells and vibrating wire piezometers with flush stopcock covers were installed in the boreholes as follows

Table 4 – Monitoring Installation Details

	Diameter of Installation	Type of Installation	Base of Borehole (m bgl)	Top RZ (m bgl)	Bottom RZ (m bgl)
PB01		VW	55.30		9.00
		VW			17.00
		VW			22.00
		VW			30.00
PB02	50mm	SPGW	55.20	2.00	8.00
PB04	50mm	SPG/GW	30.35	2.00	6.00
PB05	50mm	SPG/GW	30.00	2.00	6.00

SPGW – Groundwater standpipe
 SPG/GW – Gas and Groundwater standpipe
 VW – Vibrated Wire Piezometer
 RZ – Response Zone

The boreholes were backfilled with bentonite pellets with groundwater response zones backfilled with a 10mm pea shingle filter with a geosock surround. Where vibrating wires were installed, the boreholes were backfilled with cement / bentonite grout mix at 3.5:1:1 ratio (water:cement:bentonite). All installations were finished with concrete and a lockable stopcock covers flush with the ground.

4.7 Instrumentation Monitoring

Groundwater and vibrating wire piezometer monitoring and sampling was been carried out by Concept subsequent to completion of the site works. Historic boreholes (BH01, BH02 and BH03) were also monitored.

Ground water in the standpipes was monitored using an In-Situ Rugged interphase dipmeter and the gas concentrations were recorded using a Gas data GFM436 gas monitor. The accuracy of the instrument is summarised in Section 11 where the gas monitoring reports and groundwater results are presented.

The VW installations in PB01 were monitored using Rst DT2055-B data loggers. The raw data have been issued under separate cover and are not included in this report

4.8 Logging / Laboratory Testing

Logging of all soil samples was carried out in accordance with BS 5930:1999 incorporating Amendment No.2 (Aug '10).

Geotechnical testing is performed at Concept Site Investigations laboratory in accordance with BS1377:1990 unless otherwise stated in the report. Concept is accredited by UKAS for tests where the UKAS logo is appended to the individual test report or summary. Approved signatories for laboratory testing are as follows:

- AB – Alan Bates (Quality Manager)

- KM – Kasia Mazerant (Laboratory Manager)

Where subcontracted analysis has been carried out, the details of the laboratory (and accreditation where applicable) are shown in the individual test report or summary.

The results are presented in tabular format in Section 12 of this report.

All chemical testing was specified was carried out by Analytical I2 in accordance with the requirements of UKAS ISO17025 and MCERTS. The results are presented in tabular format in Section 13 of this report.

4.9 Setting Out

The locations of all exploratory holes were agreed with the Engineer and set out prior to commencement of the site works.

The co-ordinates and levels of the as-built locations of the boreholes are shown in the Exploratory Hole Location Plan presented in Section 7 of this report

5. GEOLOGICAL GROUND PROFILE

The geological strata encountered during the investigation are summarised in the table below. The Top and Bottom of the strata noted in the table indicates the highest and lowest boundaries encountered in the boreholes.

Table 5 - Geological Ground Profile

STRATUM	TOP (mbgl)	BASE (mbgl)	DESCRIPTION
Made Ground	0.00	5.00	Asphalt and concrete over brown clayey sandy angular to subrounded fine to coarse GRAVEL comprising flint, nails, plastic, brick and concrete fragments and occasional cobble sized brick and concrete fragments. Sand is fine to coarse.
River Terrace Deposits	0.20	7.00	Medium dense, brown fine to coarse SAND and angular to subrounded fine to coarse GRAVEL comprising flint and sandstone fragments.
London Clay	2.10	30.35	Stiff, extremely closely to very closely fissured greyish brown slightly sandy slightly micaceous CLAY with occasional bioturbation
Lambeth Group	29.50	48.70	Very stiff to hard, brown mottled bluish grey CLAY and dense light grey slightly clayey fine SAND.
Thanet Sand Formation	48.50	52.25	Dense, grey silty fine SAND and dark grey to black angular to subrounded fine to coarse rinded flint GRAVEL with rare traces of glauconitic fine sand.
Chalk	52.10	55.30	Weak to moderately weak, medium to high density off-white CHALK and structureless CHALK composed of slightly sandy silty GRAVEL with rare dark grey staining and rare dark grey flecks. <i>(encountered in PB01 and PB02)</i>

REFERENCES

British Standards Institution, (1999) Code of practice for site investigations, British Standard BS 5930: 1999 incorporating Amendment No.2 (Aug '10), BSI, London

British Standards Institution, (2011) Investigation of potentially contaminated sites, British Standard BS10175: 2011, BSI, London.

UK Specification for Ground Investigation, (2011) Site Investigation Steering Group, Thomas Telford, London


British Geological Survey (1996) London and the Thames Valley 4th Edition, London HMSO

British Standards Institution BS EN ISO 22475-1, (2006) Geotechnical Investigation and Testing – Sampling Methods and Groundwater Measurements – Part 1: Technical Principles for Execution

British Standards Institution BS EN 1997:1 (2004). EuroCode 7 - Geotechnical Design. Part 1 – General Rules.

British Standards Institution BS EN 1997:2 (2007). EuroCode 7 - Geotechnical Design. Part 2 - Ground Investigation and Testing.

6. SITE LOCATION PLAN

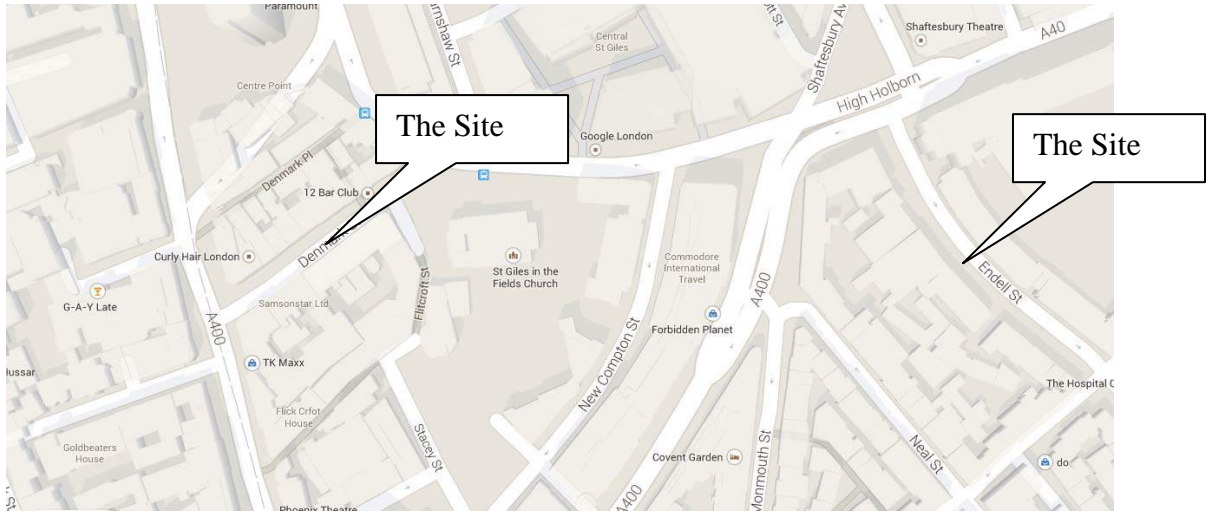

Not to Scale © Crown Copyright reserved