

IRONMONGERY INDEX

REF :	HINGES	А
A1 A2	1 1/2 pairs of 102 x 76mm plain ball bearing hinges 3 pairs of 102 x 76mm plain ball bearing hinges	
REF :	LOCKS	В
B1 B2	<i>Mortice lock 5 lever mortice deadlock for rebated meeting styles</i>	
REF :	LATCHES	С
C1	Mortice latch	
REF :	FURNITURE	D
D1 D2	Lever suite with backplate / rose Lever suite with backplate / rose & escutcheons	
REF :	BOLTS	E
E1 E2	150mm flush bolts (two per slave leaf) Emergency push panic bar with vertical bolt	
REF :	CLOSERS	F
F1	Overhead door closer (one per leaf)	
REF :	MISCELLANEOUS	G
G1	FIRE DOOR - KEEP LOCKED sign affixed at eve level	

FIRE DOOR - KEEP LOCKED sign affixed at eye level G1

WINDOW & DOOR SCHEDULE


DOOR No	LOCATION	STRUCTURAL OPENINGS W x H	NOTES
EGD01	STORE	1000 x 2025	
EGD02	STORE	1000 x 2025	
EGD03	VIEWING AREA	1000 x 2100	
EGD04	VIEWING AREA	1000 x 2100	
W01	VIEWING AREA	1000 x 2100	
W02	VIEWING AREA	1000 x 2100	

# INTERNAL DOOR SCHEDULE

DOR	LOCATION	DOOR TYPE	DOOR SIZE	STRUCTURAL OPENING	HINGES	LOCKS	LATCHES	FURNITURE	BOLTS	CLOSERS	
GF	ROUND FLOOR										
D1	STORE CUPBOARD	II <b>O</b>	2 x 762 x 1981	1610 x 2040	A2	B2	C1	D2	E1		
D2	STORE CUPBOARD	II <b>O</b>	2 x 762 x 1981	1610 x 2040	A2	B2	C1	D2	E1		
D3	STORE CUPBOARD	II <b>O</b>	2 x 762 x 1981	1610 x 2040	A2	B2	C1	D2	E1		
D4	STORE CUPBOARD	II <b>O</b>	2 x 838 x 1981	1760 x 2040	A2	B2	C1	D2	E1		
D5	SQUASH COURT	I	BY SPECIALIST	BY SPECIALIST	IRONMONGERY BY SPECIALIST SQUASH COURT SUBCONTRACTOR					OR	
D6	SQUASH COURT	I	BY SPECIALIST	BY SPECIALIST	IRONM	IRONMONGERY BY SPECIALIST SQUASH COURT SUBCONTRACTOR					
EGD01	STORE ACCESS		TO SUIT FRAME	1000 x 2025	A1				E2		
EGD02	STORE ACCESS		TO SUIT FRAME	1000 x 2025	A1				E2		
EGD03	FIRE EXIT		TO SUIT FRAME	1000 x 2100	A1				E2		
EGD04	FIRE EXIT		TO SUIT FRAME	1000 x 2100	A1				E2		



Size by specialist Glass door into squash courts in accordance with approved specialist subcontractor specification



0

WINDOW NOTES \* All widths and heights are structural openings sizes - viewed externally site by window manufacturer

W01 & W02

2 x 762 / 838 x 1981 x 44mm 44mm thick solid cored flush doors, lipped on two long edges with rebated meeting stiles 10mm wide recessed intumescent strips to sides & head of doors


FD 30S half hour fire resisting door

\* Internally fitted glazing. Average U value of all windows & doors not to exceed 1.6 W/m<sup>2°</sup>C \* Silicone sealant applied to perimeter of frame, sealing gap between brickwork and frame

\* Structural opening sizes are to be checked on

\* All windows fitted with controllable & secure 4000mm<sup>2</sup> background trickle ventilators

# IRONMONGERY SCHEDULE



44mm thick solid cored flush doors with external quality plywood face and lipped on all edges

INTERNAL DOOR LININGS

Door frames or minimum 34mm thick hardwood linings with 13 x 35mm hardwood door stops Softwood architraves to specification

All linings/frames fixed to sub-construction at maximum 600mm centres


For door swings see floor layout plans. All door frames/linings to be finished in accordance with specification

hinges, stays and fasteners with locking facility and restrictor. Average U value of all windows, & doors not to exceed 1.6 W/m<sup>2°</sup>C. Compriband 600 or equivalent compressible seal around perimeter of frames, in accordance with manufacturers requirements to seal gap between structure and frame. All widths and heights are structural openings sizes.

## GLAZING

All to be double glazed units, soft coated glass with argon gas fill by specialist manufacturer. All glass to comply with BS 6206 and BS 952. All glazing below 800mm above finished floor levels to be laminated or toughened safety glass to BS 6262, and to a height of 1500mm, and at least 300mm either side of door openings. Obscured glazing to be agreed.



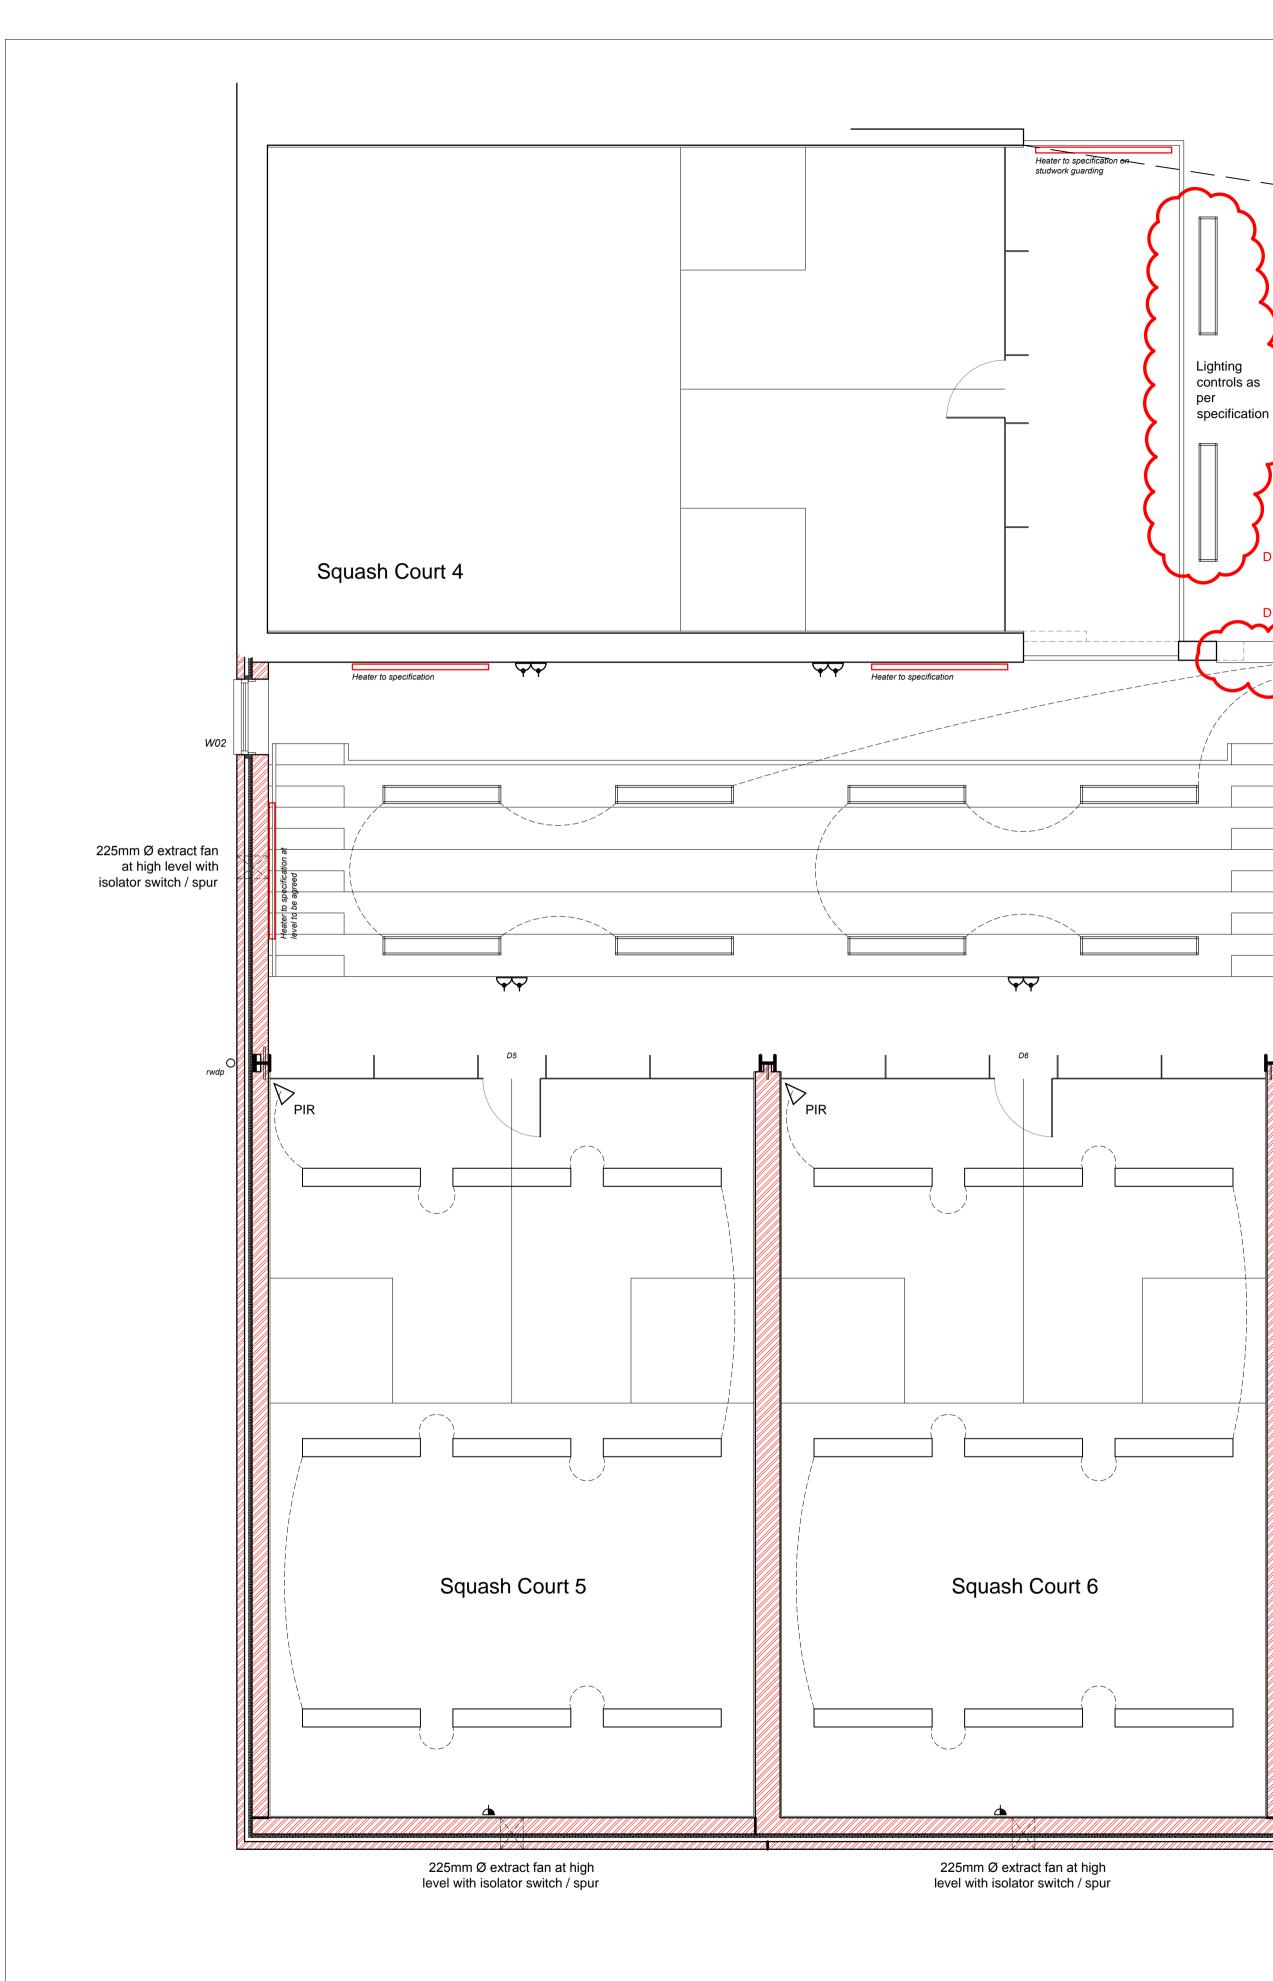

MECHANICAL / ELECTRICAL LAYOUT PLAN

225mm Ø extract fan at high level with isolator switch / spur

## ROOF CONSTRUCTION Flat Warm Roof

SARNAFIL roof membrane laid and fixed in accordance with manufacturer's specification on TYVEK® Proclad or equivalent SARNAFIL approved breather & drainage membrane over CELOTEX TD4126 warm roof deck construction on vapour barrier over 22mm Flooring grade P5 moisture resistant chipboard to BS EN 312 over softwood treated flat roof joists to structural engineers design and set to falls of 1 in 60. Warm roof deck construction to comply with manufacturer's instructions / recommendations. SARNAFIL roof membrane dressed up parapet walls with powder coated aluminium profiled coping. 12.5mm Gyproc WallBoard ceiling with taped joints and Thistle Multi-Finish skim over.

## RAINWATER DRAINAGE

New 200mm wide purpose made valley gutter as detail with internal insulated outlet to specification one end and a chute outlet into external hopper at the other. Existing valley gutter modified where passing through wall and fitted with new insulated outlet to specification. Connect new and existing outlets to 110mm Ø PVCu downpipes internally and hang to fall as indicated on drawings - in accordance with manufacturers instructions. Underground drainage as per drawings - connected into new soakaway at least 5m away from any building - layout to full local authority approval. Provide lintels over any exposed existing drains where they pass through walls, and fix flexible joints to pipes either side of wall. Encase in 150mm of concrete where passing under oversite slabs. Down pipes taken into 110mm diameter underground drainage to falls of 1 in 60, laid on 150mm pea shingle base, with 150mm pea shingle encasement and 300mm well compacted cover.

## SPACE HEATING


## As per specification - see drawings for locations.


**OPERATING & MAINTENANCE INSTRUCTIONS** FOR HEATING & HOT WATER SYSTEMS

Provide a suitable set of operating and maintenance instructions. These instructions must directly relate to the system installed, and should explain how to operate the systems so as to perform efficiently, together with what routine maintenance is advisable.


## COMMISSIONING OF HEATING AND HOT WATER SYSTEM

Heating and hot water systems to be inspected upon completion of installation to ensure that the approved provisions for efficient operation are achieved, in accordance with Part L2 of the Building Regulations 2002. Commissioning of the system includes testing and adjusting repetitively in order to achieve the specified performance, calibration, setting up and testing of the associated automatic control systems, and recording of the system settings and the performance test results. A commissioning certificate is to be obtained from the approved qualified person responsible for achieving compliance with the requirements in Part L2. This certificate is to be made available to the client and Local Authority Building Control.

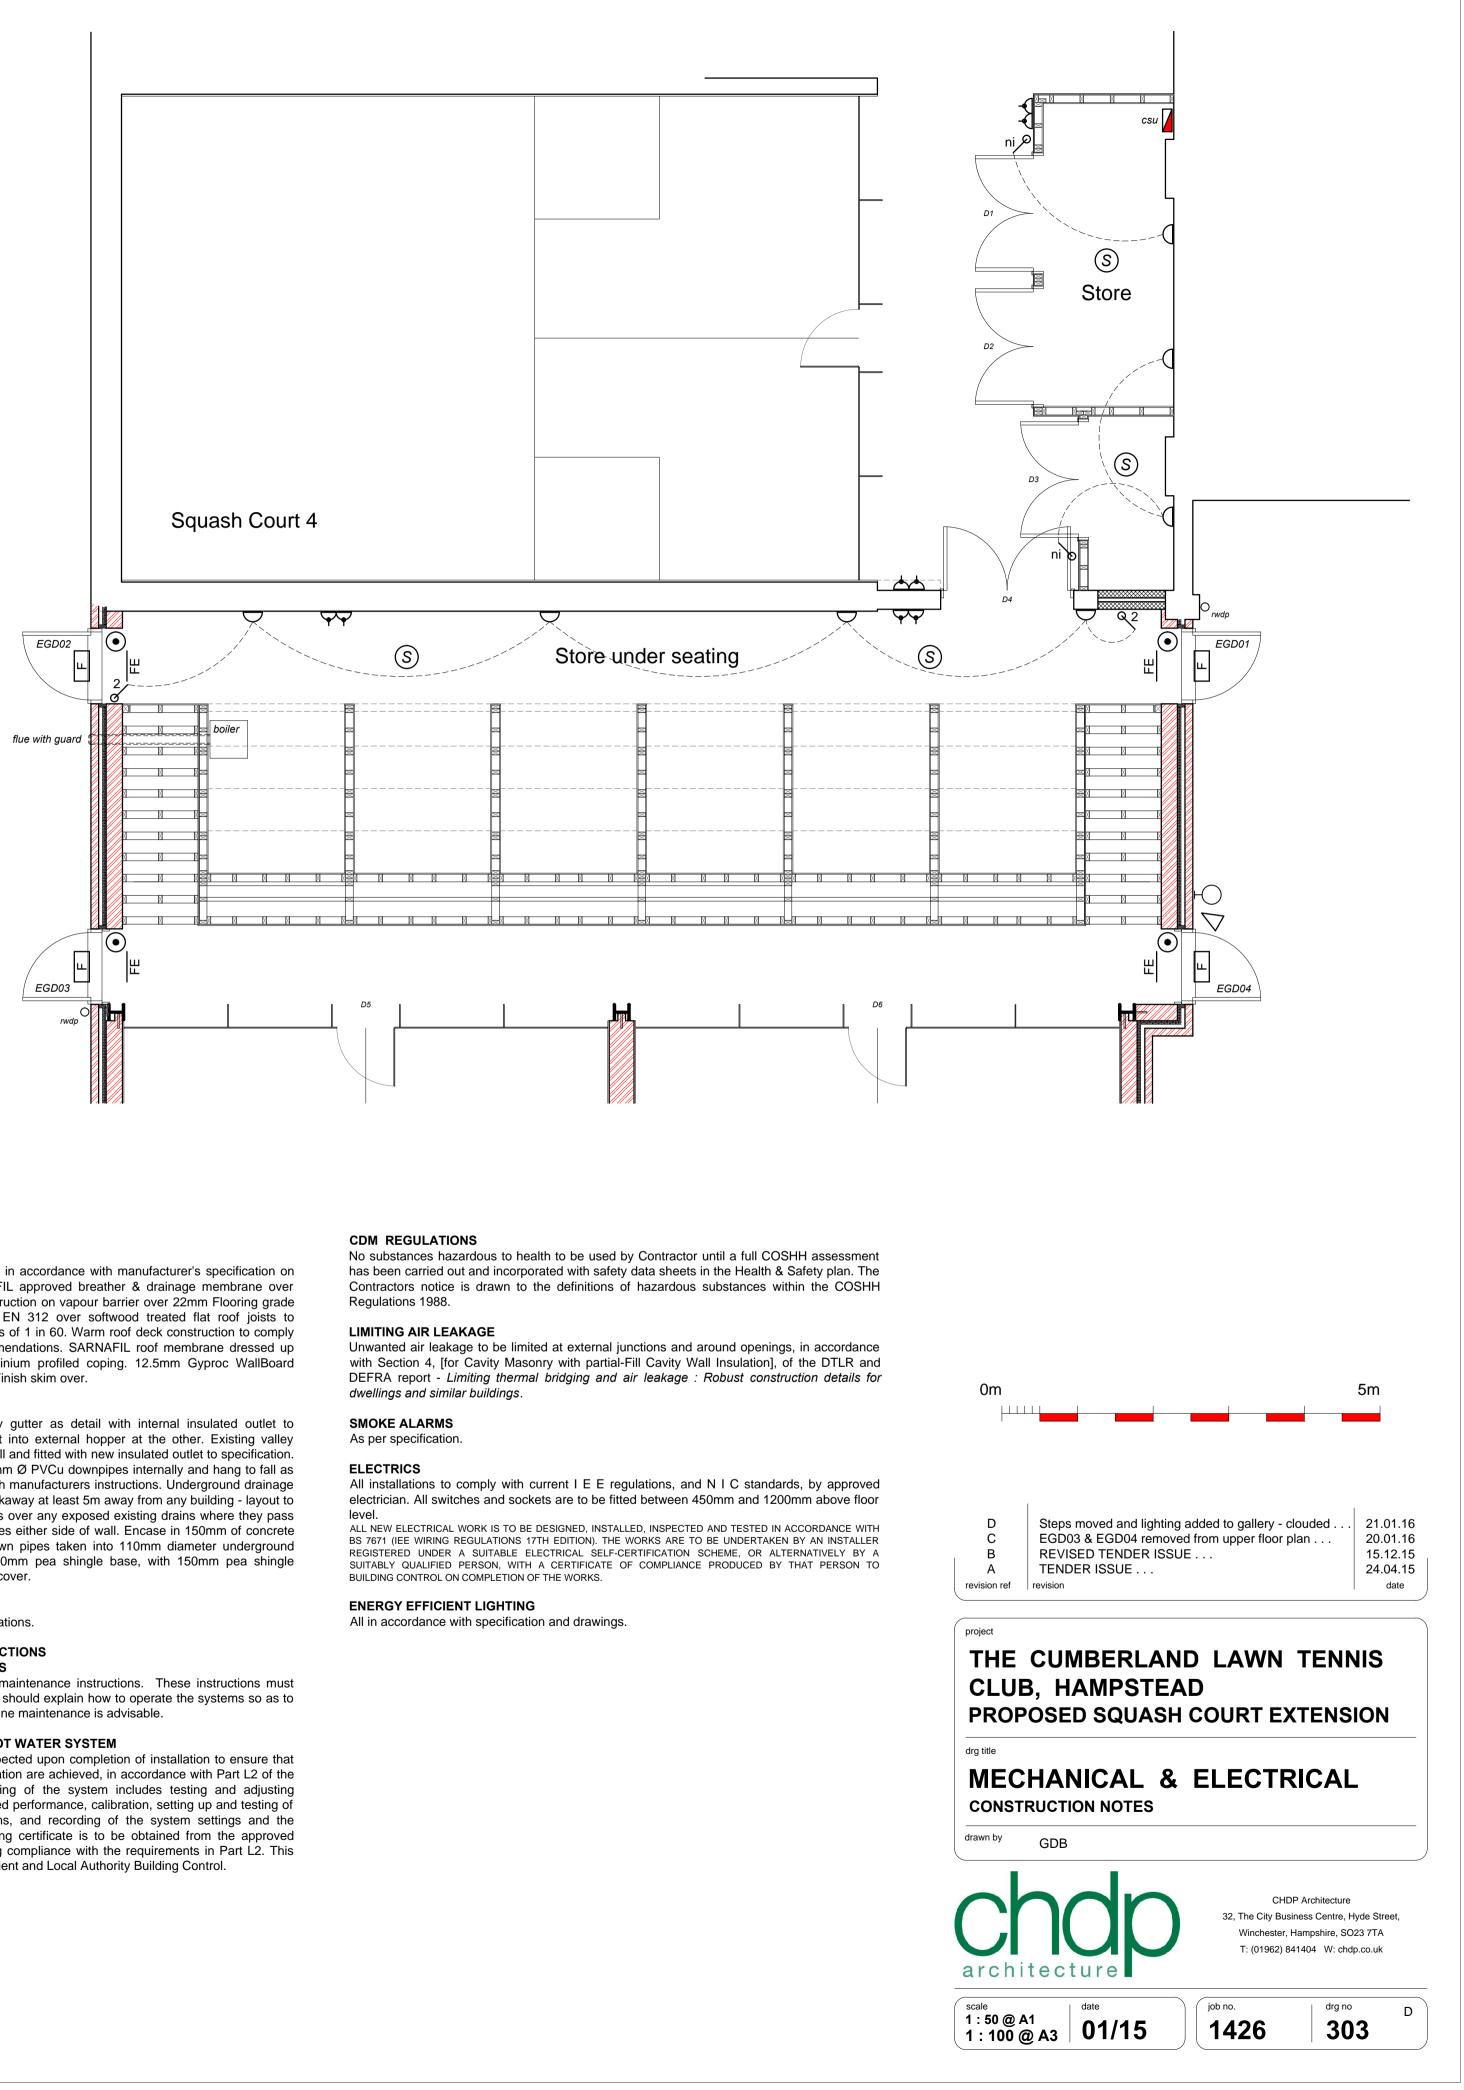

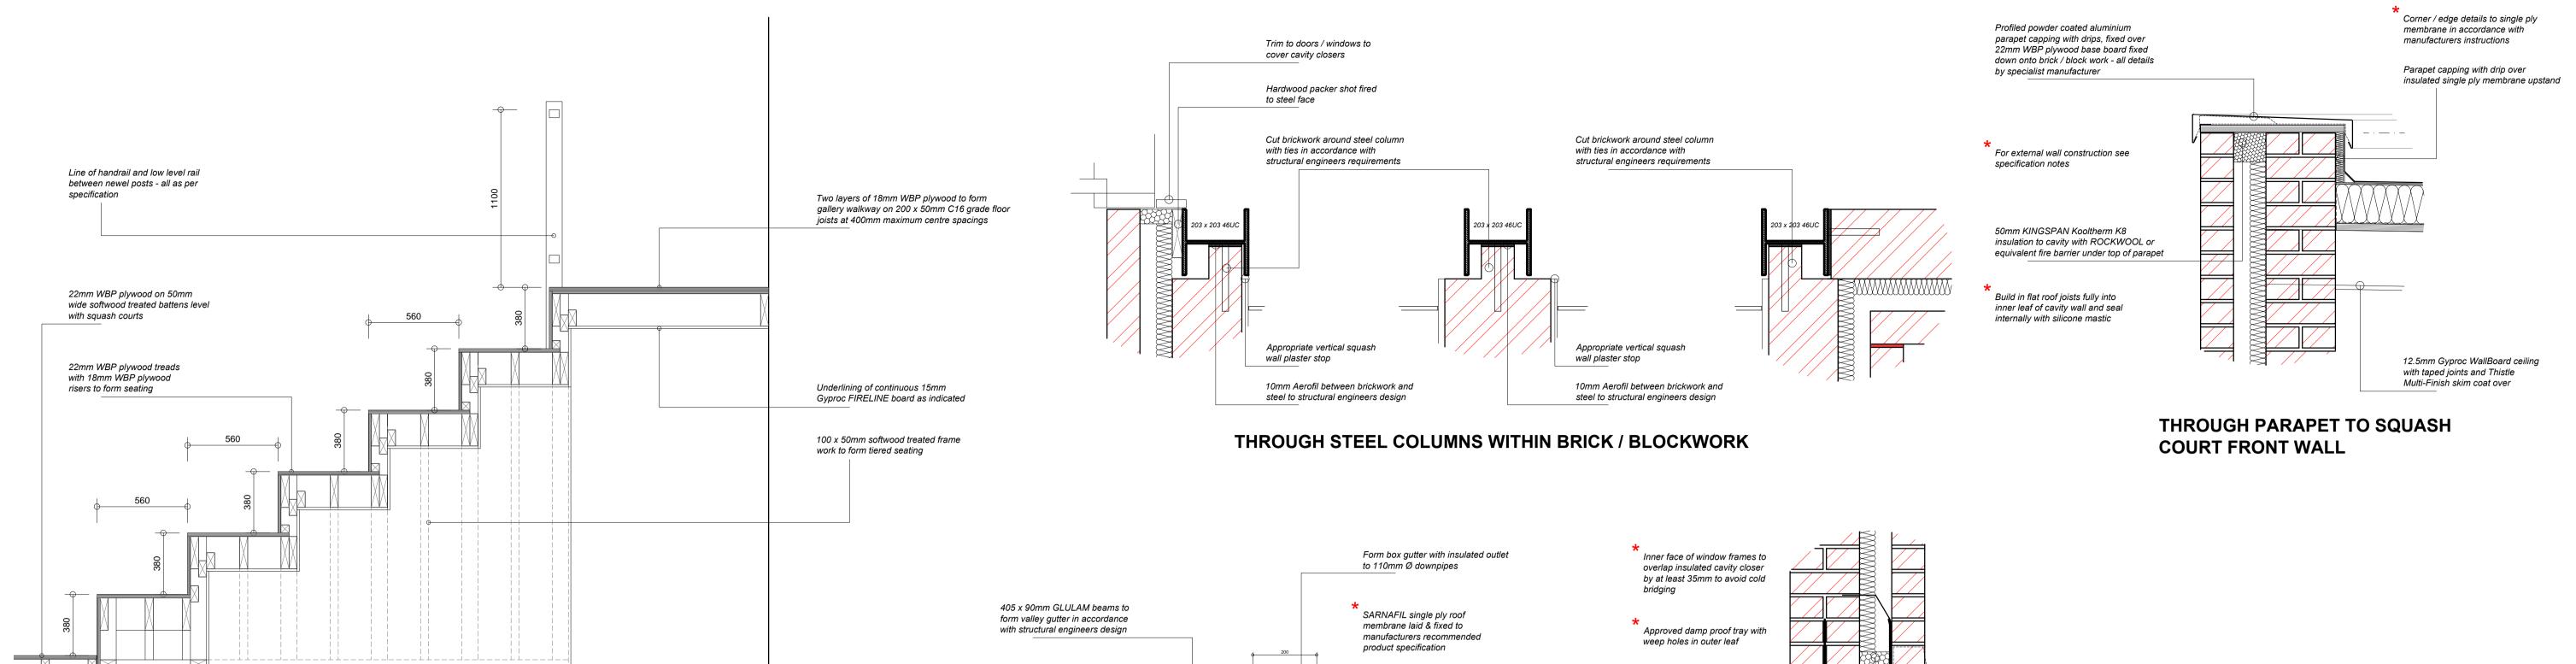


THROUGH TIERED SEATING

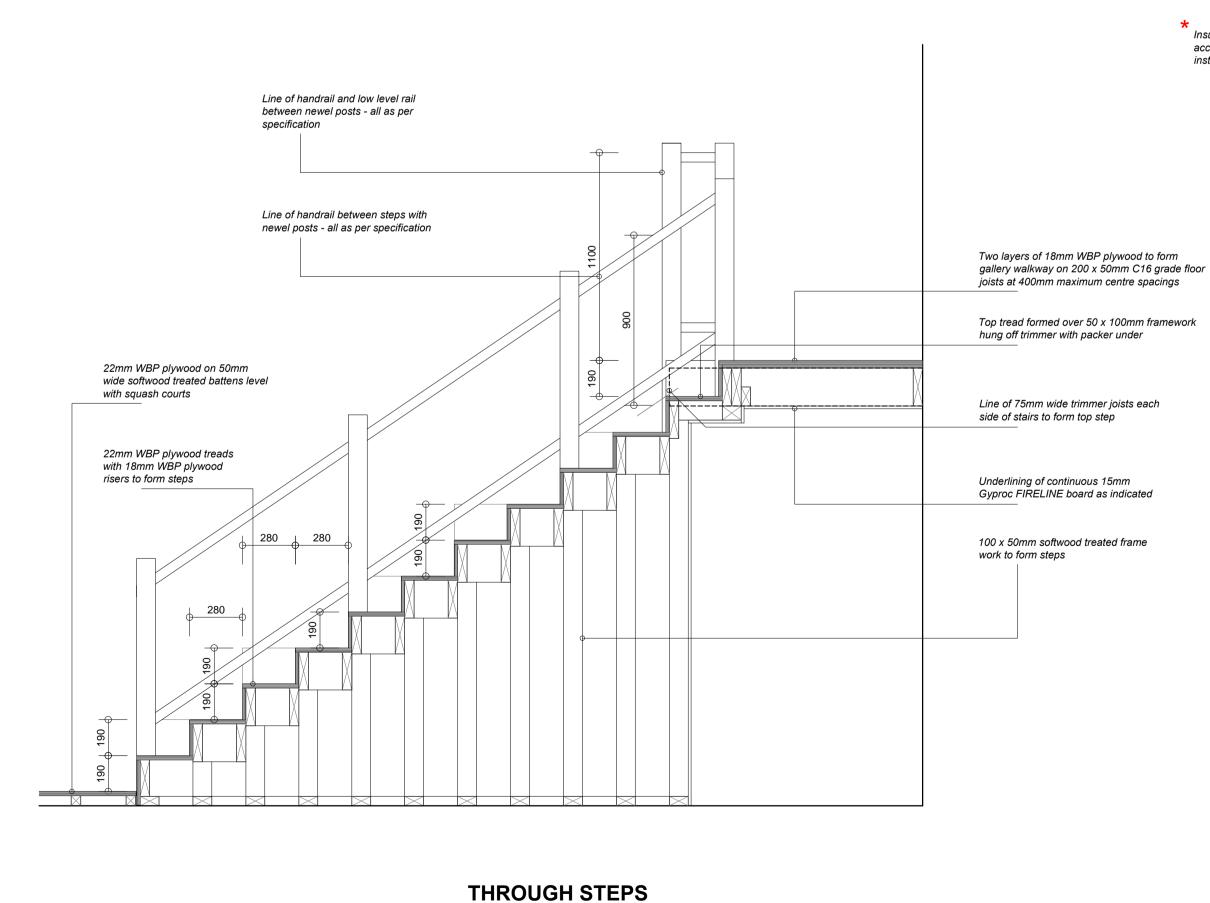


10m SCALE 1:20

0m

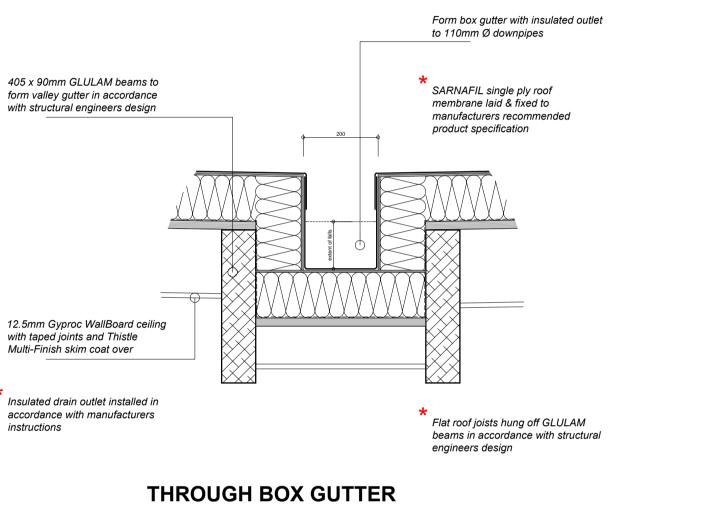

BBA approved cavity damp proof trays

over air bricks with periscope vents ventilating underfloor void

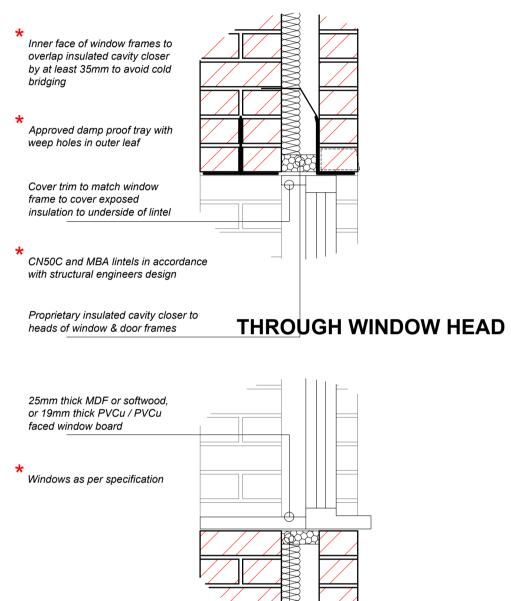

Proprietary insulated cavity closers to jambs and cills of window & door frames

## **THROUGH WINDOW CILL**

