

SITE INVESTIGATION FACTUAL REPORT

Report No: 246035
Client: Cunningham Lindsey - Maidstone
Site: 57, Aberdare Gardens
London
Client Ref: 7851572-Aberdare Gardens Ltd
Date of Visit: 13/01/2015



Home Emergency Response - Subsidence Investigation - Drainage Services – Crack & Level Monitoring – Property Video Surveys

Unit E2 First Floor Suite, Boundary Court
Willow Farm Business Park, Castle Donington
Leicestershire, DE74 2NN

☎ 0843 2272362
✉ enquiries@cet-uk.com
🌐 www.cet-uk.com

CET is the trading name of CET Structures Ltd
Registered in England No. 02527130

Investigation Layout Plan


Sheet: 1 of 1
Job No: 246035E
Date: 13/01/2015

Site: 57 Aberdare Gardens, NW6 3AL

SP (SI) MD/SE (Checked) AR (Drawn)

Weather: DRY

Work carried out for: Cunningham Lindsey

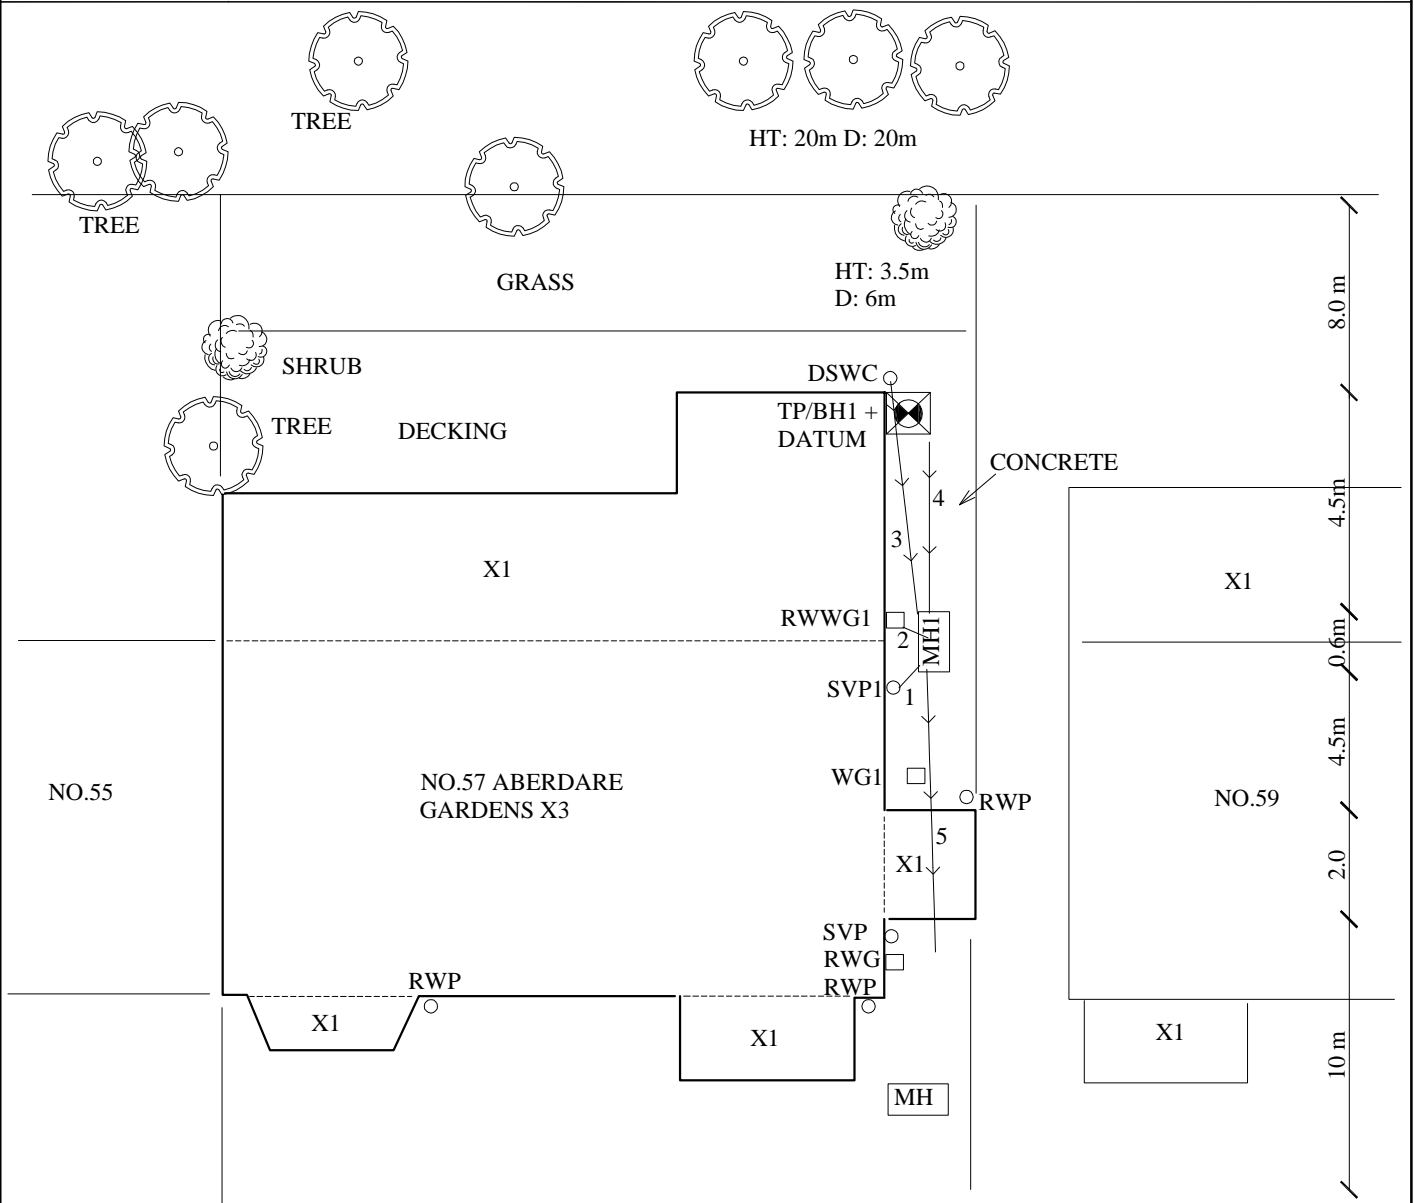

ON SITE TREE IDENTIFICATION FOR GUIDANCE ONLY. NOT AUTHENTICATED.

Remarks:

Parking - onsite.
Water supply - in house.
Site access - good.
Power - internal

Key:

- Combined Gully RWWG
- Manhole MH
- Rain Water Pipe RWP
- Rain Water Gully RWG
- Soil Vent Pipe SVP
- Waste Gully WG
- Waste Pipe WP

Surface Water Drain

Foul Water Drain


Tree / Bush

(approx. ht in m)

Trial Pit


Borehole

O/D - Open Discharge



Scale: N.T.S.

Trial Pit No: 1	Sheet: 1 of 1	Site: 57 Aberdare Gardens, London NW6
	Job No: 246035E	
Excavation Method: Hand Tools	Date: 13/01/15	Work carried out for: Cunningham Lindsey
Weather: DRY	Drawn by: DVC Ground Level mOD:	

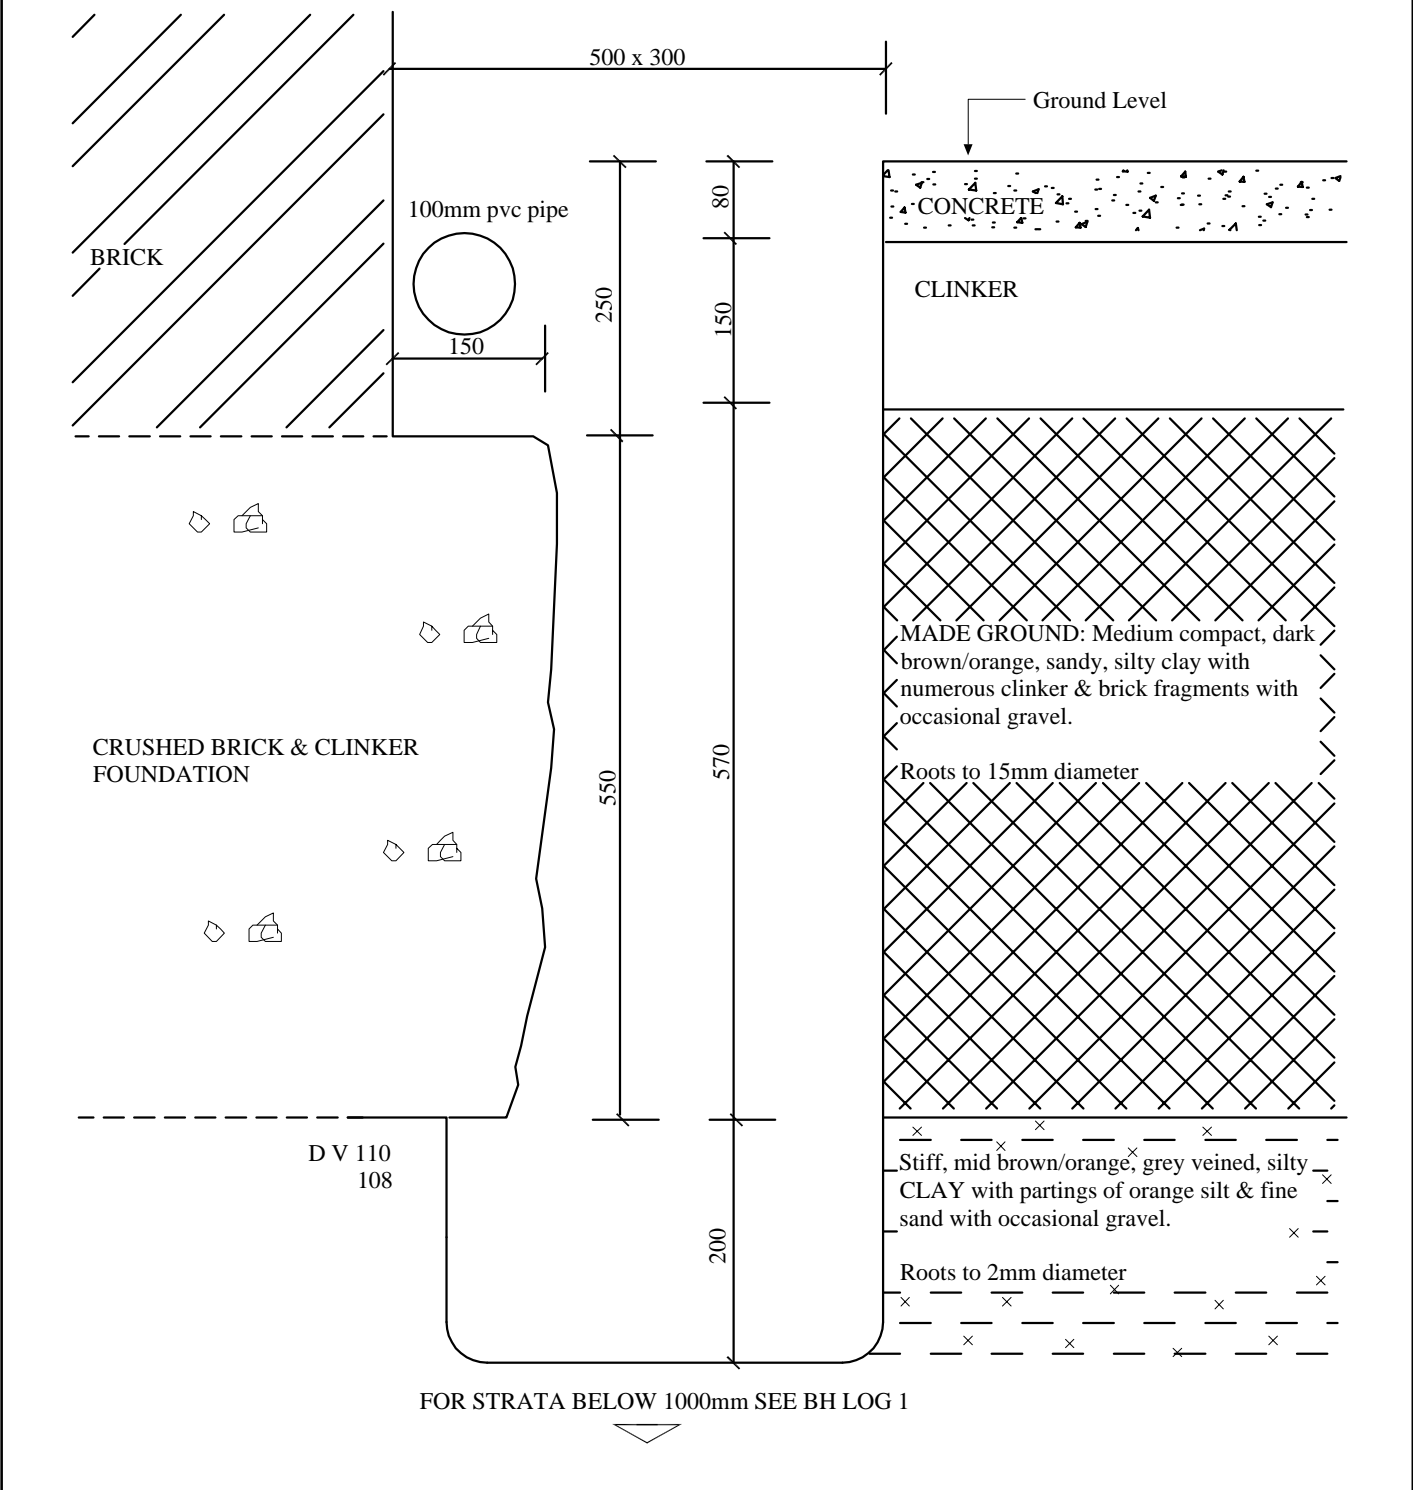

Remarks: All measurements in millimetres.	Key: D Small disturbed sample J Jar sample B Bulk disturbed sample V Pilcon Vane (kPa) W Water sample M Mackintosh probe TDTD Too dense to drive
Logged: SP	Checked: SE
Approved:	Scale: N.T.S.

Borehole No: 1 & Datum		Sheet: 1 of 1			Site: 57 Aberdare Gardens, London NW6					
Boring Method: Hand Auger		Job No: 246035E			Date: 13.01.15					
Diameter: 80mm		Coordinates:			Ground Level mOD:			Work Carried out for: Cunningham Lindsey		
Depth (m)	Description of Strata	Thickness (m)	Legend	Sample	Test Type	Test Result	Depth (m)	Field Records/Comments	Depth to water (m)	
1.00	As Trial Pit 1	1.00						Roots to 1mm diameter to 1.8m		
1.50	Stiff, mid brown/orange, grey veined, silty CLAY with partings of orange silt & fine sand with occasional gravel.	0.50	___x ____ ____	D	V	122 116	1.50			
2.50	Stiff, as above, with occasional carbon deposits.	1.00	___x ____ ____ x____ ____	D	V	128 130	2.00	No roots observed below 1.8m		
3.50	Stiff, mid brown/orange, grey veined, silty CLAY with partings of orange silt & fine sand & occasional crystals.	1.00	___x ____ ____ x____ ____	D	V	132 126	2.50			
5.00	Very stiff, mid brown/orange, grey veined, silty CLAY with partings of orange silt & fine sand with occasional crystals.	1.50	___x ____ ____ x____ ____ ____ ___x. ____ ___x	D	V	140+ 140+	3.00			
5.00	Borehole ends at 5m				D	V	140+ 140+	4.00		
					D	V	140+ 140+	4.50		
					D	V	140+ 140+	5.00		
Remarks: Borehole dry and open on completion. Datum installed at 5m					Key: T.D.T.D. Too Dense to Drive D Small disturbed sample J Jar sample B Bulk disturbed sample V Pilcon Vane (kPa) W Water sample M Mackintosh Probe					
Logged: SP	Checked: SE	Typed by: DVC			Scale: NTS		Weather: DRY			

Our Ref : 246035

Laboratory Testing Results

Date Sampled: 13/01/2015

Location : 57, Aberdare Gardens, NW6

Date Received : 14/01/2015

Work carried out for: Cunningham Lindsey - Maidstone

Date Tested : 14/01/2015

Date of Report : 22/01/2015

Sample Ref		Type	Moisture Content (%) [1]	Soil Fraction > 0.425mm (%) [2]	Liquid Limit (%) [3]	Plastic Limit (%) [4]	Plasticity Index (%) [5]	Liquidity Index [5]	Modified Plasticity Index (%) [6]	Soil Class [7]	Filter Paper Contact Time (h) [8]	Soil Sample Suction (kPa)	In situ Shear Vane Strength (kPa) [9]	Organic Content (%) [10]	pH Value [11]	Sulphate Content (g/l)		Class [14]
TP/BH No	Depth (m)															SO ₃ [12]	SO ₄ [13]	
1	0.80(U/S)	D	37	<5	78	30	48	0.15	48	CV	168	146	109					
	1.5	D	35	<5									119					
	2.0	D	33	<5	85	29	56	0.06	56	CV	168	257	129					
	2.5	D	32	<5	79	28	51	0.07	51	CV	168	325	129					
	3.0	D	34	<5									119					
	3.5	D	34	<5	81	30	51	0.09	51	CV	168	292	> 140					
	4.0	D	31	<5									> 140					
	4.5	D	35	<5								168	308	> 140				
	5.0	D	31	<5								168	375	> 140				

Test Methods / Notes

- [1] BS 1377 : Part 2 : 1990, Test No 3.2
- [2] Estimated if <5%, otherwise measured
- [3] BS 1377 : Part 2 : 1990, Test No 4.4
- [4] BS 1377 : Part 2 : 1990, Test No 5.3
- [5] BS 1377 : Part 2 : 1990, Test No 5.4
- [6] BRE Digest 240 : 1993
- [7] BS 5930 : 1981 : Figure 31 - Plasticity Chart for the classification of fine soils
- [8] In-house method S9a adapted from BRE IP 4/93

[9] Values of shear strength were determined in situ by CET using

a Picon hand vane or Geonor vane (GV).

[10] BS 1377 : Part 3 : 1990, Test No 4

[11] BS 1377 : Part 2 : 1990, Test No 9

[12] BS 1377 : Part 3 : 1990, Test No 5.6

[13] SO₄ = 1.2 x SO₃

[14] BRE Special Digest One (Concrete in Aggressive Ground) August 2005

Note that if the SO₄ content falls into the DS-4 or DS-5 class, it would be prudent to consider the sample as falling into the DS-4m or DS-5m class respectively unless water soluble magnesium testing is undertaken to prove otherwise

Key

- D Disturbed sample (small)
- B Disturbed sample (bulk)
- U Undisturbed sample
- W Groundwater sample
- ENP Essentially Non-Plastic by inspection
- U/S Underside of Foundation

Our Ref : 246035

Moisture Content and Suction Profiles

Date Sampled : 13/01/2015

Location : 57, Aberdare Gardens, NW6



Date Received : 14/01/2015

Work carried out for: Cunningham Lindsey - Maidstone

Note : Unless specifically noted the profiles have not been related to a site datum.

Date Tested : 14/01/2015

Date of Report : 22/01/2015

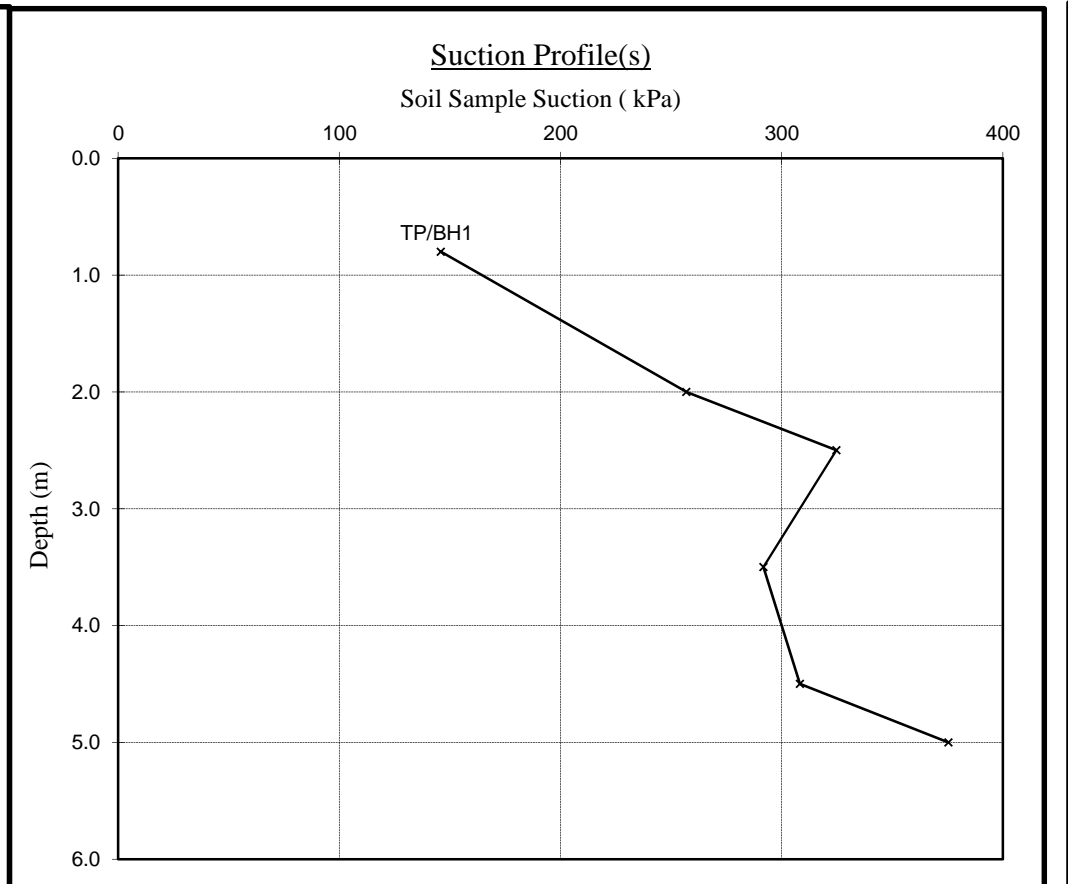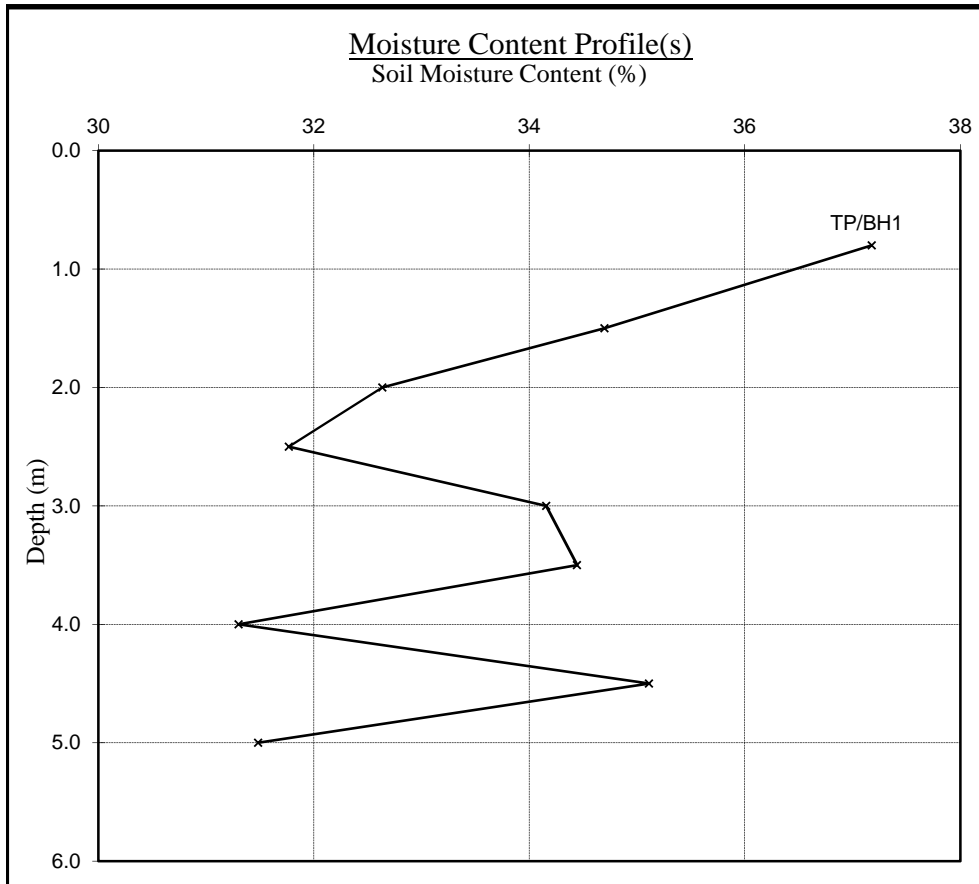

Notes

1. If plotted, 0.4 LL and PL+2 (after Driscoll, 1983) should only be applied to London Clay (and similarly overconsolidated clays) at shallow depths.

Note

When shown, the theoretical equilibrium suction profiles are based on conventional assumptions associated with London Clay (and similarly overconsolidated clays) at shallow depths. Note that the sample disturbance component is dependant on the method of sampling and any subsequent recompaction. The above plots show this to be 100kPa which is the value suggested by the BRE on the basis of their limited number of tests on recompacted samples. This may or may not be appropriate in this instance and judgement should be exercised.

Our Ref : 246035

Moisture Content and Shear Strength Profiles

Date Sampled : 13/01/2015

Location : 57, Aberdare Gardens, NW6



Date Received : 14/01/2015

Work carried out for: Cunningham Lindsey - Maidstone

Note : Unless specifically noted the profiles have not been related to a site datum.

Date Tested : 14/01/2015

Date of Report : 22/01/2015

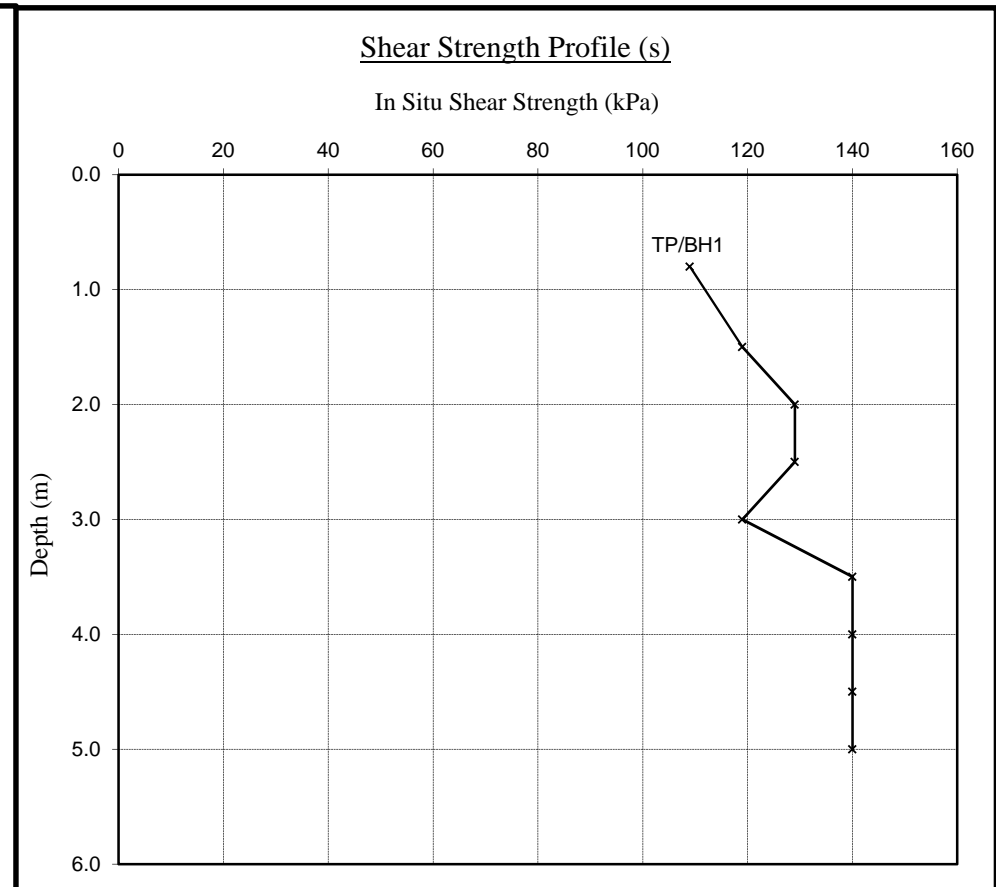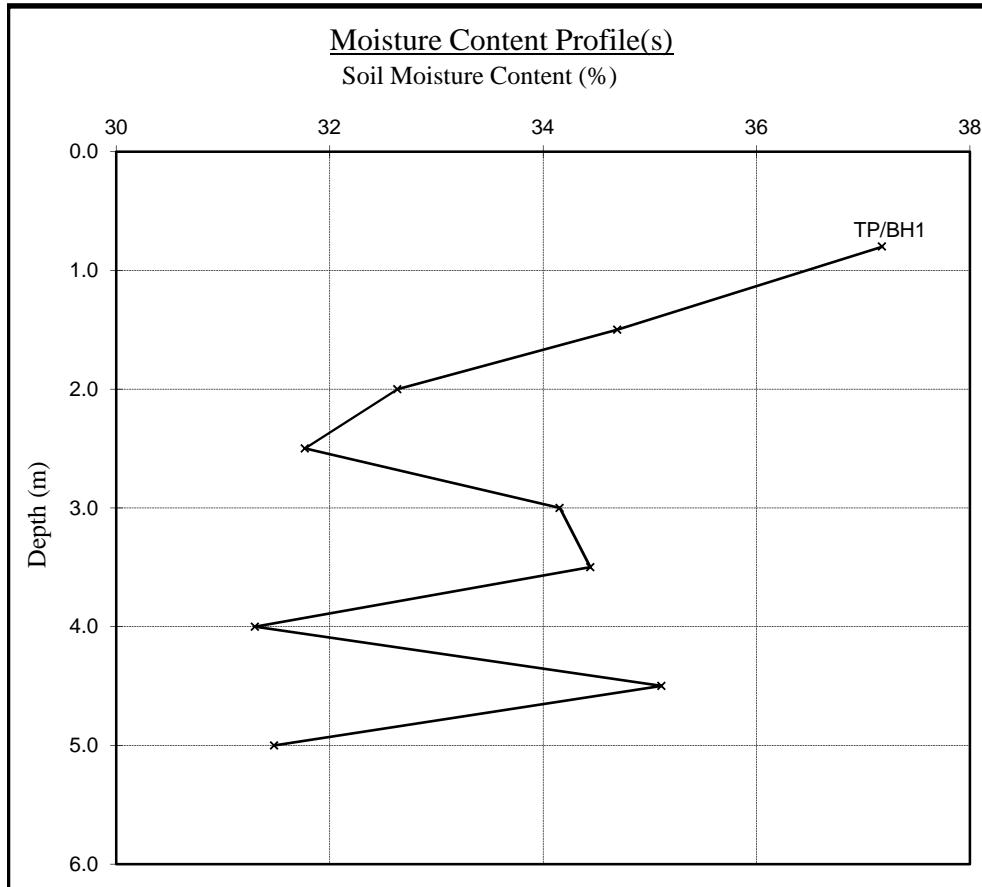

Notes

1. If plotted, 0.4 LL and PL+2 (after Driscoll, 1983) should only be applied to London Clay (and similarly overconsolidated clays) at shallow depths.

Note

Unless otherwise stated, values of Shear Strength were determined in situ by CET using a Pilcon Hand Vane the calibration of which is limited to a maximum reading of 140 kPa.

Our Ref : 246035

Moisture Content and Suction Profiles

Date Sampled : 13/01/2015

Location : 57, Aberdare Gardens, NW6



Date Received : 14/01/2015

Work carried out for: Cunningham Lindsey - Maidstone

Note : Unless specifically noted the profiles have not been related to a site datum.

Date Tested : 14/01/2015

Date of Report : 22/01/2015

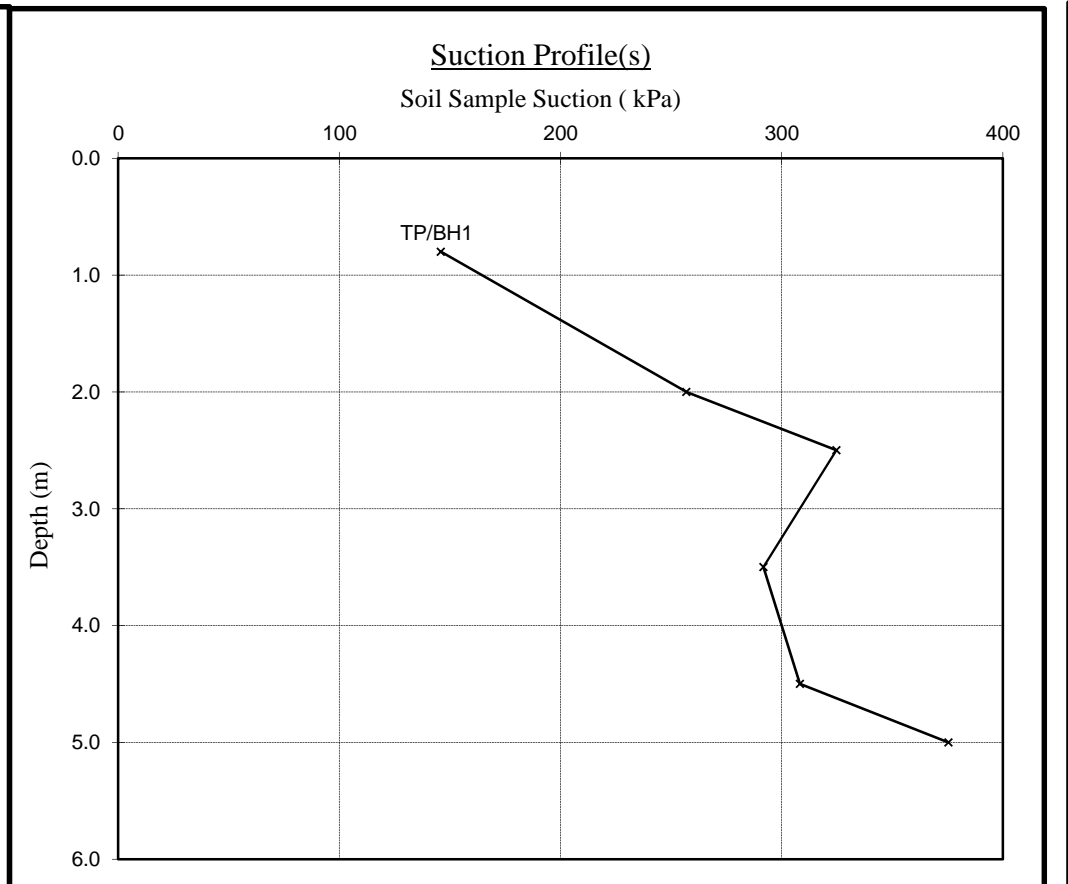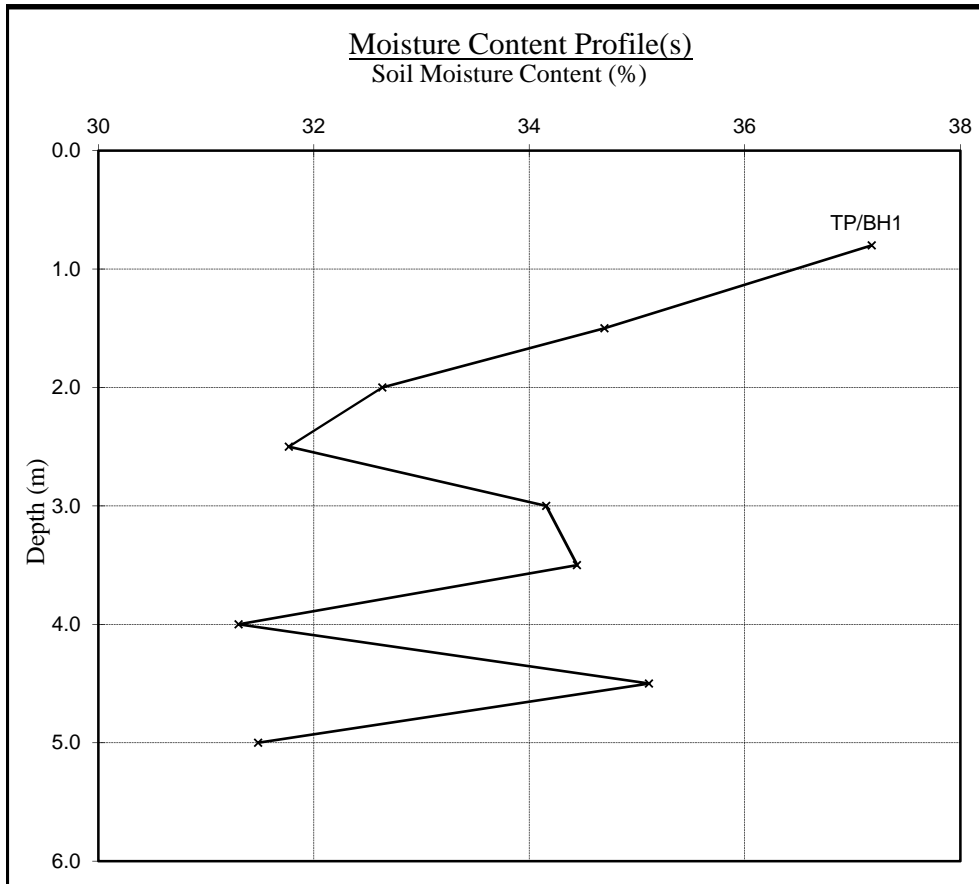

Notes

1. If plotted, 0.4 LL and PL+2 (after Driscoll, 1983) should only be applied to London Clay (and similarly overconsolidated clays) at shallow depths.

Note

When shown, the theoretical equilibrium suction profiles are based on conventional assumptions associated with London Clay (and similarly overconsolidated clays) at shallow depths. Note that the sample disturbance component is dependant on the method of sampling and any subsequent recompaction. The above plots show this to be 100kPa which is the value suggested by the BRE on the basis of their limited number of tests on recompacted samples. This may or may not be appropriate in this instance and judgement should be exercised.

Tree Root Identification Ltd

Sheet: 1 of 1

Job No: 246035
Date: 16/01/2015
Order No: 652024

Our Ref: CET160115

Site: 57 Aberdare Gardens, London.

Work carried
out for: Cunningham Lindsey

Certificate of Analysis


The following work was commissioned by CET on behalf of their client. Root samples were obtained in sealed packets from the above site with no reference given as to the types of tree or shrub from which they may have originated.

The results were as follows -

<u>Trial pit/ Borehole number</u>	<u>Root diameter (mm)</u>	<u>Tree, shrub or climber from which root originates</u>	<u>Result of starch test#</u>
TP1 (underside)	0.5-1.0	<u>Platanus</u> (plane) (1 root)	positive
BH1 (roots to a depth of 1.8m)	thread-like*	too immature to analyse (1 root)	—

The presence of starch indicates that the root was alive in the recent past.

* There were no 1.0mm in diameter roots in this sample.



DR RONALD D MACLEOD
Principal Scientist

Address for correspondence: 'Mandaya', Highfield Place, BANKFOOT, By Perth, PH1 4AX.

Telephone: 01738 787448 / 07582 733 406

e-mail: rdmmacleod@btconnect.com web site: www.treerootidentification.com

Principal Scientist: R.D. MacLeod, B.Sc., Ph.D.,

Accounts/Quality Manager: Fiona M. Sinclair, BA English Studies (Merit)

Registered in Scotland, No. 358068. Registered Office: "Mandaya", Highfield Place, Bankfoot, PH1 4AX.

To: Cunningham Lindsey - Maidstone
4 North Court
South Park Business Village
Armstrong Road
Kent
ME15 6JZ

Our Ref: **246035**
Your Ref: **7851572**
Date: **14-Jan-15**

Ftiao: Yiu-Shan Wong

ESTIMATE

Site:- **57, Aberdare Gardens**

Item		Amount
------	--	--------

	No recommendations required to the private drainage surveyed.	
--	--	--

Notes

Repairs to shared runs and off boundary pipe-work may be the responsibility of the water authority.

Total	£0.00
-------	-------

Condition Grade

A - Structurally sound with no leakage evident.
B - Cracks and fractures observed.
C - Structurally unsound

plus VAT @20%	£0.00
---------------	-------

Total + VAT	£0.00
--------------------	--------------

Quotation is binding only if accepted within 28 days from date of issue and is subject to our Standard Terms and Conditions
The price qualification notes, stated on the drainage solutions schedule of rates, apply to this quotation.
CET Structures Ltd undertakes to return to site free of charge to carry out remedial work to the drainage repairs set out above for a period of 2 months from the date of this invoice. The company standard charge rates will apply to the visit should the work requested be unrelated to the said repairs.

Underground Drainage Report

Sheet: 1 of 2

Site: 57, Aberdare Gardens

Job No: 246035

Work carried out for: Cunningham Lindsey - Maidstone

Date: 13-Jan-15

MANHOLE DETAILS

Manhole	Depth to Invert	Condition
MH1	940mm	As built

CCTV Survey:-

1. Drainage Run:

From manhole 1 run 1 to soil vent pipe 1 - 100mm plastic foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
---------	-------	---------------	---------------------------------

0.0		Start	Concrete
-----	--	-------	----------

0.0	SA	Survey abandoned - unable to put camera into run	
-----	----	--	--

2 Drainage Run:

Break in rain water waste gully 1 run 2 to manhole 1 - 100mm plastic combined - downstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
---------	-------	---------------	---------------------------------

0.0		Start	Concrete
-----	--	-------	----------

0.3	FH	Finish - reached MH1	
-----	----	----------------------	--

3 Drainage Run:

From manhole 1 run 3 to DSWC - 100mm plastic foul water - upstream (not shared) (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
---------	-------	---------------	---------------------------------

0.0		Start	Concrete for 5.3m
-----	--	-------	-------------------

5.3	LU	Line up	then decking for 0.1m
-----	----	---------	-----------------------

5.6	FH	Finish - reached DSWC	
-----	----	-----------------------	--

Water Test Grade:

0 - Unable to fill

1 - Heavy Loss

2 - Medium Loss over 2 minutes

3 - Slow Loss over 5 minutes

4 - No Loss

Underground Drainage Report

Sheet: 2 of 2

Site: 57, Aberdare Gardens

Job No: 246035

Work carried out for: Cunningham Lindsey - Maidstone

Date: 13-Jan-15

4 Drainage Run:

From manhole 1 run 4 to upstream - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete
0.0	DE	Debris 5%	
0.0	MC	Material changes 100mm lined	
4.0	LL	Line left	
4.0	SA	Survey abandoned - unable to push	

5 Drainage Run:

From manhole 1 run 5 to downstream - 100mm clay combined - downstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete 4.1m
4.3	CN	Connection at 12 o'clock 100mm WG1	then under building
7.0	FH	Finish - reached D/S	

- End of Survey -

Our assessment of the drainage system is based on our visual inspection and on information collated at the time of the survey. Where assumptions have been made these are based on our experience and do not constitute any form of guarantee, nor do we guarantee that further deterioration will not occur following this survey. CCTV video records will be stored for a period of 3 months from date of inspection and then destroyed.

Water Test Grade:

- | | |
|--------------------|--------------------------------|
| 0 - Unable to fill | 2 - Medium Loss over 2 minutes |
| 1 - Heavy Loss | 3 - Slow Loss over 5 minutes |
| | 4 - No Loss |

Water Authority Sewer Condition Codes

B Broken pipe at... (or from... to...) o'clock	JN Junction at...o'clock, diameter...mm
BR Branch Major	JX Junction defective at.. o'clock, diameter.. mm
CC Crack circumferential from... to... o'clock	LC Lining of sewer changes/starts/finishes at this point
CL Crack longitudinal @... o'clock	LD Line of sewer deviates down
CM Cracks multiple from... to... o'clock	LL Line of sewer deviates left
CN Connection at... o'clock, diameter... mm	LN Line defect at (or from.. to..) o'clock
CNI Connection at... o'clock, diameter... mm, intrusion... mm	LR Line of sewer deviates right
CU Camera under water	LU Line of sewer deviates up
CX Connection defective at... o'clock	MB Missing bricks at.. (or from.. to..) o'clock
CXI Connection defective at... o'clock, diameter... mm, intrusion... mm	MC Material of sewer changes at this point
D Deformed sewer... %	MH Manhole/node
DB Displaced bricks at (or from.. to..) o'clock	MM Mortar missing medium at.. (or from.. to..) o'clock
DC Dimension of sewer changes at this point	MS Mortar missing surface at.. (or from.. to..) o'clock
DE Debris (non silt/grease)... % cross-sectional loss	MT Mortar missing total at.. (or from.. to..) o'clock
DEG Debris grease... % cross-sectional area loss	OB Obstruction... % height/diameter loss
DES Debris silt... % cross-sectional area loss	OJL Open joint large
DI Dropped invert, gap... mm	OJM Open joint medium
EHI Encrustation heavy from.. to.. o'clock % cross-sectional area loss (at joint)	PC Length of pipe forming sewer changes at this point, new length...mm
ELJ Encrustation light from.. to.. o'clock%	RFJ Roots fine (at joint)
EMJ Encrustation medium from.. to.. o'clock %, cross-sectional area loss (at joint)	RMJ Roots mass... % cross-sectional area loss (at joint)
ESH Scale heavy... % cross-sectional area loss from... to... o'clock	RTJ Roots tap (at joint)
ESL Scale light from... to... o'clock	SA Survey abandoned
ESM Scale medium... % cross-sectional area loss from... to... o'clock	SC Shape of sewer changes at this point
FC Fracture circumferential from... to... o'clock	SSL Surface damage, spalling large at (or from.. to..) o'clock
FL Fracture longitudinal at... o'clock	SSM Surface damage, spalling medium at (or from.. to..) o'clock
FM Fractures multiple from... to... o'clock	SSS Surface damage, spalling slight at (or from.. to..) o'clock
GO General observation at this point	SWL Surface damage, wear large at... (or from.. to..) o'clock
GP General photograph number... taken at this point	SWM Surface damage, wear medium at... (or from.. to..) o'clock
H Hole in sewer at... o'clock	SWS Surface damage, wear slight at.. (or from.. to..) o'clock
IDJ Infiltration dripper at (or from... to...) o'clock (at joint)	V Vermin (rats and mice)
IGJ Infiltration gusher at (or from... to...) o'clock (at joint)	WL Water level... % height/diameter
IRJ Infiltration runner at (or from... to...) o'clock (at joint)	X Sewer collapsed... % cross-sectional area loss
ISJ Infiltration seeper at (or from... to...) o'clock (at joint)	FH End of survey
JDM Joint displaced medium	
JDL Joint displaced large	

Contract: 246035


Date: 13-Jan-15

Operative Initial: SP

Site Address: 57, Aberdare Gardens

Page: 1 of 1

M/H: 1 Depth: 940mm

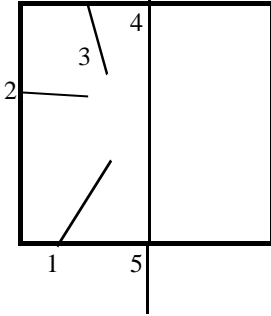

Chamber Dimension (mm):


Depths of run if different to invert level:-

Run	1 - 200mm
	2 - 180mm
	3 - 350mm

Manhole Condition

As built

M/H: Depth:




Chamber Dimension (mm):

Depths of run if different to invert level:-

Run	_____

Manhole Condition

M/H: Depth:




Chamber Dimension (mm):

Depths of run if different to invert level:-

Run	_____

Manhole Condition


KEY....



Internal Back Drop



External Back Drop



Interceptor

Water Pressure Test Results

From:

To:

Pass / Fail