


THESE ARE STAIRS INTO THE ROOF AREA
 ALL FITTINGS TO BE SUPPLIED FROM ABOVE
 No. 43 ROOF SPACE - 8No. B1 FITTINGS (9No. EMERGENCY) 1No. MANUAL SWITCH AND KEY TEST AT ENTRANCE TO ROOF SPACE AND KEY METALCLAD SWITCH AND CABLES IN CONDUIT FROM DB434M6
 No. 44-45 ROOF SPACE AS ABOVE, BUT 10 No. B1 FITTINGS (9No. EMERGENCY) FROM DB453Z5

ALLOW FOR 8No. SMOKE DETECTORS IN ROOF VOID SPACE ADJACENT TO STAIRS IN THE CEILING ADJACENT THE STAIRS TO THE ROOF 2No. DETECTORS EACH FOR THE VOIDS IN 43, 44 AND 45

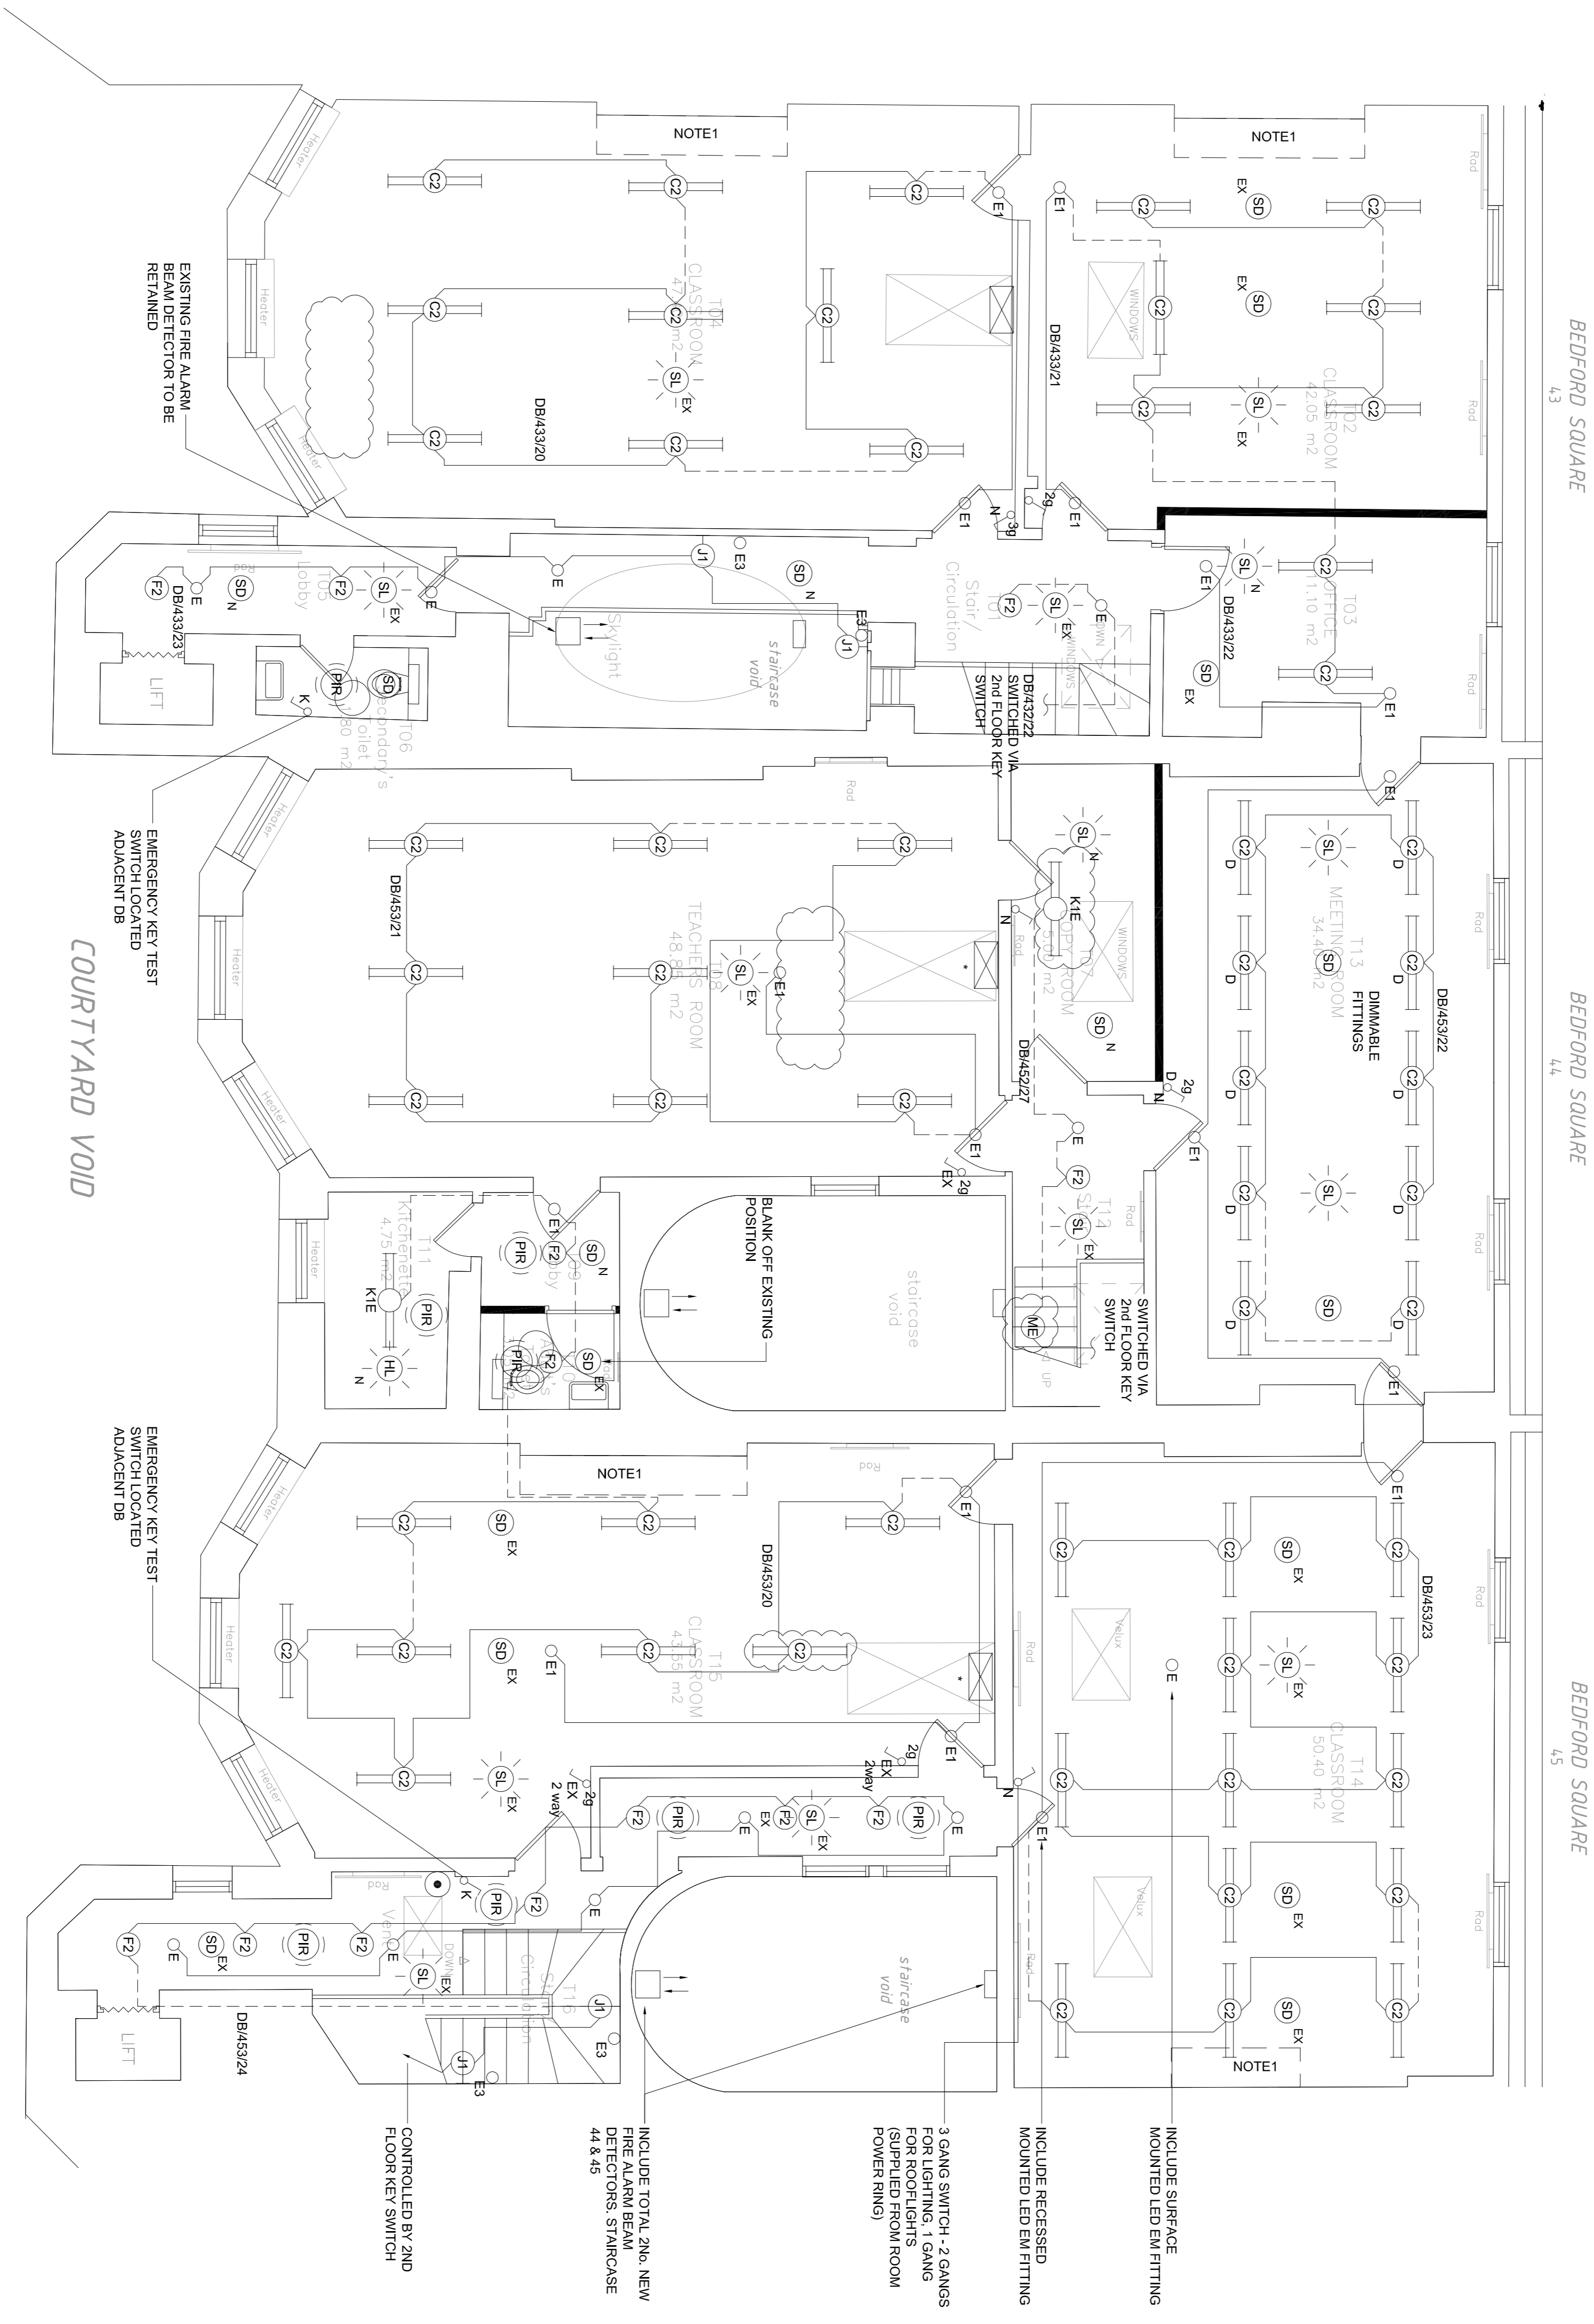

- NOTES:**
1. DASHED BOUNDARY INDICATES TEACHING WALL POSITION. REFER POWER DRAWINGS FOR ADDITIONAL DETAILS. LIGHTING TO BE INTEGRAL WHERE POSSIBLE. REUSE EXISTING LIGHTING POSITIONS AND CABLE ROUTES.
 2. WALL LIGHTS OTHER THAN THOSE SPECIFICALLY NOTED SHALL BE STRIPPED OUT AND THE POINTS BLANKED OFF. THIS GENERALLY APPLIES TO ALL EXISTING WALL LIGHTS.
 3. No. 43-45 ARE LISTED AND ANY NEW ROUTES FOR CABLEING AND NEW HOLES, ETC MUST BE APPROVED BY HERITAGE. STAIR LIGHTING WILL REQUIRE NEW CHASSES. ALL DROPS TO BE WITHIN REUSE EXISTING FIRE ALARMS GENERALLY.
 4. WHERE ADDITIONAL BEACONS ARE REQUIRED, RETAIN EXISTING BASES AND RETAIN HEADS.
 5. LIFT SPECIALIST TO RENEW LIFT SHAFT LIGHTING WHERE ZONES ARE SUPPLIED FROM STAIRS.
 6. STAIR LIGHTING TO BE CONTROLLED VIA KEY SWITCHING.

INCLUDE SURFACE MOUNTED LED EW FITTING

INCLUDE RECESSED MOUNTED LED EW FITTING

3 GANG SWITCH - 2 GANGS FOR POINT LIGHTS (SUPPLIED FROM ROOM POWER RING)


INCLUDE TOTAL 2No. NEW FIRE ALARM BEAM DETECTORS STAIRCASE 44 & 45

CONTROLLED BY 2ND FLOOR KEY SWITCH

1	08.06.15	REVISED PRICING ISSUE	JD/SM
0	26.05.15	FOR PRICING	JD/SM
Revised Date		Drawings	Checked
ARCHITECTS LAYOUTS			

PROJECT:
 43-45 BEDFORD SQUARE

Client:
 MBS



Instia Ltd
 Building Services Contractors
 100 Bedford Square
 London WC1R 4EJ
 Tel: 020 8125 2509
 Fax: 020 8125 2500

Title:
 THIRD FLOOR LEVEL LIGHTING AND FIRE ALARM SERVICES LAYOUT

Scale:
 1:50 @ A1

Drawn:
 SM

Date:
 MAY'15

Dwg No:
 P3284-E-013

REVISION: 1