




# Grays Inn Gardens

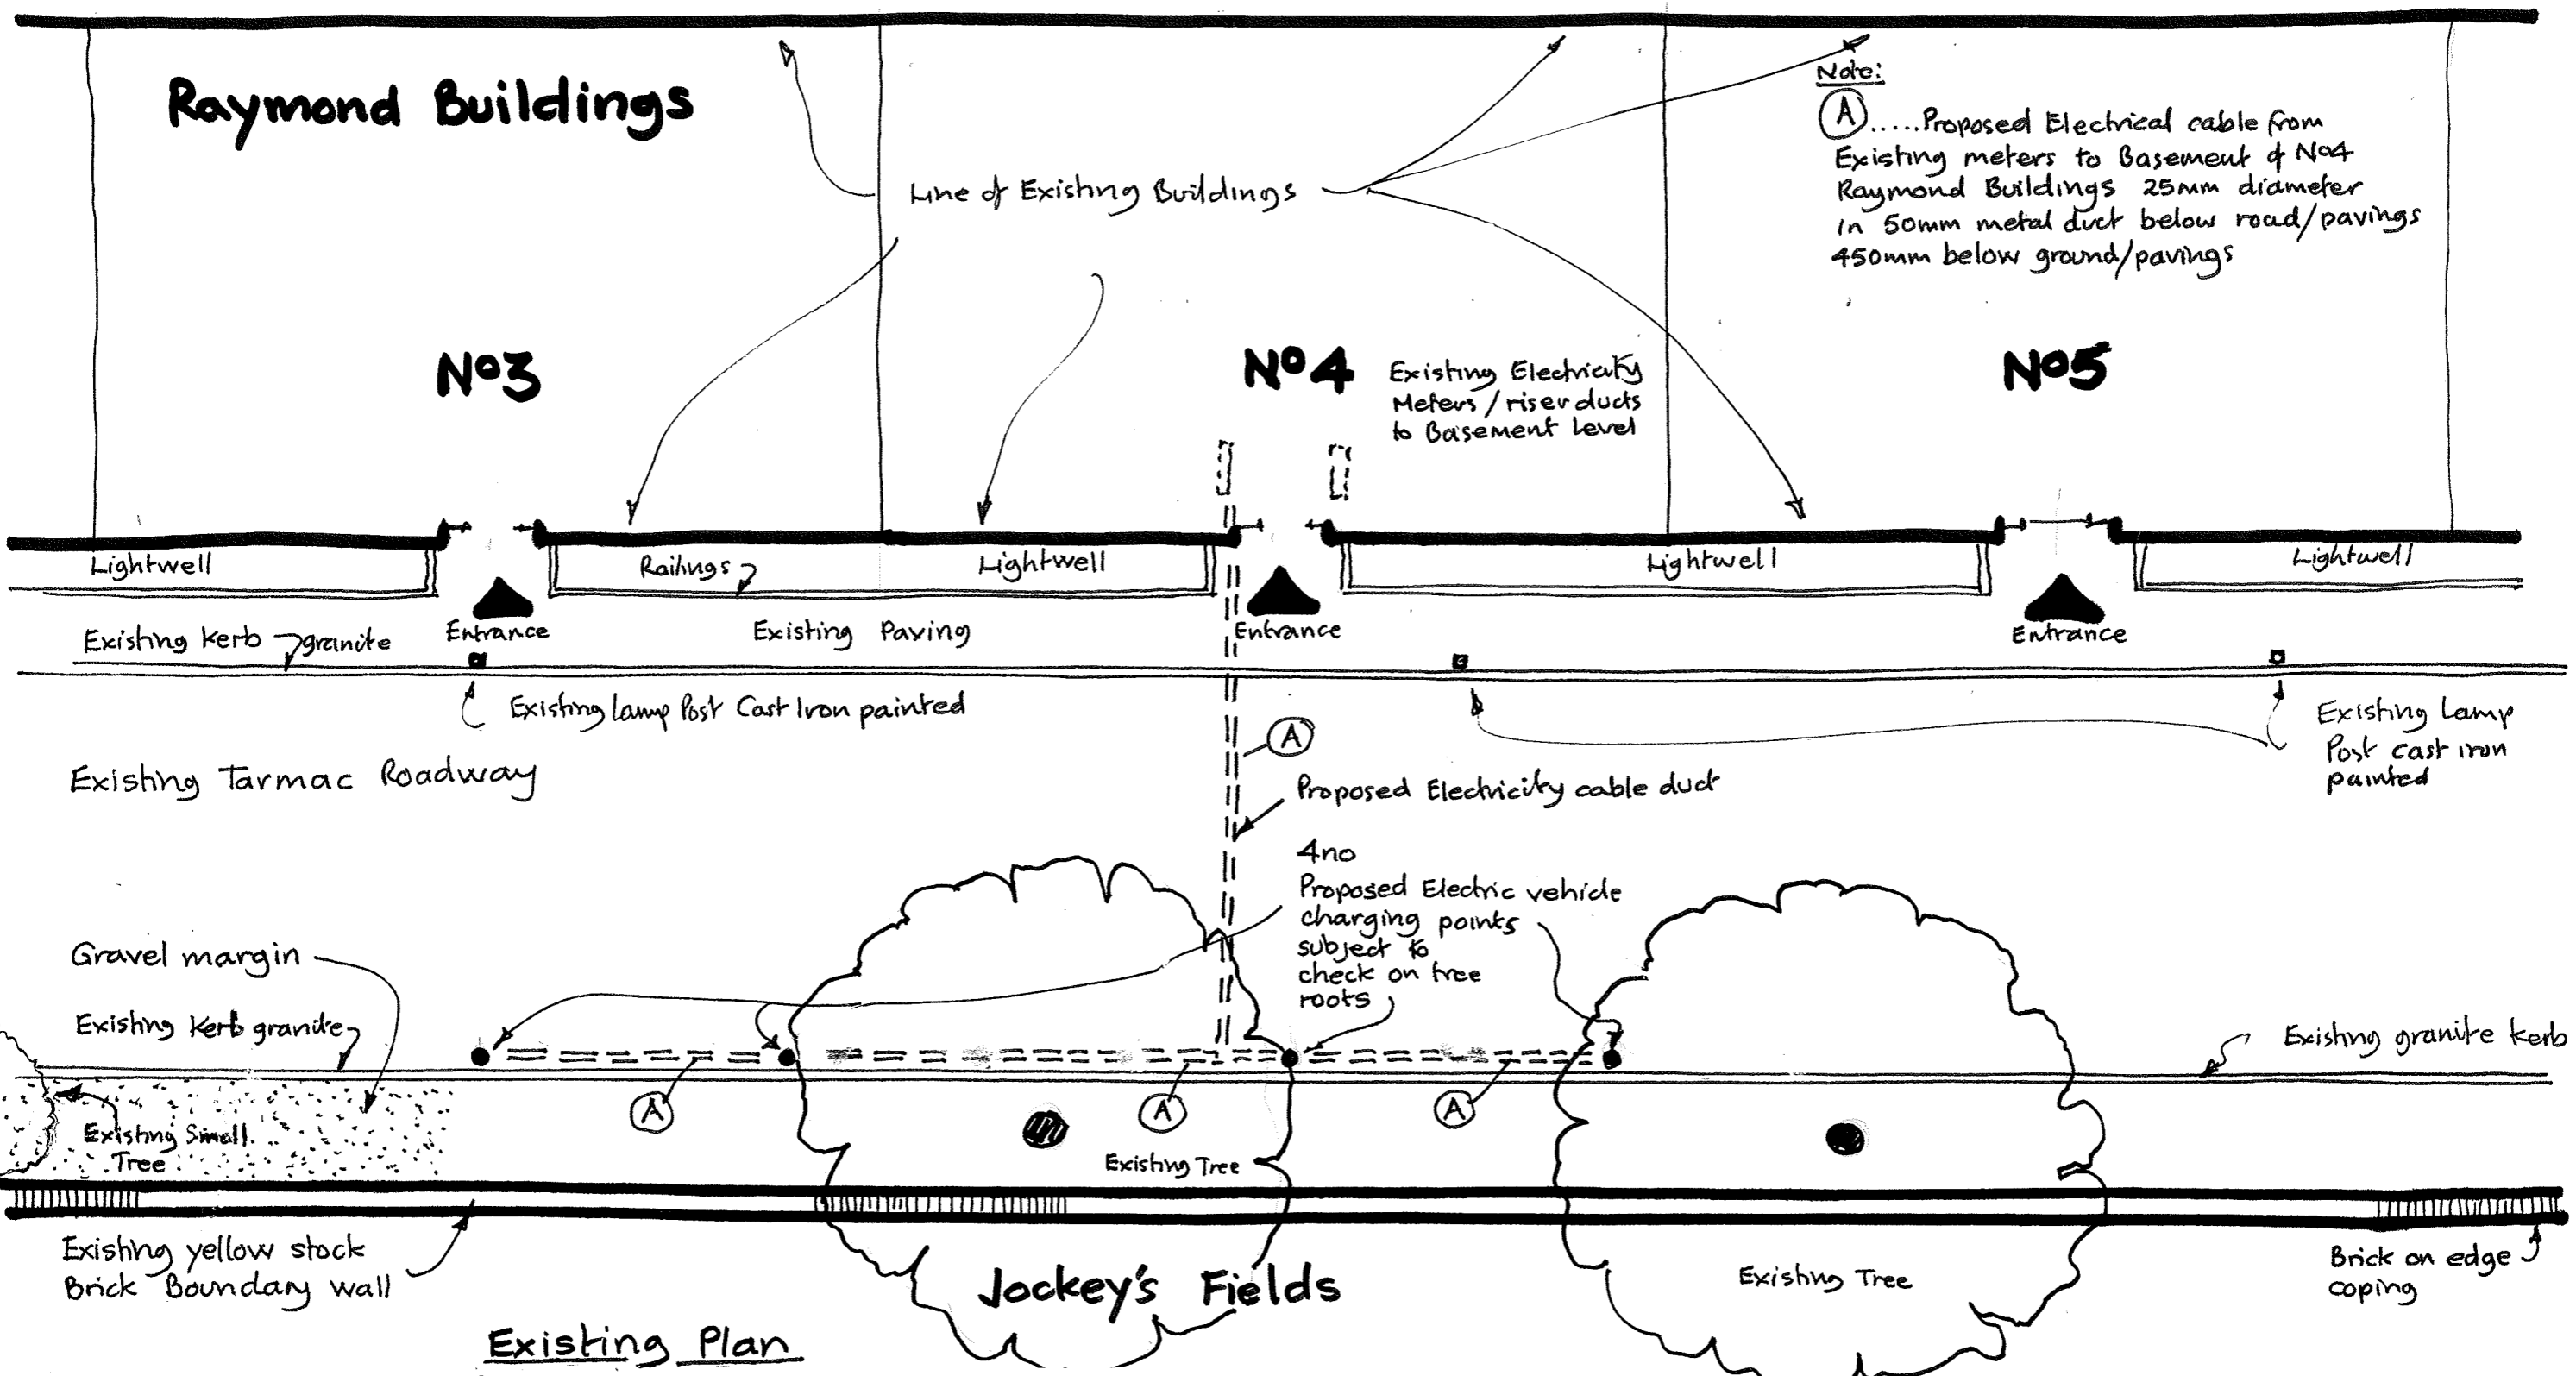

Note:  
 (A) ..... Proposed Electrical cable from Existing meters to Basement of No4 Raymond Buildings 25mm diameter in 50mm metal duct below road/pavings 450mm below ground/pavings

Existing Electricity Meters / riser ducts to Basement level

(A) Proposed Electricity cable duct  
 4 no Proposed Electric vehicle charging points subject to check on tree roots

Existing Plan  
 showing proposed Electric Vehicle charging points

Gray's Inn Estate - Proposed Electric Vehicle Charging Points  
 For The Honourable Society of Gray's Inn.  
 Proposed Installations opposite Raymond Buildings

**GHK ARCHITECTS**  
 Architects · Designers · Historic Building Specialists  
 530 Fulham Road, London SW6 5NR  
 Tel: +44 (0)20 7471 8000 mail@ghkarchitects.co.uk  
 www.ghkarchitects.co.uk

Drawing No: HK2209/SK007  
 Scale: 1:100 @ A3  
 Date: 3rd May 2016  
 Drawn: CM

