


Section of Ground Floor Detail (Stretcher Bond) @ Commercial Bins, Residential Bins & etc

1 1:5

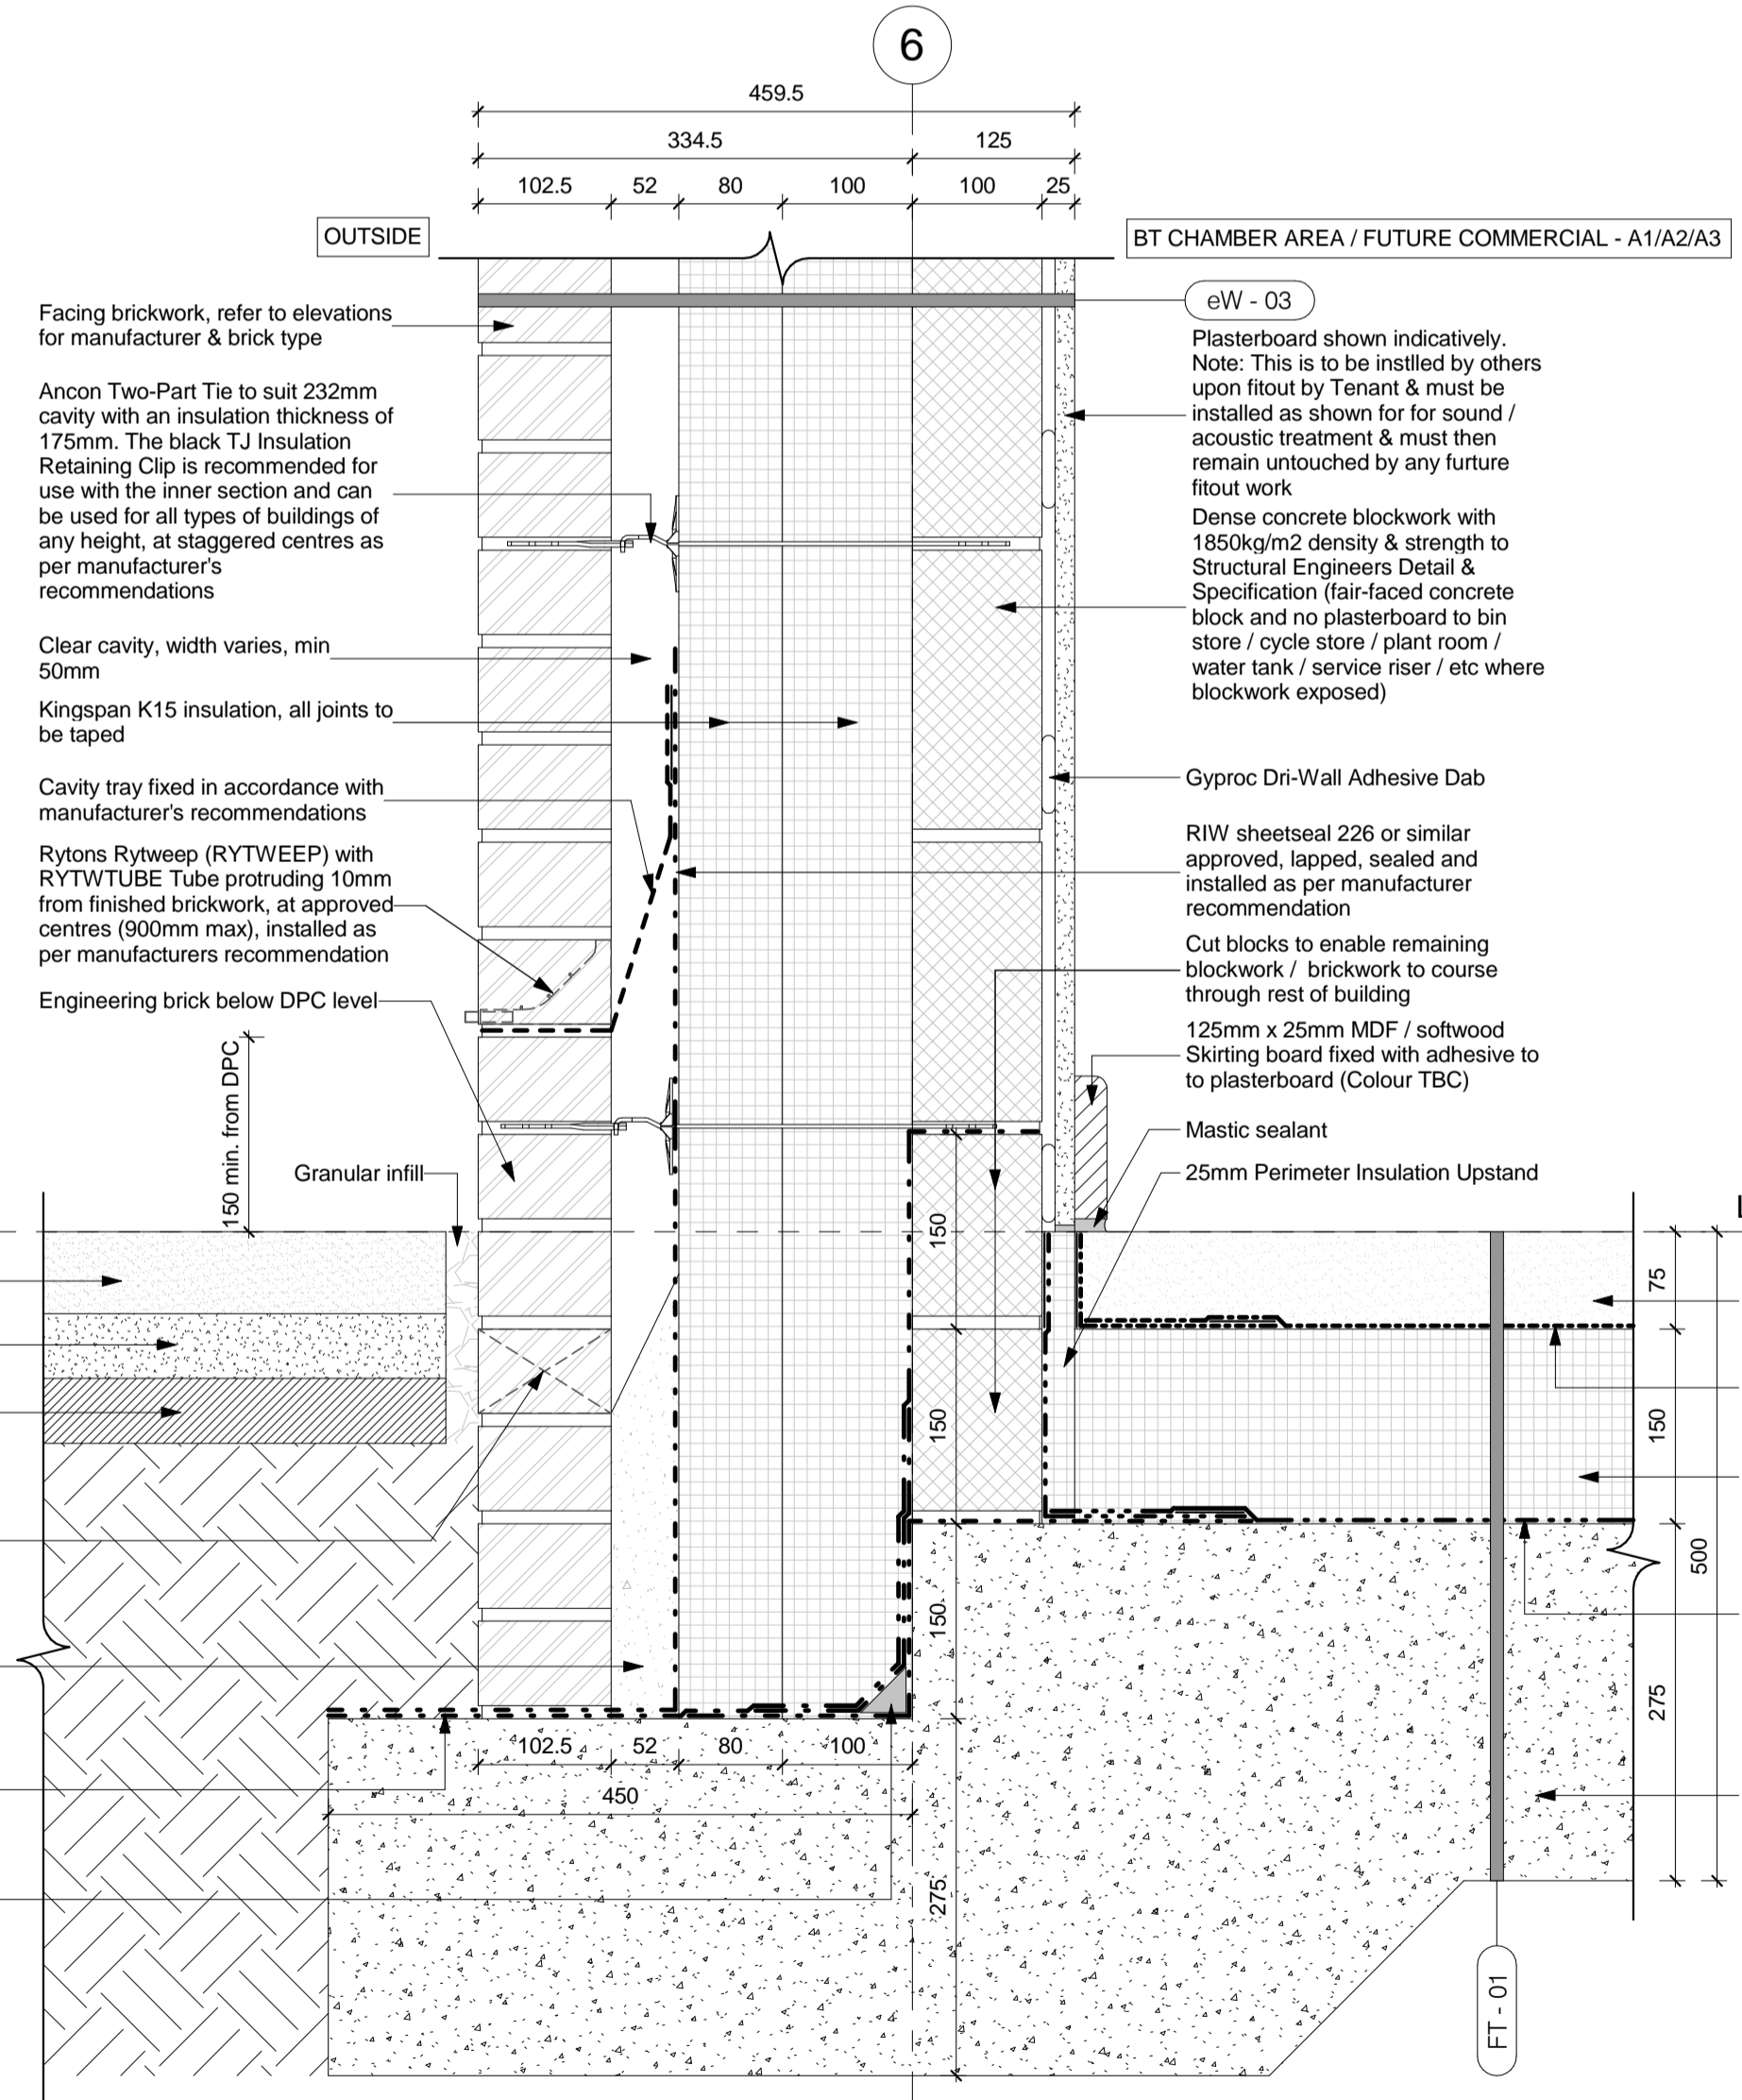

Section of Ground Floor Detail (Stretcher Bond) @ BT Chamber Area / Future Commercial - A1/A2/A3

2 1:5

Masonry Wall Tie Spacing

| | Horizontal Spacing | Vertical Spacing |
|--|--------------------|------------------|
| Distance along wall | Max. 900mm | Max. 450mm |
| Distance from Openings, Roof Verges, Movement Joints | Max. 225mm | Max. 300mm |

Note: Wall ties along wall may correspond to table above or alternatively be spaced such as not to be less than 2.5 ties/m². Wall ties to be installed to manufacturer instructions

ALL JUNCTIONS BETWEEN INTERNAL CEILING & INTERNAL WALLS AND PENETRATIONS IN AIR BARRIER TO BE SEALED WITH FLEXIBLE SEALANT.

ALL PLASTERBOARD JOINT LOCATIONS TO BE TAPED AND JOINT FINISH.

ALL PLASTERBOARD ON DABS TO HAVE CONTINUOUS RIBBON OF ADHESIVE AROUND ALL OPENINGS, ALONG TOP AND BOTTOM OF WALL, AND AT INTERNAL AND EXTERNAL CORNERS.

DETAILS TO BE READ IN CONJUNCTION WITH SECTIONS & GA PLANS - REFER TO SUITABLE PLASTERBOARD TYPE.

NOTE

Wall tie setbacks shown indicatively. Set outs & distances between ties to be installed as per manufacturer instructions

PROPOSED U-VALUE TO ACHIEVE

| | |
|---|---|
| Ground Floor | 0.11 W/m ² .K |
| External Wall - Brickwork with Mestic | 0.10 W/m ² .K |
| External Wall - Brickwork with Blockwork | 0.11 W/m ² .K |
| Separating Walls: Flat / Communal Areas | TBC |
| Separating Walls: Flat / Lift Shaft | TBC |
| Separating Walls: Flat / Flat Party Walls | 0.0* |
| Roof | 0.11 W/m ² .K |
| External Opaque Doors | 1.0 W/m ² .K |
| External Windows | 1.5 W/m ² .K (g-value of 0.63) |
| External Glazed Doors | 1.5 W/m ² .K (g-value of 0.63) |
| AIR PERMEABILITY | 4m ³ /m ² .h |

* Cavities to be fully filled with mineral wool

All dimensions to be verified on site by Main Contractor before the start of any shop drawings or work whatsoever either on their own behalf or that of sub-contractors.

Report any discrepancies to the Contract Administrator at once.

This drawing is to be read with all relevant Architect's and Engineer's drawings and other relevant information.


© Ingleton Wood LLP

LEGEND: DO NOT SCALE

GENERAL NOTES

This drawing should be read in conjunction with all relevant consultants drawings and specifications.

Setting out dimensions and sizing of all RC elements should be taken from structural engineer's drawings and documentation.

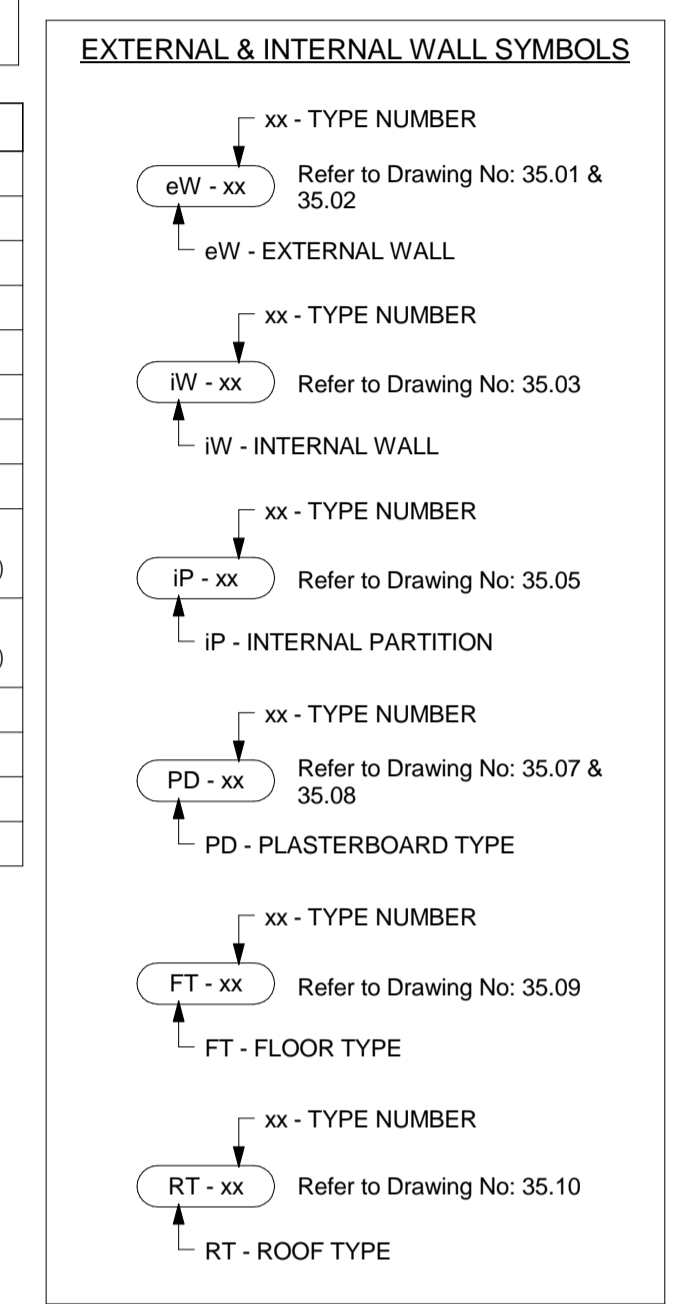

| Rev | Date | Description | Chk | Apr |
|-----|----------|---|-----|-----|
| E | 13.05.16 | CPM changed to gas membrane | KP | JP |
| D | 22.04.16 | Amended in line with comments by Lovell | KP | JR |
| C | 15.04.16 | Construction Issue | KP | JR |
| B | 16.03.16 | Detail update amendment | KP | JR |
| A | 08.02.16 | First Issue | KP | JR |

Scale @ A1: 1:5 Issuing Office: London Project No: 84923

Status: S4 Purpose of Issue: Construction

Ingleton Wood Vision, form and function

London
1 Allie Street
London E1 8DE

Colchester
T: 020 7680 4400
www.ingletonwood.co.uk

Project: Regents Park Estate
Plot 2 - Rydal Water Open Space
London
NW1 3EE

Drawing Title: Ground Floor Details - Sheet 04

Client: Lovell Partnership Ltd.

| File Ref: | Revision: |
|--------------------------------------|-----------|
| RWOS - IW - XX - ZZ - DR - A - 35.14 | E |