


NOTES ON HAZARDS/ ACCESS/ MAINTENANCE
SOME AHUS MAY REQUIRE BUILDING IN DUE TO THE RESTRICTIVE DOOR SIZES LEADING TO PLANT SPACES. PHASING OF AHU INSTALLATIONS SHOULD BE CONSIDERED.

SCALE BAR : 5.0m

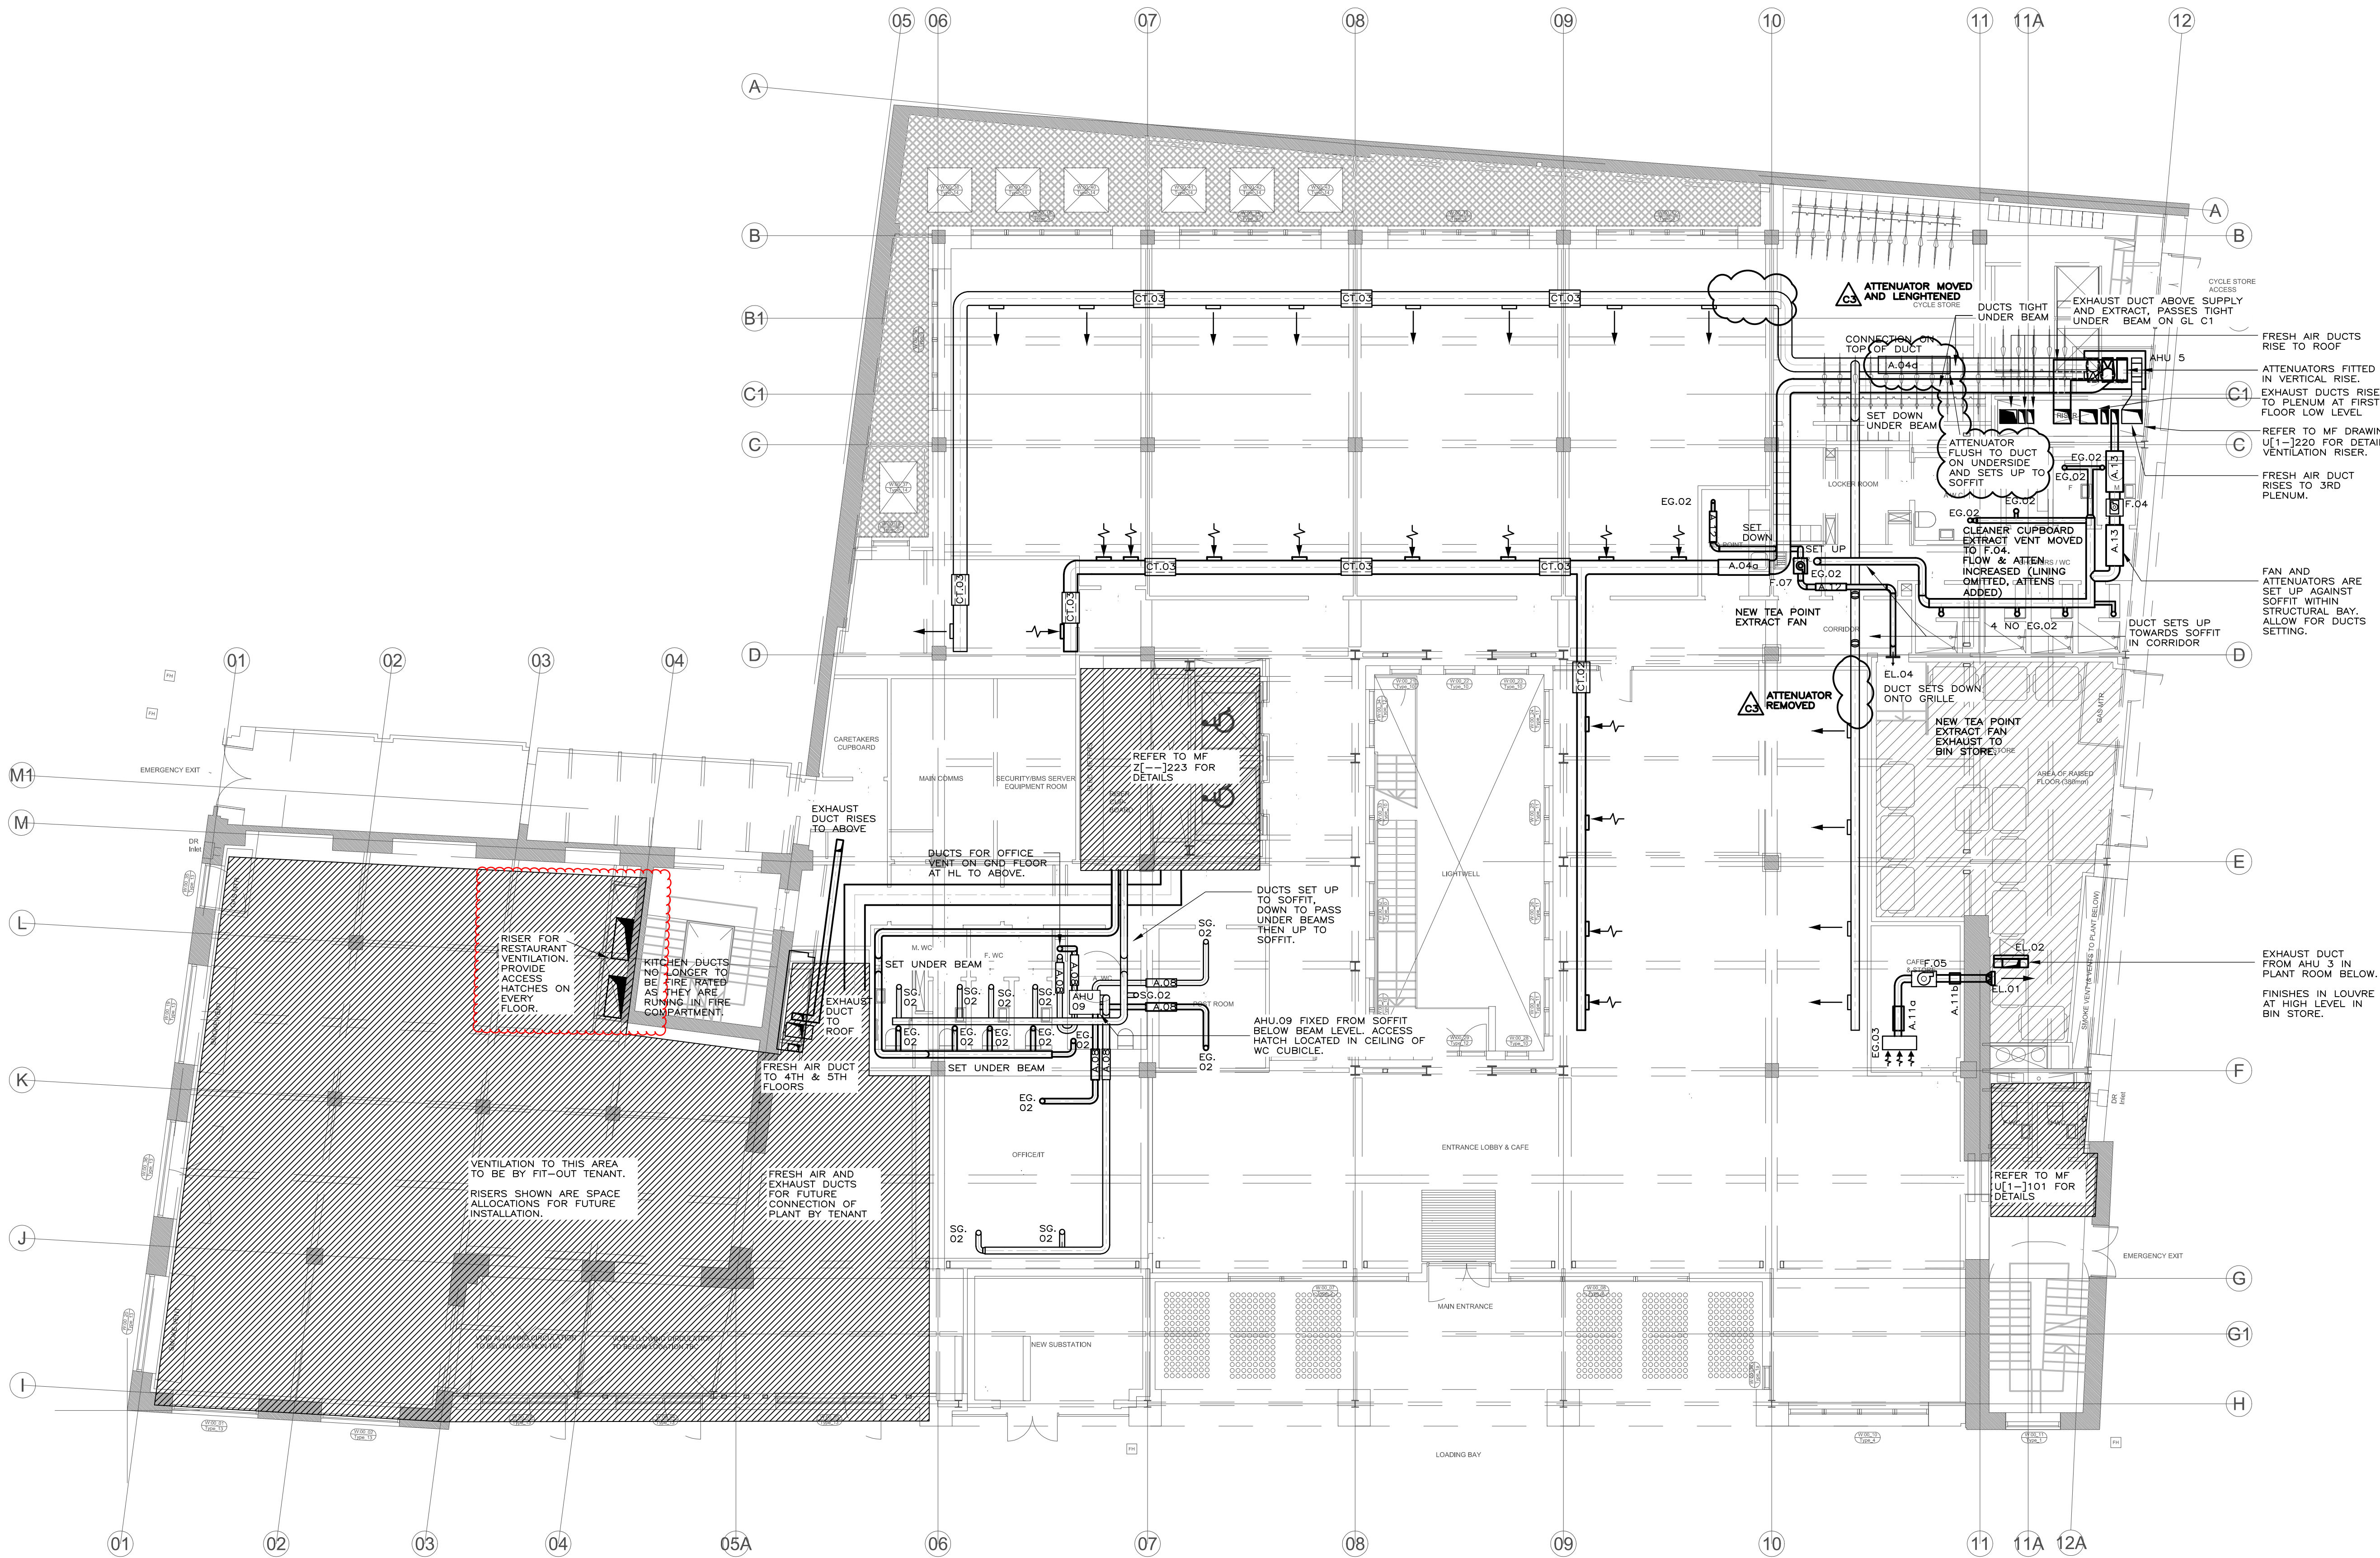

- NOTES:
1. REFER TO ALL MAX FORDHAM DRAWINGS, SCHEDULES AND SPECIFICATIONS.
 2. DO NOT SCALE.
 3. LOCATIONS SHOWN ARE APPROXIMATE – FINAL SETTING OUT BY ARCHITECT.
 4. REFER TO MF_U[1-]2XX SERIES OF DRAWINGS FOR DETAILS OF DUCTS (SIZES, AIR VELOCITIES, PRESSURE DROPS ETC).

- LEGEND:
- SUPPLY VENTILATION
 - ↖ EXTRACT VENTILATION
 - DUCT STUB COLLAR MOUNTED ON SIDEWALL OF DUCT. CONTAINING BALANCING DAMPER AND TERMINATING IN SUPPLY OR EXTRACT GRILLE. SEE U[1-]502 FOR DETAILS REF EG.01 OR SG.01.
 - EXTRACT OR SUPPLY AIR VALVE. SEE U[1-]502 FOR DETAILS REF EG.02 OR SG.02.
 - ASSISTED VENT EXTRACT GRILLE. SEE U[1-]502 FOR DETAILS REF EG.05.
 - CAFE EXTRACT GRILLE.
 - ATTENUATOR. REFER TO U[1-]504 FOR DETAILS. (CT.0* – CROSSTALK ATTENUATOR)
 - BG WIRE BIRD SCREEN

ATTENUATOR SELECTIONS UPDATED DUE TO ORIGINAL SUPPLIER (IAC) NO LONGER TRADING AND ALTERNATIVE SUPPLIER SELECTED (CAICE)

C3	07/04/16	CONSTRUCTION ISSUE	TC
C2	23/12/15	CONSTRUCTION ISSUE	IM
C1	25/06/15	CONSTRUCTION ISSUE	CB
T1	18/06/14	TENDER	CB
	14/02/14	STAGE E – FOR COSTING	TC
	23/09/13	STAGE D	TC
rev	date	description	eng

MAX FORDHAM

Max Fordham LLP
42-43 Gloucester Crescent
London
NW1 7PE
T. +44 (0) 20 7267 5161
F. +44 (0) 20 7482 0329
maxfordham.com

Registered in England No. OC300026
Registered Office 42-43 Gloucester Crescent London NW1 7PE

architect
KARAKUSEVIC CARSON

job title
**HATTON SQUARE
BUSINESS CENTRE**

project leader date scale (at A1)
CB JUL 13 1:100

drawing title
**MECHANICAL VENTILATION
LAYOUT
GROUND FLOOR**

job no dwg no rev
4723 U[1-]111 /C3