
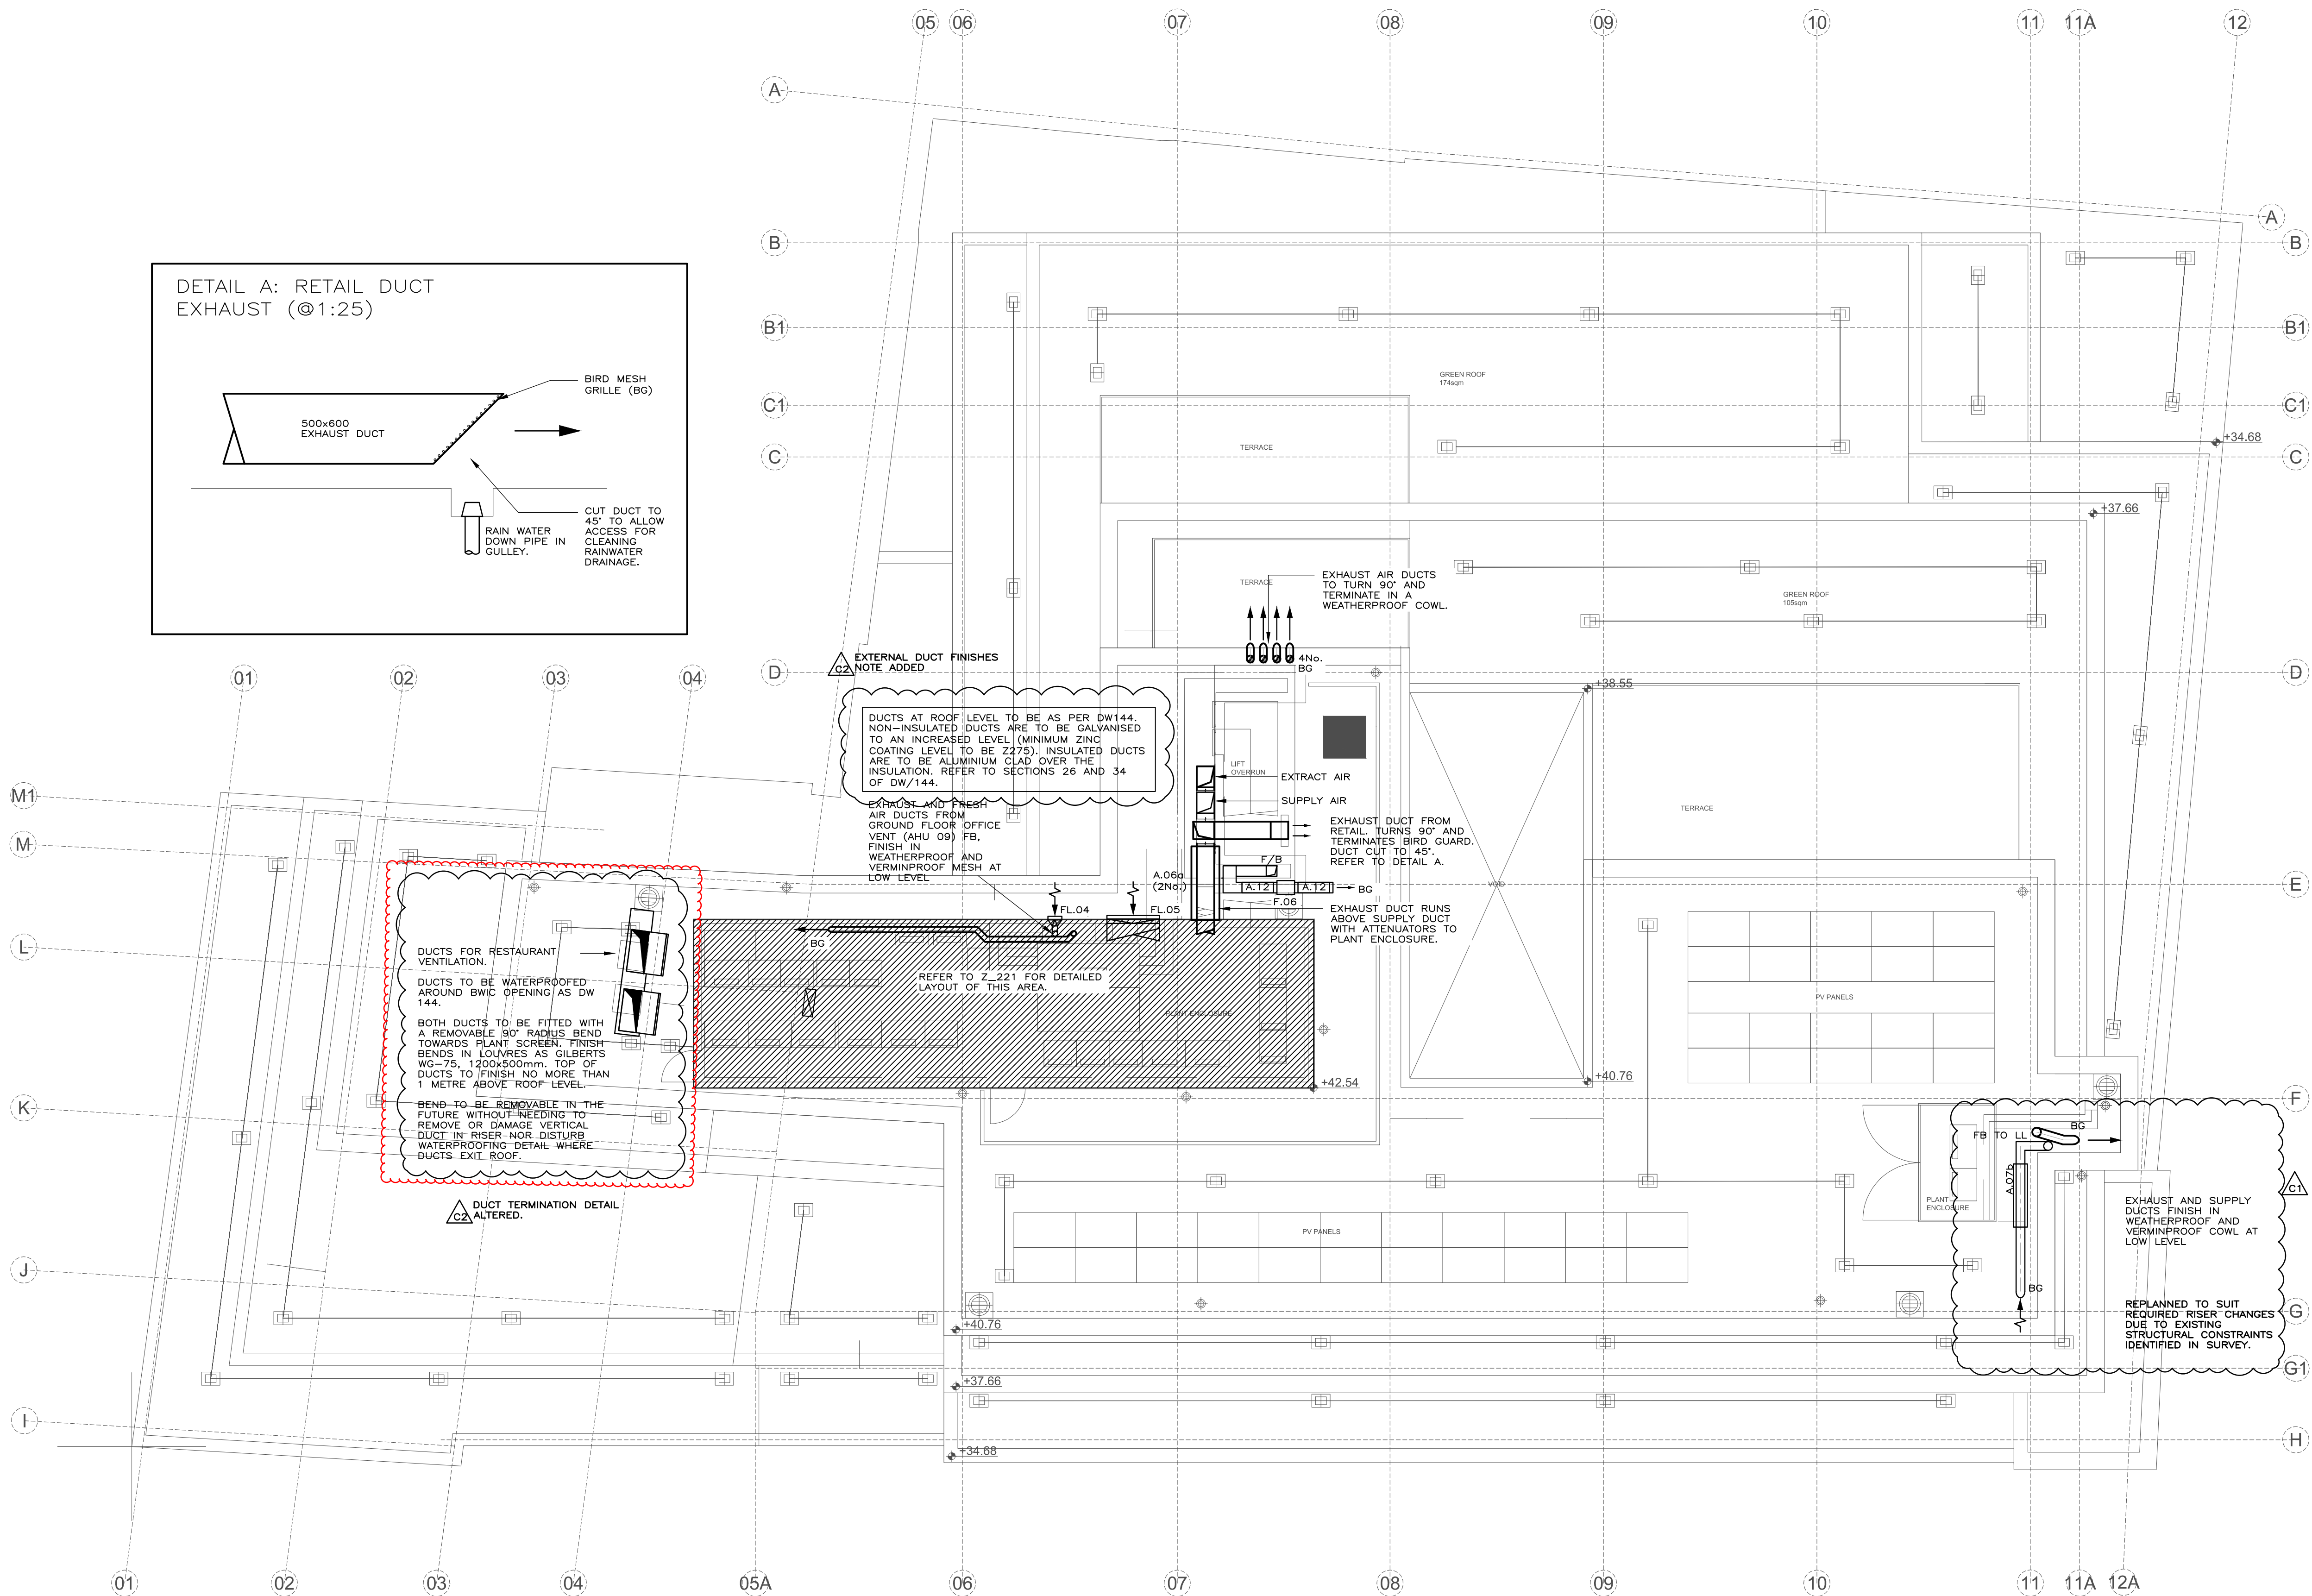


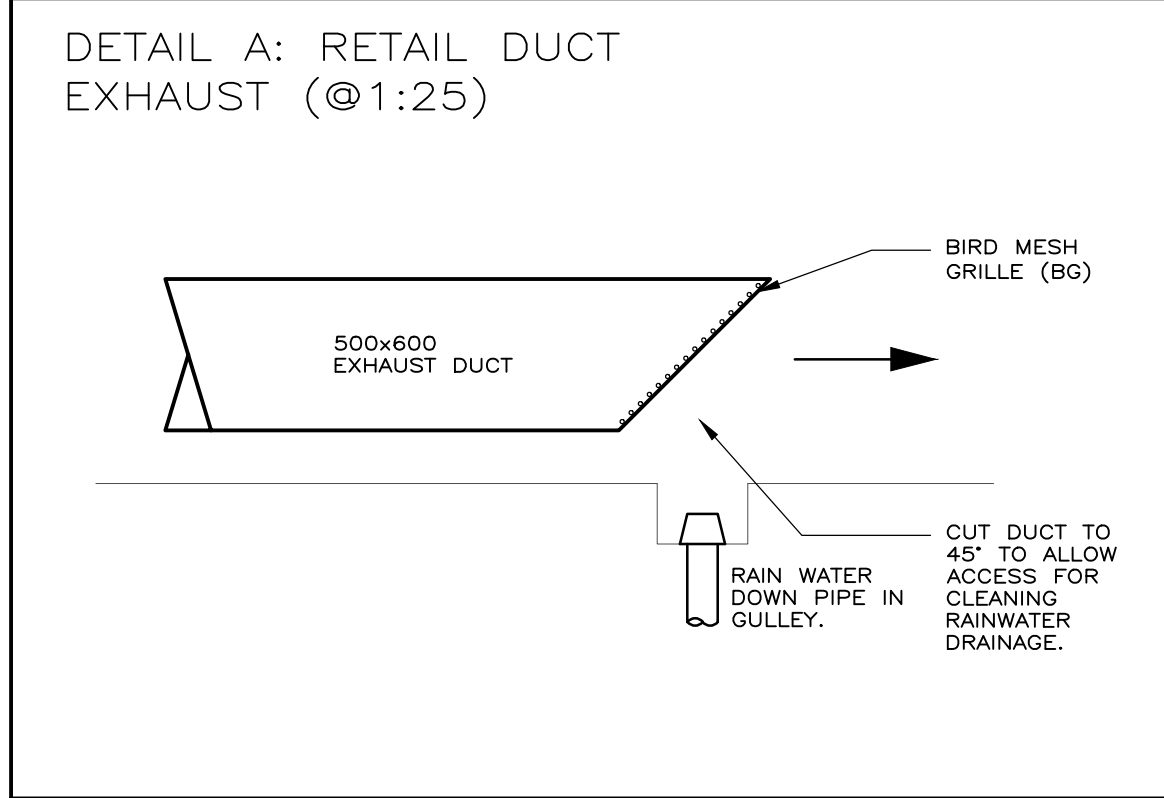

- NOTES:
1. REFER TO ALL MAX FORDHAM DRAWINGS, SCHEDULES AND SPECIFICATIONS.
  2. DO NOT SCALE.
  3. LOCATIONS SHOWN ARE APPROXIMATE – FINAL SETTING OUT BY ARCHITECT.
  4. REFER TO MF\_U[1]-[2]XX SERIES OF DRAWINGS FOR DETAILS OF DUCTS (SIZES, AIR VELOCITIES, PRESSURE DROPS ETC).

- LEGEND:
- SUPPLY VENTILATION
  - ← EXTRACT VENTILATION
  - DUCT STUB COLLAR MOUNTED ON SIDEWALL OF DUCT, CONTAINING BALANCING DAMPER AND TERMINATING IN SUPPLY OR EXTRACT GRILLE. SEE U[1]-[5]02 FOR DETAILS REF EG.01 OR SG.01.
  - EXTRACT OR SUPPLY AIR VALVE. SEE U[1]-[5]02 FOR DETAILS REF EG.02 OR SG.02.
  - ASSISTED VENT EXTRACT GRILLE. SEE U[1]-[5]02 FOR DETAILS REF EG.05.
  - CAFE EXTRACT GRILLE.
  - ATTENUATOR. REFER TO U[1]-[5]04 FOR DETAILS. (CT.0\* – CROSSTALK ATTENUATOR)
  - BG WIRE BIRD SCREEN

|     |          |                       |     |
|-----|----------|-----------------------|-----|
| C2  | 23/12/15 | CONSTRUCTION ISSUE    | CB  |
| C1  | 25/06/15 | CONSTRUCTION ISSUE    | CB  |
| T1  | 18/06/14 | TENDER                | CB  |
| *   | 14/02/14 | STAGE E – FOR COSTING | TC  |
| rev | date     | description           | eng |

MAX FORDHAM

Max Fordham LLP  
42-43 Gloucester Crescent  
London  
NW1 7PE  
T. +44 (0) 20 7267 5161  
F. +44 (0) 20 7482 0329  
maxfordham.com

Registered in England No. OC300026  
Registered Office 42-43 Gloucester Crescent London NW1 7PE

architect  
**KARAKUSEVIC CARSON**

job title  
**HATTON SQUARE  
BUSINESS CENTRE**

project leader date scale (at A1)  
**CB JUL 13 1:100**

drawing title  
**MECHANICAL VENTILATION  
LAYOUT  
ROOF LEVEL**

job no dwg no rev  
**4723 U[1]-[171] /C2**