



Geological & Geotechnical Consultants

59 Redington Road, London NW3 7RP

**Desk Study &
Report on Ground Investigation
(Aug 2016)**

Prepared for SIAW



Geological & Geotechnical Consultants

Key GeoSolutions Ltd
Nova House
Audley Avenue Enterprise Park
Newport
Shropshire
TF10 7DW

Tel. 01952 822960
Fax. 01952 822961
email info@keygs.com
web www.keygs.com

Job Number: 16-248
Report Number: 16-248-R-001

SIAW

59 Redington Road

Desk Study & Report on Ground Investigation

Prepared by:

R Westnedge BSc (Hons) MSc FGS

.....

Approved by:

B Duthie BEng CGeol FGS FIQ

.....

Report Distribution List

Name	Copies	Rev.	Date	Copies	Rev.	Date	Copies	Rev.	Date
B Halevi	pdf	1	04/10/16						
KGS File	pdf	1	04/10/16						

This report has been prepared by Key GeoSolutions Limited with all reasonable skill, care and diligence, within the terms of the Contract with the Client. The report is confidential to the Client and Key GeoSolutions Limited accept no responsibility of whatever nature to third parties to whom this report may be made known.

No part of this report may be reproduced without prior written approval of Key GeoSolutions Limited.

CONTENTS

	<u>Page Number</u>
1.0 INTRODUCTION	2
2.0 SITE OVERVIEW	4
2.1 <i>Site Location</i>	4
2.2 <i>Land Use History</i>	4
2.3 <i>Geo-Environmental Setting</i>	5
2.4 <i>Other Significant Geo-Environmental Information</i>	6
2.5 <i>Review of Previous Reports / Investigations</i>	9
3.0 GROUND INVESTIGATION	10
4.0 LABORATORY TESTING	11
5.0 DISCUSSIONS ON GROUND CONDITIONS AND RECOMMENDATIONS	12
6.0 CONCLUSIONS AND RECOMMENDATIONS	14

Figures

Figure 1	Site Location Plan
Figure 2	Window Sample Holes Location Plan

Appendices

Appendix 1	Envirocheck Report
Appendix 2	Window Sample Logs
Appendix 3	Results of Chemical Analyses (Alcontrol Laboratories)
Appendix 4	Results of Physical & Chemical Analyses (Terra Tek Laboratories)

1.0 INTRODUCTION

Key GeoSolutions Ltd (KGS) have been commissioned by SIAW LTD to undertake a ground investigation at 59 Redington Road, London in order to ascertain the ground conditions for a proposed new swimming pool and erection of associated pitched roof single-storey enclosure with dressing room within the rear garden area.

As part of the planning application for the swimming pool a Basement Impact Assessment (BIA) was submitted and reviewed by the London Borough of Camden's Consultant's Campbell Reith and reported in their BIA Audit report, Project No 12336-55 revision – D1 dated May 2016. This audit highlighted the fact that the absence of a hidden watercourse supposedly running to the rear of the gardens had not been confirmed and no site specific ground investigation report submitted. Consequently, this investigation comprises;

- a Desk Study highlighting previous uses of the site
- exploratory holes using window sampling techniques;
- samples recovered for chemical and geotechnical testing; and
- groundwater monitoring installations.

The report comprises a desk study review of publicly available information related to the site and the surrounding area, an Envirocheck report, provided by the Landmark Information Group (a copy of which can found in Appendix 1), together with the results of the Ground Investigation.

The ground investigation comprised 2No. window sample holes sunk, with water monitoring standpipe installations, close to the proposed footprints of the new structures where access allowed, to define the ground conditions and provide samples for geotechnical testing and chemical analysis.

The comments given in this report and any opinions expressed are based on the ground conditions encountered during the site work, the results of tests made in the field and in the laboratory and on information made available by SIAW LTD and other Third Parties. KGS has proceeded in good faith on the assumption that this information is accurate and accepts no liability for any inaccurate conclusions, assumptions or actions taken resulting from any inaccurate information supplied. There may be, however, conditions pertaining to the site which have not been disclosed by the investigation and which therefore could not be taken into account in this report. In particular underground services may be present that could affect the proposed development.

It should also be noted that the effects of ground and water borne contamination on the environment are constantly under review, and authoritative guidance values are potentially subject to change.

The conclusions presented herein are based on the guidance available at the time this report was prepared, and no liability can be accepted for the retrospective effects of any changes or amendments to the legislation or guidance.

2.0 SITE OVERVIEW

2.1 Site Location and Description

The site may be located by National Grid Reference 525597mE, 185959mN, the location is shown on Figure 1.

The proposed structure is to be located to the west of the existing building in what is currently a garden area. The area is bounded by other gardens to the north and west, access to the site is via the existing building at 59 Redington road.

The current layout is shown on Figure 2. From the site topographic survey provided the site falls from the front of the property at approximately 97.5mAOD to 94.0mAOD at the end of the rear garden.

2.2 Land Use History

2.2.1 General

Landmark Information Group (Landmark) was commissioned to provide an Envirocheck® Report. This report, including the Historical Ordnance Survey Maps, is presented in its entirety, in Appendix 1. The maps have been reviewed to determine the historical on-site and off-site land use. Where appropriate these have been supplemented/correlated by other information from web-based sources.

2.2.2 Historical Land uses and features

The review focuses on the land use within the boundary and the land immediately adjacent to the sites. Additional comment on the land use further from the site is added if noteworthy from a geotechnical or land contamination context.

Site – fields from 1864 until 1896, on the 1896 map the site and surrounding area are marked as being fields with Redington Road being established, a covered Reservoir (Water Works) is also noted to the south west of the site. On the 1915 map, the site and surrounding area are no longer fields, with numerous roads being established around Redington Road.

Between 1915 and 2016 the site remains undeveloped as a domestic garden.

2.2.3 Contemporary Surrounding Land Use

There has been one contemporary trade located within the surrounding 250m of the site this is an inactive furniture manufacture and is located 247m from the site. The closest was Garage Services (24 Hour Euro Windscreen Ltd) at 571, Finchley Road approximately 443m to the south west of the site, this site is currently inactive. The closest active operation is a Packaging Materials Manufacturers & Supplies (Ravtex Uk Ltd) 95 Platts Lane, Hampstead approximately 368m to the north west of the site, although this operation does not require a Local Authority Pollution Prevention and Control permit. The closest company requiring such a permit is Esso Filling Station, which is 526m to the west.

The nearest obsolete fuel station was located 538m to the west of the site at 617, Finchley Road; the nearest open fuel station is located 526m to the west adjacent to the obsolete fuel station at 617, Finchley Road (Esso).

2.3 Geo-Environmental Setting

2.3.1 Geology

The site is covered by BGS 1: 50,000 Geological Sheet No. 256 (North London) Bedrock and Superficial Deposits Published 2006. This indicates the site to be underlain by strata of the Claygate Member (clay and silt) of the Palaeogene Period, which is in turn underlain by the London Clay Formation. Based on the BGS boreholes the London Clay is anticipated to be in the order of 60m thick in this area.

2.3.2 Hydrogeology and Groundwater Vulnerability

The hydrogeology and groundwater vulnerability at the site has been assessed and is summarised in the following sections.

2.3.3 Classification of Aquifer

The bedrock strata are identified as a Secondary A Aquifer, defined by the Environment Agency as:-

“Permeable layers capable of supporting water supplies at a local rather than strategic scale, and in some cases forming an important source of base flow to rivers. These are generally aquifers formerly classified as minor aquifers.”

The Superficial deposits are identified as an Unproductive Strata.

2.3.4 Soil Vulnerability

The soils on site are classified as having a High leaching potential (U).

2.3.5 Groundwater

There is limited potential for groundwater flooding to occur on site or the surrounding area. It is estimated that the groundwater is between 15m AOD and 20mAOD this value is taken from monitoring undertaken in January 2016.

2.3.6 Source Protection Zone

The site is not within any source protection zones however 1.8Km to the south east of the site a Source Protection Zone Outer Zone (Zone 2) is visible.

2.3.7 Groundwater Abstraction

There are no recorded water abstraction points within 1000m of the site.

2.4 Other Significant Geo-environmental Information

2.4.1 Hydrology

The nearest surface water feature is a pond and river area, located approximately 617m north-east of the site.

The information contained within the Envirocheck® Report (Appendix 1) indicates that the site and surrounding area is an area with "Limited Potential for Groundwater Flooding to Occur". The pond and river, located approximately 617m to the north-east of the site, is an area marked as a "Limited Potential for Groundwater Flooding to Occur".

The 1879 OS 1: 2500 map shows a minor watercourse running to the west of the site boundary in a north - south direction. This is likely to be the tributary of the Westbourne River previously identified in the BIA.

2.4.2 Surfacewater Abstraction

There are no recorded surface water abstraction points within 1000m of the site.

2.4.3 Radon

With reference to Annex A and B of *Radon: Protective Measures for New Dwellings (BR211, 2007)*, the site is located in an area where basic radon protection is not required. The information contained within the Envirocheck® Report (Appendix 1) also confirms this assessment concluding that 'no radon protective measures are necessary in the construction of new dwellings or extensions'.

2.4.4 BGS Estimated Soil Chemistry

The table below lists the BGS Estimated Soil Chemistry Values for arsenic, cadmium, chromium, lead and nickel; these are assumed to represent the background concentrations for the soil chemistry. The high values for Lead concentrations is confined to a small location north of the site and does not represent the surrounding values of lead concentration.

Table 2.4.4 - BGS Measured Urban Soil Chemistry

Arsenic	Minimum Concentration (for London)	1.00 mg/kg
	Average Concentration (for London)	17.00 mg/kg
	Maximum Concentration (for London)	161.00 mg/kg
	Measured Values (local to site)	8.5-23 mg/kg
Cadmium	Minimum Concentration (for London)	0.10 mg/kg
	Average Concentration (for London)	0.90 mg/kg
	Maximum Concentration (for London)	165.20 mg/kg
	Measured Values (local to site)	<1.5 mg/kg
Chromium	Minimum Concentration (for London)	13.00 mg/kg
	Average Concentration (for London)	79.00 mg/kg
	Maximum Concentration (for London)	2094.00 mg/kg
	Measured Values (local to site)	50-160 mg/kg
Lead	Minimum Concentration (for London)	11.00 mg/kg
	Average Concentration (for London)	280.00 mg/kg
	Maximum Concentration (for London)	10000.00 mg/kg
	Measured Values (local to site)	99-1130 mg/kg
Nickel	Minimum Concentration (for London)	2.00 mg/kg
	Average Concentration (for London)	28.00 mg/kg
	Maximum Concentration (for London)	506.00 mg/kg
	Measured Values (local to site)	7-50 mg/kg

2.4.5 Waste

Based on the Envirocheck report there is no Historical Landfill Sites located within 1000m of the site, however Potentially Infilled Land (Non – Water and Water) have been noted.

There is a record of Potentially Infilled Land (Non-Water) located 297m to west of the site; and is described as Unknown Filled Ground (Pit quarry etc.). The historical maps for the Potentially Infilled Land show houses occupying the site from 1915 to the present day with only minor changes relating to the width of the main road. The Envirocheck® report indicates that the date the fill was mapped was 1996 but buildings have occupied this site since 1896. There is also three other Potentially infilled Land (Water) described as Unknown Filled Ground (Pond, marsh, river, stream, dock etc) located 356m south of the site, 841m and 886m to the north of the site. The two sites to the north were filled in in 1896 with the infilled land to the south being infilled in 1996.

2.4.6 Ground Stability, Mineral Workings and Coal Mining

As would be expected based on the published geology the site is noted as being in an area *'that might not be affected by coal mining'*.

The Envirocheck report indicates that there is no hazard associated with non-coal mining activity.

There are no BGS recorded Mineral Sites within 250m of the site,

The Envirocheck® Report indicates the soils found on site are classified as being 'No Hazard' or having 'very low hazard potential' for the following:

- Potential for collapsible ground
- Potential for ground dissolution
- Potential for landslide
- Potential for running sand

The Envirocheck® Report indicates the soils found on site are classified as having 'moderate hazard potential' for the potential for shrinking or swelling clay ground.

2.4.7 Environmentally Sensitive Land Uses

There is an Ancient Woodland and a Site of Special Scientific Interest located, approximately 900m to the north west of the site.

2.5 Review of Previous Reports / Investigations

2.5.1 BGS Records

A search for any available reports, which may provide relevant information with regards to the site development, has been undertaken. This includes the borehole records kept at the British Geological Survey (BGS).

The BGS has records of a number of boreholes within 1000m of the site. The nearest of these, which is not confidential, (located approximately 340m to the north west of the site) encountered 0.90m of topsoil, below which stiff brown silty clays were encountered.

The thickness of the London Clay and the depth of the underlying Lambeth Group and Chalk were approximated using the deep wells around the site approximately; two located approximately 742m and 740m the north-east of the site drilled in 1985, one located approximately 225m to the south-west of the site drilled in 1872.

3.0 GROUND INVESTIGATION

The site work was carried out on the 4th August 2016 and generally in accordance with the guidelines laid down in BS EN 1997-2:2007 (1).

Two window sample holes (WS01 to WS02) were sunk, one in the vicinity of the footprint of the proposed new building and one close to the existing building to investigate the ground conditions and provide samples for geotechnical testing and chemical analysis. Due to access restrictions it was not possible to investigate the full extent of the proposed build area. All exploratory holes were located based on geotechnical requirements as other than a general risk of contamination being present on site the Desk Study had not identified any specific targets.

The holes were sunk using a window sampling rig provided by Dynamic Sampling UK. The approximate locations of the boreholes are shown on Figure 2. The depths of the boreholes and descriptions of the soils encountered are given in the borehole records (Appendix 2).

Disturbed samples and SPT's (Standard Penetration Tests) were taken at the depths shown on the borehole record. The results are provided on the borehole logs. The results are provided within Appendix 2.

Samples taken for contamination purposes were recovered in labelled 250g amber jars, 60g amber jars and 1kg plastic tubs. The samples were then stored in cool boxes prior to being delivered to ALcontrol Laboratories in Hawarden. Samples were delivered, and scheduled using Sample Custody forms provided by ALcontrol.

Gas standpipes were installed in WS01 and WS02 details of installations are on the borehole logs (see Appendix 2).

4.0 LABORATORY TESTING

Samples were selected and scheduled for chemical analysis by KeyGS: the analysis was carried out by ALcontrol Laboratories, a UKAS accredited laboratory with MCERTs accreditation for the majority of test scheduled. The range of chemical analyses was based on the known previous land use history of the site and include asbestos screen, total cyanide, water soluble sulphate, polycyclic aromatic hydrocarbons (PAH), soil organic matter (SOM), Total Petroleum Hydrocarbons Criteria Working Group (TPH CWG) banded aliphatics and aromatics hydrocarbons, waste acceptance Criteria (WAC) (complete & leachate suite), and metals (Arsenic, Barium, Beryllium, Boron, water soluble, Cadmium, Chromium, Copper, Lead, Mercury, Nickel, Selenium, Vanadium, Zinc).

Whilst every effort has been made to schedule tests suitable for the known previous land use, there is no guarantee that other contaminants are not present on site for which analyses have not been carried out or which were not sampled in the programme of exploratory holes.

Given the relatively thin veneer of made ground the chemical testing was limited to two but generally representative samples of the ground encountered in WS01 and WS02, the results are given in Appendix 3.

In addition, three samples was also submitted to TerraTek Ltd for Atterberg testing, water soluble sulphate and pH value analyses.

5.0 DISCUSSIONS ON GROUND CONDITIONS AND RECOMMENDATIONS

5.1 Ground Conditions

The following strata were encountered during the investigation:-

- Made Ground
- Clay (thought to be the Claygate Member)

Made ground was encountered in borehole WS01 to a depth of 1.50m, it contained very occasional pieces of brick and concrete in a clay matrix.

Beneath the made ground, all boreholes encountered a generally soft to firm brown sandy clay with gravel; this was thought to represent superficial Head Deposits. Below the Head Deposits a firm grey sandy clay was encountered (Claygate Member).

- WS01 was terminated in the clay at a depth of 6.45m below ground level (bgl),
- WS02 was terminated in the clay at a depth of 6.45m bgl,

Water was encountered at approximately 4.5m bgl in both WS01 and WS02 during the drilling program. It should be noted that this report does not include post fieldwork groundwater monitoring. Given the depth of the proposed development it is considered unlikely that significant groundwater volumes will be encountered during the construction works. The exact location of the buried river channel, shown on the old OS maps as being directly to the west of the proposed development, was not identified by the site investigation it is recommended that allowance be made for the excavation of a trial trench on the site boundary at the commencement of the construction works.

With regard to foundations the made ground will be an unsuitable founding strata. If traditional foundations are to be employed then a bearing capacity of 60kN/m² should be employed for design purposes.

The Atterberg Limits tests carried out show that the ground may be classified as clay of intermediate to high plasticity and therefore will have a medium volume change potential. The foundation designs should account for this and the location of trees on and adjacent to the site whether they are retained or removed.

Visual and olfactory evidence where present is recorded on the exploratory hole logs within the relevant soil descriptions. Anthropogenic material recorded within the made ground included brick and concrete.

5.2 Chemical Considerations

5.2.1 Human health

The results of the chemical analysis are presented in full in Appendix 3. Given the proposed development which is a building to house a swimming pool with associated paved areas around the building it is considered that none of the results present a concern with regard to human health in relation to the end users of the development.

With regard to the short term exposure to construction workers the use of the correct PPE and provision of appropriate welfare facilities should mitigate any risk presented.

5.2.2 Potable Water Supply Pipes

Plastic pipes can be affected by the presence of contamination leading to stress cracking and or permeation. Following an initial screen as set out in the table below the results indicate the near surface soils are suitable for plastic water supply pipes. If water supply pipes are required as part of the works early consultation with the local water supplier is recommended in order to confirm their acceptance of these findings.

5.2.3 Buried Concrete

The presence of sulphate can have a deleterious effect on concrete. Given the results of the pH tests (6.58 to 8.6) and sulphate tests (<0.01 – 0.0549 g/l), the soils tested in WS01 and WS02 are classified as DS-1 for concrete design.

5.2.4 Classification of Arising's for Disposal to Landfill



The two waste acceptance criteria (WAC) tests undertaken on samples indicate that the arisings from the excavation works will be suitable for disposal to an inert landfill. Similarly, natural soils free from the impact of the overlying made ground or from historic spillages of contaminants should classify as listed inert. The results of the WAC tests should be made available to all interested parties.

6.0 CONCLUSIONS AND RECOMMENDATIONS

6.1 Conclusions


- It is proposed to construct an indoor swimming pool at the end of the rear garden 59 Redington Road.
- The site is underlain by Head Deposits overlying the Claygate Member (clay and silt), with 1.50m of made ground being encountered in borehole WS01.
- For foundation design purposes a bearing capacity of 60kN/m² should be employed, assuming traditional foundations within the Head Deposits.
- Further assessment should be undertaken on the risks the trees pose to foundation depths due to the plastic nature of the clays.
- Groundwater is not expected to be encountered within the excavation works, however further investigation of the location of the buried river channel close to the western boundary of the site is recommended.
- There are no significant concerns with regard to ground contamination and the proposed development.
- It is recommended that the water supply company is contacted to confirm acceptance that plastic pipes are suitable.
- Vigilance should be maintained during groundworks in case different ground conditions from those anticipated are encountered.

FIGURES

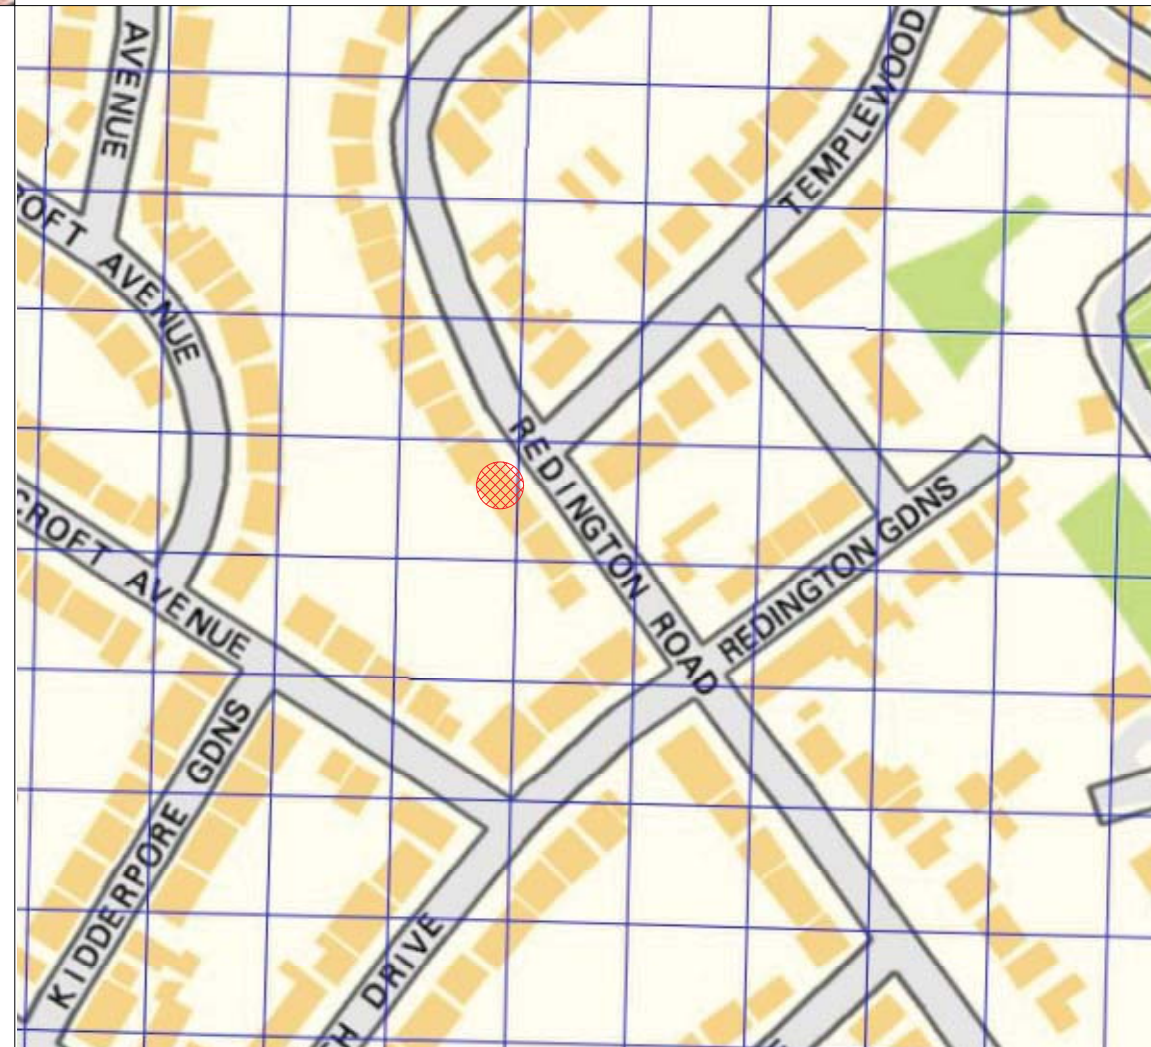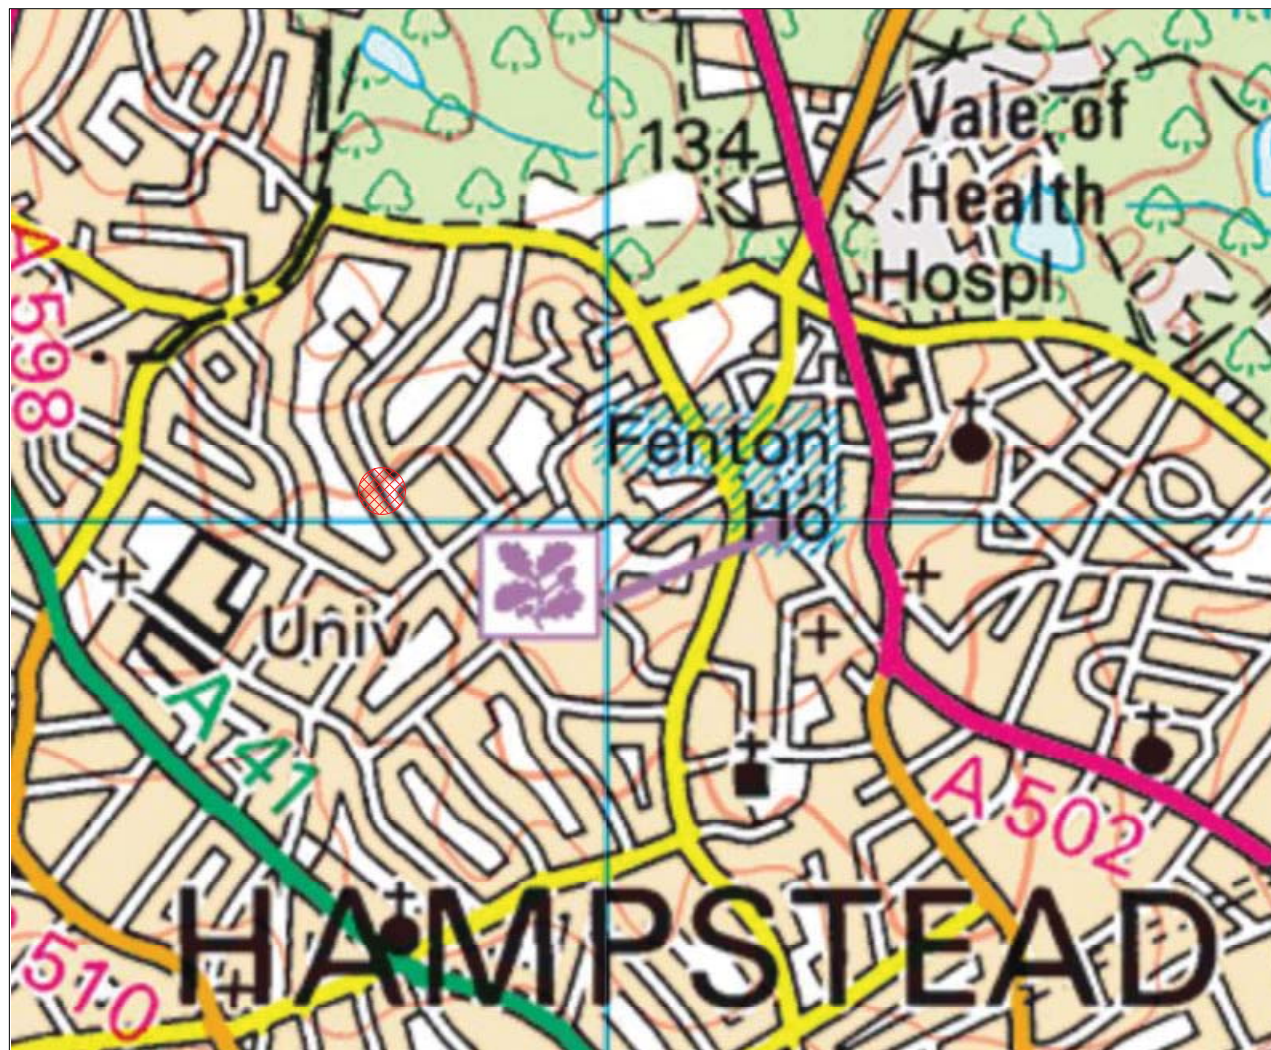

NOTES

1.



01	First Issue	RW	30/08/16
Rev.	Revision Detail	Drawn	Date

Based upon Ordnance Survey Mapping with permission of controller of HMSO. Crown copyright license no. 100045347. This drawing must not be copied or reproduced without written consent from Key GeoSolutions Ltd.



PROJECT:
59 Redington Road



TITLE:
Site Location Plan

Drawn:	Checked:	Date:
RW	BD	Aug '16
Scale:	Original Sheet Size:	Status:
NTS	A3	

Drawing No.	Revision:
Figure 1	01

NOTES

1.

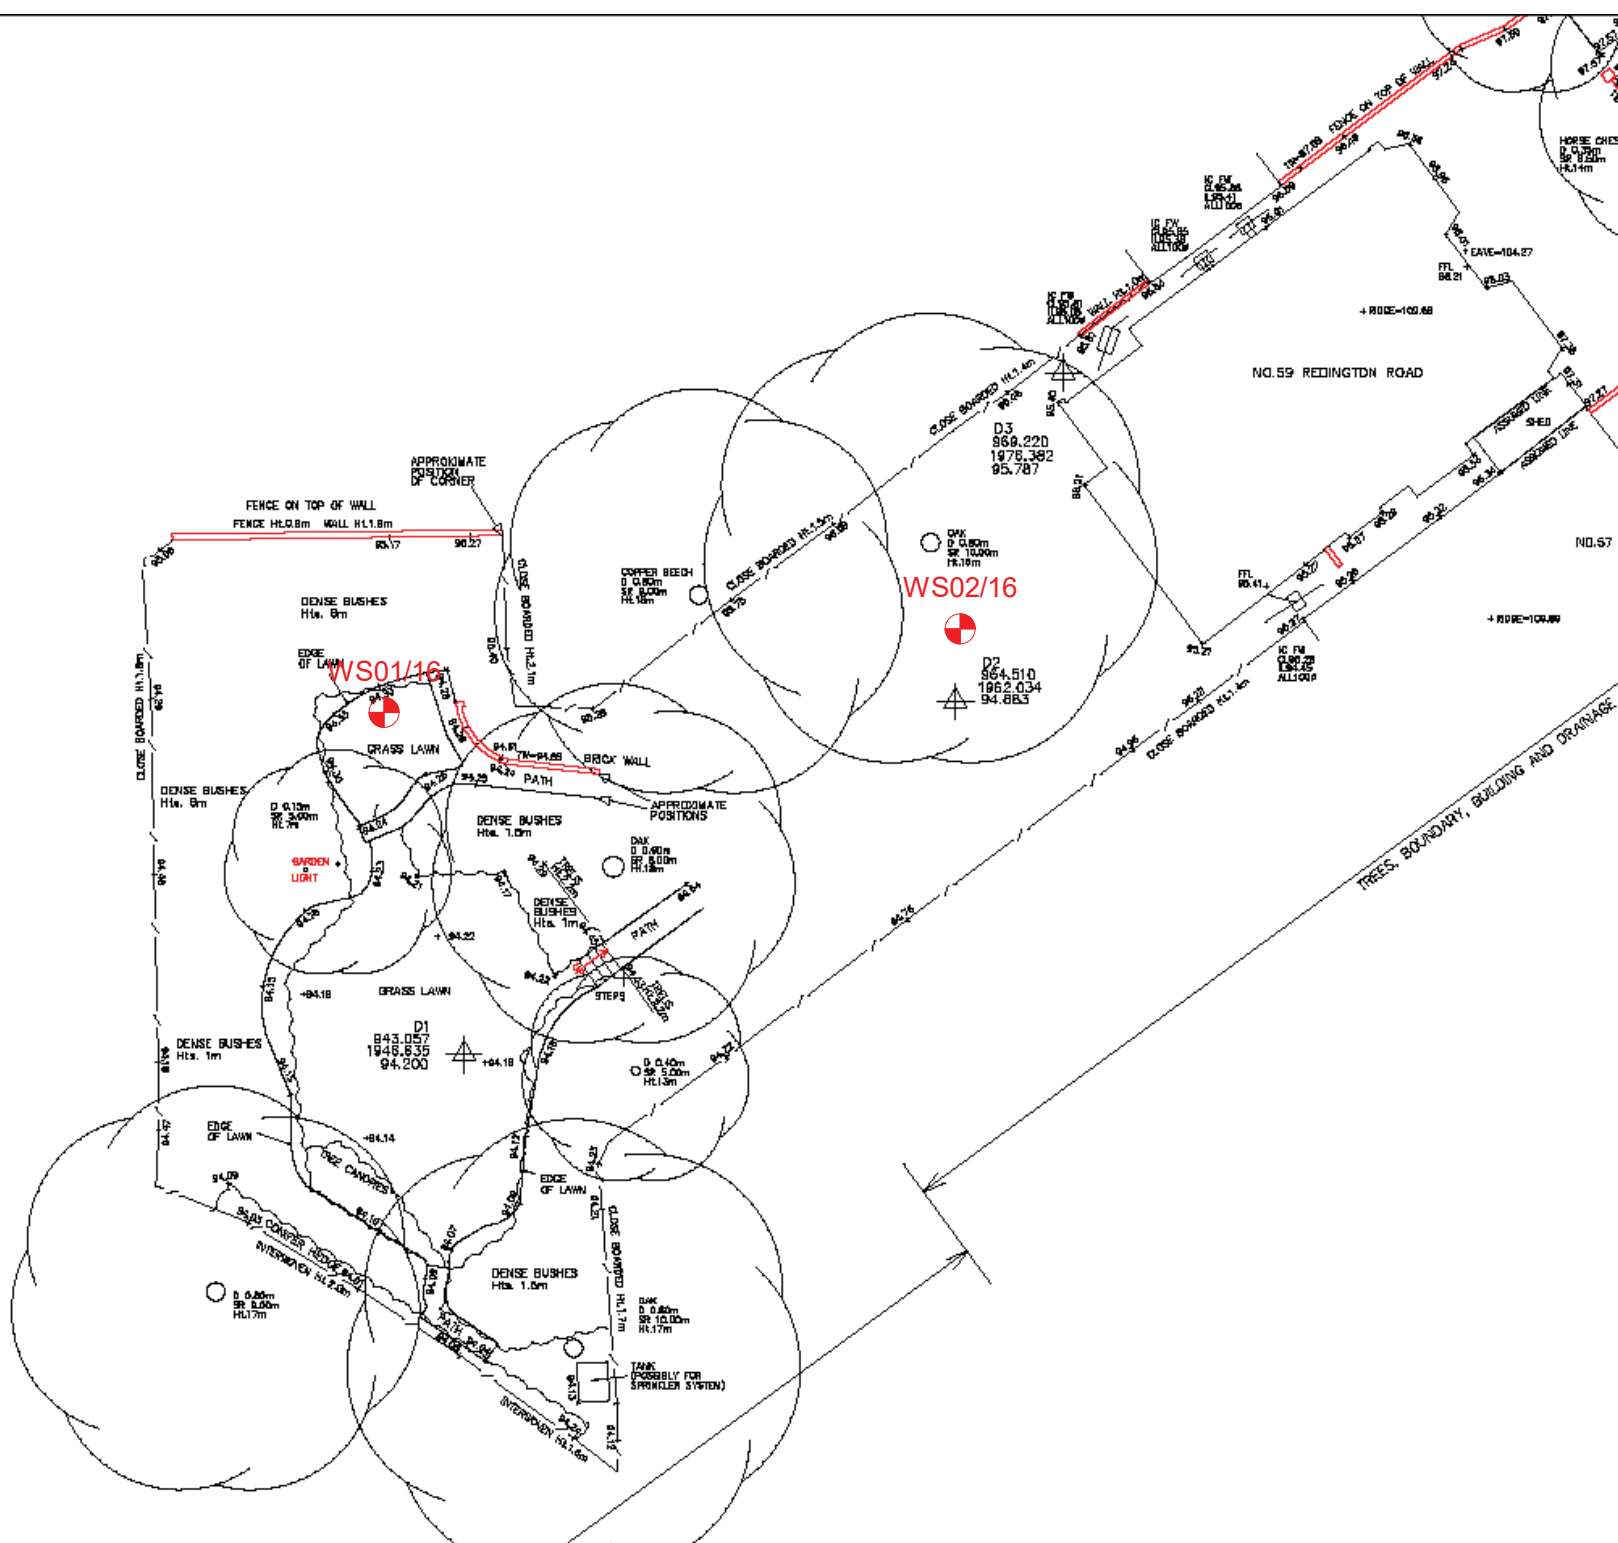

01	First Issue	RW	30/08/16
Rev.	Revision Detail	Drawn	Date

Based upon Ordnance Survey Mapping with permission of controller of HMSO. Crown copyright license no. 100045347. This drawing must not be copied or reproduced without written consent from Key GeoSolutions Ltd.



PROJECT:
Redington Road

TITLE:
BH Location Plan

Drawn:	Checked:	Date:
RW	BD	Aug '16
Scale:	Original Sheet Size:	Status:
NTS	A4	DRAFT

Drawing No.	Revision:
Figure 2	01

Key GeoSolutions Ltd

Nova House
Audley Avenue
Newport
Shropshire TF10 7DW
Tel: 01952 822960
E-mail: info@keygs.com
Web: www.keygs.com

















APPENDICES

APPENDIX 1
Envirocheck Report

APPENDIX 2

Window Sample Logs

CLIENT SIAW PROJECT NAME 59 Redington Road
 PROJECT NUMBER 16-248 PROJECT LOCATION London, NW3 7RP
 DATE STARTED 4/8/16 COMPLETED 4/8/16 CO-ORDINATES 525596 mE, 186001 mN
 DRILLING CONTRACTOR Dynamic Sampling UK GROUND ELEVATION _____ HOLE SIZE _____
 DRILLING METHOD Windowless Sampler LOGGED BY Ruby Westnedge CHECKED BY BD

DEPTH (m)	SAMPLE TYPE NUMBER	BLOW COUNTS (SPTN VALUE)	TESTS	GRAPHIC LOG	MATERIAL DESCRIPTION & REMARKS	WELL DIAGRAM
0.10	J	()			Dark brown clayey SILT with rootlets rare coarse gravel of various lithologies (TOPSOIL)	
1.50	SPT	1-1-2-2 (6)			Soft light brown mottled sandy gravelly CLAY. Gravel is fine to coarse of various lithologies with occasional brick and concrete. [MADEGROUND]	
2.40	SPT	1-2-1-1 (5)			Soft dark brown black sandy CLAY with rare fine to coarse gravel of various lithologies	
3.60	SPT	1-0-1-1 (3)			Soft light brown mottled sandy CLAY with rare cobble	
4.00	SPT	2-2-2-3 (9)			Soft mottled grey yellow sandy CLAY	
4.50	SPT	2-2-2-2 (8)			NO RECOVERY	
5.40	SPT	2-2-3-4 (11)			Firm light mottled grey brown slightly sandy CLAY	
6.45						

Bottom of borehole at 6.45 metres.

NOTES Water seepage at 4.50m

SAMPLE TYPE KEY U = Undisturbed D = Disturbed B = Bulk J = Jar VA = Shear Vane SPT = Standard Penetration Test

GENERAL BH / TP / WELL 59 REDINGTON ROAD.GPJ GINT STD A4 ASTM LAB.GDT 4/10/16

CLIENT SIAW PROJECT NAME 59 Redington Road
 PROJECT NUMBER 16-248 PROJECT LOCATION London, NW3 7RP
 DATE STARTED 4/8/16 COMPLETED 4/8/16 CO-ORDINATES 525609 mE, 186005 mN
 DRILLING CONTRACTOR Dynamic Sampling UK GROUND ELEVATION _____ HOLE SIZE _____
 DRILLING METHOD Windowless Sampler LOGGED BY Ruby Westnedge CHECKED BY BD

DEPTH (m)	SAMPLE TYPE NUMBER	BLOW COUNTS (SPTN VALUE)	TESTS	GRAPHIC LOG	MATERIAL DESCRIPTION & REMARKS	WELL DIAGRAM
0.05	J	()			Dark brown clayey SILT with rootlets rare coarse gravel of various lithologies (TOPSOIL) Soft to firm light brown mottled grey sandy CLAY with rootlets and medium to coarse gravel	
1						
2	SPT	2-2-2-2 (8)				
2.20					Firm reddish brown sandy CLAY with rare fine to medium gravel	
3	SPT	2-3-3-3 (11)				
3.60					Firm grey sandy CLAY	
4	SPT	4-4-5-5 (18)				
4.50						
5	SPT	3-3-3-3 (12)				
5.00					Firm light mottled grey slightly sandy CLAY with light yellow orange sand pockets	
6	SPT	3-4-3-4 (14)				
6.45	SPT	4-5-5-5 (19)				

Bottom of borehole at 6.45 metres.

NOTES Water seepage at 4.50m

SAMPLE TYPE KEY U = Undisturbed D = Disturbed B = Bulk J = Jar VA = Shear Vane SPT = Standard Penetration Test

GENERAL BH / TP / WELL 59 REDINGTON ROAD.GPJ GINT STD A4 ASTM LAB.GDT 4/10/16

APPENDIX 3

Results of Chemical Analyses
(Undertaken by Alcontrol Laboratories)



Key Geosolutions Limited
Nova House
Audley Avenue
Newport
Shropshire
TF10 7DW

Attention:

CERTIFICATE OF ANALYSIS

Date: 22 August 2016
Customer: H_KEYGEO_NPT
Sample Delivery Group (SDG): 160810-122
Your Reference:
Location: Redington Road
Report No: 374532

We received 3 samples on Wednesday August 10, 2016 and 2 of these samples were scheduled for analysis which was completed on Monday August 22, 2016. Accredited laboratory tests are defined within the report, but opinions, interpretations and on-site data expressed herein are outside the scope of ISO 17025 accreditation.

Should this report require incorporation into client reports, it must be used in its entirety and not simply with the data sections alone.

All chemical testing (unless subcontracted) is performed at ALcontrol Hawarden Laboratories.

Approved By:

Sonia McWhan

Operations Manager



SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

Received Sample Overview

Lab Sample No(s)	Customer Sample Ref.	AGS Ref.	Depth (m)	Sampled Date
13942271	WS01		0.10 - 0.30	04/08/2016
13942272	WS01		0.20 - 0.40	04/08/2016
13942273	WS02		0.10 - 0.30	04/08/2016



Only received samples which have had analysis scheduled will be shown on the following pages.



SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

SOLID Results Legend  Test  No Determination Possible	Lab Sample No(s)	13942272	13942273	
	Customer Sample Reference	WS01	WS02	
	AGS Reference			
	Depth (m)	0.20 - 0.40	0.10 - 0.30	
	Container	400g VOC (ALE215) 250g Amber Jar (AL 1kg TUB	60g VOC (ALE215) 400g Tub (ALE214) 250g Amber Jar (AL 1kg TUB	60g VOC (ALE215) 400g Tub (ALE214) 250g Amber Jar (AL 1kg TUB
ANC at pH4 and ANC at pH 6	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Anions by Kone (soil)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Anions by Kone (w)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Asbestos ID in Solid Samples	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Boron Water Soluble	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
CEN Readings	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Cyanide Comp/Free/Total/Thiocyanate	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Dissolved Metals by ICP-MS	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Dissolved Organic/Inorganic Carbon	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
EPH CWG (Aliphatic) GC (S)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
EPH CWG (Aromatic) GC (S)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Fluoride	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
GRO by GC-FID (S)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Loss on Ignition in soils	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Mercury Dissolved	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>



SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

SOLID Results Legend <input checked="" type="checkbox"/> Test <input checked="" type="checkbox"/> No Determination Possible	Lab Sample No(s)	13942272	13942273	
	Customer Sample Reference	WS01	WS02	
	AGS Reference			
	Depth (m)	0.20 - 0.40	0.10 - 0.30	
	Container	250g Amber Jar (AL 1kg TUB 400g Tub (ALE214) 60g VOC (ALE215)	60g VOC (ALE215) 400g Tub (ALE214) 250g Amber Jar (AL 1kg TUB)	
Metals in solid samples by OES	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Mineral Oil	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
NO3, NO2 and TON by KONE (s)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
PAH by GCMS	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
PAH Value of soil	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
PCBs by GCMS	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
pH	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Phenols by HPLC (W)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Sample description	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Total Dissolved Solids	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Total Organic Carbon	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
TPH CWG GC (S)	All	NDPs: 0 Tests: 2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>

SDG: 160810-122
Job: H_KEYGEO_NPT-118
Client Reference:
Location: Redington Road
Customer: Key Geosolutions Limited
Attention:
Order Number:
Report Number: 374532
Superseded Report:

Sample Descriptions

Grain Sizes

very fine	<input type="checkbox"/> <0.063mm	fine	<input type="checkbox"/> 0.063mm - 0.1mm	medium	<input type="checkbox"/> 0.1mm - 2mm	coarse	<input type="checkbox"/> 2mm - 10mm	very coarse	<input type="checkbox"/> >10mm
-----------	-----------------------------------	------	--	--------	--------------------------------------	--------	-------------------------------------	-------------	--------------------------------

Lab Sample No(s)	Customer Sample Ref.	Depth (m)	Colour	Description	Grain size	Inclusions	Inclusions 2
13942272	WS01	0.20 - 0.40	Dark Brown	Sandy Clay	0.063 - 2.00 mm	Stones	Vegetation
13942273	WS02	0.10 - 0.30	Dark Brown	Loamy Sand	0.063 - 2.00 mm	Stones	Fibres

These descriptions are only intended to act as a cross check if sample identities are questioned, and to provide a log of sample matrices with respect to MCERTS validation. They are not intended as full geological descriptions.

We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample.

Other coarse granular materials such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.



SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

Results Legend		Customer Sample R	WS01	WS02			
#	ISO17025 accredited.	Depth (m) Sample Type Date Sampled Sample Time Date Received SDG Ref Lab Sample No.(s) AGS Reference					
M	mCERTS accredited.		0.20 - 0.40	0.10 - 0.30			
aq	Aqueous / settled sample.		Soil/Solid	Soil/Solid			
diss.filt	Dissolved / filtered sample.		04/08/2016	04/08/2016			
tot.unfilt	Total / unfiltered sample.						
*	Subcontracted test.		10/08/2016	10/08/2016			
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery		160810-122	160810-122			
(F)	Trigger breach confirmed		13942272	13942273			
1-5&*\$@	Sample deviation (see appendix)						
Component	LOD/Units		Method				
Moisture Content Ratio (% of as received sample)	%	PM024	15	12			
Loss on ignition	<0.7 %	TM018	5.25	7.43	M	M	
Mineral oil >C10-C40	<1 mg/kg	TM061	38.6	29.8			
Mineral Oil Surrogate % recovery**	%	TM061	88.9	98.8			
Organic Carbon, Total	<0.2 %	TM132	2.14	1.02	M	M	
Soil Organic Matter (SOM)	<0.35 %	TM132	3.69	1.76	#	#	
pH	1 pH Units	TM133	6.58	7.31	M	M	
Cyanide, Total	<1 mg/kg	TM153	<1	<1	M	M	
PCB congener 28	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 52	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 101	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 118	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 138	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 153	<3 µg/kg	TM168	<3	<3	M	M	
PCB congener 180	<3 µg/kg	TM168	<3	<3	M	M	
Sum of detected PCB 7 Congeners	<21 µg/kg	TM168	<21	<21			
Arsenic	<0.6 mg/kg	TM181	10.2	10.3	M	M	
Barium	<0.6 mg/kg	TM181	151	38.3	#	#	
Beryllium	<0.01 mg/kg	TM181	0.818	0.563	M	M	
Cadmium	<0.02 mg/kg	TM181	0.281	0.279	M	M	
Chromium	<0.9 mg/kg	TM181	29.9	25.5	M	M	
Copper	<1.4 mg/kg	TM181	24.3	22.4	M	M	
Lead	<0.7 mg/kg	TM181	130	80.3	M	M	
Mercury	<0.14 mg/kg	TM181	<0.14	<0.14	M	M	
Nickel	<0.2 mg/kg	TM181	15.2	12.5	M	M	
Selenium	<1 mg/kg	TM181	<1	<1	#	#	
Vanadium	<0.2 mg/kg	TM181	46.4	40.5	#	#	
Zinc	<1.9 mg/kg	TM181	72.3	56.8	M	M	
ANC @ pH 4	<0.03 mol/kg	TM182	0.0916	0.115			
ANC @ pH 6	<0.03 mol/kg	TM182	0.0398	0.0413			
Polyaromatic hydrocarbons, Total 17	<10 mg/kg	TM213	21.1	<10			
Boron, water soluble	<1 mg/kg	TM222	<1	<1	M	M	

CERTIFICATE OF ANALYSIS

SDG: 160810-122
Job: H_KEYGEO_NPT-118
Client Reference:

Location: Redington Road
Customer: Key Geosolutions Limited
Attention:

Order Number:
Report Number: 374532
Superseded Report:

Results Legend		Customer Sample R	WS01	WS02				
#	ISO17025 accredited.							
M	mCERTS accredited.	Depth (m)	0.20 - 0.40	0.10 - 0.30				
aq	Aqueous / settled sample.	Sample Type	Soil/Solid	Soil/Solid				
dis.filt	Dissolved / filtered sample.	Date Sampled	04/08/2016	04/08/2016				
tot.unfilt	Total / unfiltered sample.	Sample Time	.	.				
*	Subcontracted test.	Date Received	10/08/2016	10/08/2016				
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery	SDG Ref	160810-122	160810-122				
(F)	Trigger breach confirmed	Lab Sample No.(s)	13942272	13942273				
1-5&\$@	Sample deviation (see appendix)	AGS Reference						
Component	LOD/Units	Method						
Water Soluble Sulphate as SO4 2:1 Extract	<0.004 g/l	TM243	0.0451	0.0549	M	M		
Chloride 2:1 water/soil extract BRE	<0.0025 g/l	TM243	0.0086	0.0074	M	M		
Nitrate as NO3, 2:1 water soluble (BRE)	<0.0003 g/l	TM243	0.00244	0.00785				



SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

PAH by GCMS

Results Legend		Customer Sample R	WS01	WS02			
#	ISO17025 accredited.	Depth (m) Sample Type Date Sampled Sample Time Date Received SDG Ref Lab Sample No.(s) AGS Reference					
M	mCERTS accredited.		0.20 - 0.40	0.10 - 0.30			
aq	Aqueous / settled sample.		Soil/Solid	Soil/Solid			
diss.filt	Dissolved / filtered sample.		04/08/2016	04/08/2016			
tot.unfilt	Total / unfiltered sample.						
*	Subcontracted test.						
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery						
(F)	Trigger breach confirmed		10/08/2016	10/08/2016			
1-5&*\$@	Sample deviation (see appendix)		160810-122	160810-122			
			13942272	13942273			
Component	LOD/Units	Method					
Naphthalene-d8 % recovery**	%	TM218	88.3	99			
Acenaphthene-d10 % recovery**	%	TM218	91.7	102			
Phenanthrene-d10 % recovery**	%	TM218	92.5	102			
Chrysene-d12 % recovery**	%	TM218	85.2	93.1			
Perylene-d12 % recovery**	%	TM218	94.4	106			
Naphthalene	<9 µg/kg	TM218	321	15			
			M	M			
Acenaphthylene	<12 µg/kg	TM218	325	20.9			
			M	M			
Acenaphthene	<8 µg/kg	TM218	699	9.61			
			M	M			
Fluorene	<10 µg/kg	TM218	797	<10			
			M	M			
Phenanthrene	<15 µg/kg	TM218	8800	170			
			M	M			
Anthracene	<16 µg/kg	TM218	2480	41			
			M	M			
Fluoranthene	<17 µg/kg	TM218	11500	438			
			M	M			
Pyrene	<15 µg/kg	TM218	8760	379			
			M	M			
Benz(a)anthracene	<14 µg/kg	TM218	4550	209			
			M	M			
Chrysene	<10 µg/kg	TM218	3640	210			
			M	M			
Benzo(b)fluoranthene	<15 µg/kg	TM218	5180	369			
			M	M			
Benzo(k)fluoranthene	<14 µg/kg	TM218	1970	136			
			M	M			
Benzo(a)pyrene	<15 µg/kg	TM218	4340	250			
			M	M			
Indeno(1,2,3-cd)pyrene	<18 µg/kg	TM218	2150	158			
			M	M			
Dibenzo(a,h)anthracene	<23 µg/kg	TM218	647	42.4			
			M	M			
Benzo(g,h,i)perylene	<24 µg/kg	TM218	2430	206			
			M	M			
PAH, Total Detected USEPA 16	<118 µg/kg	TM218	58600	2650			

SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

TPH CWG (S)

Results Legend		Customer Sample R	WS01	WS02			
#	ISO17025 accredited.	Depth (m) Sample Type Date Sampled Sample Time Date Received SDG Ref Lab Sample No.(s) AGS Reference					
M	mCERTS accredited.		0.20 - 0.40	0.10 - 0.30			
aq	Aqueous / settled sample.		Soil/Solid	Soil/Solid			
diss.filt	Dissolved / filtered sample.		04/08/2016	04/08/2016			
tot.unfilt	Total / unfiltered sample.						
*	Subcontracted test.						
**	% recovery of the surrogate standard to check the efficiency of the method. The results of individual compounds within samples aren't corrected for the recovery						
(F)	Trigger breach confirmed		10/08/2016	10/08/2016			
1-5&*\$@	Sample deviation (see appendix)		160810-122	160810-122			
			13942272	13942273			
Component	LOD/Units	Method					
GRO Surrogate % recovery**	%	TM089	110	88			
GRO TOT (Moisture Corrected)	<44 µg/kg	TM089	<44	<44	M	M	
Methyl tertiary butyl ether (MTBE)	<5 µg/kg	TM089	<5	<5	#	#	
Benzene	<10 µg/kg	TM089	<10	<10	M	M	
Toluene	<2 µg/kg	TM089	<2	<2	M	M	
Ethylbenzene	<3 µg/kg	TM089	3.51	<3	M	M	
m,p-Xylene	<6 µg/kg	TM089	<6	<6	M	M	
o-Xylene	<3 µg/kg	TM089	<3	<3	M	M	
sum of detected mpo xylene by GC	<9 µg/kg	TM089	<9	<9			
sum of detected BTEX by GC	<24 µg/kg	TM089	<24	<24			
Aliphatics >C5-C6	<10 µg/kg	TM089	<10	<10			
Aliphatics >C6-C8	<10 µg/kg	TM089	<10	<10			
Aliphatics >C8-C10	<10 µg/kg	TM089	<10	<10			
Aliphatics >C10-C12	<10 µg/kg	TM089	<10	<10			
Aliphatics >C12-C16	<100 µg/kg	TM173	<100	<100			
Aliphatics >C16-C21	<100 µg/kg	TM173	<100	353			
Aliphatics >C21-C35	<100 µg/kg	TM173	2940	6320			
Aliphatics >C35-C44	<100 µg/kg	TM173	<100	263			
Total Aliphatics >C12-C44	<100 µg/kg	TM173	2940	6930			
Aromatics >EC5-EC7	<10 µg/kg	TM089	<10	<10			
Aromatics >EC7-EC8	<10 µg/kg	TM089	<10	<10			
Aromatics >EC8-EC10	<10 µg/kg	TM089	<10	<10			
Aromatics >EC10-EC12	<10 µg/kg	TM089	<10	<10			
Aromatics >EC12-EC16	<100 µg/kg	TM173	266	377			
Aromatics >EC16-EC21	<100 µg/kg	TM173	4710	1950			
Aromatics >EC21-EC35	<100 µg/kg	TM173	15800	18700			
Aromatics >EC35-EC44	<100 µg/kg	TM173	4240	4520			
Aromatics >EC40-EC44	<100 µg/kg	TM173	1510	1600			
Total Aromatics >EC12-EC44	<100 µg/kg	TM173	25100	25500			
Total Aliphatics & Aromatics >C5-C44	<100 µg/kg	TM173	28000	32400			



SDG: 160810-122
Job: H_KEYGEO_NPT-118
Client Reference:

Location: Redington Road
Customer: Key Geosolutions Limited
Attention:

Order Number:
Report Number: 374532
Superseded Report:

Asbestos Identification - Solid Samples

		Date of Analysis	Analysed By	Comments	Amosite (Brown) Asbestos	Chrysotile (White) Asbestos	Crocidolite (Blue) Asbestos	Fibrous Actinolite	Fibrous Anthophyllite	Fibrous Tremolite	Non-Asbestos Fibre
Cust. Sample Ref. Depth (m) Sample Type Date Sampled Date Received SDG Original Sample Method Number	WS01 0.20 - 0.40 SOLID 04/08/2016 00:00:00 13/08/2016 11:05:40 160810-122 13942272 TM048	18/08/16	Lauren Sargeant	-	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected
Cust. Sample Ref. Depth (m) Sample Type Date Sampled Date Received SDG Original Sample Method Number	WS02 0.10 - 0.30 SOLID 04/08/2016 00:00:00 13/08/2016 11:09:09 160810-122 13942273 TM048	18/08/16	Lauren Sargeant	-	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected (#)	Not Detected

SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

CEN 10:1 SINGLE STAGE LEACHATE TEST

WAC ANALYTICAL RESULTS

REF : BS EN 12457/2

Client Reference	
Mass Sample taken (kg)	0.105
Mass of dry sample (kg)	0.090
Particle Size <4mm	>95%

Site Location	Redington Road
Natural Moisture Content (%)	17.6
Dry Matter Content (%)	85

Case	
SDG	160810-122
Lab Sample Number(s)	13942272
Sampled Date	04-Aug-2016
Customer Sample Ref.	WS01
Depth (m)	0.20 - 0.40

Landfill Waste Acceptance Criteria Limits

Inert Waste Landfill	Stable Non-reactive Hazardous Waste in Non-Hazardous Landfill	Hazardous Waste Landfill
3	5	6
-	-	10
6	-	-
1	-	-
500	-	-
100	-	-
-	>6	-
-	-	-
-	-	-

Solid Waste Analysis	Result
Total Organic Carbon (%)	2.14
Loss on Ignition (%)	5.25
Sum of BTEX (mg/kg)	<0.024
Sum of 7 PCBs (mg/kg)	<0.021
Mineral Oil (mg/kg)	38.6
PAH Sum of 17 (mg/kg)	21.1
pH (pH Units)	6.58
ANC to pH 6 (mol/kg)	0.0398
ANC to pH 4 (mol/kg)	0.0916

Eluate Analysis	C2 Conc ⁿ in 10:1 eluate (mg/l)		A2 10:1 conc ⁿ leached (mg/kg)		Limit values for compliance leaching test using BS EN 12457-3 at L/S 10 l/kg		
	Result	Limit of Detection	Result	Limit of Detection			
Arsenic	0.00106	<0.00051	0.0106	<0.0051	0.5	2	25
Barium	0.0139	<0.0002	0.139	<0.002	20	100	300
Cadmium	<0.00008	<0.00008	<0.0008	<0.0008	0.04	1	5
Chromium	0.00259	<0.0012	0.0259	<0.012	0.5	10	70
Copper	0.00362	<0.00085	0.0362	<0.0085	2	50	100
Mercury Dissolved (CVAF)	0.0000129	<0.00001	0.000129	<0.0001	0.01	0.2	2
Molybdenum	<0.00062	<0.00062	<0.0062	<0.0062	0.5	10	30
Nickel	0.0013	<0.00044	0.013	<0.0044	0.4	10	40
Lead	0.00238	<0.0001	0.0238	<0.001	0.5	10	50
Antimony	0.000296	<0.00016	0.00296	<0.0016	0.06	0.7	5
Selenium	<0.00081	<0.00081	<0.0081	<0.0081	0.1	0.5	7
Zinc	0.00428	<0.0013	0.0428	<0.013	4	50	200
Chloride	<2	<2	<20	<20	800	15000	25000
Fluoride	<0.5	<0.5	<5	<5	10	150	500
Sulphate (soluble)	<2	<2	<20	<20	1000	20000	50000
Total Dissolved Solids	15.5	<5	155	<50	4000	60000	100000
Total Monohydric Phenols (W)	<0.016	<0.016	<0.16	<0.16	1	-	-
Dissolved Organic Carbon	4.22	<3	42.2	<30	500	800	1000

Leach Test Information

Date Prepared	15-Aug-2016
pH (pH Units)	7.98
Conductivity (µS/cm)	17.00
Temperature (°C)	18.30
Volume Leachant (Litres)	0.884

Solid Results are expressed on a dry weight basis, after correction for moisture content where applicable
 Stated limits are for guidance only and ALcontrol cannot be held responsible for any discrepancies with current legislation
 Mcerts Certification does not apply to leachates

22/08/2016 16:22:22

16:22:07 22/08/2016

SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention:

Order Number:
 Report Number: 374532
 Superseded Report:

CEN 10:1 SINGLE STAGE LEACHATE TEST

WAC ANALYTICAL RESULTS

REF : BS EN 12457/2

Client Reference	
Mass Sample taken (kg)	0.102
Mass of dry sample (kg)	0.090
Particle Size <4mm	>95%

Site Location	Redington Road
Natural Moisture Content (%)	13.6
Dry Matter Content (%)	88

Case	
SDG	160810-122
Lab Sample Number(s)	13942273
Sampled Date	04-Aug-2016
Customer Sample Ref.	WS02
Depth (m)	0.10 - 0.30

Landfill Waste Acceptance Criteria Limits

Inert Waste Landfill	Stable Non-reactive Hazardous Waste in Non-Hazardous Landfill	Hazardous Waste Landfill
3	5	6
-	-	10
6	-	-
1	-	-
500	-	-
100	-	-
-	>6	-
-	-	-
-	-	-

Solid Waste Analysis	Result
Total Organic Carbon (%)	1.02
Loss on Ignition (%)	7.43
Sum of BTEX (mg/kg)	<0.024
Sum of 7 PCBs (mg/kg)	<0.021
Mineral Oil (mg/kg)	29.8
PAH Sum of 17 (mg/kg)	<10
pH (pH Units)	7.31
ANC to pH 6 (mol/kg)	0.0413
ANC to pH 4 (mol/kg)	0.115

Eluate Analysis	C2 Conc ^a in 10:1 eluate (mg/l)		A2 10:1 conc ^a leached (mg/kg)		Limit values for compliance leaching test using BS EN 12457-3 at L/S 10 l/kg		
	Result	Limit of Detection	Result	Limit of Detection			
Arsenic	0.000747	<0.00051	0.00747	<0.0051	0.5	2	25
Barium	0.00336	<0.0002	0.0336	<0.002	20	100	300
Cadmium	<0.00008	<0.00008	<0.0008	<0.0008	0.04	1	5
Chromium	<0.0012	<0.0012	<0.012	<0.012	0.5	10	70
Copper	0.0051	<0.00085	0.051	<0.0085	2	50	100
Mercury Dissolved (CVAF)	<0.00001	<0.00001	<0.0001	<0.0001	0.01	0.2	2
Molybdenum	0.000885	<0.00062	0.00885	<0.0062	0.5	10	30
Nickel	0.00105	<0.00044	0.0105	<0.0044	0.4	10	40
Lead	0.00113	<0.0001	0.0113	<0.001	0.5	10	50
Antimony	0.000622	<0.00016	0.00622	<0.0016	0.06	0.7	5
Selenium	<0.00081	<0.00081	<0.0081	<0.0081	0.1	0.5	7
Zinc	0.00295	<0.0013	0.0295	<0.013	4	50	200
Chloride	<2	<2	<20	<20	800	15000	25000
Fluoride	<0.5	<0.5	<5	<5	10	150	500
Sulphate (soluble)	<2	<2	<20	<20	1000	20000	50000
Total Dissolved Solids	30	<5	300	<50	4000	60000	100000
Total Monohydric Phenols (W)	<0.016	<0.016	<0.16	<0.16	1	-	-
Dissolved Organic Carbon	8.45	<3	84.5	<30	500	800	1000

Leach Test Information

Date Prepared	15-Aug-2016
pH (pH Units)	7.68
Conductivity (µS/cm)	34.40
Temperature (°C)	18.70
Volume Leachant (Litres)	0.888

Solid Results are expressed on a dry weight basis, after correction for moisture content where applicable
 Stated limits are for guidance only and ALcontrol cannot be held responsible for any discrepancies with current legislation
 Mcerts Certification does not apply to leachates

22/08/2016 16:22:22

16:22:07 22/08/2016

SDG: 160810-122
Job: H_KEYGEO_NPT-118
Client Reference:

Location: Redington Road
Customer: Key Geosolutions Limited
Attention:

Order Number:
Report Number: 374532
Superseded Report:

Table of Results - Appendix

Method No	Reference	Description	Wet/Dry Sample ¹	Surrogate Corrected
PM001		Preparation of Samples for Metals Analysis		
PM024	Modified BS 1377	Soil preparation including homogenisation, moisture screens of soils for Asbestos Containing Material		
PM115		Leaching Procedure for CEN One Stage Leach Test 2:1 & 10:1 1 Step		
TM018	BS 1377: Part 3 1990	Determination of Loss on Ignition		
TM048	HSG 248, Asbestos: The analysts' guide for sampling, analysis and clearance procedures	Identification of Asbestos in Bulk Material		
TM061	Method for the Determination of EPH, Massachusetts Dept. of EP, 1998	Determination of Extractable Petroleum Hydrocarbons by GC-FID (C10-C40)		
TM089	Modified: US EPA Methods 8020 & 602	Determination of Gasoline Range Hydrocarbons (GRO) and BTEX (MTBE) compounds by Headspace GC-FID (C4-C12)		
TM090	Method 5310, AWWA/APHA, 20th Ed., 1999 / Modified: US EPA Method 415.1 & 9060	Determination of Total Organic Carbon/Total Inorganic Carbon in Water and Waste Water		
TM104	Method 4500F, AWWA/APHA, 20th Ed., 1999	Determination of Fluoride using the Kone Analyser		
TM123	BS 2690: Part 121:1981	The Determination of Total Dissolved Solids in Water		
TM132	In - house Method	ELTRA CS800 Operators Guide		
TM133	BS 1377: Part 3 1990;BS 6068-2.5	Determination of pH in Soil and Water using the GLpH pH Meter		
TM152	Method 3125B, AWWA/APHA, 20th Ed., 1999	Analysis of Aqueous Samples by ICP-MS		
TM153	Method 4500A,B,C, I, M AWWA/APHA, 20th Ed., 1999	Determination of Total Cyanide, Free (Easily Liberatable) Cyanide and Thiocyanate using the Skalar SANS+ System Segmented Flow Analyser		
TM168	EPA Method 8082, Polychlorinated Biphenyls by Gas Chromatography	Determination of WHO12 and EC7 Polychlorinated Biphenyl Congeners by GC-MS in Soils		
TM173	Analysis of Petroleum Hydrocarbons in Environmental Media – Total Petroleum Hydrocarbon Criteria	Determination of Speciated Extractable Petroleum Hydrocarbons in Soils by GC-FID		
TM181	US EPA Method 6010B	Determination of Routine Metals in Soil by iCap 6500 Duo ICP-OES		
TM182	CEN/TC 292 - WI 292046-characterization of waste-leaching Behaviour Tests- Acid and Base Neutralization Capacity Test	Determination of Acid Neutralisation Capacity (ANC) Using Autotitration in Soils		
TM183	BS EN 23506:2002, (BS 6068-2.74:2002) ISBN 0 580 38924 3	Determination of Trace Level Mercury in Waters and Leachates by PSA Cold Vapour Atomic Fluorescence Spectrometry		
TM184	EPA Methods 325.1 & 325.2,	The Determination of Anions in Aqueous Matrices using the Kone Spectrophotometric Analysers		
TM213	In-house Method	Rapid Determination of PAHs by GC-FID		
TM218	Microwave extraction – EPA method 3546	Microwave extraction - EPA method 3546		
TM222	In-House Method	Determination of Hot Water Soluble Boron in Soils (10:1 Water:soil) by IRIS Emission Spectrometer		
TM243		Mixed Anions In Soils By Kone		
TM259	by HPLC	Determination of Phenols in Waters and Leachates by HPLC		

¹ Applies to Solid samples only. DRY indicates samples have been dried at 35°C. NA = not applicable.



SDG: 160810-122
Job: H_KEYGEO_NPT-118
Client Reference:

Location: Redington Road
Customer: Key Geosolutions Limited
Attention:

Order Number:
Report Number: 374532
Superseded Report:

Test Completion Dates

Lab Sample No(s)	13942272	13942273
Customer Sample Ref.	WS01	WS02
AGS Ref.		
Depth	0.20 - 0.40	0.10 - 0.30
Type	SOLID	SOLID
ANC at pH4 and ANC at pH 6	18-Aug-2016	18-Aug-2016
Anions by Kone (soil)	19-Aug-2016	19-Aug-2016
Anions by Kone (w)	17-Aug-2016	17-Aug-2016
Asbestos ID in Solid Samples	19-Aug-2016	19-Aug-2016
Boron Water Soluble	19-Aug-2016	19-Aug-2016
CEN 10:1 Leachate (1 Stage)	15-Aug-2016	15-Aug-2016
CEN Readings	17-Aug-2016	17-Aug-2016
Cyanide Comp/Free/Total/Thiocyanate	17-Aug-2016	17-Aug-2016
Dissolved Metals by ICP-MS	18-Aug-2016	18-Aug-2016
Dissolved Organic/Inorganic Carbon	18-Aug-2016	18-Aug-2016
EPH CWG (Aliphatic) GC (S)	19-Aug-2016	19-Aug-2016
EPH CWG (Aromatic) GC (S)	19-Aug-2016	19-Aug-2016
Fluoride	18-Aug-2016	18-Aug-2016
GRO by GC-FID (S)	18-Aug-2016	18-Aug-2016
Loss on Ignition in soils	22-Aug-2016	22-Aug-2016
Mercury Dissolved	18-Aug-2016	18-Aug-2016
Metals in solid samples by OES	18-Aug-2016	18-Aug-2016
Mineral Oil	18-Aug-2016	18-Aug-2016
NO3, NO2 and TON by KONE (s)	19-Aug-2016	19-Aug-2016
PAH by GCMS	19-Aug-2016	19-Aug-2016
PAH Value of soil	16-Aug-2016	16-Aug-2016
PCBs by GCMS	18-Aug-2016	18-Aug-2016
pH	18-Aug-2016	18-Aug-2016
Phenols by HPLC (W)	18-Aug-2016	18-Aug-2016
Sample description	13-Aug-2016	13-Aug-2016
Total Dissolved Solids	17-Aug-2016	17-Aug-2016
Total Organic Carbon	19-Aug-2016	19-Aug-2016
TPH CWG GC (S)	19-Aug-2016	19-Aug-2016

SDG: 160810-122
 Job: H_KEYGEO_NPT-118
 Client Reference:

Location: Redington Road
 Customer: Key Geosolutions Limited
 Attention: Ruby

Order Number:
 Report Number: 374532
 Superseded Report:

Appendix

General

- Results are expressed on a dry weight basis (dried at 35°C) for all soil analyses except for the following: NRA and CEN Leach tests, flash point LOI, pH, ammonium as NH4 by the BRE method, VOC TICs and SVOC TICs.
- Samples will be run in duplicate upon request, but an additional charge may be incurred.
- If sufficient sample is received a sub sample will be retained free of charge for 30 days after analysis is completed (e-mailed) for all sample types unless the sample is destroyed on testing. The prepared soil sub sample that is analysed for asbestos will be retained for a period of 6 months after the analysis date. All bulk samples will be retained for a period of 6 months after the analysis date. All samples received and not scheduled will be disposed of one month after the date of receipt unless we are instructed to the contrary. Once the initial period has expired, a storage charge will be applied for each month or part thereof until the client cancels the request for sample storage. ALcontrol Laboratories reserve the right to charge for samples received and stored but not analysed.
- With respect to turnaround, we will always endeavour to meet client requirements wherever possible, but turnaround times cannot be absolutely guaranteed due to so many variables beyond our control.
- We take responsibility for any test performed by sub-contractors (marked with an asterisk). We endeavour to use UKAS/MCERTS Accredited Laboratories, who either complete a quality questionnaire or are audited by ourselves. For some determinands there are no UKAS/MCERTS Accredited Laboratories, in this instance a laboratory with a known track record will be utilised.
- When requested, the individual sub sample scheduled will be analysed in house for the presence of asbestos fibres and asbestos containing material by our documented in house method TM048 based on HSG 248 (2005), which is accredited to ISO17025. If a specific asbestos fibre type is not found this will be reported as "Not detected". If no asbestos fibre types are found all will be reported as "Not detected" and the sub sample analysed deemed to be clear of asbestos. If an asbestos fibre type is found it will be reported as detected (for each fibre type found). Testing can be carried out on asbestos positive samples, but, due to Health and Safety considerations, may be replaced by alternative tests or reported as No Determination Possible (NDP). The quantity of asbestos present is not determined unless specifically requested.
- If no separate volatile sample is supplied by the client, or if a headspace or sediment is present in the volatile sample, the integrity of the data may be compromised. This will be flagged up as an invalid VOC on the test schedule and the result marked as deviating on the test certificate.
- If appropriate preserved bottles are not received preservation will take place on receipt. However, the integrity of the data may be compromised.
- NDP - No determination possible due to insufficient/unsuitable sample.
- Metals in water are performed on a filtered sample, and therefore represent dissolved metals - total metals must be requested separately.
- Results relate only to the items tested.
- LoDs (Limit of Detection) for wet tests reported on a dry weight basis are not corrected for moisture content.
- Surrogate recoveries** - Surrogates are added to your sample to monitor recovery of the test requested. A % recovery is reported, results are not corrected for the recovery measured. Typical recoveries for organics tests are 70-130%, they are generally wider for volatiles analysis, 50-150%. Recoveries in soils are affected by organic rich or clay rich matrices. Waters can be affected by remediation fluids or high amounts of sediment. Test results are only ever reported if all of the associated quality checks pass; it is assumed that all recoveries outside of the values above are due to matrix affect.
- Product analyses** - Organic analyses on products can only be semi-quantitative due to the matrix effects and high dilution factors employed.
- Phenols monohydric by HPLC include phenol, cresols (2-Methylphenol, 3-Methylphenol and 4-Methylphenol) and Xylenols (2,3 Dimethylphenol, 2,4 Dimethylphenol, 2,5 Dimethylphenol, 2,6 Dimethylphenol, 3,4 Dimethylphenol, 3,5 Dimethylphenol).
- Total of 5 speciated phenols by HPLC includes Phenol, 2,3,5-Trimethyl Phenol, 2-Isopropylphenol, Cresols and Xylenols (as detailed in 15).
- Stones/debris are not routinely removed. We always endeavour to take a representative sub sample from the received sample.
- In certain circumstances the method detection limit may be elevated due to the sample being outside the calibration range. Other factors that may contribute to this include possible interferences. In both cases the sample would be diluted which would cause the method detection limit to be raised.
- Mercury results quoted on soils will not include volatile mercury as the analysis is performed on a dried and crushed sample.

- For the BSEN 12457-3 two batch process to allow the cumulative release to be calculated, the volume of the leachate produced is measured and filtered for all tests. We therefore cannot carry out any unfiltered analysis. The tests affected include volatiles GCFID/GCMS and all subcontracted analysis.
- For leachate preparations other than Zero Headspace Extraction (ZHE) volatile loss may occur.
- We are accredited to MCERTS for sand, clay and loam/topsoil, or any of these materials - whether these are derived from naturally occurring soil profiles, or from fill/made ground, as long as these materials constitute the major part of the sample. Other coarse granular material such as concrete, gravel and brick are not accredited if they comprise the major part of the sample.
- Analysis and identification of specific compounds using GCFID is by retention time only, and we routinely calibrate and quantify for benzene, toluene, ethylbenzenes and xylenes (BTEX). For total volatiles in the C5-C12 range, the total area of the chromatogram is integrated and expressed as ug/kg or ug/l. Although this analysis is commonly used for the quantification of gasoline range organics (GRO), the system will also detect other compounds such as chlorinated solvents, and this may lead to a falsely high result with respect to hydrocarbons only. It is not possible to specifically identify these non-hydrocarbons, as standards are not routinely run for any other compounds, and for more definitive identification, volatiles by GCMS should be utilised.
- Tentatively Identified Compounds (TICs)** are non-target peaks in VOC and SVOC analysis. All non-target peaks detected with a concentration above the LoD are subjected to a mass spectral library search. Non-target peaks with a library search confidence of >75% are reported based on the best mass spectral library match. When a non-target peak with a library search confidence of <75% is detected it is reported as "mixed hydrocarbons". Non-target compounds identified from the scan data are semi-quantified relative to one of the deuterated internal standards, under the same chromatographic conditions as the target compounds. This result is reported as a semi-quantitative value and reported as Tentatively Identified Compounds (TICs). TICs are outside the scope of UKAS accreditation and are not moisture corrected.

Sample Deviations

1	Container with Headspace provided for volatiles analysis
2	Incorrect container received
3	Deviation from method
4	Holding time exceeded before sample received
5	Samples exceeded holding time before preservation was performed
\$	Sampled on date not provided
♦	Sample holding time exceeded in laboratory
@	Sample holding time exceeded due to sampled on date
&	Sample Holding Time exceeded - Late arrival of instructions.

Asbestos

Identification of Asbestos in Bulk Materials & Soils

The results for identification of asbestos in bulk materials are obtained from supplied bulk materials which have been examined to determine the presence of asbestos fibres using ALcontrol Laboratories (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2005).

The results for identification of asbestos in soils are obtained from a homogenised sub sample which has been examined to determine the presence of asbestos fibres using ALcontrol Laboratories (Hawarden) in-house method of transmitted/polarised light microscopy and central stop dispersion staining, based on HSG 248 (2005).

Asbestos Type	Common Name
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	-
Fibrous Anorthophyllite	-
Fibrous Tremolite	-

Visual Estimation Of Fibre Content

Estimation of fibre content is not permitted as part of our UKAS accredited test other than: - Trace - Where only one or two asbestos fibres were identified.

Further guidance on typical asbestos fibre content of manufactured products can be found in HSG 264.

The identification of asbestos containing materials and soils falls within our schedule of tests for which we hold UKAS accreditation, however opinions, interpretations and all other information contained in the report are outside the scope of UKAS accreditation.

APPENDIX 4

Results of Physical & Chemical Analyses
(Undertaken by Terra Tek Laboratories)

Key GeoSolutions Limited
 Suite 6
 Nova House
 Audley Avenue Enterprise Park
 Newport
 Shropshire, TF10 7DW
 For the attention of Ruby Westnedge




Report No: **B20218**
 Issue No **01**

LABORATORY TEST REPORT

Project Name	REDINGTON ROAD		
Project Number	B20218	Date samples received	10/08/2016
Your Ref		Date written instructions received	10/08/2016
Purchase Order	16-59	Date testing commenced	10/08/2016
Please find enclosed the results as summarised below			
Figure / Table	Test Quantity	Description	ISO 17025 Accredited
1	~	Summary of Geotechnical Tests	See Table
2	3	BRE Suite - Soil	See Report
3 - 5	3	Atterberg Limit	Yes
App X	~	Sample Descriptions - Soil	N/A
App Y	~	Summary of In-House Analytical Test Methods - Soil	N/A
Remarks :			
Issued by : Stephen Langman		Date of Issue : 24/08/2016	Key to symbols used in this report S/C : Testing was sub-contracted
Approved Signatories : <i>S. Langman</i> 24/08/2016			
G Wilson (JMD/Laboratories Director), S Langman (Laboratory Coordinator)			
<p>Unless we are notified to the contrary, samples will be disposed after a period of one month from this date. The results reported relate to samples received in the laboratory only. All results contained in this report are provisional unless signed by an approved signatory This report should not be reproduced except in full without the written approval of the laboratory. Under multisite accreditation the testing contained in this report may have been performed at another Terra Tek laboratory. The enclosed results remain the property of Terra Tek Limited and we reserve the right to withdraw our report if we have not received cleared funds in accordance with our standard terms and conditions Only those results indicated in this report are UKAS accredited and any opinions or interpretations expressed are outside the scope of UKAS accreditation. Feedback on the this report may be left via our website www.terratek.co.uk/contact-us</p>			



Moor Lane, Witton, Birmingham, B6 7HG
 Tel: +44 (0)121 344 4838 Fax: +44 (0)121 356 3599
birmingham@terratek.co.uk
www.terratek.co.uk
 Terra Tek Ltd is registered in Scotland No. 121594
 Offices in Airdrie, Birmingham, Belfast and Chesham

				Site REDINGTON ROAD Client Key GeoSolutions Limited Engineer											Contract No B20218					
Sample Identification				Lab Sample ID	Non Engineering Sample Description	Moisture Content	Atterberg limits					Particle Density	Density		Total Stress			Other Tests		
Exploratory Hole	Depth m	Sample Ref	Sample Type				Liquid Limit	Plastic Limit	Plasticity Index	Percentage retained 425µm	Atterberg Classification		Bulk	Dry	Shear Strength	Apparent Cohesion C	Angle of Shearing Resistance Phi			
						%	%	%	%		Mg/m³	Mg/m³	Mg/m³	kPa	kPa					
WS01	1.00-1.20		T	298210	Brown silty SAND	29	56	22	34	8	CH						BRE SD1 Suite			
WS01	5.90-6.00		D	298211	Brown sandy CLAY with occasional fine gravel.	28	47	21	26	0	CI						BRE SD1 Suite			
WS02	1.00-1.50		T	298212	Brown SAND	26	60	22	38	0	CH						BRE SD1 Suite			
Notes Opinions and interpretations are outside the scope of UKAS accreditation						UKAS Accredited Test Y/N											Test details are given on the 'Notes on Laboratory Procedures' sheet		See individual report sheets	
Originator	Approved		SUMMARY OF GEOTECHNICAL TESTS														 Figure 1 Sheet 1 of 1			
ME	 24/08/2016																			

1140 - BRE Suite Soil - B20218 01.xls
 Version 011 - 26/07/2012
 Lab Project No B20218 : 24/08/2016 18:01:28
 Moor Lane, Wotton, Birmingham, B6 7HG

 TERRA TEK SITE INVESTIGATION AND LABORATORY SERVICES	Site	REDINGTON ROAD	Contract No B20218
	Client	Key GeoSolutions Limited	
	Engineer		

Sample Identification				Lab Sample ID	Sulphate (acid soluble as SO4) %	Sulphate (water soluble in 2:1 extract) as SO4 g/l	pH	Chloride (water soluble) %	Magnesium (water soluble in 2:1 extract) mg/l	Ammoniacal Nitrogen (as N) mg/kg	Nitrate mg/kg	Total Sulphur %											
Hole	Depth m	Sample Ref	Sample Type																				
WS01	1.00-1.20		T	298210	<0.02	<0.01	8.6	<0.01	25	<1.0	<1	<0.05											
WS01	5.90-6.00		D	298211	0.08	0.02	8.4	<0.01	23	<1.0	<1	<0.05											
WS02	1.00-1.50		T	298212	0.10	<0.01	8.6	<0.01	19	<1.0	<1	<0.05											
Limits of Detection Terra Tek Analysis Method					0.02 TP029 M	0.01 TP043 M	~ TP019 M	0.01 TP134 M	1 S/C N	<1.0 TP072 N	1 S/C N	0.05 S/C N											
Accreditation M=Mcerts U=UKAS N=No accreditation																							

Originator	Checked & Approved	BRE SD1 SUITE - SOIL	 Figure 2 Sheet 1 of 1
TGH	 24/08/2016		



SITE INVESTIGATION AND LABORATORY SERVICES

Site REDINGTON ROAD

Client Key GeoSolutions Limited

Engineer

Contract No. B20218

Hole ID WS01



Sample Ref

Depth (m) 1.00-1.20

Sample Type T

Non Engineering Description : Brown sandy CLAY with some gravel. Gravel is fine to medium.

Preparation : Sample as received

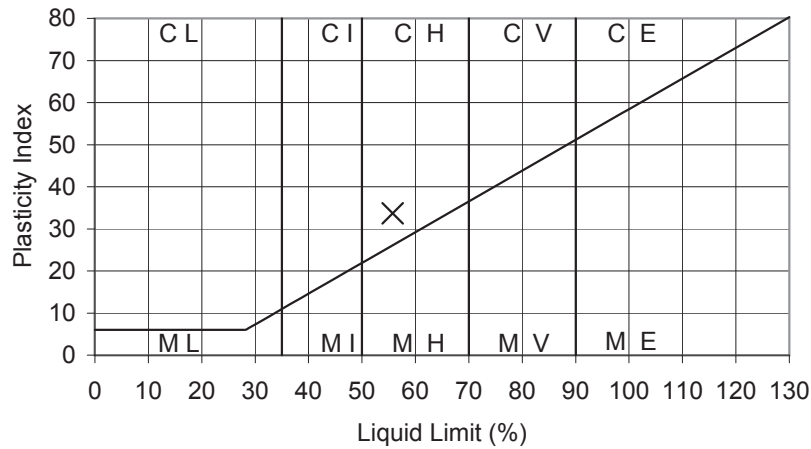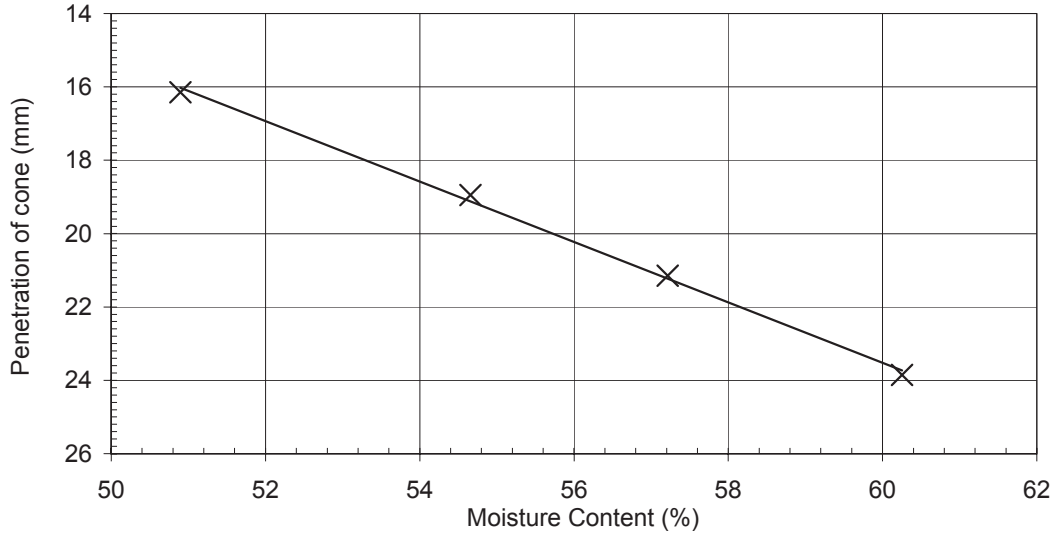

Results :

As Received Moisture Content : (BS1377:Part 2:Clause 3:1990) 29 %
 Percentage retained on 425µm sieve : 8 %
 Liquid Limit : 56 %
 Plastic Limit : 22 %
 Plasticity Index : 34
 Equivalent moisture content of material passing 425µm sieve : 32 %
 Liquidity Index : 0.29

Originator	Checked & Approved
TE/ME	<i>S. Laguerre</i> 24/08/2016

**Liquid Limit (Four Point Cone Penetrometer Method)
 Plastic Limit, Plasticity Index & Liquidity Index**
 BS 1377:Part 2:Clause 4.3:1990
 BS 1377:Part 2:Clause 5:1990



Figure 3



SITE INVESTIGATION AND LABORATORY SERVICES

Site REDINGTON ROAD

Client Key GeoSolutions Limited

Engineer

Contract No. B20218

Hole ID WS01



Sample Ref

Depth (m) 5.90-6.00

Sample Type D

Non Engineering Description : Brown mottled grey slightly sandy CLAY.

Preparation : Sample as received

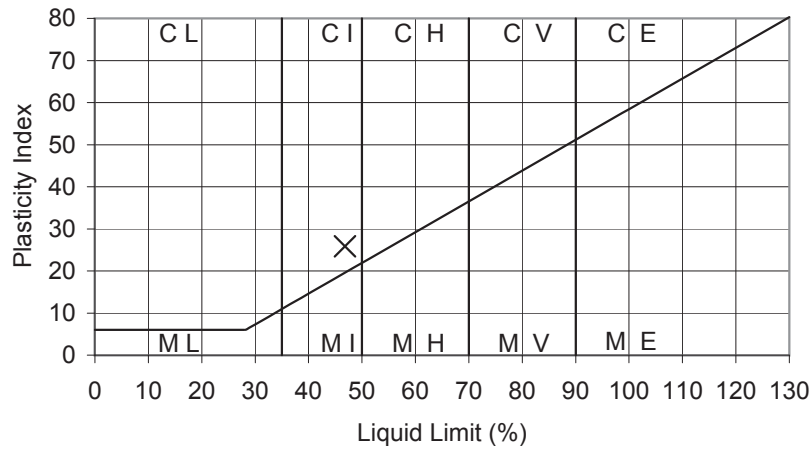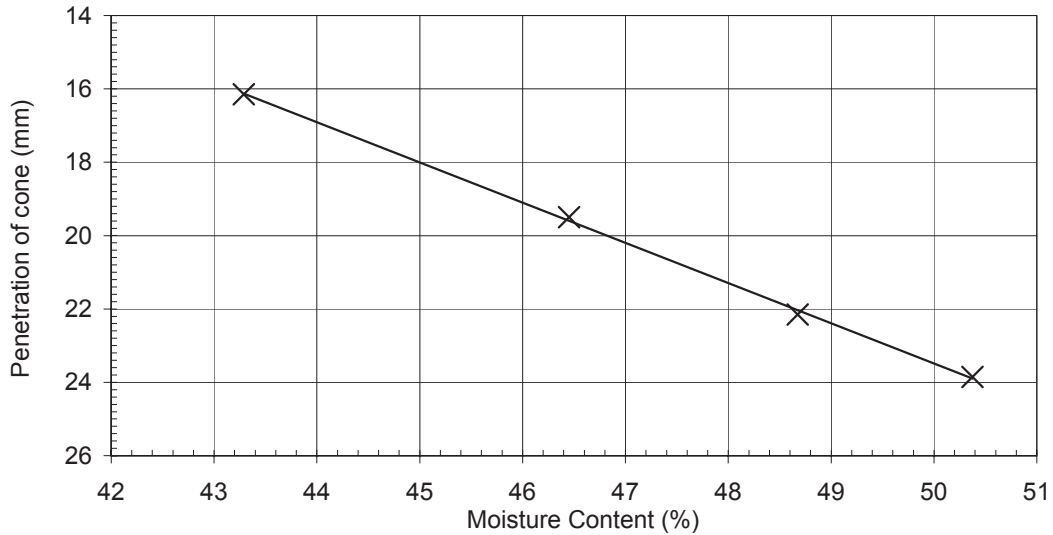

Results :

As Received Moisture Content : (BS1377:Part 2:Clause 3:1990)	28 %
Percentage retained on 425µm sieve :	0 %
Liquid Limit :	47 %
Plastic Limit :	21 %
Plasticity Index :	26
Equivalent moisture content of material passing 425µm sieve :	28 %
Liquidity Index :	0.27

Originator	Checked & Approved
TE/ME	<i>S. Laguerre</i> 24/08/2016

**Liquid Limit (Four Point Cone Penetrometer Method)
 Plastic Limit, Plasticity Index & Liquidity Index**
 BS 1377:Part 2:Clause 4.3:1990
 BS 1377:Part 2:Clause 5:1990



Figure 4



SITE INVESTIGATION AND LABORATORY SERVICES

Site REDINGTON ROAD

Client Key GeoSolutions Limited

Engineer

Contract No. B20218

Hole ID WS02



Sample Ref

Depth (m) 1.00-1.50

Sample Type T

Non Engineering Description : Brown slightly sandy CLAY.

Preparation : Sample as received

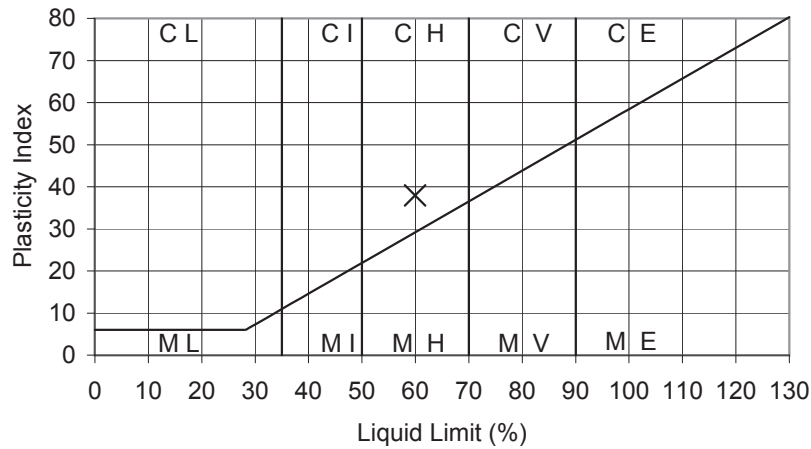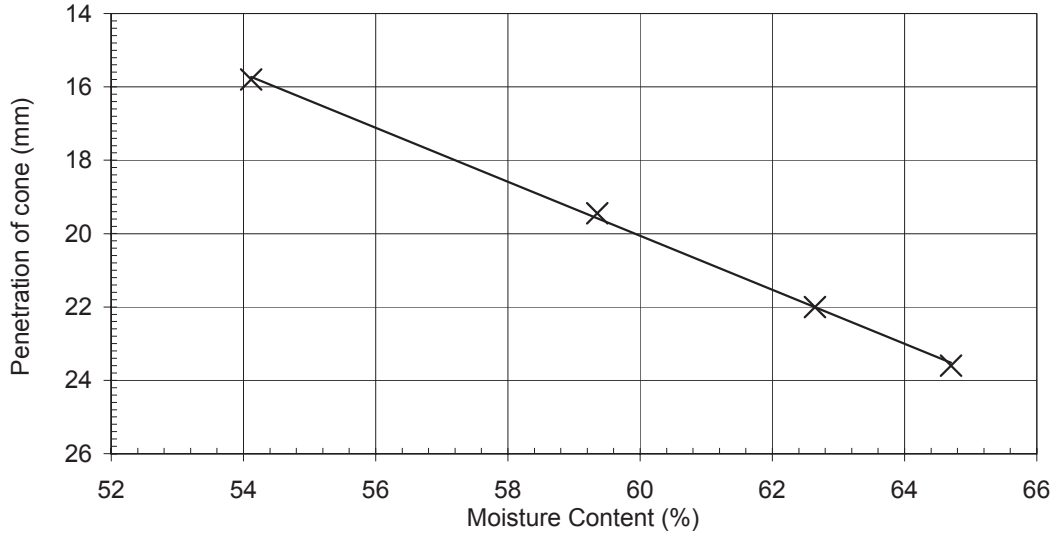

Results :

As Received Moisture Content : (BS1377:Part 2:Clause 3:1990)	26 %
Percentage retained on 425µm sieve :	0 %
Liquid Limit :	60 %
Plastic Limit :	22 %
Plasticity Index :	38
Equivalent moisture content of material passing 425µm sieve :	26 %
Liquidity Index :	0.11

Originator

Checked & Approved

TE/ME

S. Laguerre
24/08/2016

**Liquid Limit (Four Point Cone Penetrometer Method)
 Plastic Limit, Plasticity Index & Liquidity Index**


BS 1377:Part 2:Clause 4.3:1990

BS 1377:Part 2:Clause 5:1990



Figure 5

Sheet 1 of 1



 <small>SITE INVESTIGATION AND LABORATORY SERVICES</small>	Site	REDINGTON ROAD	Contract No B20218
	Client	Key GeoSolutions Limited	
	Engineer		


Sample Identification				Lab Sample ID	Date Sampled	Temperature of cool box on receipt °C	Description
Exploratory Hole	Depth m	Sample Ref	Sample Type				
WS01	1.00-1.20		T	298210	04/08/16	10.2	Brown silty SAND
WS01	5.90-6.00		D	298211	04/08/16	10.2	Brown sandy CLAY with occasional fine gravel.
WS02	1.00-1.50		T	298212	04/08/16	10.2	Brown SAND

Notes

1. Where a date of sampling is not provided, the sample is classified as deviating.
2. Temperatures exceeding 6°C on receipt may be deviating, but will be dependent upon the suite of tests carried out.
3. Samples are considered deviating if the incorrect sample container type has been used. This is indicated within the report tables.
4. Results reported for samples classified as deviating may be compromised.

Originator	Checked & Approved	LABORATORY DESCRIPTIONS	 Appendix X
TGH	 24/08/2016		

 TERRA TEK <small>SITE INVESTIGATION AND LABORATORY SERVICES</small>		Site REDINGTON ROAD	Contract No B20218		
		Client Key GeoSolutions Limited			
		Engineer			
Method Code	Reference	Description of Method	ISO17025 Accredited	MCERTS Accredited	Wet/Dry Sample Tested
GP001	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Preparation of soil samples for chemical analysis	Yes	Yes	N/A
GP012	BS EN 12457-3: Characterisation of Waste - Compliance test for leaching of granular waste materials and sludges (two-stage batch test)	Preparation of soil samples for two-stage leachate test			Dry
TP019	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of pH in 2.5:1 water/soil extract using pH meter.	Yes	Yes	Dry
TP029	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of acid soluble sulfate by gravimetry.	Yes	Yes	Dry
TP032	MAFF Book 427: The Analysis of Agricultural Materials: Method 8	Determination of water soluble boron by colorimetry	Yes		Dry
TP033	APHA/AWWA, 19th edition: Method 5520E	Determination of Toluene Extractable Matter by soxhlet extraction.	Yes		Dry
TP040	APHA/AWWA, 19th edition: Method 3500Cr-D	Determination of hexavalent chromium by colorimetry.	Yes		Dry
TP041	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of organic matter by titrimetry.	Yes		Dry
TP042	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of loss on ignition at 50-440°C by gravimetry	Yes	Yes	Dry
TP043	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of water soluble sulfate in 2:1 water/soil extract	Yes	Yes	Dry
TP045	GACHAMJA A.M. Chromatography and Analysis: 1992 9-11 (modified)	Determination of polyaromatic hydrocarbons extractable in dichloromethane, by GC/MS	Yes	Yes	Dry
TP046	MEWAM method: Phenols in water and Effluents: 4-aminoantipyrine method	Determination of monohydric phenols by steam distillation/colorimetry	Yes	Yes	Dry
TP047	MEWAM method: Cyanide in Waters etc	Determination of Free Cyanide by steam distillation/colorimetry	Yes		Dry
TP048	MEWAM method: Cyanide in Waters etc	Determination of total cyanide by steam distillation/colorimetry.	Yes	Yes	Wet
TP049	MEWAM method: Cyanide in Waters etc	Determination of complex cyanide by calculation	Yes		Dry
TP050	MEWAM method: Determination of Thiocyanate ,1985	Determination of thiocyanate by colorimetry	Yes	Yes	Dry
TP051	USEPA Method 9030B	Determination of acid soluble sulfides by steam distillation/colorimetry.	Yes	Yes	Dry
TP052	BS1881: Part 324, 1988: Testing Concrete	Determination of elemental sulfur by soxhlet extraction and titrimetry.	Yes		Dry
TP067	TNRCC Method 1005: 2001 (modified)	Determination of pentane/acetone extractable petroleum hydrocarbons (C8 - C40) by GC/FID	Yes	Yes	Wet
TP072	In-house documented method	Determination of ammoniacal nitrogen by colorimetry.			Dry
Notes 1. Terra Tek (Birmingham) are MCERTS accredited for clay, sand & loam matrix types only, where they constitute the major component of the sample. Other coarse granular materials, ie gravel, are not accredited where they comprise the major component of the sample. 2. Results are expressed on a dry-weight basis (samples dried at 30°C ± 5°C) except where stated. 3. The laboratory removes any material >2mm prior to analysis. The quantity and nature of any material removed from samples is recorded and the information is available on request. 4. The laboratory records the date of analysis of each parameter. This information is available on request. 5. Where a parameter cannot be determined in house it is our policy to use a UKAS/MCERTS accredited laboratory wherever possible. Terra Tek will assume responsibility for the quality of subcontracted tests and the performance of the subcontractor chosen. Where there is no known UKAS/MCERTS laboratory for a particular parameter, a laboratory listed within the Terra Tek Approved Subcontractors list, which is subject to performance assessment, will be selected.					
Originator	Checked & Approved	SUMMARY OF IN-HOUSE ANALYTICAL TEST METHODS (SOIL)			Appendix Y Sheet 1 of 2
N/A	N/A				

 TERRA TEK <small>SITE INVESTIGATION AND LABORATORY SERVICES</small>		Site REDINGTON ROAD	Contract No B20218		
		Client Key GeoSolutions Limited			
		Engineer			
Method Code	Reference	Description of Method	ISO17025 Accredited	MCERTS Accredited	Wet/Dry Sample Tested
TP073	In-house documented method	Determination of anionic detergent (MBAS) by colorimetry			Dry
TP074	In-house documented method	Determination of water soluble fluoride by ion selective electrode			Dry
TP098	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of acid soluble chloride by titrimetry			Dry
TP099	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of water soluble chloride by titrimetry	Yes	Yes	Dry
TP100	Wisconsin DNR Modified GRO method, Method for Determining Gasoline Range Organics	Determination of Volatile Petroleum Hydrocarbons/GRO.	Yes	Yes	Wet
TP110	USEPA Methods 8082A & 3665A	Determination of Total & Speciated 7 PCB Congeners by GC/MS SIM	Yes	Yes	Wet
TP114	BS1377, Part 3, 1990: Soils for Civil Engineering Purposes.	Determination of carbonate in soil (rapid titration method)			Dry
TP126	TNRCC Method 1006 (modified)	Extracted petroleum hydrocarbons from TP067 split into aromatic and aliphatic fractions. Analysed by GC/FID.	Yes		Wet
TP134	In-house documented method	Determination of water soluble chloride by titrimetry	Yes	Yes	Dry
TP135	USEPA Methods 8100 & 8270D. In-house method TP045	Determination of polyaromatic hydrocarbons extractable in dichloromethane, by GC/MS (with concentration stage)			Dry
TP145	USEPA Methods 3550C & 8270D	Determination of Semi-Volatile Organic Compounds by GC/MS	Yes	Yes	Wet
TP147	USEPA Methods 8082A & 3665A	Determination of total & speciated WHO 12 PCB Congeners by GC/MS SIM.			Wet
TP150	USEPA Methods 8081B & 8141B	Determination of pesticides and herbicides in soil by GC/MS SIM			Dry
TP152	USEPA Method 556	Determination of carbonyls in soil by GC/MS.			Wet
TP154	USEPA Method 5021. Wisconsin DNR modified GRO method	Determination of volatiles in soil by GC/MS headspace	Yes	Selected	Wet
TP158	USEPA Method 1671	Determination of glycols in soil by GC/FID DI			Wet
Notes 1. Terra Tek (Birmingham) are MCERTS accredited for clay, sand & loam matrix types only, where they constitute the major component of the sample. Other coarse granular materials, ie gravel, are not accredited where they comprise the major component of the sample. 2. Results are expressed on a dry-weight basis (samples dried at 30°C ± 5°C) except where stated. 3. The laboratory removes any material >2mm prior to analysis. The quantity and nature of any material removed from samples is recorded and the information is available on request. 4. The laboratory records the date of analysis of each parameter. This information is available on request. 5. Where a parameter cannot be determined in house it is our policy to use a UKAS/MCERTS accredited laboratory wherever possible. Terra Tek will assume responsibility for the quality of subcontracted tests and the performance of the subcontractor chosen. Where there is no known UKAS/MCERTS laboratory for a particular parameter, a laboratory listed within the Terra Tek Approved Subcontractors list, which is subject to performance assessment, will be selected.					
Originator	Checked & Approved	SUMMARY OF IN-HOUSE ANALYTICAL TEST METHODS (SOIL)			Appendix Y Sheet 2 of 2
N/A	N/A				