

Emtec Products Ltd, Unit L Turnpike Way,  
High Wycombe, Bucks, HP12 3TF

Telephone: 020 8848 3031 Fax: 020 8573 3605  
Web: www.emteproducts.co.uk Email: sales@emteproducts.co.uk

RESULTS OF A 24-HOUR NOISE LEVEL SURVEY  
CARRIED OUT ON THE ROOF OF THE COMMUNAL BOILER HOUSE AT  
CHOLMLEY GARDENS, LONDON NW6  
AND A REPORT ON THE NOISE CONTROL MEASURES  
REQUIRED TO MINIMISE THE NOISE IMPACT  
OF THE PROPOSED NEW BOILER PLANT

Test Engineer : M G Roberts

Report Author :

  
M G Roberts

Authorised for  
Release by :

  
I J Marchant

Client : De Metz Forbes Knight Architects Ltd  
Project : Cholmley Gardens – Boiler House Refurbishment  
Emtec Ref. : QF8737/PF5766/RP2A  
Original Issue : 22<sup>nd</sup> July 2016  
Revised Issue : 6<sup>th</sup> October 2016



Certificate No. 11540  
ISO 14001:2004

Reg. No. 3164658. VAT Reg. No. GB675017042  
Directors: I.J.Marchant MIOA (Managing) – J.R.Tait B.Eng, AMIMechE, MIOA  
M.G.Roberts BSc., C.Eng., MIMechE, MIOA – R.T.H.Roberts FCA. (Co.Sec.)



RESULTS OF A 24-HOUR NOISE LEVEL SURVEY  
CARRIED OUT ON THE ROOF OF THE COMMUNAL BOILER HOUSE AT  
CHOLMLEY GARDENS, LONDON NW6  
AND A REPORT ON THE NOISE CONTROL MEASURES  
REQUIRED TO MINIMISE THE NOISE IMPACT  
OF THE PROPOSED NEW BOILER PLANT

1.0. INTRODUCTION

This report details the results of a 24-hour noise survey carried out on the roof of the boiler house located in the centre of the Cholmley Garden Estate, London NW6.

The objectives of this survey were as follows:

- To assess the proposal to install new boiler plant into the existing boiler house.
- To identify the nearest properties that might be affected by plant noise.
- To establish the background noise level outside the nearest affected properties.
- To recommend noise limits and any necessary measures to ensure that the operation of the new boiler plant does not disturb the occupants of the nearest affected properties.

This report has been divided into the following sections for ease of analysis:

- 1.0. INTRODUCTION
- 2.0. SITE DESCRIPTION
- 3.0. TEST INSTRUMENTATION
- 4.0. TEST PROCEDURE
- 5.0. RESULTS AND EVALUATION OF NOISE CRITERIA
- 6.0. DISCUSSION OF RESULTS

## 2.0. SITE DESCRIPTION

The boiler house, within the Cholmley Garden Estate, is a single storey, flat roofed, building which is located next to the entrance gates off Mill Lane and directly behind the Alpha Building Nursery School. The boiler house is overlooked on both sides by blocks of flats within the Cholmley Gardens Estate. The attached aerial view Photo A shows the position of the boiler room.

## 3.0. TEST INSTRUMENTATION

All measurement equipment used during the survey complied with the requirements of BS4142:2014 "Method for Rating Industrial Noise Affecting Mixed Residential and Industrial Areas". Details of the equipment are as follows:

Integrating Sound Level Meter:	Rion type NL-52 class 1 Sound Level Meter fitted with a Rion type UC-59 ½ inch condenser microphone.
Statistical Analysis Modules:	Built in module capable of computing the percentile levels L1, L10, L50, L90 and L99 and also the Leq level.
Acoustic Calibrator:	Bruel & Kjaer type 4231 electronic calibrator. Serial No.: 1934160

Calibration was performed before and after the surveys and found to be, in all cases, +/- 0.1 dB from the reference source.

### 3.1. Existing Noise Climate

Road traffic travelling on nearby Mill Lane could be heard during the manned periods at the start and the end of the survey, so the noise levels measured will include contributions from road vehicles.

Commercial jet aircraft were observed at medium and high altitude during the manned periods at the start and the end of the survey, so it is possible that the noise levels measured could include contributions from medium altitude jet aircraft.

There are no overland railways nearby, so the noise levels measured will not include contributions from rail noise.

The existing hot water boiler plant was operating during the survey although it switched on for periods and then was inoperative for other portions of the survey. We judged that the noise of this hot water boiler was the dominant noise source during the survey.

#### 4.0. TEST PROCEDURE

The survey was conducted during a continuous 24-hour period from 10:25am on Monday the 18<sup>th</sup> of July 2016 to 10:10am on Tuesday the 19<sup>th</sup> of July 2016.

Data was continuously acquired throughout the measurement period with the individual averaging time for statistical noise data set to 15 minutes. The following 'A' weighted statistical measurements were recorded concurrently: -

- LA<sub>1</sub> - The Sound Pressure Level exceeded for 1% of the measurement period.
- LA<sub>10</sub> - The Sound Pressure Level exceeded for 10% of the measurement period.
- LA<sub>50</sub> - The Sound Pressure Level exceeded for 50% of the measurement period.
- LA<sub>90</sub> - The Sound Pressure Level exceeded for 90% of the measurement period. LA90 is considered to represent the "background noise level" during the measurement period and is used for the assessment of noise to determine the likelihood of complaints (See BS 4142:2014).
- LA<sub>99</sub> - The Sound Pressure Level exceeded for 99% of the measurement period.
- LA<sub>eq</sub> - The continuous steady state Sound Pressure Level that has the same acoustic energy as the real fluctuating level.

#### 4.1. Measurement Positions

Noise levels were measured at a position on the roof of the boiler house building. The location of the microphone was at the opposite end of the roof from the flue discharge from the hot water boiler. The location of the microphone is shown in the attached Photos A, B & D.

The microphone was pointing vertically and was approximately 1.2 metres above the boiler house roof. The rest of the measurement equipment was located in a weatherproof enclosure with a low impedance cable running from the microphone to the instrumentation.

#### 4.2. Weather Conditions

The weather conditions prevailing during the measurement period were generally in line with those recommended in BS 4142:2014: -

Weather daytime: -	Warm and Sunny	Weather night time: -	Clear
Wind daytime: -	Dead Calm	Wind night time: -	Calm

The microphone was protected throughout the tests by an acoustically transparent wind balloon.

## 5.0. RESULTS AND EVALUATION OF NOISE CRITERIA

The raw test data, gathered during the noise survey, is given in Appendix 'A' of this report.

The 'A' Weighted Leq levels measured over each 15 minute interval throughout the 24-hour period (denoted by  $LA_{eq}$ , (15 mins)) are displayed as a line graph on the attached Sketch No QF/8737/T1 at the back of this report.

The 'A' Weighted percentile levels measured over each 15 minute interval denoted by  $LA_{10}$  (15 mins),  $LA_{50}$  (15 mins) and  $LA_{90}$  (15 mins) are displayed as line graphs on the attached Sketch No QF/8737/T2 at the back of this report.

### 5.1. Summary of Results

The table QF/8737/D1 below summarises the noise levels taken over the 24-hour period in terms of the maximum and minimum Sound Pressure Levels recorded.

Table QF/8737/D1 – Summary of Maximum and Minimum Noise Levels

	$LA_{eq}$	$LA_1$	$LA_{10}$	$LA_{50}$	$LA_{90}$	$LA_{99}$
<b>Minimum</b>	37.5dBA	43.2dBA	38.7dBA	36.4dBA	35.5dBA	35.3dBA
<b>Maximum</b>	59.4dBA	68.8dBA	59.2dBA	55.7dBA	54.8dBA	54.6dBA

5.2. Summary of the Local Authority's planning requirements regarding noise for noise sensitive properties

Table E of Camden's current replacement Unitary Development Plan states that noise from external plant and machinery must be at least 5dB less than the lowest measured LA90 when measured at 1 metre external to the nearest sensitive façade.

Where the noise has a distinguishable discrete continuous note (whine, hiss, screech, hum) the Development Place states that noise from external plant and machinery must be at least 10dB less than then the lowest measured LA90 when measured at 1 metre external to the nearest sensitive façade.

Where the noise has distinct impulses (bang, clicks, clatters, thumps) the Development Plan states that noise from external plant and machinery must be at least 10dB less than the lowest measured LA90 when measured at 1 metre external to the nearest sensitive façade.

5.3. Determination of noise sensitive property design criteria

The new boiler plant will be intermittent but will probably not contain tones. Based on the local authority's planning requirements outlined above, the new plant should be designed to be 10dBA below the minimum existing LA<sub>90</sub> background noise level during the relevant operational period.

It is proposed to operate the boiler plant on a 24-hour basis.

The lowest recorded LA<sub>90</sub> level measured during the 24-hour period was 35.5dBA. This occurred during the time period starting at 02:55am.

The new plant should therefore be designed to achieve 25.5dBA at 1 metre from the nearest noise sensitive properties' windows if the externally located equipment is to be operated on a 24-hour basis.

5.4. Summary of external noise criteria

Based upon the results of the survey and the above design criteria we summarise the actual design rating levels to be adopted for this project in table QF/8737/D2: -

Table QF/8737/D2 – recommended design rating levels L<sub>Ar,T</sub>

Type of premises	L <sub>Ar,T</sub> (24-hour)
Noise sensitive	25.5dBA

6.0. DISCUSSION OF RESULTS

The results of the overnight noise survey show that the background LA90 noise level falls to a lowest level of 35.5dBA but the results also show that the Hot Water boiler plant operates intermittently during the night and when in operation gives an LA<sub>90</sub> background noise level of about 53dBA. This is the noise level measured at approximately 11 metres from the Hot Water boiler flue outlet and is equivalent to the noise level that can be expected at the nearest residential neighbours' windows which are at a similar distance from the flue (see aerial Photo A).

The operation of the existing hot water boiler therefore elevates the LA90 background noise level, at worst, by 18dBA. This is a significant increase under the guidelines of BS4142:2014 and we are surprised that no complaints have been received from local residents.

The new boiler plant will need to have significant acoustic treatment incorporated within its design in order to reduce the noise level, at 1 metre from the nearest neighbours' windows, to no more than LA<sub>eq</sub>: 25.5dB.

We believe that it is proposed to install three number Remeha 610 ECO PRO double bank boilers each with 9 sections. The boilers are forced draught gas boilers with a burner being enclosed inside a steel casing. Two of these boilers will run at any given time, the third boiler being a standby unit. There will also be three sets of pumps (Heating Primary and Secondary and HWS Pumps).

The main noise source within the boiler plantroom will be the two boilers and the table QF/8737/D3 itemises the boiler noise level and the natural and required attenuation to achieve the established noise criteria.

Table QF/8737/D3 – Noise Level of Boilers Plus Attenuation

Equipment/Attenuation	Sound Pressure Level (dB ref 2 x 10 <sup>-5</sup> N/m <sup>2</sup> )								dBA
	63	125	250	500	1k	2k	4k	8k	
Remeha 9/10 Section G310 boiler SPL at 1 metre	47	49	57	60	56	57	54	43	63
Addition for 610 boiler (2 off 310S)	+3	+3	+3	+3	+3	+3	+3	+3	
2 Boilers in Boiler plantroom	+3	+3	+3	+3	+3	+3	+3	+3	
Overall SPL in Plantroom	53	55	63	66	62	63	60	49	69
Distance attenuation to Windows (20 log 9) – 10 metre distance	-19	-19	-19	-19	-19	-19	-19	-19	
SPL at 1 metre from flat's window	34	36	42	47	43	44	41	30	50
Attenuation of Emtec LAAC30/105 Acoustic Louvres	-6	-9	-11	-17	-25	-32	-30	-23	
Attenuation of Emtec WCAC30 Acoustic Wall lining to area behind louvres	-2	-4	-6	-6	-6	-6	-6	-6	
Overall SPL at 1 metre from neighbours windows	23	23	25	24	12	6	5	1	23

EMTEC PRODUCTS LTD.

Note: The above attenuation assumes that the boiler plantroom will be totally sealed except for the acoustic louvred opening and that the two access doors will be Emtec DAC33 acoustic doors.

Based upon the above noise calculations the following recommendations should be incorporated into the design of the boiler plantroom:

- The plantroom structure should be made up of well-sealed brickwork, concrete block or reinforced concrete elements.
- The two access doors into the boiler plantroom should be Emtec DAC33 steel acoustic doors having a sound reduction index of Rw:35dB.
- The ventilation opening into the boiler plantroom should have Emtec LAAC30/105 acoustic louvres installed into it to provide the following noise reduction:-

Sound Reduction Index (dB)							
63	125	250	500	1k	2k	4k	8k
6	9	11	17	25	32	30	23

- The plantroom walls and ceiling in the heat exchanger and primary heating pump area of the plantroom should have Emtec WCAC30 acoustic panels fixed to their internal surfaces.

The above recommendations are shown in principle on the attached sketch No.QF/8737/SK1.

If the above measures are introduced then the airborne noise from the boilers and pumps will be reduced to below the established noise criteria at 1 metre from the nearest residential property's window.


The only other potential noise problem is noise breakout from the common flue from the three boilers. The flue is to be routed out of the plantroom onto the roof and then across onto the wall of the block of flats adjacent. The flue will take the same route as the boxed in water pipes shown on the attached Photo C.

In order for the noise of the flue to be contained the wall of the flue, and any outer insulation and casing, should provide a noise reduction of at least Rw:40dB. This will probably require the flue to be of heavy construction and be surrounded by a mineral wool thermal jacket and an outer casing of galvanised sheet steel. The detail of this construction should be discussed and agreed with the flue installer.

As the flue is to be supported off the side wall of the flats opposite the boiler plantroom it is important that the insulation itemised above should completely encase the flue. The flue supports should also be mounted resiliently off the side of the flats. A neoprene insert should be incorporated into the supports so that there is no metal to metal continuity within the support brackets which would allow structural borne noise to be transferred into the building fabric.

If the above measures are incorporated into the design then we are confident that the installation will be both acceptable to the local Council's planning authority and also cause no problems with the residents of the Cholmley Garden flats.




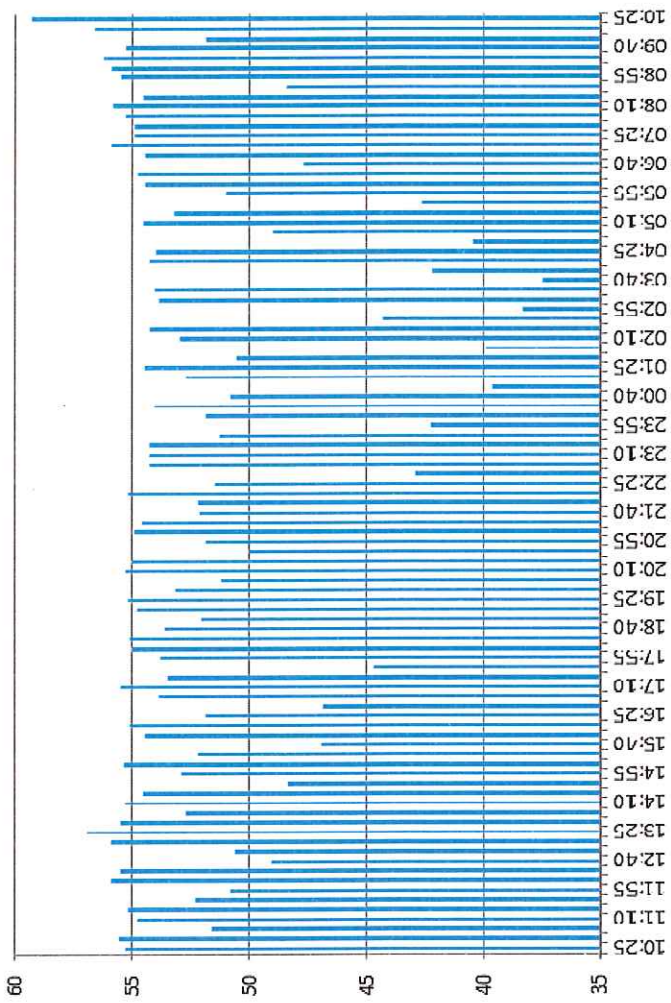

<b>TITLE:</b> LAeq Levels	<b>ISSUE DATE:</b> 19/07/2016	<b>DRAWN BY:</b> MGR	A	B	C	D	E	F	G	H	
			REVISION								
<b>CLIENT:</b> De Metz Forbes Knight  <b>PROJECT:</b> Cholmley Gardens, Boiler Room	<b>PF No:</b> 5766	<b>APPROVED BY:</b> MGR	<b>SKETCH No:</b> QF/8737/T1								
	Q    A    M    I										



Unit L, Turnpike Way, High Wycombe  
 Bucks HP12 3TF  
 Tel: 020 8848 3031 Fax: 020 8573 3605

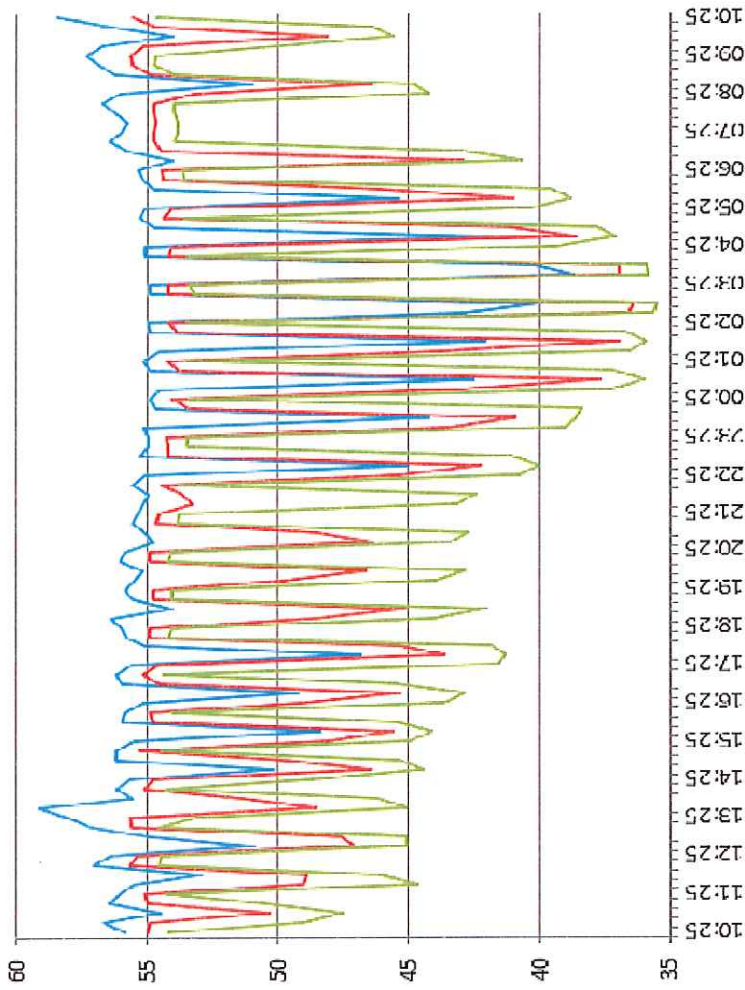

<b>TITLE:</b> LA10; LA50 & LA90 Levels		<b>ISSUE DATE:</b> 19/07/2016		<b>DRAWN BY:</b> MGR		A B C D E F G H	
<b>CLIENT:</b> De Metz Forbes Knight		<b>PF No:</b> 5766		<b>APPROVED BY:</b> MGR		REVISION	
<b>PROJECT:</b> Cholmley Gardens, Boiler Room		Q	A	M	I	<b>SKETCH No.</b> QF/8737/T2	
						<b>EMTEC</b> Unit L, Turnpike Way, High Wycombe Bucks HP12 3TF Tel: 020 8848 3031 Fax: 020 8573 3605	

APPENDIX 'A'

Raw Data – Noise Survey  
18<sup>th</sup> to 19<sup>th</sup> of July 2016

**RAW NOISE DATA - Cholmley Gardens, Boiler House**

Ref: QF8737/PF5766/RP1  
 Client: De Metz Forbes Knight  
 Date: 18th to 19th July 2016

Address	Start Time	LAeq	LE	Lmax	Lmin	LA1	LA10	LA50	LA90	LA99
1	10:25	55.3	84.9	68	52.7	59	55.9	55	54.2	54
2	10:40	55.6	85.2	79.7	44.5	62	56.7	54.9	49	47.9
3	10:55	51.6	81.2	63.7	44.3	58.2	54.5	50.3	47.5	46.9
4	11:10	54.8	84.4	63.2	46.6	58.2	56.5	55	50.6	49.7
5	11:25	55.2	84.8	61.7	52.8	57.8	56.1	55.1	54.3	54.1
6	11:40	52.3	81.9	59.3	41.5	56.5	55.5	49	44.6	43.9
7	11:55	50.8	80.4	69.3	42.5	58.5	52.9	48.9	46.1	45.5
8	12:10	55.9	85.5	68.3	44.4	59.9	57.1	55.7	54.6	54.2
9	12:25	55.5	85.1	62.2	52.9	57.8	56.4	55.4	54.5	54.3
10	12:40	49.1	78.7	65.5	42.8	57.2	50.9	47	45	44.6
11	12:55	50.6	80.2	66.7	42.9	58.7	55	47.6	45.1	44.7
12	13:10	55.9	85.5	66.7	52.6	59.7	57.2	55.6	54.6	54.4
13	13:25	57	86.6	81.5	43.9	64.1	58.1	55.7	53.1	47.9
14	13:40	55.5	85.1	72.3	42	67.5	59.2	48.5	45	44.5
15	13:55	52.7	82.3	65.3	43	57.7	55.6	51.4	46.2	45.4
16	14:10	55.3	84.9	71.1	52.5	57.6	56.2	55.1	54.3	54.1
17	14:25	54.5	84.1	59.3	43.5	56.7	55.7	54.8	48.6	46
18	14:40	48.3	77.9	67.9	42.7	56.6	50.2	46.4	44.4	44
19	14:55	52.9	82.5	62	42.7	59.4	56.2	49.8	45.4	44.9
20	15:10	55.4	85	61.5	52.9	57.8	56.2	55.3	54.5	54.3
21	15:25	52.2	81.8	68.3	43.3	57.5	55.5	48	44.9	44.5
22	15:40	46.9	76.5	62.3	42.6	55.7	48.4	45.6	44.1	43.8
23	15:55	54.4	84	64.8	42.5	58.5	56	54.8	45.5	44.7
24	16:10	55.1	84.7	65.2	52.4	58.6	55.9	54.9	54.1	53.9
25	16:25	51.8	81.4	61.4	41.5	56.7	55.2	49	43.6	43.1
26	16:40	46.8	76.4	61.7	40.2	54.4	49.2	45.3	42.8	42.2
27	16:55	53.9	83.5	63.1	42.4	58.3	56	54.6	45.5	44.6
28	17:10	55.5	85.1	65.9	52.7	60.5	56.2	55.2	54.4	54.2
29	17:25	53.5	83.1	58.9	38.9	56.4	55.6	54.6	41.6	40.8
30	17:40	44.7	74.3	61.2	39.6	51.1	46.8	43.6	41.3	40.9
31	17:55	53.8	83.4	73.1	39.1	67.3	55.1	45.4	41.9	41.4
32	18:10	55	84.6	64.4	52.8	57.4	55.8	54.9	54.2	53.9
33	18:25	55.1	84.7	68	51.9	58.3	56	54.9	54.1	53.9
34	18:40	53.6	83.2	72.8	40.9	64.2	56.4	48.5	44	43.1
35	18:55	52	81.6	82.3	38.6	62	54.1	45.1	42	41.3
36	19:10	54.8	84.4	59.9	52.6	56.3	55.6	54.8	54.1	53.9
37	19:25	55.2	84.8	67.8	52.4	59	55.9	54.8	54.1	53.9
38	19:40	53.1	82.7	77.1	40.1	60	55.5	49.7	43.9	43.2
39	19:55	51.2	80.8	74.4	39	59.6	55.2	46.6	42.8	42.1
40	20:10	55.3	84.9	67.9	52.3	59.2	56.1	54.9	54.2	53.9
41	20:25	55	84.6	64.4	52.5	57.6	55.9	54.9	54.1	53.8
42	20:40	50	79.6	70.6	40.3	56.5	54.8	46.3	43.4	42.7
43	20:55	51.8	81.4	60.2	40.5	56.1	55.1	48.5	42.7	42.1
44	21:10	54.9	84.5	66.7	52.2	57.6	55.6	54.7	53.9	53.7
45	21:25	54.6	84.2	59.5	52.2	56.1	55.4	54.6	53.8	53.6
46	21:40	52.1	81.7	58	40	56	55.2	53.3	43.1	42.6
47	21:55	52.2	81.8	57.1	40.5	55.8	55	53.7	42.4	41.9
48	22:10	55.2	84.8	67.9	51.8	62.9	55.6	54.5	53.8	53.6
49	22:25	51.5	81.1	61.7	38.6	56.3	55.1	45.3	40.8	40.4
50	22:40	42.9	72.5	53.1	37.9	48.6	45	42.2	40	39.6
51	22:55	54.3	83.9	68.9	38	65	55.3	54.2	41.1	40.3

52	23:10	54.3	83.9	59.4	52	55.8	55	54.2	53.5	53.3
53	23:25	54.3	83.9	57.1	52	55.7	55	54.3	53.5	53.3
54	23:40	51.3	80.9	60.4	37.1	57	55.2	43.4	39	38.6
55	23:55	42.3	71.9	60.7	36.8	49	44.2	40.9	38.6	38.2
56	00:10	51.8	81.4	58.2	36.5	55.6	54.7	53.4	38.4	38
57	00:25	54.1	83.7	57.6	51.9	55.6	54.9	54.1	53.4	53.2
58	00:40	50.8	80.4	56.7	34.6	55.4	54.6	43	37.2	36.8
59	00:55	39.6	69.2	51.8	34.9	47	42.5	37.7	36	35.8
60	01:10	52.7	82.3	59.7	35.3	56.1	54.9	53.8	37.2	36.7
61	01:25	54.4	84	60.9	51.6	58	55.2	54.3	53.5	53.3
62	01:40	50.5	80.1	56.7	35	55.5	54.6	43.5	36.5	36.2
63	01:55	39.9	69.5	53.4	34.8	50.8	42.1	36.9	35.9	35.7
64	02:10	53	82.6	67.7	35.3	55.8	54.9	53.9	36.7	36.3
65	02:25	54.3	83.9	56.9	51.8	55.7	55	54.2	53.5	53.3
66	02:40	44.3	73.9	56.9	34.3	54.9	42.8	36.6	35.6	35.4
67	02:55	38.3	67.9	53.1	34.1	47.3	39.9	36.4	35.5	35.3
68	03:10	53.9	83.5	56.9	35.3	55.6	54.9	54.2	53.2	39.4
69	03:25	54.1	83.7	57	39.1	55.7	54.9	54.2	53.4	53.1
70	03:40	37.5	67.1	48.6	34.2	43.2	38.7	36.9	35.8	35.5
71	03:55	42.2	71.8	56.4	35	54.7	40.3	36.9	35.9	35.8
72	04:10	54.3	83.9	63.5	51.9	55.9	55.1	54.2	53.5	53.3
73	04:25	54	83.6	69.8	36.6	58.7	55.1	54.1	39.3	38.1
74	04:40	40.4	70	55	35.6	49.4	41.9	38.6	37.1	36.8
75	04:55	49	78.6	58.3	36.4	56	54.8	41.2	37.8	37.6
76	05:10	54.5	84.1	59.1	52.1	56.3	55.3	54.4	53.6	53.4
77	05:25	53.2	82.8	65	37.5	56.1	55.1	54.1	40.3	39.3
78	05:40	42.7	72.3	59.3	36.9	49.3	45.4	41	38.8	38.4
79	05:55	51	80.6	57.7	37.5	55.8	54.8	46.1	39.6	39
80	06:10	54.4	84	61.2	51.6	56.1	55.2	54.4	53.6	53.4
81	06:25	54.8	84.4	64.2	52.2	60.9	55.4	54.5	53.7	53.5
82	06:40	47.7	77.3	64.2	38.6	55.6	54.1	42.9	40.7	40.2
83	06:55	54.4	84	66.3	39.3	62.2	55.8	54.5	43	41.8
84	07:10	55.9	85.5	69.9	52.4	63.6	56.5	54.8	54	53.8
85	07:25	54.9	84.5	62.1	52.3	57.7	56	54.8	53.9	53.7
86	07:40	54.9	84.5	66.2	52.1	58.8	55.8	54.7	53.9	53.6
87	07:55	55.3	84.9	63.5	52.3	60.1	56.3	54.8	54	53.8
88	08:10	55.8	85.4	66.2	52.6	62.8	56.8	54.8	54	53.8
89	08:25	54.5	84.1	69.5	42	66	56.1	53.2	44.2	43.6
90	08:40	48.4	78	63.2	43.2	55.9	51	46.4	44.8	44.5
91	08:55	55.5	85.1	66.5	45.2	62.5	56.3	54.9	54	53.5
92	09:10	55.9	85.5	64	53	59.9	56.9	55.6	54.8	54.6
93	09:25	56.2	85.8	64.9	52.9	61.5	57.4	55.7	54.7	54.4
94	09:40	55.3	84.9	66.8	44.1	60.9	56.8	55.2	49.9	48.4
95	09:55	51.8	81.4	68.6	42.9	63.1	54.1	48.1	45.6	44.9
96	10:10	56.6	86.2	73.2	43.6	68.8	56.4	54.7	46.4	45.7

APPENDIX 'B'

Photos and sketches

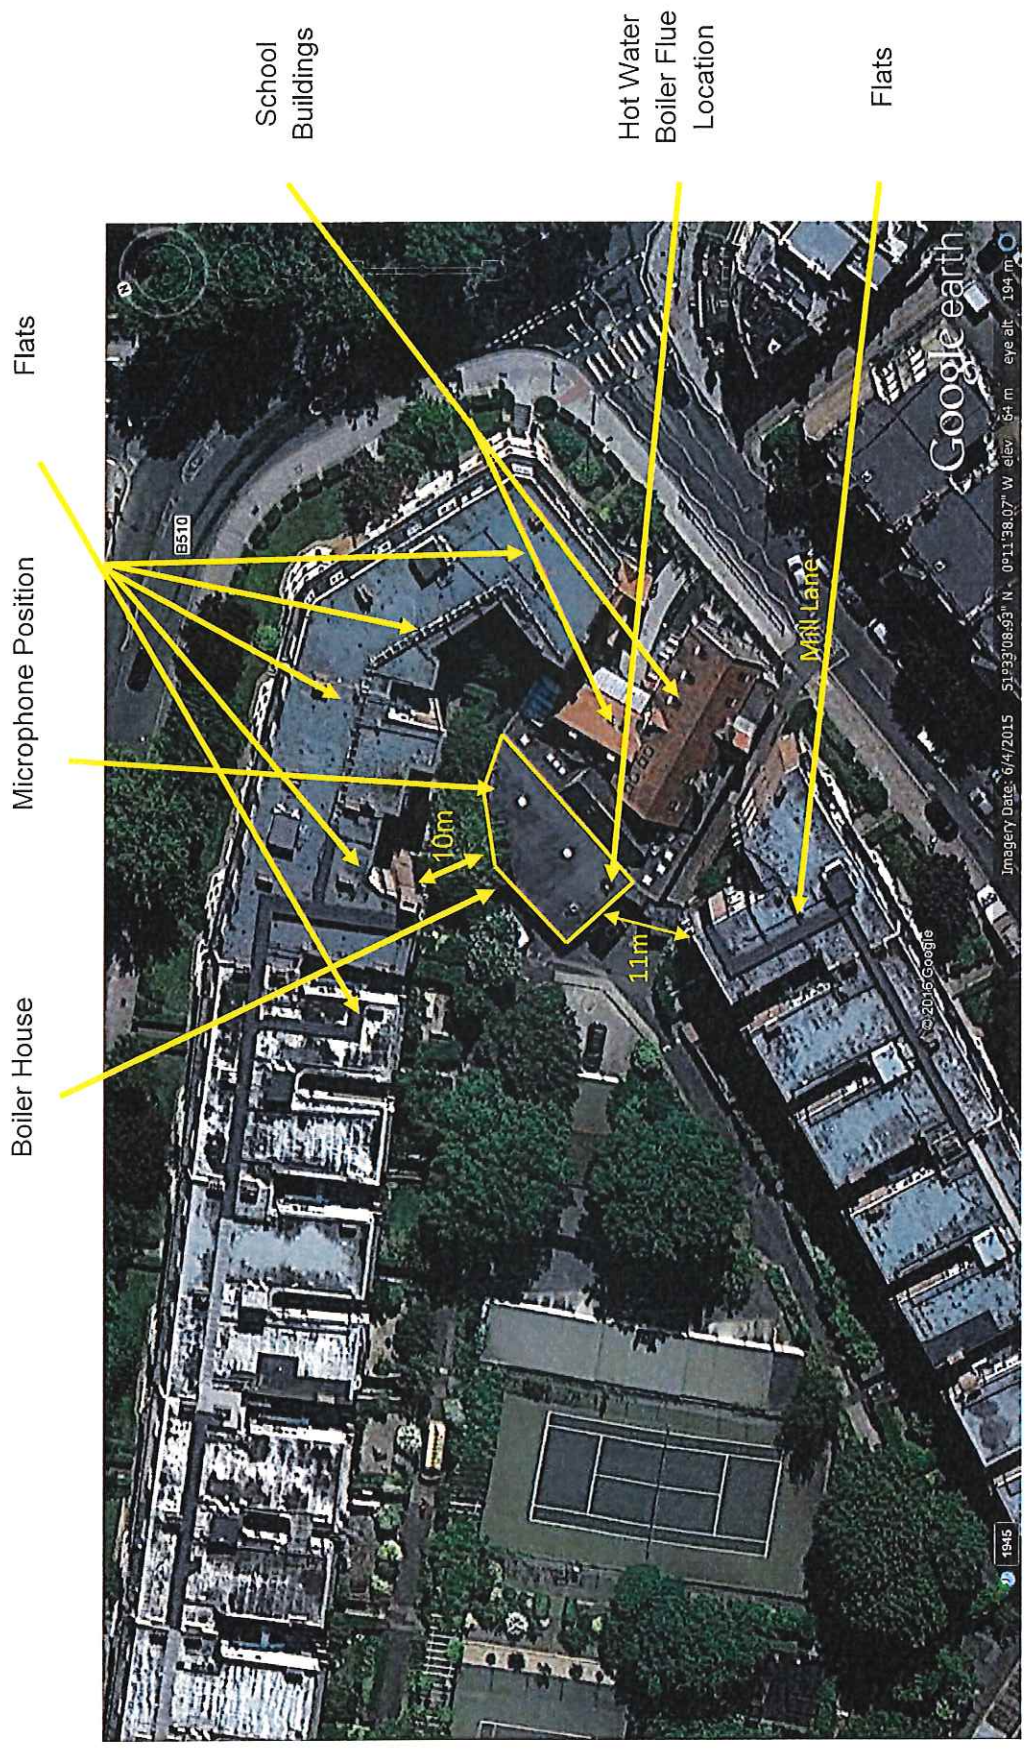


Photo A – Aerial View of Cholimley Garden Estate Showing Boiler House in Centre of Site

Flats Behind



Microphone

School Buildings

Hot Water  
Boiler Flue This  
End of the Roof

Photo B — Location of Microphone on Roof of the Boiler House





Photo C – Location of Existing Boiler Flue at Other End of Boiler House Roof

Microphone



Photo D – Blocks of Flats Overlooking Boiler House Roof



Proposed Air  
Intake to Boiler  
Plantroom

Photo E – Blocks of Flats on North Side of Estate Opposite Boiler Plantroom Air Intake

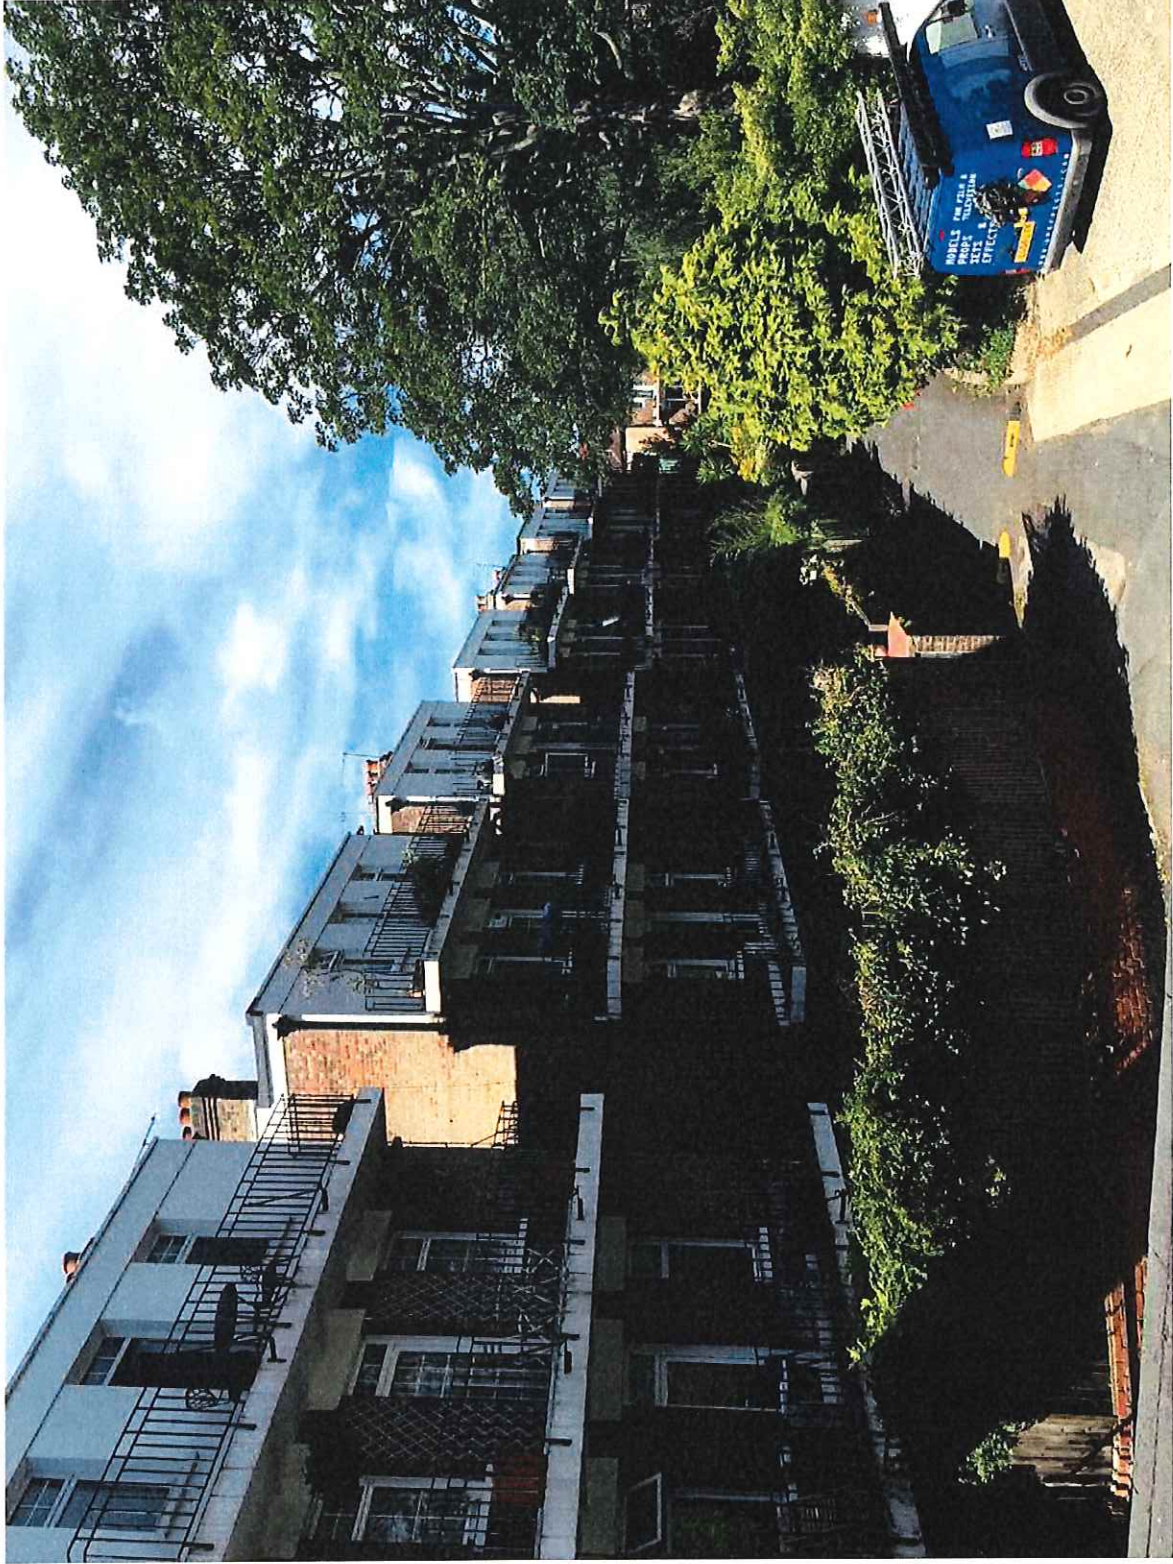


Photo F – Blocks of Flats on South Side of Estate




Photo G – Roof of Adjacent Primary School Buildings Next to Boiler House

DO NOT SCALE FROM THIS DRAWING  
 ALL DIMENSIONS TO BE SHOWN UNLESS OTHERWISE  
 INDICATED IN FOOTNOTES AND IT SHALL BE THE  
 RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL  
 DIMENSIONS.  
 IF IN DOUBT - ASK  
 NOTES



FRONT ELEVATION ON BOILERS - 1:20 @ AO

NOTE: ALL PLASTERED WALLS  
 TO BE SEALED BRICK  
 OR CONCRETE BLOCK  
 CONSTRUCTION

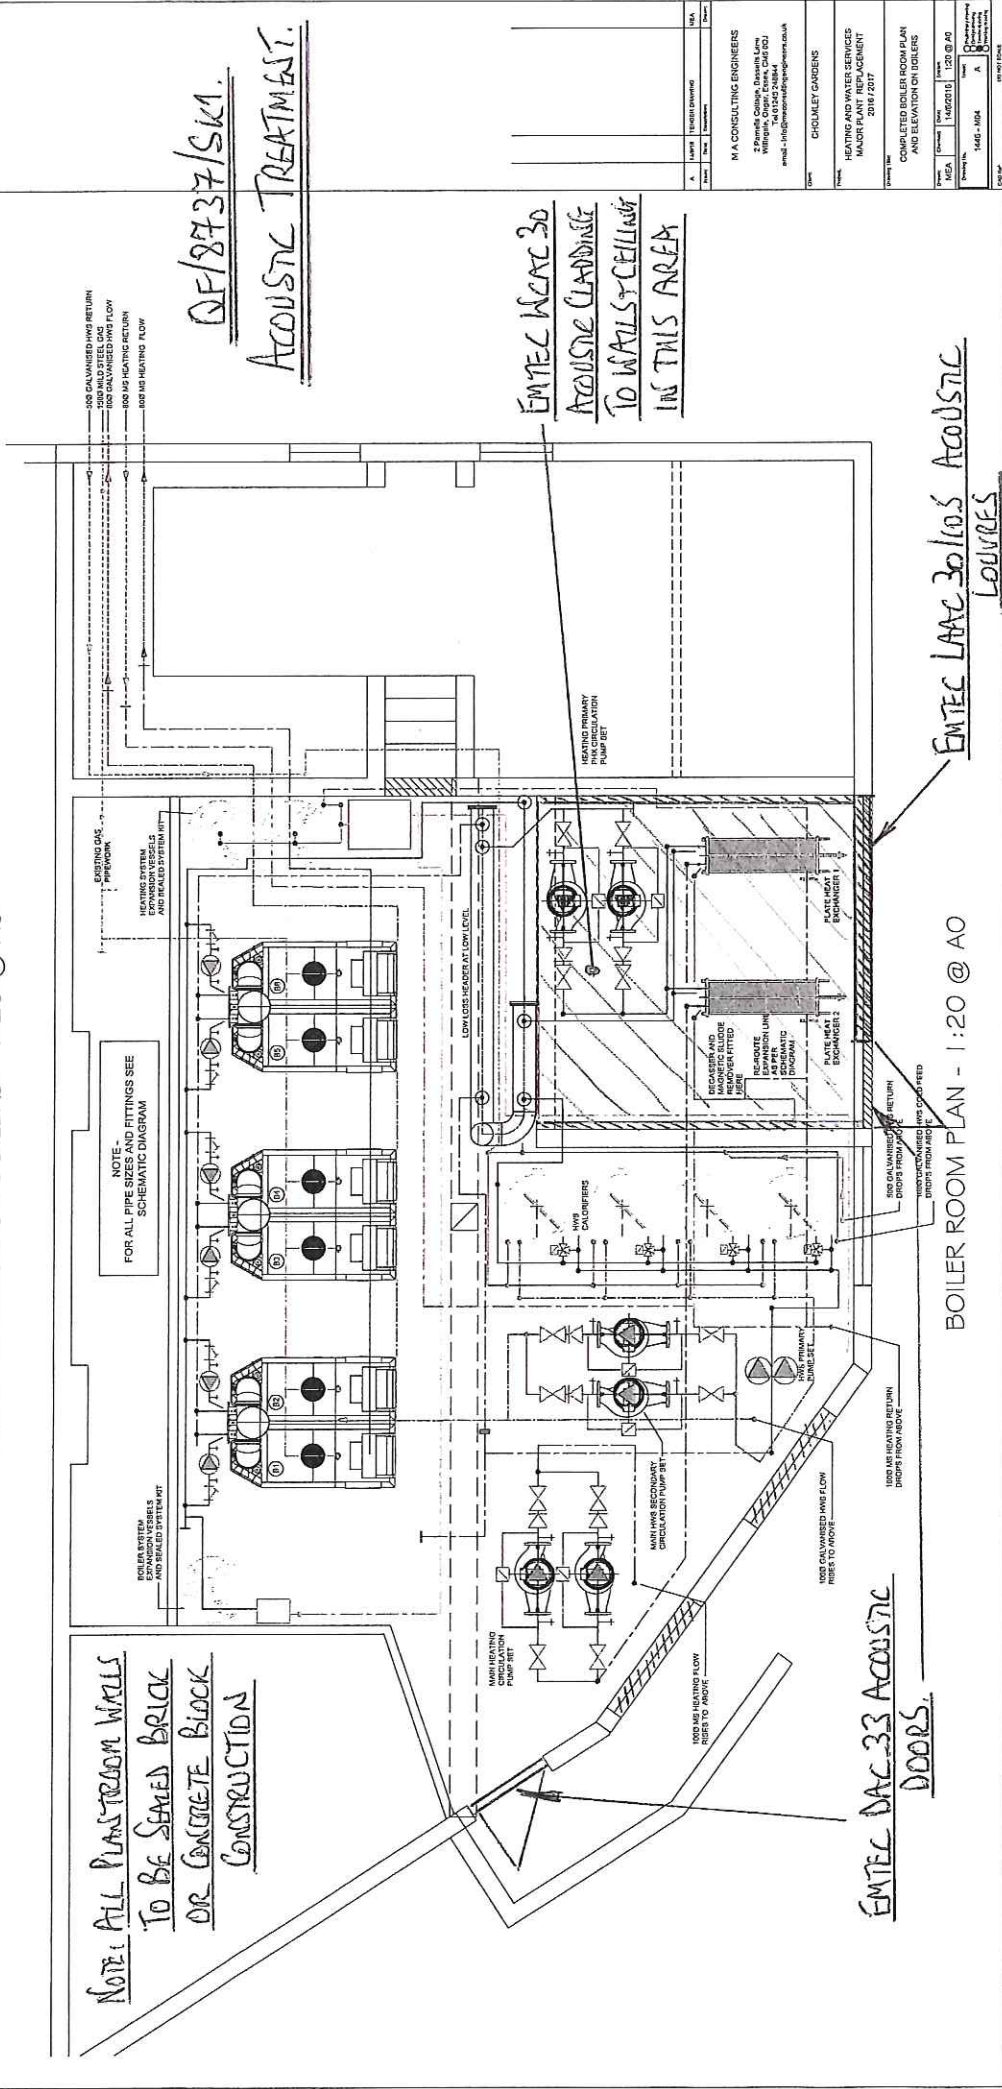

BOILER ROOM PLAN - 1:20 @ AO

QF/2737/SK1.  
ACOUSTIC TREATMENT.

EMTEC WACAC 3D  
ACOUSTIC CLADDING  
TO WALLS & CEILING  
IN THIS AREA

EMTEC DAC-33 ACOUSTIC  
DOORS.

EMTEC LAAC 30/100S ACOUSTIC  
LOUVRES

M/A CONSULTING ENGINEERS	
2 Prince's Court, Church Lane Watlington, Oxon, OX4 0DU Tel: 01845 282828 Email: info@macconsulting.co.uk	
CHOUMLY GARDENS	
HEATING AND WATER SERVICES MAJOR PLANT REPLACEMENT 2018/2017	
COMPLETED BOILER ROOM PLAN AND ELEVATION ON BOILERS	
DATE	1:20 @ AO
SCALE	1:20 @ AO
PROJECT	1845 - 1846
NO.	A
DATE	18/07/2018