

table continued from previous page...




Building: Bacton Low Rise, Block F - Flat 190			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-26								
bath panel	wood										
Building: Bacton Low Rise, Block F - Flat 190			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-24	2 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-26								
toilet cistern	rubber										
boxing	wood										
pipework within boxing	metal										
Building: Bacton Low Rise, Block F - Flat 190			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...



Building: Bacton Low Rise, Block F - Flat 190			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-24	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 191			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126254-52	4 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126254-53	2 Sqm.	2	1	1	Amosite	6	3	R2
electrics	modern										
Building: Bacton Low Rise, Block F - Flat 191			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	2 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 191			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...

Building: Bacton Low Rise, Block F - Flat 191			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	modern vinyl tiles										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	14 Sqm.	1	1	0	Chrysotile	3	2	R3
panels to external wall	insulating board	Sample	126254-54								NAD
boiler	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
Building: Bacton Low Rise, Block F - Flat 191			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	2 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 191			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	12 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-54								NAD

Building: Bacton Low Rise, Block F - Flat 191			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	12 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-54								NAD
Building: Bacton Low Rise, Block F - Flat 191			Level: 3		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	2 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 191			Level: 3		Location: 002/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-52	4 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-54								NAD
bath panel	wood										
within wooden boxing	no asbestos observed										

Building: Bacton Low Rise, Block F - Flat 191			Level: 3		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	12 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-54								NAD
riser panels	wood										
Building: Bacton Low Rise, Block F - Flat 191			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-52	2 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 192			Level: -3		Location: 001/ Hall & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panel above cupboard door	wood										





Building: Bacton Low Rise, Block F - Flat 192			Level: -3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-31								 NAD
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126254-33	2 Sqm.	2	1	2	Chrysotile, Amosite	7	3	 R1
panels to shelves	insulating board	Sample	126254-34								 NAD
Building: Bacton Low Rise, Block F - Flat 192			Level: -3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	6 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										

table continued from previous page...





Building: Bacton Low Rise, Block F - Flat 192			Level: -3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels to external wall	insulating board	Cross Reference	126254-31								 NAD
bath panel	wood										
boxing	wood										
pipework within boxing	metal										
toilet cistern	Asbestos-containing composite	Sample	126254-35	1 No.	1	1	0	Amosite	4	3	 R3
Building: Bacton Low Rise, Block F - Flat 192			Level: -2		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-31								 NAD
Building: Bacton Low Rise, Block F - Flat 192			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										

table continued from previous page...




Building: Bacton Low Rise, Block F - Flat 192			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	12 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-31								
Building: Bacton Low Rise, Block F - Flat 192			Level: -1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-29	2 Sqm.	1	1	0	Chrysotile	3	2	
Building: Bacton Low Rise, Block F - Flat 192			Level: -1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...





Building: Bacton Low Rise, Block F - Flat 192			Level: -1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-29	14 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Sample	126254-31								 NAD
boiler	modern										
boxing left side of sink	wood										
pipework within boxing	metal										
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126254-32	2 Sqm.	2	1	1	Chrysotile, Amosite	6	3	 R2
Building: Bacton Low Rise, Block F - Flat 192			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	ceramic tiles										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126254-29	4 Sqm.	1	1	0	Chrysotile	3	2	 R3

table continued from previous page...



Building: Bacton Low Rise, Block F - Flat 192			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126254-30	2 Sqm.	2	1	1	Chrysotile, Amosite	6	3	 R2
electrics	modern										
Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 001/ Hall & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles			2 Sqm.	1	1	0			3	
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-36	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panel above cupboard door	wood										
Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 002/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-45	6 Sqm.	1	1	0	Chrysotile	3	3	R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-48								NAD
bath panel	wood										
boxing	wood										

table continued from previous page...







Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 002/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
pipework within boxing	metal										
toilet cistern	Asbestos-containing composite	Sample	126254-49	1 No.	1	1	0	Amosite	4	2	R3
Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-39	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-38								 NAD
Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-36	6 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										



table continued from previous page...


Building: Bacton Low Rise, Block F - Flat 193			Level: -3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels to external wall	insulating board	Cross Reference	126254-38								 NAD
bath panel	wood										
boxing	wood										
pipework within boxing	metal										
toilet cistern	ceramic			1 No.	1	1	0			3	

Building: Bacton Low Rise, Block F - Flat 193			Level: -2		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-36	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126254-38								 NAD

Building: Bacton Low Rise, Block F - Flat 193			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										





table continued from previous page...

Building: Bacton Low Rise, Block F - Flat 193			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126254-39	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-38								 NAD

Building: Bacton Low Rise, Block F - Flat 193			Level: -1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-36	2 Sqm.	1	1	0	Chrysotile	3	2	 R3

Building: Bacton Low Rise, Block F - Flat 193			Level: -1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...

Building: Bacton Low Rise, Block F - Flat 193			Level: -1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-36	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Sample	126254-38								 NAD
boiler	modern										
sink pad	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
Building: Bacton Low Rise, Block F - Flat 193			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	ceramic tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Sample	126254-36	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126254-37	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
electrics	modern										




Building: Bacton Low Rise, Block F - Flat 194			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126254-40	4 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126254-41	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
electrics	modern										
Building: Bacton Low Rise, Block F - Flat 194			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 194			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...

Building: Bacton Low Rise, Block F - Flat 194			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
subfloor	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Sample	126254-42								 NAD
boiler	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126254-43	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
panels to shelves	Asbestos-containing insulating board	Sample	126254-44	2 Sqm.	2	1	2	Amosite	7	3	 R1
Building: Bacton Low Rise, Block F - Flat 194			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										




Building: Bacton Low Rise, Block F - Flat 194			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-42								 NAD
Building: Bacton Low Rise, Block F - Flat 194			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-42								 NAD
Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										

table continued from previous page...









Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126254-42								 NAD
riser panels	wood										
Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...

Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-40	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126254-42								 NAD
bath panel	wood										
Building: Bacton Low Rise, Block F - Flat 194			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126254-40	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126254-42								 NAD
boxing	wood										
pipework within boxing	metal										
toilet cistern	ceramic										

Building: Bacton Low Rise, Block F - Flat 194			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete with polystyrene tiles										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126254-40	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										

Annotated Plans and Other Additional Documents

The following documents accompany this report and should be regarded as an integral part of this report.

They can be downloaded from <http://web.lucion.co.uk/reports/126254/attachments>.

- [Method Statement \[http://web.lucion.co.uk/method_statements/126254?s=005018a685d7ae9caa7766e8ce29a392 \]](http://web.lucion.co.uk/method_statements/126254?s=005018a685d7ae9caa7766e8ce29a392)
- [Risk Assessment \[http://web.lucion.co.uk/risk_assessment/126254?s=3ca012da785fe9a1b92ef20530bac294 \]](http://web.lucion.co.uk/risk_assessment/126254?s=3ca012da785fe9a1b92ef20530bac294)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Communal-Areas.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-182.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-184.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-186.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-187.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-189.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-190.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-192.pdf](#)
- [A4-Plan_126254_Block-F-Bacton-Low-Rise_Flat-193.pdf](#)



Additional Advice and Information

As the reader of this report you are recommended to make sure that it meets with your requirements. Publication HSG 264 Asbestos: The survey guide suggests the following:

- Check your report against our quotation or your tender
- Check for any caveats or disclaimers you are unsure of
- Check that the survey is as you requested
- Check you understand the included plans
- Check that we have accessed all the areas and rooms you wanted us to

Asbestos Fibre Identification Material Test Certificate

Job Ref No: **126254**, Account Ref No: **17637**, Contract Ref No: **15270**

This certificate is for the attention of	Colin Silvey Rydon Construction Ltd Pinewood, Chineham Business Park, Crockford Lane, Chineham, Basingstoke, RG24 8AL
Site Address	Block F, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Sampled Buildings	Bacton Low Rise, Block F - Communal Area, Bacton Low Rise, Block F - Flat 182, Bacton Low Rise, Block F - Flat 184, Bacton Low Rise, Block F - Flat 185, Bacton Low Rise, Block F - Flat 186, Bacton Low Rise, Block F - Flat 187, Bacton Low Rise, Block F - Flat 189, Bacton Low Rise, Block F - Flat 190, Bacton Low Rise, Block F - Flat 191, Bacton Low Rise, Block F - Flat 192, Bacton Low Rise, Block F - Flat 193, Bacton Low Rise, Block F - Flat 194
Analyst(s)	Laura Leck, Joe McIntyre
Analyst signature(s)	
Analysis date	Thursday, 18th August, 2016
Approved signatory	Simon Spreyer
Approved signature	
Approval date	Tuesday, 23rd August, 2016
Report Rendered on	Tue 23 Aug 2016 @ 16:25:27

Analysis method - In-house method TOP01.03 in accordance with HSG 248 - Asbestos: The Analysts' Guide For Sampling, Analysis and Clearance Procedures H.S.E. 2005. All analysis carried out at Lucion's Head Office laboratory.

Lucion bear no responsibility for sample collection or sample description related information provided by the client.

Where Lucion Environmental Ltd has not undertaken sampling; any prior sampling activity is beyond the company's responsibility. Where Lucion Environmental Ltd has sampled the test material, this has been done in accordance with in-house method TOP01.02. Any opinions and interpretations expressed herein are outside the scope of UKAS accreditation.

The results quoted in this report relate to:

1. Samples analysed in accordance with methods described above
2. Samples analysed and not necessarily to the material from which the samples were taken
3. The time during which sampling took place and to the conditions prevailing during that time

The samples referred to in this report will be retained for 6 months unless requested otherwise.

Total Samples

No Asbestos Detected

Asbestos-Containing Samples

54	16	38
-----------	-----------	-----------

Fibre Identification Analysis Results

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126254-1	Bacton Low Rise, Block F - Flat 182	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126254-2	Bacton Low Rise, Block F - Flat 182	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126254-3	Bacton Low Rise, Block F - Flat 182	1	001/ Stairs	panel to shelves	insulating board		NAD
126254-4	Bacton Low Rise, Block F - Flat 182	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-5	Bacton Low Rise, Block F - Flat 182	2	003/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-6	Bacton Low Rise, Block F - Flat 182	3	003/ Bathroom	toilet cistern	Asbestos-containing composite		Amosite
126254-7	Bacton Low Rise, Block F - Flat 184	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-8	Bacton Low Rise, Block F - Flat 184	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-9	Bacton Low Rise, Block F - Flat 184	-1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-10	Bacton Low Rise, Block F - Flat 184	-1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-11	Bacton Low Rise, Block F - Flat 184	-3	002/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-12	Bacton Low Rise, Block F - Flat 186	0	001/ Entrance Lobby	subfloor	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-13	Bacton Low Rise, Block F - Flat 186	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-14	Bacton Low Rise, Block F - Flat 186	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-15	Bacton Low Rise, Block F - Flat 186	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-16	Bacton Low Rise, Block F - Flat 186	1	002/ Kitchen & Lounge	panels to shelves within wooden cupboard	insulating board		NAD
126254-17	Bacton Low Rise, Block F - Flat 187	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126254-18	Bacton Low Rise, Block F - Flat 187	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-19	Bacton Low Rise, Block F - Flat 187	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-20	Bacton Low Rise, Block F - Flat 187	2	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile

table continued from previous page...

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126254-21	Bacton Low Rise, Block F - Flat 189	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-22	Bacton Low Rise, Block F - Flat 189	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-23	Bacton Low Rise, Block F - Flat 189	-1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-24	Bacton Low Rise, Block F - Flat 190	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-25	Bacton Low Rise, Block F - Flat 190	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-26	Bacton Low Rise, Block F - Flat 190	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-27	Bacton Low Rise, Block F - Flat 190	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-28	Bacton Low Rise, Block F - Flat 190	1	002/ Kitchen & Lounge	panels to shelves within wooden cupboard	insulating board		NAD
126254-29	Bacton Low Rise, Block F - Flat 192	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	Tile and Bitumen contain Chrysotile	Chrysotile
126254-30	Bacton Low Rise, Block F - Flat 192	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-31	Bacton Low Rise, Block F - Flat 192	-1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-32	Bacton Low Rise, Block F - Flat 192	-1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-33	Bacton Low Rise, Block F - Flat 192	-3	002/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board		Chrysotile, Amosite
126254-34	Bacton Low Rise, Block F - Flat 192	-3	002/ Bedroom	panels to shelves	insulating board		NAD
126254-35	Bacton Low Rise, Block F - Flat 192	-3	003/ Bathroom	toilet cistern	Asbestos-containing composite		Amosite
126254-36	Bacton Low Rise, Block F - Flat 193	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126254-37	Bacton Low Rise, Block F - Flat 193	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126254-38	Bacton Low Rise, Block F - Flat 193	-1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-39	Bacton Low Rise, Block F - Flat 193	-2	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product		Chrysotile
126254-40	Bacton Low Rise, Block F - Flat 194	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product		Chrysotile
126254-41	Bacton Low Rise, Block F - Flat 194	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile

table continued from previous page...

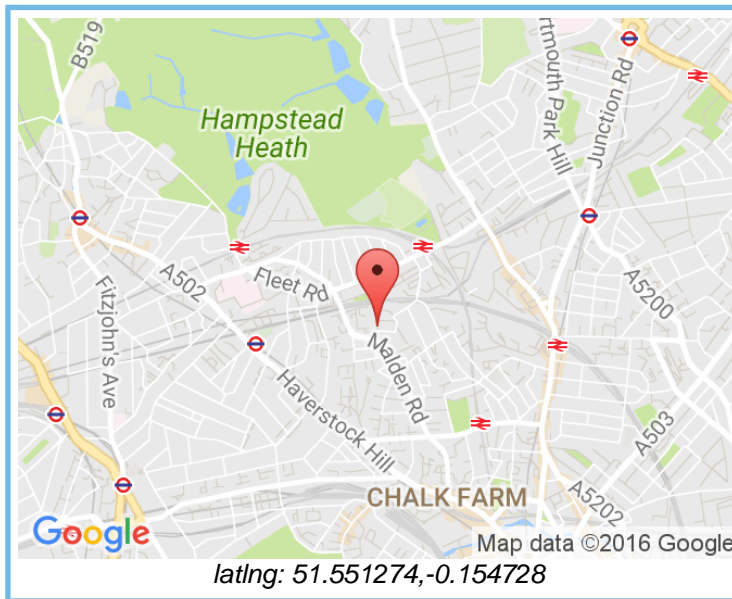
Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126254-42	Bacton Low Rise, Block F - Flat 194	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-43	Bacton Low Rise, Block F - Flat 194	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126254-44	Bacton Low Rise, Block F - Flat 194	1	002/ Kitchen & Lounge	panels to shelves	Asbestos-containing insulating board		Amosite
126254-45	Bacton Low Rise, Block F - Flat 185	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126254-46	Bacton Low Rise, Block F - Flat 185	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite
126254-47	Bacton Low Rise, Block F - Flat 185	-1	001/ Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	chrysotile present in both tile and bitumen	Chrysotile
126254-48	Bacton Low Rise, Block F - Flat 185	-1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126254-49	Bacton Low Rise, Block F - Flat 193	-3	002/ Bathroom	toilet cistern	Asbestos-containing composite		Amosite
126254-50	Bacton Low Rise, Block F - Flat 185	-3	003/ Bedroom	boxing within cupboard	Asbestos-containing insulating board		Amosite
126254-51	Bacton Low Rise, Block F - Flat 185	-3	003/ Bedroom	panels to shelves	insulating board		NAD
126254-52	Bacton Low Rise, Block F - Flat 191	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	chrysotile present in both tile and bitumen	Chrysotile
126254-53	Bacton Low Rise, Block F - Flat 191	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite
126254-54	Bacton Low Rise, Block F - Flat 191	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD

Asbestos Pre-Demolition Survey Report

Job Ref No: **126255**, Account Ref No: **17637**, Contract Ref No: **15270**

Block G, Bacton Low Rise, Haverstock Road, London, NW5 4PS



Title: Pre-demolition Survey - Block G, **Including:** All of property



on site photo

Total Records	Analysed Records	No Asbestos Detected	R3	R2	R1
294	92	41	46	5	0

Report Summary

This certificate is for the attention of	Colin Silvey Rydon Construction Ltd Pinewood, Chineham Business Park, Crockford Lane, Chineham, Basingstoke, RG24 8AL
Contract Title	Phase 2 Bacton Low Rise - Demolition Survey
Survey Type	Survey, Pre-demolition
Site Address	Block G, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Buildings Surveyed	Bacton Low Rise, Block G - Communal Area, Bacton Low Rise Block G Flat 195, Bacton Low Rise Block G Flat 195F, Bacton Low Rise Block G Flat 196, Bacton Low Rise Block G Flat 198, Bacton Low Rise Block G Flat 199, Bacton Low Rise Block G Flat 200
Surveyor(s)	Matthew Nash, Jeremy Billingsby
Surveyor signature(s)	
Survey Date	Monday, 8th August, 2016
Analyst(s)	Stuart Hogg, Sean Campbell
Analyst signature(s)	
Analysis date	Thursday, 25th August, 2016
Approved signatory	Simon Spreyer
Approved signature	
Approval date	Wednesday, 31st August, 2016
Report Rendered on	Wed 31 Aug 2016 @ 11:30:21

Report Contents

Asbestos Register and Executive Summary	4
Introduction	7
Buildings Included in Survey Scope	8
Site Data	9
Survey Methodology	10
HSG 264 Asbestos: The Survey Guide	10
Survey Methodology - Important Notes	11
Method of Sample analysis	12
HSG 248 Asbestos: The Analysts' Guide for Sampling, Analysis and Clearance Procedures	12
Sampling Strategy	13
Results and Findings	14
Initial Risk Level Assessment	14
Recommendations	17
Cited References and Further Reading	19
Management Recommendation Detail	20
Areas Excluded & Not Fully Accessed During Survey	35
Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report	36
Annotated Plans and Other Additional Documents	62
Additional Advice and Information	62
Material Test Certificate	63

Asbestos Register and Executive Summary

The current survey report is not intended to be used as a bill of quantities for asbestos removal activities. This survey can be used to compile a scope of work and technical specification. We can assist you in the preparation of these documents.

Summary of Asbestos Containing Materials

Ordered By Building, Level and Location

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Rise Block G Flat 195	-3	002/Bathroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	-3	002/Bathroom	ceiling	Asbestos-containing concrete	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	1	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	1	002/Kitchen / Living room	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	2	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	2	002/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	2	003/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	3	001/Stairs	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	3	002/Bathroom	toilet cistern	Asbestos-containing composite	R3 (4)	Remove
Bacton Low Rise Block G Flat 195	3	002/Bathroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	3	002/Bathroom	ceiling	Asbestos-containing textured coating	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	3	003/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195	4	001/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board	R3 (6)	Remove
Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 196	-3	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (4)	Remove
Bacton Low Rise Block G Flat 196	-3	002/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 196	-3	002/Bedroom	boxing within cupboard	Asbestos-containing insulating board	R2 (7)	Remove
Bacton Low Rise Block G Flat 196	-2	001/Stairs / Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (4)	Remove
Bacton Low Rise Block G Flat 196	-2	002/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (4)	Remove
Bacton Low Rise Block G Flat 196	-1	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove

table continued from previous page...

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board	R2 (7)	Remove
Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board	R3 (6)	Remove
Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board	R3 (6)	Remove
Bacton Low Rise Block G Flat 198	1	001/Stairs	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board	R2 (7)	Remove
Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	2	001/Stairs	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	2	002/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	2	003/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	3	001/Stairs	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	3	002/Bathroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	3	002/Bathroom	ceiling	Asbestos-containing textured coating	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	3	003/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	4	001/Bedroom	floor covering	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 198	4	001/Bedroom	adhesive to concrete floor	Asbestos-containing bitumen adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 199	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board	R3 (6)	Remove
Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	panel to shelf	Asbestos-containing insulating board	R2 (7)	Remove
Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 199	2	002/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 199	3	002/Bathroom	ceiling	Asbestos-containing concrete	R3 (3)	Remove
Bacton Low Rise Block G Flat 199	3	003/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 200	-3	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 200	-3	002/Bathroom	panel to external wall	Asbestos-containing insulating board	R3 (5)	Remove
Bacton Low Rise Block G Flat 200	-3	002/Bathroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 200	-3	002/Bedroom	floor covering	Asbestos-containing vinyl tile & adhesive	R3 (3)	Remove
Bacton Low Rise Block G Flat 200	-1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board	R2 (7)	Remove
Bacton Low Rise Block G Flat 200	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board	R3 (6)	Remove

Summary of Areas Excluded & Not Fully Accessed During Survey

Building	Level	Location	Item / Product Examined	Accessibility	Access Comments
Nothing to report					

Introduction

This report aims to:

- Introduce pertinent legislation relating to the management of asbestos in non-domestic premises
- Outline the sample testing and inspection methodology employed by the surveyor
- Relate the significance of the report contents to the Control of Asbestos Regulations (2012)
- Detail survey findings compliant with HSG 264
- Serve as a reference document to assist in making further steps towards the management of any asbestos containing materials in the premises
- Provide the information necessary to compile an asbestos management plan compliant with the Control of Asbestos Regulations (2012)
- Form an asbestos register

Regulation 4 of the Control of Asbestos Regulations (2012) states the obligations that persons defined as "duty holders" have to manage asbestos containing materials in non-domestic premises. This instrument defines a duty holder as being:

"Every person who has, by virtue of a contract or tenancy, an obligation of any extent in relation to the maintenance or repair of non-domestic premises or any means of access thereto or egress there from; or

*In relation to any part of non-domestic premises where there is no such contract or tenancy, every person who, to any extent, has control of that part of non-domestic premises or any means of access thereto or egress there from" - **CAR, 2012.***

Regulation 4 also states the following:

"In order to enable him [sic "dutyholder"] to manage the risk from asbestos in non-domestic premises, the dutyholder shall ensure that a suitable and sufficient assessment is carried out as to whether asbestos is or is liable to be present in the premises"

This report satisfies this requirement, unless stated otherwise, by detailing the inspection findings reporting the presence of asbestos containing materials in those areas given in the survey inspection detail.

Health and Safety Guidance - Publication "Asbestos: The Survey Guide (HSG 264)" details the material assessment that must be carried out to determine the risk posed by asbestos containing materials in buildings. This material risk assessment has been carried out on those materials strongly presumed or proven to contain asbestos. The resulting material assessment risk ratings can (in conjunction with the management recommendation made for these materials) then be used to form the basis of an asbestos management plan.

Where possible the surveyor has attempted to interpret the needs of the client in their demolition works however the reader must satisfy themselves that the report includes those areas affected by demolition works.

Buildings Included in Survey Scope

Site Address: **Block G, Bacton Low Rise, Haverstock Road, London, NW5 4PS**

Surveyed Buildings: **Bacton Low Rise, Block G - Communal Area, Bacton Low Rise Block G Flat 195, Bacton Low Rise Block G Flat 195F, Bacton Low Rise Block G Flat 196, Bacton Low Rise Block G Flat 198, Bacton Low Rise Block G Flat 199, Bacton Low Rise Block G Flat 200**

Every effort has been made to identify all asbestos materials so far as was reasonably practical to do so within the scope of the survey and the attached report. Methods used to carry out the survey were agreed with the client prior to any works being commenced by way of acceptance of our contract / quotation.

This survey was conducted in accordance with Health and Safety Guidance - Publication "Asbestos: The Survey Guide (HSG 264)". Lucion Environmental Ltd cannot accept any liability for loss, injury, damage or penalty issues that arise for reasons of survey scope limitations. Lucion Environmental Ltd cannot be held responsible for any damage caused as part of this survey carried out on your behalf. Due to the nature and necessity of sampling for asbestos some damage is unavoidable and will be limited to that necessary for taking of the samples.

The "areas excluded and not fully accessed during survey" section of this report gives details of those buildings, locations and items not accessed at the time of the survey (where appropriate, and if all areas were fully accessed, no items are listed). The "included buildings" list above gives details of those buildings included in the survey scope. The inspection log should be referenced for details of specific locations inspected within these buildings.

The scope of this survey relates only to building or area(s) inspected and does not include any form of investigation of the land on which the building is situated.

Where investigation of an intrusive nature (within the scope of the survey being performed) is needed to discern the presence of a material and the property is occupied during the inspection the level of intrusion may be restricted. As far as is reasonably practicable such restrictions will be indicated within the "areas excluded & not fully accessed during survey" section of this report. Scenarios leading to intrusion restriction may [by way of example] include (but are not limited to) security integrity of the building envelope, significant damage to decorative finishes, risk to the structural integrity of the building, occupation within adjacent areas. Investigations undertaken in such situations may, through circumstantial restrictions, be incomplete. Further investigation works may be required once unrestricted access can be offered.

Items or areas not covered by this survey that are scheduled to undergo demolition should be investigated prior to commencement of such activities.

Site Data

Site ID	91579
Address	Block G, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Property Type	Domestic
Property Build Date	mixed construction age
Property Number of buildings	1
Property Number of rooms	5-10
Property Size	Unknown
Property Construction type	Traditional
Roof Type	Mixed types
Roof Material	Slated or tiled
Property access notes	Access arranged with tenant
Property access restrictions	none
Property unusual features	none
Property in Conservation area?	NO
Listed Building?	NO
Property Plant or equipment installed?	YES

Survey Methodology

The asbestos survey findings detailed in this report were gathered using documented in house inspection (TOP01.01) and sampling procedures (TOP01.02) that implement the requirements of the Health and Safety Executive Publications HSG 264 (Asbestos: The survey guide) and HSG 248 (Asbestos: The analysts' guide for sampling, analysis and clearance procedures). All asbestos surveys aim to locate as far as is reasonable practical, the presence and extent of any ACMs in the building within the defined scope of the survey (refer HSG 264). This method complies with section 3 of Regulation 4 (CAR, 2012)

HSG 264 Asbestos: The Survey Guide

Publication HSG 264 sub-divides asbestos surveys into 2 principal types, termed: Management and Refurbishment & Demolition surveys respectively. These survey types may be summarised as follows (both have been shown to allow visualisation of the scope of the present management survey relative to the refurbishment & demolition survey specification and their suggested application/s).

Management Survey - Standard Sampling, Identification and Assessment

The underlying purpose and inspection methodology of the management survey is to locate the presence, extent and condition by way of sampling and inspection of suspect asbestos containing materials as they are encountered. Where possible, representative samples of materials suspected by the surveyor to contain asbestos are taken and analysed for the presence and type of asbestos fibre present. This survey is intended for integration into a plan for the management of asbestos containing materials under Regulation 4 of CAR (2012). The management surveys offers information allowing routine and simple maintenance works to be carried and this reflects the surveyor's level of intrusion at the time of the inspection. More extensive maintenance or repair work may require additional investigations to be undertaken; the findings of this survey should be checked with this in mind to confirm whether or not they of adequate scope.

Demolition Survey - Full Access, Sampling and Identification

The refurbishment and demolition survey is fully intrusive (as far as is reasonably practicable) and is aimed at locating all asbestos containing materials within a survey area. Normally, unless otherwise specified (*refer to the Method Statement as listed in **Annotated Plans and Other Additional Documents** section of this document*), it involves fully invasive and possibly destructive investigation of all survey areas, in order to locate and assess all materials suspected as containing asbestos. The survey records only the location and estimated extent of asbestos containing materials. A priority rating has been assigned to asbestos containing materials encountered during the course of the inspection to aid ongoing management of these materials prior to refurbishment (*HSG 264 states a duration in excess of 3 months as requiring ongoing management of ACMs*). Recommendations made for material management are based solely on isolated item inspection and material assessment and may be subject to change in the context of the overall refurbishment works. However the surveyor will default to "remove" as a recommendation within a refurbishment survey. This type of survey is normally recommended prior to refurbishment work commencing in the survey area. There is a specific requirement in CAR (2012) (Regulation 7) for all asbestos containing materials to be removed as far reasonably practicable before demolition.

Survey Methodology - Important Notes

Reasonable Skill and Care

Although all survey areas that have been examined are reported in accordance with HSG 264 and documented in house procedures (for the specified survey type) and all reasonable skill and care has been exercised by the surveyor in doing so, it must be realised that no survey can reasonably guarantee beyond doubt that all asbestos containing materials have been located. Reasons for this limitation may include health and safety issues, reasons of practicality, non-access to live equipment and dangerous or contaminated environments or risk of unsafe levels of damage being inflicted on the survey area amongst others, or the location of the material being outside the investigative scope of the survey type undertaken.

Non-asbestos Materials - A Reasoned Argument

All items examined by the surveyor at the time of the survey are listed in the inspection detail of this report. This detail includes those items believed by the surveyor not to contain asbestos and an appropriate categorisation of their material composition is given. Employing this rationale the surveyor can use experience and judgement to form a reasoned argument that there is evidence to suggest that the material may not contain asbestos. Periodically "non-asbestos" building materials may be sampled by way of a method control to further support the surveyor's argument. These materials do not bear any risk assessment detail.

Materials Presumed to Contain Asbestos

If the surveyor feels that a reasoned argument against a material containing asbestos cannot be formed, the item in question may be presumed to contain asbestos. This may include, but is not restricted to, areas where access cannot be gained. This scenario attracts the designation "P" in the sampling strategy column of the "Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report" table within this report.

Materials Strongly Presumed to Contain Asbestos

In the case of a material or materials being encountered that the surveyor suspects, following visual assessment, as containing asbestos but cannot be sampled for reasons of practicality, that material is strongly presumed to contain asbestos. An assessment (where possible) of the material's extent and condition is made. Nota bene: as no definitive assessment of asbestos fibre type contained in the material may be made, this portion of the priority score is based on a strongly presumed worst-case scenario of fibre type commonly contained in the material concerned. This scenario attracts the designation "SP" in the sampling strategy column of the "Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report" table within this report.

Sampling of Materials

If access to the material permits, a representative sample of the material is taken according to the "sampling strategy". An assessment (where necessary or possible) of the material's extent and condition is made. As no practical sampling strategy can be assured as being entirely representative of the circumstances encountered during surveying, care should be exercised when interpreting results. That is to say that if works are planned that may cause disturbance or require the removal of asbestos containing materials, implementation of a more intense sampling regime may be desirable.

Material Cross Referencing

In the event of a suspect material being encountered with a frequency that does not permit repeated re-sampling on the grounds of practicality, the surveyor may cross reference this item with one that has already been sampled. To do this the surveyor will ensure that the material is identical in nature (through examining visual appearance e.g. colour) to that of the material to which it is referenced. Nota bene: as no definitive assessment of asbestos fibre type contained in the material may be made, this portion of the priority score is strongly presumed as being the same as that of the material from which it is cross referenced.

Method of Sample analysis

The bulk asbestos fibre identification results detailed in this report and the appended certificate of bulk analysis were obtained using a documented in house testing procedure (TOP01.03) that implements the requirements of Health and Safety Executive Publication HSG 248, Appendix 2 (Asbestos: The analysts' guide for sampling, analysis and clearance procedures). All samples collected during the course of this survey are tested in accordance with this method.

HSG 248 Asbestos: The Analysts' Guide for Sampling, Analysis and Clearance Procedures

Publication HSG 248 describes a two stage approach to the detection and subsequent identification of asbestos fibre in bulk (i.e. suspect sample) materials. Initially the microscopist will examine the material under a low power stereo light microscope. The microscopist then performs extensive optical tests using polarised light microscopy in order to confirm or refute that the material contains an asbestos mineral. This technique allows for the detection of the six common forms of asbestos fibre as follows:

Asbestos Fibre Type	Common Nomenclature
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	N/A
Fibrous Anthophyllite	N/A
Fibrous Tremolite	N/A

The results of this test are given, where appropriate, in the inspection detail report for each sample taken and are summarised in the management recommendation report. They are also separately detailed in the bulk-analysis report appended to this report. The homogeneity of asbestos containing materials can differ depending on their type. Typically, homogeneous materials include sprayed coatings, insulating board and asbestos cement products. Other materials are typically less homogeneous including pipe lagging (due to patch repairs, hand mixing at time of application), textured coatings (due to low concentration of asbestos fibre and hand application), composites (due to low concentration of asbestos fibre and material matrix) and debris samples (due to the potentially inconsistent occurrences that have led to their presence). Whilst sampling frequencies / techniques and analysis methods attempt to address the issue of non-homogeneity it should be realised that sampling in accordance with HSG 264 and analysis in accordance with HSG 248 cannot always obviate the problems of determining asbestos fibre content in non-homogeneous materials. The results of sample analysis presented in this report therefore pertain to the samples analysed and so relate only to the time at which sampling took place and to the conditions prevailing during that time.

Sampling Strategy

Product Type	Sampling Strategy
Vinyl, composite floor coverings, surface coverings	One sample per room, or one sample per 40m ² per product type or colour. Where large expanses of the same material have been used throughout an area, the frequency of sampling may be decreased at the discretion of the surveyor. Associated adhesives, depending on site and material conditions, will either be collected as separate samples or included with the floor covering as a single entity.
Textured Coatings	One composite sample per room or one sample per 9m ² dependent on similarity of coating type. Where large expanses of the same material have been used throughout an area. The frequency of sampling may be increased or decreased at the discretion of the surveyor.
Gaskets, ropes, woven product, seals, mastics, papers, felts	One sample per product type, or if appropriate, per area or location.
Asbestos containing insulating board	One sample per location or per 25m ² of continuous product run. The frequency of sampling may be increased or decreased at the discretion of the surveyor dependent on such factors as consistency of product type or occurrence of different board types. The specific nature of this material has been determined on site using the competence and experience of the surveyor. Lucion Environmental accepts no liability for any decision based on this determination and as such it should only be regarded as an opinion. Where doubt exists as to the classification of a board material HSE Approved Code of Practice L143 "Managing and working with asbestos" recommends carrying out a water absorption test. Lucion Environmental will perform this test only upon specific request.
Cement Products	One sample per product type, or if appropriate, per area or location. The specific nature of this material has been determined on site using the competence and experience of the surveyor. Lucion Environmental accepts no liability for any decision based on this determination and as such it should only be regarded as an opinion. Where doubt exists as to the classification of a board material HSE Approved Code of Practice L143 "Managing and working with asbestos" recommends carrying out a water absorption test. Lucion Environmental will perform this test only upon specific request.
Debris	One sample per location, or more at the discretion of the surveyor. Where debris exists in a location quantification can be hindered by a number of factors including paint coverings, air movement, the passage of time etc. The surveyor reports only the material discernable within the confines of the survey sufficient to show that debris exists in a location. Further focused investigation may be needed to determine the extent of debris for the purposes of decontamination.
Insulative Materials	One sample per material product type (to include change in outward appearance) and at least one sample per 10 metre pipe run. In addition, one sample per different product applied to pipe bends.
Sprayed Insulation	One sample per 20m ² of material

Results and Findings

The item examination and inspection findings, bulk analysis results, material assessment and initial risk level assessment are reported in the form of an asbestos inspection and testing detail register. The purpose and structure of this register are explained in the preceding sections.

Initial Risk Level Assessment

The initial risk level assessments made within this report for those items strongly presumed, or positively proven by sampling and subsequent analysis, to contain asbestos have been made on the basis of the Material Assessment Algorithm detailed within the publications HSG 264 and HSG 227.

This assessment aims to elucidate the potential for a particular material to release hazardous fibres and expose those within the specific area to asbestos dust. The following table gives the scoring strategy for the initial risk level assessment and indicates the scoring degree of those points that are considered, namely product type, condition, surface treatment and asbestos fibre type present.

	Score	Score Category
Product Type An assessment of the inherent risk a product may pose (Product debris is assessed on the product type from which it originates)	1	Asbestos reinforced composites - Plastics / resins / mastics / felts / vinyl tiling / semi rigid paints / decorative finishes / asbestos cement and other such similar bound materials.
	2	Materials of a medium asbestos content including - Asbestos insulating board / millboard / low density insulation board / textiles / gaskets / ropes / papers / debris from asbestos containing composite material and cement.
	3	Materials of a high asbestos content including - Thermal insulation / sprayed asbestos / loose asbestos / packing / filled padding / all other debris.
Material Condition An assessment of the damage or deterioration in condition of product	0	Undamaged - No visible signs of damage
	1	Minor damage - Light material surface abrasion / abrasion to edges
	2	Medium damage - Evidence of loose asbestos fibre protruding from material / poor condition of material is notable
	3	Major damage - Significant damage to materials often resulting in the short-term production of asbestos containing debris / delamination of sprays and thermal insulation / asbestos debris

table continued from previous page...

	Score	Score Category
<p>Surface Treatment</p> <p>An assessment of the level of fibre retention the surface of a material may be capable of</p>	0	Composite materials - Plastics / resins / mastics / felts / vinyl tiling / semi rigid paints / decorative finishes
	1	Sealed and enclosed materials - Painted asbestos insulating board (with exposed face painted or encapsulated) / enclosed asbestos lagging and sprayed asbestos (as originally installed) / unsealed asbestos cement products
	2	Unsealed and encapsulated materials - Unsealed asbestos insulating board / asbestos lagging, sprayed asbestos and woven material encapsulated (remedially)
	3	Unsealed friable materials - Unsealed asbestos lagging and sprayed asbestos
<p>Asbestos Fibre Type</p> <p>An assessment of asbestos fibre types propensity to cause asbestos related diseases</p>	1	Serpentine Asbestos - Chrysotile
	2	Amphibole Asbestos - Amosite / Anthophyllite / Tremolite / Actinolite
	3	Amphibole Asbestos - Crocidolite

Material / Accessibility Score

Following the rating of a material using the above criteria, the resulting aggregated additive material score may be assessed in terms of accessibility to derive an assessment of initial risk level as follows:

	Very Low Risk (2-4)	Low Risk (5-6)	Medium Risk (7-9)	High Risk (10-12)
Normally Inaccessible (1)	R3	R3	R3	R2
Periodically Accessed (2)	R3	R3	R2	R1
Frequently Accessed (3)	R3	R2	R1	R1

The level of access to the ACM determines how easily the product can be reached by the building occupants which could result in a disturbance that causes fibre release, it relates purely to access and does not consider product type.

The above is defined by the following:

1. Normally inaccessible or occasionally accessed:

The ACM will not be accessed or is unlikely to be disturbed.

2. Periodically accessed:

The ACM is likely to be disturbed occasionally.

3. Frequently accessed:

The ACM is routinely and easily disturbed.

General Interpretation of Risk Assessment Level

Risk Assessment Level	Interpretation of the Recommended Control Action
R1	immediate implementation
R2	as soon as practicable - <i>in interim period material should be regularly inspected and its management planned for</i>
R3	not immediately necessary - <i>material should be regularly inspected and its management planned for</i>

Recommendations

In addition to the risk assessment level assigned to strongly presumed and identified asbestos containing material, a management control action recommendation is also made. In the case of survey carried out prior to refurbishment or demolition works, the "normal" recommendation will be "remove" as the surveyor assumes that asbestos removal will take place prior to other works commencing (unless the surveyor has been advised otherwise in advance of the survey). However in certain circumstances another recommendation may be made and those commonly used are given in the recommendations table.

The current recommendations conventionally made by the surveyor may include the following:

Recommendation	Description	Notes
Air Monitoring	Sampling of air for asbestos fibre concentration. Necessary where a risk of fibre exposure is present and assessment of such exposure presence or absence is prudent.	UKAS accredited analytical laboratory should perform reassurance air testing.
Access Restriction	Restriction of access to area / location only to personnel wearing appropriate PPE / RPE.	Suitability of RPE / PPE must be carefully assessed and procedure invoked to ensure these control measures are adhered to.
Access Prohibition	Prohibition of access to area / location to all personnel.	Area should be marked clearly as being prohibited to all personnel, possibly in conjunction with asbestos warning stickers.
Environmental Clean	A cleanup of areas following disturbance of asbestos or discovery of loose asbestos dust/debris/material.	The work is not removal (ie requiring physical force) and consists of vacuuming, wiping, picking up and bagging of debris. The work can be either licensed or unlicensed depending on the product and whether exposure is likely to exceed the 4 hour control limit or sporadic and low intensity limit. For licensed work a 4-stage clearance by a UKAS accredited laboratory is required, whilst for non-licensed work appropriate air tests are recommended.
Material Repair	Repair of the material in such a manner as to minimise the release of asbestos fibre.	Repair of materials is recommended by the Health and Safety Executive as an alternative to removal, where reasonably safe to so.
Material Encapsulation	Encapsulation of the material in a manner that ensures the complete enclosure of any remaining asbestos fibres.	Encapsulation of materials is a possible alternative to their removal, where reasonably safe to do so. Works should also be accompanied by appropriate air test performed by a UKAS accredited laboratory.
Material Removal	Removal of the material in instances where it is remaining in situ would lead to a high residual risk level. Or removal may be necessary to permit work within the location. Removal of materials may also be carried out on a preventive basis.	Removal works should be carried out in accordance with the relevant ACOP (approved code of practice), L143
<p><i>Any recommendations made within this report are made on the basis of findings collated at the time of survey. Recommendations should undergo careful client evaluation prior to a final management decision being made. Lucion Environmental Ltd does not accept any responsibility for any works carried out as a result of recommendations made within this report.</i></p>		

Cited References and Further Reading

1. Control of Asbestos Regulations (2012) ~ The Stationery Office. **ISBN 978-0111521083**
2. Construction (Design and Management) Regulations (2015) ~ The Stationery Office. **ISBN 9780717666263**
3. The Hazardous Waste (England and Wales) Regulations (2005) ~ The Stationery Office. **ISBN 011072685-5**
4. Managing and working with asbestos Control of Asbestos Regulations 2012. Approved Code of Practice & guidance L143 (second edition, 2013) ~ HSE Books. **ISBN 978-0717666188**
5. A Comprehensive Guide to Managing Asbestos in Premises (2002) ~ HSE Books. **ISBN 978-0717623815**
6. Asbestos Essentials: A task manual for building, maintenance and allied trades of non-licensed asbestos work (third edition, 2012) ~ HSE Books. **ISBN 978-0717665037**
7. [Asbestos Essentials Task Sheets \[http://www.hse.gov.uk/asbestos/essentials/ \]](http://www.hse.gov.uk/asbestos/essentials/) ~ HSE. *electronic downloadable version of the above*
8. Asbestos: The licensed contractors' guide HSG247 (2006) ~ HSE Books. **ISBN 978-0717628742**
9. Asbestos: The analysts' guide for sampling, analysis and clearance procedures HSG248 (2005) ~ HSE Books. **ISBN 978-0717628759**
10. Asbestos: The Survey Guide HSG 264 (second edition, 2012) ~ HSE Books. **ISBN 978-0717665020**
11. The Management of Health and Safety at Work Regulations (1999) ~ The Stationery Office. **ISBN 011085625-2**
12. The Health & Safety at Work etc. Act (1974) ~ The Stationery Office.

Management Recommendation Detail


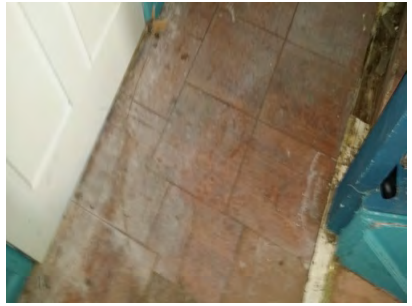

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 195	-3	002/Bathroom	adhesive to concrete floor	126255-8	Asbestos-containing bitumen adhesive	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	-3	002/Bathroom	ceiling	126255-6	Asbestos-containing concrete	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	1	001/Stairs	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	1	002/Kitchen / Living room	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 195	2	001/Stairs	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	2	002/Bedroom	adhesive to concrete floor	126255-1	Asbestos-containing bitumen adhesive	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	2	003/Bedroom	adhesive to concrete floor	126255-1	Asbestos-containing bitumen adhesive	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 195	3	001/Stairs	adhesive to concrete floor	126255-1	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	3	002/Bathroom	toilet cistern	126255-7	Asbestos-containing composite	Amosite	4	1 No.	R3	Remove	
Bacton Low Rise Block G Flat 195	3	002/Bathroom	adhesive to concrete floor	126255-1	Asbestos-containing bitumen adhesive	Chrysotile	3	8 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 195	3	002/Bathroom	ceiling	126255-6	Asbestos-containing textured coating	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	3	003/Stairs	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 195	4	001/Bedroom	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	10 Sqm.	R3	Remove	

table continued from previous page...

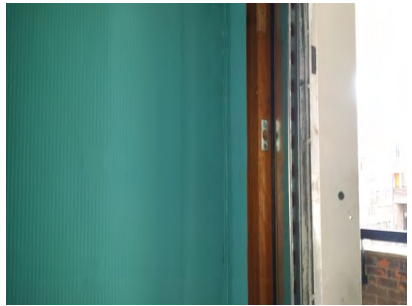


Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	panel to electrics	126255-2	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Lm.	R3	Remove	
Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	floor covering	126255-1	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 196	-3	001/Stairs	floor covering	126255-7	Asbestos-containing vinyl tile & adhesive	Amosite	4	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 196	-3	002/Bedroom	floor covering	126255-8	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 196	-3	002/Bedroom	boxing within cupboard	126255-11	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R2	Remove	
Bacton Low Rise Block G Flat 196	-2	001/Stairs / Bedroom	floor covering	126255-7	Asbestos-containing vinyl tile & adhesive	Amosite	4	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 196	-2	002/Bedroom	floor covering	126255-7	Asbestos-containing vinyl tile & adhesive	Amosite	4	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 196	-1	001/Stairs	floor covering	126255-8	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	floor covering	126255-8	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...



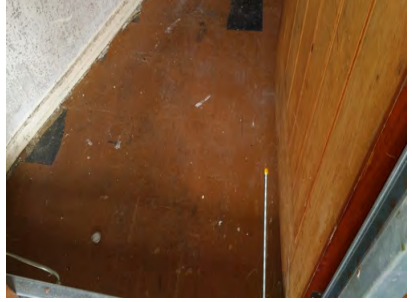
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	boxing within cupboard	126255-11	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R2	Remove	
Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	panel to electrics	126255-9	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Lm.	R3	Remove	
Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	floor covering	126255-8	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	panel to electrics	126255-15	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Lm.	R3	Remove	
Bacton Low Rise Block G Flat 198	1	001/Stairs	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...


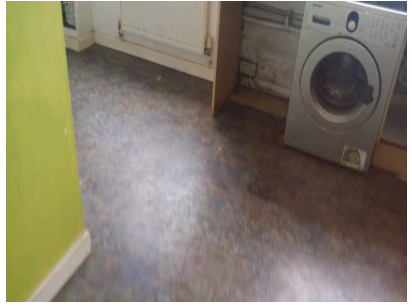

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	boxing within cupboard	126255-17	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R2	Remove	
Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	2	001/Stairs	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 198	2	002/Bedroom	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	2	003/Bedroom	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	3	001/Stairs	adhesive to concrete floor	126255-1	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 198	3	002/Bathroom	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	3	002/Bathroom	ceiling	126255-6	Asbestos-containing textured coating	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	3	003/Bedroom	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 198	4	001/Bedroom	floor covering	126255-21	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...


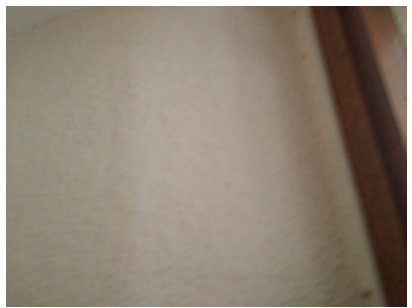

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 198	4	001/Bedroom	adhesive to concrete floor	126255-14	Asbestos-containing bitumen adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 199	0	001/Entrance Lobby	panel to electrics	126255-20	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Lm.	R3	Remove	
Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	panel to shelf	126255-24	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R2	Remove	

table continued from previous page...


Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	floor covering	126255-21	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 199	2	002/Bedroom	floor covering	126255-14	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 199	3	002/Bathroom	ceiling	126255-6	Asbestos-containing concrete	Chrysotile	3	8 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 199	3	003/Bedroom	floor covering	126255-21	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...


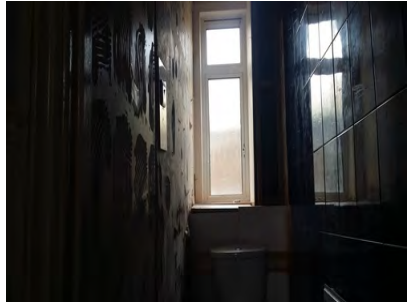



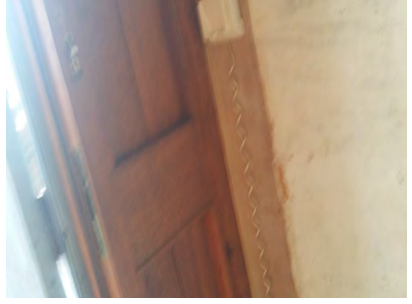

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 200	-3	001/Stairs	floor covering	126255-29	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 200	-3	002/Bathroom	panel to external wall	126255-29	Asbestos-containing insulating board	Chrysotile	5	6 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 200	-3	002/Bathroom	floor covering	126255-29	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	8 Sqm.	R3	Remove	

table continued from previous page...

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Rise Block G Flat 200	-3	002/Bedroom	floor covering	126255-29	Asbestos-containing vinyl tile & adhesive	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Rise Block G Flat 200	-1	002/Kitchen / Living room	boxing within cupboard	126255-28	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R2	Remove	
Bacton Low Rise Block G Flat 200	0	001/Entrance Lobby	panel to electrics	126255-26	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Lm.	R3	Remove	

Areas Excluded & Not Fully Accessed During Survey


⊖ Asbestos should be presumed to be present within Locations and Items not accessed until a further assessment can be performed.

 Additional surveyor comments.

Building	Level	Location	Item / Product Examined	Accessibility	Surveyor Additional Comments At Time Of Survey	Photograph
Nothing to report						

Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report

 Asbestos should be presumed to be present within Locations and Items not accessed until a further assessment can be performed.

 Additional surveyor comments.

Building: Bacton Low Rise, Block G - Communal Area			Level: 0			Location: 001/ Garage 66					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										

Building: Bacton Low Rise, Block G - Communal Area			Level: 0			Location: 002/ Garage 67					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										

Building: Bacton Low Rise, Block G - Communal Area			Level: 0			Location: 003/ Garage 68					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										

table continued from previous page...

Building: Bacton Low Rise, Block G - Communal Area			Level: 0		Location: 003/ Garage 68						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
Building: Bacton Low Rise, Block G - Communal Area			Level: 0		Location: 004/ Garage 69						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
Building: Bacton Low Rise, Block G - Communal Area			Level: 0		Location: 005/ Garage 70						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
Building: Bacton Low Rise, Block G - Communal Area			Level: 0		Location: 006/ Garage 71						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										



Building: Bacton Low Rise, Block G - Communal Area				Level: 0	Location: 007/ Garage 72						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
Building: Bacton Low Rise, Block G - Communal Area				Level: 0	Location: 008/ Garage 73						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
Building: Bacton Low Rise Block G Flat 195				Level: -3	Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	Asbestos-containing concrete	Cross Reference	126255-6	8 Sqm.	1	1	0	Chrysotile	3	2	R3
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-8	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-10								 NAD
within wooden boxing	no asbestos observed										

table continued from previous page...








Building: Bacton Low Rise Block G Flat 195			Level: -3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
within wooden bath panel	no asbestos observed										
Building: Bacton Low Rise Block G Flat 195			Level: 1		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-1	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 195			Level: 1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-1	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Sample	126255-4								 NAD
boiler	modern										
within wooden boxing to boiler	no asbestos observed										

table continued from previous page...

Building: Bacton Low Rise Block G Flat 195			Level: 1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panel to shelf	insulating board	Sample	126255-5								 NAD
Building: Bacton Low Rise Block G Flat 195			Level: 2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-1	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 195			Level: 2		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-1	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD








Building: Bacton Low Rise Block G Flat 195			Level: 2		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-1	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD
Building: Bacton Low Rise Block G Flat 195			Level: 3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-1	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 195			Level: 3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	Asbestos-containing textured coating	Sample	126255-6	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
walls	concrete										

table continued from previous page...

Building: Bacton Low Rise Block G Flat 195			Level: 3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-1	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD
toilet cistern	Asbestos-containing composite	Sample	126255-7	1 No.	1	1	0	Amosite	4	2	 R3
within wooden boxing	no asbestos observed										
within wooden bath panel	no asbestos observed										
Building: Bacton Low Rise Block G Flat 195			Level: 3		Location: 003/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-1	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD
within wooden boxing	no asbestos observed										


Building: Bacton Low Rise Block G Flat 195			Level: 4		Location: 001/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-1	10 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 195F			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Sample	126255-1	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to electrics	Asbestos-containing insulating board	Sample	126255-2	2 Lm.	2	1	1	Amosite, Chrysotile	6	2	 R3
panel to wall	insulating board	Sample	126255-3								 NAD
electrics	modern										
Building: Bacton Low Rise Block G Flat 196			Level: -3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										

table continued from previous page...





Building: Bacton Low Rise Block G Flat 196			Level: -3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-7	12 Sqm.	1	1	0	Amosite	4	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 196			Level: -3		Location: 002/Bathroom						
No Records were taken at this Location											
Building: Bacton Low Rise Block G Flat 196			Level: -3		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-8	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-10								 NAD
boxing within cupboard	Asbestos-containing insulating board	Cross Reference	126255-11	2 Sqm.	2	1	2	Amosite, Chrysotile	7	2	 R2

table continued from previous page...





Building: Bacton Low Rise Block G Flat 196			Level: -3		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panel to shelves	insulating board	Sample	126255-13								 NAD
Building: Bacton Low Rise Block G Flat 196			Level: -2		Location: 001/Stairs / Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-7	12 Sqm.	1	1	0	Amosite	4	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-10								 NAD
Building: Bacton Low Rise Block G Flat 196			Level: -2		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-7	12 Sqm.	1	1	0	Amosite	4	2	 R3
floor	concrete										

table continued from previous page...



Building: Bacton Low Rise Block G Flat 196			Level: -2		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panel to external wall	insulating board	Cross Reference	126255-10								 NAD
Building: Bacton Low Rise Block G Flat 196			Level: -1		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-8	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 196			Level: -1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-8	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Sample	126255-10								 NAD
boiler	modern										

table continued from previous page...

Building: Bacton Low Rise Block G Flat 196			Level: -1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
within wooden boxing to boiler	no asbestos observed										
boxing within cupboard	Asbestos-containing insulating board	Sample	126255-11	2 Sqm.	2	1	2	Amosite, Chrysotile	7	2	 R2
sink pad	bituminous product	Sample	126255-12								 NAD
Building: Bacton Low Rise Block G Flat 196			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Sample	126255-8	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to electrics	Asbestos-containing insulating board	Sample	126255-9	2 Lm.	2	1	1	Amosite, Chrysotile	6	2	 R3
electrics	modern										
Building: Bacton Low Rise Block G Flat 198			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...









Building: Bacton Low Rise Block G Flat 198			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Sample	126255-14	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to electrics	Asbestos-containing insulating board	Sample	126255-15	2 Lm.	2	1	1	Amosite, Chrysotile	6	2	 R3
electrics	modern										
Building: Bacton Low Rise Block G Flat 198			Level: 1		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 198			Level: 1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	12 Sqm.	1	1	0	Chrysotile	3	2	 R3

table continued from previous page...

Building: Bacton Low Rise Block G Flat 198			Level: 1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
panel to external wall	insulating board	Sample	126255-16								 NAD
boiler	modern										
within wooden boxing to boiler	no asbestos observed										
panel to shelf	insulating board	Cross Reference	126255-5								NAD
boxing within cupboard	Asbestos-containing insulating board	Sample	126255-17	2 Sqm.	2	1	2	Amosite, Chrysotile	7	2	 R2
panel to shelf	insulating board	Sample	126255-18								 NAD
Building: Bacton Low Rise Block G Flat 198			Level: 2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										

Building: Bacton Low Rise Block G Flat 198			Level: 2		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD

Building: Bacton Low Rise Block G Flat 198			Level: 2		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-4								 NAD

Building: Bacton Low Rise Block G Flat 198			Level: 3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...




Building: Bacton Low Rise Block G Flat 198			Level: 3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-1	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 198			Level: 3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	Asbestos-containing textured coating	Cross Reference	126255-6	8 Sqm.	1	1	0	Chrysotile	3	2	R3
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-16								 NAD
within wooden boxing	no asbestos observed										
within wooden bath panel	no asbestos observed										
Building: Bacton Low Rise Block G Flat 198			Level: 3		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...


Building: Bacton Low Rise Block G Flat 198			Level: 3		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-16								 NAD
within wooden boxing	no asbestos observed										
Building: Bacton Low Rise Block G Flat 198			Level: 4		Location: 001/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing bitumen adhesive	Cross Reference	126255-21	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 198			Level: 4		Location: 001/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bitumen adhesive	Cross Reference	126255-14	2 Sqm.	1	1	0	Chrysotile	3	2	 R3

table continued from previous page...

Building: Bacton Low Rise Block G Flat 198				Level: 4		Location: 001/Bedroom					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
Building: Bacton Low Rise Block G Flat 199				Level: 0		Location: 001/Entrance Lobby					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	vinyl tile & adhesive	Sample	126255-19								
floor	concrete										
panel to electrics	Asbestos-containing insulating board	Sample	126255-20	2 Lm.	2	1	1	Amosite, Chrysotile	6	2	
electrics	modern										
Building: Bacton Low Rise Block G Flat 199				Level: 1		Location: 001/Stairs					
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-19								
floor	concrete										










Building: Bacton Low Rise Block G Flat 199			Level: 1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Sample	126255-21	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Sample	126255-22								 NAD
boiler	modern										
within wooden boxing to boiler	no asbestos observed										
boxing within cupboard	insulating board	Sample	126255-23								 NAD
panel to shelf	Asbestos-containing insulating board	Sample	126255-24	2 Sqm.	2	1	2	Amosite, Chrysotile	7	2	 R2
Building: Bacton Low Rise Block G Flat 199			Level: 2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-19								 NAD

table continued from previous page...

Building: Bacton Low Rise Block G Flat 199			Level: 2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
Building: Bacton Low Rise Block G Flat 199			Level: 2		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-14	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-22								 NAD
Building: Bacton Low Rise Block G Flat 199			Level: 2		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-19								 NAD
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-22								 NAD



Building: Bacton Low Rise Block G Flat 199			Level: 3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-19								 NAD
floor	concrete										
Building: Bacton Low Rise Block G Flat 199			Level: 3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	Asbestos-containing concrete	Cross Reference	126255-6	8 Sqm.	1	1	0	Chrysotile	3	2	R3
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-19								 NAD
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-22								 NAD
within wooden boxing	no asbestos observed										
within wooden bath panel	no asbestos observed										
Building: Bacton Low Rise Block G Flat 199			Level: 3		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...




Building: Bacton Low Rise Block G Flat 199			Level: 3		Location: 003/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-21	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-16								 NAD
within wooden boxing	no asbestos observed										
Building: Bacton Low Rise Block G Flat 200			Level: -3		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Sample	126255-29	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor	concrete										
Building: Bacton Low Rise Block G Flat 200			Level: -3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete			8 Sqm.	1	1	0			2	
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-29	8 Sqm.	1	1	0	Chrysotile	3	2	 R3

table continued from previous page...






Building: Bacton Low Rise Block G Flat 200			Level: -3		Location: 002/Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
panel to external wall	Asbestos-containing insulating board	Cross Reference	126255-29	6 Sqm.	2	1	1	Chrysotile	5	2	
within wooden boxing	no asbestos observed										
within wooden bath panel	no asbestos observed										
Building: Bacton Low Rise Block G Flat 200			Level: -3		Location: 002/Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing vinyl tile & adhesive	Cross Reference	126255-29	12 Sqm.	1	1	0	Chrysotile	3	2	
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-27								
Building: Bacton Low Rise Block G Flat 200			Level: -2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...

Building: Bacton Low Rise Block G Flat 200			Level: -2		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-25								 NAD
floor	concrete										
Building: Bacton Low Rise Block G Flat 200			Level: -2		Location: 002/Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-25								 NAD
floor	concrete										
panel to external wall	insulating board	Cross Reference	126255-27								 NAD
Building: Bacton Low Rise Block G Flat 200			Level: -1		Location: 001/Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-25								 NAD
floor	concrete										





Building: Bacton Low Rise Block G Flat 200			Level: -1		Location: 002/Kitchen / Living room						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Cross Reference	126255-25								 NAD
floor	concrete										
panel to external wall	insulating board	Sample	126255-27								 NAD
boiler	modern										
within wooden boxing to boiler	no asbestos observed										
boxing within cupboard	Asbestos-containing insulating board	Sample	126255-28	2 Sqm.	2	1	2	Amosite, Chrysotile	7	2	 R2
Building: Bacton Low Rise Block G Flat 200			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	bitumen adhesive	Sample	126255-25								 NAD
floor	concrete										

table continued from previous page...

Building: Bacton Low Rise Block G Flat 200			Level: 0		Location: 001/Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panel to electrics	Asbestos-containing insulating board	Sample	126255-26	2 Lm.	2	1	1	Amosite, Chrysotile	6	2	 R3
electrics	modern										

Annotated Plans and Other Additional Documents

The following documents accompany this report and should be regarded as an integral part of this report.

They can be downloaded from <http://web.lucion.co.uk/reports/126255/attachments>.

- [Method Statement \[http://web.lucion.co.uk/method_statements/126255?s=11adfc8dbcac234524567a67096d28be \]](http://web.lucion.co.uk/method_statements/126255?s=11adfc8dbcac234524567a67096d28be)
- [Risk Assessment \[http://web.lucion.co.uk/risk_assessment/126255?s=55f3df04c8750243c4e0f499c20be341 \]](http://web.lucion.co.uk/risk_assessment/126255?s=55f3df04c8750243c4e0f499c20be341)



Additional Advice and Information

As the reader of this report you are recommended to make sure that it meets with your requirements. Publication HSG 264 Asbestos: The survey guide suggests the following:

- Check your report against our quotation or your tender
- Check for any caveats or disclaimers you are unsure of
- Check that the survey is as you requested
- Check you understand the included plans
- Check that we have accessed all the areas and rooms you wanted us to

Asbestos Fibre Identification Material Test Certificate

Job Ref No: **126255**, Account Ref No: **17637**, Contract Ref No: **15270**

This certificate is for the attention of	Colin Silvey Rydon Construction Ltd Pinewood, Chineham Business Park, Crockford Lane, Chineham, Basingstoke, RG24 8AL
Site Address	Block G, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Sampled Buildings	Bacton Low Rise, Block G - Communal Area, Bacton Low Rise Block G Flat 195, Bacton Low Rise Block G Flat 195F, Bacton Low Rise Block G Flat 196, Bacton Low Rise Block G Flat 198, Bacton Low Rise Block G Flat 199, Bacton Low Rise Block G Flat 200
Analyst(s)	Stuart Hogg, Sean Campbell
Analyst signature(s)	
Analysis date	Thursday, 25th August, 2016
Approved signatory	Simon Spreyer
Approved signature	
Approval date	Wednesday, 31st August, 2016
Report Rendered on	Wed 31 Aug 2016 @ 11:30:21

Analysis method - In-house method TOP01.03 in accordance with HSG 248 - Asbestos: The Analysts' Guide For Sampling, Analysis and Clearance Procedures H.S.E. 2005. All analysis carried out at Lucion's Head Office laboratory.

Lucion bear no responsibility for sample collection or sample description related information provided by the client.

Where Lucion Environmental Ltd has not undertaken sampling; any prior sampling activity is beyond the company's responsibility. Where Lucion Environmental Ltd has sampled the test material, this has been done in accordance with in-house method TOP01.02. Any opinions and interpretations expressed herein are outside the scope of UKAS accreditation.

The results quoted in this report relate to:

1. Samples analysed in accordance with methods described above
2. Samples analysed and not necessarily to the material from which the samples were taken
3. The time during which sampling took place and to the conditions prevailing during that time

The samples referred to in this report will be retained for 6 months unless requested otherwise.

Total Samples	No Asbestos Detected	Asbestos-Containing Samples
29	13	16

Fibre Identification Analysis Results

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126255-1	Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	floor covering	Asbestos-containing vinyl tile & adhesive	in tile & bitumen.	Chrysotile
126255-2	Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board		Amosite, Chrysotile
126255-3	Bacton Low Rise Block G Flat 195F	0	001/Entrance Lobby	panel to wall	insulating board		NAD
126255-4	Bacton Low Rise Block G Flat 195	1	002/Kitchen / Living room	panel to external wall	insulating board		NAD
126255-5	Bacton Low Rise Block G Flat 195	1	002/Kitchen / Living room	panel to shelf	insulating board		NAD
126255-6	Bacton Low Rise Block G Flat 195	3	002/Bathroom	ceiling	Asbestos-containing textured coating		Chrysotile
126255-7	Bacton Low Rise Block G Flat 195	3	002/Bathroom	toilet cistern	Asbestos-containing composite		Amosite
126255-8	Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	floor covering	Asbestos-containing vinyl tile & adhesive	in tile & bitumen	Chrysotile
126255-9	Bacton Low Rise Block G Flat 196	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board		Amosite, Chrysotile
126255-10	Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	panel to external wall	insulating board		NAD
126255-11	Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126255-12	Bacton Low Rise Block G Flat 196	-1	002/Kitchen / Living room	sink pad	bituminous product		NAD
126255-13	Bacton Low Rise Block G Flat 196	-3	002/Bedroom	panel to shelves	insulating board		NAD
126255-14	Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	adhesive to concrete floor	Asbestos-containing bitumen adhesive		Chrysotile
126255-15	Bacton Low Rise Block G Flat 198	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board		Amosite, Chrysotile
126255-16	Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	panel to external wall	insulating board		NAD
126255-17	Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126255-18	Bacton Low Rise Block G Flat 198	1	002/Kitchen / Living room	panel to shelf	insulating board		NAD
126255-19	Bacton Low Rise Block G Flat 199	0	001/Entrance Lobby	floor covering	vinyl tile & adhesive		NAD
126255-20	Bacton Low Rise Block G Flat 199	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board		Amosite, Chrysotile
126255-21	Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	floor covering	Asbestos-containing vinyl tile & adhesive	in bitumen	Chrysotile
126255-22	Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	panel to external wall	insulating board		NAD
126255-23	Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	boxing within cupboard	insulating board		NAD
126255-24	Bacton Low Rise Block G Flat 199	1	002/Kitchen / Living room	panel to shelf	Asbestos-containing insulating board		Amosite, Chrysotile
126255-25	Bacton Low Rise Block G Flat 200	0	001/Entrance Lobby	adhesive to concrete floor	bitumen adhesive		NAD
126255-26	Bacton Low Rise Block G Flat 200	0	001/Entrance Lobby	panel to electrics	Asbestos-containing insulating board		Amosite, Chrysotile

table continued from previous page...

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126255-27	Bacton Low Rise Block G Flat 200	-1	002/Kitchen / Living room	panel to external wall	insulating board		NAD
126255-28	Bacton Low Rise Block G Flat 200	-1	002/Kitchen / Living room	boxing within cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126255-29	Bacton Low Rise Block G Flat 200	-3	001/Stairs	floor covering	Asbestos-containing vinyl tile & adhesive	in tile & bitumen	Chrysotile

Asbestos Pre-Demolition Survey Report

Job Ref No: **126256**, Account Ref No: **17637**, Contract Ref No: **15270**

Block E, Bacton Low Rise, Haverstock Road, London, NW5 4PS




Title: Pre-demolition Survey - Block E, **Including:** All of property



on site photo

Total Records	Analysed Records	No Asbestos Detected	R3	R2	R1
464	135	48	76	7	4

Report Summary

This certificate is for the attention of	Colin Silvey Rydon Construction Ltd Pinewood, Chineham Business Park, Crockford Lane, Chineham, Basingstoke, RG24 8AL
Contract Title	Phase 2 Bacton Low Rise - Demolition Survey
Survey Type	Survey, Pre-demolition
Site Address	Block E, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Buildings Surveyed	Bacton Low Riser, Block E - Communal Area, Bacton Low Riser, Block E - Flat 176, Bacton Low Riser, Block E - Flat 177, Bacton Low Riser, Block E - Flat 178, Bacton Low Riser, Block E - Flat 179, Bacton Low Riser, Block E - Flat 180, Bacton Low Riser, Block E - Flat 181
Surveyor(s)	Simon Spreyer
Surveyor signature(s)	
Survey Date	Monday, 8th August, 2016
Analyst(s)	James Barnes, Agnes Suska
Analyst signature(s)	
Analysis date	Friday, 19th August, 2016
Approved signatory	Simon Spreyer
Approved signature	
Approval date	Tuesday, 23rd August, 2016
Report Rendered on	Tue 23 Aug 2016 @ 16:17:49

Report Contents

Asbestos Register and Executive Summary	4
Introduction	9
Buildings Included in Survey Scope	10
Site Data	11
Survey Methodology	12
HSG 264 Asbestos: The Survey Guide	12
Survey Methodology - Important Notes	13
Method of Sample analysis	14
HSG 248 Asbestos: The Analysts' Guide for Sampling, Analysis and Clearance Procedures	14
Sampling Strategy	15
Results and Findings	16
Initial Risk Level Assessment	16
Recommendations	19
Cited References and Further Reading	21
Management Recommendation Detail	22
Areas Excluded & Not Fully Accessed During Survey	50
Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report	51
Annotated Plans and Other Additional Documents	90
Additional Advice and Information	90
Material Test Certificate	91

Asbestos Register and Executive Summary

The current survey report is not intended to be used as a bill of quantities for asbestos removal activities. This survey can be used to compile a scope of work and technical specification. We can assist you in the preparation of these documents.

Summary of Asbestos Containing Materials

Ordered By Building, Level and Location

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Riser, Block E - Communal Area	0	003/ Garage 46	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	004/ Garage 45	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	005/ Garage 44	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	006/ Garage 43	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	007/ Garage 42	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	008/ Garage 41	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	009/ Garage 40	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	0	010/ Garage 39	flange gaskets to pipework	Asbestos-containing gasket	R3 (5)	Remove
Bacton Low Riser, Block E - Communal Area	1	001/ Walkway	panels around electric meter cupboards	Asbestos-containing insulating board	R3 (6)	Remove
Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	1	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board	R1 (7)	Remove
Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	2	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove

table continued from previous page...

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Riser, Block E - Flat 176	2	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	2	003/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	3	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	3	002/ Stairs & Landing	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	3	003/ Bathroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 176	4	001/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	001/ Stairs, Hall & Cupboards	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	003/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	004/ Toilet	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	005/ Bathroom	toilet cistern	Asbestos-containing composite	R3 (4)	Remove
Bacton Low Riser, Block E - Flat 177	-2	005/ Bathroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	006/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-2	006/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board	R1 (7)	Remove
Bacton Low Riser, Block E - Flat 177	-1	001/ Stairs	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-1	002/ Lounge & Cupboard	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-1	003/ Kitchen	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	-1	004/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove

table continued from previous page...

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 178	1	001/ Stairs	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	1	002/ Kitchen & Lounge	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	2	001/ Stairs	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	2	002/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	2	003/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	3	001/ Stairs & Landing	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	3	002/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	3	003/ Bathroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	3	004/ Toilet	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 178	4	001/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 179	1	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	subfloor	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	2	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	2	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	2	003/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	3	001/ Stairs & Landing	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	3	002/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	3	003/ Bathroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	3	004/ Toilet	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 179	4	001/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove

table continued from previous page...

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Riser, Block E - Flat 180	-2	001/ Stairs, Hall & Cupboards	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-2	002/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-2	003/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-2	004/ Toilet	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-2	005/ Bathroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-2	006/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board	R1 (7)	Remove
Bacton Low Riser, Block E - Flat 180	-2	006/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-1	001/ Stairs	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-1	002/ Lounge & Cupboard	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-1	003/ Kitchen	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	-1	004/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board	R2 (6)	Remove
Bacton Low Riser, Block E - Flat 181	1	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board	R1 (7)	Remove
Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	2	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	2	002/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	2	003/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	3	001/ Stairs & Landing	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	3	002/ Bedroom	floor covering within cupboard	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	3	002/ Bedroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	3	003/ Bathroom	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove

table continued from previous page...

Building	Level	Location	Item / Product Examined	Material Description	Risk Level (Material Score)	Initial Control Recommendation
Bacton Low Riser, Block E - Flat 181	3	004/ Toilet	adhesive to concrete floor	Asbestos-containing bituminous product	R3 (3)	Remove
Bacton Low Riser, Block E - Flat 181	4	001/ Bedroom	floor covering	Asbestos-containing floor tiles & bituminous product	R3 (3)	Remove

Summary of Areas Excluded & Not Fully Accessed During Survey

Building	Level	Location	Item / Product Examined	Accessibility	Access Comments
Nothing to report					

Introduction

This report aims to:

- Introduce pertinent legislation relating to the management of asbestos in non-domestic premises
- Outline the sample testing and inspection methodology employed by the surveyor
- Relate the significance of the report contents to the Control of Asbestos Regulations (2012)
- Detail survey findings compliant with HSG 264
- Serve as a reference document to assist in making further steps towards the management of any asbestos containing materials in the premises
- Provide the information necessary to compile an asbestos management plan compliant with the Control of Asbestos Regulations (2012)
- Form an asbestos register

Regulation 4 of the Control of Asbestos Regulations (2012) states the obligations that persons defined as "duty holders" have to manage asbestos containing materials in non-domestic premises. This instrument defines a duty holder as being:

"Every person who has, by virtue of a contract or tenancy, an obligation of any extent in relation to the maintenance or repair of non-domestic premises or any means of access thereto or egress there from; or

*In relation to any part of non-domestic premises where there is no such contract or tenancy, every person who, to any extent, has control of that part of non-domestic premises or any means of access thereto or egress there from" - **CAR, 2012.***

Regulation 4 also states the following:

"In order to enable him [sic "dutyholder"] to manage the risk from asbestos in non-domestic premises, the dutyholder shall ensure that a suitable and sufficient assessment is carried out as to whether asbestos is or is liable to be present in the premises"

This report satisfies this requirement, unless stated otherwise, by detailing the inspection findings reporting the presence of asbestos containing materials in those areas given in the survey inspection detail.

Health and Safety Guidance - Publication "Asbestos: The Survey Guide (HSG 264)" details the material assessment that must be carried out to determine the risk posed by asbestos containing materials in buildings. This material risk assessment has been carried out on those materials strongly presumed or proven to contain asbestos. The resulting material assessment risk ratings can (in conjunction with the management recommendation made for these materials) then be used to form the basis of an asbestos management plan.

Where possible the surveyor has attempted to interpret the needs of the client in their demolition works however the reader must satisfy themselves that the report includes those areas affected by demolition works.

Buildings Included in Survey Scope

Site Address: **Block E, Bacton Low Rise, Haverstock Road, London, NW5 4PS**

Surveyed Buildings: **Bacton Low Riser, Block E - Communal Area, Bacton Low Riser, Block E - Flat 176, Bacton Low Riser, Block E - Flat 177, Bacton Low Riser, Block E - Flat 178, Bacton Low Riser, Block E - Flat 179, Bacton Low Riser, Block E - Flat 180, Bacton Low Riser, Block E - Flat 181**

Every effort has been made to identify all asbestos materials so far as was reasonably practical to do so within the scope of the survey and the attached report. Methods used to carry out the survey were agreed with the client prior to any works being commenced by way of acceptance of our contract / quotation.

This survey was conducted in accordance with Health and Safety Guidance - Publication "Asbestos: The Survey Guide (HSG 264)". Lucion Environmental Ltd cannot accept any liability for loss, injury, damage or penalty issues that arise for reasons of survey scope limitations. Lucion Environmental Ltd cannot be held responsible for any damage caused as part of this survey carried out on your behalf. Due to the nature and necessity of sampling for asbestos some damage is unavoidable and will be limited to that necessary for taking of the samples.

The "areas excluded and not fully accessed during survey" section of this report gives details of those buildings, locations and items not accessed at the time of the survey (where appropriate, and if all areas were fully accessed, no items are listed). The "included buildings" list above gives details of those buildings included in the survey scope. The inspection log should be referenced for details of specific locations inspected within these buildings.

The scope of this survey relates only to building or area(s) inspected and does not include any form of investigation of the land on which the building is situated.

Where investigation of an intrusive nature (within the scope of the survey being performed) is needed to discern the presence of a material and the property is occupied during the inspection the level of intrusion may be restricted. As far as is reasonably practicable such restrictions will be indicated within the "areas excluded & not fully accessed during survey" section of this report. Scenarios leading to intrusion restriction may [by way of example] include (but are not limited to) security integrity of the building envelope, significant damage to decorative finishes, risk to the structural integrity of the building, occupation within adjacent areas. Investigations undertaken in such situations may, through circumstantial restrictions, be incomplete. Further investigation works may be required once unrestricted access can be offered.

Items or areas not covered by this survey that are scheduled to undergo demolition should be investigated prior to commencement of such activities.

Site Data

Site ID	91580
Address	Block E, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Property Type	Domestic
Property Build Date	mixed construction age
Property Number of buildings	1
Property Number of rooms	5-10
Property Size	Unknown
Property Construction type	Traditional
Roof Type	Mixed types
Roof Material	Slated or tiled
Property access notes	Access arranged with tenant
Property access restrictions	none
Property unusual features	none
Property in Conservation area?	NO
Listed Building?	NO
Property Plant or equipment installed?	YES

Survey Methodology

The asbestos survey findings detailed in this report were gathered using documented in house inspection (TOP01.01) and sampling procedures (TOP01.02) that implement the requirements of the Health and Safety Executive Publications HSG 264 (Asbestos: The survey guide) and HSG 248 (Asbestos: The analysts' guide for sampling, analysis and clearance procedures). All asbestos surveys aim to locate as far as is reasonable practical, the presence and extent of any ACMs in the building within the defined scope of the survey (refer HSG 264). This method complies with section 3 of Regulation 4 (CAR, 2012)

HSG 264 Asbestos: The Survey Guide

Publication HSG 264 sub-divides asbestos surveys into 2 principal types, termed: Management and Refurbishment & Demolition surveys respectively. These survey types may be summarised as follows (both have been shown to allow visualisation of the scope of the present management survey relative to the refurbishment & demolition survey specification and their suggested application/s).

Management Survey - Standard Sampling, Identification and Assessment

The underlying purpose and inspection methodology of the management survey is to locate the presence, extent and condition by way of sampling and inspection of suspect asbestos containing materials as they are encountered. Where possible, representative samples of materials suspected by the surveyor to contain asbestos are taken and analysed for the presence and type of asbestos fibre present. This survey is intended for integration into a plan for the management of asbestos containing materials under Regulation 4 of CAR (2012). The management surveys offers information allowing routine and simple maintenance works to be carried and this reflects the surveyor's level of intrusion at the time of the inspection. More extensive maintenance or repair work may require additional investigations to be undertaken; the findings of this survey should be checked with this in mind to confirm whether or not they of adequate scope.

Demolition Survey - Full Access, Sampling and Identification

The refurbishment and demolition survey is fully intrusive (as far as is reasonably practicable) and is aimed at locating all asbestos containing materials within a survey area. Normally, unless otherwise specified (*refer to the Method Statement as listed in **Annotated Plans and Other Additional Documents** section of this document*), it involves fully invasive and possibly destructive investigation of all survey areas, in order to locate and assess all materials suspected as containing asbestos. The survey records only the location and estimated extent of asbestos containing materials. A priority rating has been assigned to asbestos containing materials encountered during the course of the inspection to aid ongoing management of these materials prior to refurbishment (*HSG 264 states a duration in excess of 3 months as requiring ongoing management of ACMs*). Recommendations made for material management are based solely on isolated item inspection and material assessment and may be subject to change in the context of the overall refurbishment works. However the surveyor will default to "remove" as a recommendation within a refurbishment survey. This type of survey is normally recommended prior to refurbishment work commencing in the survey area. There is a specific requirement in CAR (2012) (Regulation 7) for all asbestos containing materials to be removed as far reasonably practicable before demolition.

Survey Methodology - Important Notes

Reasonable Skill and Care

Although all survey areas that have been examined are reported in accordance with HSG 264 and documented in house procedures (for the specified survey type) and all reasonable skill and care has been exercised by the surveyor in doing so, it must be realised that no survey can reasonably guarantee beyond doubt that all asbestos containing materials have been located. Reasons for this limitation may include health and safety issues, reasons of practicality, non-access to live equipment and dangerous or contaminated environments or risk of unsafe levels of damage being inflicted on the survey area amongst others, or the location of the material being outside the investigative scope of the survey type undertaken.

Non-asbestos Materials - A Reasoned Argument

All items examined by the surveyor at the time of the survey are listed in the inspection detail of this report. This detail includes those items believed by the surveyor not to contain asbestos and an appropriate categorisation of their material composition is given. Employing this rationale the surveyor can use experience and judgement to form a reasoned argument that there is evidence to suggest that the material may not contain asbestos. Periodically "non-asbestos" building materials may be sampled by way of a method control to further support the surveyor's argument. These materials do not bear any risk assessment detail.

Materials Presumed to Contain Asbestos

If the surveyor feels that a reasoned argument against a material containing asbestos cannot be formed, the item in question may be presumed to contain asbestos. This may include, but is not restricted to, areas where access cannot be gained. This scenario attracts the designation "P" in the sampling strategy column of the "Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report" table within this report.

Materials Strongly Presumed to Contain Asbestos

In the case of a material or materials being encountered that the surveyor suspects, following visual assessment, as containing asbestos but cannot be sampled for reasons of practicality, that material is strongly presumed to contain asbestos. An assessment (where possible) of the material's extent and condition is made. Nota bene: as no definitive assessment of asbestos fibre type contained in the material may be made, this portion of the priority score is based on a strongly presumed worst-case scenario of fibre type commonly contained in the material concerned. This scenario attracts the designation "SP" in the sampling strategy column of the "Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report" table within this report.

Sampling of Materials

If access to the material permits, a representative sample of the material is taken according to the "sampling strategy". An assessment (where necessary or possible) of the material's extent and condition is made. As no practical sampling strategy can be assured as being entirely representative of the circumstances encountered during surveying, care should be exercised when interpreting results. That is to say that if works are planned that may cause disturbance or require the removal of asbestos containing materials, implementation of a more intense sampling regime may be desirable.

Material Cross Referencing

In the event of a suspect material being encountered with a frequency that does not permit repeated re-sampling on the grounds of practicality, the surveyor may cross reference this item with one that has already been sampled. To do this the surveyor will ensure that the material is identical in nature (through examining visual appearance e.g. colour) to that of the material to which it is referenced. Nota bene: as no definitive assessment of asbestos fibre type contained in the material may be made, this portion of the priority score is strongly presumed as being the same as that of the material from which it is cross referenced.

Method of Sample analysis

The bulk asbestos fibre identification results detailed in this report and the appended certificate of bulk analysis were obtained using a documented in house testing procedure (TOP01.03) that implements the requirements of Health and Safety Executive Publication HSG 248, Appendix 2 (Asbestos: The analysts' guide for sampling, analysis and clearance procedures). All samples collected during the course of this survey are tested in accordance with this method.

HSG 248 Asbestos: The Analysts' Guide for Sampling, Analysis and Clearance Procedures

Publication HSG 248 describes a two stage approach to the detection and subsequent identification of asbestos fibre in bulk (i.e. suspect sample) materials. Initially the microscopist will examine the material under a low power stereo light microscope. The microscopist then performs extensive optical tests using polarised light microscopy in order to confirm or refute that the material contains an asbestos mineral. This technique allows for the detection of the six common forms of asbestos fibre as follows:

Asbestos Fibre Type	Common Nomenclature
Chrysotile	White Asbestos
Amosite	Brown Asbestos
Crocidolite	Blue Asbestos
Fibrous Actinolite	N/A
Fibrous Anthophyllite	N/A
Fibrous Tremolite	N/A

The results of this test are given, where appropriate, in the inspection detail report for each sample taken and are summarised in the management recommendation report. They are also separately detailed in the bulk-analysis report appended to this report. The homogeneity of asbestos containing materials can differ depending on their type. Typically, homogeneous materials include sprayed coatings, insulating board and asbestos cement products. Other materials are typically less homogeneous including pipe lagging (due to patch repairs, hand mixing at time of application), textured coatings (due to low concentration of asbestos fibre and hand application), composites (due to low concentration of asbestos fibre and material matrix) and debris samples (due to the potentially inconsistent occurrences that have led to their presence). Whilst sampling frequencies / techniques and analysis methods attempt to address the issue of non-homogeneity it should be realised that sampling in accordance with HSG 264 and analysis in accordance with HSG 248 cannot always obviate the problems of determining asbestos fibre content in non-homogeneous materials. The results of sample analysis presented in this report therefore pertain to the samples analysed and so relate only to the time at which sampling took place and to the conditions prevailing during that time.

Sampling Strategy

Product Type	Sampling Strategy
Vinyl, composite floor coverings, surface coverings	One sample per room, or one sample per 40m ² per product type or colour. Where large expanses of the same material have been used throughout an area, the frequency of sampling may be decreased at the discretion of the surveyor. Associated adhesives, depending on site and material conditions, will either be collected as separate samples or included with the floor covering as a single entity.
Textured Coatings	One composite sample per room or one sample per 9m ² dependent on similarity of coating type. Where large expanses of the same material have been used throughout an area. The frequency of sampling may be increased or decreased at the discretion of the surveyor.
Gaskets, ropes, woven product, seals, mastics, papers, felts	One sample per product type, or if appropriate, per area or location.
Asbestos containing insulating board	One sample per location or per 25m ² of continuous product run. The frequency of sampling may be increased or decreased at the discretion of the surveyor dependent on such factors as consistency of product type or occurrence of different board types. The specific nature of this material has been determined on site using the competence and experience of the surveyor. Lucion Environmental accepts no liability for any decision based on this determination and as such it should only be regarded as an opinion. Where doubt exists as to the classification of a board material HSE Approved Code of Practice L143 "Managing and working with asbestos" recommends carrying out a water absorption test. Lucion Environmental will perform this test only upon specific request.
Cement Products	One sample per product type, or if appropriate, per area or location. The specific nature of this material has been determined on site using the competence and experience of the surveyor. Lucion Environmental accepts no liability for any decision based on this determination and as such it should only be regarded as an opinion. Where doubt exists as to the classification of a board material HSE Approved Code of Practice L143 "Managing and working with asbestos" recommends carrying out a water absorption test. Lucion Environmental will perform this test only upon specific request.
Debris	One sample per location, or more at the discretion of the surveyor. Where debris exists in a location quantification can be hindered by a number of factors including paint coverings, air movement, the passage of time etc. The surveyor reports only the material discernable within the confines of the survey sufficient to show that debris exists in a location. Further focused investigation may be needed to determine the extent of debris for the purposes of decontamination.
Insulative Materials	One sample per material product type (to include change in outward appearance) and at least one sample per 10 metre pipe run. In addition, one sample per different product applied to pipe bends.
Sprayed Insulation	One sample per 20m ² of material

Results and Findings

The item examination and inspection findings, bulk analysis results, material assessment and initial risk level assessment are reported in the form of an asbestos inspection and testing detail register. The purpose and structure of this register are explained in the proceeding sections.

Initial Risk Level Assessment

The initial risk level assessments made within this report for those items strongly presumed, or positively proven by sampling and subsequent analysis, to contain asbestos have been made on the basis of the Material Assessment Algorithm detailed within the publications HSG 264 and HSG 227.

This assessment aims to elucidate the potential for a particular material to release hazardous fibres and expose those within the specific area to asbestos dust. The following table gives the scoring strategy for the initial risk level assessment and indicates the scoring degree of those points that are considered, namely product type, condition, surface treatment and asbestos fibre type present.

	Score	Score Category
Product Type An assessment of the inherent risk a product may pose (Product debris is assessed on the product type from which it originates)	1	Asbestos reinforced composites - Plastics / resins / mastics / felts / vinyl tiling / semi rigid paints / decorative finishes / asbestos cement and other such similar bound materials.
	2	Materials of a medium asbestos content including - Asbestos insulating board / millboard / low density insulation board / textiles / gaskets / ropes / papers / debris from asbestos containing composite material and cement.
	3	Materials of a high asbestos content including - Thermal insulation / sprayed asbestos / loose asbestos / packing / filled padding / all other debris.
Material Condition An assessment of the damage or deterioration in condition of product	0	Undamaged - No visible signs of damage
	1	Minor damage - Light material surface abrasion / abrasion to edges
	2	Medium damage - Evidence of loose asbestos fibre protruding from material / poor condition of material is notable
	3	Major damage - Significant damage to materials often resulting in the short-term production of asbestos containing debris / delamination of sprays and thermal insulation / asbestos debris

table continued from previous page...

	Score	Score Category
<p>Surface Treatment</p> <p>An assessment of the level of fibre retention the surface of a material may be capable of</p>	0	Composite materials - Plastics / resins / mastics / felts / vinyl tiling / semi rigid paints / decorative finishes
	1	Sealed and enclosed materials - Painted asbestos insulating board (with exposed face painted or encapsulated) / enclosed asbestos lagging and sprayed asbestos (as originally installed) / unsealed asbestos cement products
	2	Unsealed and encapsulated materials - Unsealed asbestos insulating board / asbestos lagging, sprayed asbestos and woven material encapsulated (remedially)
	3	Unsealed friable materials - Unsealed asbestos lagging and sprayed asbestos
<p>Asbestos Fibre Type</p> <p>An assessment of asbestos fibre types propensity to cause asbestos related diseases</p>	1	Serpentine Asbestos - Chrysotile
	2	Amphibole Asbestos - Amosite / Anthophyllite / Tremolite / Actinolite
	3	Amphibole Asbestos - Crocidolite

Material / Accessibility Score

Following the rating of a material using the above criteria, the resulting aggregated additive material score may be assessed in terms of accessibility to derive an assessment of initial risk level as follows:

	Very Low Risk (2-4)	Low Risk (5-6)	Medium Risk (7-9)	High Risk (10-12)
Normally Inaccessible (1)	R3	R3	R3	R2
Periodically Accessed (2)	R3	R3	R2	R1
Frequently Accessed (3)	R3	R2	R1	R1

The level of access to the ACM determines how easily the product can be reached by the building occupants which could result in a disturbance that causes fibre release, it relates purely to access and does not consider product type.

The above is defined by the following:

1. Normally inaccessible or occasionally accessed:

The ACM will not be accessed or is unlikely to be disturbed.

2. Periodically accessed:

The ACM is likely to be disturbed occasionally.

3. Frequently accessed:

The ACM is routinely and easily disturbed.

General Interpretation of Risk Assessment Level

Risk Assessment Level	Interpretation of the Recommended Control Action
R1	immediate implementation
R2	as soon as practicable - <i>in interim period material should be regularly inspected and its management planned for</i>
R3	not immediately necessary - <i>material should be regularly inspected and its management planned for</i>

Recommendations

In addition to the risk assessment level assigned to strongly presumed and identified asbestos containing material, a management control action recommendation is also made. In the case of survey carried out prior to refurbishment or demolition works, the "normal" recommendation will be "remove" as the surveyor assumes that asbestos removal will take place prior to other works commencing (unless the surveyor has been advised otherwise in advance of the survey). However in certain circumstances another recommendation may be made and those commonly used are given in the recommendations table.

The current recommendations conventionally made by the surveyor may include the following:

Recommendation	Description	Notes
Air Monitoring	Sampling of air for asbestos fibre concentration. Necessary where a risk of fibre exposure is present and assessment of such exposure presence or absence is prudent.	UKAS accredited analytical laboratory should perform reassurance air testing.
Access Restriction	Restriction of access to area / location only to personnel wearing appropriate PPE / RPE.	Suitability of RPE / PPE must be carefully assessed and procedure invoked to ensure these control measures are adhered to.
Access Prohibition	Prohibition of access to area / location to all personnel.	Area should be marked clearly as being prohibited to all personnel, possibly in conjunction with asbestos warning stickers.
Environmental Clean	A cleanup of areas following disturbance of asbestos or discovery of loose asbestos dust/debris/material.	The work is not removal (ie requiring physical force) and consists of vacuuming, wiping, picking up and bagging of debris. The work can be either licensed or unlicensed depending on the product and whether exposure is likely to exceed the 4 hour control limit or sporadic and low intensity limit. For licensed work a 4-stage clearance by a UKAS accredited laboratory is required, whilst for non-licensed work appropriate air tests are recommended.
Material Repair	Repair of the material in such a manner as to minimise the release of asbestos fibre.	Repair of materials is recommended by the Health and Safety Executive as an alternative to removal, where reasonably safe to so.
Material Encapsulation	Encapsulation of the material in a manner that ensures the complete enclosure of any remaining asbestos fibres.	Encapsulation of materials is a possible alternative to their removal, where reasonably safe to do so. Works should also be accompanied by appropriate air test performed by a UKAS accredited laboratory.
Material Removal	Removal of the material in instances where it is remaining in situ would lead to a high residual risk level. Or removal may be necessary to permit work within the location. Removal of materials may also be carried out on a preventive basis.	Removal works should be carried out in accordance with the relevant ACOP (approved code of practice), L143
<p><i>Any recommendations made within this report are made on the basis of findings collated at the time of survey. Recommendations should undergo careful client evaluation prior to a final management decision being made. Lucion Environmental Ltd does not accept any responsibility for any works carried out as a result of recommendations made within this report.</i></p>		

Cited References and Further Reading

1. Control of Asbestos Regulations (2012) ~ The Stationery Office. **ISBN 978-0111521083**
2. Construction (Design and Management) Regulations (2015) ~ The Stationery Office. **ISBN 9780717666263**
3. The Hazardous Waste (England and Wales) Regulations (2005) ~ The Stationery Office. **ISBN 011072685-5**
4. Managing and working with asbestos Control of Asbestos Regulations 2012. Approved Code of Practice & guidance L143 (second edition, 2013) ~ HSE Books. **ISBN 978-0717666188**
5. A Comprehensive Guide to Managing Asbestos in Premises (2002) ~ HSE Books. **ISBN 978-0717623815**
6. Asbestos Essentials: A task manual for building, maintenance and allied trades of non-licensed asbestos work (third edition, 2012) ~ HSE Books. **ISBN 978-0717665037**
7. [Asbestos Essentials Task Sheets \[http://www.hse.gov.uk/asbestos/essentials/ \]](http://www.hse.gov.uk/asbestos/essentials/) ~ HSE. *electronic downloadable version of the above*
8. Asbestos: The licensed contractors' guide HSG247 (2006) ~ HSE Books. **ISBN 978-0717628742**
9. Asbestos: The analysts' guide for sampling, analysis and clearance procedures HSG248 (2005) ~ HSE Books. **ISBN 978-0717628759**
10. Asbestos: The Survey Guide HSG 264 (second edition, 2012) ~ HSE Books. **ISBN 978-0717665020**
11. The Management of Health and Safety at Work Regulations (1999) ~ The Stationery Office. **ISBN 011085625-2**
12. The Health & Safety at Work etc. Act (1974) ~ The Stationery Office.

Management Recommendation Detail




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Communal Area	0	003/ Garage 46	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	0	004/ Garage 45	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	0	005/ Garage 44	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Communal Area	0	006/ Garage 43	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	0	007/ Garage 42	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	0	008/ Garage 41	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Communal Area	0	009/ Garage 40	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	0	010/ Garage 39	flange gaskets to pipework	126256-34	Asbestos-containing gasket	Chrysotile	5	4 No.	R3	Remove	
Bacton Low Riser, Block E - Communal Area	1	001/ Walkway	panels around electric meter cupboards	126256-27	Asbestos-containing insulating board	Amosite, Chrysotile	6	2x 4 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	boxing to electric cupboard	126256-27	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	
Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	adhesive to concrete floor	126256-26	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	1	001/ Stairs	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...



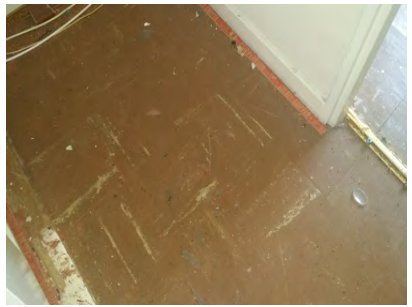
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	boxing within wooden cupboard	126256-30	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R1	Remove	
Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	2	001/ Stairs	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 176	2	002/ Bedroom	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	2	003/ Bedroom	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	3	002/ Bedroom	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 176	3	002/ Stairs & Landing	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	3	003/ Bathroom	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	6 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 176	4	001/ Bedroom	floor covering	126256-28	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...


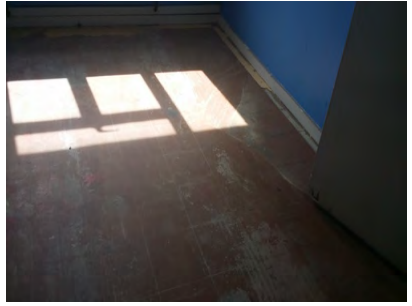
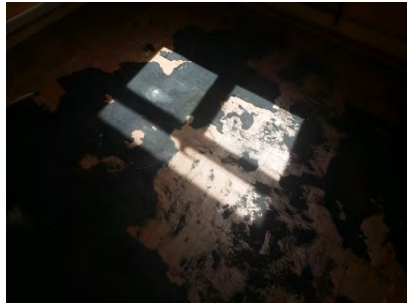
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 177	-2	001/ Stairs, Hall & Cupboards	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	10 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-2	002/ Bedroom	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-2	003/ Bedroom	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	8 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 177	-2	004/ Toilet	adhesive to concrete floor	126256-21	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-2	005/ Bathroom	toilet cistern	126256-25	Asbestos-containing composite	Amosite	4	1 No.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-2	005/ Bathroom	adhesive to concrete floor	126256-21	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 177	-2	006/ Bedroom	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-2	006/ Bedroom	boxing within wooden cupboard	126256-32	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R1	Remove	
Bacton Low Riser, Block E - Flat 177	-1	001/ Stairs	adhesive to concrete floor	126256-21	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 177	-1	002/ Lounge & Cupboard	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-1	003/ Kitchen	adhesive to concrete floor	126256-21	Asbestos-containing bituminous product	Chrysotile	3	6 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	-1	004/ Bedroom	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	

table continued from previous page...

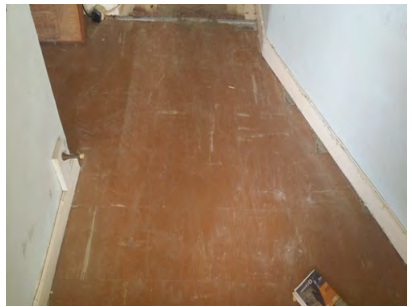
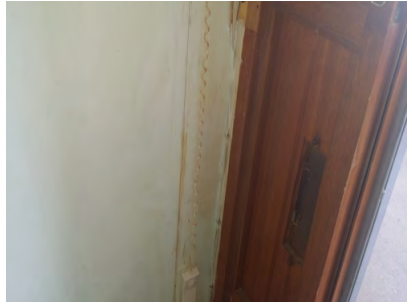

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	floor covering	126256-21	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	boxing to electric cupboard	126256-22	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	
Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...

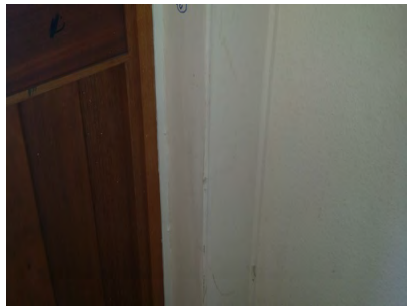

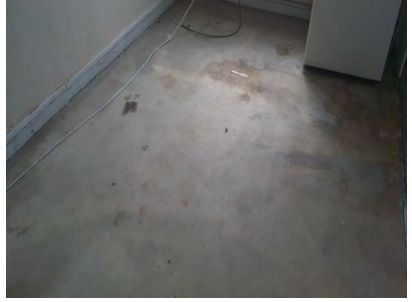
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	boxing to electric cupboard	126256-19	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	
Bacton Low Riser, Block E - Flat 178	1	001/ Stairs	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	1	002/ Kitchen & Lounge	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 178	2	001/ Stairs	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	2	002/ Bedroom	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	2	003/ Bedroom	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 178	3	001/ Stairs & Landing	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	3	002/ Bedroom	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	3	003/ Bathroom	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 178	3	004/ Toilet	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 178	4	001/ Bedroom	adhesive to concrete floor	126256-18	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...

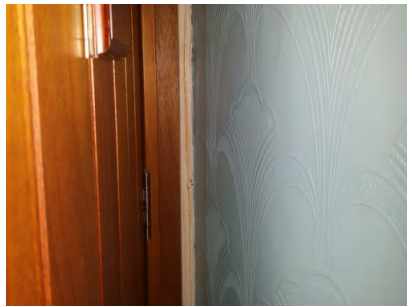


Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	boxing to electric cupboard	126256-14	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	
Bacton Low Riser, Block E - Flat 179	1	001/ Stairs	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	boxing within wooden cupboard	126256-16	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	subfloor	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	2	001/ Stairs	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	2	002/ Bedroom	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...



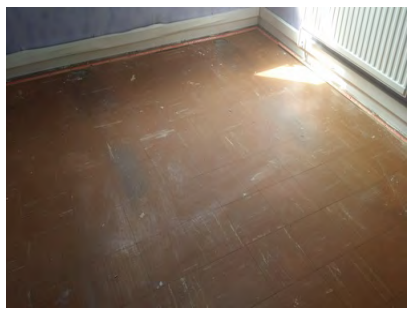
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 179	2	003/ Bedroom	adhesive to concrete floor	126256-13	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	3	001/ Stairs & Landing	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	3	002/ Bedroom	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 179	3	003/ Bathroom	adhesive to concrete floor	126256-13	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	3	004/ Toilet	adhesive to concrete floor	126256-13	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 179	4	001/ Bedroom	floor covering	126256-13	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 180	-2	001/ Stairs, Hall & Cupboards	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	10 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-2	002/ Bedroom	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-2	003/ Bedroom	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	

table continued from previous page...

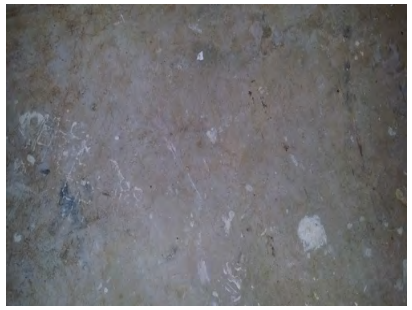


Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 180	-2	004/ Toilet	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-2	005/ Bathroom	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-2	006/ Bedroom	boxing within wooden cupboard	126256-12	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R1	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 180	-2	006/ Bedroom	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-1	001/ Stairs	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-1	002/ Lounge & Cupboard	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	

table continued from previous page...



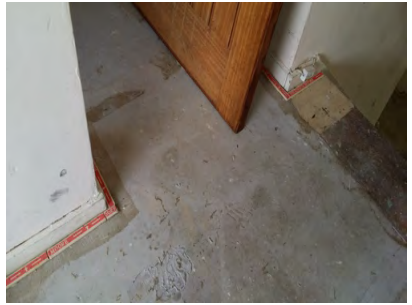
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 180	-1	003/ Kitchen	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	6 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	-1	004/ Bedroom	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	adhesive to concrete floor	126256-8	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	

table continued from previous page...



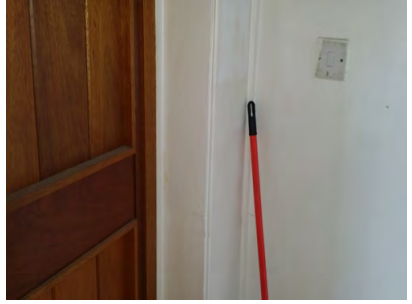
Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	boxing to electric cupboard	126256-9	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	
Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	boxing to electric cupboard	126256-2	Asbestos-containing insulating board	Amosite, Chrysotile	6	2 Sqm.	R2	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 181	1	001/ Stairs	floor covering	126256-3	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	boxing within wooden cupboard	126256-6	Asbestos-containing insulating board	Amosite, Chrysotile	7	2 Sqm.	R1	Remove	
Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	14 Sqm.	R3	Remove	

table continued from previous page...




Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 181	2	001/ Stairs	floor covering	126256-3	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	2	002/ Bedroom	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	2	003/ Bedroom	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...

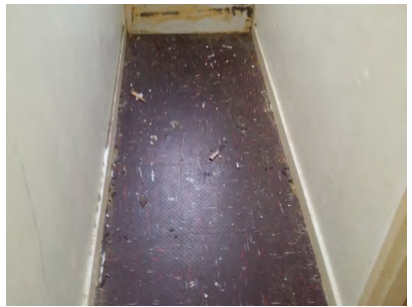


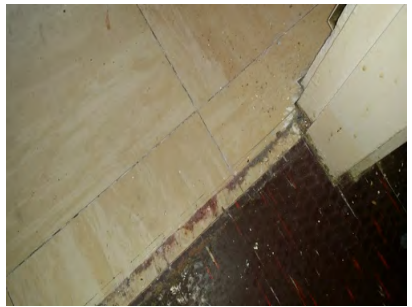
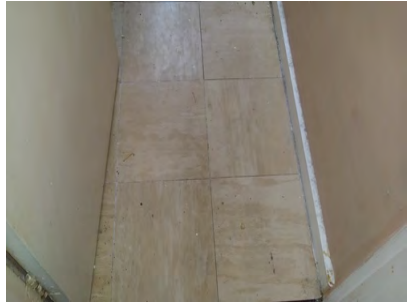


Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 181	3	001/ Stairs & Landing	floor covering	126256-3	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	5 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	3	002/ Bedroom	floor covering within cupboard	126256-3	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	1 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	3	002/ Bedroom	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	

table continued from previous page...

Building	Level	Location	Item / Product Examined	Sample No.	Material Description	Fibre Type	Material Score	Extent	Risk Level Assessment	Initial Control Recommendation	Photograph
Bacton Low Riser, Block E - Flat 181	3	003/ Bathroom	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	4 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	3	004/ Toilet	adhesive to concrete floor	126256-1	Asbestos-containing bituminous product	Chrysotile	3	2 Sqm.	R3	Remove	
Bacton Low Riser, Block E - Flat 181	4	001/ Bedroom	floor covering	126256-3	Asbestos-containing floor tiles & bituminous product	Chrysotile	3	12 Sqm.	R3	Remove	


Areas Excluded & Not Fully Accessed During Survey


⊖ Asbestos should be presumed to be present within Locations and Items not accessed until a further assessment can be performed.



 Additional surveyor comments.

Building	Level	Location	Item / Product Examined	Accessibility	Surveyor Additional Comments At Time Of Survey	Photograph
Nothing to report						

Survey Inspection Detail, Sample Test Report and Risk Level Assessment Report

 Asbestos should be presumed to be present within Locations and Items not accessed until a further assessment can be performed.

 Additional surveyor comments.

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
insulation within expansion joint	insulating board	Sample	126256-33	 Unable to quantify extent as material is within the structure of the building. Strongly presumed present within all expansion joints.							 NAD

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 002/ Bin Store						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 003/ Garage 46						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										

table continued from previous page...






Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 003/ Garage 46						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Sample	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3
Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 004/ Garage 45						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3
Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 005/ Garage 44						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										

table continued from previous page...

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 005/ Garage 44						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 006/ Garage 43						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 007/ Garage 42						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3





Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 008/ Garage 41						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	
Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 009/ Garage 40						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	
Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 010/ Garage 39						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
pipework	metal										
pipe lagging	man made mineral fibre										

table continued from previous page...

Building: Bacton Low Riser, Block E - Communal Area			Level: 0		Location: 010/ Garage 39						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
flange gaskets to pipework	Asbestos-containing gasket	Cross Reference	126256-34	4 No.	2	1	1	Chrysotile	5	2	 R3
Building: Bacton Low Riser, Block E - Communal Area			Level: 1		Location: 001/ Walkway						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	brick										
floor	concrete										
panels around electric meter cupboards	Asbestos-containing insulating board	Cross Reference	126256-27	2x 4 Sqm.	2	1	1	Amosite, Chrysotile	6	2	 R3
outside storage cupboards	brick & concrete construction										
pipework within outside storage cupboards	metal										
lagging to pipework within outside storage cupboard	man made mineral fibre										
cladding to outside storage cupboards	wood										
Building: Bacton Low Riser, Block E - Communal Area			Level: 1		Location: 002/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	wood										
suspended ceiling	wood										
walls	brick										
floor	concrete										





Building: Bacton Low Riser, Block E - Flat 176			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Sample	126256-26	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-27	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
Building: Bacton Low Riser, Block E - Flat 176			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126256-28	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 176			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 176			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	14 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										
panels to external wall	insulating board	Sample	126256-29								
boiler	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126256-30	2 Sqm.	2	1	2	Amosite, Chrysotile	7	3	
panels to shelves within wooden cupboard	insulating board	Sample	126256-31								
Building: Bacton Low Riser, Block E - Flat 176			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	2 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										



Building: Bacton Low Riser, Block E - Flat 176			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-29								 NAD
Building: Bacton Low Riser, Block E - Flat 176			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-29								 NAD
Building: Bacton Low Riser, Block E - Flat 176			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 176			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-29								 NAD
riser panels	wood										
Building: Bacton Low Riser, Block E - Flat 176			Level: 3		Location: 002/ Stairs & Landing						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 176			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	6 Sqm.	1	1	0	Chrysotile	3	3	 R3

table continued from previous page...







Building: Bacton Low Riser, Block E - Flat 176			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-29								
boxing	wood										
pipework within boxing	metal										
bath panel	wood										
toilet cistern	ceramic										
Building: Bacton Low Riser, Block E - Flat 176			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-28	12 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 001/ Stairs, Hall & Cupboards						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	10 Sqm.	1	1	0	Chrysotile	3	2	



table continued from previous page...



Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 001/ Stairs, Hall & Cupboards						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels above cupboard doors	wood										
boxing within cupboard	wood										

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-23								 NAD
panels to shelves within wooden cupboard	insulating board	Sample	126256-24								 NAD

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										




table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	8 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-23								 NAD

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-21	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-23								 NAD
boxing	wood										
toilet cistern	rubber										

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 005/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 005/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-21	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-23								 NAD
boxing	wood										
toilet cistern	Asbestos-containing composite	Sample	126256-25	1 No.	1	1	0	Amosite	4	3	 R3



Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 006/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-23								 NAD

table continued from previous page...





Building: Bacton Low Riser, Block E - Flat 177			Level: -2		Location: 006/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels to shelves within wooden cupboard	insulating board	Cross Reference	126256-24								 NAD
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126256-32	2 Sqm.	2	1	2	Amosite, Chrysotile	7	3	 R1
Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-21	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 002/ Lounge & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing within cupboard	wood										

table continued from previous page...




Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 002/ Lounge & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
pipework	metal										
pipe lagging	man made mineral fibre										
panels to external wall	insulating board	Sample	126256-23								 NAD
Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 003/ Kitchen						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-21	6 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor covering	modern linoleum										
panels to external wall	insulating board	Cross Reference	126256-23								 NAD
sink pad	modern										
boiler	modern										
boxing	wood										
pipework within boxing	metal										
Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 004/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										

table continued from previous page...








Building: Bacton Low Riser, Block E - Flat 177			Level: -1		Location: 004/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-21	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing within cupboard	wood										
panels to external wall	insulating board	Cross Reference	126256-23								 NAD
Building: Bacton Low Riser, Block E - Flat 177			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126256-21	4 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-22	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
Building: Bacton Low Riser, Block E - Flat 178			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										



table continued from previous page...


Building: Bacton Low Riser, Block E - Flat 178			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor covering	carpet										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Sample	126256-18	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-19	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2

Building: Bacton Low Riser, Block E - Flat 178			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	2 Sqm.	1	1	0	Chrysotile	3	2	 R3

Building: Bacton Low Riser, Block E - Flat 178			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										



table continued from previous page...



Building: Bacton Low Riser, Block E - Flat 178			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Sample	126256-20								 NAD
boiler	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
sink pad	modern										

Building: Bacton Low Riser, Block E - Flat 178			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	2 Sqm.	1	1	0	Chrysotile	3	2	 R3

Building: Bacton Low Riser, Block E - Flat 178			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										


table continued from previous page...



Building: Bacton Low Riser, Block E - Flat 178			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-20								 NAD

Building: Bacton Low Riser, Block E - Flat 178			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-20								 NAD

Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 001/ Stairs & Landing						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 001/ Stairs & Landing						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panel to understairs	plasterboard										

Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-20								 NAD
riser panels	wood										

Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...





Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-20								 NAD
bath panel	wood										
Building: Bacton Low Riser, Block E - Flat 178			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-20								 NAD
boxing	wood										
toilet cistern	ceramic										
Building: Bacton Low Riser, Block E - Flat 178			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										

table continued from previous page...






Building: Bacton Low Riser, Block E - Flat 178			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-18	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
Building: Bacton Low Riser, Block E - Flat 179			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126256-13	4 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-14	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
Building: Bacton Low Riser, Block E - Flat 179			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	2 Sqm.	1	1	0	Chrysotile	3	3	 R3

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 179			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 179			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
subfloor	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	14 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
floor covering	linoleum										
panels to external wall	insulating board	Sample	126256-15								 NAD
sink pad	modern										
boiler	modern										
boxing left side of sink	wood										
pipework within boxing	metal										
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126256-16	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
panels to shelves within wooden cupboard	insulating board	Sample	126256-17								 NAD







Building: Bacton Low Riser, Block E - Flat 179			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 179			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-15								 NAD
Building: Bacton Low Riser, Block E - Flat 179			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-13	12 Sqm.	1	1	0	Chrysotile	3	3	 R3

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 179			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
panels to external wall	insulating board	Cross Reference	126256-15								

Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 001/ Stairs & Landing						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	2 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										
panel to understairs	plasterboard										





Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	12 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels to external wall	insulating board	Cross Reference	126256-15								 NAD
riser panels	wood										

Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-13	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-15								 NAD
bath panel	wood										

Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...


Building: Bacton Low Riser, Block E - Flat 179			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-13	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-15								 NAD
boxing	wood										
pipework within boxing	metal										
toilet cistern	ceramic										
Building: Bacton Low Riser, Block E - Flat 179			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-13	12 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 001/ Stairs, Hall & Cupboards						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										

table continued from previous page...




Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 001/ Stairs, Hall & Cupboards						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	10 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels above cupboard doors	wood										
boxing within cupboard	wood										
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
panels to shelves within wooden cupboard	insulating board	Sample	126256-11								 NAD
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										

table continued from previous page...





Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
boxing	wood										
toilet cistern	ceramic										
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 005/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										

table continued from previous page...






Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 005/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
bath panel	wood										
toilet cistern	plastic										
Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 006/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
panels to shelves within wooden cupboard	insulating board	Cross Reference	126256-11								 NAD

table continued from previous page...


Building: Bacton Low Riser, Block E - Flat 180			Level: -2		Location: 006/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126256-12	2 Sqm.	2	1	2	Amosite, Chrysotile	7	3	
Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	4 Sqm.	1	1	0	Chrysotile	3	2	
Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 002/ Lounge & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	14 Sqm.	1	1	0	Chrysotile	3	2	
boxing within cupboard	wood										
pipework	metal										
pipe lagging	man made mineral fibre										

table continued from previous page...




Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 002/ Lounge & Cupboard						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
panels to external wall	insulating board	Sample	126256-10								 NAD
Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 003/ Kitchen						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	6 Sqm.	1	1	0	Chrysotile	3	2	 R3
floor covering	modern linoleum										
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
sink pad	modern										
boiler	modern										
boxing	wood										
pipework within boxing	metal										
Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 004/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										

table continued from previous page...





Building: Bacton Low Riser, Block E - Flat 180			Level: -1		Location: 004/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-8	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing within cupboard	wood										
panels to external wall	insulating board	Cross Reference	126256-10								 NAD
Building: Bacton Low Riser, Block E - Flat 180			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Sample	126256-8	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-9	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
Building: Bacton Low Riser, Block E - Flat 181			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										

table continued from previous page...




Building: Bacton Low Riser, Block E - Flat 181			Level: 0		Location: 001/ Entrance Lobby						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Sample	126256-1	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
boxing to electric cupboard	Asbestos-containing insulating board	Sample	126256-2	2 Sqm.	2	1	1	Amosite, Chrysotile	6	3	 R2
Building: Bacton Low Riser, Block E - Flat 181			Level: 1		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Sample	126256-3	2 Sqm.	1	1	0	Chrysotile	3	3	 R3
floor	concrete										
Building: Bacton Low Riser, Block E - Flat 181			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...









Building: Bacton Low Riser, Block E - Flat 181			Level: 1		Location: 002/ Kitchen & Lounge						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	14 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Sample	126256-4								 NAD
sink pad	bituminous product	Sample	126256-5								 NAD
boiler	modern										
boxing right side of sink	wood										
pipework within boxing	metal										
boxing within wooden cupboard	Asbestos-containing insulating board	Sample	126256-6	2 Sqm.	2	1	2	Amosite, Chrysotile	7	3	 R1
panels to shelves within wooden cupboard	insulating board	Sample	126256-7								 NAD
Building: Bacton Low Riser, Block E - Flat 181			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										



table continued from previous page...


Building: Bacton Low Riser, Block E - Flat 181			Level: 2		Location: 001/ Stairs						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-3	2 Sqm.	1	1	0	Chrysotile	3	3	
floor	concrete										

Building: Bacton Low Riser, Block E - Flat 181			Level: 2		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	12 Sqm.	1	1	0	Chrysotile	3	2	
panels to external wall	insulating board	Cross Reference	126256-4								

Building: Bacton Low Riser, Block E - Flat 181			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										




table continued from previous page...



Building: Bacton Low Riser, Block E - Flat 181			Level: 2		Location: 003/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-4								 NAD




Building: Bacton Low Riser, Block E - Flat 181			Level: 3		Location: 001/ Stairs & Landing						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-3	5 Sqm.	1	1	0	Chrysotile	3	3	 R3
panel to understairs	plasterboard										

Building: Bacton Low Riser, Block E - Flat 181			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										

table continued from previous page...

Building: Bacton Low Riser, Block E - Flat 181			Level: 3		Location: 002/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	12 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-4								 NAD
riser panels	wood										
floor covering within cupboard	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-3	1 Sqm.	1	1	0	Chrysotile	3	3	 R3

Building: Bacton Low Riser, Block E - Flat 181			Level: 3		Location: 003/ Bathroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	4 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-4								 NAD
bath panel	wood										

Building: Bacton Low Riser, Block E - Flat 181			Level: 3		Location: 004/ Toilet						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor covering	modern vinyl tiles										
floor	concrete										
adhesive to concrete floor	Asbestos-containing bituminous product	Cross Reference	126256-1	2 Sqm.	1	1	0	Chrysotile	3	2	 R3
panels to external wall	insulating board	Cross Reference	126256-4								 NAD
boxing	wood										
toilet cistern	ceramic										
Building: Bacton Low Riser, Block E - Flat 181			Level: 4		Location: 001/ Bedroom						
Item / Product Examined	Material Description	Sampling Strategy	Sample No.	Extent	Product Score	Material Condition	Surface Treatment	Fibre Id.	Material Score	Accessibility Score	Risk Level Assessment
ceiling	concrete										
walls	concrete										
floor	concrete										
floor covering	Asbestos-containing floor tiles & bituminous product	Cross Reference	126256-3	12 Sqm.	1	1	0	Chrysotile	3	3	 R3

Annotated Plans and Other Additional Documents

The following documents accompany this report and should be regarded as an integral part of this report.

They can be downloaded from <http://web.lucion.co.uk/reports/126256/attachments>.

- Method Statement [http://web.lucion.co.uk/method_statements/126256?s=27c83fc3c956fb53ca1a9a3160c4c8bc]
- Risk Assessment [http://web.lucion.co.uk/risk_assessment/126256?s=be1d82aa2c3fbd25caa08fea0c114999]
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Communal-Areas.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-176.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-177.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-178.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-179.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-180.pdf
- A4-Plan_126256_Block-E---Bacton-Low-Rise---Flat-181.pdf

Additional Advice and Information

As the reader of this report you are recommended to make sure that it meets with your requirements. Publication HSG 264 Asbestos: The survey guide suggests the following:

- Check your report against our quotation or your tender
- Check for any caveats or disclaimers you are unsure of
- Check that the survey is as you requested
- Check you understand the included plans
- Check that we have accessed all the areas and rooms you wanted us to

Asbestos Fibre Identification Material Test Certificate

Job Ref No: **126256**, Account Ref No: **17637**, Contract Ref No: **15270**

This certificate is for the attention of	Colin Silvey Rydon Construction Ltd Pinewood, Chineham Business Park, Crockford Lane, Chineham, Basingstoke, RG24 8AL
Site Address	Block E, Bacton Low Rise, Haverstock Road, London, NW5 4PS
Sampled Buildings	Bacton Low Riser, Block E - Communal Area, Bacton Low Riser, Block E - Flat 176, Bacton Low Riser, Block E - Flat 177, Bacton Low Riser, Block E - Flat 178, Bacton Low Riser, Block E - Flat 179, Bacton Low Riser, Block E - Flat 180, Bacton Low Riser, Block E - Flat 181
Analyst(s)	James Barnes, Agnes Suska
Analyst signature(s)	
Analysis date	Friday, 19th August, 2016
Approved signatory	Simon Spreyer
Approved signature	
Approval date	Tuesday, 23rd August, 2016
Report Rendered on	Tue 23 Aug 2016 @ 16:17:49

Analysis method - In-house method TOP01.03 in accordance with HSG 248 - Asbestos: The Analysts' Guide For Sampling, Analysis and Clearance Procedures H.S.E. 2005. All analysis carried out at Lucion's Head Office laboratory.

Lucion bear no responsibility for sample collection or sample description related information provided by the client.

Where Lucion Environmental Ltd has not undertaken sampling; any prior sampling activity is beyond the company's responsibility. Where Lucion Environmental Ltd has sampled the test material, this has been done in accordance with in-house method TOP01.02. Any opinions and interpretations expressed herein are outside the scope of UKAS accreditation.

The results quoted in this report relate to:

1. Samples analysed in accordance with methods described above
2. Samples analysed and not necessarily to the material from which the samples were taken
3. The time during which sampling took place and to the conditions prevailing during that time

The samples referred to in this report will be retained for 6 months unless requested otherwise.

Total Samples	No Asbestos Detected	Asbestos-Containing Samples
34	13	21

Fibre Identification Analysis Results

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126256-1	Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126256-2	Bacton Low Riser, Block E - Flat 181	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-3	Bacton Low Riser, Block E - Flat 181	1	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	tile - negative, bitumen - positive	Chrysotile
126256-4	Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126256-5	Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	sink pad	bituminous product		NAD
126256-6	Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-7	Bacton Low Riser, Block E - Flat 181	1	002/ Kitchen & Lounge	panels to shelves within wooden cupboard	insulating board		NAD
126256-8	Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126256-9	Bacton Low Riser, Block E - Flat 180	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-10	Bacton Low Riser, Block E - Flat 180	-1	002/ Lounge & Cupboard	panels to external wall	insulating board		NAD
126256-11	Bacton Low Riser, Block E - Flat 180	-2	002/ Bedroom	panels to shelves within wooden cupboard	insulating board		NAD
126256-12	Bacton Low Riser, Block E - Flat 180	-2	006/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-13	Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	tile - positive, bitumen - positive	Chrysotile
126256-14	Bacton Low Riser, Block E - Flat 179	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-15	Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126256-16	Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-17	Bacton Low Riser, Block E - Flat 179	1	002/ Kitchen & Lounge	panels to shelves within wooden cupboard	insulating board		NAD
126256-18	Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126256-19	Bacton Low Riser, Block E - Flat 178	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-20	Bacton Low Riser, Block E - Flat 178	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126256-21	Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	floor covering	Asbestos-containing floor tiles & bituminous product	tile - positive, bitumen - positive	Chrysotile

table continued from previous page...

Sample No.	Building	Level	Location	Item / Product Examined	Material Description	Analyst Comments	Fibre Identification
126256-22	Bacton Low Riser, Block E - Flat 177	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-23	Bacton Low Riser, Block E - Flat 177	-1	002/ Lounge & Cupboard	panels to external wall	insulating board		NAD
126256-24	Bacton Low Riser, Block E - Flat 177	-2	002/ Bedroom	panels to shelves within wooden cupboard	insulating board		NAD
126256-25	Bacton Low Riser, Block E - Flat 177	-2	005/ Bathroom	toilet cistern	Asbestos-containing composite		Amosite
126256-26	Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	adhesive to concrete floor	Asbestos-containing bituminous product		Chrysotile
126256-27	Bacton Low Riser, Block E - Flat 176	0	001/ Entrance Lobby	boxing to electric cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-28	Bacton Low Riser, Block E - Flat 176	1	001/ Stairs	floor covering	Asbestos-containing floor tiles & bituminous product	tile - positive, bitumen - positive	Chrysotile
126256-29	Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	panels to external wall	insulating board		NAD
126256-30	Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-31	Bacton Low Riser, Block E - Flat 176	1	002/ Kitchen & Lounge	panels to shelves within wooden cupboard	insulating board		NAD
126256-32	Bacton Low Riser, Block E - Flat 177	-2	006/ Bedroom	boxing within wooden cupboard	Asbestos-containing insulating board		Amosite, Chrysotile
126256-33	Bacton Low Riser, Block E - Communal Area	0	001/ Entrance Lobby	insulation within expansion joint	insulating board		NAD
126256-34	Bacton Low Riser, Block E - Communal Area	0	003/ Garage 46	flange gaskets to pipework	Asbestos-containing gasket		Chrysotile