



# PRELIMINARY ISSUE

**NOTES:**

1. ALL PIPEWORK & VALVES ETC, INDICATED ARE TO REMAIN.
2. THE EXISTING VARIABLE HEATING FLOW & RETURN CIRCUIT SERVING THE RADIATORS WILL SERVE THE NEW RADIATOR LAYOUT.
3. THE MECHANICAL & ELECTRICAL CONTRACTOR SHALL ALLOW FOR THE EXISTING BMS SYSTEM TO FLAT 8 TO BE DECOMMISSIONED BEFORE ANY WORK COMMENCES AND ALSO REINSTATED (RE-COMMISSIONED) WHEN THE WORKS ARE COMPLETED.

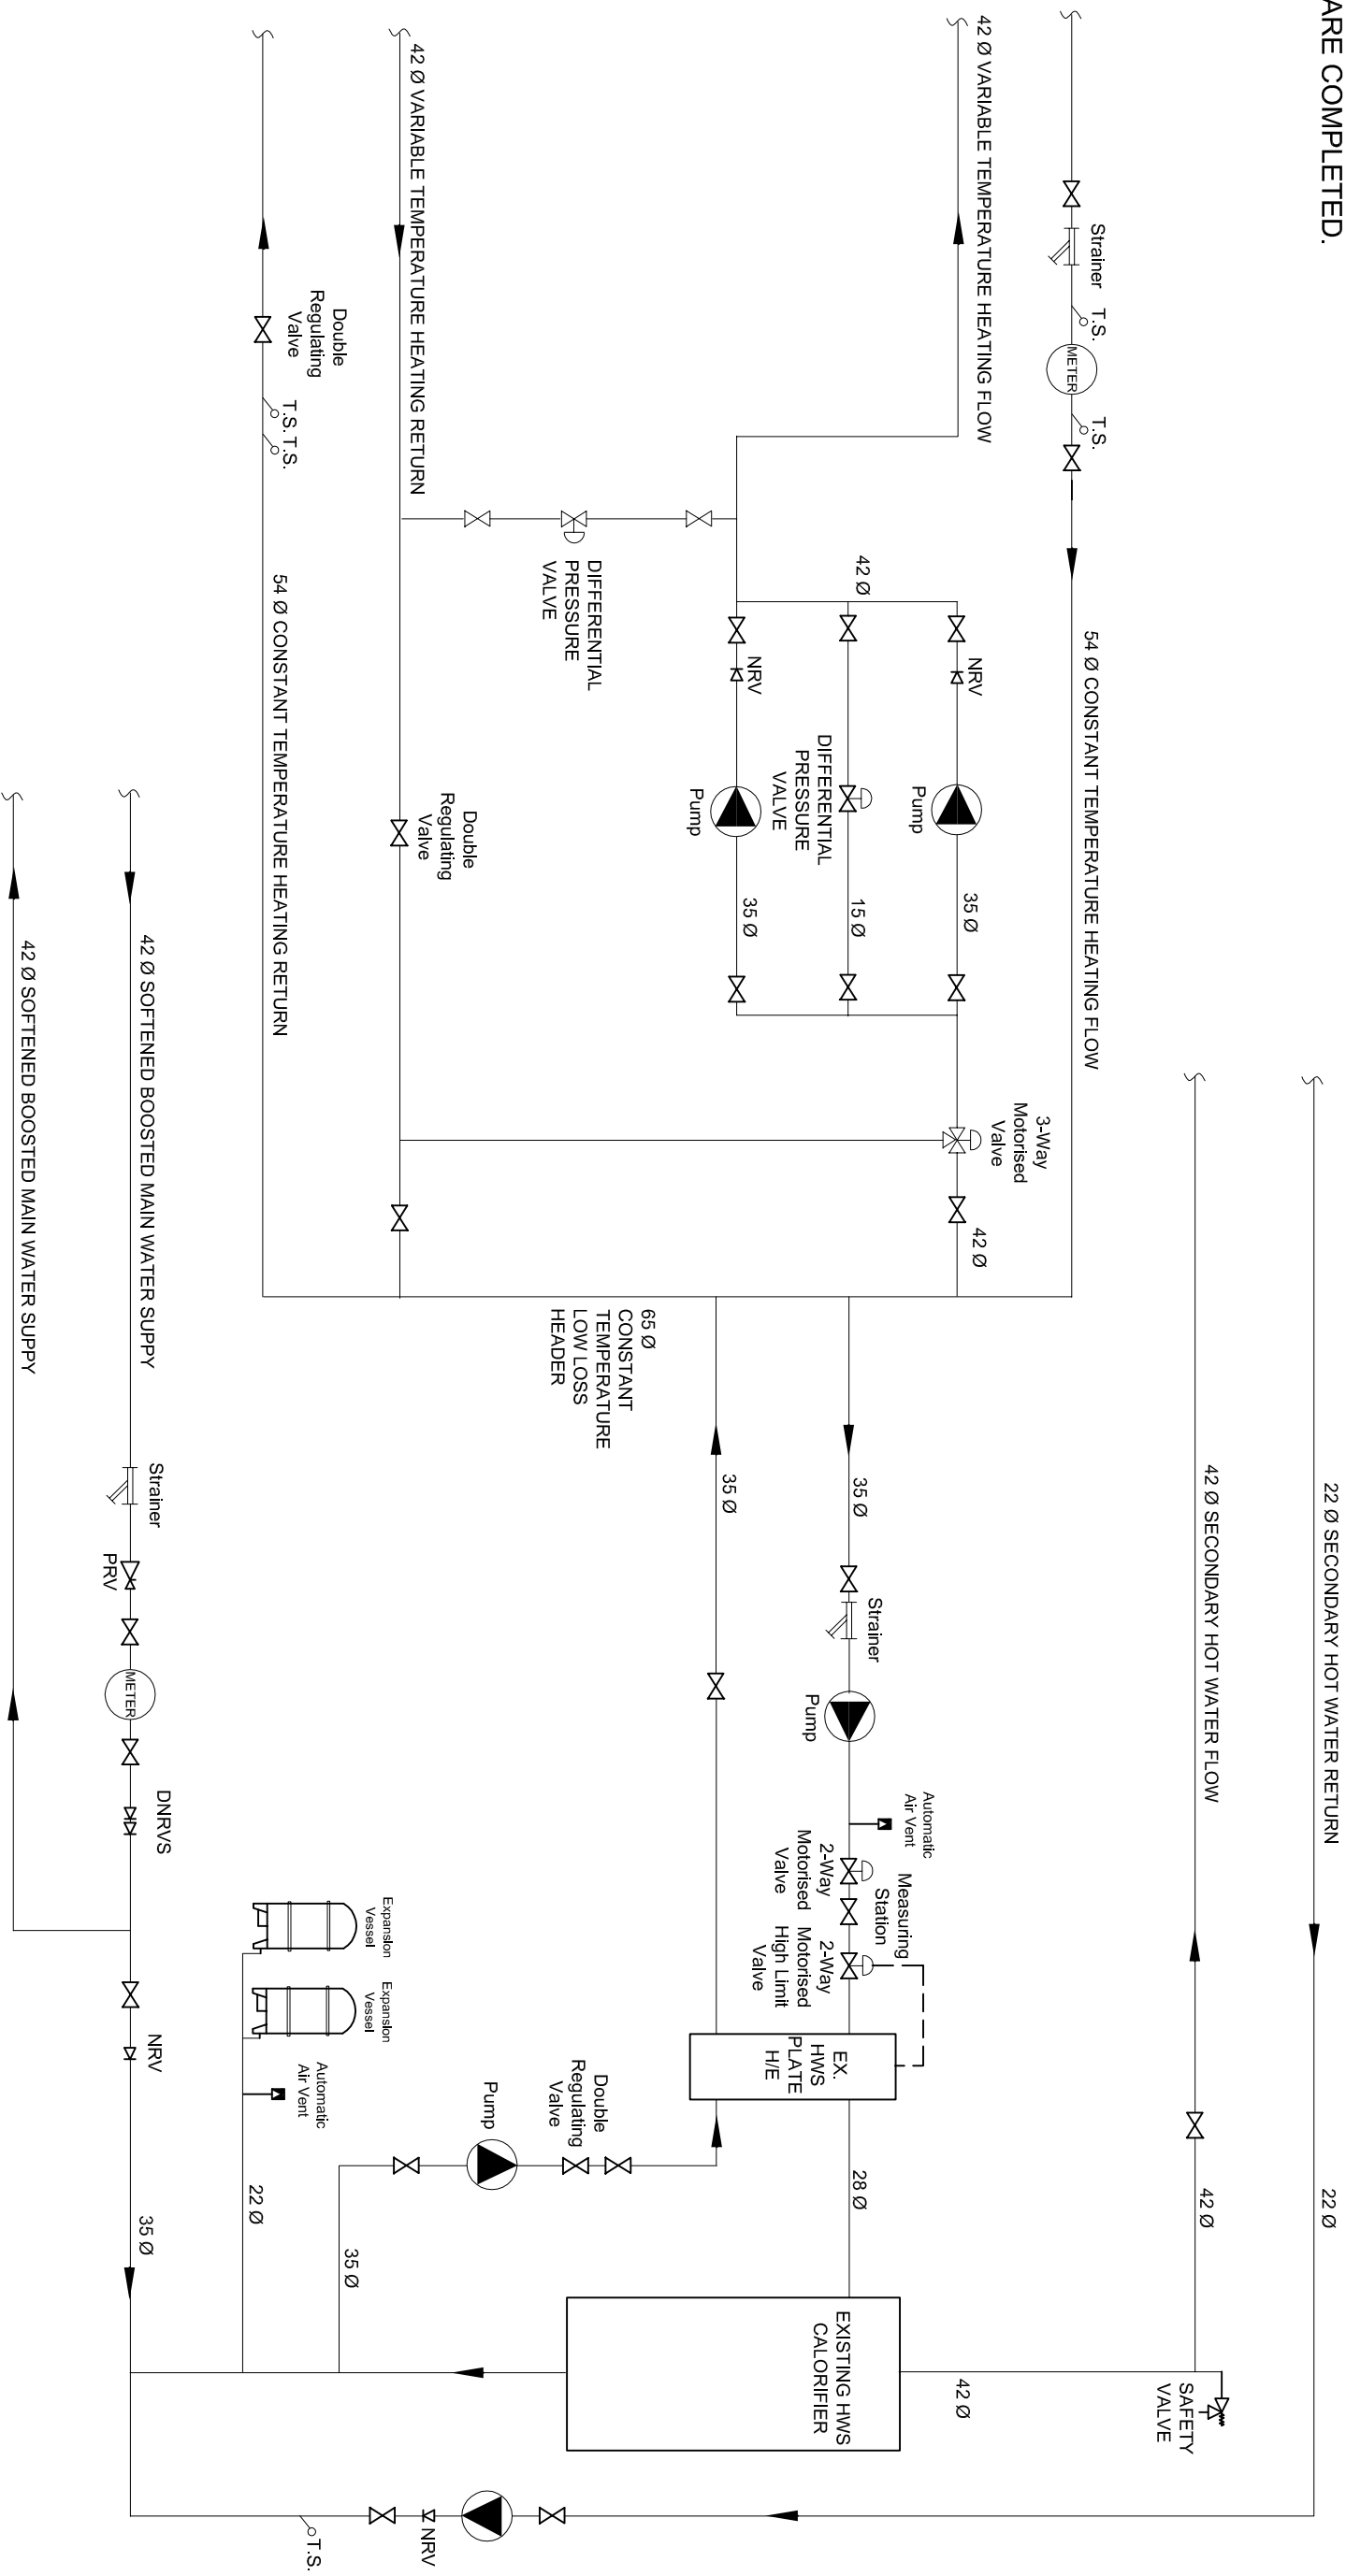

## EXISTING CALORIFIER ROOM SCHEMATIC LAYOUT MAIN MWS, HWS & HEATING ONLY SHOWN

<b>Job:</b>	FLAT 8 INVERFORTH HOUSE
<b>Title:</b>	CALORIFIER ROOM SCHEMATIC LAYOUT INDICATIVE LAYOUT
<b>Drawn:</b>	gg
<b>Date:</b>	OCT 2016
<b>Scale:</b>	1:100 @ A2
<b>Checked:</b>	
 <b>Barry Griffin Associates</b> Building Services and Public Health Consultants Telephone 020 8866 7885 Fax 020 8866 7883 D/g. No. 756/M/04	