



- All dimensions to be checked on site.
- Do not scale from this drawing
- Report any discrepancies and omissions to Llewelyn Davies Weeks Ltd
- All dimensions are shown in mm unless otherwise stated
- Refer to drawing issue sheet for purpose of issue
- If in doubt ask
- This drawing is Copyright © Llewelyn Davies Weeks Ltd

Notes

LEGEND:


 Cross-hatch denotes extent of acoustic screens referred to in Temple Group Noise Assessment Report consisting of:
 New powder coated metal framed min. 5mm thick glazed toughened glass outer acoustic screen to match colour of existing awning and cladding.
 Where screens cross over roofing between parapets min. 3mm thick glazed acrylic to be used in lieu of toughened glass for ease of site cutting.
 On noise source side of screen 50mm thick Quietstone or similar approved absorbent fire resisting weatherproof lining to be fitted to back of outer screen leaving no air gaps.

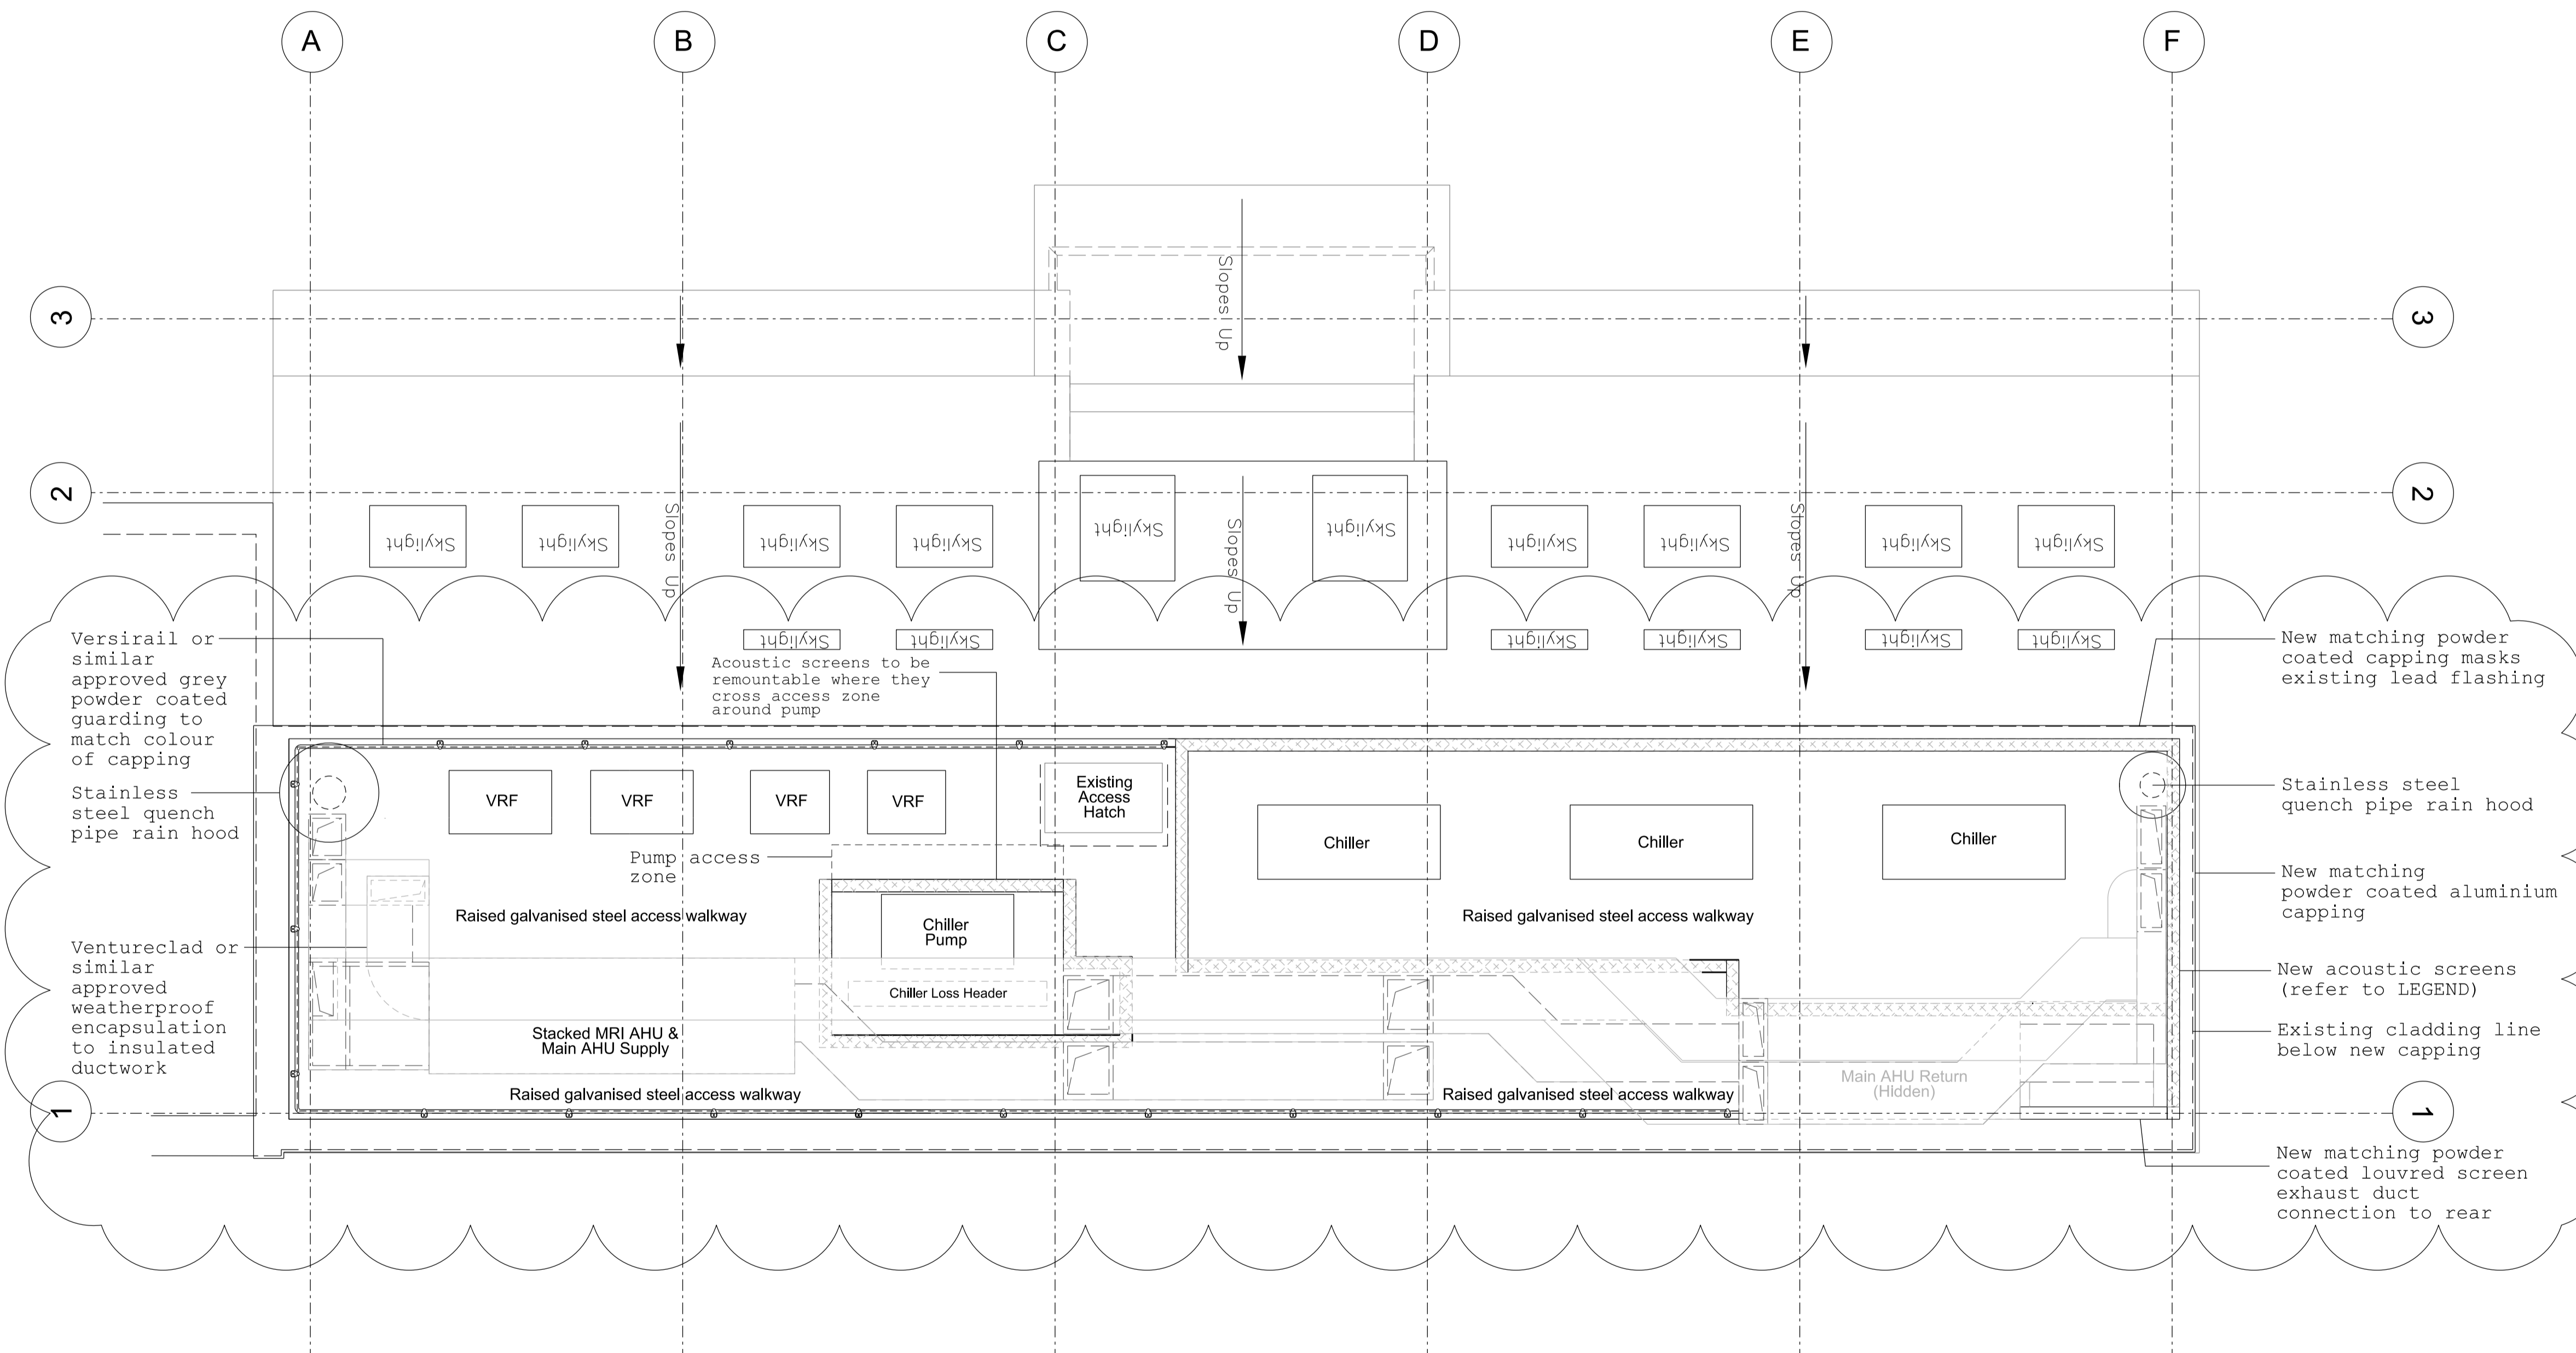

Versirail or similar approved grey powder coated guarding to match colour of capping
 Stainless steel quench pipe rain hood
 Ventureclad or similar approved weatherproof encapsulation to insulated ductwork

New matching powder coated capping masks existing lead flashing
 Stainless steel quench pipe rain hood
 New matching powder coated aluminium capping
 New acoustic screens (refer to LEGEND)
 Existing cladding line below new capping
 New matching powder coated louvred screen exhaust duct connection to rear

P3 For approval.	16-11-30	JD
P2 For information only	16-10-21	JD
P1 For information only	16-10-06	YC
No. Description	Date	By
Revisions		

Structural Consultant	Services Consultant
AECOM	ARUP
Project Manager	Cost Consultant
	

Project Title
The Liver Institute
 69-75 Chenies Mews, London
 WC1E 6HX

Client
University College London Hospitals Charity (UCLHC)

Drawing Title
Proposed Plan Roof Level

Drawing number	Revision
CM_P_00_RF	P3

Scale @ A3
 1:100

Drawn
 LD

Date
 16-09-29