

73.00m

72.00m

71.00m

70.00m


69.00m



ELEVATION KEY - E2



<p>Notes: Drawing units are metres.</p> <p>Stair/ slope arrows point up</p> <p>Direction of floor boards</p> <p>Direction of roof slope (up)</p>	<p>Abbreviations:</p>	<p>Notes:</p> <p>THIS SURVEY HAS BEEN CARRIED OUT WITH AN ACCURACY CONSISTENT WITH A SCALE OF 1:10. INTERROGATED DIMENSIONS WILL BE WITHIN THE TOLERANCE ASSOCIATED WITH THIS AND SMALLER SCALES ONLY.</p> <p>ALL LEVELS ARE IN METRES, RELATED TO AN ARBITRARY DATUM</p> <p>UNITS ARE MILLIMETRES.</p>	<div><div>St. Katharine's - The Danish Church in London</div><div>Rectified Elevation</div><div><div>00.10.20.30.40.511.52</div><div>metres</div></div></div>	<p>SURVEYED & DRAWN BY:</p> <div><div>James Brennan Associates</div><div>Chartered Surveyors</div><div>www.jbrennanassociates.co.uk</div></div> <p>UNIT 6 WARREN HOUSE DEEPPDALE BUSINESS PARK ASHFORD ROAD, BAKEWELL DE45 1CT TEL: 01629 814654 EMAIL: mail@jbrennanassociates.co.uk</p>	<p>Architect/ Surveyor:</p> <div><div>MFA</div><div>Malcolm Fryer Architects</div></div> <p>23 Gerrard Road London N1 8AY 0207 6847244 0795 0781411 mf@mfr-architects.com www.mfr-architects.com</p>	<p>Client:</p> <p>The Danish Church in London</p> <p>4 St Katharine's Precinct London NW1 4HH</p>	<div><div>Drawing</div><div>I043-E2-N05-01</div></div> <div><div>Issue date</div><div>Sept 2016</div></div> <div><div>FOR TENDER</div></div> <div><div>Scale</div><div>1:10@ A1</div></div>
--	-----------------------	---	---	---	--	---	---

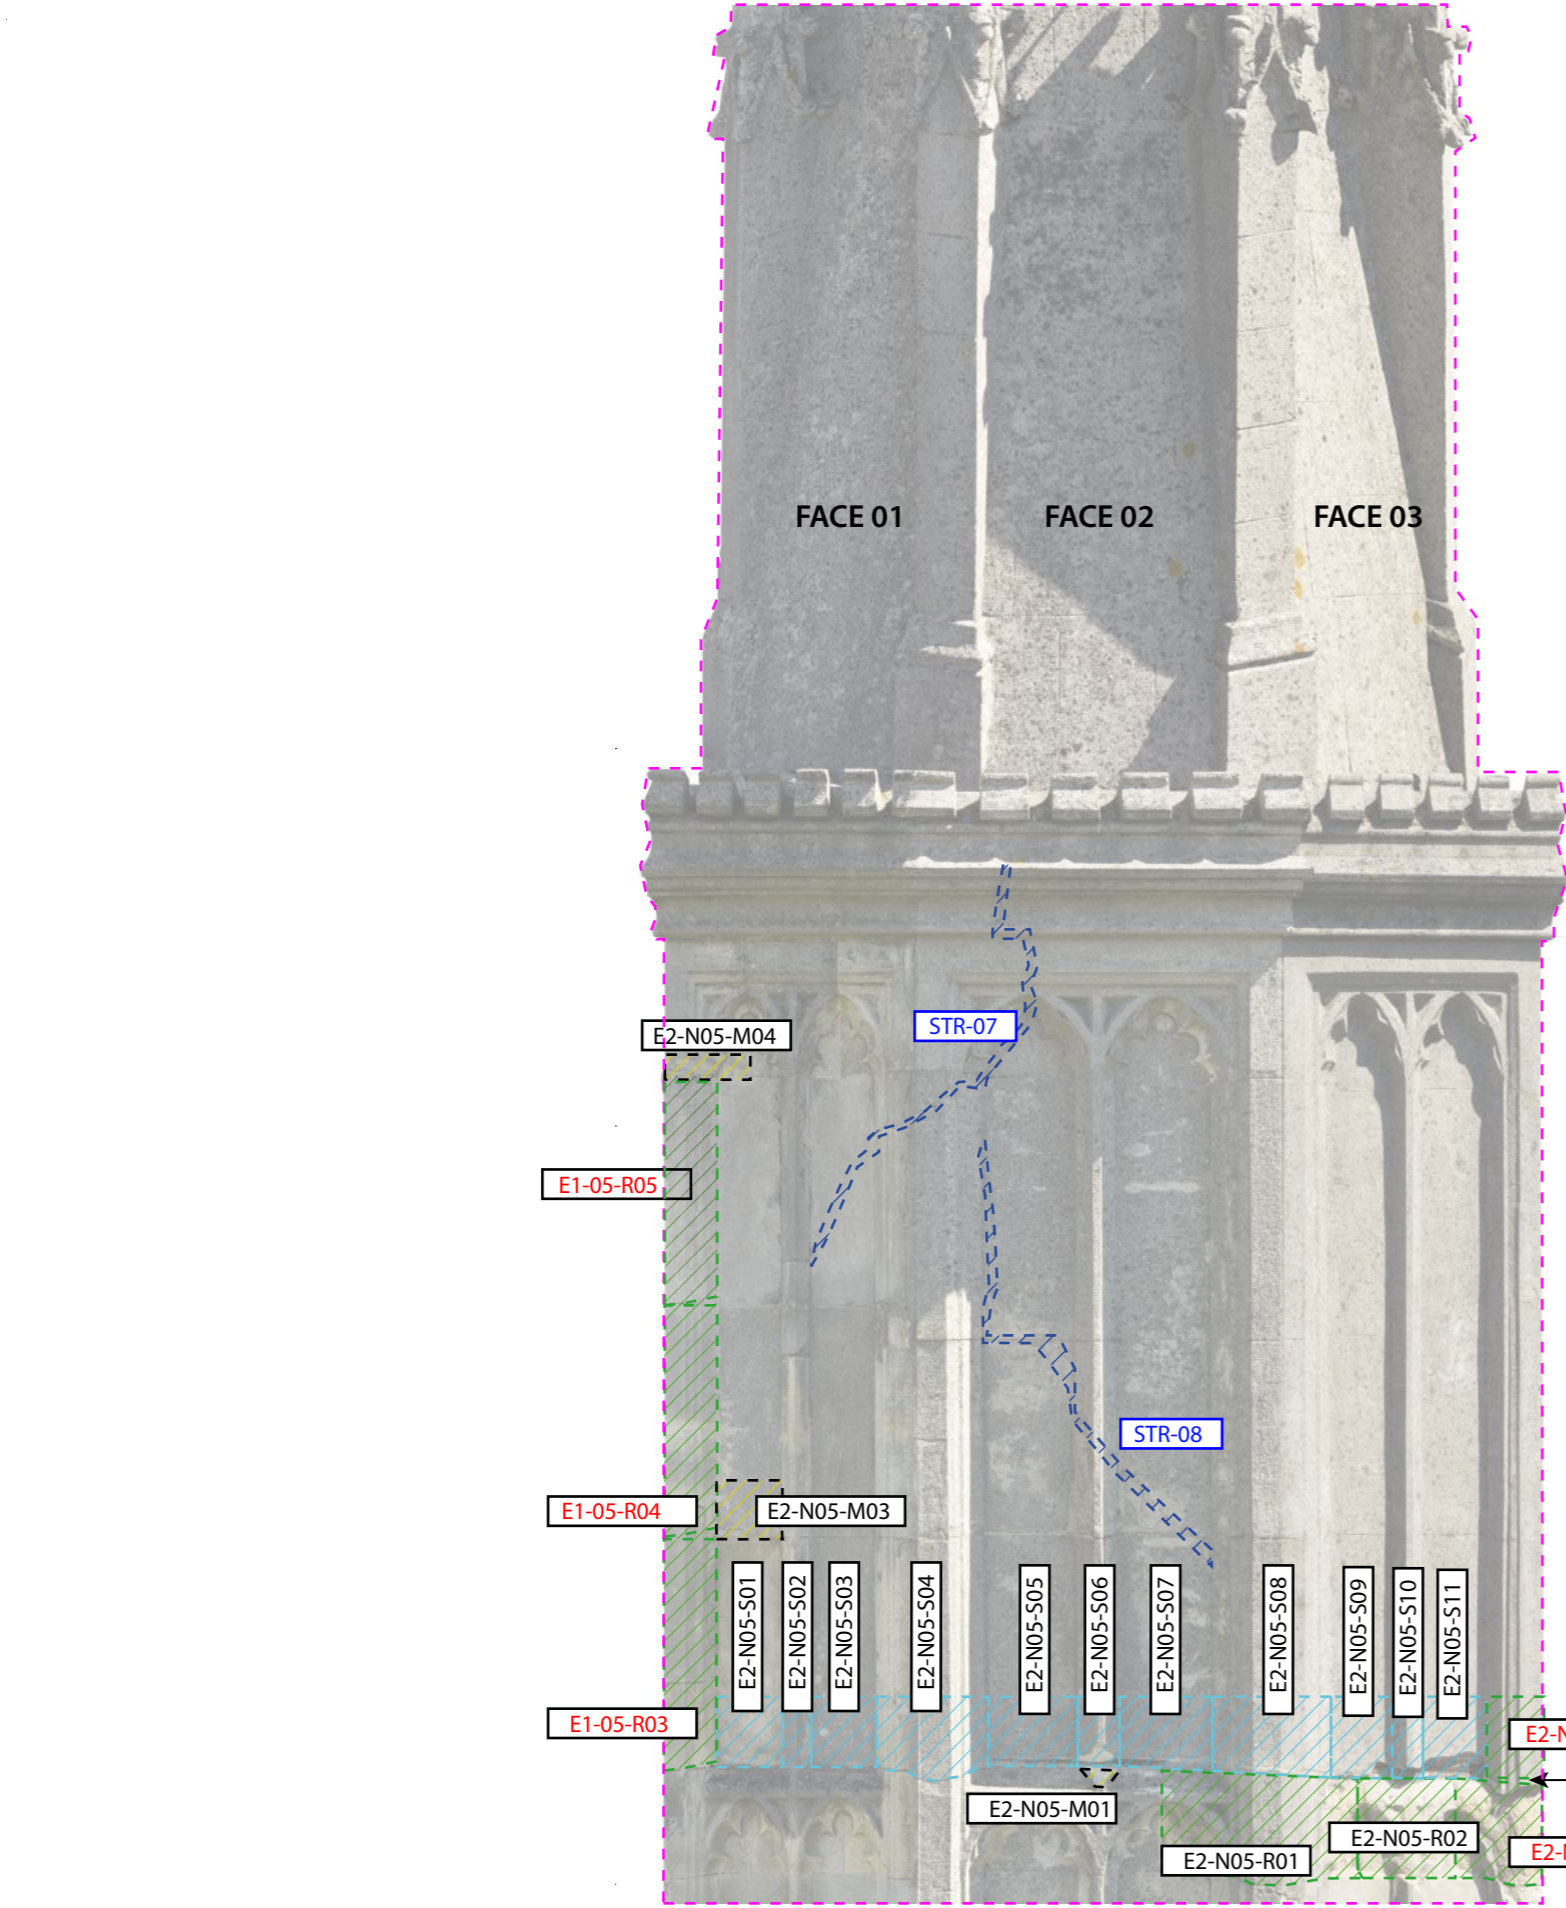

GENERAL NOTES

To be read in conjunction with prelims and specialist stonemason details

Final scope of work to be agreed with CA prior to commencement.

CLEANING

External cleaning to be completed prior to commencement of stonework repairs, following approved external cleaning trials with DOFF steam as per spec A12r/460 in consultation with CA.

REPOINTING GENERALLY

Allow for ashlar repointing to open joints only (approximately 50% of total surface area) as per specification Z21r/ 490. All hairline fissures to ashlar and retained rendered surfaces to be filled where possible, in consultation with CA.

KEY



Replace Stonework
Carefully replace stonework as per specification F21r and approved sample.



Mortar Repair
Repair with lime mortar as per specification F21r/750 and approved sample.



Stone Indent Repair
Indented repair as per specification F21r/710 and approved sample.

C

Replace Cramp
Careful removal of existing cramp and cramp replacement as per specification F21r/610. Allow for stone replacement, indent repair or mortar repair as scheduled.

CA

Cramp Assumed
Evidence suggests corrosion of embedded cramp within face stonework. Area to be investigated by specialist stonemason. Allow for careful removal of cramp and cramp replacement as per specification F21r/610, and stone replacement, indent repair or mortar repair as scheduled.



For Structural Investigation
Signs of movement or structural concern at time of survey to be investigated by Structural Engineer



Shelter Coat
As per specification F21r/860

ELEVATION KEY - E2



Notes:

Drawing units are metres.

- Stair/ slope arrows point up
- Direction of floor boards
- Direction of roof slope (up)

Abbreviations:

Notes:


THIS SURVEY HAS BEEN CARRIED OUT WITH AN ACCURACY CONSISTENT WITH A SCALE OF 1:50. INTERROGATED DIMENSIONS WILL BE WITHIN THE TOLERANCE ASSOCIATED WITH THIS AND SMALLER SCALES ONLY.

ALL LEVELS ARE IN METRES, RELATED TO AN ARBITRARY DATUM

UNITS ARE MILLIMETRES.

St. Katharine's - The Danish Church in London

EXTERNAL MASONRY REPAIR



SURVEYED & DRAWN BY:

James Brennan Associates
Chartered Surveyors
www.jbrennansassociates.co.uk

UNIT 6 WARREN HOUSE
DEEPDALE BUSINESS PARK
ASHFORD ROAD, BAKEWELL
DE45 1CT TEL: 01629 814654
EMAIL: mail@jbrennansassociates.co.uk

Architect/ Surveyor:

MFA / Malcolm Fryer Architects

23 Gerrard Road
London N1 8AY
0207 6847244
0795 0781411
mfa@mfryer-architects.com
www.mfryer-architects.com

Client:

The Danish Church in London

4 St Katharine's Precinct
London
NW1 4HH

Drawing **043-E2-N05-02**

Issue date **Oct 2016**

FOR TENDER

Scale **1:10@ A1**

79.00m


78.00m

77.00m

76.00m

75.00m

74.00m

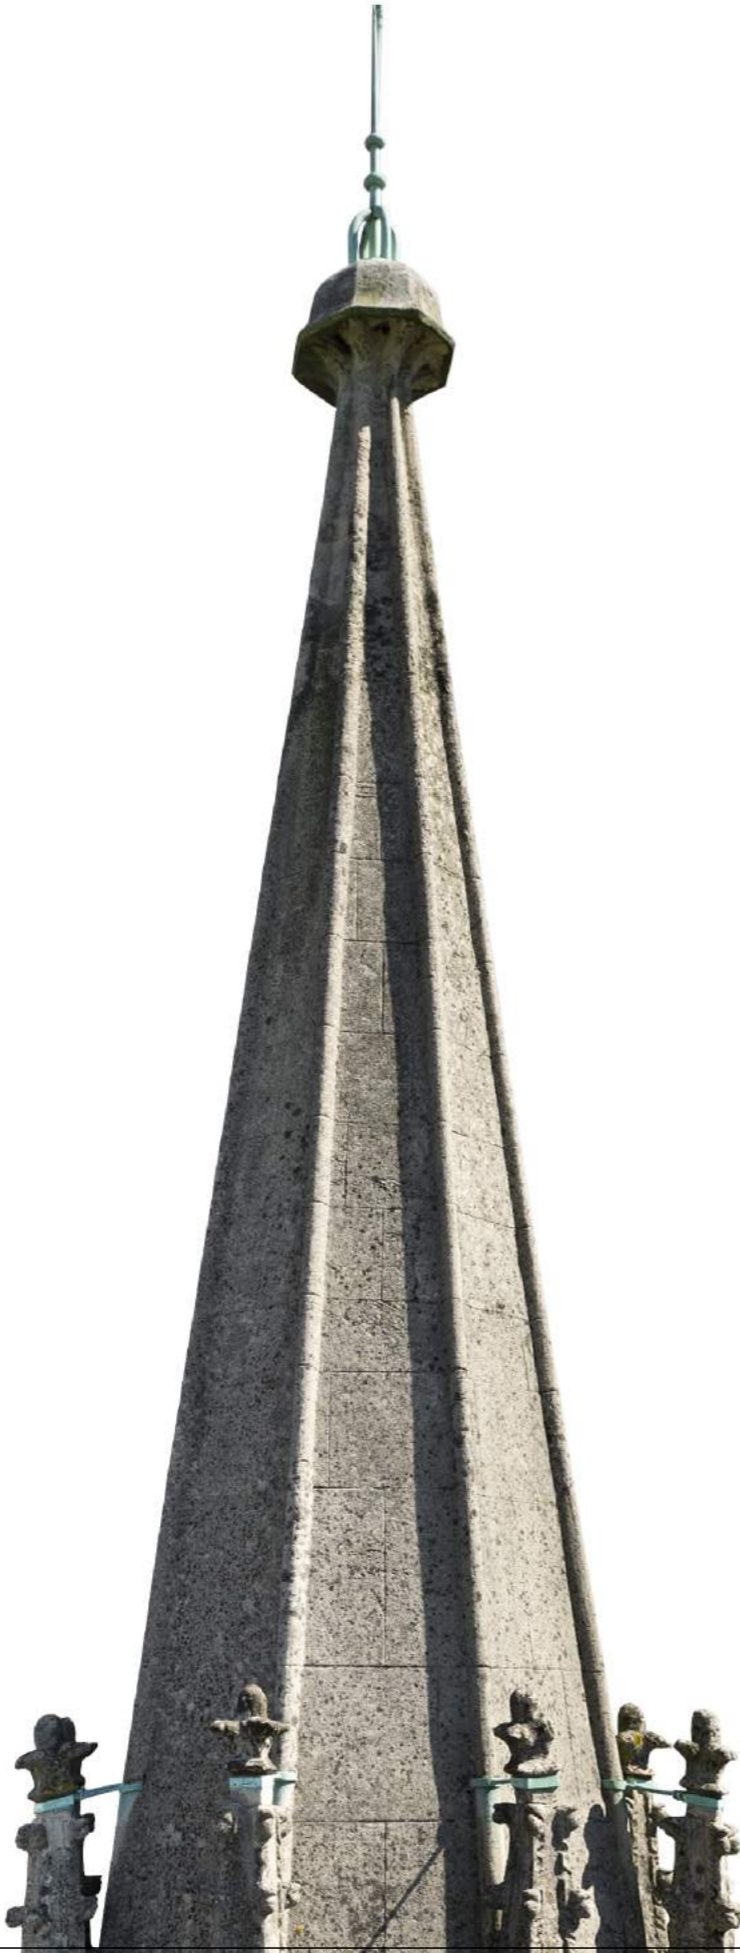

ELEVATION KEY - E2



<p>Notes: Drawing units are metres.</p> <p>Stair/ slope arrows point up</p> <p>Direction of floor boards</p> <p>Direction of roof slope (up)</p>	<p>Abbreviations:</p>	<p>Notes:</p> <p>THIS SURVEY HAS BEEN CARRIED OUT WITH AN ACCURACY CONSISTENT WITH A SCALE OF 1:50. INTERROGATED DIMENSIONS WILL BE WITHIN THE TOLERANCE ASSOCIATED WITH THIS AND SMALLER SCALES ONLY.</p> <p>ALL LEVELS ARE IN METRES, RELATED TO AN ARBITRARY DATUM</p> <p>UNITS ARE MILLIMETRES.</p>	<div><div>St. Katharine's - The Danish Church in London</div><div>Rectified Elevation</div><div><div>0</div><div>0.1</div><div>0.2</div><div>0.3</div><div>0.4</div><div>0.5</div><div>1</div><div>1.5</div><div>2 metres</div></div></div>	<p>SURVEYED & DRAWN BY:</p> <p>James Brennan Associates</p> <p>Chartered Surveyors</p> <p>www.jbrennanassociates.co.uk</p> <p>UNIT 6 WARREN HOUSE DEEPDALE BUSINESS PARK ASHFORD ROAD, BAKEWELL DE45 1GT TEL: 01629 814654 EMAIL: mail@jbrennanassociates.co.uk</p>	<p>Architect/ Surveyor:</p> <p>MFA Malcolm Fryer Architects</p> <p>23 Gerrard Road London N1 6AY 0207 6847244 0795 0781411 mfm@mfryer-architects.com www.mfryer-architects.com</p>	<p>Client:</p> <p>The Danish Church in London</p> <p>4 St Katharine's Precinct London NW1 4HH</p>	<p>Drawing 043-E2-N06-01</p> <p>Issue date Sept 2016</p> <p>FOR TENDER</p> <p>Scale 1:10@ A1</p>
--	-----------------------	---	---	---	--	---	--

GENERAL NOTES

To be read in conjunction with prelims and specialist stonemason details


Final scope of work to be agreed with CA prior to commencement.

CLEANING

External cleaning to be completed prior to commencement of stonework repairs, following approved external cleaning trials with DOFF steam as per spec A12r/460 in consultation with CA.

REPOINTING GENERALLY

Allow for ashlar repointing to open joints only (approximately 50% of total surface area) as per specification Z21r/ 490. All hairline fissures to ashlar and retained rendered surfaces to be filled where possible, in consultation with CA.

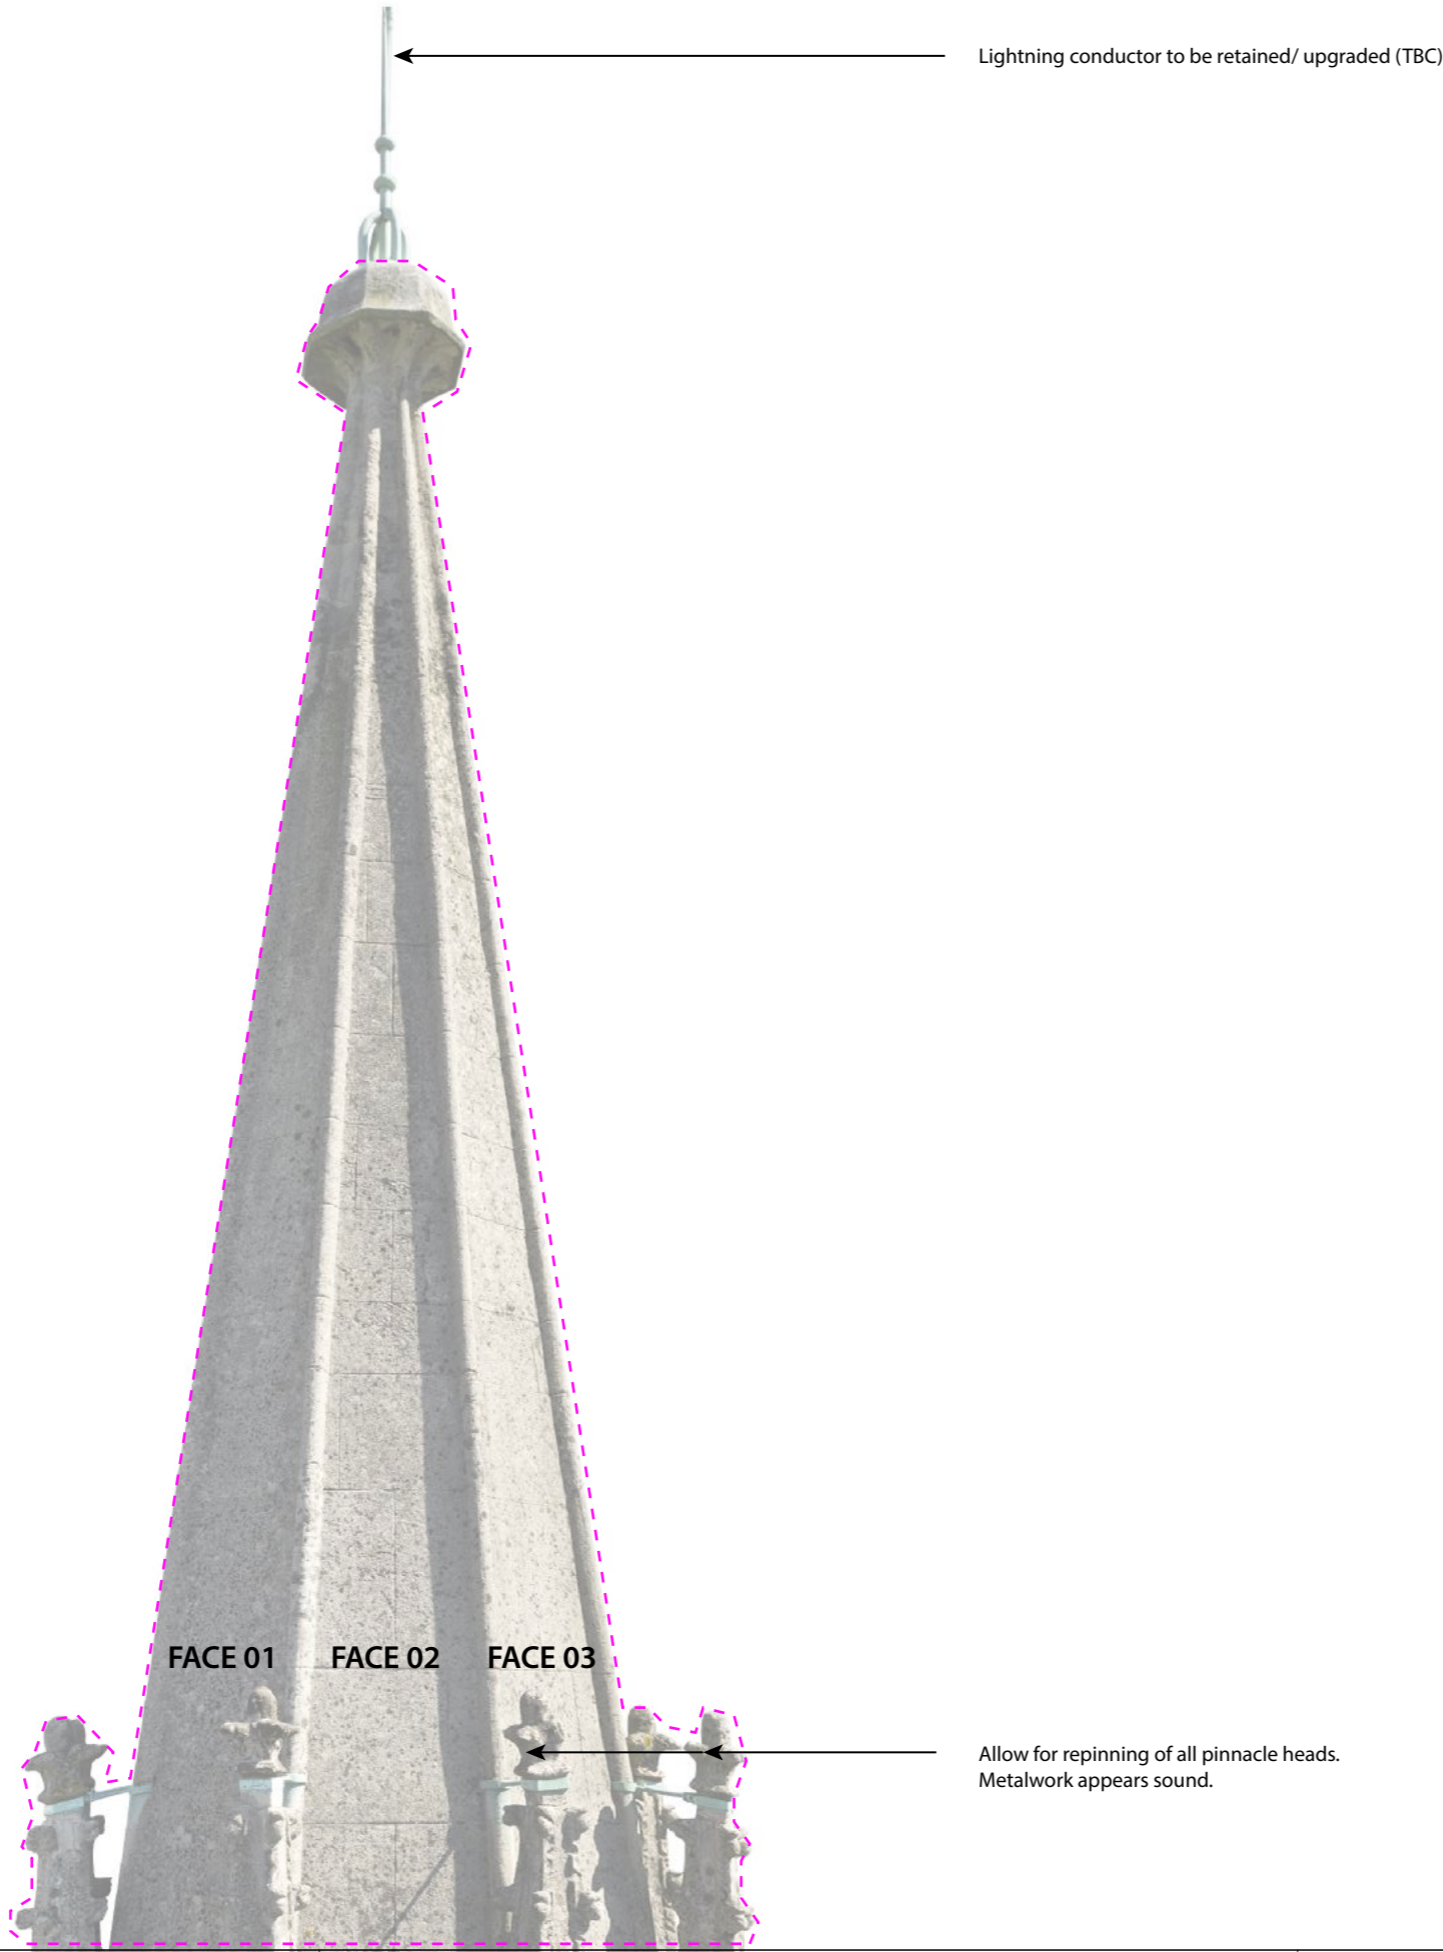

KEY

- Replace Stonework**
Carefully replace stonework as per specification F21r and approved sample.
- Mortar Repair**
Repair with lime mortar as per specification F21r/750 and approved sample.
- Stone Indent Repair**
Indented repair as per specification F21r/710 and approved sample.
- C** **Replace Cramp**
Careful removal of existing cramp and cramp replacement as per specification F21r/610. Allow for stone replacement, indent repair or mortar repair as scheduled.
- CA** **Cramp Assumed**
Evidence suggests corrosion of embedded cramp within face stonework. Area to be investigated by specialist stonemason. Allow for careful removal of cramp and cramp replacement as per specification F21r/610, and stone replacement, indent repair or mortar repair as scheduled.
- For Structural Investigation**
Signs of movement or structural concern at time of survey to be investigated by Structural Engineer
- Shelter Coat**
As per specification F21r/860

ELEVATION KEY - E2

