

Basement Impact Report

3 Belsize Crescent,
London, NW3 5QY

Job No.: 2604
Client: David Templer
Date: December 2015

Non-Technical Summary

The proposals are to lower the existing basement floor under an existing end terrace house at No. 3 Belsize Crescent by approx. 1m.

A thorough desk study of the site has been carried out which indicates that the site is underlain by the London Clay formation.

A Site Investigation confirms that the site is underlain by some made ground with London Clay below. The water table is below the level of the proposed basement.

The site is not located in within the flood zone for rivers and seas and reservoirs. The site is located within the area for low risk of surface water flooding.

The existing structure is constructed of load bearing masonry walls with timber joisted floors supported on shallow strip foundations. The site investigation has confirmed that the foundations are stepped brick within the London Clay.

The proposed works a new single storey basement and to extend the ground floor at the rear of the property. The works also include some alterations to the ground floor to remove loadbearing walls at ground and first floor.

The existing perimeter walls shall be underpinned and a new basement floor constructed approx. 1m below its current level.

The temporary works will be required in order to limit any movements in the neighboring buildings.

This report demonstrates how all the issues with lowering the basement level have been addressed and where any constraints has impacted on the proposed works to the basement.

1.0 INTRODUCTION

Concept Consultancy has been commissioned by David Templer to carry out a basement Impact Assessment for the site at 3 Belsize Crescent, London, NW3. The intention is to make some structural modifications to an existing basement in the form of lowering the existing basement floor slab level by approximately 1.0m. There are internal renovation works to be carried out to the basement and superstructure but this report is concerned only with the lowering of the basement slab.

2.0 Site Location

The site is located at the southern end of Belsize Crescent, London NW3 adjacent to Burdett Mews. The site is roughly rectangular in shape and measures approximately 11m x 7m. The site presently contains a four-storey end terrace (3 storey's over Basement) residential building.

The building has been constructed entirely within the London Clay formation.

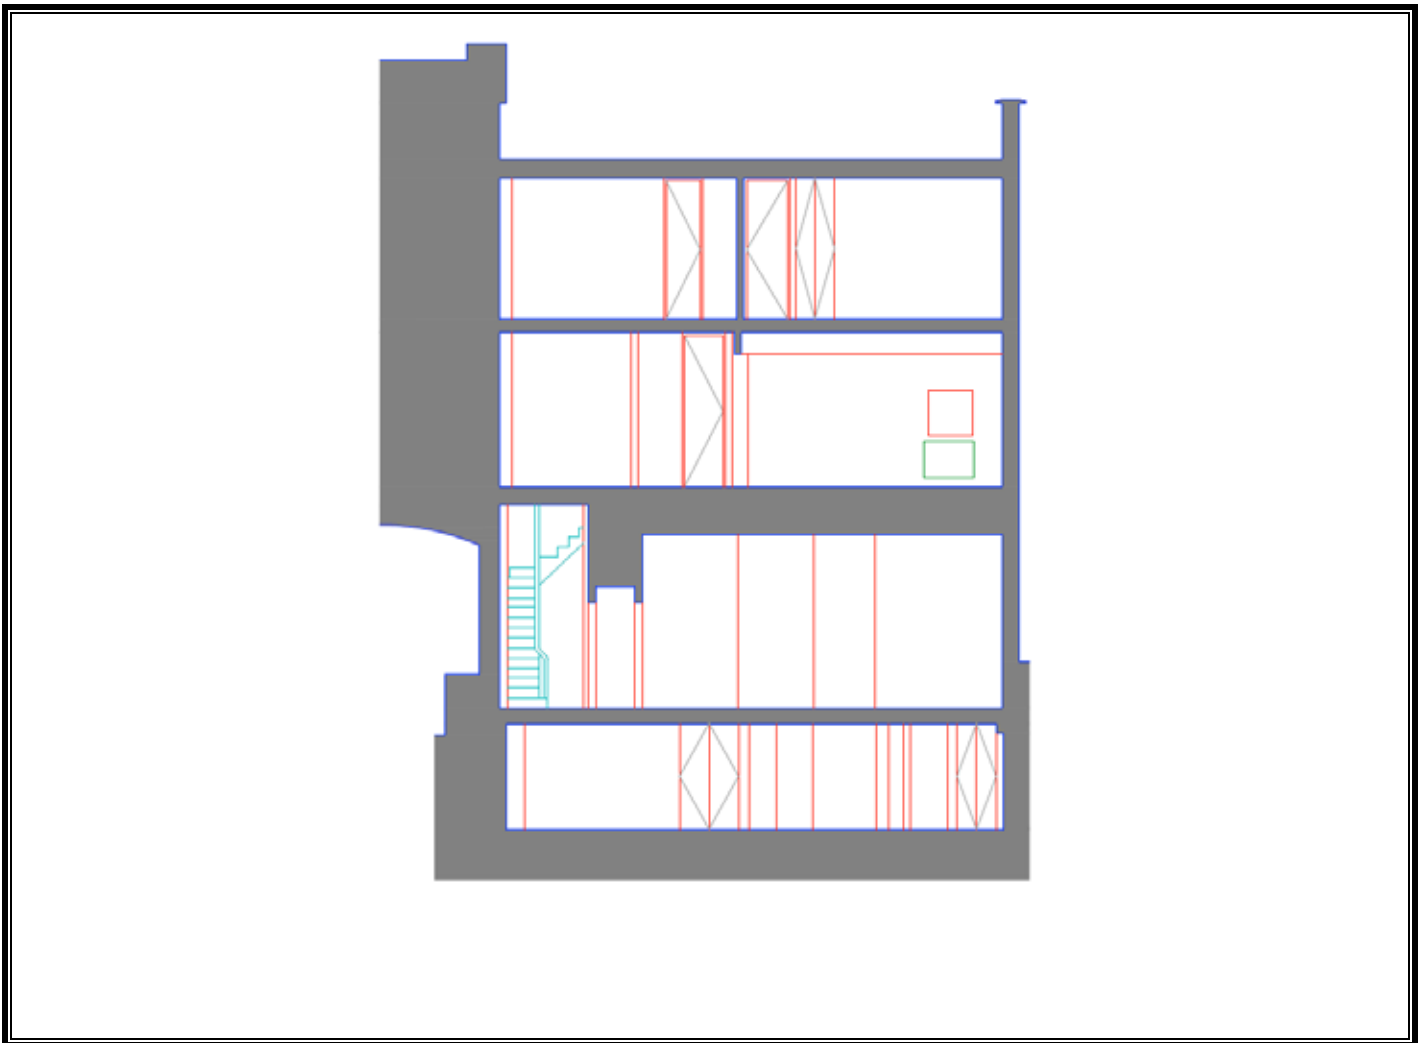


Fig 1: Original Long Section Through Property

The site is essentially a level site from front to back, however, the ground level of Belsize Crescent, to the front of the site has a fall across the front of approximately 0.6m. but this will have no influence over the proposed works. The rear boundary of the property is formed by a masonry/concrete retaining wall up to first floor level. The properties to the rear are a set of terraced domestic dwellings/mews.

2.1 Basement Works

The existing building is supported off the existing basement walls and slab within the London Clay stratum with the foundation formation level being approximately 2.7m below existing ground level. It is intended to increase the height of the headroom of the basement by lowering the basement floor level by approximately 1.0m (see Fig2).

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

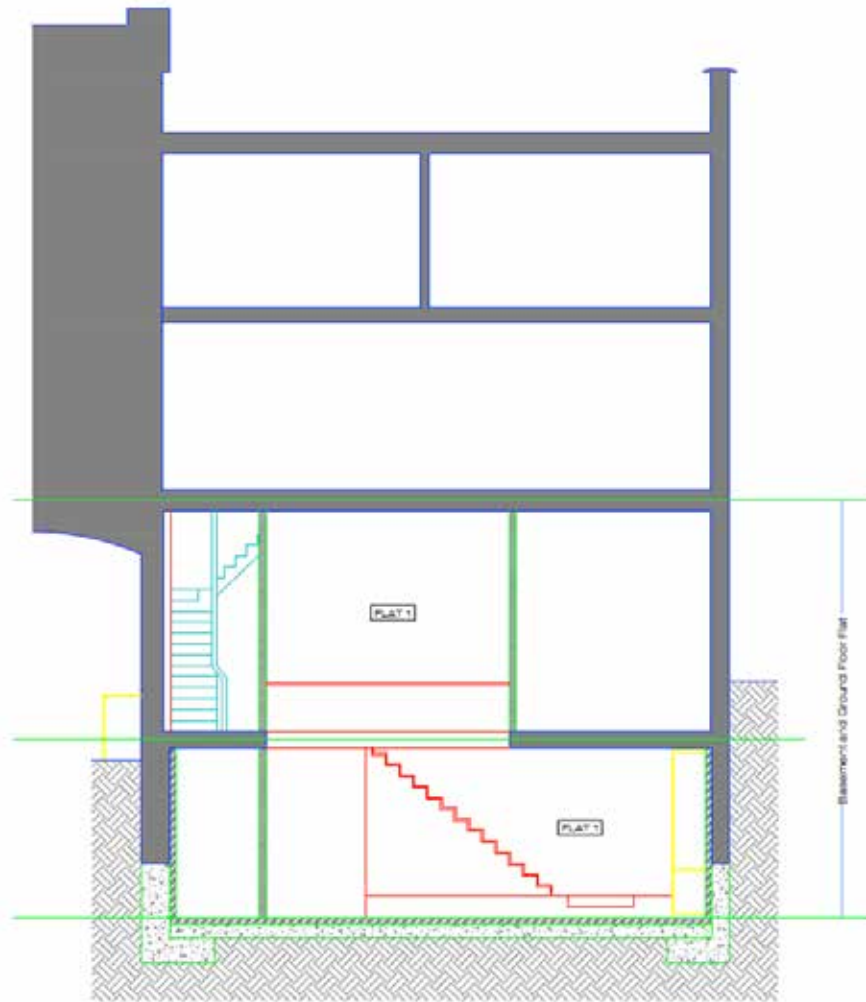


Fig 2: Proposed Long Section Through Property

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

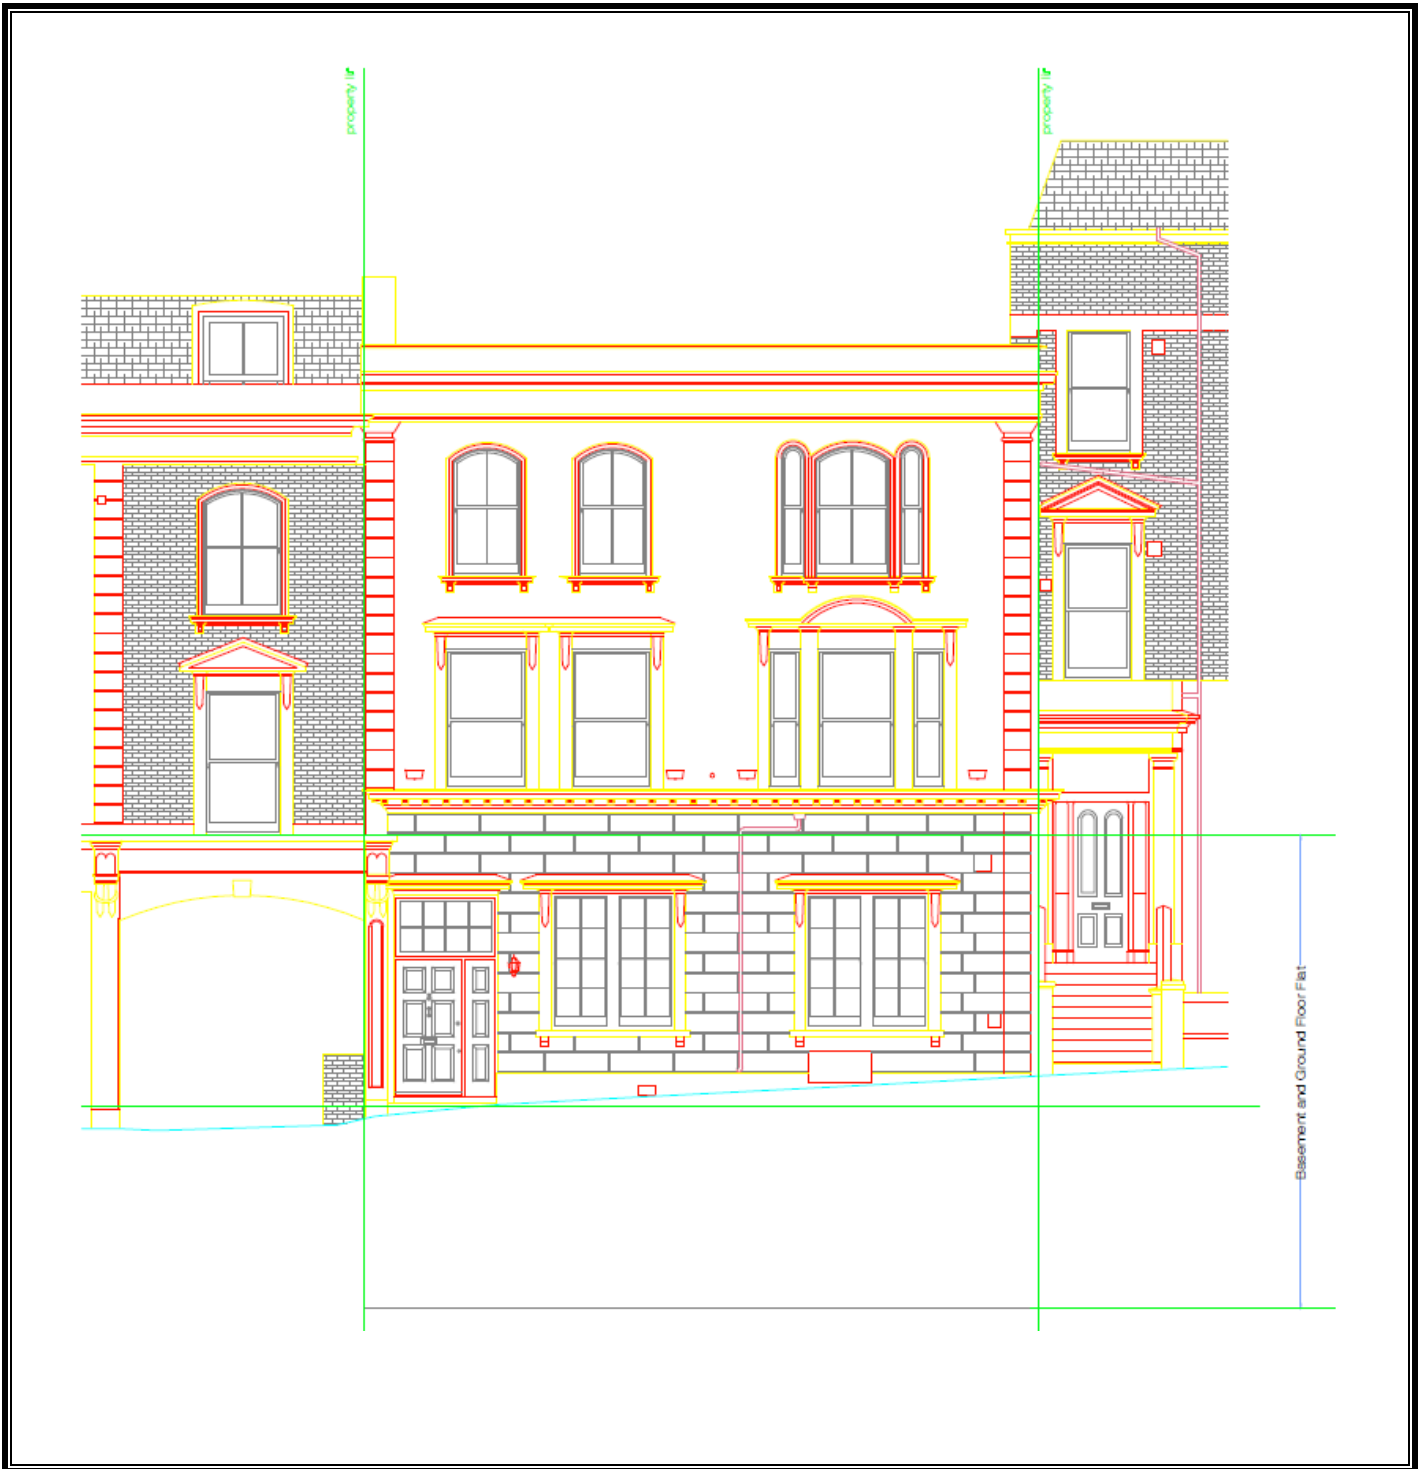


Fig 3: Front Elevation

3.0 Ground Conditions

3.1 Soil Conditions

A desktop study indicates London Clay close to the surface. This underlying London Clay formation is in line with the Geological Survey Map for the area which indicates same.

Ground investigation was carried out by Land Science as part of this project. A detailed report by Land Science is available, in summary a single window sampler borehole and 2 No. trial pits were dug. These confirmed the underlying ground comprises of:

- 0.65m to 0.75m of Made Ground Overlaying
- 0.75m to 2m plus London Clay

One borehole and two trial pits were constructed at 3 Belsize Crescent in January 2016. These were logged from basement floor level. These encountered made ground to 0.65 to 0.75 m depth, then London Clay. The existing foundation level was 0.65 m to 0.75 m below ground level (i.e. the same as the depth of made ground).

Trial pit TP1 and borehole WS1 were constructed in the north east corner of the basement. WS1 went through the base of TP1; the borehole reached 2 m depth and was dry to its base. Trial pit TP2 encountered a seepage of water, which stood at 0.73 m depth. This elevation is at the very base of the gravelly made ground, and the trial pit was 0.80 m deep in total.

The existing foundations were found to be at a depth of 0.65m and 0.75m below existing basement level (in trial holes TP 1 and TP2 respectively)

3.2 Adjacent Structures

The property is a terrace house. The adjacent houses are of similar construction. The adjacent building (and all other buildings within the immediate area) are Category 6 structures in accordance with table B.1 of BS ISO 4866:2010 which would be described

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

as having a medium resistance to vibration and therefore would require little or no protection against vibration for the type of works proposed. It is noted that:

- The basement construction will not be lower than the prevailing groundwater level in this area so will not interfere with the natural flow of the groundwater.
- The building will be formed off of stiff London Clay, which has a significant bearing capacity, and the foundations will be designed to reflect the recommended permissible pressures and ensure they will not be compressed by more than 15mm
- Removal of the existing construction will, ultimately generate little or no relief and consequent heave in the London Clay that underlies the band of Made Ground.
- The boundary walls on four sides can be retained safely and easily following industry-standard practices and, by following a pre-determined sequence will allow the basement wall to be constructed without detriment to the existing, surrounding construction.
- Excavations for the pins that will form the new basement walls can be undertaken using small excavators, which will be low-impact technique and unlikely to generate excessive vibration.

Adopting a controlled and sequenced work process will limit any damage to surrounding buildings to between Category 1 and 2 on The Burland Scale, Hairline or Very Slight cracks, easily repaired with filling & decoration.

The existing foundations of the adjacent property are expected to be stepped brick on a concrete strip footing also. The adjacent properties do not presently have basements.

3.3 Groundwater Conditions

During the ground investigation ground water was found to be at a depth of 0.73m below existing basement level (in Trial Hole No. 2) and at 1.8m below basement level during the window sampling. As the existing ground is clay the ground water is most likely perched on the clay layer.

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

3.4 Surface Water Features

No culvert, rivers and or other water bodies are known within the immediate vicinity of the site.

4.0 Stage 1 - Screening

The London Borough of Camden guidance suggests that any development proposal that includes a subterranean basement should be screened to determine whether or not a full BIA is required.

The following screening is based on a series of questions as set out in the Camden Planning Guidance - Basement & Light Wells (CPG 4).

4.1 Ground Water Flow:

Question 1a: Is the site located directly above an aquifer?

No. The geological map and the nearest off-site boreholes indicate that a layer of permeable superficial deposits is not present beneath the site. Local boreholes and the site borehole show clayey made ground, over London Clay. None of these can be considered an aquifer. Beneath made ground a considerable thickness of London Clay isolates the deeper aquifer units of the London Basin aquifer from the surface.

Question 1b: Will the proposed basement extend beneath the water table surface?

No. Only one out of several local boreholes identified a groundwater seepage at 12.1m below ground level. A 0.8 m trial pit (TP2) at 3 Belsize Crescent did encounter a seepage of water at the base of gravelly made ground, but a 2 m deep borehole at the site did not encounter any water.

It is typical of some boreholes in the London Clay to exhibit seepages of water from horizons above low permeability bands; others remain dry to depth. These are not instances of intercepting water tables, just pockets of water moving through the upper horizons. This is likely to be the case with the water encountered in the single local borehole, TQ28SE2336, about 500 m from the site.

The water detected in TP2 was inside the existing foundations of the property, and it seems probable that the water is not groundwater, but leakage from the property or an adjacent property. Despite there being shallower foundations in TP1 and WS1 there was no water detected: if there was a local perched water table in the made ground it should have been expected to have flowed in below the foundation here.

Hence it is considered that, in the event of water being encountered by the excavation, inflows will be low, but it may need a little dewatering. Waterproofing of the basement may be required for property protection purposes. However when the basement is constructed these flows are not expected to be sufficient to lead to any change in the groundwater flow patterns beneath or around the site.

Question 2: Is the site within 100m of a watercourse, well (used/disused) or potential spring line?

No. There are no surface water bodies within 100 m of the site. The site lies about 200m east of a former tributary of the former River Tyburn. There are no known water wells within 100 m of the site.

Geological conditions indicate that there is no potential for development of a spring line near the property, as the 1:50 000 geology map indicates that it is located on London Clay outcrop (Claygate Beds crop out about 130 m to the north west, and 8 m higher in elevation), and there are no superficial deposits nearby.

Question 3: Will the proposed basement development result in a change in the proportion of hard surfaced / paved external areas?

No. The development will be beneath the current footprint of the property, so surface water flows will be unchanged.

Question 4: As part of the site drainage, will more surface water (e.g. rainfall and runoff) than at present be discharged to the ground (e.g. via soakaways and/or SUDS)?

No. Discharge to the ground is not proposed.

Question 5: Is the lowest point of the proposed excavation (allowing for any drainage and foundation space under the basement floor) close to or lower than, the mean water level in any local pond (not just the pond chains on Hampstead Heath)?

No. The nearest surface water body is the Hampstead No. 1 Pond, about 970 m to the north east of the site. Whilst the elevation of the pond is about the same as that of 3 Belsize Crescent there is a ridge feature between them that rises to about 80 m AOD.

The above assessment has identified that there are no potential issues that need to be assessed

4.2 Slope Stability:

Question 1: Does the existing site include slopes, natural or manmade, greater than 7 degrees? (Approximately 1 in 8)

No. The existing ground level falls across the site at approximately 1 in 16

Question 2: Will the proposed re-profiling of landscaping at site change slopes at the property boundary to more than 7 degrees? (Approximately 1 in 8)

No.

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

Question 3: Does the development neighbour land, including railway cuttings and the like, with a slope greater than 7degs? (Approximately 1 in 8)

No.

Question 4: Is the site within a wider hillside setting in which the general slope is greater than 7degrees? (Approximately 1 in 8)

No.

Question 5: Is the London Clay the shallowest strata at the site?

Yes. The existing basement is within the existing London Clay layer.

Question 6: Will any tree/s be felled as part of the proposed development and/or are any works proposed within any tree protection zones where trees are to be retained?

No. There are no trees on the site.

Question 7: Is there a history of seasonal shrink-swell subsidence in the local area, and/or evidence of such effects at the site?

No. We have no evidence indicating any possible shrink-swell subsidence in the local area.

Question 8: Is the site within 100m of a watercourse or a potential spring line?

No. There is no known watercourse, spring or well within 100 m of the site.

Question 9: Is the site within an area of previously worked ground?

Yes. This is an existing basement, to be extended downwards further into the London Clay

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

Question 10: Is the site within an aquifer? If so, will the proposed basement extend beneath the water table such that dewatering may be required during construction?

No. The site is not within an aquifer.

Question 11: Is the site within 50m of the Hampstead Heath Ponds?

No. No the site is approx. 920m from the nearest pond in Hampstead Heath.

Question 12: Is the site within 5m of a highway or pedestrian right of way?

Yes. The front wall of the basement is on the same line of the edge of the footpath on Belsize Crescent

Question 13: Will the proposed basement significantly increase the differential depth of foundations relative to the neighboring properties

Yes. The depth to the new foundations will be increased by approximately 1.0m to that of the surrounding buildings, underpinning will be carried out as required.

Question 14: Is the site over (or within the exclusion zone of) any tunnels, e.g. railway lines?

No. There are no railway networks in close proximity of the property.

The above assessment has identified the following issues to be assessed:

Question 12 The existing property fronts directly on to Belsize Crescent the existing basement is fully within the site. This existing arrangement will remain unchanged. The new works will have no impact on the right of way on the public road or foot path.

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

Question 13 By lowering the existing basement slab by approximately 1.0m will mean that the new foundations will be lowered by the same amount relative to the surrounding buildings. Any potential impact on the foundations of the surrounding buildings will be address at design stage and underpinning will be carried out where necessary.

4.3 Surface Flow & Flooding:

Question 1: Is the site within the catchment area of the pond chains on Hampstead Heath?

No. The site is not located within the catchment area as shown on Figure 14 of the Camden Geological, Hydrogeological and Hydrological Study. The site is approximately 1km from Hampstead Heath.

Question 2: As part of the site drainage, will surface water flows (e.g. volume of rainfall and peak run off) be materially changed from the existing route?

No. The current proposal is to re-use the existing connections to the Thames Water combined public sewer located in Belsize Crescent.

Question 3: Will the proposed basement development result in a change in the proportion of hard surfaced / paved areas?

No. The proposed development will not increase the impermeable area post-development. The site is at present 100% hard standing and will remain so post development

Question 4: Will the proposed basement result in changes to the profile of the inflows (instantaneous and long term) of surface water being received by adjacent properties or downstream.

No. The proposed development is deemed not to affect the profile of inflows to adjacent properties.

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

Question 5: Will the proposed basement result in changes to the quality of surface water being received by adjacent properties or downstream water courses?

No. The proposed basement will not result in any changes to the quality of surface water being received by adjacent properties or downstream watercourses.


Question 6: Is the site in an area known to be at risk from surface water flooding such as South Hampstead, West Hampstead, Gospel Oak and Kings Cross, or is it at risk from flooding, for example because the basement is below the static water level of a nearby surface water feature?

Yes. Perched water table discovered in ground investigation, see Chapter 3 for details.
Developer is required undertake a Flood Risk Assessment in accordance with the NPPF.

The above assessment has identified that there are potential issues, which has triggered the requirement for a Flood Risk Assessment. A detailed Flood Risk Assessment was undertaken by Water Environment Ltd in October 2016 in accordance with the NPPF. This assessment concludes that, with recommended mitigation measures, the proposed development is not at significant risk of flooding from any source.

Nothing further occurs.

Sincerely,

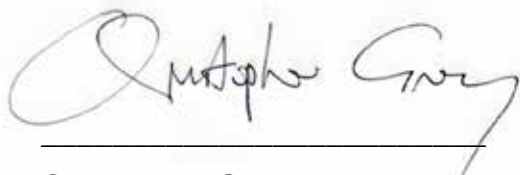

Christopher Grey

cgrey@conceptconsultancy.eu

Chartered Engineer for and on behalf of

Concept Consultancy Structural Designers Ltd.

+44 (0)7955 919824 UK & +353(0)86 8235150 IRE


Office: 020 7625 6106

Web: www.ConceptConsultancy.eu

Mobile: 07955 919824 UK 086 8235150 Ireland

.....3 Knoll House, 77 Carlton Hill, London, NW8 9XD


APPENDIX A – Proposed Underpinning Sequence

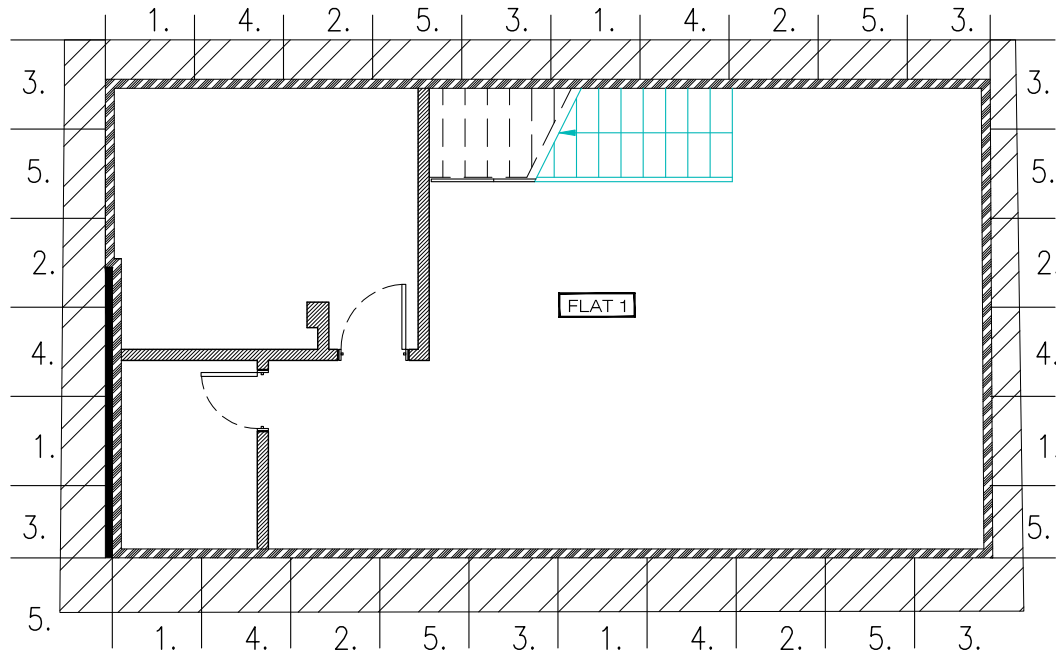

PROPOSED BASEMENT UNDERPINNING SEQUENCE PLAN

Concept Consultancy

Chartered Civil & Structural Consulting Engineers

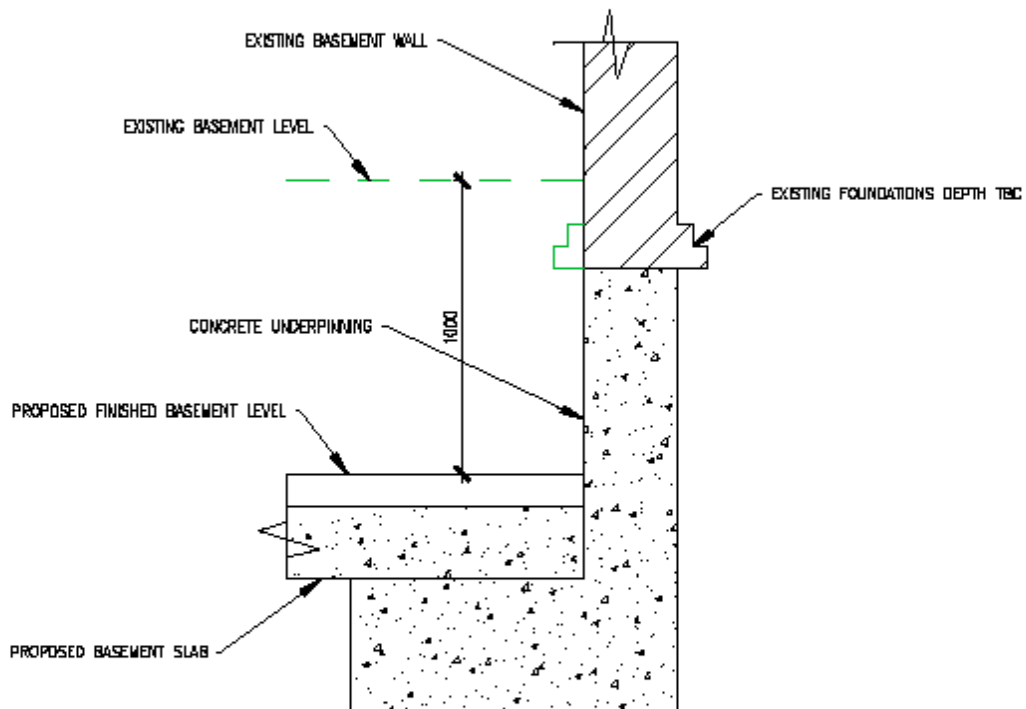

DETAIL 1

Underpinning Sequence of works:

1. Underpinning to be carried out in the sequence shown, in bays 1000mm width max.
2. Bays with the same number to be excavated simultaneously with concreting carried out immediately after exposure to avoid deterioration.
3. Excavate out by hand all bays No. 1 to the depth & width specified. Ensure that ground is level, clean and rammed if necessary. Should any ground water be encountered this may be pumped out.
4. Dowel bars to be inserted into surrounding ground on both sides as required to provide a key for the adjoining base section.
5. Pour concrete to 75mm of underside of existing wall.
6. The day after concreting fill the 75mm gap with dry pack mortar and backfill excavation.
7. Excavation of bays No. 2 of underpinning shall not be commenced until at least 48 hours after previous bay has been dry packed.
8. Continue remaining bays as per above until all underpinning is complete.
9. Once complete excavation to lower existing basement level.
10. Installation of new concrete basement floor.