


Scale 1:10@A1

of Typical external wall

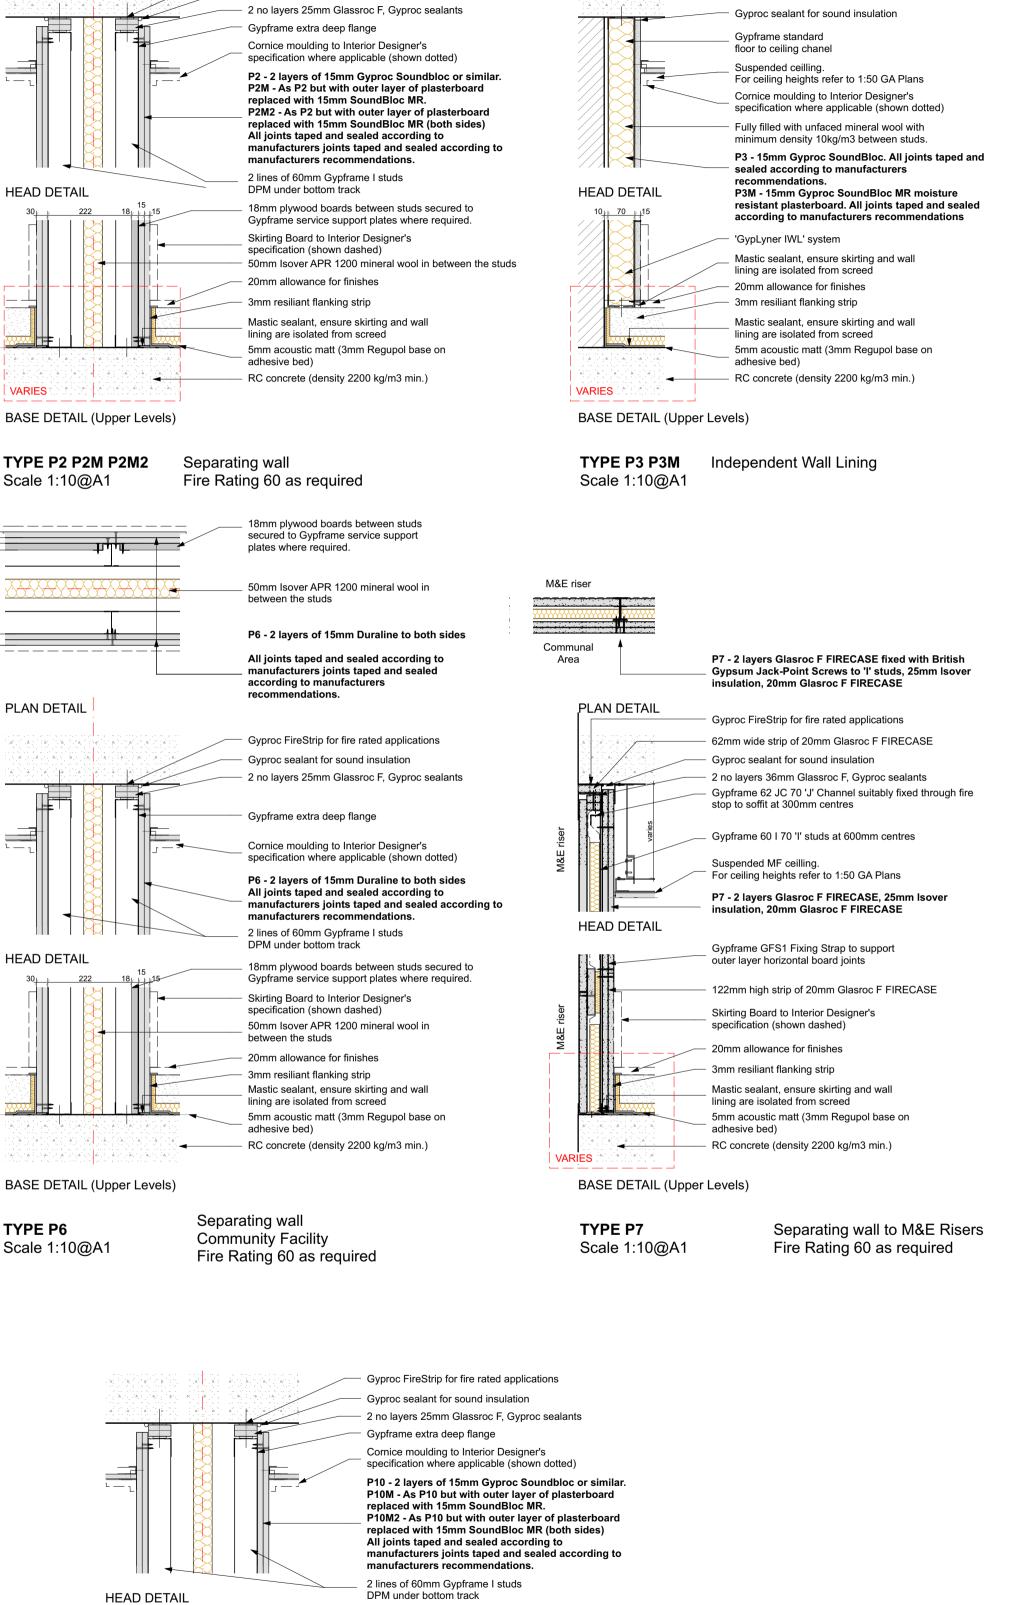

18mm plywood boards between studs secured to

50mm Isover APR 1200 mineral wool in between the studs

Gypframe service support plates where required.

Skirting Board to Interior Designer's

Mastic sealant, ensure skirting and wall

RC concrete (density 2200 kg/m3 min.)

5mm acoustic matt (3mm Regupol base on

specification (shown dashed)

20mm allowance for finishes

3mm resiliant flanking strip

lining are isolated from screed

adhesive bed)

Fire Rating 60 as required

BASE DETAIL (Upper Levels)

TYPE P10 P10M P10M2 Separating wall (Pavilions)

18mm plywood boards between studs

secured to Gypframe service support

50mm Isover APR 1200 mineral wool in

replaced with 15mm SoundBloc MR.

manufacturers recommendations.

Gyproc sealant for sound insulation

All joints taped and sealed according to

Gyproc FireStrip for fire rated applications

P2 - 2 layers of 15mm Gyproc Soundbloc or similar.

P2M - As P2 but with outer layer of plasterboard

P2M2 - As P2 but with outer layer of plasterboard

replaced with 15mm SoundBloc MR (both sides)

manufacturers joints taped and sealed according to

plates where required.

between the studs

adhesive dabs

PLAN DETAIL

Skirtings shown dotted

GypLyner IWL' system

PLAN DETAIL

sealed according to manufacturers

P3 - 15mm Gyproc Wallboard, All joints taped and

P3M - 15mm Gyproc MR moisture resistant


according to manufacturers recommendation

plasterboard. All joints taped and sealed

Fully filled with unfaced mineral wool with

- RC concrete (density 2200 kg/m3 min.)

minimum density 10kg/m3 between studs.

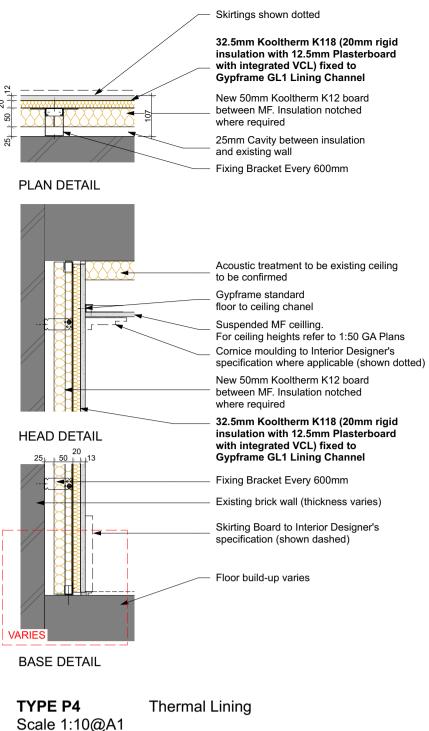

Skirtings shown dotted P8 - 15mm Gyproc Wallboard. All joints taped and sealed according to manufacturers P8M - 15mm Gyproc MR moisture resistant plasterboard. All joints taped and sealed according to manufacturers recommendatio Fully filled with unfaced mineral wool with minimum density 10kg/m3 between studs. GypLyner IWL' system 10mm cavity wall membrane PLAN DETAIL RC concrete (density 2200 kg/m3 min.) Gyproc sealant for sound insulation Gypframe standard floor to ceiling chane Suspended ceilling. For ceiling heights refer to 1:50 GA Plans Cornice moulding to Interior Designer's specification where applicable (shown dotted) Fully filled with unfaced mineral wool with ninimum density 10kg/m3 between studs P8 - 15mm Gyproc SoundBloc. All joints taped and sealed according to manufacturers P8M - 15mm Gyproc SoundBloc MR moisture **HEAD DETAIL** resistant plasterboard. All joints taped and sealed according to manufacturers recommendations 10mm cavity wall membrane 'GypLyner IWL' system Mastic sealant, ensure skirting and wall lining are isolated from screed 20mm allowance for finishes 3mm resiliant flanking strip Insulation 20mm cavity floor membrane

Scale 1:10@A1

Type P45M - As type P45 but with outer layer replaced by 12.5mm RC concrete (density 2200 kg/m3 min.) British Gypsum, nom. 11-12mm BASE DETAIL

TYPE P8 P8M Independent Wall Lining Type P48. Plaster Repair to existing Walls.

with Cavity Drain

Type P45 - Typical Lining to RC, blockwork columns, walls -12.5mm Gyproc SoundBloc on dabs. All joints to be taped and jointed, giving a smooth and seamless finish ready for decoration.

SoundBloc MR Board on dabs. All joints to be taped and jointed, giving a smooth and seamless finish ready for decoration. Type P46. Plaster to Leisure Area (not to pool). Thistle HardWall by

Type P47. Tiling to pool Area. Microtec Fibre reinforced floor adhesive (Ardex X 77) or similar. Thickness varies depending on tile

types (to pool specialist's specification)

Type P49. Lime Plaster repair to existing Walls.

Type P50. Typical Sacrificial Wall - Gyplyner GL1 with offset of 35mm at 600mm centres (GL2 fixing brackets) with 2 layerw of 12.5mm British Gypsum wallboard. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

**Type P50M.** As type P50 but with the outer layer of Plasterboard replaced with Gyproc Moisture Resistant plasterboard to 'wet' area. General Notes:

 All types noted below are based on the British Gypsum range. 'Similar and approved' products will be considered by the client. Any alterations to the specifications below are to be approved by the client PRIOR to order.

2. Drylining drawings are to be read in conjunction with all relevant AQP GA and M&E consultant drawings.

3. Moisture resistant plasterboard is to be used in all wet areas (Kitchens, Bathrooms, En-suites and Utility Cupboards), Areas requiring moisture resistant board are identified with the 'M' prefix in the partition type. Tiled surfaces: MR Plasterboard to be replaced with 12.5mm Glasroc H Tilebacker boards.

4. 18mm WBP plywood support patresses on proprietary service plates are to be provided in the following areas:

ii.Bathrooms (A band between 300-1800mm) iii.Living Rooms (1500mm(wide) x 1035mm(high) behind wall mounted TVpositions, exact locations to be agreed with client).

5. Additional noggings/supports etc are to be provided as necessary for radiators, kitchen units, wall mounted TVs, shower mixers & diverters etc.

6.Deflection head details are indicated at partition heads giving min. vertical deflection allowance of 25mm. Extra deep flange channels and packing to be provided in accordance with manufacturers standard detail.

7.All necessary beads etc. to be provided.

## General Internal Suspended Ceiling:

British Gypsum Casoline MF ceiling system finished with 1 no. 12.5mm Wallboard in 'dry areas' and 12.5mm moisture resistant wallboard in 'wet areas'. Gypframe MF8 strap hangers to be fixed to u/s of concrete soffit with Gypframe M12 soffit cleats. Proprietary primary and secondary support grids to be provided at centres in accordance with manufacturers standard details. All perimeter channels etc. to be provided in accordance with manufacturers standard details. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

**External and Separating Wall Lining Types:** 

Type P1. Metsec Wall - 2 no. layer of 15mm British Gypsum Soundbloc on Vapour Control layer. All joints to be taped and jointed, giving a smooth and seamless finish ready for decoration

Type P1M. As type P1, but with outer layer replaced with 15mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side). Type P2. Separating Wall - 2 no. layer of 15mm British Gypsum

Soundbloc or similar to each side. All joints to be taped and jointed, giving a smooth and seamless finish ready for decoration.

Type P2M. As type P2, but with outer layer replaced with 15mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side only). Type P2M2. As type P2, but with outer layer replaced with 15mm

Gyproc Soundbloc Moisture Resistant plasterboard (each side) Type P3. Independant Wall Lining - Gyplyner IWL at 600mm centres with 1 layer of 15mm British Gypsum Gyproc SoundBloc. Fully filled with unfaced mineralwool with min. density 10kg/m3 between studs.

All joints to be taped and jointed, giving a smooth and seamless

finish, ready for decoration

Type P3M. As type P3, but with outer layer replaced with 15mm Gyproc SounBloc Moisture Resistant plasterboard ('wet' side).

Type P4. Thermal Lining to existing walls - Gyplyner GL1 at 600mm centres (offset 75mm) (packed with 50mm Kooltherm K12 board insulation notched where required) with 32.5mm Kooltherm K118 (20mm rigid insulation with 12.5mm Plasterboard with integrated VCL). All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration

Type P5 & P5M. SVP Boxing. 2 no. layers 15mm SoundBloc plasterboard, on 60mm Gypframe studwork generally to svp casings. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration. Pipework to be wrapped in 50mm unfaced mineral wool. NB. 15mm Moisture Resistant Soundblock MR to replace outer layer of boxing in 'Wet' areas (Bathrooms, WCs, Utility Cupboards, Kitchens, etc), Boxings to be fully filled with insulation when adjoining solid party walls.

Type P6. Separating Wall (Community Facility) - 2 no. layer of 15mm British Gypsum Duraline (both sides). All joints to be taped and jointed, giving a smooth and seamless finish ready for decoration

Type P7. Separating Wall (M&E Risers) 60 minuts - 2 layers Glasroc

F FIRECASE, 25mm Isover insulation, 20mm Glasroc F FIRECASE

on Gypframe 60 I 70 'I' studs at 600mm centres. All joints to be taped and jointed, giving a smooth and seamless finish ready for Type P8. Thermal Independent Wall Lining - Drained cavity wall -

Gyplyner IWL at 600mm centres with 1 layer of 15mm British Gypsum Gyproc Wallboard on 92 I studs. Fully filled with unfaced mineralwool. Density 10kg/m3 between studs, cavityAll joints to be taped and jointed, giving a smooth and seamless finish, ready for

Type P8M. As type P8, but with outer layer replaced with 15mm Gyproc Wallboard Moisture Resistant plasterboard ('wet' side).

Type P9. Load-bearing studwork - 2 no. layer of 15mm British Gypsum Soundbloc on Vapour Control layer. All joints to be taped and jointed, giving a smooth and seamless finish ready for

Type P9M. As type P9, but with outer layer replaced with 15mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side).

Type P10. Separating Wall - 2 no. layer of 15mm British Gypsum Soundbloc or similar to each side. All joints to be taped and jointed,

giving a smooth and seamless finish ready for decoration Type P10M. As type P2, but with outer layer replaced with 15mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side only).

Type P10M2. As type P2, but with outer layer replaced with 15mm Gyproc Soundbloc Moisture Resistant plasterboard (each side) Internal Partitions:

Type P20. Internal Partition width 100mm. 70mm Gypframe 'C' studs at max. 600mm centres with 1 layer of 12.5mm British Gypsum Gyproc SoundBLoc to each side. All joints to be taped and jointed giving a smooth and seamless finish, ready for decoration.

studs at max, 600mm centres with 12.5mm Gyproc SoundBloc to one side and 1 layer of 12.5mm Gyproc SoundBloc MR to 'wet area' side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

Type P20M. Internal Partiton width 100mm. 70mm Gypframe 'C'

Type P20M2. Internal Partiton width 100mm. 70mm Gypframe 'C' studs at 600mm centres work with 1 layer of 12.5mm Gypro SoundBloc MR plasterboard to each side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

Type P21. Internal Partition width 155mm. 92mm Gypframe 'C' studs at max. 600mm centres with 1 layer of 12.5mm British Gypsum Gyproc SoundBLoc on 18mm Plywood to each side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for

Type P21M. As type P21, but with outer layer replaced with 12.5mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side).

**Type P21M2**. As type P21, but with outer layer replaced with 12.5mm Gyproc Soundbloc Moisture Resistant plasterboard (each

Type P22. Timber stud braced wall. 100mm timber studs at 600mm centres work with1 layer of 18mm Plywood to each side and 1 layer of 12.5mm Gyproc SoundBloc plasterboard to each side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for

Type P22M.As type P22, but with outer layer replaced with 12.5mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side). Type P23. Timber stud braced wall. 140mm timber studs at 600mm centres work with1 layer of 18mm Plywood to each side and 1 layer of 12.5mm Gyproc SoundBloc plasterboard to each side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for

**Type P23M**. As type P23, but with outer layer replaced with 12.5mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side). Type P24. Internal Partition width 122mm. 70mm Gypframe 'C' studs. at max. 600mm centres with 2 layer of 12.5mm British Gypsum Gyproc SoundBLoc to each side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

Type P24M As type P24, but with outer layer replaced with 12.5mm Gyproc Soundbloc Moisture Resistant plasterboard ('wet' side).

Internal Linings & Boxing Types: Type P40. Typical Boxing and False Wall - 70mm Gypframe 'C' studs at max. 600mm centres with 1 layer of 12.5mm British Gypsum

Wallboard to one side. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

**Type P40M.** As type P40 but with the layer of Plasterboard replaced

with Gyproc Moisture Resistant plasterboard to 'wet' area. Type P41. Typical Sacrificial Wall - Gyplyner GL1 with offset of 35mm at 600mm centres (GL2 fixing brackets) with 1 layer of

12.5mm British Gypsum wallboard. All joints to be taped and jointed,

giving a smooth and seamless finish, ready for decoration.

giving a smooth and seamless finish, ready for decoration.

Type P41M. As type P41 but with the layer of Plasterboard replaced with Gyproc Moisture Resistant plasterboard to 'wet' area.

Type P42. Typical Sacrificial Wall - Gyplyner GL1 with offset of 75mm at 600mm centres (GL2 fixing brackets) with 1 layer of 12.5mm British Gypsum wallboard. All joints to be taped and jointed,

**Type P42M.** As type P42 but with the layer of Plasterboard replaced with Gyproc Moisture Resistant plasterboard to 'wet' area.

Type P43. Typical Sacrificial Wall - Gyplyner GL1 with offset of 125mm at 600mm centres (GL9 fixing brackets) with 1 layer of 12.5mm British Gypsum wallboard. All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

Type P43M. As type P43 but with the layer of Plasterboard replaced with Gyproc Moisture Resistant plasterboard to 'wet' area. Type P44. Typical Lining to brick walls - 1 layer of 12.5mm British

Gypsum wallboard on 10mm adhesive dabs on 8mm parge coat (Gyproc Soundcoat Plus). All joints to be taped and jointed, giving a smooth and seamless finish, ready for decoration.

**Type P44M.** As type P44 but with the layer of Plasterboard replaced with Gyproc Moisture Resistant plasterboard to 'wet' area.

DIMENSION AT ORIGINAL SHEET SIZE ractors must check all dimensions on site. Only figured dimensions are to be worked from Discrepancies must be reported to the Architect before proceeding. This drawing is Copyright KEY PLAN

NOTE

Floor build-ups may vary depending on the location. Basement and Ground Floor accommodation will have different floor build-up which derives from the u-value and waterproofing requirements. For floor build-ups refer to the drawing: 9000-DRG-11GN-DE001

Putty Pads for electrical sockets / radiator pipe drop detail within Party wall

Mimber studs to door opening within partitions.

For access panel detail refer to British Gypsum Standard ceiling Gyproc

FOR TENDER

REVISION CH'KD DATE TW Drawing Detail of wall P8/P8M, P9/P9M and P10/P10M added. P-numbers list altered



MOUNT ANVIL LTD



KIDDERPORE AVENUE

Generally Applicable Dry Lining Details 1

SCALE 1:10 @ A1 DATE September 2016 DRAWING No. **DRAWN BY** 15 230

9000-DRG-00GN-DE030 A&Q PARTNERSHIP (LONDON) LTD THE LUX BUILDING, 2-4 HOXTON SQUARE, LONDON N 1 6 NU Tel: 020 7613 2244 Fax: 020 7613 2642 Email:london@aqp.co.uk

ARCHITECTURE DESIGN MASTERPLANNING INTERIORS