

General Notes:

<u>Radiator Schedule</u>							
Reference No.	Casing Length (mm)	Casing Height (mm)	Output (W)	Manufacturer/Comme			
RO	560	650	358	Stelrad LST Standard			
R1	760	650	536	Stelrad LST Standard			
R2	960	650	715	Stelrad LST Standard			
R3	1160	650	894	Stelrad LST Standard			
R4	1360	650	1073	Stelrad LST Standard			
R5	1560	650	1251	Stelrad LST Standard			


<u>Radiator Schedule</u>								
Reference No.	Casing Length (mm)	Casing Height (mm)	Output (W)	Manufacturer/Comment				
R0	560	650	358	Stelrad LST Standard				
R1	760	650	536	Stelrad LST Standard				
R2	960	650	715	Stelrad LST Standard				
R3	1160	650	894	Stelrad LST Standard				
R4	1360	650	1073	Stelrad LST Standard				
R5	1560	650	1251	Stelrad LST Standard				

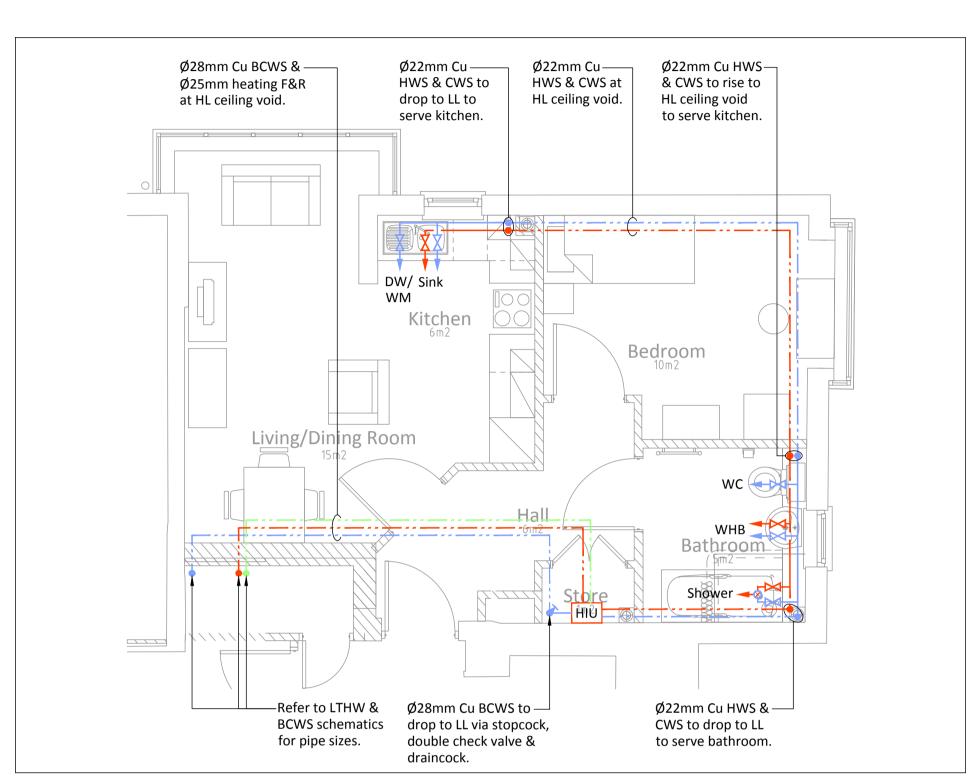


Water Layout

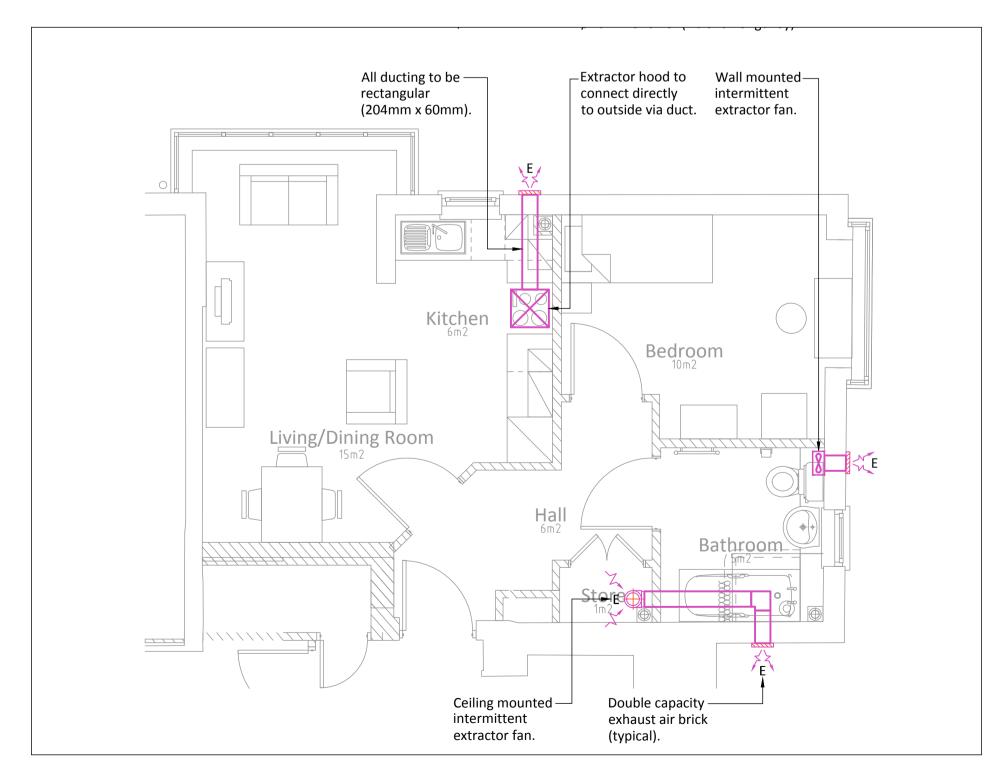

Ventilation Layout

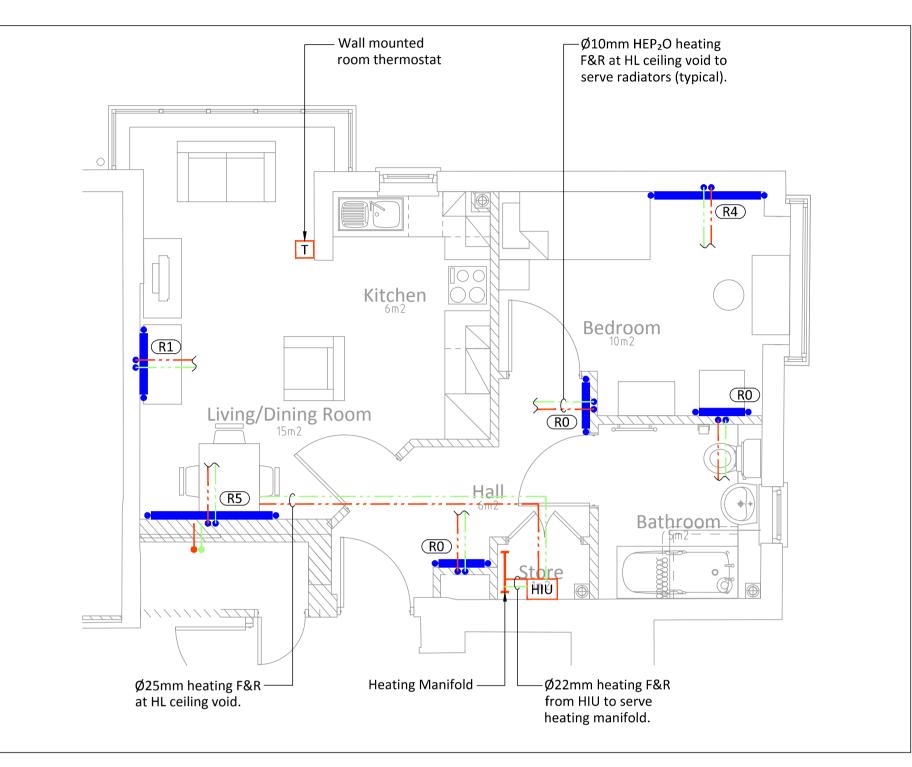

**Heating Layout** 

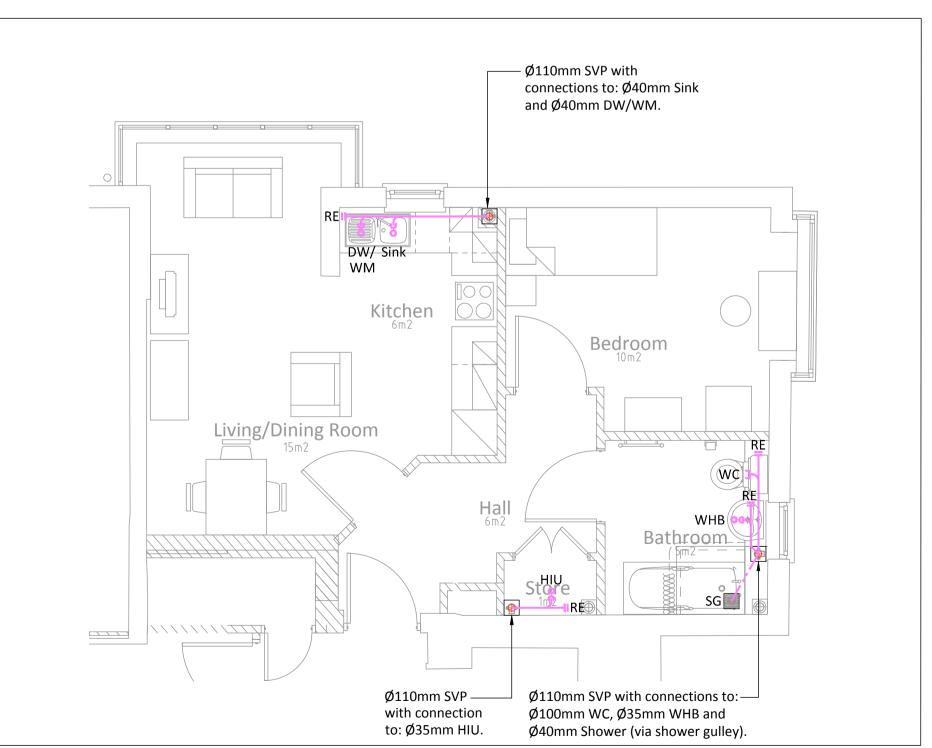

**Drainage Layout** 

Legend: Water Outlet **→**▶**◇**• Basin / Sink Taps 

**├**──**|**RE Rodding Eye

**Boost Switch** 

Supply / Extract Air Brick

Wall Mounted Extract Grille

Supply / Extract Grille

BS

 $\infty$ 

Pipework Line Types:

------ Low Level

CWS Cold Water Supply

Abbreviations:

FA From Above

FB From Below

F&R Flow and Return

**— — —** Below Ground

— – – Within Service Void

3) Please refer to the final kitchen, bathroom and furniture Thermostatic Mixer Outlet 4) Noisy items of equipment (such as pumps) not to be installed next to bedrooms, nor be fixed to plasterboard **Room Thermostat** 

5) Avoid crossovers of HWS & CWS and ventilation SVP / SS

distribution. 6) Penetrations through fire seals to be reinstated.

#### **Ventilation Notes:** Radiator / Towel Rail

1) Intermittent extractor fans to be installed in all kitchens, bathrooms and store cupboards. 2) Ventilation rates as per latest building regulations Part F.

and all other contract drawings.

Waste Trap 3) Toilet, bathroom and shower extract fans shall be timer controlled and shall be activated by the light switch. FS Fire Sleeve 4) Kitchen extractor hood to be manually controlled.

5) Extractor fans located in HIU cupboards to be activated Supply / Extract Duct via temperature sensor.

6) All exposed ducting to be boxed in. 7) Extractor hood to be located at all cooker hobs.

8) For wet room / utility rooms, all doors are to be undercut.

**HWS & CWS Notes:** 

1) All draw off points to be fitted with ball type service valve.

1) All dimensions in millimeters unless otherwise stated.

2) This drawings to be read in conjunction with specification

washing machine points & on all bath/shower mixers.

3) Thermostatic valves to be fitted to baths/showers.

2) Double check valves to be installed on dishwasher &

### 4) HWS & CWS to be in non metal plumbing supplies will be subject to the employers approval.

**Drainage Notes:** 1) All exposed SVPs shall be located within boxing with access or rodding points which shall be accessible by

# means of removable panel securely fixed.

**Heating Notes:** 

## to manifold. 2) All radiators to be fitted with Danfoss, Grundfos or

HL High Level 3) Thermostatic valves shall be fitted to all radiators, except in the room where the room thermostat is located. **HWS Hot Water Supply** 

LL Low Level

SV Service Void

TA To Above

TB To Below

1) Wall mounted heating controllers to be hardwired back

Honeywell, or similar approved thermostatic valves.

4) The heating system must be fully flushed in the presence of the employer in accordance with BSRIA AG 2001/1.

5) All radiators are to be LSTs and from an approved manufacturer.

6) Programmer and thermostat to be positioned at an accessible height for wheelchair users.

7) Electric LST chrome towel warmer to be installed in all bathrooms and WCs.

## Pipework Notes:

1) Heating & plumbing pipes are as far as practicable to be routed in such a way to enable easy access for maintenance.

2) Exposed pipework in rooms (other than cupboards/stores) to be avoided. Up-right connections to heating to radiators from floors are acceptable. All vertical heating drops (other than in cupboards/stores) appropriate ducts complete with approved access point.

3) Route of pipes underfloor boarding shall be marked on the boarding.

4) All connections to dwellings to be Ø28mm CWS and Ø25mm heating F&R, unless otherwise stated. Please refer to LTHW and BCWS schematics for pipe sizes.

5) All pipework, valves, fittings etc to be insulated as per specification. 6) Where possible, pipework drops from ceiling void should

be next to SVP.

7) All exposed pipework to be boxed in.

PRELIMINARY REV DESCRIPTION calfordseaden

Project No:

K160624



Flat Type 05 Mechanical Services Layout

Drawn By Checked By 1:50@A1 28.10.16

St John's House 1a Knoll Rise Orpington Kent BR6 0JX 01689 888222 orpington@calfordseaden.co.uk calfordseaden LLP is a Limited Liability Partnership Registered in England & Wales number OC315838

ORPINGTON | LONDON | BIRMINGHAM | SOUTHEND-ON-SEA | WINCHESTER

calfordseaden.co.uk

Drawing No:

M(0)204