


DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS TO BE VERIFIED BY THE CONTRACTOR ON SITE


<u>Radiator Schedule</u>				
Reference No.	Casing Length (mm)	Casing Height (mm)	Output (W)	Manufacturer/Comments
RO	560	650	358	Stelrad LST Standard
R1	760	650	536	Stelrad LST Standard
R2	960	650	715	Stelrad LST Standard
R3	1160	650	894	Stelrad LST Standard
R4	1360	650	1073	Stelrad LST Standard
DE	1560	CEO.	1251	Ctalrad LCT Ctandard

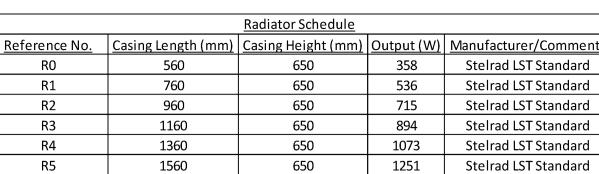

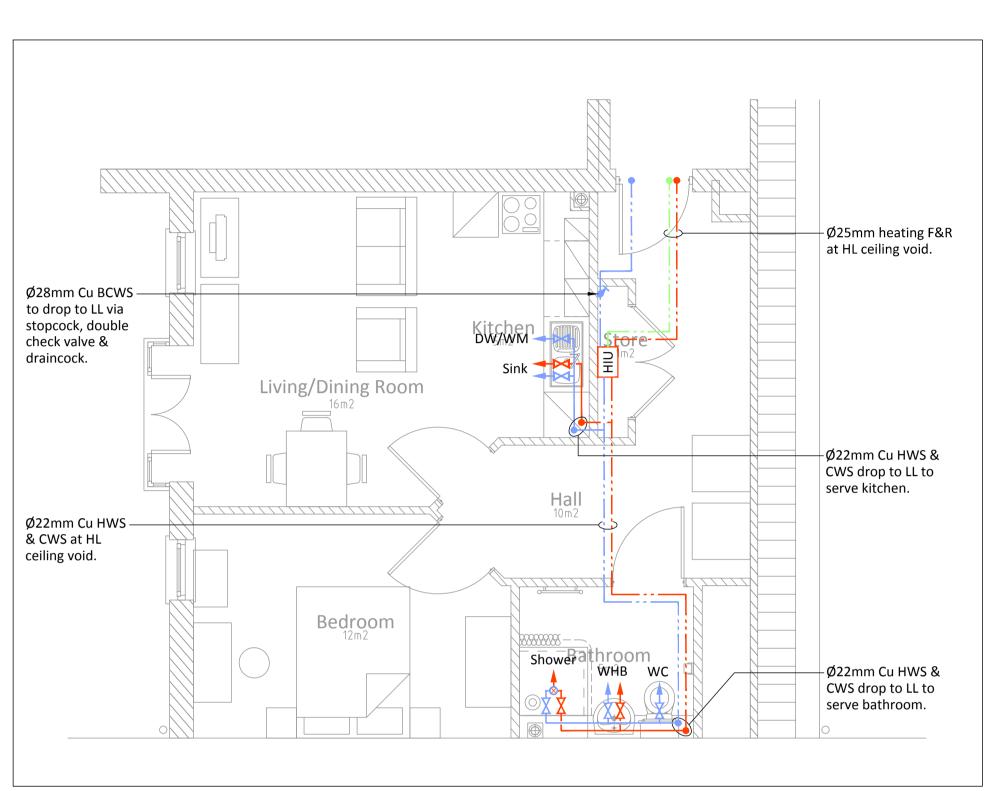

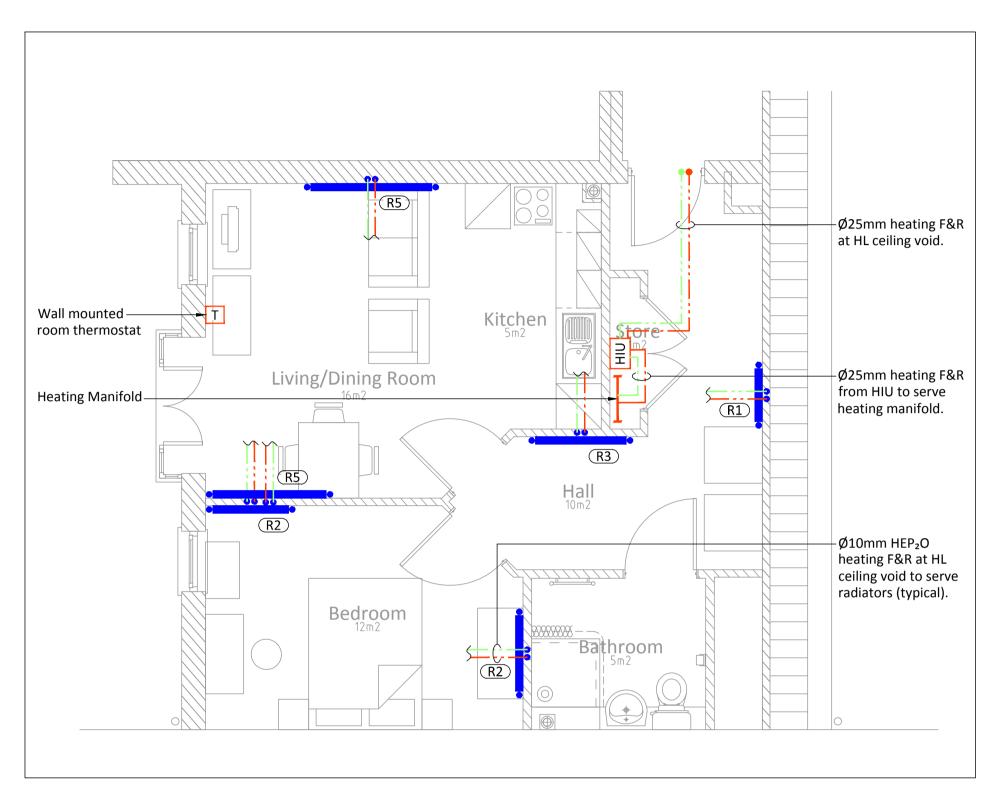


Water Layout

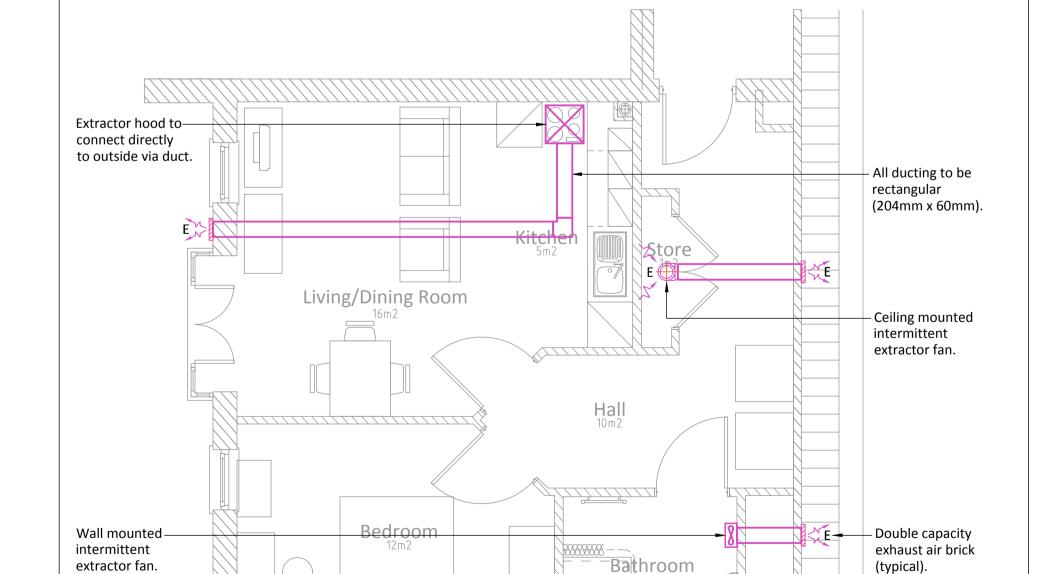

Ventilation Layout

Heating Layout

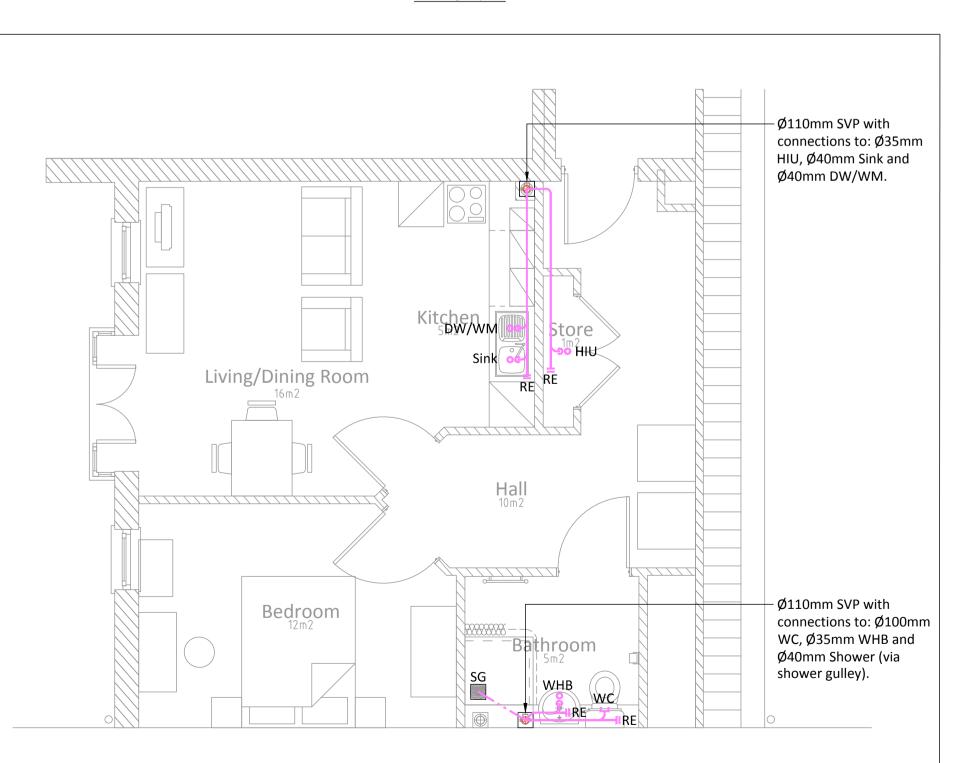

Drainage Layout

General Notes:

1) All dimensions in millimeters unless otherwise stated. 2) This drawings to be read in conjunction with specification

and all other contract drawings. 3) Please refer to the final kitchen, bathroom and furniture

4) Noisy items of equipment (such as pumps) not to be installed next to bedrooms, nor be fixed to plasterboard

5) Avoid crossovers of HWS & CWS and ventilation

distribution. 6) Penetrations through fire seals to be reinstated.

Ventilation Notes: Radiator / Towel Rail

1) Intermittent extractor fans to be installed in all kitchens, bathrooms and store cupboards.

> 2) Ventilation rates as per latest building regulations Part F. 3) Toilet, bathroom and shower extract fans shall be timer

controlled and shall be activated by the light switch. 4) Kitchen extractor hood to be manually controlled.

5) Extractor fans located in HIU cupboards to be activated via temperature sensor.

6) All exposed ducting to be boxed in.

7) Extractor hood to be located at all cooker hobs. 8) For wet room / utility rooms, all doors are to be undercut.

1) All draw off points to be fitted with ball type service valve.

washing machine points & on all bath/shower mixers.

3) Thermostatic valves to be fitted to baths/showers. 4) HWS & CWS to be in non metal plumbing supplies will be

2) Double check valves to be installed on dishwasher &

subject to the employers approval.

HWS & CWS Notes:

1) All exposed SVPs shall be located within boxing with access or rodding points which shall be accessible by means of removable panel securely fixed.

Heating Notes:

Drainage Notes:

1) Wall mounted heating controllers to be hardwired back

Honeywell, or similar approved thermostatic valves. 3) Thermostatic valves shall be fitted to all radiators, except

HWS Hot Water Supply

LL Low Level SV Service Void

TA To Above

Legend:

→>

Water Outlet

Basin / Sink Taps

Room Thermostat

SVP / SS

Waste Trap

Fire Sleeve

Boost Switch

Supply / Extract Duct

Supply / Extract Air Brick

Wall Mounted Extract Grille

Supply / Extract Grille

├──**|**RE Rodding Eye

FS FS

BS

8

Pipework Line Types:

------ Low Level

CWS Cold Water Supply

Abbreviations:

FA From Above

FB From Below

HL High Level

F&R Flow and Return

— — — Below Ground

— – – Within Service Void

Thermostatic Mixer Outlet

TB To Below

to manifold. 2) All radiators to be fitted with Danfoss, Grundfos or

in the room where the room thermostat is located.

4) The heating system must be fully flushed in the presence of the employer in accordance with BSRIA AG 2001/1. 5) All radiators are to be LSTs and from an approved

manufacturer.

6) Programmer and thermostat to be positioned at an accessible height for wheelchair users.

7) Electric LST chrome towel warmer to be installed in all bathrooms and WCs.

Pipework Notes:

1) Heating & plumbing pipes are as far as practicable to be routed in such a way to enable easy access for

maintenance. 2) Exposed pipework in rooms (other than cupboards/stores) to be avoided. Up-right connections to heating to radiators from floors are acceptable. All vertical heating drops (other than in cupboards/stores)

appropriate ducts complete with approved access point. 3) Route of pipes underfloor boarding shall be marked on the boarding.

4) All connections to dwellings to be Ø28mm CWS and Ø25mm heating F&R, unless otherwise stated. Please

refer to LTHW and BCWS schematics for pipe sizes. 5) All pipework, valves, fittings etc to be insulated as per specification.

6) Where possible, pipework drops from ceiling void should be next to SVP.

7) All exposed pipework to be boxed in.

PRE INIT CHKD calfordseaden



REV DESCRIPTION

Flat Type 09 Mechanical Services Layout

Drawn By Checked By Project No: 1:50@A1 28.10.16 RH K160624

St John's House 1a Knoll Rise Orpington Kent BR6 0JX 01689 888222 orpington@calfordseaden.co.uk calfordseaden LLP is a Limited Liability Partnership Registered in England & Wales number OC315838

ORPINGTON | LONDON | BIRMINGHAM | SOUTHEND-ON-SEA | WINCHESTER

calfordseaden.co.uk

M(0)208

Drawing No: Revision