

**LEGEND**  
External Finishes - The Yard - Ground Floor Level

- T1** : Granite Stone Set Paving various rotation. Lengths between 100-250mm  
Width x 100 Depth. 24% Stirling Red/Grey (availability of Stirling red TBC  
by quarry), 38% Millennium Green, 38% Sea Black 10mm joints 40mm bed
- T2** : Sea black sets. The setting-out of the sets within the  
perimeter of the fan is indicative and should be developed with the  
paving subcontractor along traditional laying techniques.  
**SEE DRAWING (90)-5003 FOR TYPICAL 'FAN' PAVING LAYOUTS TYP 1,2,3**
- T3** : Lightly Sawn and Textured Granite Sets - Source from site.  
Lengths between 100-250mm x 80-125mm Width x APPROX. 100  
Depth Sawn + Textured (Tolerance +/- 2mm). (sizes will be limited to  
available existing set sizes & numbers.)
- T5** : Rough Reclaimed Granite Sets - Source from site  
Lengths between 100-250mm x 80-125mm Width x Approx 100 Depth  
Reclaimed, cleaned + laid with no finish.  
(sizes will be limited to available existing set sizes & numbers.)
- T7** : Sea black paving zone to mark original ECD Viaduct footprint. Two rows  
border around periphery
- T8** : Tactile Granite Corduroy Paving of milled granite to match surrounding  
paving (Sea black). 800mm Length x 400mm Width x 50mm depth
- T9** : Single line of new granite sets threshold  
100x100 Width x 100 Depth. Colour to match T1.
- T9B** : Triple line of new granite sets threshold  
100x100 Width x 100 Depth. Colour to match T1.
- Slot Drain - C250
- Slot Drain - D400
- Concrete encasing for Slot Drain
- Concrete encasing for Slot Drain
- CF: Compressible filler
- MJ: Expansion joint in paving  
See Structural Engineers Details
- Fall lines shown indicatively, slopes to be  
executed with soft blends, no sets to be cut.
- SOP  
Setting out position for paving finish

Continuation on drawing (90) - 400504

DO NOT SCALE FROM THIS DRAWING.  
ALL DIMENSIONS TO BE CHECKED ON SITE.  
FOR REFERENCED VIEWS REFER TO  
SERIES OF DRAWINGS



Continuation on drawing (90) - 400403

**DO NOT SCALE FROM THIS DRAWING - ALL DIMENSIONS TO BE CHECKED ON SITE**

**NOTES:**

1. This drawing shows design intent only & is subject to detailed design specialists.
2. Tolerances are to be taken from this drawing. All contractors must visit site & are responsible for taking & checking all dimensions relating to their work. BAM Design to be advised of any variation between drawings & site conditions.
3. All vertical dimensions to be taken from FFL, please note that all manufacturing schedules are to take this into account.
4. All dimensions are in millimetres unless noted otherwise.
5. All levels in meters unless noted otherwise.

**To be read in conjunction with -**  
ARUP drawings for structural frame, openings, supports


**TO BE READ IN CONJUNCTION WITH ALL ARCH DETAILS & SPECIFICATIONS**

**NOTES:**

- General -**
- Material finishes all to approved samples
  - Areas stated are approximate for pricing exercise only and are total area of BAMC scope of works boundary as indicated on drawing 4389-A-20-001
  - Existing services covers in new / re-installed paving to be re-aligned with paving where possible - individual covers to be reviewed on site
- To be read in conjunction with -**
- ARUP Structural Engineers drawings for sub base information
  - ARUP / PBA drawings for drainage layouts
  - BAMC Electrical Engineers drawings for services, lighting layouts
  - BAMC for waterproofing details (Z3 - Series)
  - Miller Druck for paving finishes / cut patterns
  - PBA - Drainage levels

002	TM	DW	26.05.17	Updated as per BAMC comments

**KEY PLAN**



**BAM Design Ltd**  
An exciting company of  
BAM Consulting UK Ltd  
Architect  
Interior Design  
3D Visualisation  
Feasibility Studies  
Structural Engineering  
Building Information Modelling

PROJECT COAL DROPS YARD

External Paving Layout - I2 WRA  
- L00 Yard Level - Sheet 04


As indicated @ A1  
date 03/08/16  
sheet 04  
KXC-12- 001-BD4389-A-(90)-400404 002

drawn TM  
checked MWB  
34389  
Scale 1:500  
Consultant  
Role CD/SE  
Contract

**CONSTRUCTION**  
S4

**LEGEND**  
**External Finishes - The Yard - Ground Floor Level**

- T1** : Granite Stone Set Paving various rotation. Lengths between 100-250mm Width x 100 Depth. 24% Stirling Red/Grey (availability of Stirling red TBC by quarry) .38% Millennium Green. 38% Sea Black 10mm joints 40mm bed
- T2** : Sea black setts. The setting-out of the setts within the perimeter of the fan is indicative and should be developed with the paving subcontractor along traditional laying techniques.
- T3** : Lightly Sawn and Textured Granite Setts - Source from site. Lengths between 100-250mm x 80-125mm Width x APPROX. 100 Depth Sawn + Textured (Tolerance +/- 2mm). (sizes will be limited to available existing sett sizes & numbers.)
- T5** : Rough Reclaimed Granite Setts - Source from site. Lengths between 100-250mm x 80-125mm Width x Approx 100 Depth Reclaimed, cleaned + laid with no finish. (sizes will be limited to available existing sett sizes & numbers.)
- T7** : Sea black paving zone to mark original ECD Viaduct footprint. Two rows border around periphery
- T8** : Tactile Granite Corduroy Paving of milled granite to match surrounding paving (Sea black). 800mm Length x 400mm Width x 50mm depth
- T9** : Single line of new granite setts threshold 100x100 Width x 100 Depth. Colour to match T1.
- T9B** : Triple line of new granite setts threshold 100x100 Width x 100 Depth. Colour to match T1.
- Slot Drain - C250
- Slot Drain - D400
- Concrete encasing for Slot Drain
- Concrete encasing for Slot Drain
- CF: Compressible filler
- MJ: Expansion joint in paving See Structural Engineers Details
- Fall lines shown indicatively, slopes to be executed with soft blends, no setts to be cut
- SOP Setting out position for paving finish

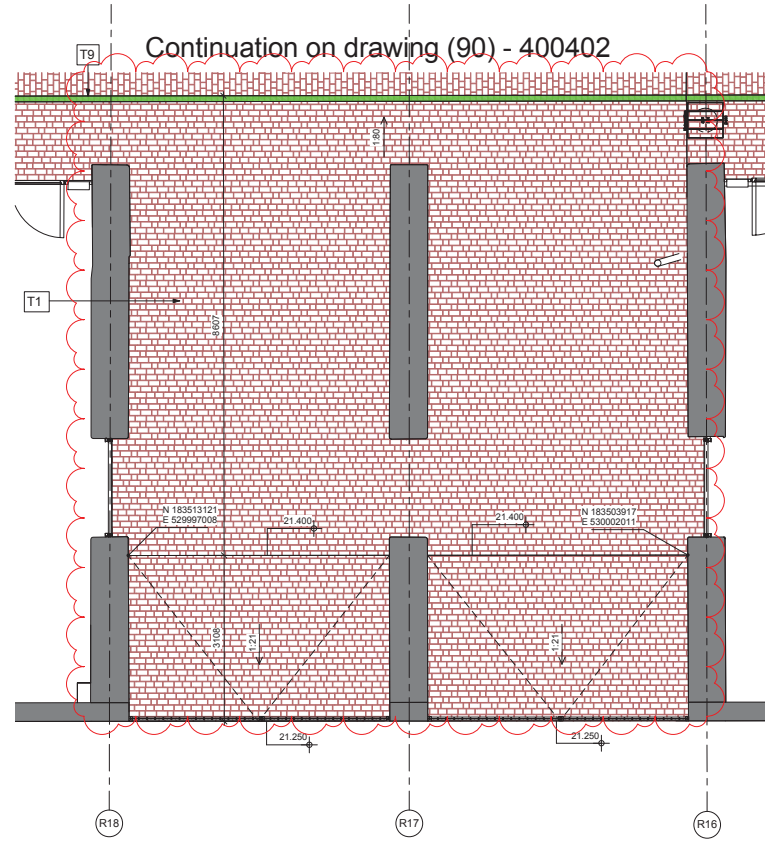


**DO NOT SCALE FROM THIS DRAWING - ALL DIMENSIONS TO BE CHECKED ON SITE**

- NOTES:**
- This drawing shows design intent only & is subject to detailed design specialists.
  - Figured dimensions only are to be taken from this drawing. All contractors must visit site & are responsible for taking & checking all dimensions relating to their work. BAM Design to be advised of any variation between drawings & site conditions.
  - All vertical dimensions to be taken from FFL, please note that all manufacturing schedules are to take this into account.
  - All dimensions are in millimetres unless noted otherwise.
  - All levels in meters unless noted otherwise.
- To be read in conjunction with -**  
 ARUP drawings for structural frame, openings, supports

**TO BE READ IN CONJUNCTION WITH ALL ARCH DETAILS & SPECIFICATIONS**

- NOTES:**
- General -**
- Material finishes all to approved samples
  - Areas stated are approximate for pricing exercise only and are total area of BAMC scope of works boundary as indicated on drawing 4389-A-20-001
  - Existing services covers in new / re-instated paving to be re-aligned with paving where possible - individual covers to be reviewed on site
- To be read in conjunction with -**
- ARUP Structural Engineers drawings for sub base information
  - ARUP / PBA drawings for drainage layouts
  - BAMC Electrical Engineers drawings for services, lighting layouts
  - BAMC for waterproofing details (Z3 - Series)
  - Miller Druck for paving finishes / cut patterns
  - PBA - Drainage levels

NO	BY	CHKD	DATE	DESCRIPTION
002	TM	DW	26.05.17	Updated as per BAMC comments



PROJECT COAL DROPS YARD

External Paving Layout - I2 WRA  
 - L00 Yard Level - Sheet 05

CONSTRUCTION

As indicated @ A1

03/08/16

KXC-12- 001-BD4389-A-(90)-400405 002

drawn TM  
 checked MHB  
 4389

Rev: 005/01

Sheet of issue

Rev: 005/01

4389

Sheet of issue

**LEGEND**  
External Finishes - The Yard - Ground Floor Level


- T1** : Granite Stone Set Paving various rotation. Lengths between 100-250mm Width x 100 Depth. 24% Stirling Red/Grey (availability of Stirling red TBC by quarry). 38% Millennium Green, 38% Sea Black 10mm joints 40mm bed
- T2** : Sea black sets. The setting-out of the sets within the perimeter of the fan is indicative and should be developed with the paving subcontractor along traditional laying techniques.
- T3** : Lightly Sawn and Textured Granite Setts - Source from site. Lengths between 100-250mm x 80-125mm Width x APPROX. 100 Depth Sawn + Textured (Tolerance +/- 2mm). (sizes will be limited to available existing set sizes & numbers.)

- T5** : Rough Reclaimed Granite Setts - Source from site Lengths between 100-250mm x 80-125mm Width x Approx 100 Depth Reclaimed, cleaned + laid with no finish. (sizes will be limited to available existing set sizes & numbers.)
- T7** : Sea black paving zone to mark original ECD Viaduct footprint. Two rows border around periphery
- T8** : Tactile Granite Corduroy Paving of milled granite to match surrounding paving (Sea black). 800mm Length x 400mm Width x 50mm depth
- T9** : Single line of new granite setts threshold 100x100 Width x 100 Depth. Colour to match T1.
- T9B** : Triple line of new granite setts threshold 100x100 Width x 100 Depth. Colour to match T1.

- Slot Drain - C250
- Slot Drain - D400
- Concrete encasing for Slot Drain
- Concrete encasing for Slot Drain
- CF: Compressible filler
- MJ: Expansion joint in paving See Structural Engineers Details
- Fall lines shown indicatively, slopes to be executed with soft blends, no setts to be cut
- SOP: Setting out position for paving finish

DO NOT SCALE FROM THIS DRAWING.  
ALL DIMENSIONS TO BE CHECKED ON SITE.  
FOR REFERENCED VIEWS REFER TO SERIES OF DRAWINGS  
KXC-MO-001-A (100)

Continuation on drawing  
(90)-400513

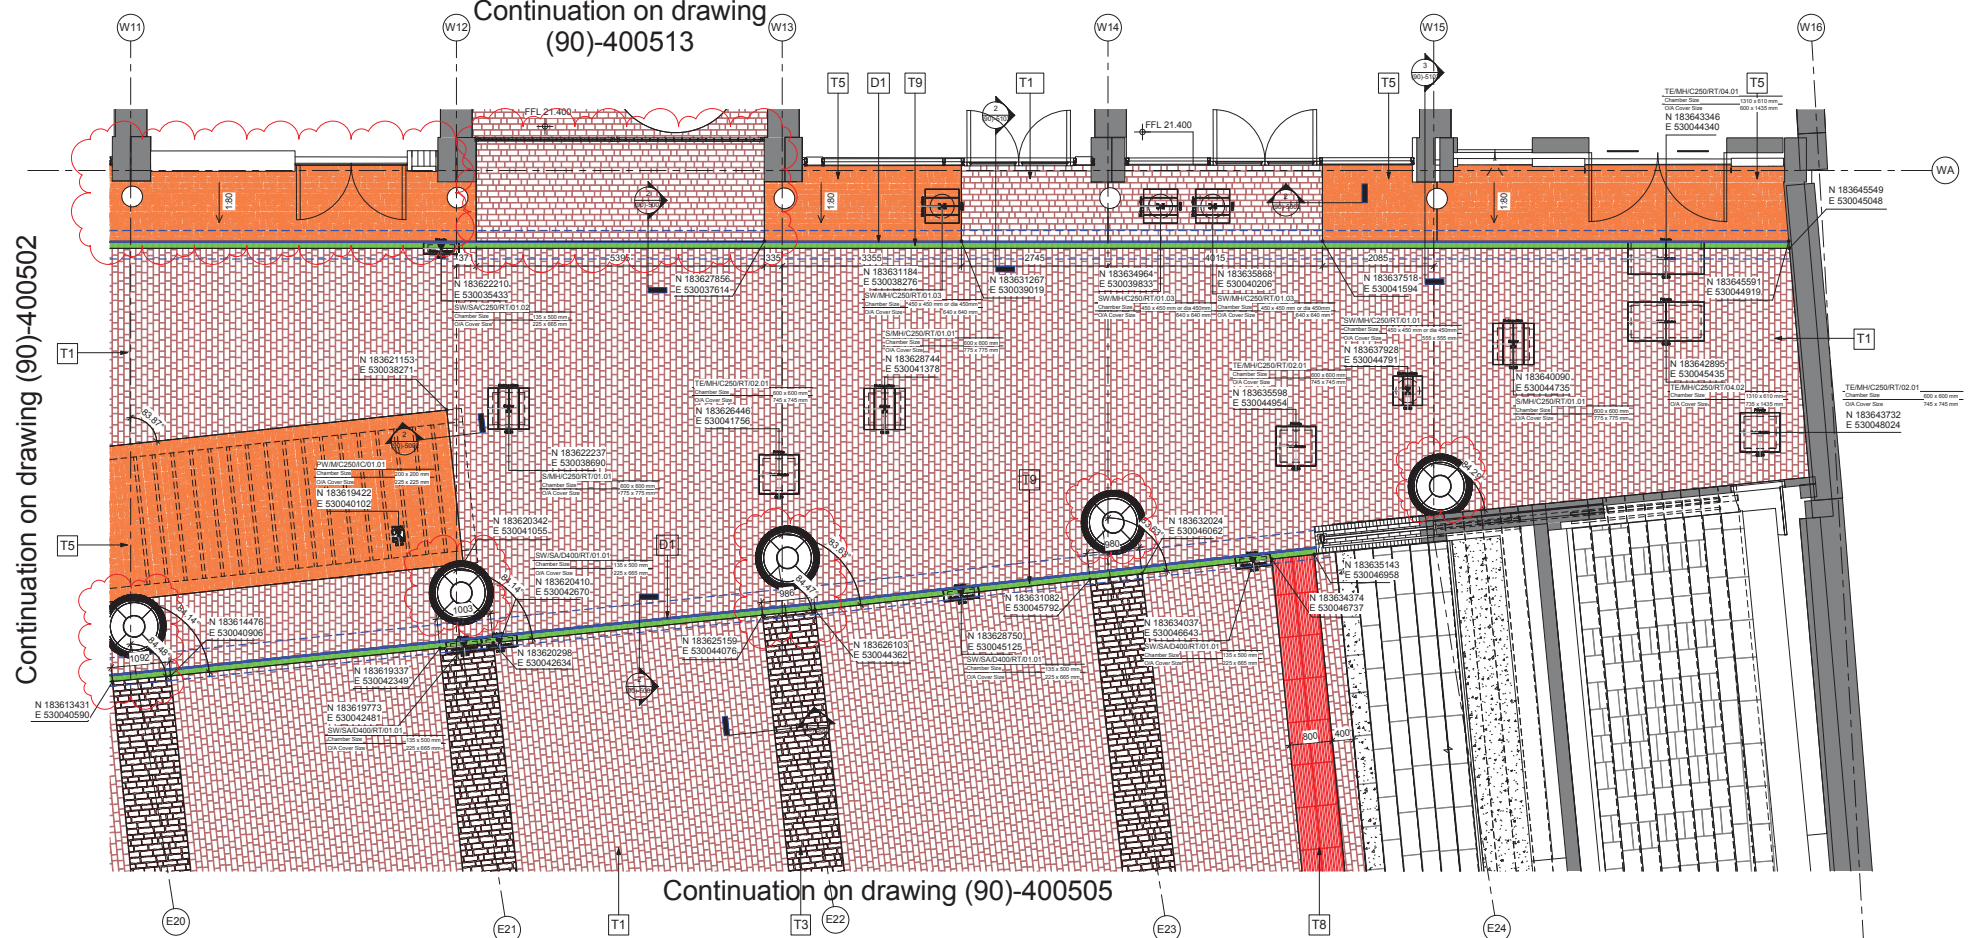

Continuation on drawing (90)-400502

Continuation on drawing (90)-400505


DO NOT SCALE FROM THIS DRAWING - ALL DIMENSIONS TO BE CHECKED ON SITE

- NOTES:**
- This drawing shows design intent only & is subject to detailed design specialists.
  - Squared dimensions only are to be taken from this drawing. All contractors must visit site & are responsible for taking & checking all dimensions relating to their work. BAM Design to be advised of any variation between drawings & site conditions.
  - All vertical dimensions to be taken from FFL, please note that all manufacturing schedules are to take this into account.
  - All dimensions are in millimetres unless noted otherwise.
  - All levels in meters unless noted otherwise.
- To be read in conjunction with -  
ARUP drawings for structural frame, openings, supports

TO BE READ IN CONJUNCTION WITH ALL ARCH DETAILS & SPECIFICATIONS

- NOTES:**
- General -**
- Material finishes all to approved samples
  - Areas stated are approximate for pricing exercise only and are total area of BAMC scope of works boundary as indicated on drawing 4308-A-20-001
  - Existing services covers in new / re-instated paving to be re-aligned with paving where possible - individual covers to be reviewed on site
  - To be read in conjunction with -
    - ARUP Structural Engineers drawings for sub base information
    - ARUP / PBA drawings for drainage layouts
    - BAMC Electrical Engineers drawings for services, lighting layouts
    - BAMC for waterproofing details (23 - Series)
    - Miler Druck for paving finishes / cut patterns
    - PBA - Drainage levels

KEY PLAN



002	TM	MWB	26.05.17	Updated as per BAMC comments
REV	DATE	BY	DESCRIPTION	



PROJECT COAL DROPS YARD

External Paving Layout - The Yard - L00 Yard Level - Sheet 01

As indicated @ A1  
date 03/08/16  
KXC-MO- 001-BD4389-A-(90)-400501

drawn SS  
checked MWB  
approved CSB

scale 1:100  
sheet 4389  
revision 001

project of issue  
CONSTRUCTION  
S4

8/1/2016 10:00:00 AM  
www.bamc.co.uk