

Deliveroo

115 to 121 Finchley Road
Swiss Cottage
London
NW3 6HY

Plant Noise Impact Assessment

On behalf of

chapman
ventilation

Project Reference: 86967 | Revision: 00 | Date: 4 August 2017

Document Information

Project Name : **Deliveroo, Swiss Cottage**
Project Reference : **86967**
Report Title : **Plant Noise Impact Assessment Report**
Doc Reference : **86967/NIA**
Date : **4 August 2017**

	Name	Qualifications	Initials	Date
Prepared by:	Adam Meakins	AMIOA	AM	4 August 2017
Reviewed and approved by:	Dean Bowden	BSc(Hons), MIOA,	DB	8 August 2017
For and on behalf of Noise Solutions Ltd				

Revision	Date	Description	Prepared	Reviewed/ Approved

Noise Solutions Ltd (NSL) disclaims any responsibility to the Client and others in respect of any matters outside the scope of this report. This report has been prepared with reasonable skill, care and diligence within the terms of the Contract with the Client and generally in accordance with the appropriate ACE Agreement and taking account of the manpower, resources, investigations and testing devoted to it by agreement with the Client. This report is confidential to the Client and NSL (Noise Solutions Ltd) accepts no responsibility of whatsoever nature to third parties to whom this report or any part thereof is made known. Any such party relies upon the report at their own risk.

© Noise Solutions Ltd (NSL) 2016

Reg no. 3483481 Trading office Unit 6, LDL Business Centre, Station Road West, Ash Vale, GU12 5RT

Contents

1.0 Introduction1

2.0 Details of development proposals1

3.0 Nearest noise sensitive receptors1

4.0 Existing noise climate.....1

5.0 Plant noise design criteria2

 National Planning Policy Framework2

 Camden London Borough Council.....3

6.0 Noise assessment.....4

7.0 Summary6

Appendices

Appendix A Acoustic Terminology

Appendix B Aerial Photograph of site showing areas of interest

Appendix C Environmental Sound Survey

Appendix D Manufacturer plant noise data

Appendix E Plant noise level predictions at receptor

Appendix F Proposed plant layout

1.0 Introduction

- 1.1. A Deliveroo kitchen is to be located within an existing building along Finchley Road in Swiss Cottage, London. Noise Solutions Ltd (NSL) has been commissioned to undertake a noise impact assessment in relation to the plant noise emissions from the building services plant serving the proposed kitchen.
- 1.2. Noise emission levels for the proposed plant have been predicted at the nearest noise sensitive receptors to the site and assessed against the relevant local and national guidance.
- 1.3. [Appendix A](#) contains a guide to common acoustic terminology.

2.0 Details of development proposals

- 2.1. A Deliveroo kitchen will be located on the ground floor of an existing building located on the western side of Finchley Road in Swiss Cottage, London. The proposals include for the installation of three supply Air Handling Units (AHU) and three kitchen extract fans.
- 2.2. All plant will be located inside the building with external intake and discharge vents.
- 2.3. The proposed extract and supply systems will operate only between 09.00 and 23.00 hours daily. [Appendix D](#) contains the noise output data for the proposed plant.

3.0 Nearest noise sensitive receptors

- 3.1. The area surrounding the site contains mixed residential and commercial properties. The nearest residential dwellings are above the shops adjoining the proposed kitchen (Reference R1) at a distance of approximately 2m from the closest ventilation grille. There are further residential properties (Reference R2) behind the proposed kitchen along Dobson Close at a distance of approximately 20m from the closest proposed plant item.
- 3.2. [Appendix B](#) contains an aerial photograph showing the site and surrounding area.

4.0 Existing noise climate

- 4.1. An environmental noise survey was undertaken to establish the typical background sound levels at a location representative of the noise climate outside the façades of the nearest noise sensitive receptors to the proposed plant area during the quietest times at which the plant will operate.

- 4.2. The results of the environmental sound survey are summarised in Table 1 below. The full set of measurement results and details of the survey methodology are presented in [Appendix C](#).

Table 1: Summary of survey results

Measurement period	Range of recorded sound pressure levels (dB)			
	L _{Aeq} (15min)	L _{Amax} (15min)	L _{A10} (15min)	L _{A90} (15min)
Daytime (07.00 - 23.00 hours)	55-69	65-92	57-75	54-59
Night-time (23.00 - 07.00 hours)	53-60	57-91	54-59	52-58

- 4.3. The noise climate at the nearest residential flat overlooking the site was dominated by noise from existing plant serving other premises in the area. In order to be robust, the lowest L_{A90,15min} background levels are therefore deemed to be representative.
- 4.4. It should be noted that BS 4142:2014 'Methods for rating and assessing industrial and commercial sound' states the following with regard to the measurement of background noise levels;

Since the intention is to determine a background sound level in the absence of the specific sound that is under consideration, it is necessary to understand that the background sound level can in some circumstances legitimately include industrial and/or commercial sounds that are present as separate to the specific sound.

5.0 Plant noise design criteria

National Planning Policy Framework

- 5.1. The National Planning Policy Framework (NPPF) was introduced in March 2012. The document sets out the Government's planning policies for England and how these are expected to be applied.
- 5.2. *Paragraph 123* of the *NPPF* states that planning policies and decisions should aim to:
- *avoid noise from giving rise to significant adverse impacts on health and quality of life as a result of new development;*
 - *mitigate and reduce to a minimum other adverse impacts on quality of life arising from noise from new development, including through the use of conditions;*
 - *recognise that development will often create some noise and existing businesses wanting to develop in continuance of their business should not have unreasonable restrictions put*

on them because of changes in nearby land uses since they were established [subject to the provisions of the Environmental Protection Act 1990 and other relevant law]; and

- *identify and protect areas of tranquillity which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.*

5.3. Furthermore the NPPF gives weight to the requirements of the local authority as it states the following:

11. Planning law requires that applications for planning permission must be determined in accordance with the development plan unless material considerations indicate otherwise.

12. This National Planning Policy Framework does not change the statutory status of the development plan as the starting point for decision making. Proposed development that accords with an up-to-date Local Plan should be approved, and proposed development that conflicts should be refused unless other material considerations indicate otherwise. It is highly desirable that local planning authorities should have an up-to-date plan in place.

13. The National Planning Policy Framework constitutes guidance for local planning authorities and decision-takers both in drawing up plans and as a material consideration in determining applications.

Camden London Borough Council

5.4. The Camden London Borough Council Policy DP28 “Noise and Vibration” states that: *“The Council will seek to ensure that noise and vibration is controlled and managed and will not grant planning permission for: a) development likely to generate noise pollution; or b) development sensitive to noise in locations with noise pollution, unless appropriate attenuation measures are provided. Development that exceeds Camden’s Noise and Vibration Thresholds will not be permitted.”*

5.5. The policy document goes on to describe noise thresholds at which development related noise levels will be acceptable:

Table 2: Noise levels from plant and machinery at which planning permission will not be granted (excerpt from Camden Council guidance)

Noise description and location of measurement	Period	Time	Noise Level
Noise at 1 metre external to a sensitive façade	Day, evening and night	0000-2400	5dB(A) <LA90
Noise that has a distinguishable discrete continuous note (whine, hiss, screech, hum) at 1 metre external to a sensitive façade.	Day, evening and night	0000-2400	10dB(A) <LA90
Noise that has distinct impulses (bangs, clicks, clatters, thumps) at 1 metre external to a sensitive façade.	Day, evening and night	0000-2400	10dB(A) <LA90
Noise at 1 metre external to sensitive façade where LA90 > 60dB	Day, evening and night	0000-2400	55dBLAeq

- 5.6. Based on the guidance above and given that noise from existing plant serving adjacent units is presently influencing the prevailing background, it is recommended that the cumulative noise level for the proposed plant should not exceed a level 10dB lower than the representative L_{A90} background level at the nearest noise sensitive receptors. The following noise limits apply:

Table 3: Plant noise emissions limits at nearest receptors

Period	Cumulative plant noise rating level, dB(A)
Daytime (07.00 – 23.00 hours)	44
Night-time (23.00 – 07.00 hours)	42

6.0 Noise assessment

- 6.1. Cumulative noise emissions from the proposed plant have been predicted at the nearest properties to the site based on the manufacturer noise data presented in [Appendix D](#).
- 6.2. Noise levels for the proposed extract and supply systems have been predicted taking into account ductwork system losses, aperture size, directivity of sound propagation and distance attenuation. Predictions are inclusive of the following atmospheric-side attenuation fitted to the ventilation systems.

Table 4: Proposed atmospheric-side attenuator selections

Attenuator	Insertion loss (dB) at Octave Band Centre Frequencies (Hz)							
	63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz
Kitchen extract 1	4	6	9	17	22	20	16	10
Kitchen extract 2	4	6	9	17	22	20	16	10
Kitchen extract 3	4	6	9	17	22	20	16	10
AHU 1	5	7	11	19	25	22	18	12
AHU 2	6	13	26	36	40	36	30	21
AHU 3	5	7	11	19	25	22	18	12

- 6.3. It should be noted that the proposed plant is high-quality, inverter driven equipment which will minimise the presence of any specific acoustic characteristics (i.e. bangs, clicks, tonal components, impulsive nature, etc.). In order to be robust, however, Camden Council’s most stringent plant noise emissions criteria have been applied.
- 6.4. Predicted noise levels during the daytime period (specifically between 09.00 and 23.00 hours) are based upon all plant operating simultaneously at maximum capacity. All the plant will be switched off during the night-time period (between 23.00 and 07.00), when the kitchen is closed.
- 6.5. Table 5, below, summarises the assessment of predicted noise levels. The full set of calculations are presented in [Appendix E](#).

Table 5 Assessment of predicted noise levels at the nearest noise sensitive receptors

Receptor	Period	Predicted noise level at receptor, L_{Aeq} (dB)	Design criterion (dB)	Difference (dB)
Receptor R1	All plant operating (11.00 - 23.00 hours)	44	44	0
Receptor R2	All plant operating (11.00 - 23.00 hours)	41	44	-3

- 6.6. The plant noise impact assessment has demonstrated that cumulative noise emissions from the proposed plant will comply with appropriate design criteria (as established in Table 3) at the

nearest residential premises, inclusive of suitable atmospheric-side attenuation fitted to the kitchen extract and supply systems.

- 6.7. In addition, all plant and associated ductwork/pipework will be fitted with suitable anti-vibration isolation in order to ensure structure-borne transmission to the adjoined residential properties is appropriately mitigated.


7.0 Summary

- 7.1. Noise Solutions Ltd (NSL) has been commissioned by Chapman Ventilation Ltd to undertake a noise assessment for new plant at a proposed Deliveroo kitchen along Finchley Road in Swiss Cottage.
- 7.2. The noise impact from the proposed plant has been predicted at the nearest noise sensitive receptors to the site and assessed against the typical requirements of the local authority (and in accordance with national policy on noise).
- 7.3. The predictions demonstrate that cumulative noise from the proposed plant should be acceptable to Camden Council at all nearby receptors and all times, inclusive of suitable atmospheric-side attenuators fitted to the fresh air supply and kitchen extract systems.
- 7.4. In addition, all plant and associated ductwork/pipework will be fitted with suitable anti-vibration isolation in order to ensure structure-borne transmission to the adjoined residential properties is appropriately mitigated.
- 7.5. Therefore, noise from the plant proposals should not be a reason for refusal of planning permission.

Appendix A Acoustic Terminology

Parameter	Description
Ambient Noise Level	The totally encompassing sound in a given situation at a given time, usually composed of a sound from many sources both distant and near ($L_{Aeq,T}$).
Decibel (dB)	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds s_1 and s_2 is given by $20 \log_{10}(s_1/s_2)$. The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is $20\mu\text{Pa}$. The threshold of normal hearing is in the region of 0 dB and 140 dB is the threshold of pain. A change of 1 dB is only perceptible under controlled conditions.
dB(A), L_{Ax}	Decibels measured on a sound level meter incorporating a frequency weighting (A weighting) which differentiates between sounds of different frequency (pitch) in a similar way to the human ear. Measurements in dB(A) broadly agree with people's assessment of loudness. A change of 3 dB(A) is the minimum perceptible under normal conditions, and a change of 10 dB(A) corresponds roughly to halving or doubling the loudness of a sound. The background noise in a living room may be about 30 dB(A); normal conversation about 60 dB(A) at 1 metre; heavy road traffic about 80 dB(A) at 10 metres; the level near a pneumatic drill about 100 dB(A).
Fast Time Weighting	Setting on sound level meter, denoted by a subscript F, that determines the speed at which the instrument responds to changes in the amplitude of any measured signal. The fast time weighting can lead to higher values than the slow time weighting when rapidly changing signals are measured. The average time constant for the fast response setting is 0.125 (1/8) seconds.
Free-field	Sound pressure level measured outside, far away from reflecting surfaces (except the ground), usually taken to mean at least 3.5 metres
Façade	Sound pressure level measured at a distance of 1 metre in front of a large sound reflecting object such as a building façade.
$L_{Aeq,T}$	A noise level index called the equivalent continuous noise level over the time period T. This is the level of a notional steady sound that would contain the same amount of sound energy as the actual, possibly fluctuating, sound that was recorded.
$L_{max,T}$	A noise level index defined as the maximum noise level recorded during a noise event with a period T. L_{max} is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall L_{eq} noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
$L_{10,T}$	A noise level index. The noise level exceeded for 10% of the time over the period T. L_{10} can be considered to be the "average maximum" noise level. Generally used to describe road traffic noise. $L_{A10,18h}$ is the A-weighted arithmetic average of the 18 hourly $L_{A10,1h}$ values from 06:00-24:00.
$L_{90,T}$	A noise level index. The noise level that is exceeded for 90% of the measurement time interval, T. It gives an indication of the lower levels of fluctuating noise. It is often used to describe the background noise level and can be considered to be the "average minimum" noise level and is a term used to describe the level to which non-specific noise falls during quiet spells, when there is lull in passing traffic for example.

Appendix B Aerial Photograph of site showing areas of interest

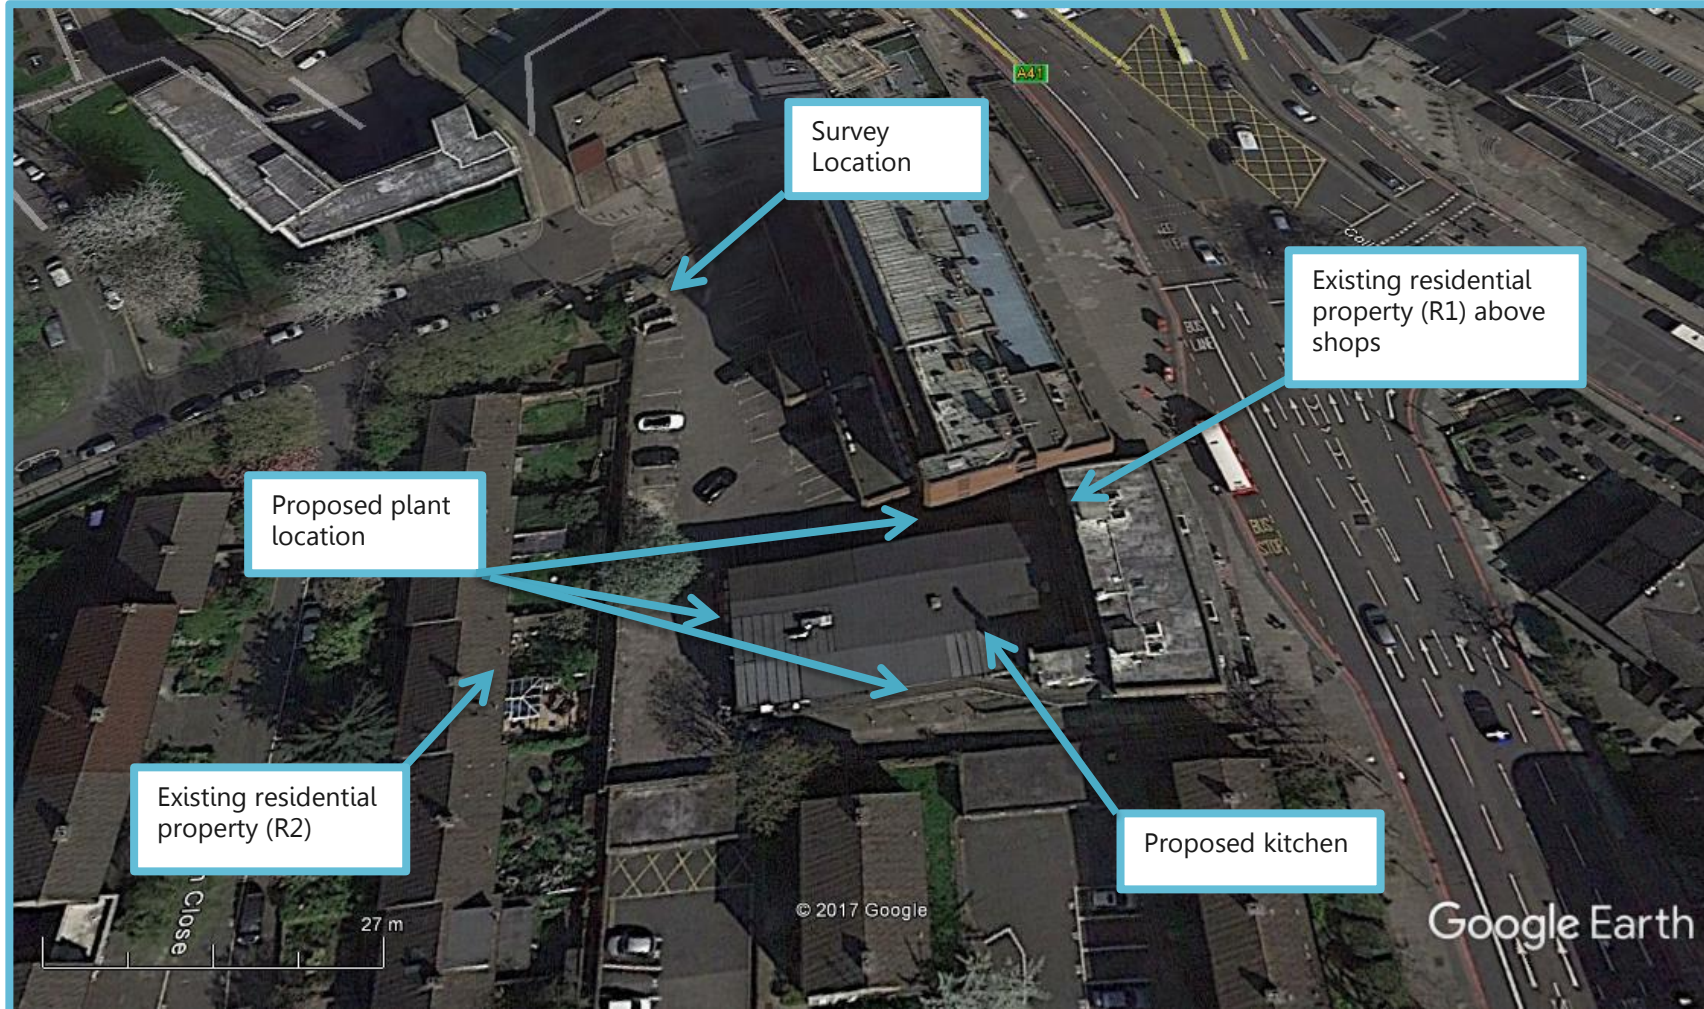

Appendix C Environmental Sound Survey

Details of environmental sound survey

- C.1 Measurements of the existing background sound levels were undertaken from 12:00 hours on Wednesday 2 August 2017 and 10:00 hours on Thursday 3 August 2017.
- C.2 The sound level meter was programmed to record the A-weighted L_{eq} , L_{90} , L_{10} and L_{max} noise indices for consecutive 15-minute sample periods for the duration of the survey.

Measurement position

- C.3 The sound level meter was positioned on a lamppost at the rear of the building as shown in Appendix B. The microphone was positioned in free-field at a height of approximately 3.5m above ground level.
- C.4 The adopted position is considered to be representative of the noise climate affecting the nearest noise sensitive premises to the site. The position was located at a similar distance and comparably screened from the dominant noise sources in the area, when compared to the nearest receptors assessed in this report.

Equipment


- C.5 Details of the equipment used during the survey are provided in the table below. The sound level meter was calibrated before and after the survey; no significant change (+/-0.2 dB) in the calibration level was noted.

Description	Model / serial no.	Calibration date	Calibration certificate no.
Class 1 Sound level meter	Rion NL-52 / 00654035	21/09/2015	CONF091517
Condenser microphone	Rion UC-59 /08290		
Preamplifier	Rion NH-25 / 54080		
Calibrator	Rion NC-74 /34535932	21/09/2015	14746

Weather Conditions

- C.6 Weather conditions were determined both at the start and on completion of the surveys. It is considered that the meteorological conditions were appropriate for environmental noise

measurements. The table below presents the weather conditions recorded on site at the beginning and end of the survey.

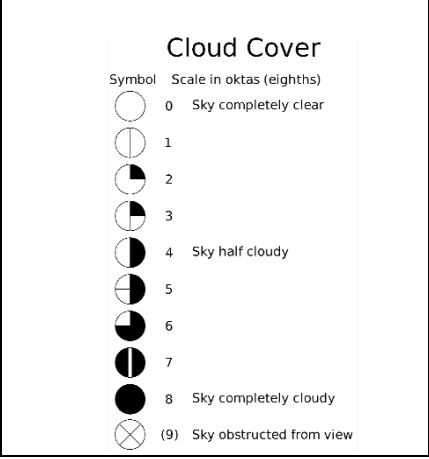
Weather Conditions				
Measurement Location	Date/Time	Description	Beginning of Survey	End of Survey
As indicated on Appendix B	12:00 2/8/2017-10:00 3/8/2017	Temperature (°C)	20	19
		Precipitation:	Yes	Yes
		Cloud cover (oktas - see guide)	6	5
		Presence of fog/snow/ice	No	No
		Presence of damp roads/wet ground	Yes	Yes
		Wind Speed (m/s)	8	5
		Wind Direction	North Easterly	South Westerly
		Conditions that may cause temperature inversion (i.e. calm nights with no cloud)	No	No

Results

C.7 The results of the survey are considered to be representative of background sound pressure levels at the façades of the nearest noise sensitive receptors to the proposed plant area during the quietest times at which the plant will operate. The noise climate during the survey period was dominated by road traffic movements and plant noise emissions from neighbouring premises. The results of the survey are presented in a time history graph overleaf.

Deliveroo, Swiss Cottage

Sound pressure level measurements from 2nd August to 3rd August 2017

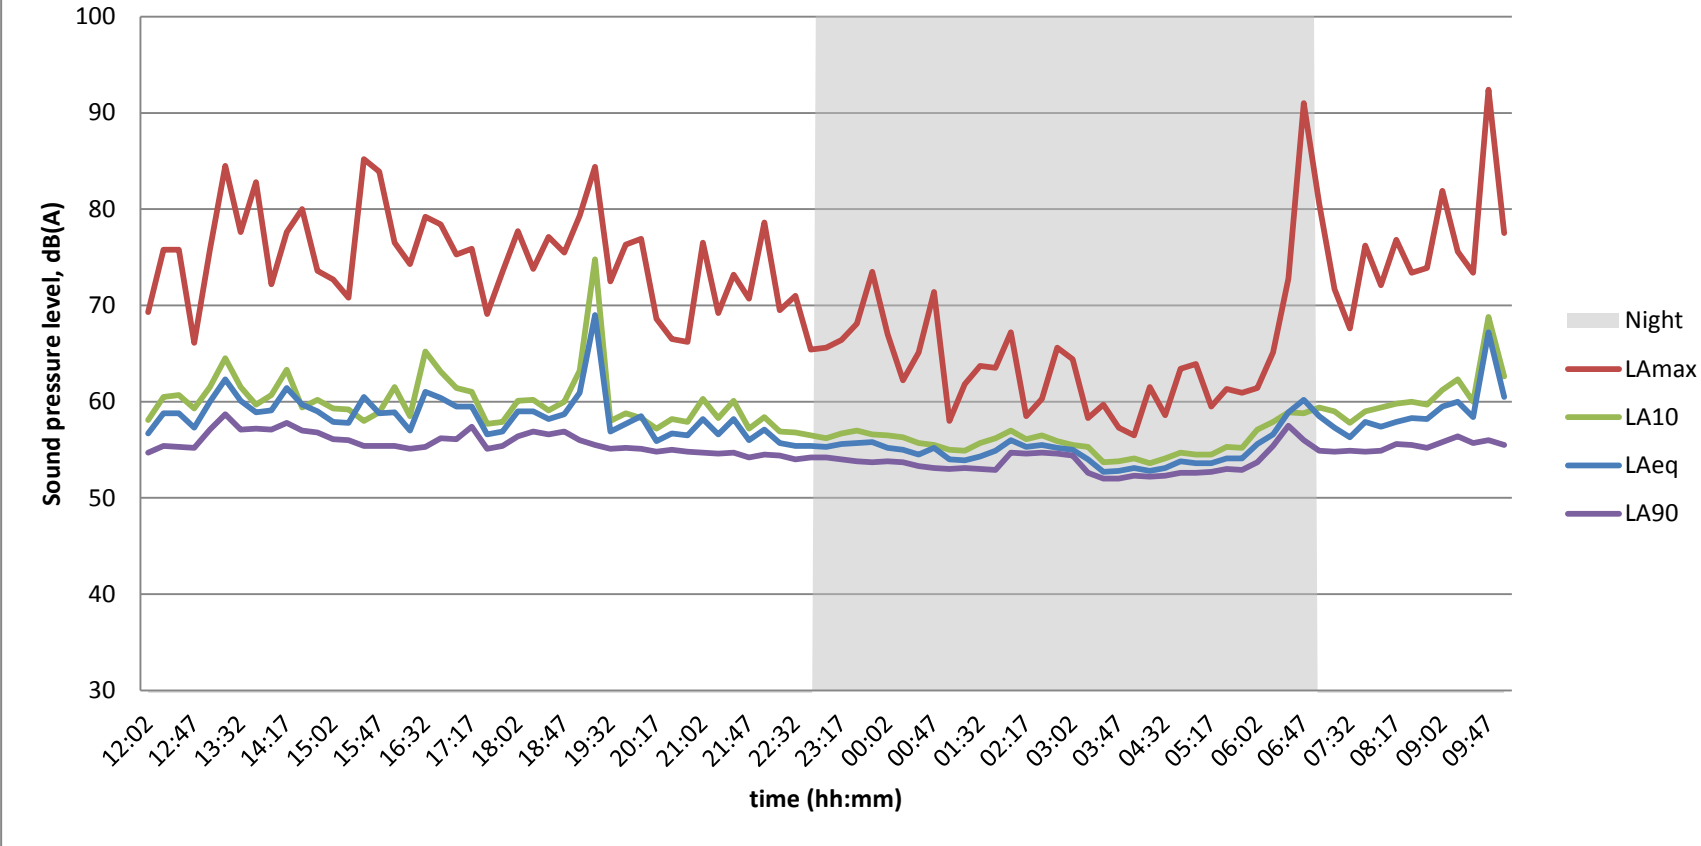

Appendix D Manufacturer plant noise data

Description	Model / Model	Quantity	Notes.	Sound power level(dB) at octave band centre frequencies (Hz)								L _{Aeq,T} (dB)
				63	125	250	500	1k	2k	4k	8k	
Kitchen Extract	Fläkt Woods	3	In-duct Lw Outlet	82	82	84	87	86	81	79	75	90
AHU	Fläkt Woods	3	In-duct Lw Inlet	76	77	89	81	81	75	76	73	86

Appendix E Plant noise level predictions at receptor

Receptor	Plant	Resultant at Receptor (dBA)
R1	Kitchen extract 1	31
	Kitchen extract 2	31
	Kitchen extract 3	31
	AHU 1	31
	AHU 2	42
	AHU 3	36
	Cumulative	44
R2	Kitchen extract 1	35
	Kitchen extract 2	35
	Kitchen extract 3	35
	AHU 1	30
	AHU 2	16
	AHU 3	33
	Cumulative	41

Kitchen extract fans

Description	Notes.	Sound level (dB) at octave band centre frequencies (Hz)								dBA
		63	125	250	500	1k	2k	4k	8k	
Source noise level (unattenuated)	In-duct L _w	82	82	84	87	86	81	79	75	90
System losses		-6	-2	0	-1	-2	-3	-3	-3	
Atmospheric side attenuator	I.L.	-4	-6	-9	-17	-22	-20	-16	-10	
Directivity correction	90,0	0.25	0.25	0	-4	-7	-7	-7	-7	
Distance correction	30m	-38	-38	-38	-38	-38	-38	-38	-38	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R1	L _p	35	36	38	27	17	13	15	17	31
Source noise level (unattenuated)	In-duct L _w	82	82	84	87	86	81	79	75	90
System losses		-6	-2	0	-1	-2	-3	-3	-3	
Atmospheric side attenuator	I.L.	-4	-6	-9	-17	-22	-20	-16	-10	
Directivity correction	90,0	0.25	0.25	0	-4	-7	-7	-7	-7	
Distance correction	20m	-34	-34	-34	-34	-34	-34	-34	-34	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R2	L _p	38	40	41	30	21	17	19	21	35

AHU 1

Description	Notes.	Sound level (dB) at octave band centre frequencies (Hz)								dBA
		63	125	250	500	1k	2k	4k	8k	
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-5	-7	-11	-19	-25	-22	-18	-12	
Directivity correction	0,135	-0.5	-2	-5.5	-8	-8	-8	-8	-8	
Distance correction	20m	-34	-34	-34	-34	-34	-34	-34	-34	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R1	L _p	32	33	38	20	13	11	16	19	31
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-5	-7	-11	-19	-25	-22	-18	-12	
Directivity correction	0,90	0.75	0.75	0.5	-3.5	-7	-7	-7	-7	
Distance correction	40m	-40	-40	-40	-40	-40	-40	-40	-40	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R2	L _p	27	30	38	18	8	6	10	14	30

AHU 2

Description	Notes.	Sound level (dB) at octave band centre frequencies (Hz)								dBA
		63	125	250	500	1k	2k	4k	8k	
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-6	-13	-26	-36	-40	-36	-30	-21	
Directivity correction	0,90	0.75	0.75	0.5	-3.5	-7	-7	-7	-7	
Distance correction	2m	-14	-14	-14	-14	-14	-14	-14	-14	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R1	L _p	52	50	49	27	19	18	25	31	42
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-6	-13	-26	-36	-40	-36	-30	-21	
Directivity correction	0,90	0.75	0.75	0.5	-3.5	-7	-7	-7	-7	
Distance correction	42m	-40	-40	-40	-40	-40	-40	-40	-40	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R2	L _p	26	23	23	1	-7	-8	-2	4	16

AHU 3

Description	Notes.	Sound level (dB) at octave band centre frequencies (Hz)								dBA
		63	125	250	500	1k	2k	4k	8k	
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-5	-7	-11	-19	-25	-22	-18	-12	
Directivity correction	0,90	0.75	0.75	0.5	-3.5	-7	-7	-7	-7	
Distance correction	20m	-34	-34	-34	-34	-34	-34	-34	-34	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R1	L _p	33	36	44	24	14	12	17	20	36
Source noise level (unattenuated)	In-duct L _w	76	77	89	81	81	75	76	73	86
System losses		-4	-1	0	0	0	0	0	0	
Atmospheric side attenuator	I.L.	-5	-7	-11	-19	-25	-22	-18	-12	
Directivity correction	0,90	0.75	0.75	0.5	-3.5	-7	-7	-7	-7	
Distance correction	30m	-38	-38	-38	-38	-38	-38	-38	-38	
Screening correction	0	0	0	0	0	0	0	0	0	
Resultant at receptor R2	L _p	29	32	41	21	11	9	13	16	33

Appendix F Proposed plant layout

