

**GVA**

GVA Schatunowski Brooks

An **APLEONA** company

Daylight &  
Sunlight Report

65 Gresham Street  
London  
EC2V 7NQ

T: +44 (0)20 7911 2468  
F: +44 (0)20 7911 2560



# The Hope Project, Camden, London NW1

Hope Lease Ltd

October 2017

[gva.co.uk](http://gva.co.uk)

## Contents

1.	Introduction and Scope of Report .....	1
2.	Sources of Information and Limitations.....	3
3.	Daylight & Sunlight Standards.....	4
4.	Scheme Assessment.....	8
5.	Summary and Conclusion .....	11

## Appendices

Appendix I	Drawings HO81/17/BRE/140-150
Appendix II	Daylight Analysis Table
Appendix III	Sunlight Analysis Table

Prepared By: Ian Absolon  
Status: 02B615680/6091894\_1.docx  
Date: 18 October 2017

**For and on behalf of GVA Grimley Limited**

# 1. Introduction and Scope of Report

- 1.1 GVA Schatunowski Brooks has been retained by Hope Lease Ltd to assess the performance and impact of The Hope Project, Camden, London NW1 in respect of daylight and sunlight.

## **Scheme Proposals and Application Site**

- 1.2 Full planning and listed building consent is sought for the:
- 1.3 *"Demolition of 65 Bayham Place, 1 Bayham Street (retention of façade) and rebuilding to provide private members club (sui generis) with extension to the rear and basement; retention and refurbishment of the ground floor of the Hope & Anchor Public House (Use Class A4) with replacement of internal floors to provide restaurant and bar, minor reconfiguration to circulation space within KOKO. Use of the Flytower by the private members club with retention of original theatre equipment. Installation of fourth floor extension to provide amenity space with terrace restaurant and bar. The proposals also include for the conversion of the KOKO dome to a private bar and general refurbishment and restoration to the building, along with the installation new plant."*
- 1.4 The site is comprised of a cluster of buildings including Camden Palace "(KOKO)", the Hope and Anchor Public House and 1 Bayham Street and 65 Bayham Place. The application site lies to the north of Crowndale Road on the Camden gyratory system. The site is located adjacent to the Mornington Crescent underground station and has a high PTAL rating of 6b (excellent).
- 1.5 The site lies within Camden Town Centre and also falls within the Camden Town Conservation Area. The site is located within the Regents Park Ward.
- 1.6 KOKO is a Grade II listed structure. The Hope and Anchor Public House and adjacent buildings on Bayham Place (No. 65) are not listed, nationally or locally. The buildings are adjacent to the rear of the theatre. They are not included in the Grade II listing, but listed as 'positive contributors' in the Camden Town Conservation Area Appraisal, 2007.
- 1.7 Hope Lease Ltd is the freehold owner of the Camden Palace (KOKO), the freehold owner recently acquired the Hope and Anchor PH, 1 Bayham Street and 65 Bayham Place, with an ultimate vision to enhance and protect the location as a leading music venue.
- 1.8 The surrounding area is characterised by a variety of building sizes and uses, including mixed use (business, retail and residential) buildings of up to six storeys.

- 1.9 A scheme of redevelopment has been previously consented for this site and the current scheme does not alter significantly. Where applicable this report references the previous analysis.
- 1.10 The purpose of this report is to assess the impact of the proposed development on the daylight and sunlight enjoyed by existing neighbouring dwellings in accordance with the Building Research Establishment (BRE) Guidelines "Site Layout Planning for Daylight and Sunlight - A Guide to Good Practice", 2011, to demonstrate that the proposed development satisfies the objectives of the Council's policy to ensure that existing neighbouring residents will continue to enjoy a reasonable level of amenity in context with the general character of this part of the Borough.
- 1.11 The buildings with the potential to be impacted are as follows:
- 48-56 Bayham Place
  - 4 Bayham Place
  - 2 Bayham Place
  - 31-41 Crowndale Road
  - 43-55 Crowndale Road
  - 46 Bayham Place/3-7 Bayham Street
- 1.12 Drawings HO81/17/BRE/141 & 143 provide plan and 3d views of the scheme and assessed neighbours.

## 2. Sources of Information and Limitations

2.1 No-Skyline Contours Drawing had been created using the following information:

- Existing & Surrounding Buildings
- On Centre Surveys drawings 23745A,7 and 8-1 to 8-8
  
- Proposed Scheme Information.

The model has been drawn in accordance with Architect's application drawings numbered:

- AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17
- AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17
- AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17
- AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17
- AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17
- AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17
- AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17
- AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17
- AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

### 3. Daylight & Sunlight Standards

3.1 The BRE Guidelines – *Site Layout Planning for Daylight and Sunlight: A Guide to Good Practice* are well established and are adopted by most Local Authorities as the appropriate scientific and empirical methods of measuring daylight and sunlight in order to provide objective data upon which to apply their planning policies. The Guidelines are not fixed standards but should be applied flexibly to take account of the specific circumstances of each case.

3.2 The Introduction of the Guidelines states:

*"The guide is intended for building designers and their clients, consultants and planning officials. The advice given here is not mandatory and this document should not be seen as an instrument of planning policy. Its aim is to help rather than constrain the developer. Although it gives numerical guidelines, these should be interpreted flexibly because natural lighting is only one of the many factors in site layout design."*

3.3 The 'flexibility' recommended in the Guidelines should reflect the specific characteristics of each case being considered. For example, as the numerical targets within the Guidelines have been derived on the basis of a low density suburban housing model, it is entirely appropriate to apply a more flexible approach when dealing with higher rise developments in a denser urban environment where the general scale of development is greater. In addition, where existing and proposed buildings have specific design features such as projecting balconies, deep recesses, bay windows etc., it is also equally valid to apply a degree of flexibility to take account of the effect of these particular design features. This does not mean that the recommendations and targets within the Guidelines can be disregarded but, instead, the 'flexibility' that should be applied should be founded on sound scientific principles that can be supported and justified. This requires a certain level of professional value judgement and experience.

#### **Daylighting**

3.4 In respect of daylighting, the BRE Guidelines adopt different methods of measurement depending on whether the assessment is for the impact on existing neighbouring premises or for measuring the adequacy of proposed new dwellings. For safeguarding the daylight received by existing neighbouring residential buildings around a proposed development, the relevant recommendations are set out in Section 2.2 of the Guidelines.

3.5 The adequacy of daylight received by existing neighbouring dwellings is measured using two methods of measurement. First, it is necessary to measure the Vertical Sky Component (VSC)

---

followed by the measurement of internal Daylight Distribution by plotting the position of the 'existing' and 'proposed' no sky line contour.

- 3.6 VSC is measured at the mid-point on the external face of the window serving a habitable room. For the purpose of the Guidelines, a "habitable" room is defined as a Kitchen, Living Room or Bedroom. Bathrooms, hallways and circulation space are excluded from this definition. In addition, many Local Authorities make a further distinction in respect of small kitchens. Where the internal area of a small kitchen limits the use to food preparation and is not of sufficient size to accommodate some other form of "habitable" use such as dining, the kitchen need not be classed as a "habitable" room in its own right.
- 3.7 VSC is a 'spot' measurement taken on the face of the window and is a measure of the availability of light from the sky from over the "existing" and "proposed" obstruction caused by buildings or structures in front of the window. As it is measured on the outside face of the window, one of the inevitable shortcomings is that it does not take account of the size of the window or the size or use of the room served by the window. For this reason, the BRE Guidelines require internal Daylight Distribution to be measured in addition to VSC.
- 3.8 The 'No Sky Line' contour plotted for the purpose of measuring internal Daylight Distribution identifies those areas within the room usually measured on a horizontal working plane set at table top level, where there is direct sky visibility. This therefore represents those parts within the room where the sky can be seen through the window. This second measure therefore takes account of the size of the window and the size of the room but is only more reliable than VSC when the actual room uses, layouts and dimensions are known. When interpreted in conjunction with the VSC value, the likely internal lighting conditions, and hence the quality of lighting within the room, can be assessed.
- 3.9 For VSC, the Guidelines states that:
- "If this Vertical Sky Component is greater than 27% then enough skylight should still be reaching the window of the existing building. Any reduction below this level should be kept to a minimum. If the Vertical Sky Component with the new development in place is both less than 27% and less than 0.8 times its former value, then the occupants of the existing building will notice the reduction in the amount of skylight."*
- 3.10 To put this in context, the maximum VSC value that can be received for a totally unobstructed vertical window is 40%. There are however circumstances where the VSC value is already below 27%. In such circumstances, it is permissible to reduce the existing VSC value by a factor of 0.2 (i.e. 20%) so that the value on the 'proposed' conditions remains more than 0.8 times its former value. The scientific reasoning for this permissible margin of reduction is that existing daylight (and sunlight) levels can be reduced by a factor of 20% before the loss

becomes materially noticeable. This factor of reduction applies to VSC, daylight distribution, sunlight and overshadowing.

3.11 By contrast, the adequacy of daylight for proposed 'New-Build' dwellings is measured using the standards in the British Standard Code of Practice for Daylighting, BS8206 Part 2.

3.12 The British Standard relies upon the use of Average Daylight Factors (ADF) rather than VSC and Daylight Distribution. The use of ADF is referred to in the BRE Guidelines (Appendix C) but its use is usually limited as a supplementary 'check' of internal lighting conditions once the VSC and Daylight Distribution tests have been completed.

3.13 ADF is sometimes seen as a more accurate and representative measure of internal lighting conditions as it comprises a greater number of design factors and input variables/coefficients. That is, the value of ADF is derived from:

- The actual amount of daylight received by the window(s) serving the room expressed as the "angle of visible sky" which is derived from the VSC value and therefore represents the amount of light striking the face of the window.
- The loss of transmittance through the glazing.
- The size of the window (net area of glazing).
- The size of the room served by the window(s) (net internal surface area of the room).
- The internal reflectance values of the internal finishes within the room.
- The specific use of the room.

3.14 One of the main reasons why ADF is more appropriate for New-Build dwellings is that any of the above input variables can be changed during the course of the design process in order to achieve the required internal lighting values. The ability to make such changes is not usually available when dealing with existing neighbouring buildings.

3.15 Unlike the application of VSC and daylight distribution, the British Standard differentiates between different room uses. It places the highest ADF standard on Family Kitchens where the minimum target value is 2% *df*. Living Rooms should achieve 1.5% *df*, and Bedrooms 1.0% *df*.

### **Sunlighting**

3.16 The requirements for protecting sunlight to existing residential buildings are set out in section 3.2 of the BRE Guidelines.



3.17 The availability of sunlight varies throughout the year with the maximum amount of sunlight being available on the summer solstice and the minimum on the winter solstice. In view of this, the internationally accepted test date for measuring sunlight is the spring equinox (21 March), on which day the United Kingdom has equal periods of daylight and darkness and sunlight is available from approximately 0830hrs to 1730hrs. In addition, on that date, sunlight received perpendicular to the face of a window would only be received where that window faces within 90° of due south. The BRE Guidelines therefore limit the extent of testing for sunlight where a window faces within 90° of due south.

3.18 The sunlight standards are normally applied to the principal Living Room within each dwelling rather than to kitchens and bedrooms.

3.19 The recommendation for sunlight is:

*"If this window reference point can receive more than one quarter of annual probable sunlight hours, including at least 5% of annual probable sunlight hours during the winter months of 21 September and 21 March, then the room should still receive enough sunlight ...*

*Any reduction in sunlight access below this level should be kept to a minimum. If the availability of sunlight hours are both less than the amounts given and less than 0.8 times their former value, either over the whole year or just during the winter months, then the occupants of the existing building will notice the loss of sunlight."*

3.20 A good level of sunlight will therefore be achieved where a window achieves more than 25% APSH, of which 5% should be in the winter months. Where sunlight levels fall below this suggested recommendation, a comparison with the existing condition should be undertaken and if the reduction ratio is less than 0.2, i.e. the window continues to receive more than 0.8 times its existing sunlight levels, the impact on sunlight will be acceptable.

## 4. Scheme Assessment

### Impact on Neighbouring Dwellings

- 4.1 Although the BRE Guidelines contain recommendations for commercial and non-domestic buildings as well as buildings in residential use, for the purpose of Planning, the tests within the Guidelines are usually limited to existing neighbouring residential buildings. Non-domestic and commercial buildings are usually excluded as it is generally accepted that these uses normally rely primarily on supplementary artificial lighting throughout the day and are therefore not fully dependent on natural daylight as the sole source of amenity.
- 4.2 For the purpose of the Guidelines, a '*habitable*' room is defined as a Kitchen, Living Room, or Bedroom. Bathrooms, hallways and circulation space are excluded and therefore do not require testing.
- 4.3 We set out below our commentary on the assessments for the daylight/sunlight tests, all results are shown graphically on the attached plans and in tabular format.
- 4.4 Drawings HO81/17/BRE/141 & 143 provide plan and 3d views of the scheme and assessed neighbours.

### Daylight & Sunlight Analysis

#### 48-56 Bayham Place – HO81/17/BRE/144-145

- 4.5 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located from Ground Floor to the FourthFloor.
- 4.6 The neighbouring units are not currently occupied and therefore the appropriate test is not the potential difference in VSC but the level of retained light within each unit as compared to BS 8206 for internal daylighting.
- 4.7 This therefore means an assessment of the ADF and daylight distribution.
- 4.8 The consented assessment showed that despite significant reductions in Vertical Sky Component the level of light within the properties was in the main at a higher level than the requirements for internal lighting. This represents no material difference when compared to the consented levels.
- 4.9 Similarly the Sunlight Analysis shows that slightly higher levels in all test locations will be received as compared to the consented scheme.

**4 Bayham Street – HO81/17/BRE/146**

- 4.10 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located from Basement to First Floor.
- 4.11 As with the consented scheme all rooms see either a less than 20% reduction in VSC or retain in excess of 27% VSC.
- 4.12 This is a fully BRE compliant building.
- 4.13 The Sunlight Analysis also shows the proposed percentages remain above 5% for the sunlight during winter, and retain at least 25%, which should be considered to meet BRE guidance.

**2 Bayham Street – HO81/17/BRE/147**

- 4.14 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located on First Floor only.
- 4.15 As with the consented scheme all rooms retain in excess of 27% VSC.
- 4.16 This is a fully BRE compliant building.
- 4.17 The Sunlight Analysis also shows the proposed percentages remain above 5% for the sunlight during winter, and retain at least 25%, which should be considered to meet BRE guidance.

**31-41 Crowndale Road – HO81/17/BRE/148**

- 4.18 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located on First Floor only.
- 4.19 AS with the consented scheme all rooms see small reductions in Daylight that are less than 20% of existing.
- 4.20 This is a fully BRE compliant building.
- 4.21 There is no requirement to test these north facing buildings for Sunlight.

**43-55 Crowndale Road – HO81/17/BRE/149**

- 4.22 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located on First Floor only.

- 4.23 As with the consented scheme all rooms see small reductions in Daylight that are less than 20% of existing.
- 4.24 This is a fully BRE compliant building.
- 4.25 There is no requirement to test these north facing buildings for Sunlight.

**46 Bayham Place and 3, 5 and 7 Bayham Street – HO81/17/BRE/150**

- 4.26 The drawing referenced as above found in Appendix 1, shows the results on plan of the properties' windows, located on ground to third floor. This property has been assessed in accordance with the recent planning consent
- 4.27 Again, the neighbouring units are not currently occupied in the consented condition and therefore the appropriate test is not the potential difference in VSC but the level of retained light within each unit as compared to BS 8206 for internal daylighting. This therefore means an assessment of the ADF and daylight distribution.
- 4.28 All rooms will see only small reductions in Daylight that are less than 20% of existing in relation to ADF and daylight distribution.
- 4.29 For sunlight, all windows will retain the BRE AP SH values of 25% or greater, where applicable.
- 4.30 This is a fully BRE compliant building.

## 5. Summary and Conclusion

- 5.1 We have undertaken a detailed study of the impact of the proposed development on the relevant rooms within the neighbouring buildings.
- 5.2 The tests were undertaken in accordance with the BRE Report 209 'Site Layout Planning for Daylight and Sunlight – A Guide to Good Practice' (second edition, 2011) and the British Standard - BS 8206: Part 2.
- 5.3 The results of the Daylight and Sunlight Analysis demonstrate the impact of the proposed development onto the effected neighbouring properties.
- 5.4 As compared to the consented scheme this application scheme is causing slightly less impact on neighbouring properties.
- 5.5 The scheme is therefore considered to be more compliant than the consented scheme and for the majority of neighbour's buildings is fully BRE compliant.

# GVA


An **APLEONA** company

GVA Schatunowski Brooks

Appendix I

[gva.co.uk](http://gva.co.uk)

This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

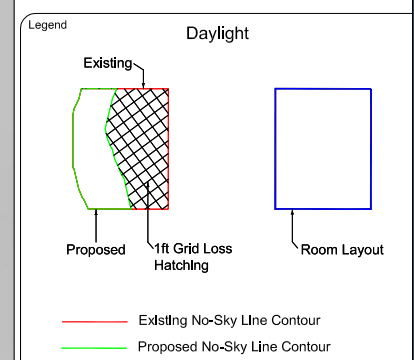

Sources of Information

**Existing And Surrounding Buildings**

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**

Archer Humphries Architects  
 18 Oct 2017

AHA-KKC-GA-098 [ ] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [ ] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [ ] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [ ] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [ ] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [ ] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [ ] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [ ] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [ ] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [ ] Proposed Crowndale Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [ ] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [ ] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [ ] Proposed Section AA DRAFT dated 13.10.17

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited

Drawing Title  
 Existing Site Plan



Drawn By AH	Chk'd By	Scale @ A3	Date 18/10/2017
----------------	----------	------------	--------------------

Project No. HO81-17	Drawing No. BRE/140	Revision -
------------------------	------------------------	---------------

Daylight

A3

This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

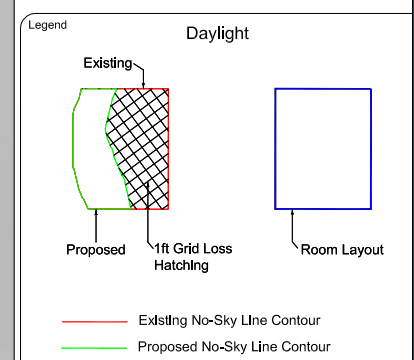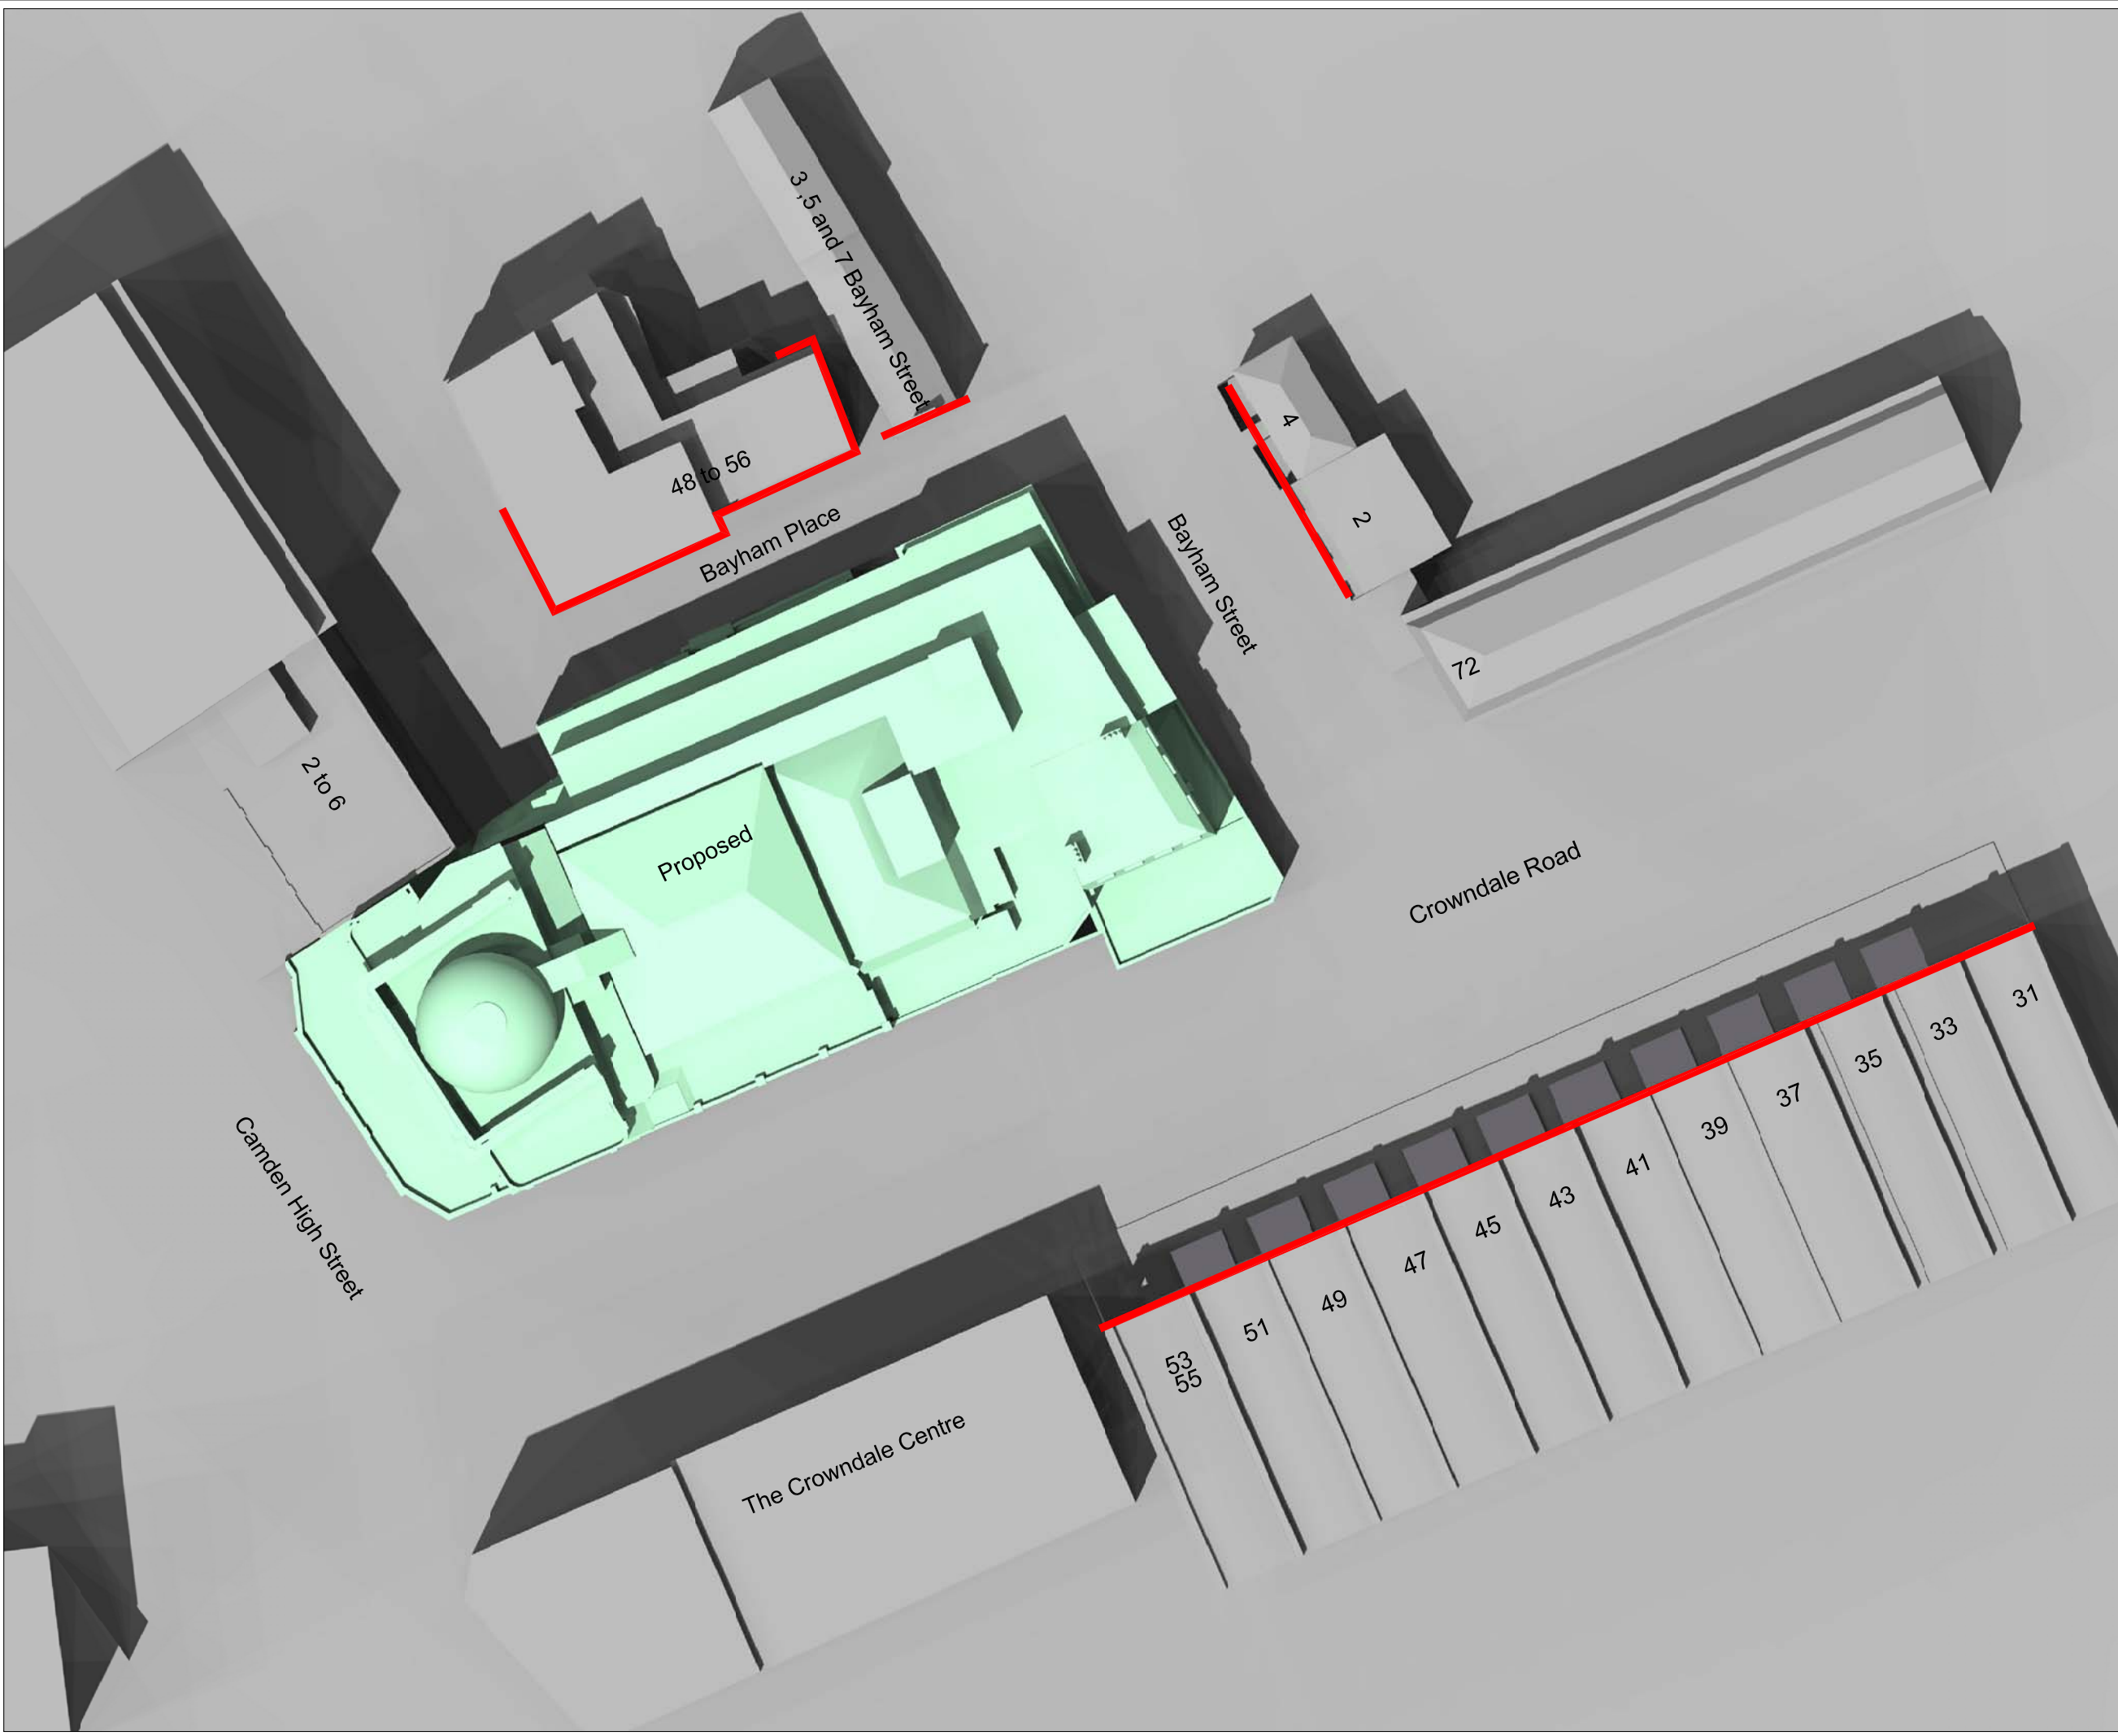

- Sources of Information
- Existing And Surrounding Buildings**
- On Centre Surveys LTD
  - 23745A-7 ROOF PLAN
  - 23745A-8-1
  - 23745A-8-2
  - 23745A-8-3
  - 23745A-8-4
  - 23745A-8-5
  - 23745A-8-6
  - 23745A-8-7
  - 23745A-8-8
  - 48-56 Bayham Place
  - 04 April 2017
  - 48 56 Bayham Place drawings
- Proposed Scheme**
- Archer Humphries Architects
  - 18 Oct 2017
  - AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17
  - AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17
  - AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17
  - AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17
  - AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17
  - AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17
  - AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17
  - AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17
  - AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited

Drawing Title  
 Proposed Site Plan

Drawn By AH	Chk'd By	Scale @ A3	Date 18/10/2017
----------------	----------	------------	--------------------



Project No. HO81-17	Drawing No. BRE/141	Revision -
------------------------	------------------------	---------------

Daylight

A3



This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

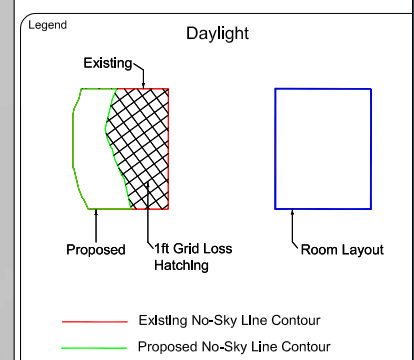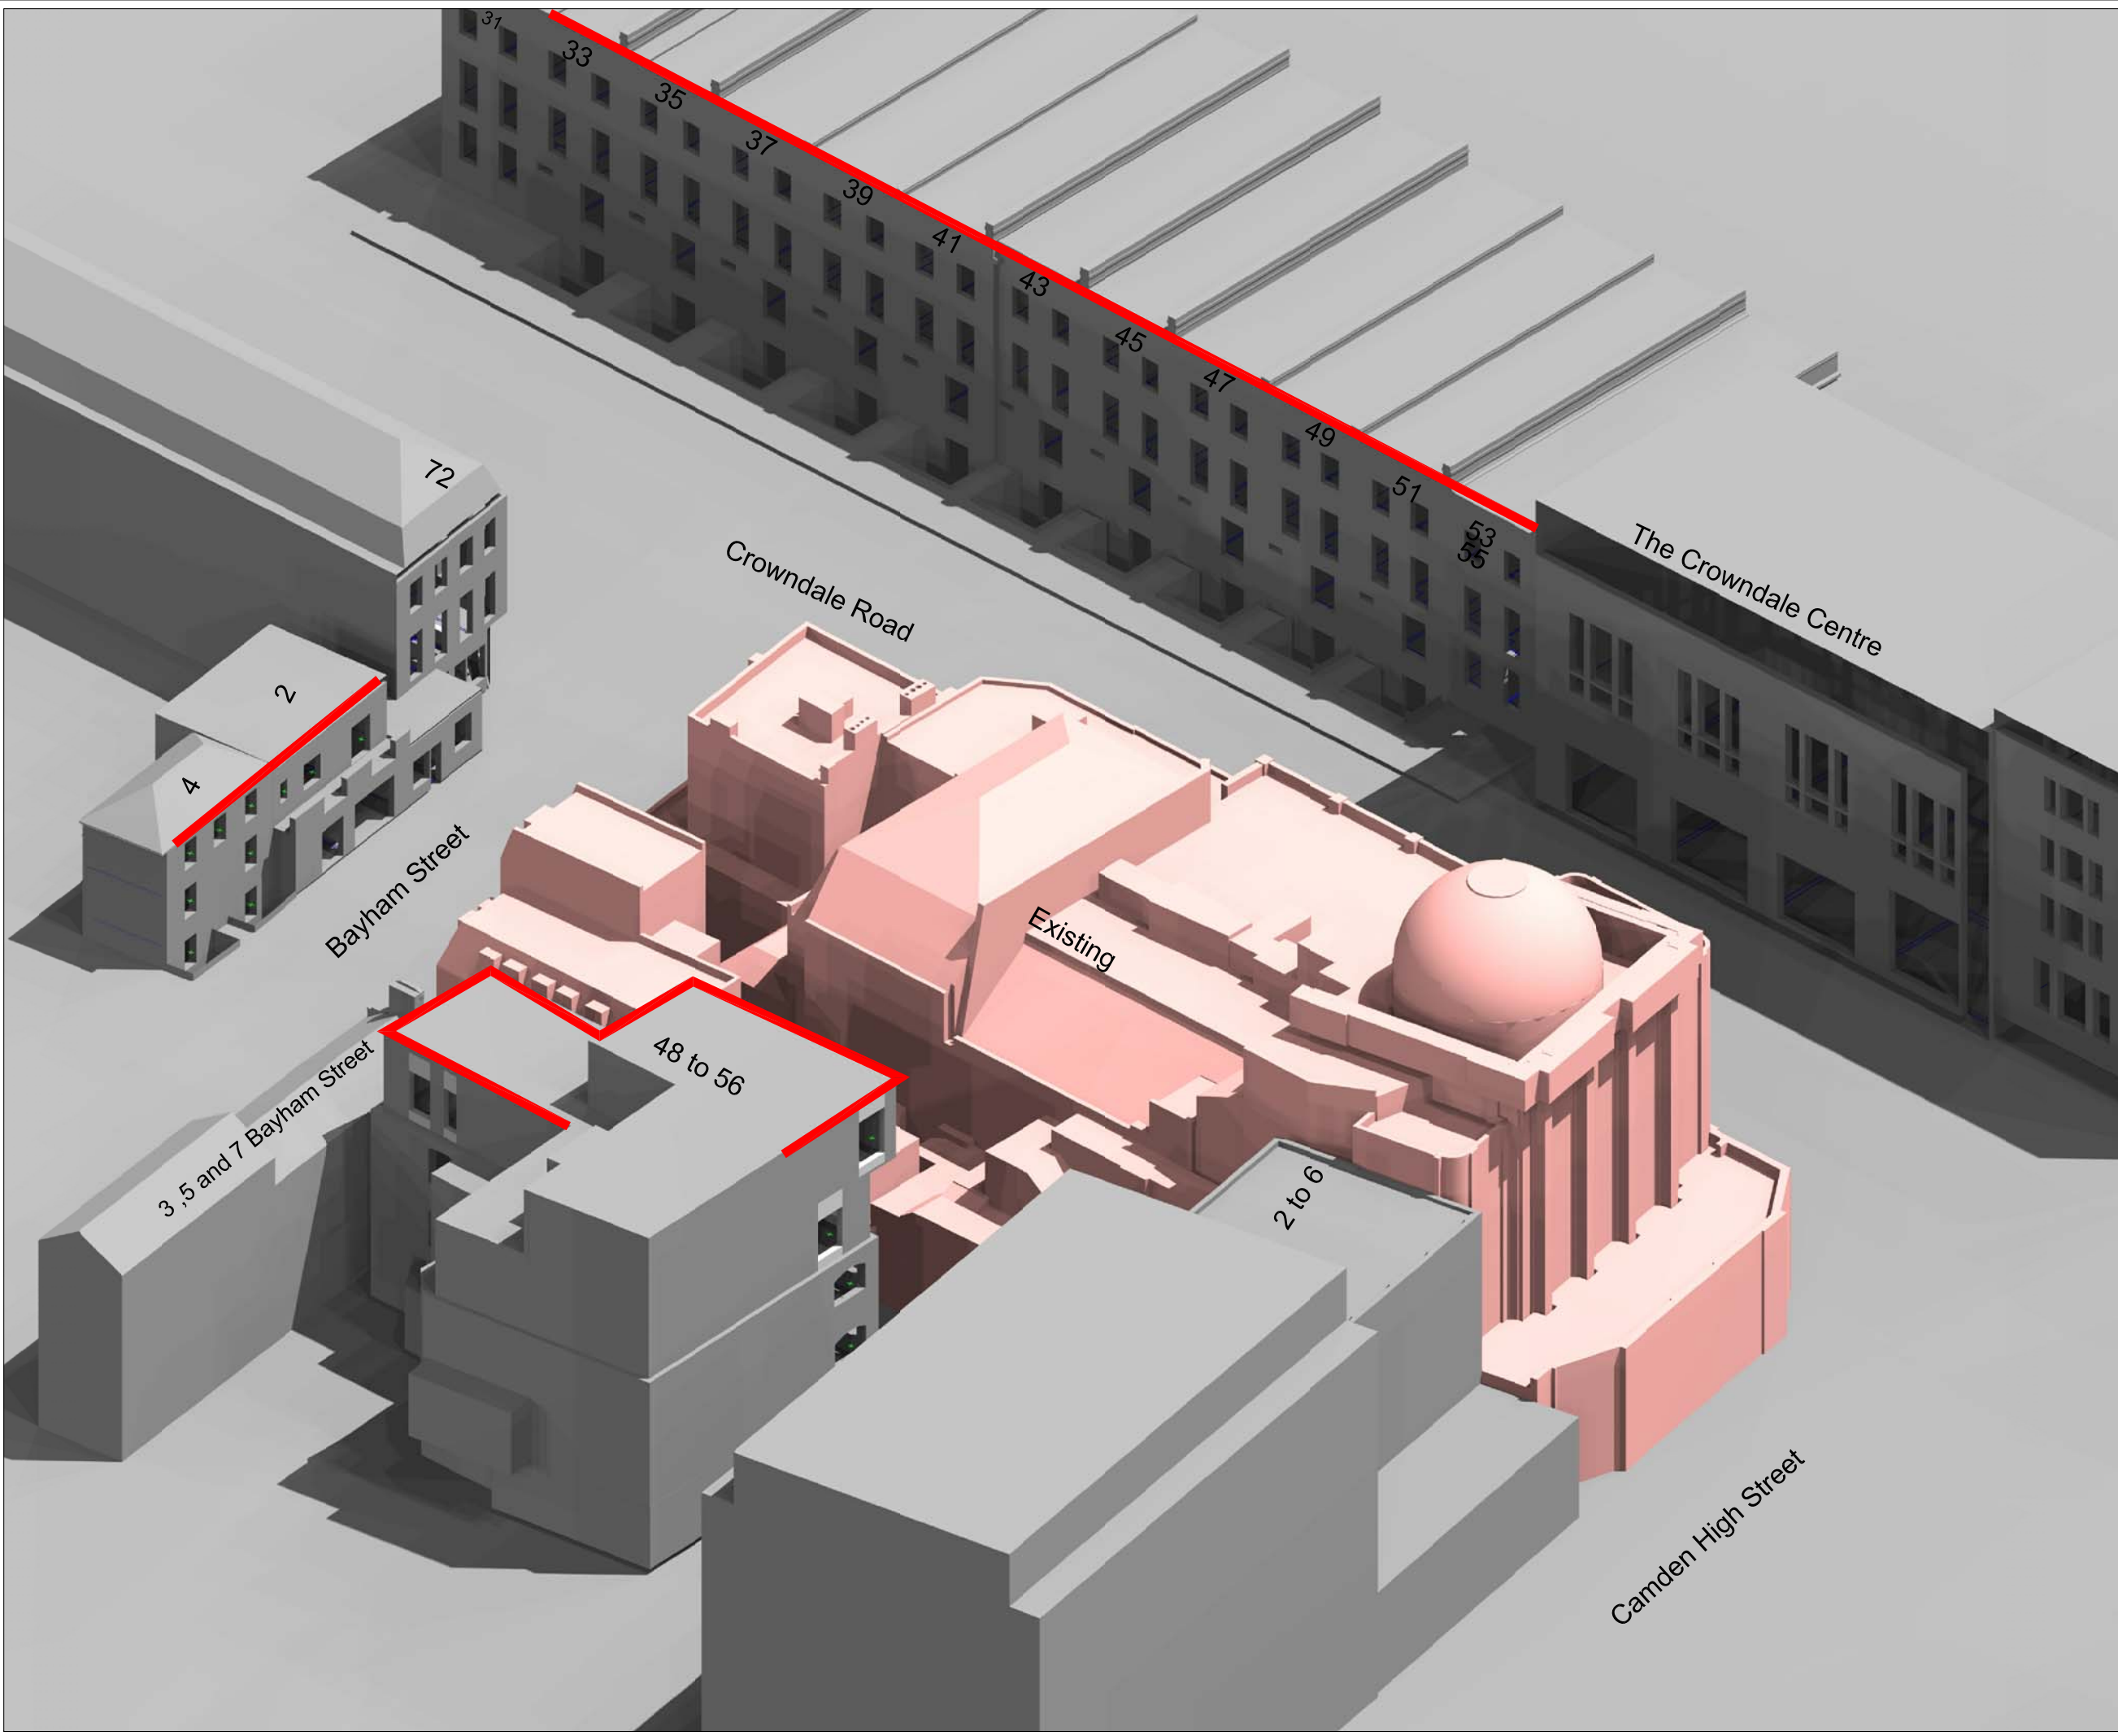

Sources of Information

**Existing And Surrounding Buildings**

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**

Archer Humphries Architects  
 18 Oct 2017

AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited

Drawing Title  
 Existing 3D View



Drawn By AH	Chk'd By	Scale @ A3	Date 18/10/2017
----------------	----------	------------	--------------------

Project No. HO81-17	Drawing No. BRE/142	Revision -
------------------------	------------------------	---------------

Daylight

A3

This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

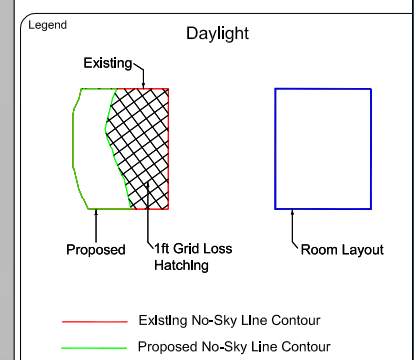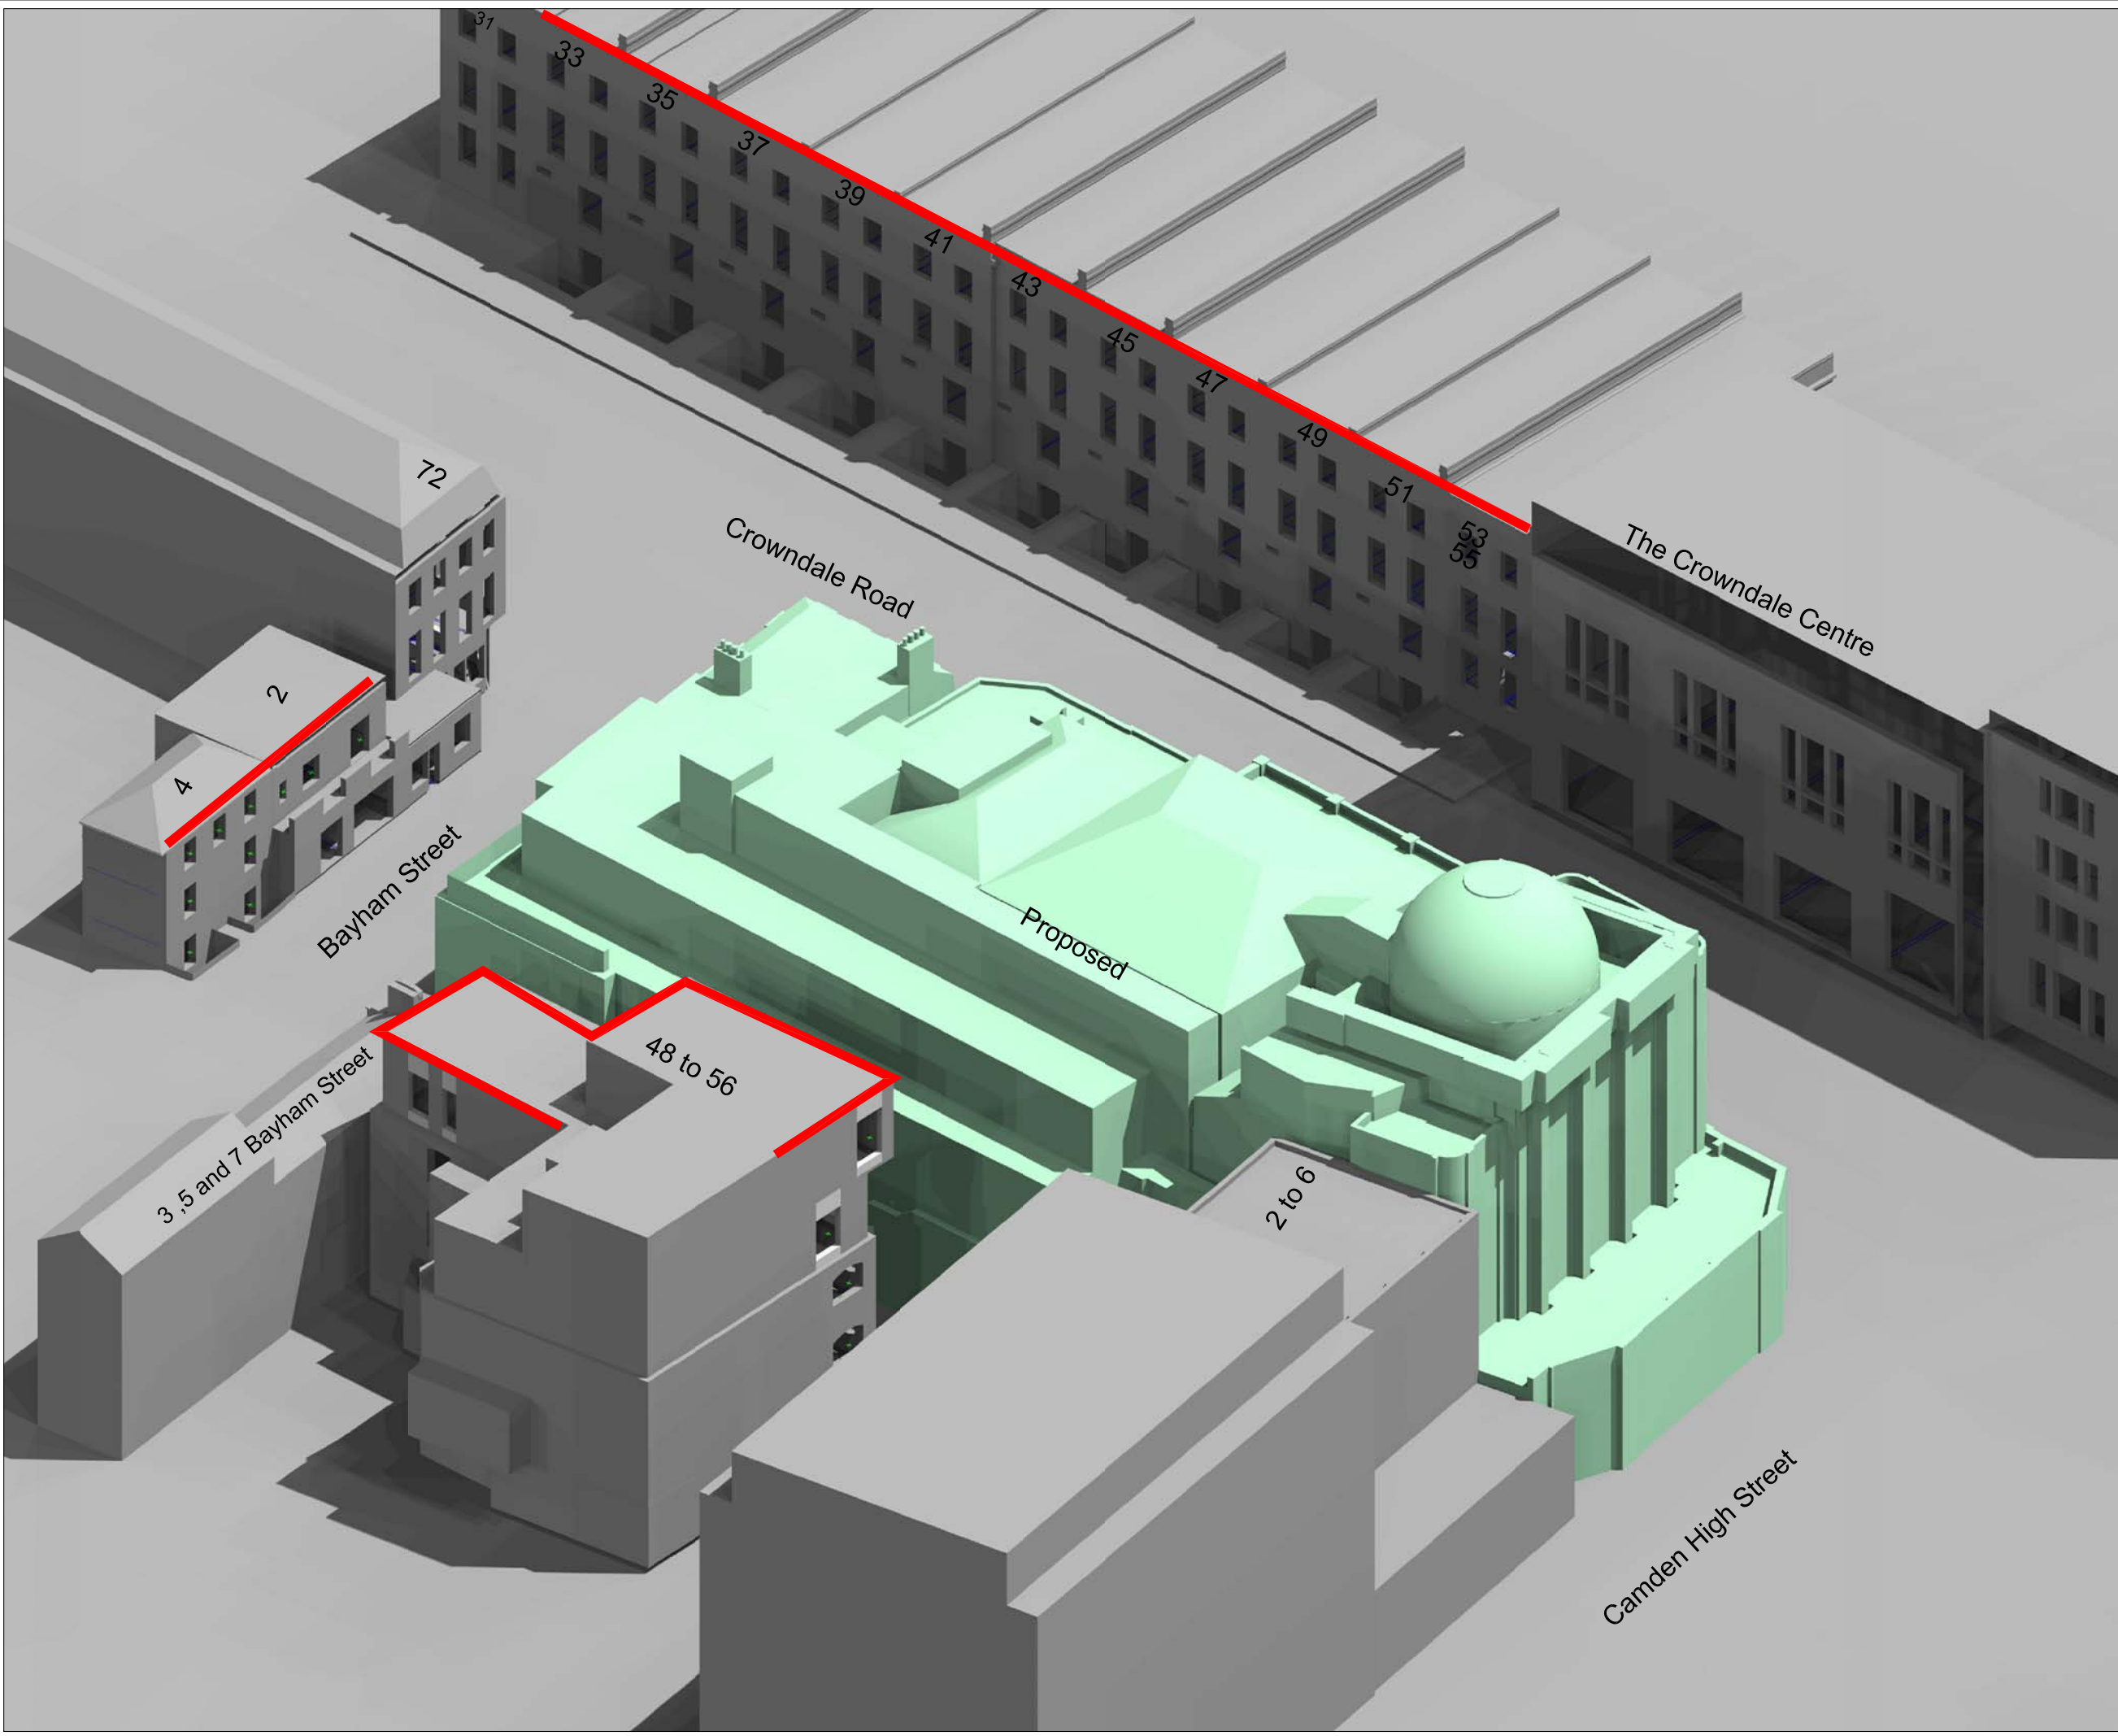

Sources of Information

**Existing And Surrounding Buildings**

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**

Archer Humphries Architects  
 18 Oct 2017

AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited

Drawing Title  
 Proposed 3D View

Drawn By AH	Chk'd By	Scale @ A3	Date 18/10/2017
----------------	----------	------------	--------------------

Project No. HO81-17	Drawing No. BRE/143	Revision -
------------------------	------------------------	---------------


Daylight

A3


This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.



Ground Floor

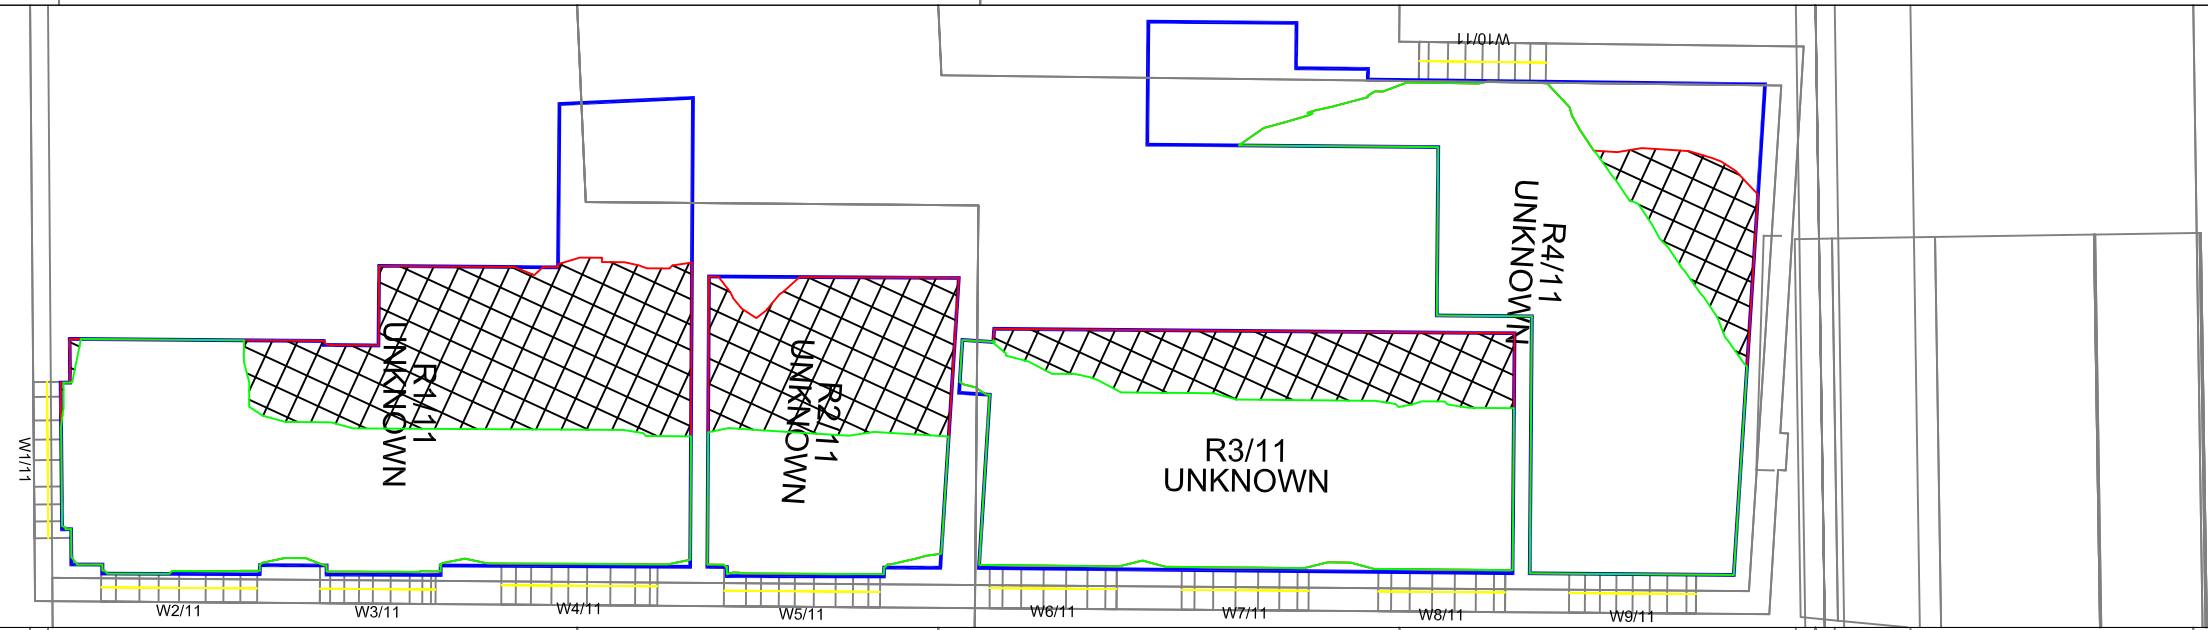

First Floor

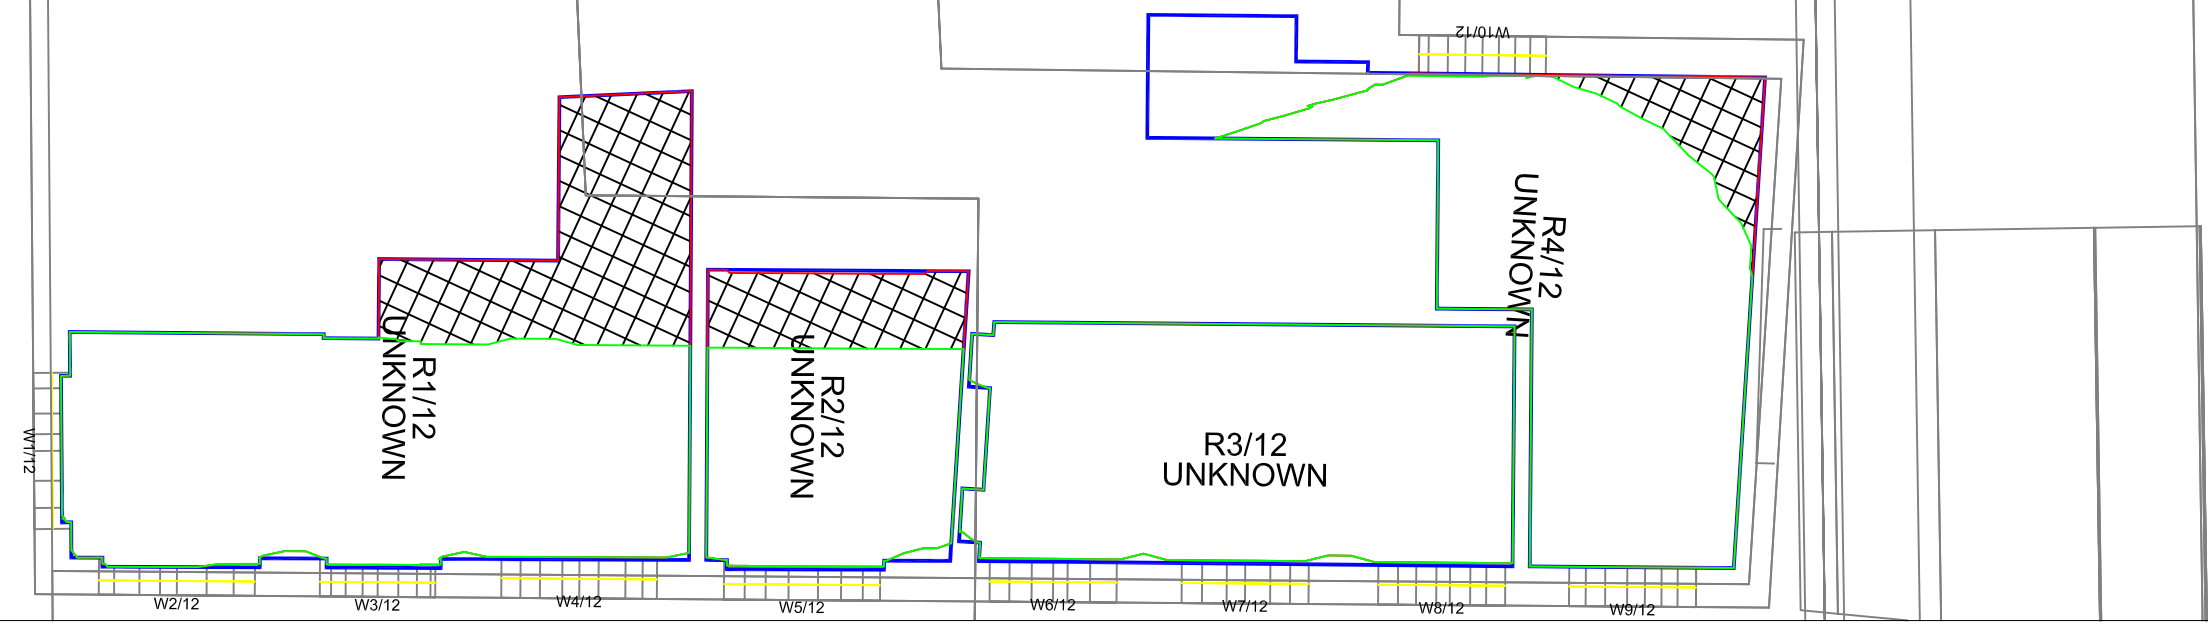

Second Floor

**Legend**

**Daylight**

Existing  
Proposed  
1R Grid Loss Hatching  
Room Layout

Existing No-Sky Line Contour  
Proposed No-Sky Line Contour

- Sources of Information**
- Existing And Surrounding Buildings**
- On Centre Surveys LTD
  - 23745A-7 ROOF PLAN
  - 23745A-8-1
  - 23745A-8-2
  - 23745A-8-3
  - 23745A-8-4
  - 23745A-8-5
  - 23745A-8-6
  - 23745A-8-7
  - 23745A-8-8
  - 48-56 Bayham Place
  - 04 April 2017
  - 48 56 Bayham Place drawings
- Proposed Scheme**
- Archer Humphreys Architects  
18 Oct 2017
- AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17
  - AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17
  - AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17
  - AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17
  - AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17
  - AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17
  - AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17
  - AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17
  - AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-201 [-] Proposed Crownside Road Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

**GVA**  
An APLEONA company

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

**Project Name**  
The Hope Project, Koko, Camden  
London

**Client**  
Vevil International Limited

**Drawing Title**  
No sky-line contours for  
48 to 56 Bayham Place


<b>Drawn By</b> AH	<b>Chk'd By</b>	<b>Scale @ A3</b> 1:100	<b>Date</b> 18/10/2017
-----------------------	-----------------	----------------------------	---------------------------

<b>Project No.</b> HO81-17	<b>Drawing No.</b> BRE/144	<b>Revision</b> -
-------------------------------	-------------------------------	----------------------


Daylight

**A3**


This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

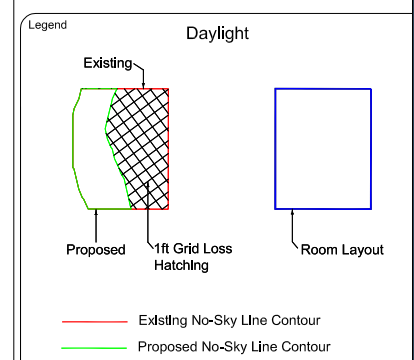

- Sources of Information
- Existing And Surrounding Buildings**
- On Centre Surveys LTD
  - 23745A-7 ROOF PLAN
  - 23745A-8-1
  - 23745A-8-2
  - 23745A-8-3
  - 23745A-8-4
  - 23745A-8-5
  - 23745A-8-6
  - 23745A-8-7
  - 23745A-8-8
- 48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings
- Proposed Scheme**
- Archer Humphries Architects  
 18 Oct 2017
- AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17
  - AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17
  - AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17
  - AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17
  - AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17
  - AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17
  - AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17
  - AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17
  - AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-201 [-] Proposed Crownside Road Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17
  - AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

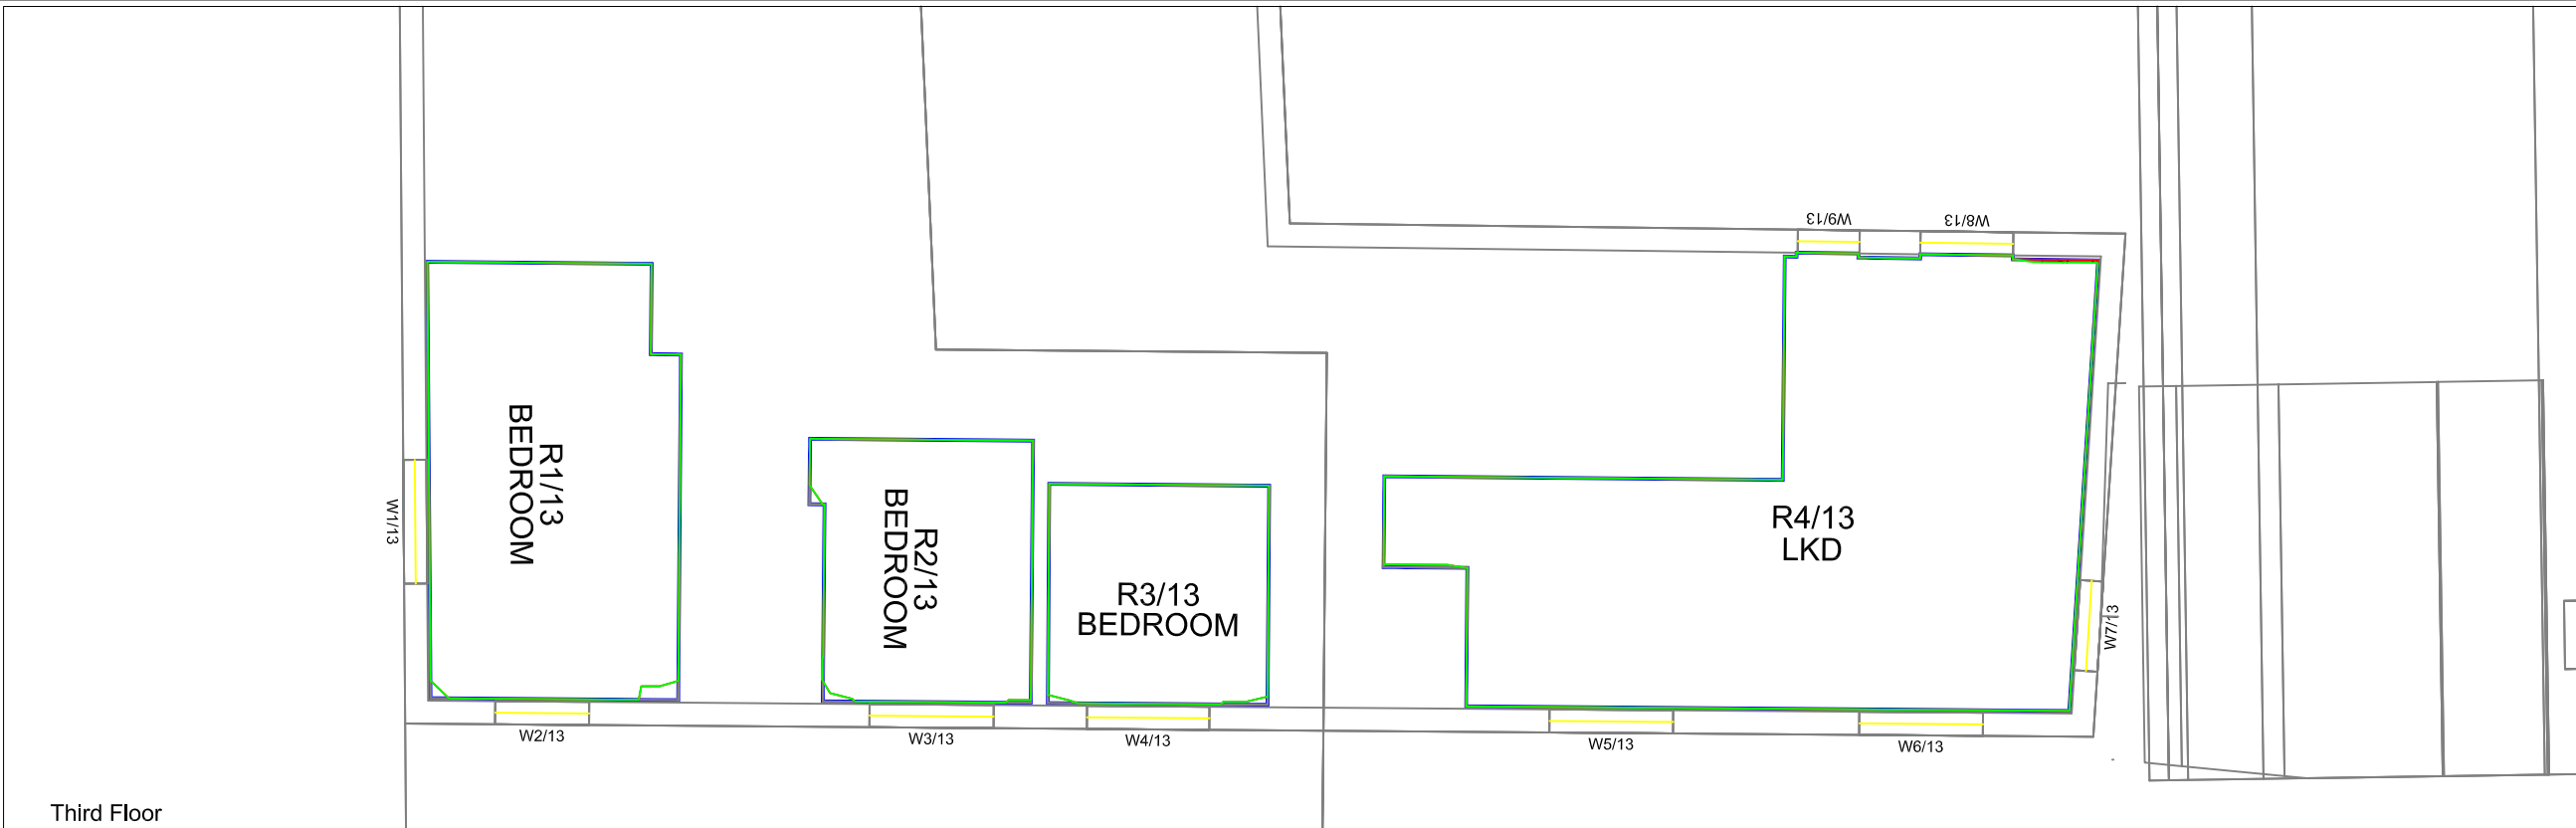

Third Floor

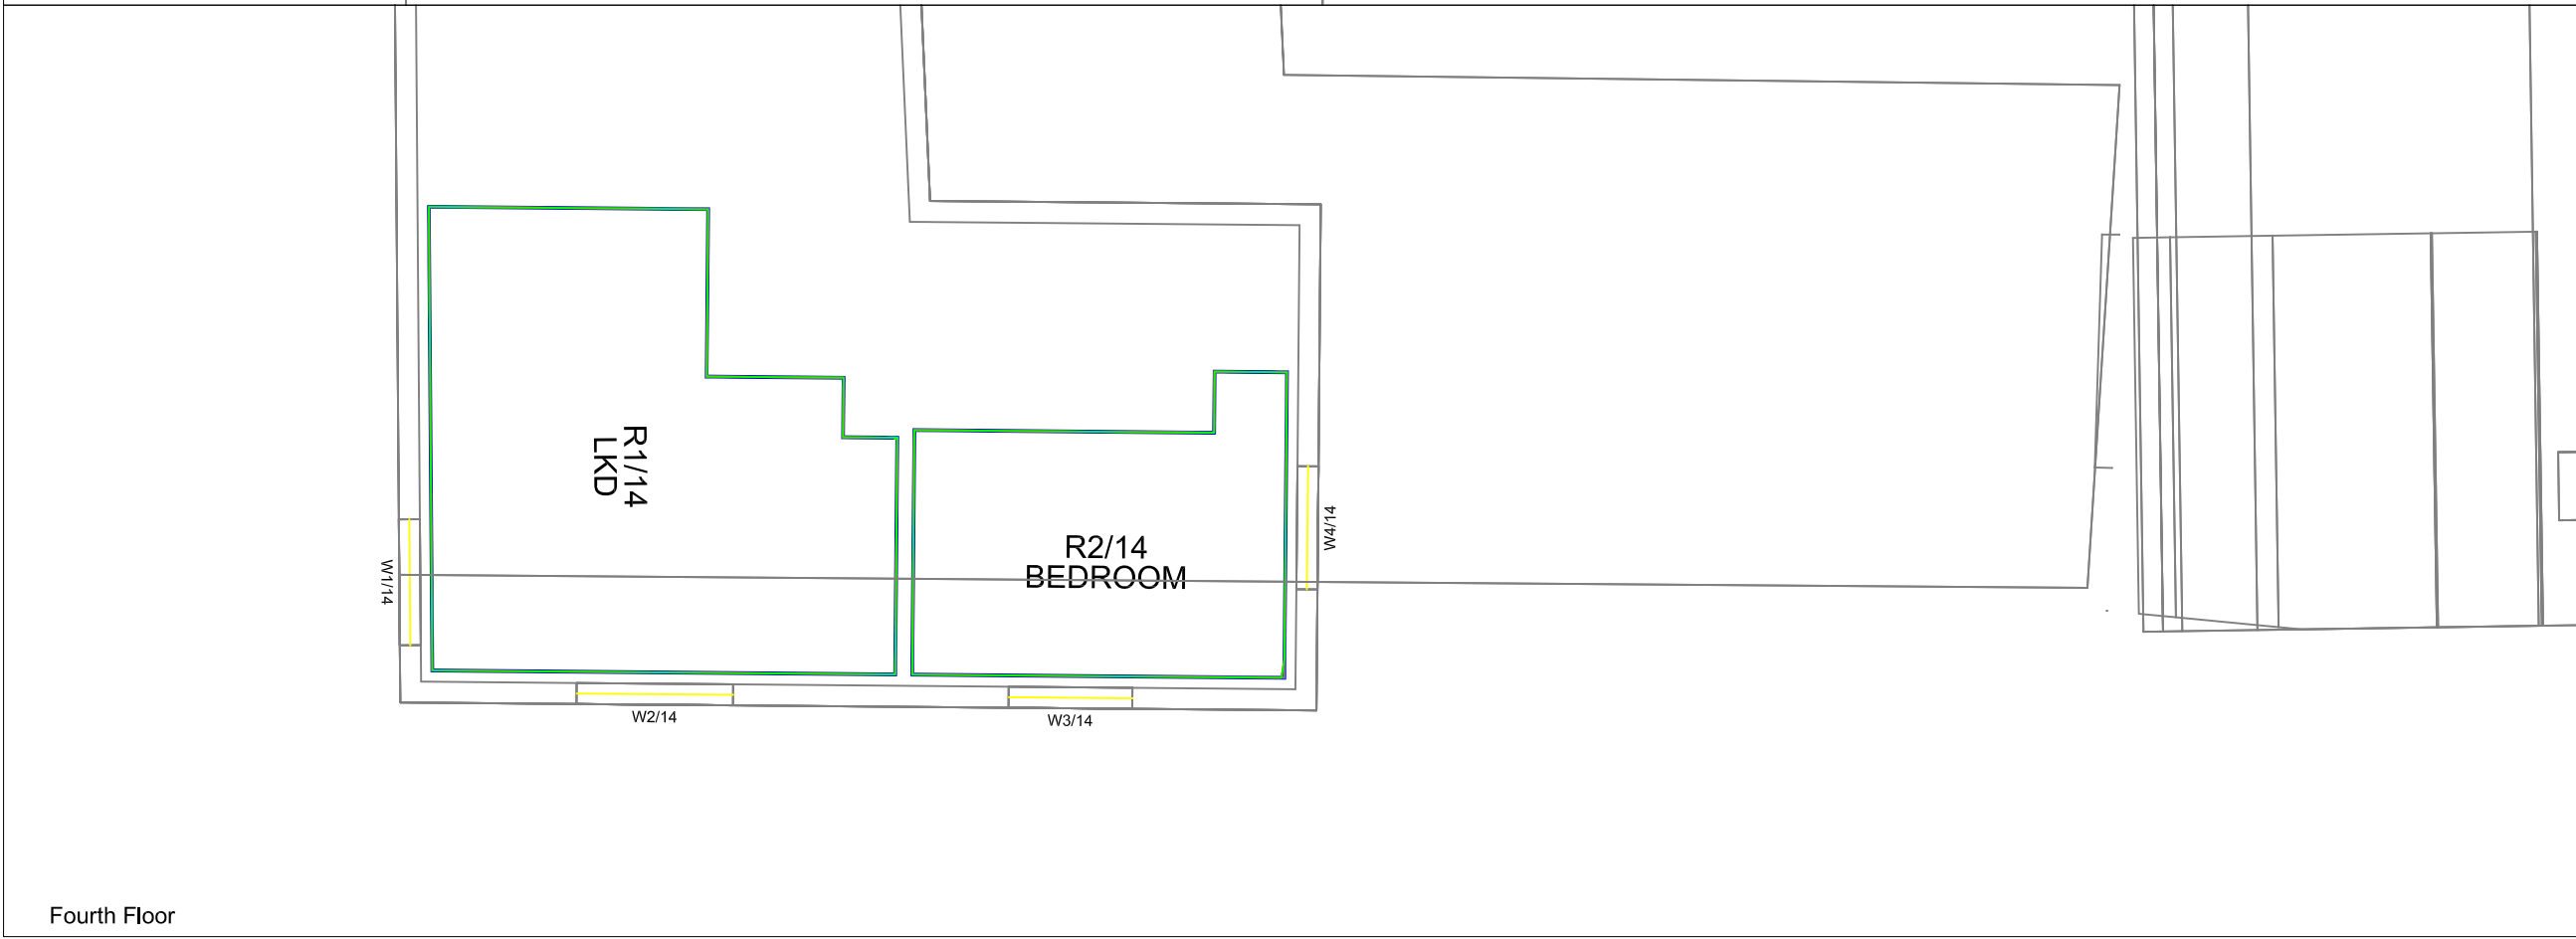

Fourth Floor

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited


Drawing Title  
 No sky-line contours for  
 48 to 56 Bayham Place

Drawn By AH	Chk'd By	Scale @ A3 1:100	Date 18/10/2017
----------------	----------	---------------------	--------------------

Project No. HO81-17	Drawing No. BRE/145	Revision -
------------------------	------------------------	---------------

Daylight

**A3**

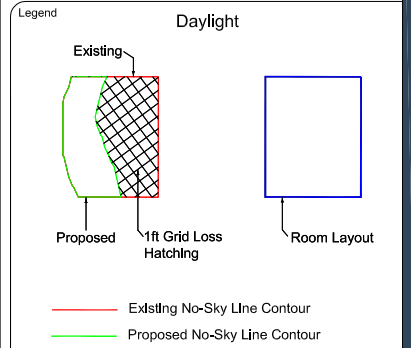

Sources of Information




Existing And Surrounding Buildings

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

Proposed Scheme

Archer Humphries Architects  
 18 Oct 2017  
 AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crownmole Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

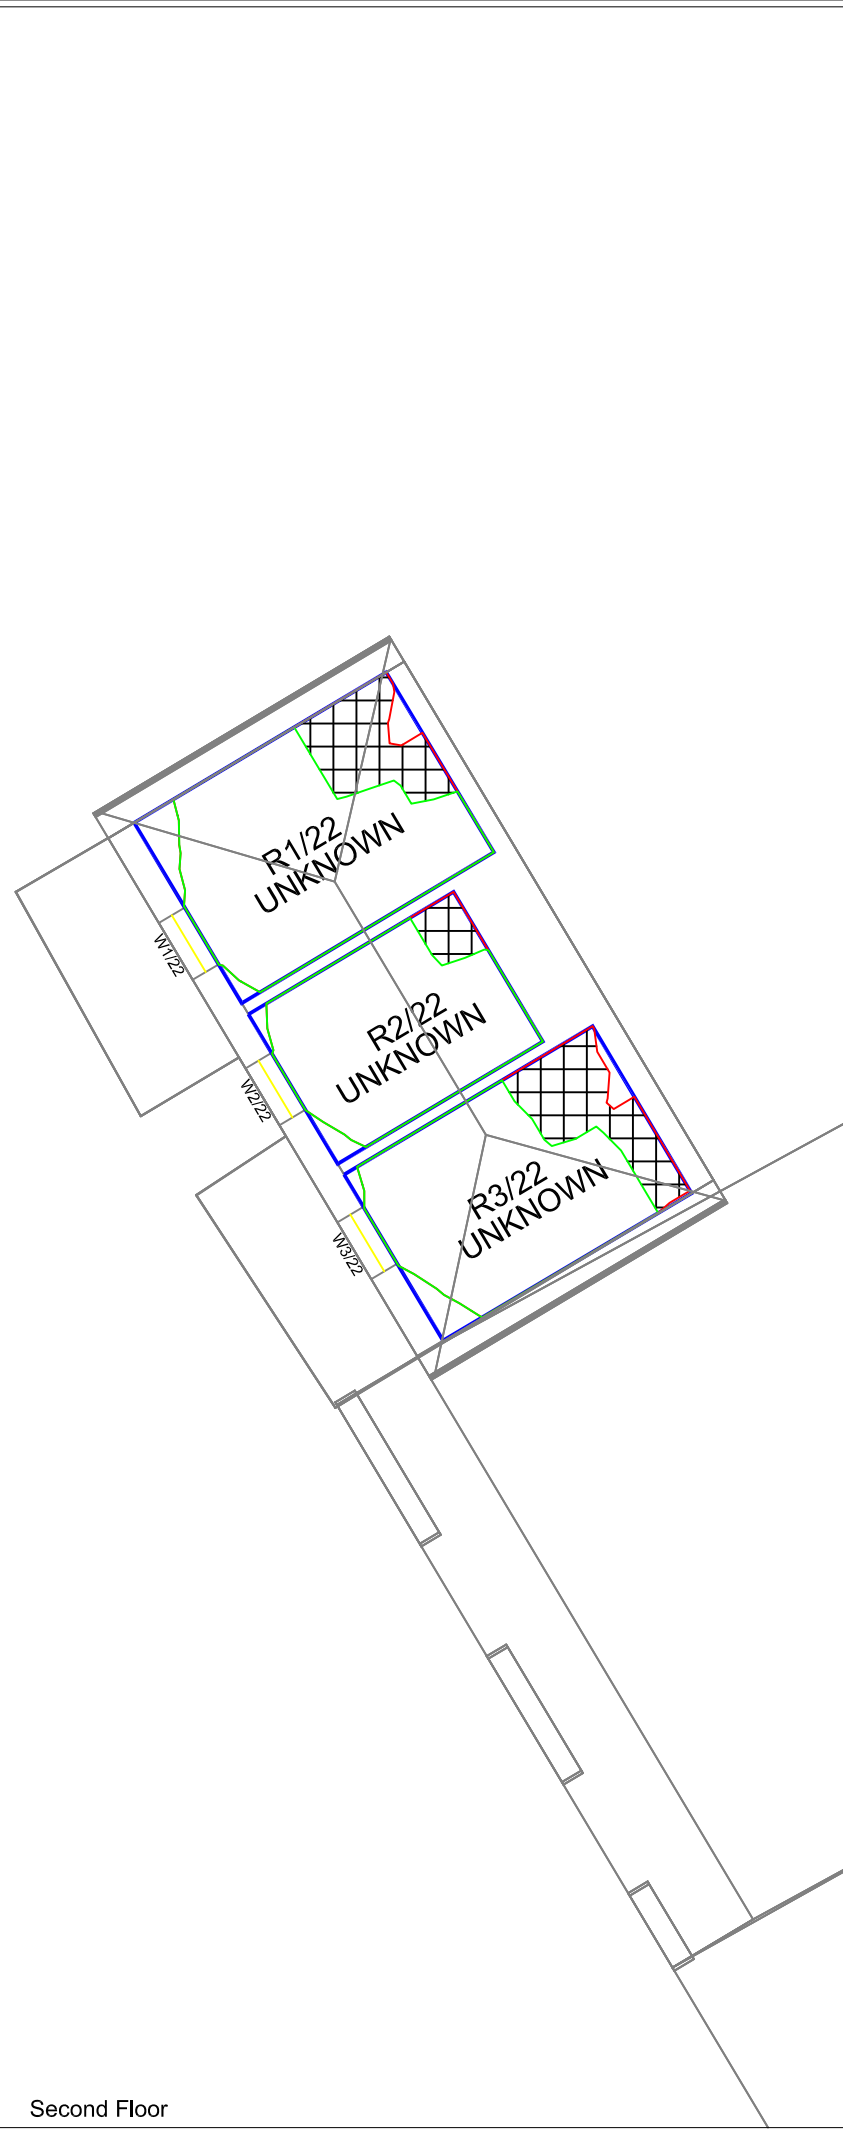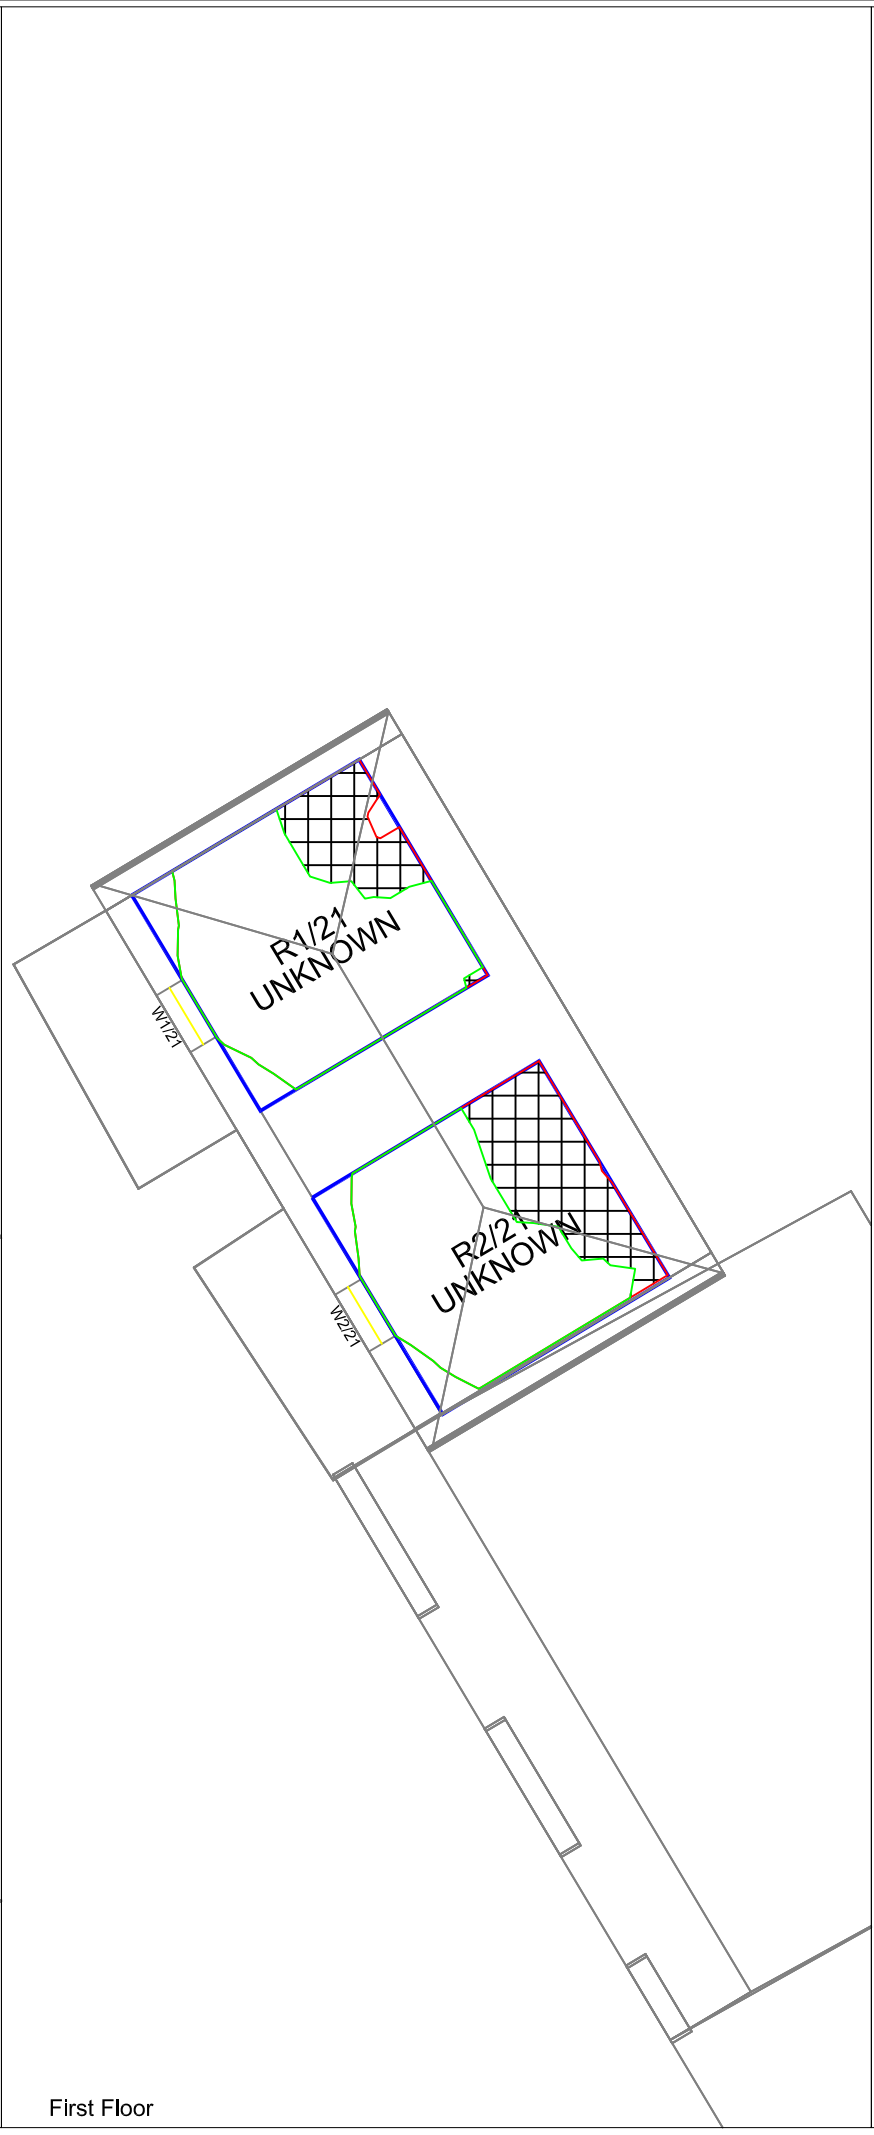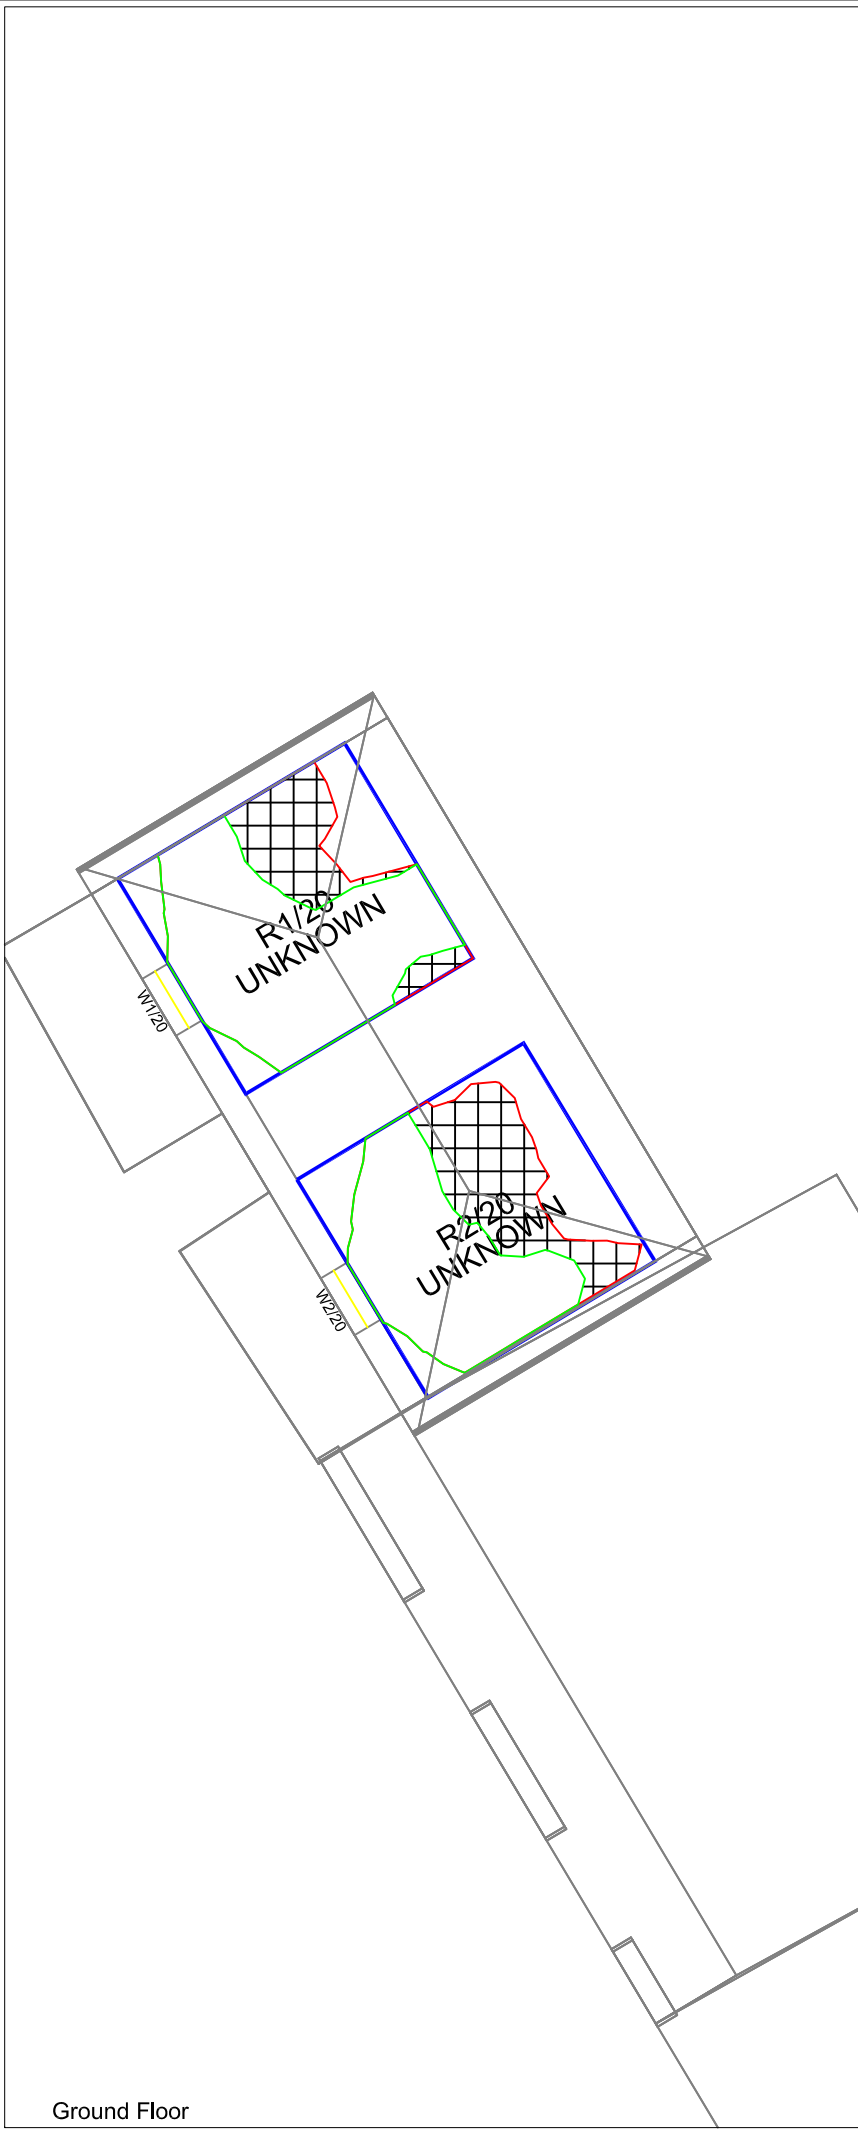

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited


Drawing Title  
 No sky-line contours for  
 4 Bayham Street

Drawn By AH	Chk'd By	Scale @ A3 1:100	Date 18/10/2017
----------------	----------	---------------------	--------------------

Project No. HO81-17	Drawing No. BRE/146	Revision -
------------------------	------------------------	---------------



First Floor

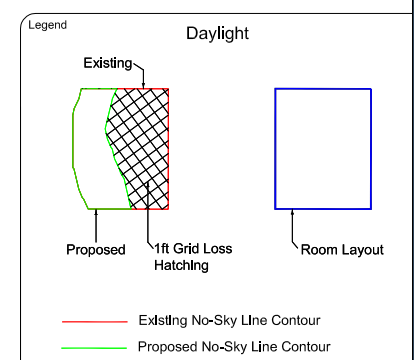

**Sources of Information**

**Existing And Surrounding Buildings**

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**

Archer Humphries Architects  
 18 Oct 2017

AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crownside Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

**Project Name**  
 The Hope Project, Koko, Camden  
 London


**Client**  
 Vevil International Limited

**Drawing Title**  
 No sky-line contours for  
 2 Bayham Street

<b>Drawn By</b> AH	<b>Chk'd By</b>	<b>Scale @ A3</b> 1:100	<b>Date</b> 18/10/2017
-----------------------	-----------------	----------------------------	---------------------------

<b>Project No.</b> HO81-17	<b>Drawing No.</b> BRE/147	<b>Revision</b> -
-------------------------------	-------------------------------	----------------------

This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

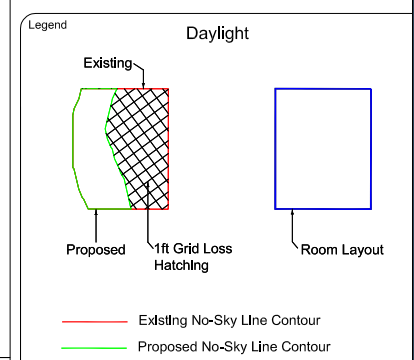

**Sources of Information**

**Existing And Surrounding Buildings**

- On Centre Surveys LTD
- 23745A-7 ROOF PLAN
- 23745A-8-1
- 23745A-8-2
- 23745A-8-3
- 23745A-8-4
- 23745A-8-5
- 23745A-8-6
- 23745A-8-7
- 23745A-8-8
- 48-56 Bayham Place
- 04 April 2017
- 48 56 Bayham Place drawings

**Proposed Scheme**

- Archer Humphries Arch@ects
- 18 Oct 2017
- AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17
- AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17
- AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17
- AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17
- AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17
- AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17
- AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17
- AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17
- AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17
- AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17



**GVA**  
 An APLEONA company

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

**Project Name**  
 The Hope Project, Koko, Camden  
 London

**Client**  
 Vevil International Limited

**Drawing Title**  
 No sky-line contours for  
 31 to 41 Crowndale Road

**Drawn By**  
 AH

**Chk'd By**  
 AH

**Scale @ A3**  
 1:100



**Date**  
 18/10/2017

**Project No.**  
 HO81-17

**Drawing No.**  
 BRE/148

**Revision**  
 -

This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

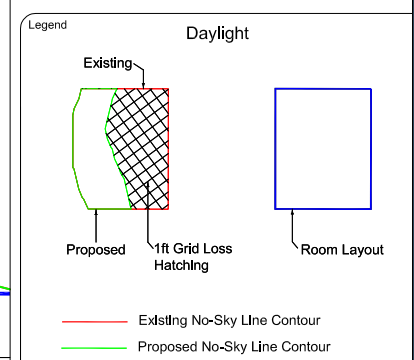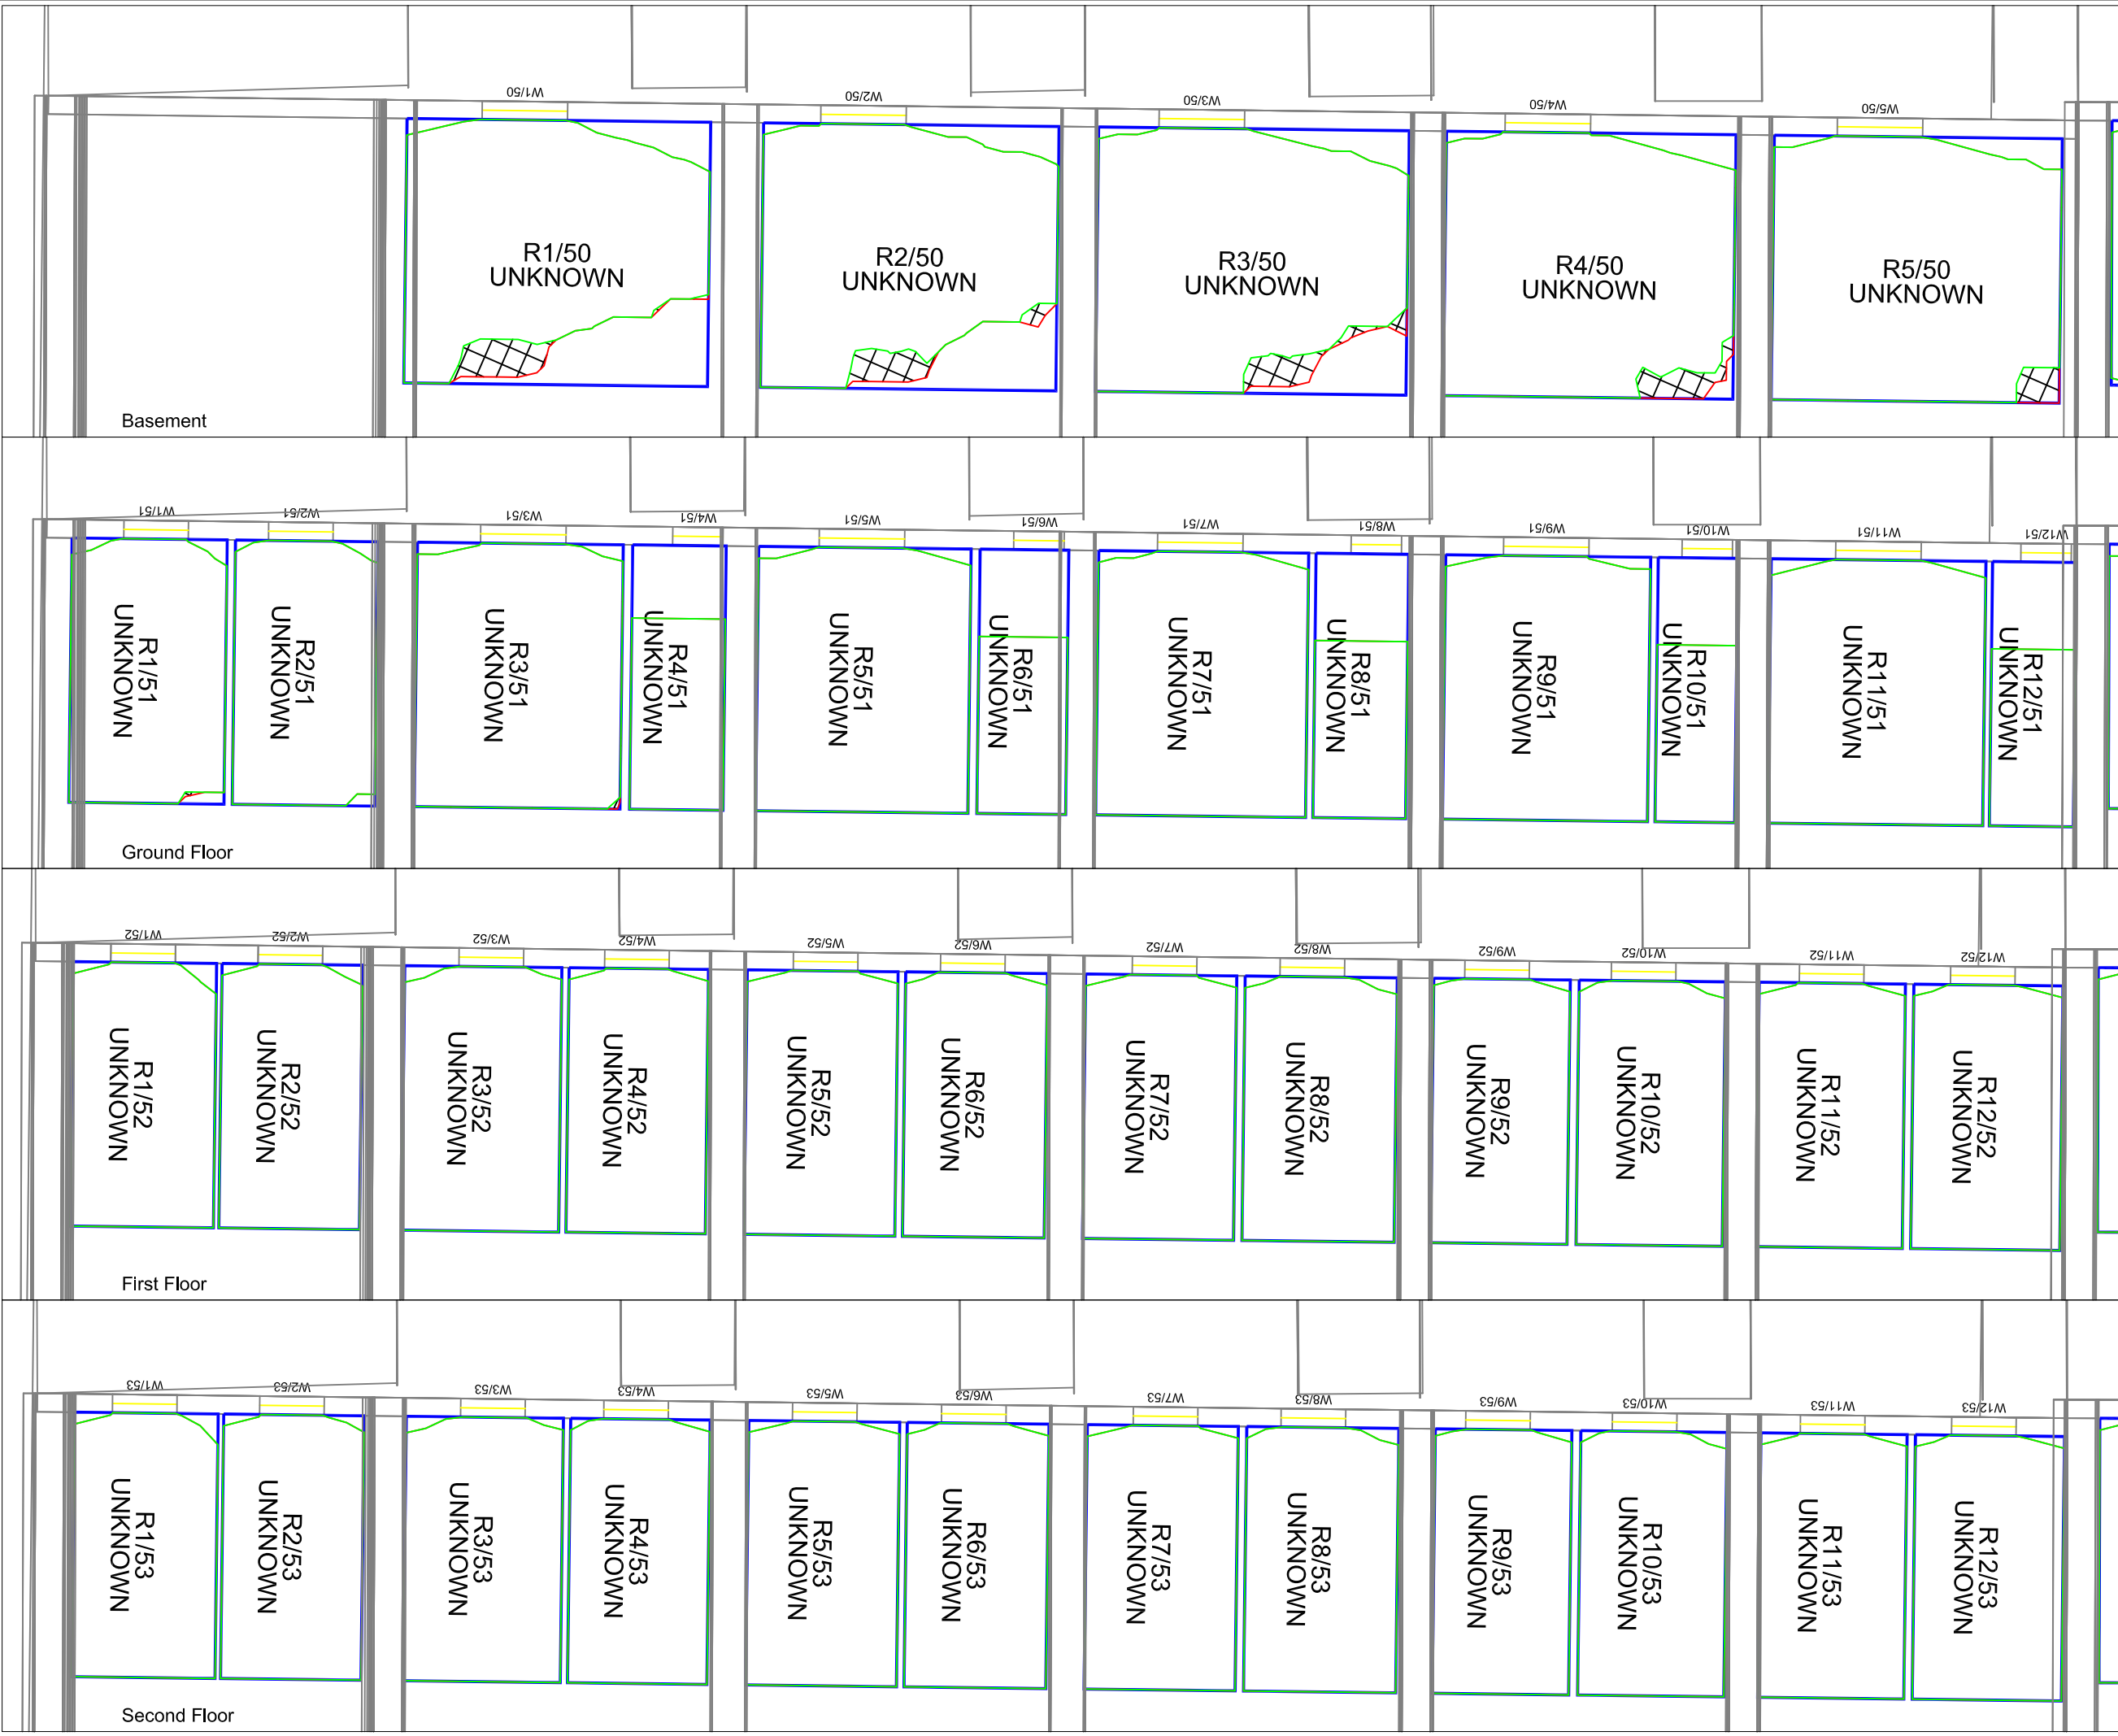

**Sources of Information**

**Existing And Surrounding Buildings**

On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8

48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**

Archer Humphries Arch@ects  
 18 Oct 2017

AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crowndale Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17


**GVA**  
 An APLEONA company

08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

<b>Project Name</b>			
The Hope Project, Koko, Camden London			
<b>Client</b>			
Vevil International Limited			
<b>Drawing Title</b>			
No sky-line contours for 43 to 55 Crowndale Road			
<b>Drawn By</b>	<b>Chk'd By</b>	<b>Scale @ A3</b>	<b>Date</b>
AH		1:100	18/10/2017
<b>Project No.</b>	<b>Drawing No.</b>	<b>Revision</b>	
HO81-17	BRE/149	-	



This drawing is Copyright © of GVA Grimley Limited.  
 Do not scale this drawing.  
 All dimensions to be checked on site. Drawing to be read in conjunction with any specifications, schedules and Consultants drawings and details.

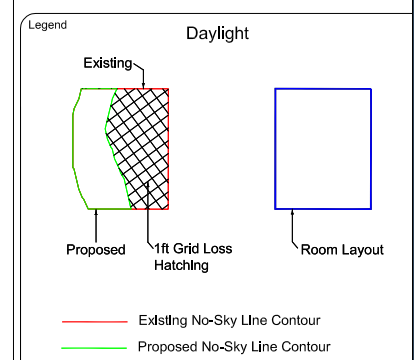

Sources of Information

**Existing And Surrounding Buildings**  
 On Centre Surveys LTD  
 23745A-7 ROOF PLAN  
 23745A-8-1  
 23745A-8-2  
 23745A-8-3  
 23745A-8-4  
 23745A-8-5  
 23745A-8-6  
 23745A-8-7  
 23745A-8-8  
 48-56 Bayham Place  
 04 April 2017  
 48 56 Bayham Place drawings

**Proposed Scheme**  
 Archer Humphries Architects  
 18 Oct 2017  
 AHA-KKC-GA-098 [-] Proposed LBF Plan dated 17.10.17  
 AHA-KKC-GA-099 [-] Proposed BF Plan dated 17.10.17  
 AHA-KKC-GA-100 [-] Proposed GF Plan dated 17.10.17  
 AHA-KKC-GA-101 [-] Proposed 1F Plan dated 17.10.17  
 AHA-KKC-GA-102 [-] Proposed 2F Plan dated 17.10.17  
 AHA-KKC-GA-103 [-] Proposed 3F Plan dated 17.10.17  
 AHA-KKC-GA-104 [-] Proposed 4F Plan dated 17.10.17  
 AHA-KKC-GA-105 [-] Proposed Roof Plan dated 17.10.17  
 AHA-KKC-PR-200 [-] Proposed Front Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-201 [-] Proposed Crownside Road Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-202 [-] Proposed Bayham Street Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-203 [-] Proposed Bayham Place Elevation DRAFT dated 11.10.17  
 AHA-KKC-PR-300 [-] Proposed Section AA DRAFT dated 13.10.17



08449 02 03 04  
 GVA Schatunowski Brooks  
 65 Gresham Street, London, EC2V 7NQ  
 www.gva.co.uk

Project Name  
 The Hope Project, Koko, Camden  
 London

Client  
 Vevil International Limited

Drawing Title  
 No sky-line contours for  
 3, 5 and 7 Bayham Street

Drawn By AH	Chk'd By	Scale @ A3 1:100	Date 18/10/2017
----------------	----------	---------------------	--------------------

Project No. HO81-17	Drawing No. BRE/150	Revision -
------------------------	------------------------	---------------

Daylight

A3

# GVA

An **APLEONA** company

GVA Schatunowski Brooks

Appendix II

[gva.co.uk](http://gva.co.uk)



The Hope Project, Koko, Camden

Daylight analysis results  
Job 17  
18-Oct-17

Room/Floor	Room Use	Window	%VSC			% Daylight Factor			Proposed No Sky	
			Exist	Prop	% Loss	Exist	Prop	% Loss	% of Room Area	% Loss of Existing
<b>48 to 56 Bayham Place - BRE144, 145</b>										
<b>Gnd Floor</b>										
R1/10	UNKNOWN	W1/10	13.98	13.67	2.22%	4.57	3.66	20.03%	63.30%	23.23%
		W2/10	18.83	12.11	35.69%					
R2/10	UNKNOWN	W3/10	19.41	12.30	36.63%	3.66	2.19	40.20%	40.53%	58.68%
R3/10	UNKNOWN	W4/10	19.78	12.48	36.91%	2.10	1.27	39.25%	23.64%	64.42%
		W5/10	19.97	12.67	36.55%					
		W7/10	19.92	12.76	35.94%					
R4/10	UNKNOWN	W8/10	18.57	12.40	33.23%	2.64	1.29	51.06%	28.49%	61.46%
R5/10	UNKNOWN	W9/10	18.04	12.47	30.88%	1.62	0.81	49.94%	17.60%	62.81%
R6/10	UNKNOWN	W10/10	17.41	12.50	28.20%	1.68	1.43	15.38%	85.53%	0.70%
		W11/10	33.82	33.82	>27					
<b>1st Floor</b>										
R1/11	UNKNOWN	W1/11	17.93	17.64	1.62%	4.40	3.64	17.20%	54.42%	37.82%
		W2/11	23.81	17.33	27.22%					
		W3/11	24.28	17.43	28.21%					
		W4/11	24.63	17.62	28.46%					
R2/11	UNKNOWN	W5/11	25.13	17.92	28.69%	3.07	2.37	22.65%	45.35%	52.86%
R3/11	UNKNOWN	W6/11	25.29	18.32	27.56%	5.75	4.50	21.73%	73.21%	25.52%
		W7/11	25.41	18.54	27.04%					
		W8/11	25.45	18.79	26.17%					
R4/11	UNKNOWN	W9/11	25.67	19.02	25.91%	2.84	2.53	10.88%	67.72%	13.20%
		W10/11	23.51	23.51	0.00%					
<b>2nd Floor</b>										
R1/12	UNKNOWN	W1/12	22.70	22.45	1.10%	4.99	4.36	12.69%	73.65%	25.70%
		W2/12	27.85	22.32	19.86%					
		W3/12	27.99	22.14	20.90%					
		W4/12	28.22	22.14	21.55%					
R2/12	UNKNOWN	W5/12	29.10	22.75	21.82%	3.44	2.86	16.90%	71.46%	26.82%
R3/12	UNKNOWN	W6/12	30.26	23.82	21.28%	6.73	5.55	17.50%	98.31%	0.00%
		W7/12	31.12	24.50	21.27%					
		W8/12	31.88	25.09	21.30%					
R4/12	UNKNOWN	W9/12	32.42	25.63	20.94%	3.38	3.08	9.07%	78.49%	9.96%
		W10/12	30.39	30.39	>27					

Room/Floor	Room Use	Window	%VSC			% Daylight Factor			Proposed No Sky	
			Exist	Prop	% Loss	Exist	Prop	% Loss	% of Room Area	% Loss of Existing
<b>3rd Floor</b>										
R1/13	BEDROOM	W1/13	27.58	27.44	>27	4.04	3.84	5.07%	99.31%	0.00%
		W2/13	21.44	17.59	17.96%					
R2/13	BEDROOM	W3/13	21.00	16.70	20.48%	3.40	2.89	15.07%	99.24%	0.00%
R3/13	BEDROOM	W4/13	22.02	17.59	20.12%	3.90	3.32	14.95%	99.34%	0.00%
R4/13	LKD	W5/13	34.87	30.18	>27	6.67	6.31	5.44%	99.81%	0.10%
		W6/13	36.48	31.80	>27					
		W7/13	39.46	39.01	>27					
		W8/13	38.16	38.16	>27					
		W9/13	37.50	37.50	>27					
<b>4th Floor</b>										
R1/14	LKD	W1/14	33.54	33.43	>27	5.03	4.90	2.66%	100.00%	0.00%
		W2/14	37.70	35.77	>27					
R2/14	BEDROOM	W3/14	38.18	36.24	>27	7.64	7.45	2.56%	99.94%	0.00%
		W4/14	39.61	39.29	>27					
<b>4 Bayham Street - BRE146</b>										
<b>Base Floor</b>										
R1/20	UNKNOWN	W1/20	24.89	22.18	10.89%	0.73	0.65	10.56%	63.62%	23.36%
R2/20	UNKNOWN	W2/20	21.46	18.27	14.86%	0.69	0.60	13.17%	45.78%	37.26%
<b>Gnd Floor</b>										
R1/21	UNKNOWN	W1/21	28.84	25.95	10.02%	0.81	0.74	9.59%	75.30%	18.72%
R2/21	UNKNOWN	W2/21	26.90	23.61	12.23%	0.79	0.70	11.44%	63.73%	31.43%
<b>1st Floor</b>										
R1/22	UNKNOWN	W1/22	32.12	29.23	>27	0.80	0.73	8.81%	76.47%	18.40%
R2/22	UNKNOWN	W2/22	31.84	28.75	>27	1.03	0.93	9.79%	89.03%	7.79%
R3/22	UNKNOWN	W3/22	31.59	28.50	>27	0.83	0.75	9.88%	72.32%	22.93%
<b>2 Bayham Street - BRE147</b>										
<b>1st Floor</b>										
R1/31	UNKNOWN	W1/31	30.67	27.53	>27	0.50	0.45	10.93%	51.47%	32.88%
R2/31	UNKNOWN	W2/31	30.38	27.25	>27	1.13	1.03	8.70%	56.93%	33.60%
R3/31	UNKNOWN	W3/31	29.92	26.98	9.83%	1.44	1.33	7.85%	59.79%	30.96%
<b>31 to 41 Crowdale Road - BRE148</b>										
<b>Base Floor</b>										
R6/50	UNKNOWN	W6/50	25.43	25.20	0.90%	1.19	1.18	0.84%	94.81%	1.06%
R7/50	UNKNOWN	W7/50	25.70	25.60	0.39%	1.19	1.18	0.50%	95.91%	0.00%
R8/50	UNKNOWN	W8/50	25.88	25.88	0.00%	1.20	1.20	0.08%	95.67%	0.00%
R9/50	UNKNOWN	W9/50	25.93	25.93	0.00%	1.21	1.21	0.00%	96.03%	0.00%
R10/50	UNKNOWN	W10/50	26.32	26.32	0.00%	1.20	1.20	0.00%	95.54%	0.00%
<b>Gnd Floor</b>										
R13/51	UNKNOWN	W13/51	33.00	32.59	>27	1.78	1.76	1.07%	98.26%	0.00%
R14/51	UNKNOWN	W14/51	33.49	33.12	>27	0.21	0.20	1.94%	74.01%	0.00%
R15/51	UNKNOWN	W15/51	32.75	32.41	>27	1.75	1.73	0.86%	98.19%	0.00%



Room/Floor	Room Use	Window	%VSC			% Daylight Factor			Proposed No Sky	
			Exist	Prop	% Loss	Exist	Prop	% Loss	% of Room Area	% Loss of Existing
R16/51	UNKNOWN	W16/51	33.19	32.88	>27	0.20	0.20	1.48%	74.04%	0.00%
R17/51	UNKNOWN	W17/51	32.35	32.08	>27	1.75	1.73	0.74%	98.24%	0.00%
R18/51	UNKNOWN	W18/51	32.84	32.60	>27	0.20	0.20	1.50%	74.03%	0.00%
R19/51	UNKNOWN	W19/51	32.22	31.98	>27	1.78	1.76	0.62%	98.25%	0.00%
R20/51	UNKNOWN	W20/51	32.92	32.71	>27	0.20	0.20	1.01%	74.17%	0.00%
R21/51	UNKNOWN	W21/51	32.47	32.28	>27	1.76	1.75	0.45%	98.22%	0.00%
R22/51	UNKNOWN	W22/51	33.23	33.09	>27	0.20	0.20	1.00%	74.11%	0.00%
R23/51	UNKNOWN	W23/51	32.95	32.82	>27	1.71	1.70	0.35%	98.58%	0.00%
R24/51	UNKNOWN	W24/51	33.25	33.13	>27	1.73	1.73	0.23%	98.75%	0.00%
<b>1st Floor</b>										
R13/52	UNKNOWN	W13/52	35.17	34.76	>27	1.84	1.82	1.09%	98.64%	0.00%
R14/52	UNKNOWN	W14/52	35.12	34.74	>27	1.80	1.79	0.94%	98.59%	0.00%
R15/52	UNKNOWN	W15/52	35.03	34.69	>27	1.80	1.78	0.83%	98.62%	0.00%
R16/52	UNKNOWN	W16/52	34.89	34.59	>27	1.85	1.84	0.76%	98.63%	0.00%
R17/52	UNKNOWN	W17/52	34.75	34.47	>27	1.83	1.81	0.71%	98.66%	0.00%
R18/52	UNKNOWN	W18/52	34.67	34.42	>27	1.82	1.81	0.61%	98.66%	0.00%
R19/52	UNKNOWN	W19/52	34.61	34.40	>27	1.85	1.84	0.49%	98.62%	0.00%
R20/52	UNKNOWN	W20/52	34.63	34.45	>27	1.80	1.80	0.44%	98.67%	0.00%
R21/52	UNKNOWN	W21/52	34.68	34.53	>27	1.81	1.80	0.39%	98.65%	0.00%
R22/52	UNKNOWN	W22/52	34.81	34.69	>27	1.79	1.79	0.28%	98.59%	0.00%
R23/52	UNKNOWN	W23/52	35.01	34.92	>27	1.88	1.88	0.21%	98.77%	0.00%
R24/52	UNKNOWN	W24/52	35.22	35.15	>27	1.91	1.91	0.16%	98.75%	0.00%
<b>2nd Floor</b>										
R13/53	UNKNOWN	W13/53	37.28	36.87	>27	1.43	1.42	1.05%	98.64%	0.00%
R14/53	UNKNOWN	W14/53	37.26	36.89	>27	1.40	1.39	0.93%	98.59%	0.00%
R15/53	UNKNOWN	W15/53	37.23	36.93	>27	1.35	1.34	0.81%	98.18%	0.00%
R16/53	UNKNOWN	W16/53	37.17	36.91	>27	1.40	1.39	0.64%	98.17%	0.00%
R17/53	UNKNOWN	W17/53	37.10	36.88	>27	1.38	1.37	0.58%	98.30%	0.00%
R18/53	UNKNOWN	W18/53	37.05	36.87	>27	1.37	1.37	0.44%	98.22%	0.00%
R19/53	UNKNOWN	W19/53	36.99	36.85	>27	1.40	1.39	0.36%	98.25%	0.00%
R20/53	UNKNOWN	W20/53	37.00	36.87	>27	1.36	1.36	0.29%	98.23%	0.00%
R21/53	UNKNOWN	W21/53	37.02	36.91	>27	1.37	1.37	0.22%	98.65%	0.00%
R22/53	UNKNOWN	W22/53	37.08	36.99	>27	1.36	1.35	0.22%	98.59%	0.00%
R23/53	UNKNOWN	W23/53	37.16	37.10	>27	1.40	1.40	0.14%	98.77%	0.00%
R24/53	UNKNOWN	W24/53	37.27	37.22	>27	1.42	1.42	0.14%	98.65%	0.00%
<b>43 to 55 Crowndale Road - BRE149</b>										
<b>Base Floor</b>										
R1/50	UNKNOWN	W1/50	21.82	21.54	1.28%	1.06	1.05	1.13%	76.56%	4.84%
R2/50	UNKNOWN	W2/50	22.58	22.22	1.59%	1.10	1.09	1.27%	81.63%	4.17%
R3/50	UNKNOWN	W3/50	23.19	22.81	1.64%	1.09	1.07	1.20%	85.25%	3.72%
R4/50	UNKNOWN	W4/50	23.64	23.31	1.40%	1.18	1.17	0.94%	92.43%	3.26%
R5/50	UNKNOWN	W5/50	24.83	24.55	1.13%	1.22	1.21	0.82%	94.47%	2.01%



Room/Floor	Room Use	Window	%VSC			% Daylight Factor			Proposed No Sky	
			Exist	Prop	% Loss	Exist	Prop	% Loss	% of Room Area	% Loss of Existing
<b>Gnd Floor</b>										
R1/51	UNKNOWN	W1/51	25.94	25.48	1.77%	1.35	1.33	1.41%	96.41%	0.18%
R2/51	UNKNOWN	W2/51	27.89	27.40	>27	1.48	1.46	1.42%	97.76%	0.00%
R3/51	UNKNOWN	W3/51	29.44	28.91	>27	1.66	1.64	1.62%	98.00%	0.13%
R4/51	UNKNOWN	W4/51	31.07	30.48	>27	0.14	0.13	4.29%	72.30%	0.00%
R5/51	UNKNOWN	W5/51	30.87	30.33	>27	1.67	1.64	1.50%	98.25%	0.00%
R6/51	UNKNOWN	W6/51	32.26	31.65	>27	0.12	0.11	4.35%	67.07%	0.00%
R7/51	UNKNOWN	W7/51	31.98	31.41	>27	1.72	1.70	1.57%	98.42%	0.00%
R8/51	UNKNOWN	W8/51	33.21	32.53	>27	0.12	0.12	4.96%	67.05%	0.00%
R9/51	UNKNOWN	W9/51	32.92	32.34	>27	1.82	1.79	1.48%	98.45%	0.00%
R10/51	UNKNOWN	W10/51	33.64	33.07	>27	0.13	0.13	3.76%	67.00%	0.00%
R11/51	UNKNOWN	W11/51	33.10	32.61	>27	1.77	1.75	1.24%	98.14%	0.00%
R12/51	UNKNOWN	W12/51	30.77	30.32	>27	0.13	0.12	3.20%	66.93%	0.00%
<b>1st Floor</b>										
R1/52	UNKNOWN	W1/52	28.91	28.23	>27	1.60	1.57	1.88%	97.69%	0.00%
R2/52	UNKNOWN	W2/52	30.89	30.18	>27	1.69	1.66	1.95%	98.21%	0.00%
R3/52	UNKNOWN	W3/52	32.37	31.61	>27	1.61	1.58	1.99%	98.39%	0.00%
R4/52	UNKNOWN	W4/52	32.98	32.22	>27	1.76	1.72	2.05%	98.57%	0.00%
R5/52	UNKNOWN	W5/52	33.65	32.86	>27	1.70	1.67	2.06%	98.59%	0.00%
R6/52	UNKNOWN	W6/52	34.08	33.30	>27	1.78	1.75	1.97%	98.69%	0.00%
R7/52	UNKNOWN	W7/52	34.59	33.78	>27	1.75	1.71	2.06%	98.59%	0.00%
R8/52	UNKNOWN	W8/52	34.87	34.09	>27	1.75	1.72	2.00%	98.34%	0.00%
R9/52	UNKNOWN	W9/52	35.09	34.43	>27	1.89	1.86	1.69%	99.03%	0.00%
R10/52	UNKNOWN	W10/52	35.18	34.58	>27	1.82	1.79	1.49%	98.64%	0.00%
R11/52	UNKNOWN	W11/52	35.20	34.68	>27	1.83	1.81	1.31%	98.64%	0.00%
R12/52	UNKNOWN	W12/52	34.80	34.34	>27	1.81	1.79	1.16%	98.75%	0.00%
<b>2nd Floor</b>										
R1/53	UNKNOWN	W1/53	32.14	31.17	>27	1.26	1.23	2.54%	97.96%	0.00%
R2/53	UNKNOWN	W2/53	34.09	33.09	>27	1.33	1.30	2.48%	98.49%	0.00%
R3/53	UNKNOWN	W3/53	35.37	34.35	>27	1.27	1.24	2.52%	98.39%	0.00%
R4/53	UNKNOWN	W4/53	35.85	34.85	>27	1.39	1.36	2.52%	98.86%	0.00%
R5/53	UNKNOWN	W5/53	36.29	35.33	>27	1.34	1.31	2.39%	98.59%	0.00%
R6/53	UNKNOWN	W6/53	36.54	35.66	>27	1.39	1.36	2.15%	98.69%	0.00%
R7/53	UNKNOWN	W7/53	36.83	36.02	>27	1.37	1.34	2.05%	98.59%	0.00%
R8/53	UNKNOWN	W8/53	36.99	36.25	>27	1.37	1.34	1.90%	98.52%	0.00%
R9/53	UNKNOWN	W9/53	37.12	36.49	>27	1.46	1.44	1.58%	99.03%	0.00%
R10/53	UNKNOWN	W10/53	37.20	36.62	>27	1.41	1.39	1.42%	98.64%	0.00%
R11/53	UNKNOWN	W11/53	37.24	36.71	>27	1.42	1.40	1.34%	98.64%	0.00%
R12/53	UNKNOWN	W12/53	36.84	36.38	>27	1.42	1.40	1.13%	98.75%	0.00%



Room/Floor	Room Use	Window	%VSC			% Daylight Factor			Proposed No Sky	
			Exist	Prop	% Loss	Exist	Prop	% Loss	% of Room Area	% Loss of Existing
<b>3, 5 and 7 Bayham Street - BRE150</b>										
<b>Gnd Floor</b>										
R1/90	LKD	W1/90	17.40	12.94	25.63%	1.74	1.63	6.66%	97.41%	0.00%
		W2/90	18.45	13.60	26.29%					
		W3/90	18.70	14.79	20.91%					
		W4/90	37.05	36.97	>27					
<b>1st Floor</b>										
R1/91	KD	W1/91	22.91	16.68	27.19%	2.99	2.63	12.04%	97.32%	0.08%
		W2/91	24.40	18.69	23.40%					
		W4/91	37.79	37.68	>27					
<b>2nd Floor</b>										
R1/92	BEDROOM	W2/92	30.20	24.26	19.67%	3.68	3.42	7.22%	95.92%	0.70%
		W4/92	37.86	37.77	>27					
<b>3rd Floor</b>										
R1/93	BEDROOM	W1/93	34.36	29.04	>27	1.97	1.83	7.26%	81.20%	0.00%
		W2/93	39.06	38.98	>27					

**GVA**

An **APLEONA** company

GVA Schatunowski Brooks

Appendix III

[gva.co.uk](http://gva.co.uk)



Hope Project, Koko, Camden

Sunlight analysis results  
Job 17  
18-Oct-17

Available sunlight as a percentage of annual unobstructed total (1486.0 Hrs)

Room use	Window Ref	Existing %			Proposed %			% Loss of Summer	% Loss of Winter	% Loss of Total
		Summer	Winter	Total	Summer	Winter	Total			
<b>48 to 56 Bayham Place - BRE144, 145</b>										
<b>Gnd Floor</b>										
UNKNOWN	W1/10	22.00	2.00	24.00	20.00	0.00	20.00	9.09%	100.00%	16.67%
UNKNOWN	W2/10	47.00	1.00	48.00	29.00	0.00	29.00	38.30%	100.00%	39.58%
UNKNOWN	W3/10	49.00	2.00	51.00	33.00	0.00	33.00	32.65%	100.00%	35.29%
UNKNOWN	W4/10	48.00	3.00	51.00	33.00	0.00	33.00	31.25%	100.00%	35.29%
UNKNOWN	W5/10	49.00	4.00	53.00	34.00	0.00	34.00	30.61%	100.00%	35.85%
UNKNOWN	W7/10	47.00	4.00	51.00	34.00	0.00	34.00	27.66%	100.00%	33.33%
UNKNOWN	W8/10	44.00	4.00	48.00	31.00	1.00	32.00	29.55%	75.00%	33.33%
UNKNOWN	W9/10	44.00	3.00	47.00	30.00	1.00	31.00	31.82%	66.67%	34.04%
UNKNOWN	W10/10	44.00	5.00	49.00	32.00	1.00	33.00	27.27%	80.00%	32.65%
UNKNOWN	W11/10	0.00	0.00	0.00	0.00	0.00	0.00	0.00%	0.00%	0.00%
<b>1st Floor</b>										
UNKNOWN	W1/11	26.00	5.00	31.00	26.00	2.00	28.00	0.00%	60.00%	9.68%
UNKNOWN	W2/11	54.00	8.00	62.00	46.00	3.00	49.00	14.81%	62.50%	20.97%
UNKNOWN	W3/11	55.00	8.00	63.00	48.00	1.00	49.00	12.73%	87.50%	22.22%
UNKNOWN	W4/11	54.00	9.00	63.00	48.00	2.00	50.00	11.11%	77.78%	20.63%
UNKNOWN	W5/11	52.00	8.00	60.00	47.00	2.00	49.00	9.62%	75.00%	18.33%
UNKNOWN	W6/11	51.00	11.00	62.00	46.00	4.00	50.00	9.80%	63.64%	19.35%
UNKNOWN	W7/11	51.00	11.00	62.00	46.00	4.00	50.00	9.80%	63.64%	19.35%
UNKNOWN	W8/11	52.00	12.00	64.00	45.00	4.00	49.00	13.46%	66.67%	23.44%
UNKNOWN	W9/11	53.00	11.00	64.00	47.00	4.00	51.00	11.32%	63.64%	20.31%
<b>2nd Floor</b>										
UNKNOWN	W1/12	27.00	11.00	38.00	27.00	9.00	36.00	0.00%	18.18%	5.26%
UNKNOWN	W2/12	55.00	18.00	73.00	53.00	9.00	62.00	3.64%	50.00%	15.07%
UNKNOWN	W3/12	55.00	17.00	72.00	54.00	9.00	63.00	1.82%	47.06%	12.50%
UNKNOWN	W4/12	50.00	18.00	68.00	49.00	10.00	59.00	2.00%	44.44%	13.24%
UNKNOWN	W5/12	51.00	20.00	71.00	50.00	10.00	60.00	1.96%	50.00%	15.49%
UNKNOWN	W6/12	50.00	20.00	70.00	49.00	10.00	59.00	2.00%	50.00%	15.71%
UNKNOWN	W7/12	50.00	20.00	70.00	49.00	10.00	59.00	2.00%	50.00%	15.71%
UNKNOWN	W8/12	51.00	21.00	72.00	51.00	13.00	64.00	0.00%	38.10%	11.11%
UNKNOWN	W9/12	53.00	21.00	74.00	53.00	14.00	67.00	0.00%	33.33%	9.46%
<b>3rd Floor</b>										
BEDROOM	W1/13	30.00	16.00	46.00	30.00	14.00	44.00	0.00%	12.50%	4.35%
BEDROOM	W2/13	29.00	24.00	53.00	29.00	19.00	48.00	0.00%	20.83%	9.43%
BEDROOM	W3/13	21.00	23.00	44.00	21.00	16.00	37.00	0.00%	30.43%	15.91%
BEDROOM	W4/13	24.00	24.00	48.00	24.00	15.00	39.00	0.00%	37.50%	18.75%
LKD	W5/13	46.00	26.00	72.00	46.00	19.00	65.00	0.00%	26.92%	9.72%
LKD	W6/13	53.00	27.00	80.00	53.00	20.00	73.00	0.00%	25.93%	8.75%
<b>4th Floor</b>										
LKD	W1/14	36.00	19.00	55.00	36.00	19.00	55.00	0.00%	0.00%	0.00%
LKD	W2/14	55.00	27.00	82.00	55.00	27.00	82.00	0.00%	0.00%	0.00%
BEDROOM	W3/14	55.00	28.00	83.00	55.00	28.00	83.00	0.00%	0.00%	0.00%

Room use	Window Ref	Existing %			Proposed %			% Loss of Summer	% Loss of Winter	% Loss of Total
		Summer	Winter	Total	Summer	Winter	Total			
<b>4 Bayham Street - BRE146</b>										
<b>Base Floor</b>										
UNKNOWN	W1/20	34.00	12.00	46.00	30.00	10.00	40.00	11.76%	16.67%	13.04%
UNKNOWN	W2/20	22.00	3.00	25.00	19.00	2.00	21.00	13.64%	33.33%	16.00%
<b>Gnd Floor</b>										
UNKNOWN	W1/21	39.00	15.00	54.00	37.00	14.00	51.00	5.13%	6.67%	5.56%
UNKNOWN	W2/21	36.00	10.00	46.00	34.00	9.00	43.00	5.56%	10.00%	6.52%
<b>1st Floor</b>										
UNKNOWN	W1/22	40.00	19.00	59.00	39.00	16.00	55.00	2.50%	15.79%	6.78%
UNKNOWN	W2/22	39.00	19.00	58.00	38.00	15.00	53.00	2.56%	21.05%	8.62%
UNKNOWN	W3/22	40.00	20.00	60.00	38.00	15.00	53.00	5.00%	25.00%	11.67%
<b>2 Bayham Street - BRE147</b>										
<b>1st Floor</b>										
UNKNOWN	W1/31	40.00	19.00	59.00	38.00	16.00	54.00	5.00%	15.79%	8.47%
UNKNOWN	W2/31	40.00	18.00	58.00	37.00	16.00	53.00	7.50%	11.11%	8.62%
UNKNOWN	W3/31	40.00	18.00	58.00	33.00	17.00	50.00	17.50%	5.56%	13.79%
<b>3 ,5 and 7 Bayham Street - BRE150</b>										
<b>Gnd Floor</b>										
LKD	W1/90	0.00	0.00	0.00	0.00	0.00	0.00	0.00%	0.00%	0.00%
LKD	W2/90	0.00	0.00	0.00	0.00	0.00	0.00	0.00%	0.00%	0.00%
LKD	W3/90	33.00	1.00	34.00	25.00	0.00	25.00	24.24%	100.00%	26.47%
<b>1st Floor</b>										
KD	W1/91	34.00	6.00	40.00	27.00	1.00	28.00	20.59%	83.33%	30.00%
KD	W2/91	37.00	7.00	44.00	32.00	2.00	34.00	13.51%	71.43%	22.73%
<b>2nd Floor</b>										
BEDROOM	W2/92	37.00	15.00	52.00	37.00	5.00	42.00	0.00%	66.67%	19.23%
<b>3rd Floor</b>										
BEDROOM	W1/93	36.00	22.00	58.00	36.00	13.00	49.00	0.00%	40.91%	15.52%