


FOR APPROVAL

Status	Date:	Description:
A	03/07/2017	ISSUED FOR APPROVAL

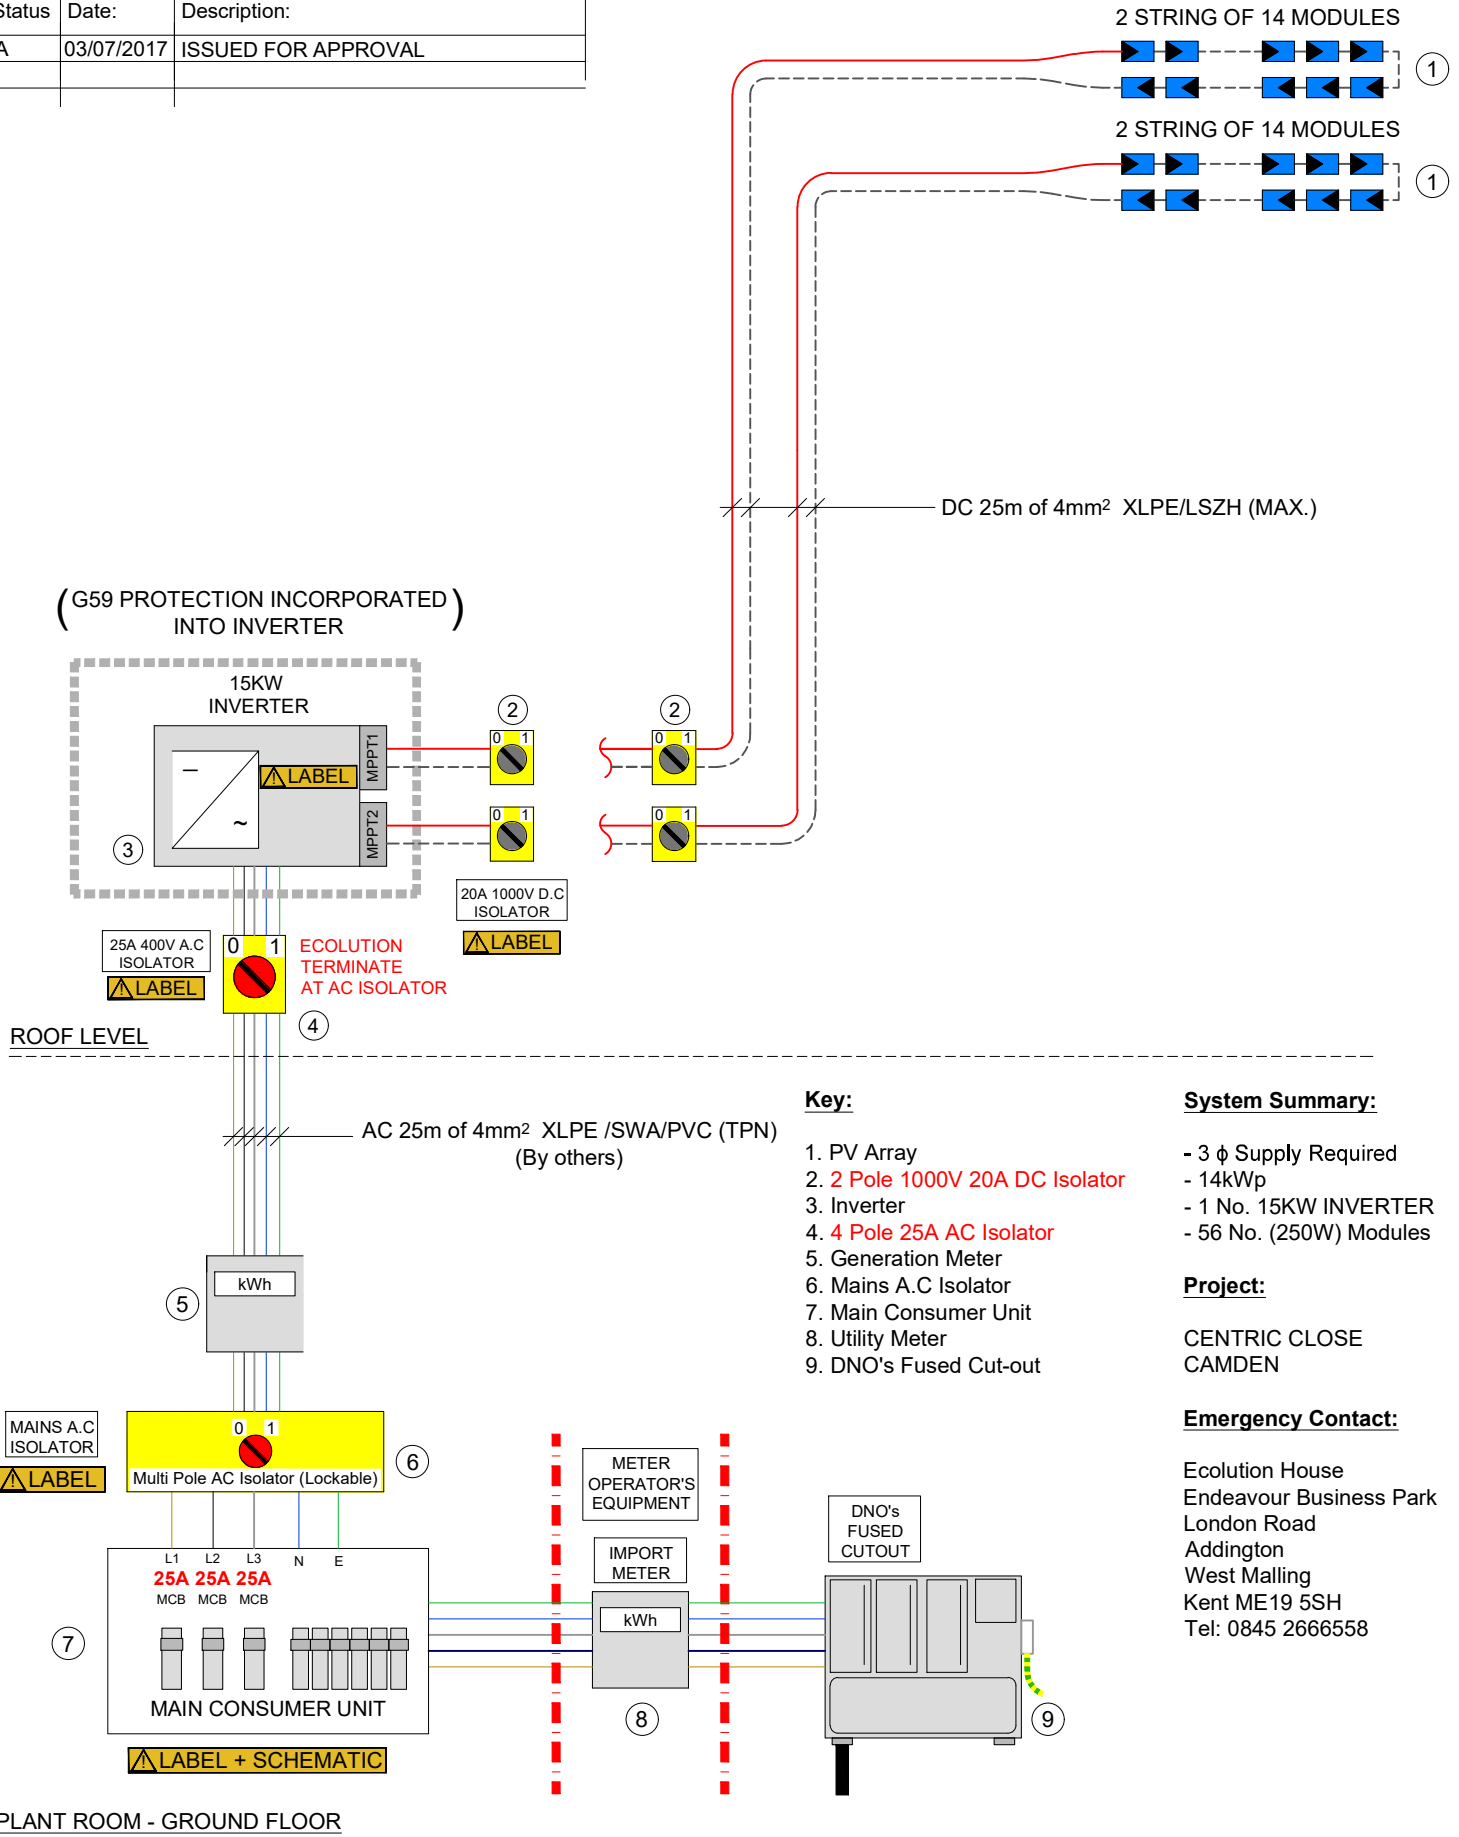

Key:

1. PV Array
2. 2 Pole 1000V 20A DC Isolator
3. Inverter
4. 4 Pole 25A AC Isolator
5. Generation Meter
6. Mains A.C Isolator
7. Main Consumer Unit
8. Utility Meter
9. DNO's Fused Cut-out

System Summary:

- 3 φ Supply Required
- 14kWp
- 1 No. 15KW INVERTER
- 56 No. (250W) Modules

Project:

CENTRIC CLOSE
CAMDEN

Emergency Contact:

Ecolution House
Endeavour Business Park
London Road
Addington
West Malling
Kent ME19 5SH
Tel: 0845 2666558

Title: PV Electrical Schematic	
Drawing Ref.: 17124 PVES-001	
Date Drawn: 03/07/2017	Drawn by: JA

