

## SITE INVESTIGATION FACTUAL REPORT

Report No: 287264  
Client: Cunningham Lindsey - Maidstone  
Site: 54 Compayne Gardens, London  
Client Ref: XXXXXXXXXX  
Date of Visit: 20/10/2015



Home Emergency Response - Subsidence Investigation - Drainage Services – Crack & Level Monitoring – Property Video Surveys

Unit E2 First Floor Suite, Boundary Court  
Willow Farm Business Park, Castle Donington  
Leicestershire, DE74 2NN

☎ 0843 2272362  
✉ enquiries@cet-uk.com  
💻 www.cet-uk.com

CET is the trading name of CET Structures Ltd  
Registered in England No. 02527130

# Investigation Layout Plan

Sheet: 1 of 1

Job No: 287264

Date: 20/10/2015

Site: 54 Compayne Gardens, London NW6

MH  
(SI)


MD/SA  
(Checked)

AR  
(Drawn)

Weather: DRY

Work carried  
out for:

Cunningham Lindsey

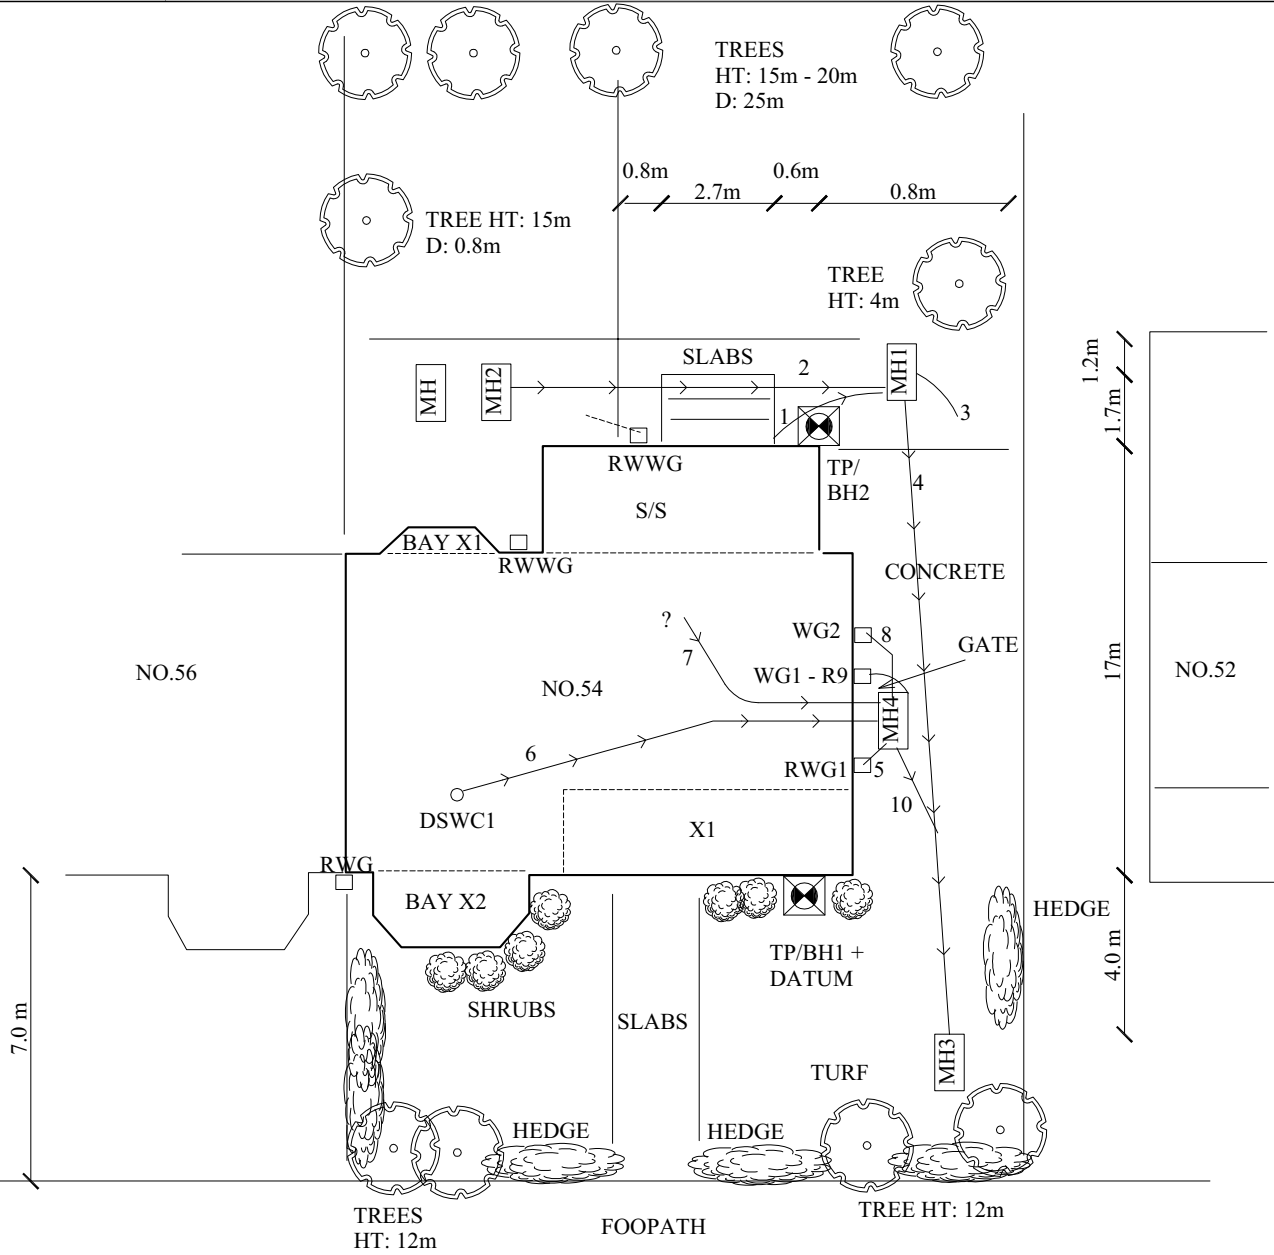

## COMPAYNE GARDENS

ON SITE TREE IDENTIFICATION FOR GUIDANCE ONLY. NOT AUTHENTICATED.


Remarks:

Key:

Combined Gully

RWWG


Surface Water Drain



Manhole

MH

Foul Water Drain



Rain Water Pipe

RWP

Tree / Bush



Rain Water Gully

RWG

(approx. ht in m)

Soil Vent Pipe

SVP

Trial Pit



Waste Gully

WG

Borehole



Waste Pipe

WP


O/D - Open Discharge



Scale:

N.T.S.

<b>Trial Pit No: 1</b>	Sheet: 1 of 1	Site: 54 Compayne Gardens
	Job No: 287264	
Excavation Method: Hand Tools	Date: 20.10.15	Work carried out for: Cunningham Lindsey
Weather: DRY	Drawn by: DVC	
	Ground Level mOD:	

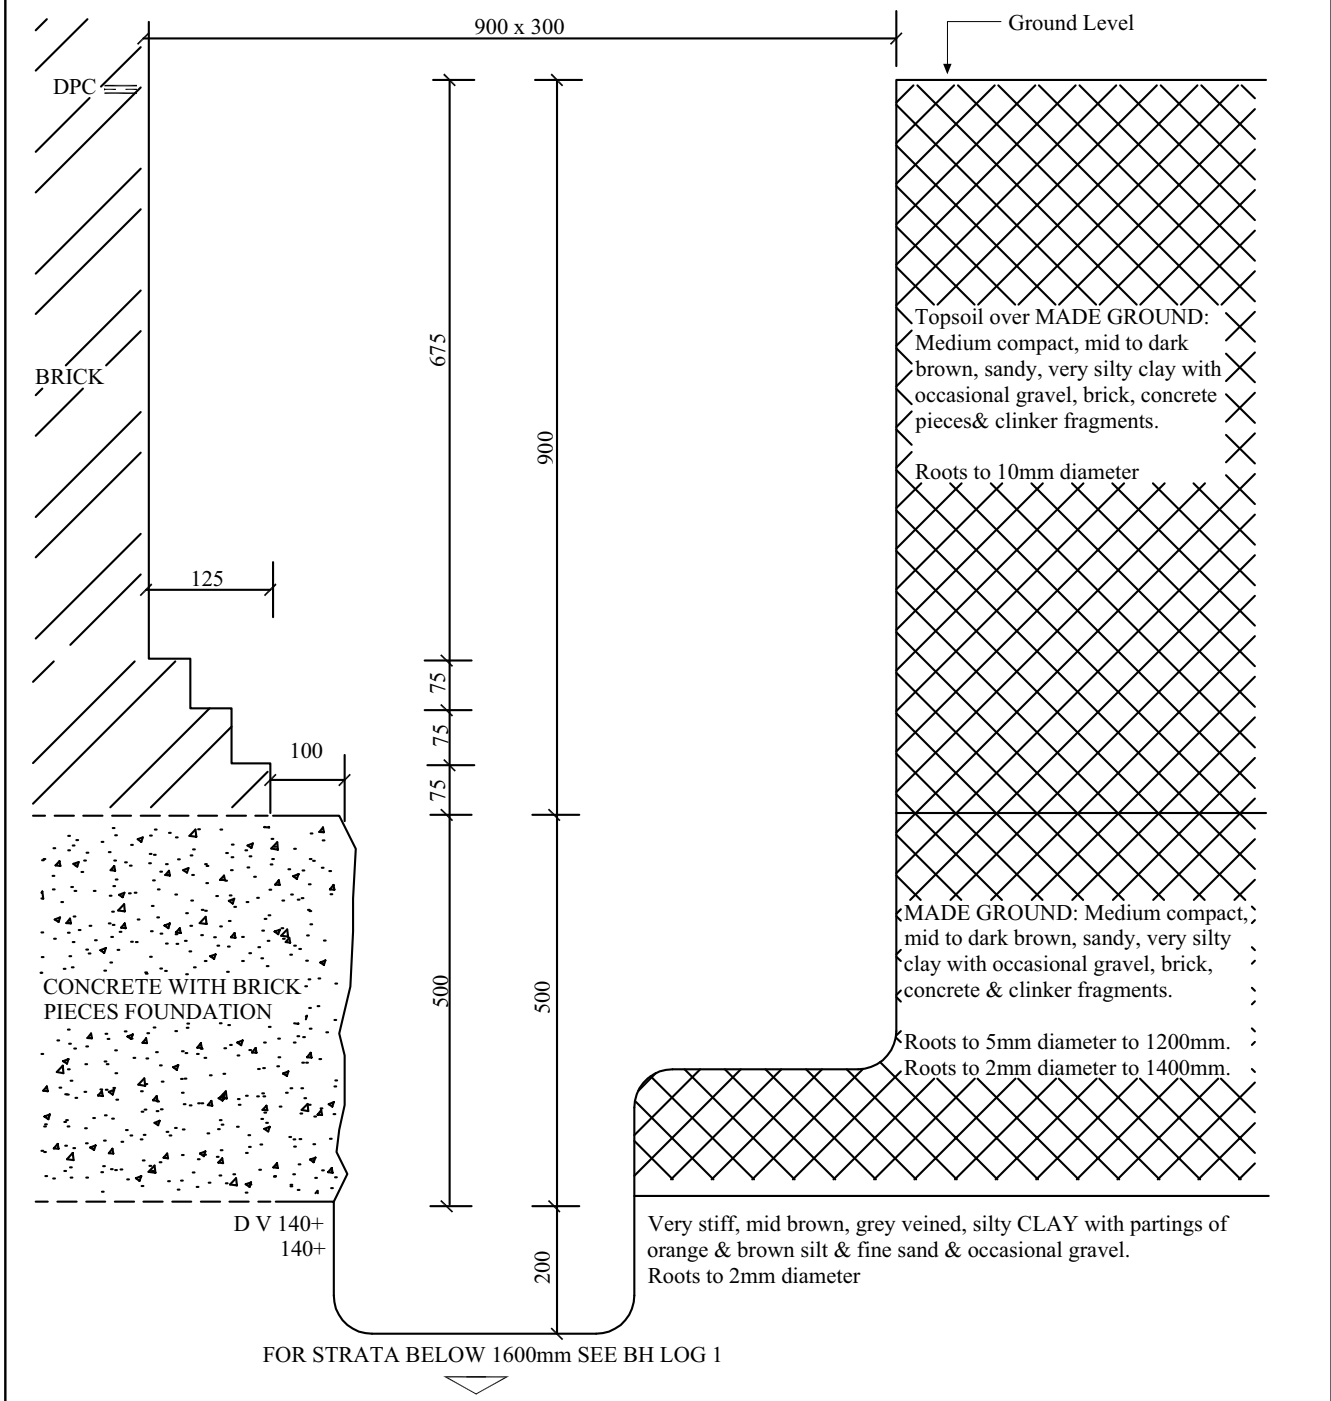

Remarks: All measurements in millimetres. Trial Pit excavated to 1200mm then extended with the aid of a hand auger to 1600mm.	Key:	
	D Small disturbed sample	J Jar sample
	B Bulk disturbed sample	V Pilcon Vane (kPa)
	W Water sample	M Mackintosh probe
	TDTD Too dense to drive	
Logged: MH	Checked: SA	Approved:
	Scale: N.T.S.	


# Trial Pit No: 2

Sheet: 1 of 1  
 Job No: 287264  
 Date: 20.10.15

Site: 54 Compayne Gardens  
 Work carried out for: Cunningham Lindsey

Excavation Method: Hand Tools  
 Weather: DRY

Drawn by: DVC  
 Ground Level mOD:

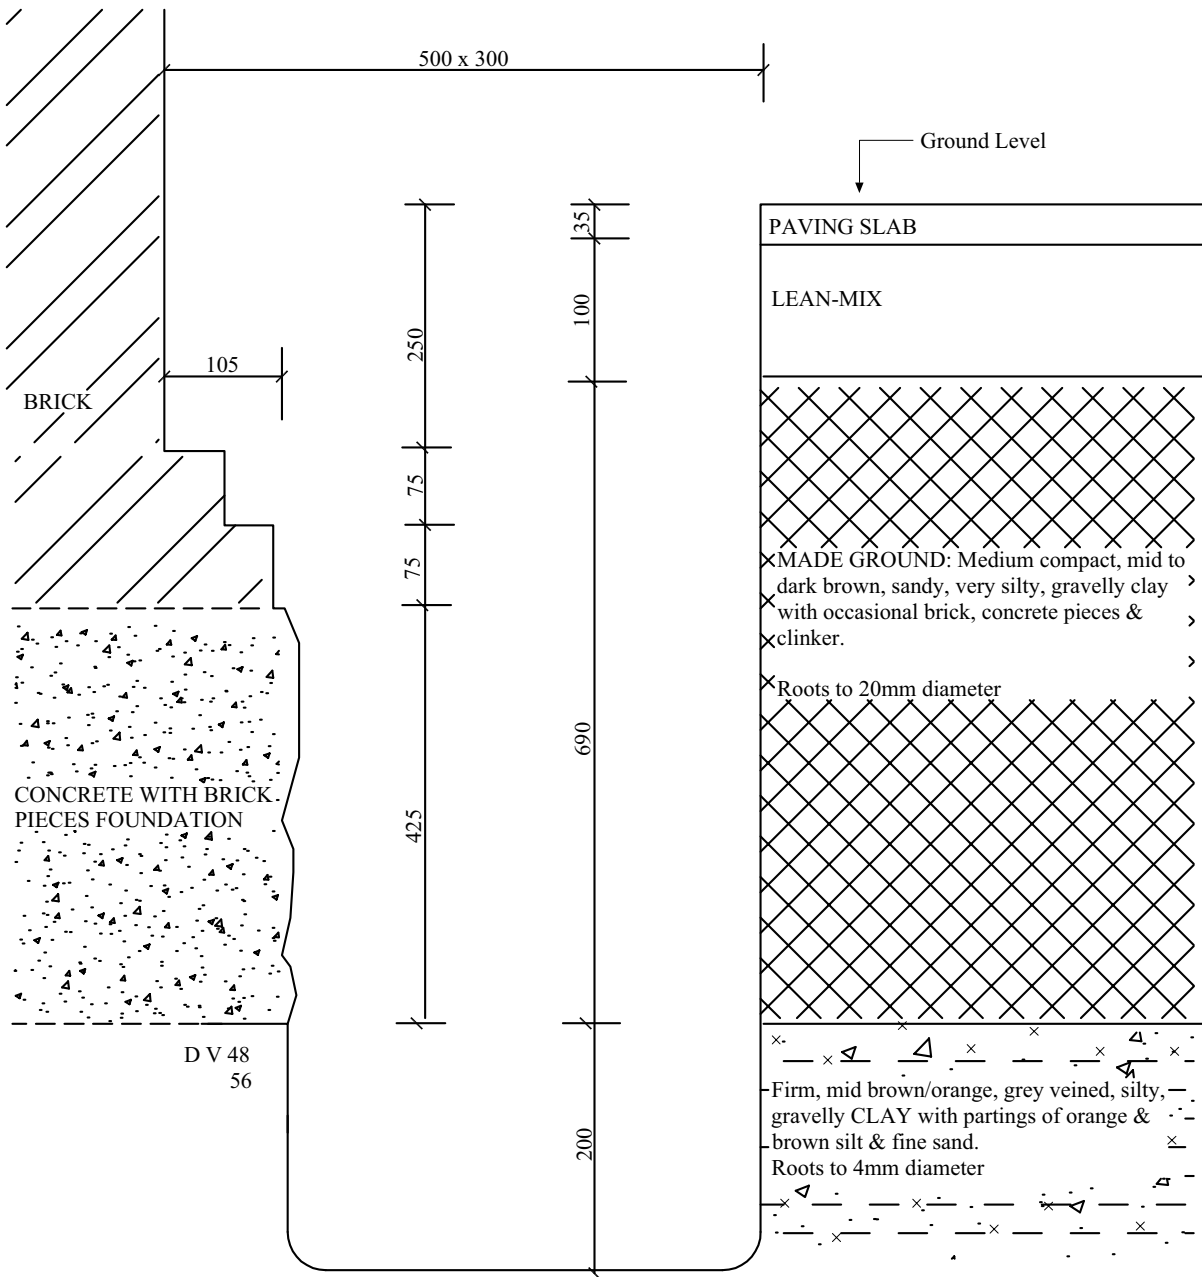

FOR STRATA BELOW 1025mm SEE BH LOG 2

Remarks: All measurements in millimetres.

Key:

D	Small disturbed sample	J	Jar sample
B	Bulk disturbed sample	V	Pilcon Vane (kPa)
W	Water sample	M	Mackintosh probe
TDTD	Too dense to drive		

Logged: MH

Checked: SA

Approved:

Scale: N.T.S.

Borehole No: 1 & Datum			Sheet: 1 of 1		Site: 54 Compayne Gardens									
Boring Method: CFA			Job No: 287264							Date: 20.10.15				
Diameter: 100mm		Coordinates:	Ground Level mOD:											
Depth (m)	Description of Strata	Thick-ness (m)	Legend	Sample	Test Type	Result	Depth (m)	Field Records/Comments	Depth to water (m)					
1.60	As Trial Pit 1	1.60						Roots to 1mm diameter to 2.2m						
2.80	Very stiff, fragmented, mid brown, grey veined, silty CLAY with partings of orange & brown silt & fine sand, occasional clay-stone nodules & crystals.	1.20	..x											
			x	D	V	140+	2.00	Hair & fibrous roots to 2.5m						
			x.	D			2.50	Dead & decomposing root fragments to 5m						
			x	D	V	140+	3.00							
6.00	Very stiff, mid brown, grey veined, silty CLAY with partings of orange & brown silt & fine sand, occasional claystone nodules & crystals.	3.20	x	D			3.50							
			x.	D	V	140+	4.00							
			x	D			4.50							
			x.	D	V	140+	5.00							
	Borehole ends at 6m													
Remarks: Borehole dry and open on completion. Datum installed at 6m. No soil samples taken or insitu strength tests carried out below 5m					Key: T.D.T.D. Too Dense to Drive D Small disturbed sample J Jar sample B Bulk disturbed sample V Pilcon Vane (kPa) W Water sample M Mackintosh Probe									
Logged: MH	Checked: SA	Typed by: DVC		Scale: NTS			Weather: DRY							

Borehole No: 2		Sheet: 1 of 1		Site: 54 Compayne Gardens					
Boring Method: Hand Auger		Date: 20.10.15		Work Carried out for: Cunningham Lindsey					
Diameter: 75mm	Coordinates:	Ground Level mOD:							
Depth (m)	Description of Strata	Thick-ness (m)	Legend	Sample	Test Type	Result	Depth (m)	Field Records/Comments	Depth to water (m)
1.025	As Trial Pit 2	1.025						Roots to 3mm diameter to 1.4m	
1.10	Firm, mid brown/orange, grey veined, silty gravelly CLAY with partings of orange & brown silt & fine sand.	0.075	___x o___						
1.40	Very stiff, mid brown, grey veined, silty CLAY with partings of orange & brown silt & fine sand & occasional gravel.	0.30	___x o___					Roots to 1mm diameter to 1.8m	
1.80	Very stiff, mid brown, grey veined, silty CLAY with partings of orange & brown silt & fine sand, occasional claystone nodules & crystals.	0.40	___x ___ ___	D	V	140+ 140+	1.50		
			___x ___ ___	D	V	94 104	2.00	Dead & decomposing root fragments to 5m	
	Stiff, as above	1.20	x___ ___ ___	D	V	114 118	2.50		
3.00			x___ ___ ___	D	V	140+ 140+	3.00		
			___x ___ ___	D	V	140+ 140+	3.50		
	Very stiff, mid brown, grey veined, silty CLAY with partings of orange & brown silt & fine sand, occasional claystone nodules & crystals.	2.00	___x ___ ___	D	V	140+ 140+	4.00		
			___x ___ ___	D	V	140+ 140+	4.50		
5.00			___x	D	V	140+ 140+	5.00		
	Borehole ends at 5m								
Remarks: Borehole dry and open on completion				Key: T.D.T.D. Too Dense to Drive D Small disturbed sample J Jar sample B Bulk disturbed sample V Pilcon Vane (kPa) W Water sample M Mackintosh Probe					
Logged: MH	Checked: SA	Typed by: DVC		Scale: NTS			Weather: DRY		

# Laboratory Summary Results

Our Ref : 287264  
 Date Sampled: 20/10/2015  
 Location : 54, Compayne Gardens, London, NW6  
 Date Received : 21/10/2015  
 Work carried out for: Cunningham Lindsey - Maidstone  
 Date Tested : 22/10/2015  
 Date of Report : 29/10/2015

TP/BH No	Sample Ref Depth (m)	Type	Moisture Content (%) [11]	Soil Fraction > 0.425mm (%) [2]	Liquid Limit (%) [3]	Plastic Limit (%) [4]	Plasticity Index (%) [5]	Liquidity Index [5]	Modified Plasticity Index (%) [6]	Soil Class [7]	Filter Paper Contact Time (h)	Soil Sample Suction (kPa) [8]	Oedometer Strain [9]	Estimated Heave Potential (Dd) (mm) [10]	In situ Shear Vane Strength (kPa) [11]	Organic Content (%) [12]	pH Value [13]	Sulphate Content* (g/l)		* Class [16]
																		SO3 [14]	SO4 [15]	
1	U/S 1.40	D	23	<5	66	20	46	0.06	46	CH					> 140					
	2.0	D	23	<5	69	22	47	0.02	47	CH					> 140					
	2.5	D	23	<5																
	3.0	D	31	<5	72	26	46	0.10	46	CV					> 140					
	3.5	D	31	<5																
	4.0	D	32	<5	73	30	43	0.04	43	CV					> 140					
	4.5	D	32	<5																
	5.0	D	32	<5											> 140					

## Test Methods / Notes

- [1] BS 1377 : Part 2 : 1990, Test No 3.2
- [2] Estimated if <5%, otherwise measured
- [3] BS 1377 : Part 2 : 1990, Test No 4.4
- [4] BS 1377 : Part 2 : 1990, Test No 5.3
- [5] BS 1377 : Part 2 : 1990, Test No 5.4
- [6] BRE Digest 240 : 1993
- [7] BS 5930 : 1981 : Figure 31 - Plasticity Chart for the classification of fine soils
- [8] In-house method S9a, adapted from BRE IP 4/93

## Test Methods / Notes

- [9] In-house Test Procedure S17a: One Dimensional Swell/Strain Test
- [10] Estimated Heave Potential (Dd)
- [11] Values of shear strength were determined in situ by CET using a Pilon hand vane or Geonor vane (GV).
- [12] BS 1377 : Part 3 : 1990, Test No 4
- [13] BS 1377 : Part 2 : 1990, Test No 9
- [14] BS 1377 : Part 3 : 1990, Test No 5.6
- [15] SO<sub>4</sub> = 1.2 x SO<sub>3</sub>

## Key

- D Disturbed sample ( small )
- B Disturbed sample ( bulk )
- U Undisturbed sample
- W Groundwater sample
- ENP Essentially Non-Plastic by inspection
- UIS Underside of Foundation

\* These tests are not UKAS accredited

Full reports can be provided upon request

Version: 5BH V1.4 - 11/05/15



8618

# Laboratory Testing Results

Our Ref : 287264 Date Sampled : 20/10/2015  
 Location : 54, Compayne Gardens, London, NW6 Date Received : 21/10/2015  
 Work carried out for: Cunningham Lindsey - Maidstone Date Tested : 22/10/2015  
Date of Report : 29/10/2015

Sample Ref. TP/BH No.	Depth (m)	Type	Moisture Content (%) [11]	Soil Fraction > 0.425mm (%) [2]	Liquid Limit (%) [3]	Plastic Limit (%) [4]	Plasticity Index (%) [5]	Liquidity Index [5]	Modified Plasticity Index (%) [6]	Soil * Class [7]	Filter Paper Contact Time (h)	Soil Sample Suction (kPa) [8]	Oedometer Strain [9]	Estimated Heave Potential (Dd) (mm) [10]	In situ * Shear Vane Strength (kPa) [11]	Organic * Content (%) [12]	pH * Value [13]	Sulphate Content * (g/l)		* Class
																		SO3 [14]	SO4 [15]	
2	U/S 0.825	D	15	62											52					
	1.5	D	24	<5	70	23	47	0.03	47	CV					> 140					
	2.0	D	29	<5	72	27	45	0.05	45	CV					99					
	2.5	D	32	<5											116					
	3.0	D	32	<5	74	28	46	0.09	46	CV					> 140					
	3.5	D	31	<5											> 140					
	4.0	D	32	<5											> 140					
	4.5	D	33	<5											> 140					
	5.0	D	33	<5											> 140					

**Test Methods / Notes**  
 [1] BS 1377 : Part 2 : 1990, Test No 3.2  
 [2] Estimated if <5%, otherwise measured  
 [3] BS 1377 : Part 2 : 1990, Test No 4.4  
 [4] BS 1377 : Part 2 : 1990, Test No 5.3  
 [5] BS 1377 : Part 2 : 1990, Test No 5.4  
 [6] BRE Digest 240 : 1993  
 [7] BS 5930 : 1981 : Figure 31 - Plasticity Chart for the classification of fine soils  
 [8] In-house method S9a, adapted from BRE IP 4/93  
 [9] In-house Test Procedure S7/a: One Dimensional Swell/Strain Test  
 [10] Estimated Heave Potential (Dd)  
 [11] Values of shear strength were determined in situ by CET using a Picon hand vane or Geonor vane (GV).  
 [12] BS 1377 : Part 3 : 1990, Test No 4  
 [13] BS 1377 : Part 2 : 1990, Test No 9  
 [14] BS 1377 : Part 3 : 1990, Test No 5.6  
 [15] SO<sub>4</sub> = 1.2 x SO<sub>3</sub>  
 \* These tests are not UKAS accredited  
 Full reports can be provided upon request  
 Version: SBH V1.4 - 11/05/15






## Moisture Content Profiles


Our Ref : 287264  
 Location : 54, Compayne Gardens, London, NW6  
 Work carried out for: Cunningham Lindsey - Maidstone

Date Sampled : 20/10/2015  
 Date Received : 21/10/2015  
 Date Tested : 22/10/2015  
 Date of Report : 29/10/2015

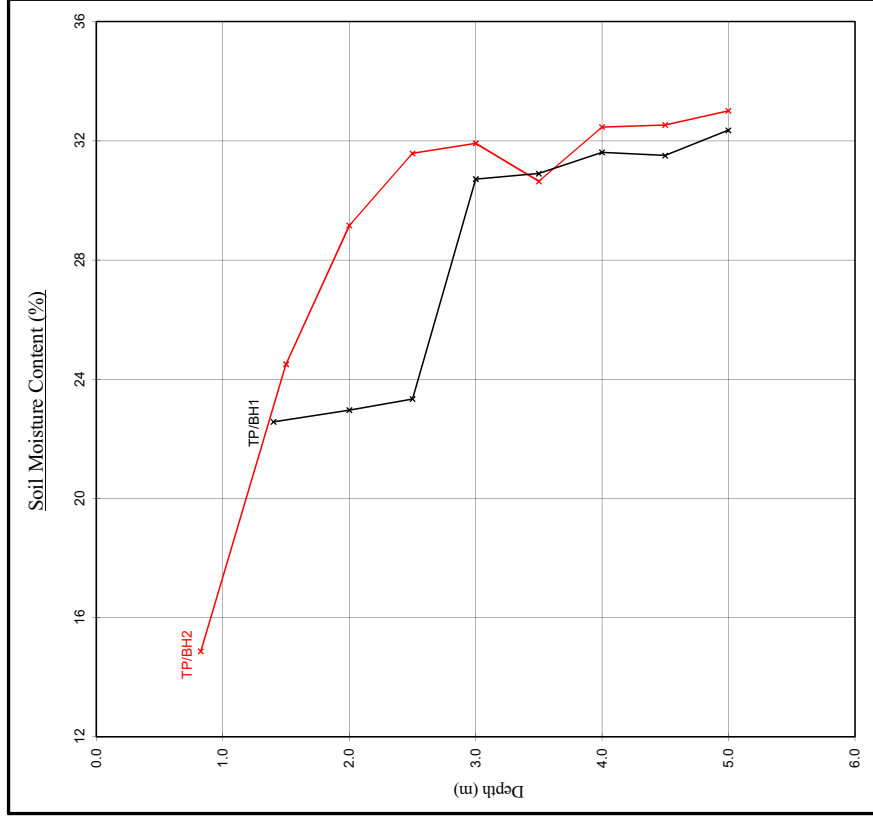

**Notes**  
 1. If plotted, 0.4 LL and PL<sub>2</sub> ( after Driscoll, 1983 ) should only be applied to London Clay ( and similarly overconsolidated clay ) at shallow depths.  
 2. Unless specifically noted the profiles have not been related to a site datum.

## Shear Strength Profiles

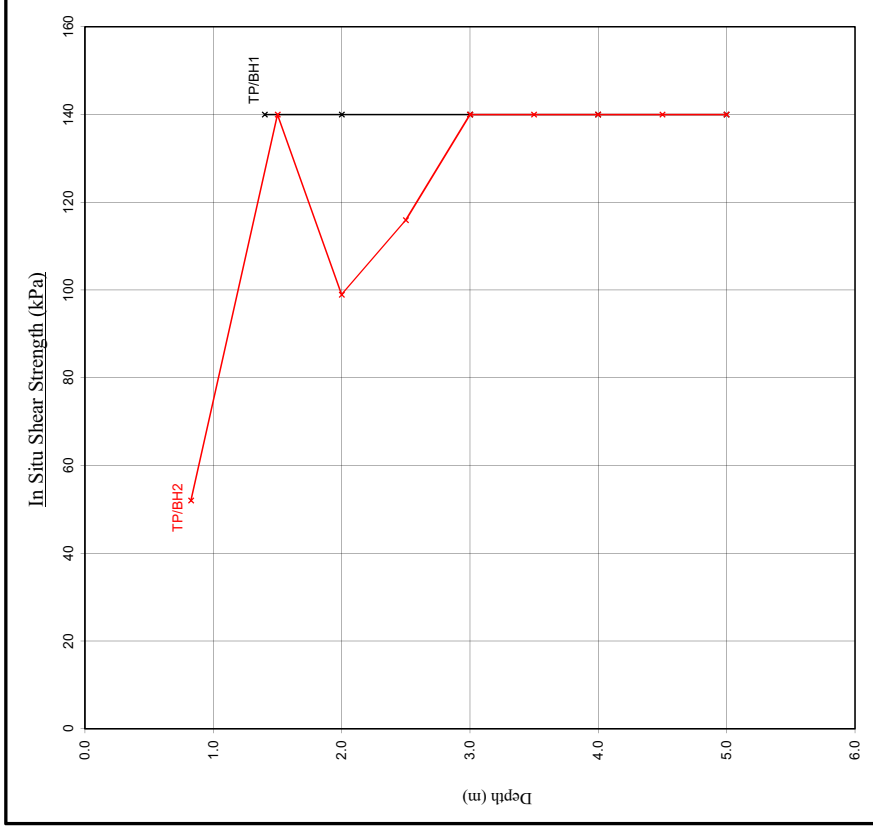

**Note**  
 1. Unless otherwise stated, values of Shear Strength were determined in situ by CET using a Picon Hand Vane the calibration of which is limited to a maximum reading of 140 kPa.  
 2. Unless specifically noted the profiles have not been related to a site datum.

***Certificate of Analysis***

The following work was commissioned by CET on behalf of their client. Root samples were obtained in sealed packets from the above site with no reference given as to the types of tree or shrub from which they may have originated.

The results were as follows -

<b><u>Trial pit/ Borehole number</u></b>	<b><u>Root diameter (mm)</u></b>	<b><u>Tree, shrub or climber from which root originates</u></b>	<b><u>Result of starch test</u></b>
TP1 (USF)	1.5 mm	Tilia spp. 5 roots	Positive
BH1 (1.6-2.5m)	1 mm	Tilia spp. 4 roots	Positive
TP2 (USF)	2 mm	Fraxinus spp. 3 roots	Positive
BH2 (1.025-1.8m)	2 mm	Fraxinus spp. 3 roots	Positive
BH2 (1.025-1.8m)	1 mm	Clematis spp.	Positive

Tilia spp. are limes.

Fraxinus spp. include common ash.

Clematis spp. are common flowering, garden climbers.



MDM

**Address for correspondence:** EPSL, Intec, Parc Menai, Bangor, Gwynedd, North Wales, LL57 4FG

**Telephone:** 01248 672 652

**e-mail:** [lab@innovation-environmental.co.uk](mailto:lab@innovation-environmental.co.uk)

**Head of Laboratory Services :** M D Mitchell B.Sc. (Hons), M.Phil.

**Plant Anatomist :** Dr G S Turner B.Sc. (Hons), M.Sc., Ph.D

**Plant Anatomist :** Dr D P Aebischer B.Sc. (Hons), M.Sc., Ph.D

**Consultant:** Dr M P Denne B.Sc. (Hons), M.Sc., Ph.D

Registered in England. No 3256771, Registered Office: Yarmouth House, 1300 Parkway, Solent Business Park, Hampshire, PO15 7AE

To: Cunningham Lindsey - Maidstone  
4 North Court  
South Park Business Village  
Armstrong Road  
Kent  
ME15 6JZ

Our Ref: **287264**  
Your Ref: **6095485**  
Date: **21-Oct-15**

Ftiao: Yiu-Shan Wong

<b>ESTIMATE</b>
-----------------

Site:- **54 Compayne Gardens, London**

Item		Amount
	<b>No recommendations required to the private drainage surveyed.</b>	

**Notes**

Repairs to shared runs and off boundary pipe-work may be the responsibility of the water authority.	Total	£0.00
---	-------	-------

**Condition Grade**

A - Structurally sound with no leakage evident.	plus VAT @20%	£0.00
B - Cracks and fractures observed.		
C - Structurally unsound	<b>Total + VAT</b>	<b>£0.00</b>

Quotation is binding only if accepted within 28 days from date of issue and is subject to our Standard Terms and Conditions  
The price qualification notes, stated on the drainage solutions schedule of rates, apply to this quotation.  
CET Structures Ltd undertakes to return to site free of charge to carry out remedial work to the drainage repairs set out above for a period of 2 months from the date of this invoice. The company standard charge rates will apply to the visit should the work requested be unrelated to the said repairs.

# Underground Drainage Report

Sheet: 1 of 4

Job No: 287264

Date: 20-Oct-15

Site: 54 Compayne Gardens, London

Work carried out for: Cunningham Lindsey - Maidstone

## MANHOLE DETAILS

Manhole	Depth to Invert	Condition
MH1	950mm	As built
MH4	600mm	As built

## CCTV Survey:-

### 1. Drainage Run:

From manhole 1 run 1 to unknown / disused - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Slabs
0.6	JDL		
0.6	LR		
0.6	DES	80%	
1.0			Under S/S
1.3	SA	Survey abandoned - unable to push - assumed disused	

### 2 Drainage Run:

From manhole 1 run 2 to manhole 2 - 100mm cast iron combined - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Slabs
0.5			Steps
3.5			Slabs
4.0			Slabs
6.0	FH	Survey ends - reached MH2 (situated in garden of other ground floor flat)	

## Water Test Grade:

0 - Unable to fill	2 - Medium Loss over 2 minutes
1 - Heavy Loss	3 - Slow Loss over 5 minutes
	4 - No Loss

# Underground Drainage Report

Sheet: 2 of 4

Site: 54 Compayne Gardens, London

Job No: 287264

Work carried out for: Cunningham Lindsey - Maidstone

Date: 20-Oct-15

### 3 Drainage Run:

From manhole 1 run 3 to unknown - cast iron surface water - upstream (shared)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Slabs
0.8	DES	60%	
1.0			Concrete
1.6	LU		
1.9	LR		
1.9	FH	Survey ends - reached unknown assumed disused (gully not there)	

### 4 Drainage Run:

From manhole 1 run 4 to manhole 3 - cast iron combined - downstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Slabs
1.0			Concrete
2.7			Under hedge
14.6	JN	At 12 o'clock	
22.6	FH	Survey ends - reached MH3 under hedge (unable to lift)	

### 5 Drainage Run:

From manhole 4 run 5 to rain water gully 1 - plastic surface water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete
0.0	LL	Line left	
0.2	FH	Finish - reached RWG1	
<b>Gully condition:</b>		As built	

### Water Test Grade:

0 - Unable to fill	2 - Medium Loss over 2 minutes
1 - Heavy Loss	3 - Slow Loss over 5 minutes
	4 - No Loss

# Underground Drainage Report

Sheet: 3 of 4

Job No: 287264

Date: 20-Oct-15

Site: 54 Compayne Gardens, London

Work carried out for: Cunningham Lindsey - Maidstone

## 6 Drainage Run:

From manhole 4 run 6 to DSWC1 - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Under property (unseen)
2.3	LL		
5.5	LU		
6.0	FH	Survey ends - reached DSWC1	

## 7 Drainage Run:

From manhole 4 run 7 to upstream - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Under property
0.4	MC	To plastic	
0.9	LR		
5.0	LU		
5.8	FH	Survey ends - reached unknown	

## 8 Drainage Run:

From manhole 4 run 8 to buried waste gully 2 - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete
0.0	DEG	10%	
0.2	LL		
0.2	DE	100%	
0.2	FH	Survey ends - reached buried WG2	

## Water Test Grade:

0 - Unable to fill	2 - Medium Loss over 2 minutes
1 - Heavy Loss	3 - Slow Loss over 5 minutes
	4 - No Loss

# Underground Drainage Report

Sheet: 4 of 4

Job No: 287264

Date: 20-Oct-15

Site: 54 Compayne Gardens, London

Work carried out for: Cunningham Lindsey - Maidstone

## 9 Drainage Run:

From manhole 4 run 9 to waste gully 1 - 100mm clay foul water - upstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete
0.1	LL		
0.2	FH	Survey ends - reached WG1	
<b>Gully condition:</b> As built			

## 10 Drainage Run:

From manhole 4 run 10 to run 4 - 100mm clay combined - downstream (shared with flats)

Metres:	Code:	Observations:	Surface Material/ Condition:
0.0		Start	Concrete
0.0	LD	Slight	
1.0	FH	Survey ends - reached run 4	

**- End of Survey -**

*Our assessment of the drainage system is based on our visual inspection and on information collated at the time of the survey. Where assumptions have been made these are based on our experience and do not constitute any form of guarantee, nor do we guarantee that further deterioration will not occur following this survey. CCTV video records will be stored for a period of 3 months from date of inspection and then destroyed.*

## Water Test Grade:


0 - Unable to fill	2 - Medium Loss over 2 minutes
1 - Heavy Loss	3 - Slow Loss over 5 minutes
	4 - No Loss

## Water Authority Sewer Condition Codes

<b>B</b> Broken pipe at... (or from... to...) o'clock	<b>JN</b> Junction at...o'clock, diameter...mm
<b>BR</b> Branch Major	<b>JX</b> Junction defective at.. o'clock, diameter.. mm
<b>CC</b> Crack circumferential from... to... o'clock	<b>LC</b> Lining of sewer changes/starts/finishes at this point
<b>CL</b> Crack longitudinal @... o'clock	<b>LD</b> Line of sewer deviates down
<b>CM</b> Cracks multiple from... to... o'clock	<b>LL</b> Line of sewer deviates left
<b>CN</b> Connection at... o'clock, diameter... mm	<b>LN</b> Line defect at (or from.. to.. ) o'clock
<b>CNI</b> Connection at... o'clock, diameter... mm, intrusion... mm	<b>LR</b> Line of sewer deviates right
<b>CU</b> Camera under water	<b>LU</b> Line of sewer deviates up
<b>CX</b> Connection defective at... o'clock	<b>MB</b> Missing bricks at.. (or from.. to..) o'clock
<b>CXI</b> Connection defective at... o'clock, diameter... mm, intrusion... mm	<b>MC</b> Material of sewer changes at this point
<b>D</b> Deformed sewer... %	<b>MH</b> Manhole/node
<b>DB</b> Displaced bricks at (or from.. to..) o'clock	<b>MM</b> Mortar missing medium at.. (or from.. to..) o'clock
<b>DC</b> Dimension of sewer changes at this point	<b>MS</b> Mortar missing surface at.. (or from.. to..) o'clock
<b>DE</b> Debris (non silt/grease)... % cross-sectional loss	<b>MT</b> Mortar missing total at.. (or from.. to..) o'clock
<b>DEG</b> Debris grease... % cross-sectional area loss	<b>OB</b> Obstruction... % height/diameter loss
<b>DES</b> Debris silt... % cross-sectional area loss	<b>OJL</b> Open joint large
<b>DI</b> Dropped invert, gap... mm	<b>OJM</b> Open joint medium
<b>EHJ</b> Encrustation heavy from.. to.. o'clock % cross-sectional area loss (at joint)	<b>PC</b> Length of pipe forming sewer changes at this point, new length...mm
<b>ELJ</b> Encrustation light from.. to.. o'clock%	<b>RFJ</b> Roots fine (at joint)
<b>EMJ</b> Encrustation medium from.. to.. o'clock %, cross-sectional area loss (at joint)	<b>RMJ</b> Roots mass... % cross-sectional area loss (at joint)
<b>ESH</b> Scale heavy... % cross-sectional area loss from... to... o'clock	<b>RTJ</b> Roots tap (at joint)
<b>ESL</b> Scale light from... to... o'clock	<b>SA</b> Survey abandoned
<b>ESM</b> Scale medium... % cross-sectional area loss from... to... o'clock	<b>SC</b> Shape of sewer changes at this point
<b>FC</b> Fracture circumferential from... to... o'clock	<b>SSL</b> Surface damage, spalling large at (or from.. to..) o'clock
<b>FL</b> Fracture longitudinal at... o'clock	<b>SSM</b> Surface damage, spalling medium at (or from.. to..) o'clock
<b>FM</b> Fractures multiple from... to... o'clock	<b>SSS</b> Surface damage, spalling slight at (or from.. to..) o'clock
<b>GO</b> General observation at this point	<b>SWL</b> Surface damage, wear large at... (or from.. to..) o'clock
<b>GP</b> General photograph number... taken at this point	<b>SWM</b> Surface damage, wear medium at... (or from.. to..) o'clock
<b>H</b> Hole in sewer at... o'clock	<b>SWS</b> Surface damage, wear slight at.. (or from.. to..) o'clock
<b>IDJ</b> Infiltration dripper at (or from... to...) o'clock (at joint)	<b>V</b> Vermin (rats and mice)
<b>IGJ</b> Infiltration gusher at (or from... to...) o'clock (at joint)	<b>WL</b> Water level... % height/diameter
<b>IRJ</b> Infiltration runner at (or from... to...) o'clock (at joint)	<b>X</b> Sewer collapsed... % cross-sectional area loss
<b>ISJ</b> Infiltration seeper at (or from... to...) o'clock (at joint)	<b>FH</b> End of survey
<b>JDM</b> Joint displaced medium	
<b>JDL</b> Joint displaced large	



M/H: 1 Depth: 950mm

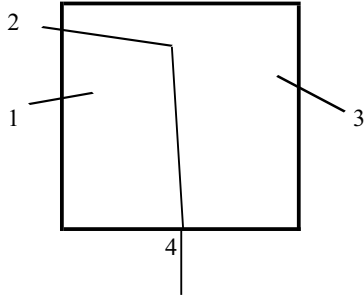

Chamber Dimension (mm):


Depths of run if different to invert level:-

Run \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Manhole Condition

As built

M/H: 4 Depth: 600mm

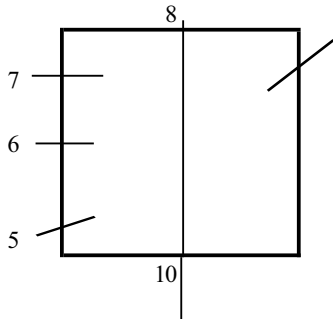

Chamber Dimension (mm): 650 X 450


Depths of run if different to invert level:-

Run \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Manhole Condition

As built

M/H: Depth:



Chamber Dimension (mm):

Depths of run if different to invert level:-

Run \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Manhole Condition


KEY...



Internal Back Drop



External Back Drop



Interceptor

Water Pressure Test Results

From:

To:

Pass / Fail