


TABLE 1

NOISE SURVEY LTD

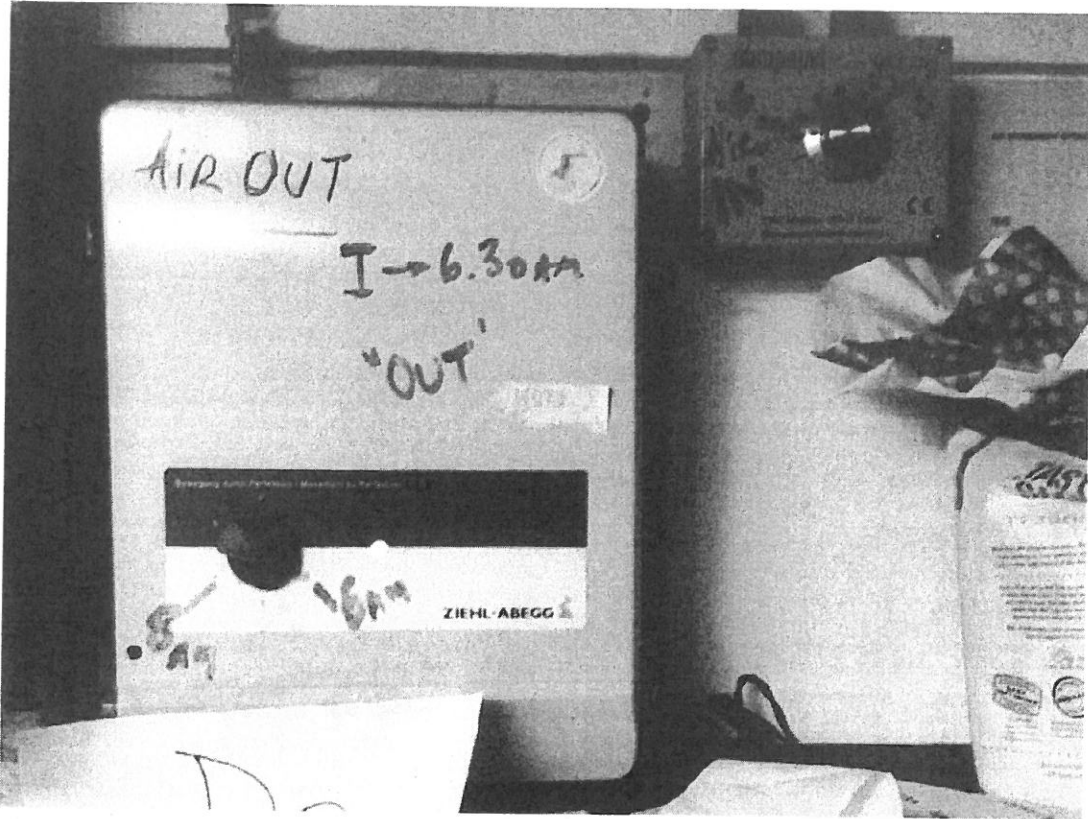

Picture AP1: Settings on the extractor fan labelled 6AM and 8 AM on the Ziehl Abegg controller. A corresponding 6AM and 8AM setting was also applied respectively on the inlet air controller.

The background noise level was measured as LAF90(15min) 52dB at the start of measurements and LAF90(15min) 53dB..

Description	LAeq (15min)	LAF90 (15min)
Background	54	52
6AM start fan speed 2	56	55
8AM fan speed 4	63	62
Maximum	64	63
6AM start fan speed 1 dial higher	59	57
Background	55	53
3 on the dial	62	61

Table AP1: Noise measurements outside noise sensitive residence.