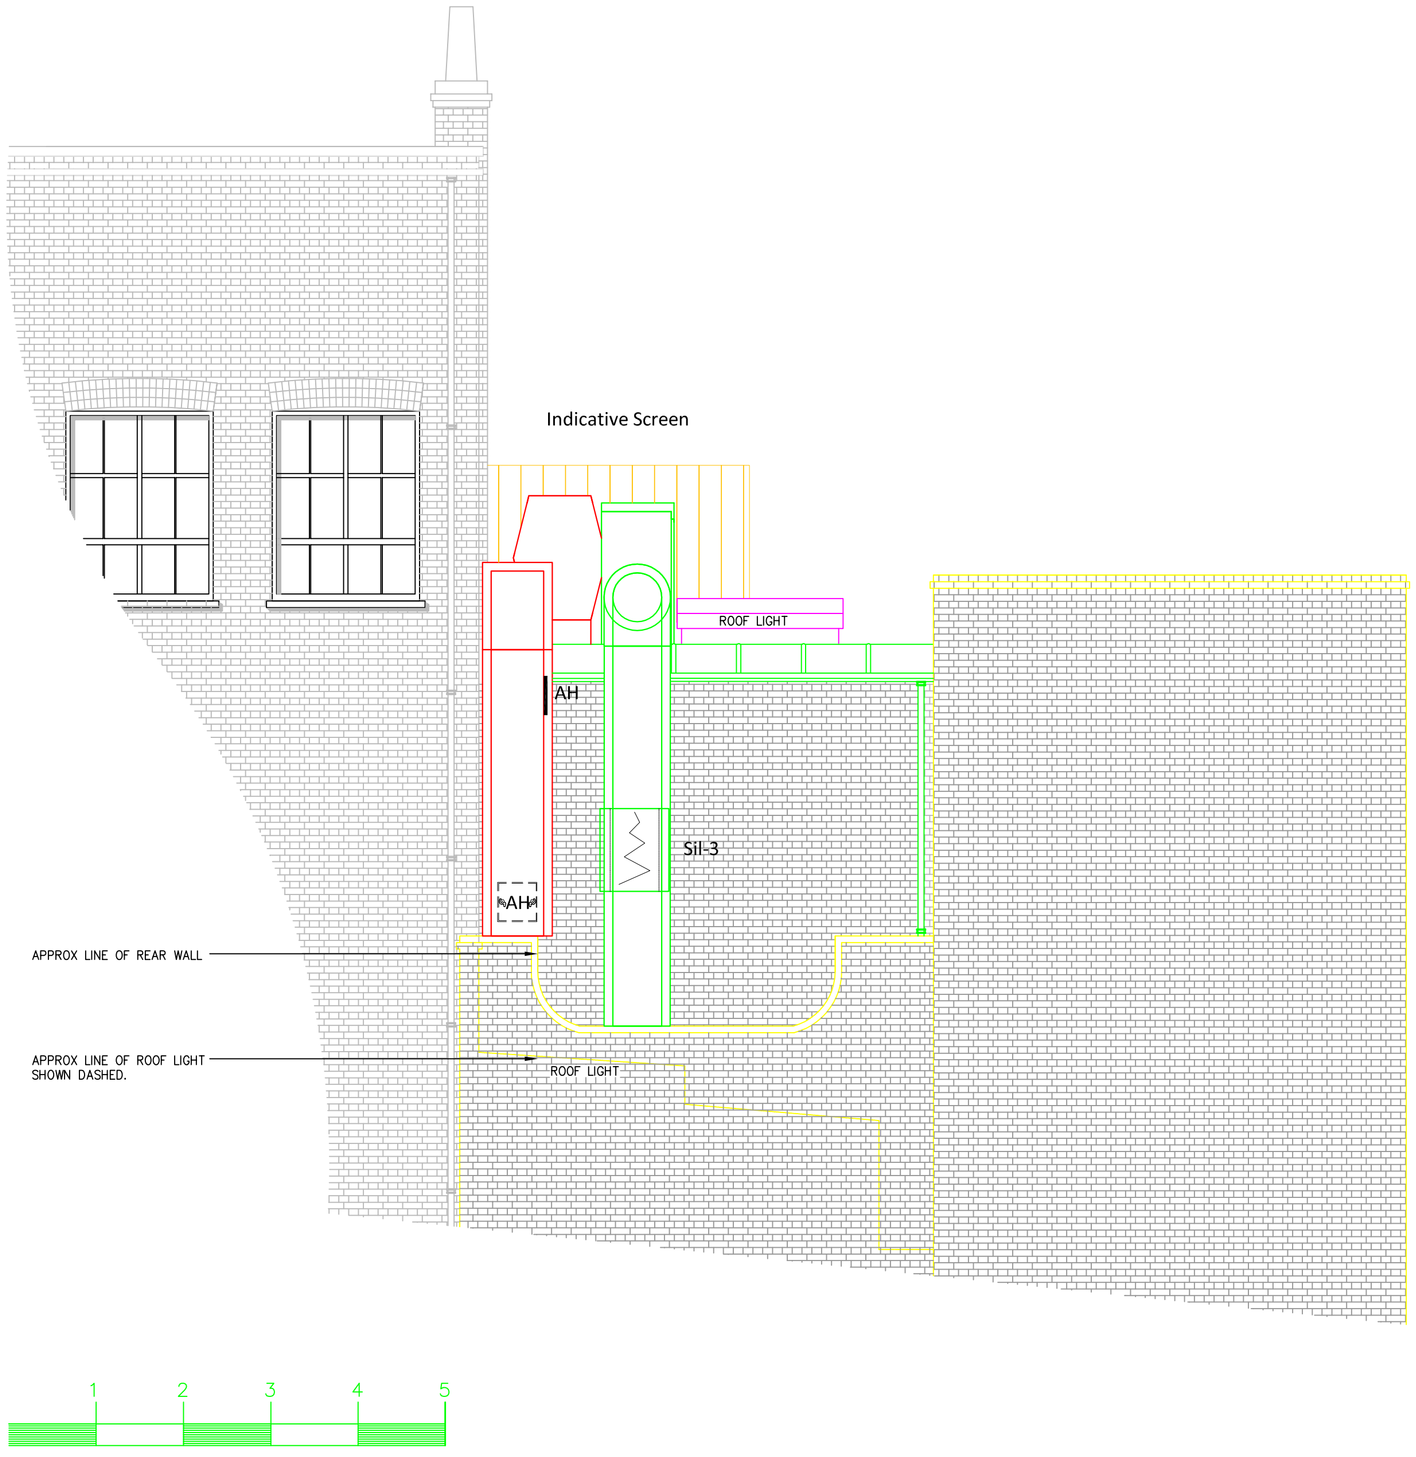

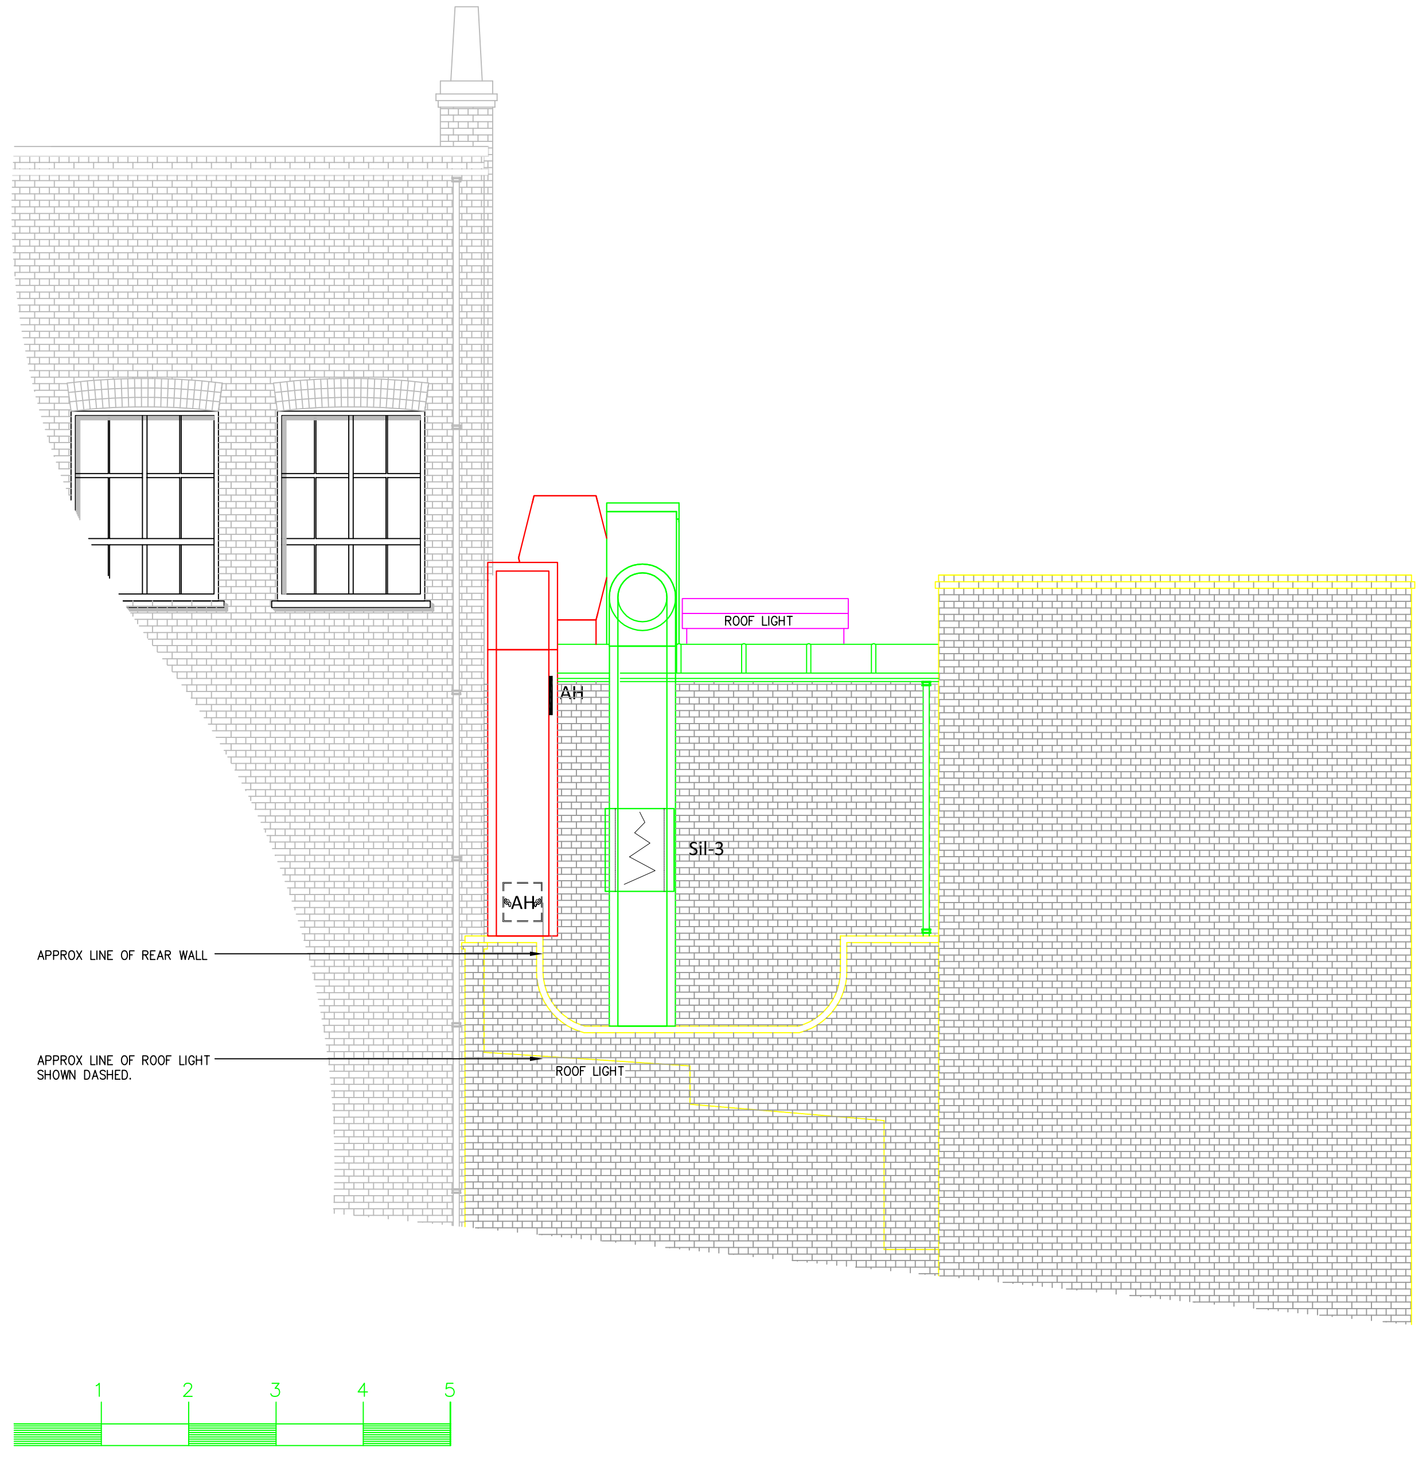

LEGEND:

- Supply Air Duct
- Extract Air Duct
- Supply Air Grille
- Extract Air Grille
- A/C Ceiling Cassette
- A/C Pipe Work
- FD — Fire Damper
- VCD — Volume Control Damper
- Extract Air Valve
- Supply Air Valve
- A/C — Air Conditioning Unit
- AH — 450 x 450 Access Hatch

NOTES:

THIS DRAWING MUST NOT BE SCALED; ALL SETTING OUT MUST BE CHECKED ON SITE; ALL DIMENSIONS MUST BE CHECKED ON SITE; THIS DRAWING MUST BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION CLAUSES; THIS DRAWING MUST NOT BE USED FOR LAND TRANSFER PURPOSE

COPYRIGHT OF LEECH GROUP SERVICES, LEECH MECHANICAL SERVICES & POSITIVE ELECTRICAL COMPANY

LEECH
GROUP SERVICES
Unit 17, Mapledean Works, Maldon Road, Latchingdon, Essex, CM3 6LG
Tel: +44 (0)1621 742424,
Email: help@leechgroupservices.co.uk
www.leechgroupservices.co.uk

Rev	Rev by	Description	Date
I.			
H.			
G.			
F.			
E.			
D.	IT	Silencer added	13/02/2018
C.	IT	Screen length decreased	05/02/2018
B.	IT	Ductwork layout redesigned	31/01/2018
A.	IT	Ductwork layout changed	25/01/2018

PROJECT:
Pizza Express
Food Innovation centre
Charlotte Mews

TITLE:
Proposed Elevation with and without screen

PROJECT NUMBER:	Q5907
DATE:	19/01/2017
DRAWN BY:	IT
CHECKED BY:	
DRAWING NO:	Q5907/007 Rev D
SCALE	1:50@ A1 - 1:100@A3