

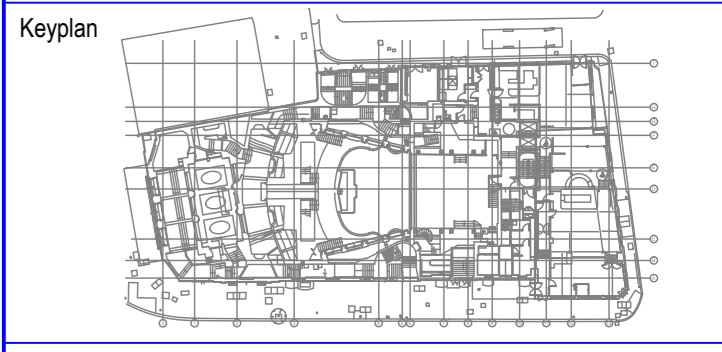
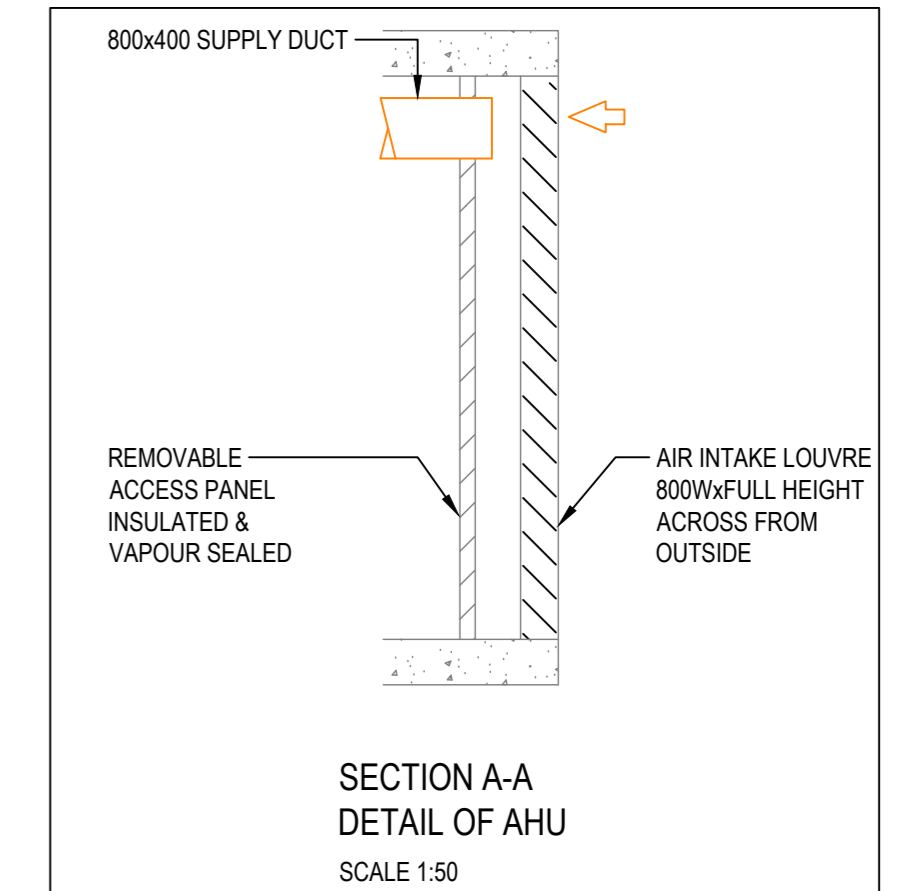
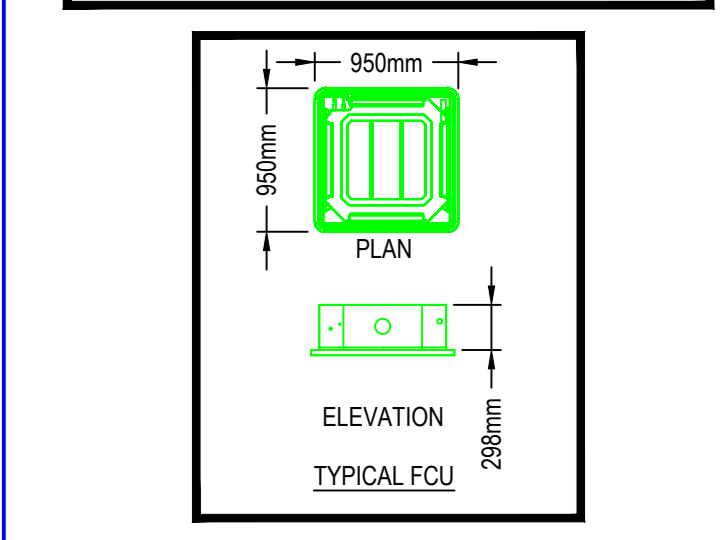
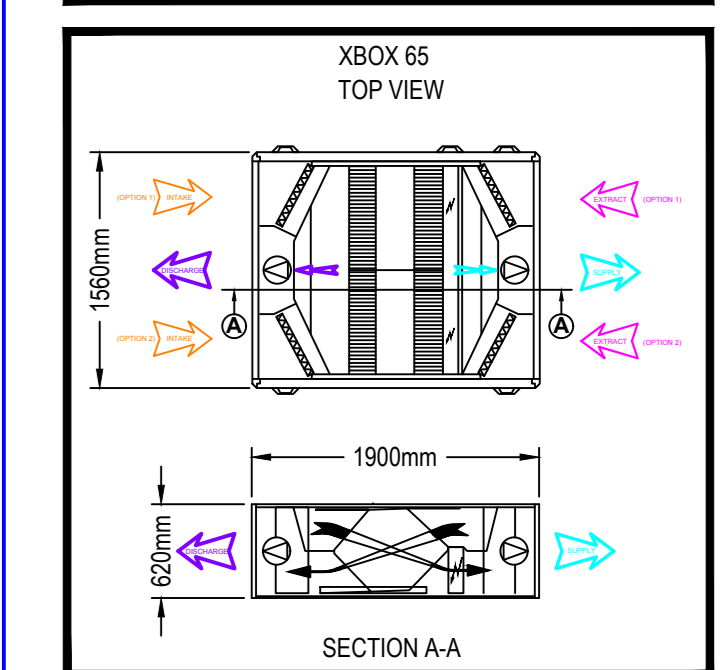


THIS DRAWING IS THE PROPERTY OF RALPH T. KING & ASSOCIATES. IT MUST NOT BE COPIED WITHOUT WRITTEN CONSENT AND IS TO BE RETURNED IN REQUEST. DIMENSIONS IN MM UNLESS OTHERWISE STATED. DO NOT SCALE FROM THIS DRAWING (PRINTED OR ELECTRONIC).

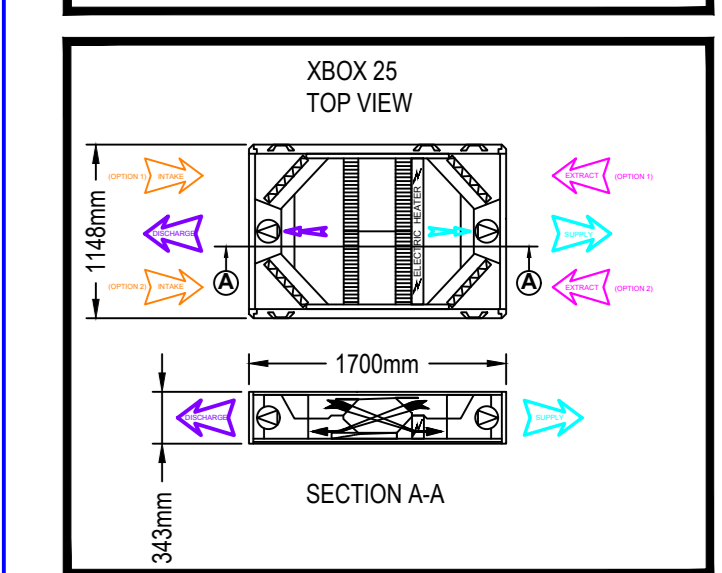

- Notes:
- LEGEND**
 - FRESH AIR DUCTWORK
 - EXHAUST AIR DUCTWORK
 - EXTRACT DUCTWORK
 - SUPPLY DUCTWORK
 - 2 HOUR FIRE RATED KITCHEN EXHAUST DUCT
 - ACOUSTICALLY ENCASED DUCT SECTION
 - AHU AIR HANDLING UNIT
 - FAN COIL UNIT CEILING MOUNTED CASSETTE
 - TRAY AT HL IN CORRIDORS FOR DX PIPework
 - UNSUPPORTED DX PIPework SERVING FAN COILS
 - SMALL AIRVENTER CASE FOR UNIT

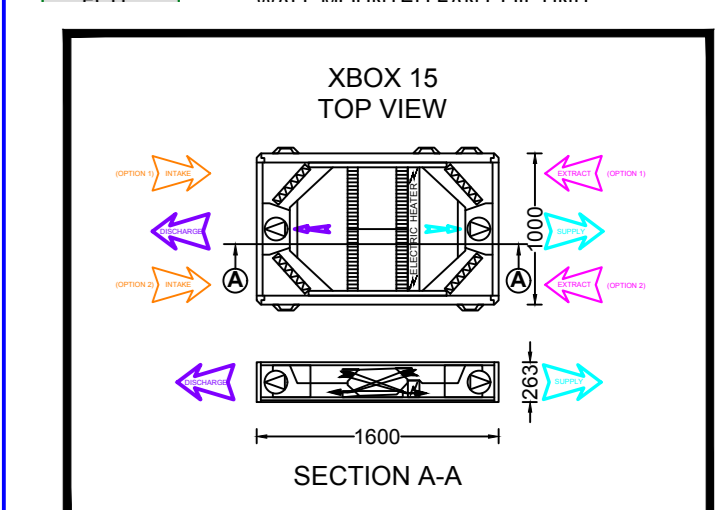

ISSUED FOR TENDER		01.03.18	
Rev	Description	Date	
TENDER			
Client: KOKO			
Project: KOKO - CAMDEN PALACE HOTEL			
Title: GROUND FLOOR VENTILATION LAYOUT SHELL & CORE			
Scale @ A0: 1:50	Drawn (CAD): W.M.	Engineer: N.C.	Date: JAN 2017
Project No.: 1355	Drawing No.: S-M202	Revision: T	
Ralph T. King & Associates Consulting Mechanical & Electrical Engineers			
Old Marlowes House 53 Marlowes Hemel Hempstead Hertfordshire HP1 1LE		Tel: +44 1442 838000 Fax: +44 1442 838080 Email: rti@rtka.co.uk Web: www.rtk.co.uk	