




S29		
Location SUBSTATION ENCLOSURE		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	240 mins	*acceptable
Acoustic Rating	50dB	*acceptable

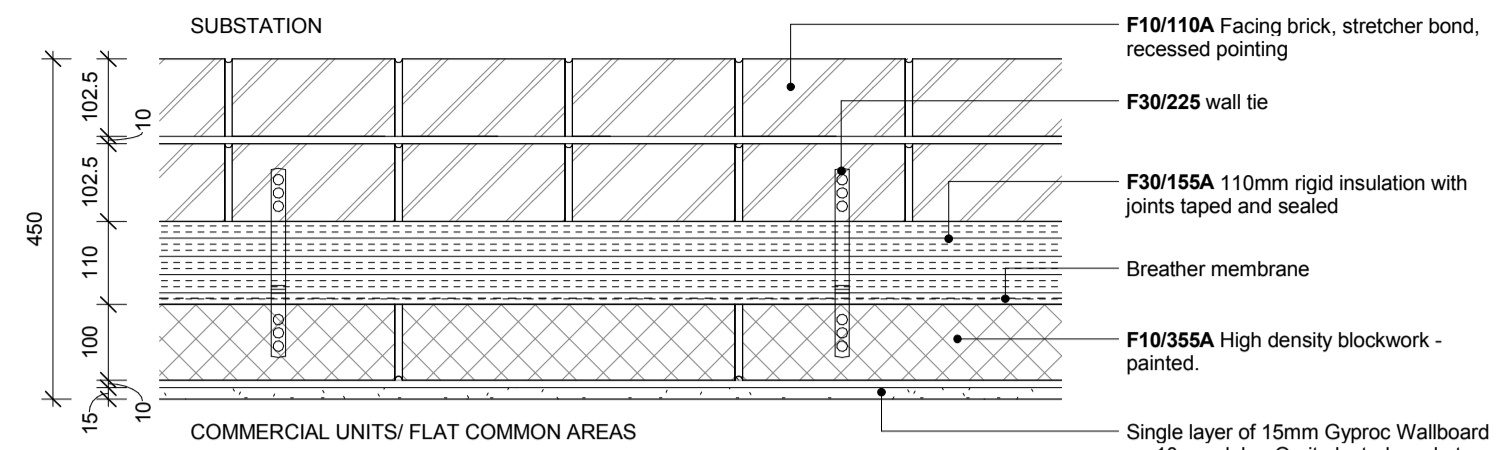


S36		
Location BLOCK F CORE AT JAMB + HEAD OF FLAT ENTRANCE DOORS		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120 mins	120 mins
Acoustic Rating	50dB	*acceptable

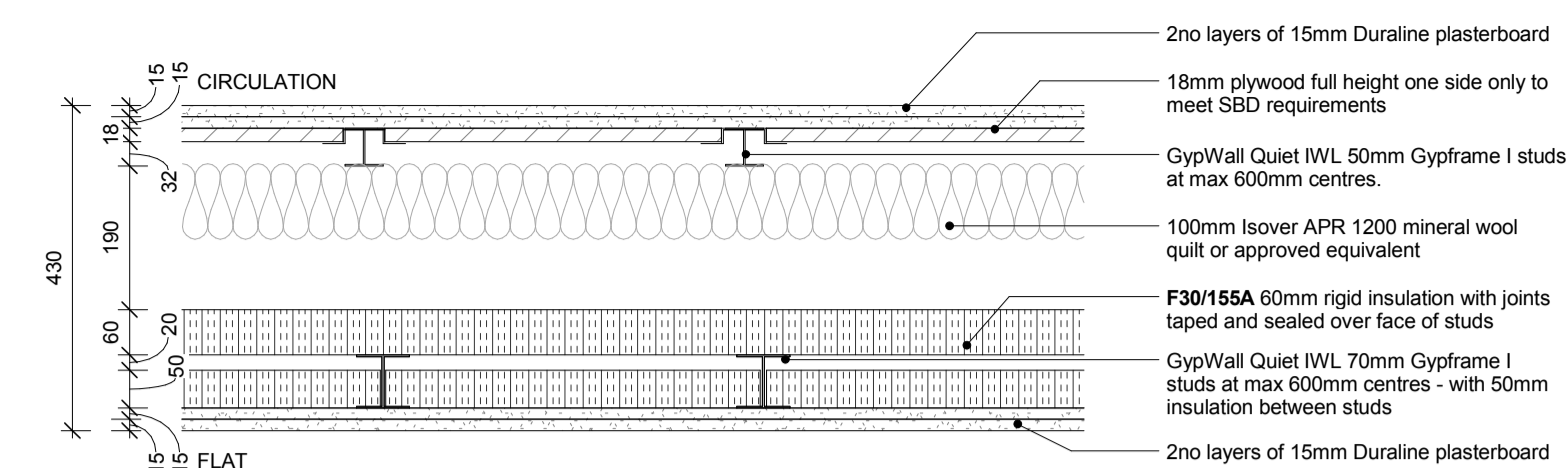


S30		
Location BETWEEN FLAT + COMMERCIAL UNITS		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120 mins	120 mins
Acoustic Rating	50dB	*acceptable

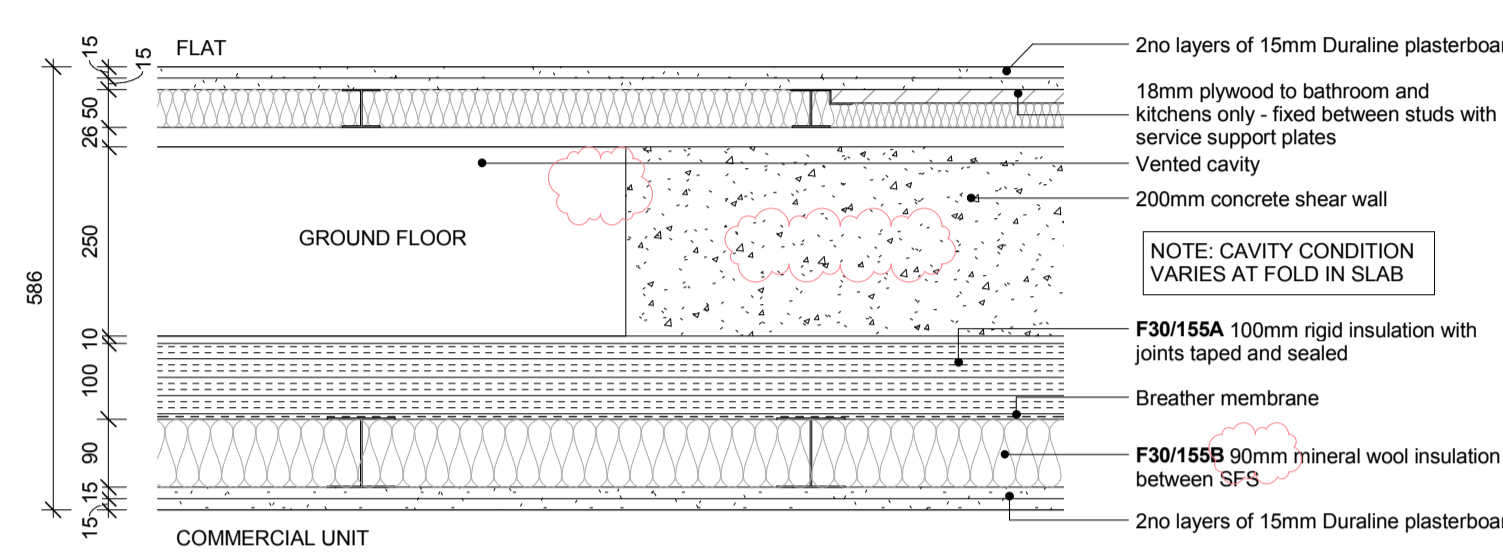


S37		
Location BLOCK F BASEMENT		
U-Value	Target N/A	Achieved N/A
Fire Rating	120 mins	*acceptable
Acoustic Rating	N/A	N/A

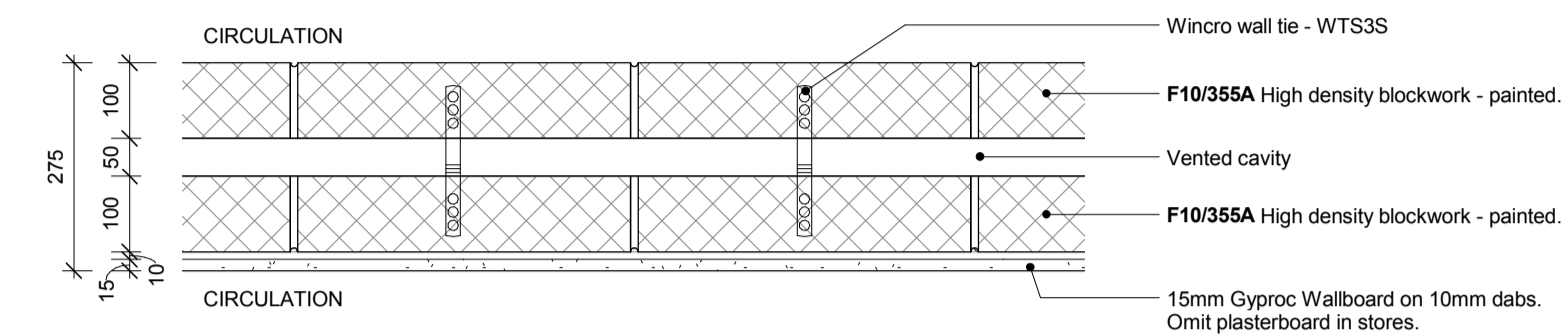


S31		
Location BETWEEN COMMERCIAL UNITS		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120 mins	*acceptable
Acoustic Rating	50dB	*acceptable

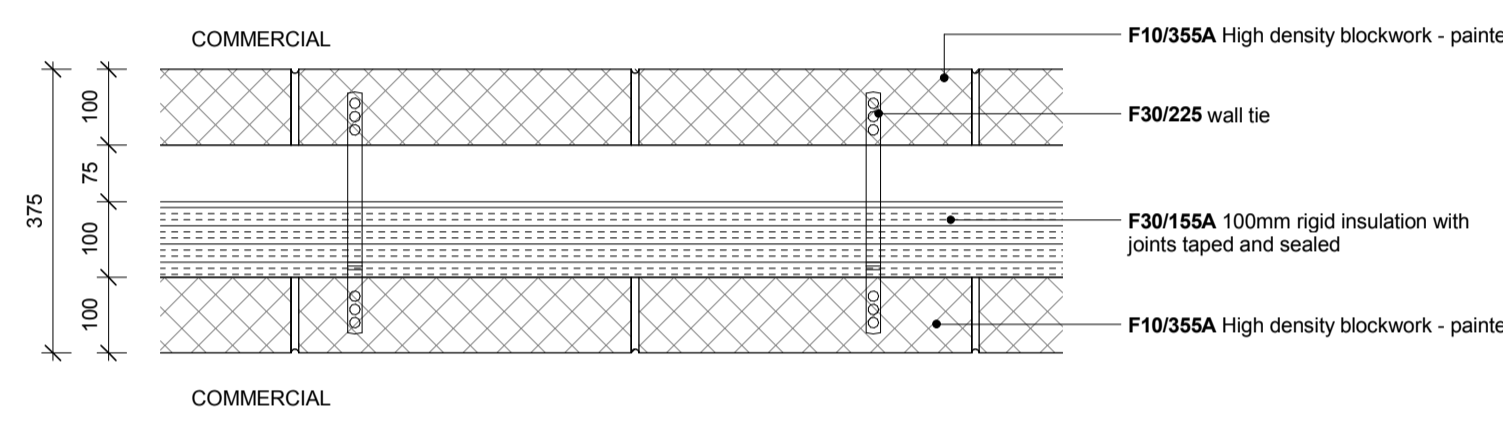


S38		
Location BLOCK D+E STAIR CORES		
U-Value	Target N/A	Achieved N/A
Fire Rating	60 mins	*acceptable
Acoustic Rating	N/A	N/A

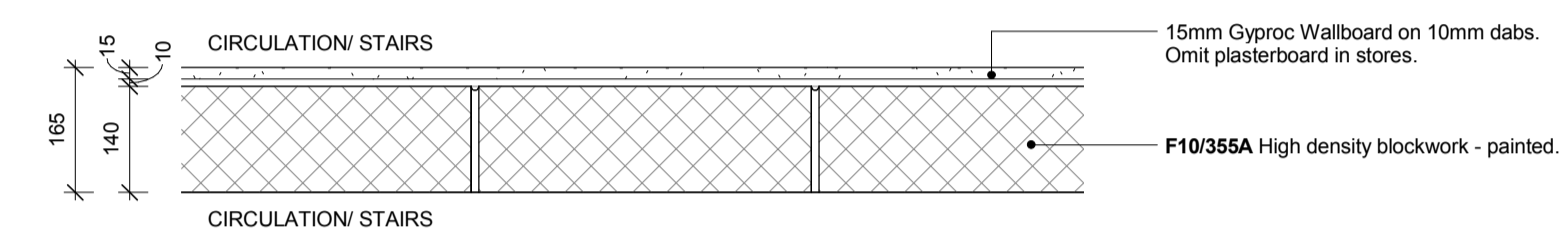


S32		
Location GL26 LEVELS 1 - 5 BETWEEN BLOCKS E + F		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120mins	120mins
Acoustic Rating	50dB	*acceptable

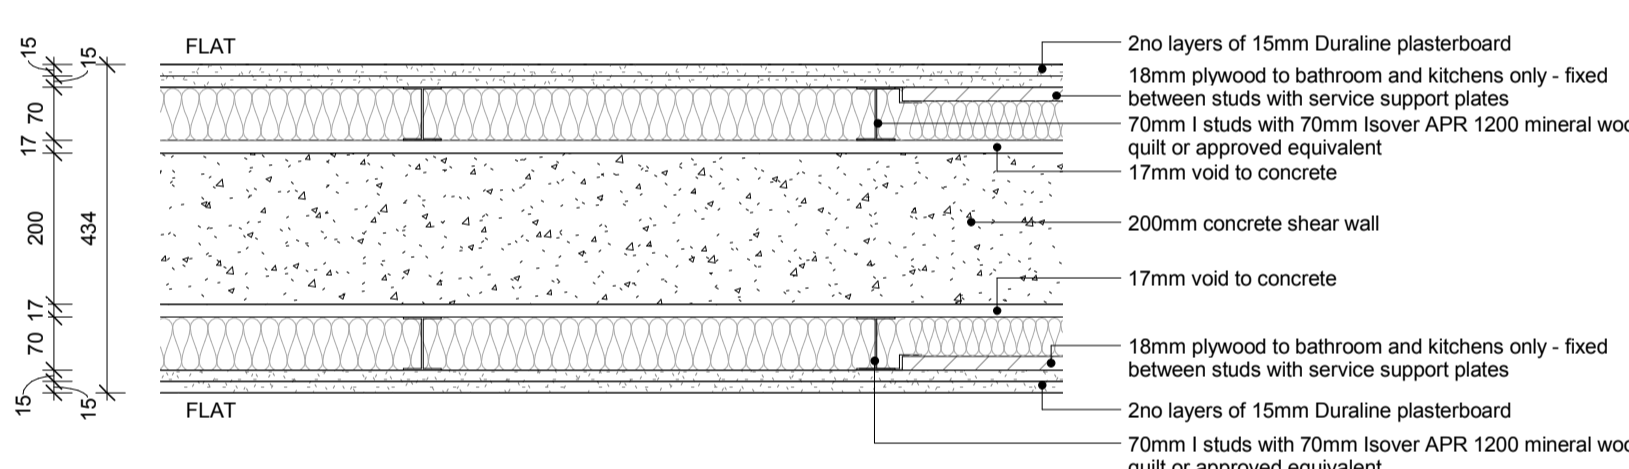


S39		
Location BLOCK E GROUND FLOOR		
U-Value	Target N/A	Achieved N/A
Fire Rating	60mins	60mins
Acoustic Rating	N/A	N/A

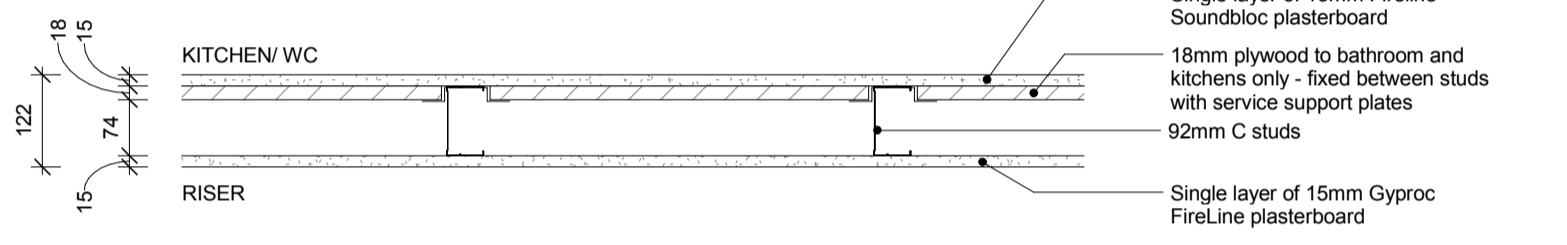


S33		
Location BLOCK F LEVEL 12		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120 mins	120 mins
Acoustic Rating	50dB	*acceptable

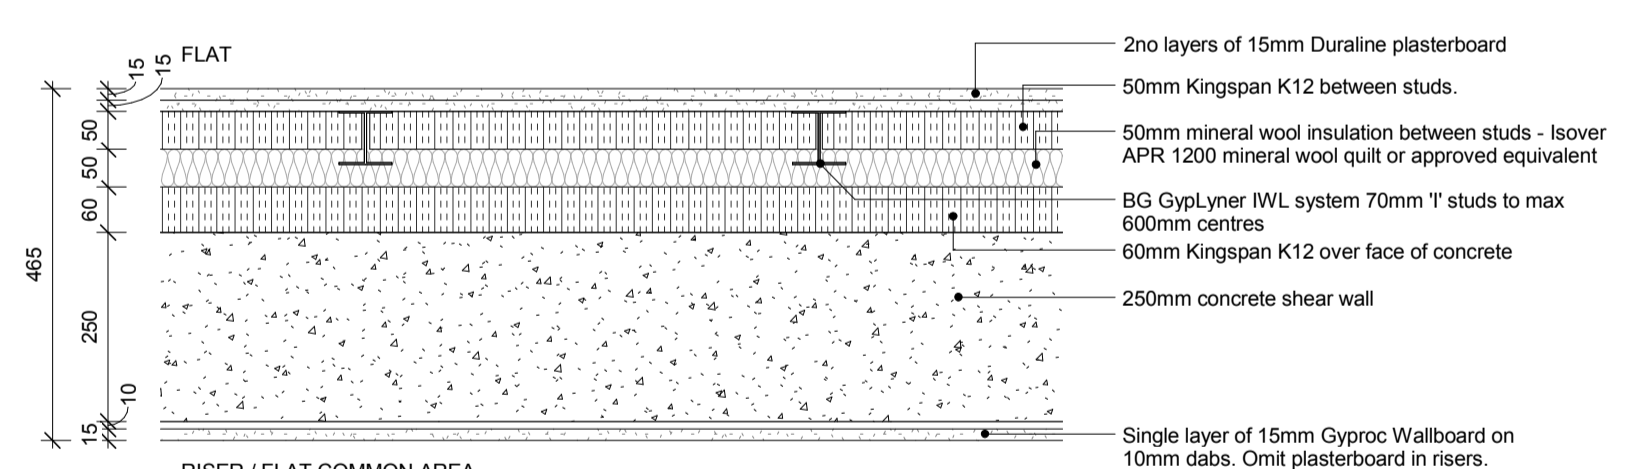


S40		
Location BLOCK D GROUND FLOOR		
U-Value	Target N/A	Achieved N/A
Fire Rating	N/A	N/A
Acoustic Rating	N/A	N/A

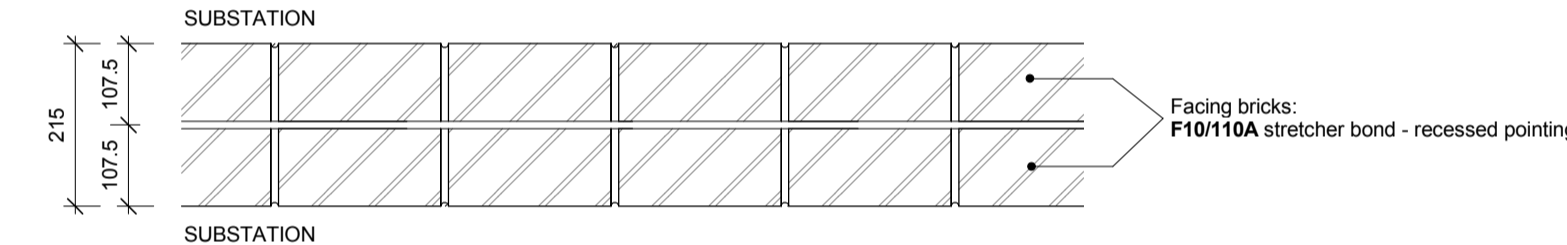


S34		
Location BLOCK F LEVEL 0		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	120 mins	*acceptable
Acoustic Rating	N/A	N/A

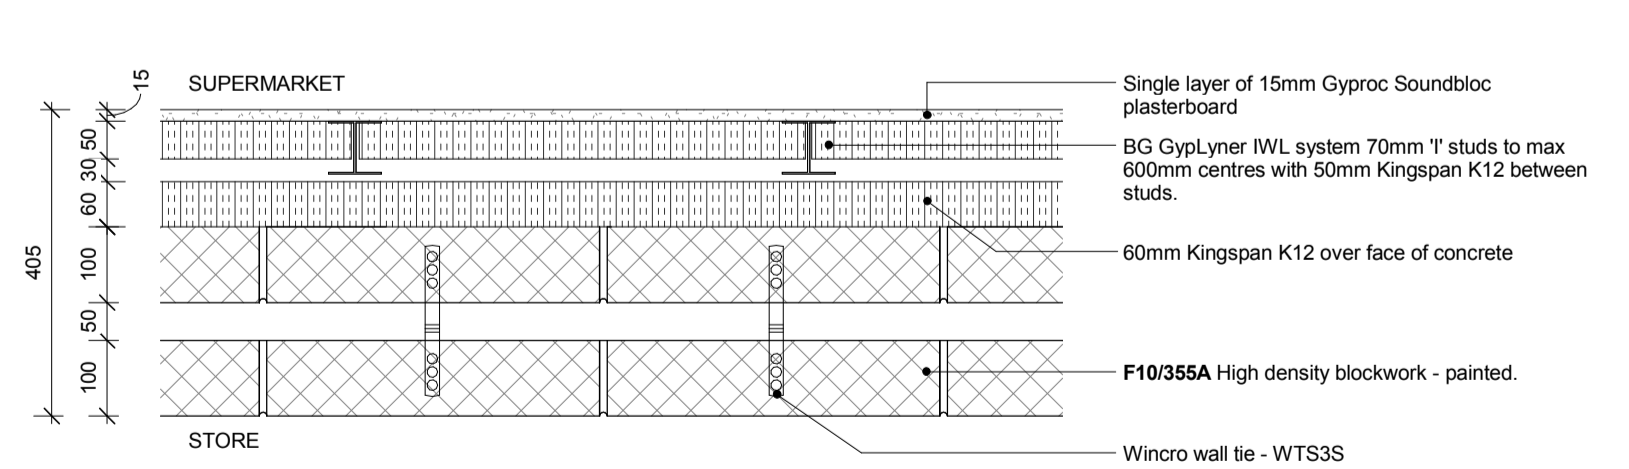


S42		
Location BLOCK B+F BASEMENT		
U-Value	Target N/A	Achieved N/A
Fire Rating	60mins B 120 mins F	*acceptable
Acoustic Rating	N/A	N/A

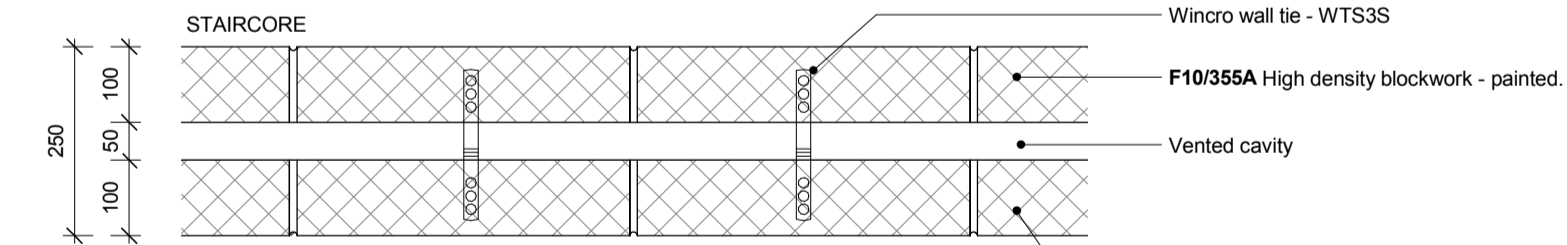


S35		
Location BLOCK E+F CONCIERGE		
U-Value	Target N/A	Achieved TBC
Fire Rating	30mins	60mins
Acoustic Rating	N/A	N/A

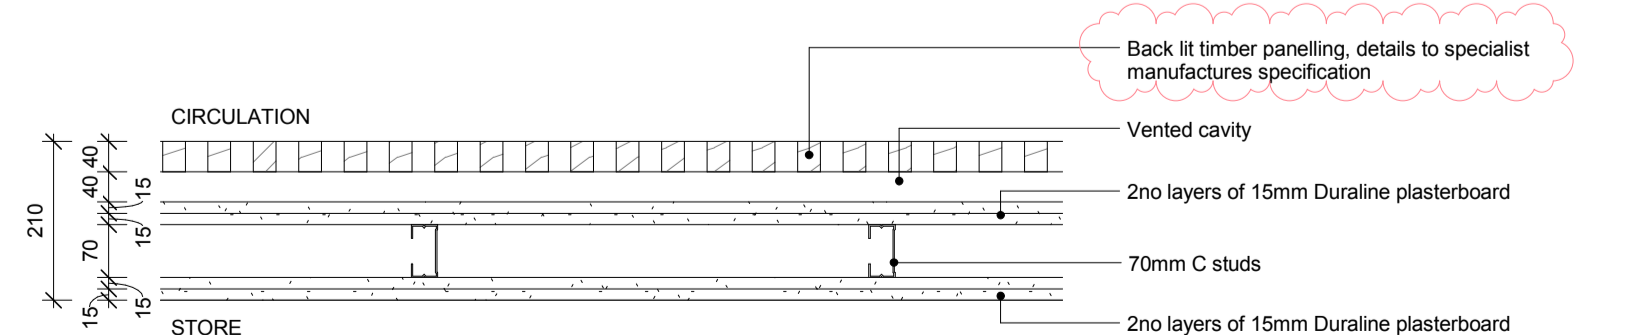

S43		
Location BLOCK D FIFTH FLOOR		
U-Value	Target 0.2 W/m ² K	Achieved TBC
Fire Rating	60min	90mins
Acoustic Rating	50dB	*acceptable

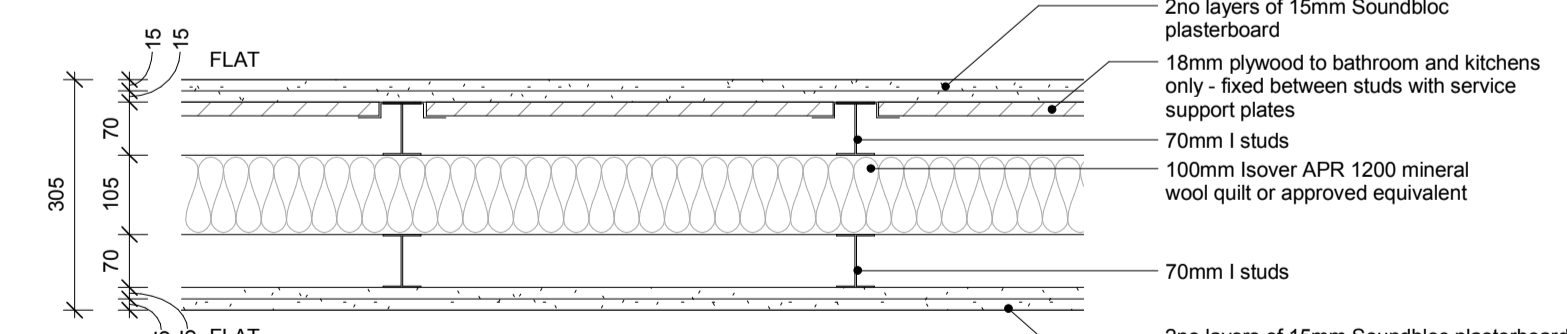


S44		
Location CONCIERGE		
U-Value	Target N/A	Achieved TBC
Fire Rating	60mins	60mins
Acoustic Rating	N/A	N/A

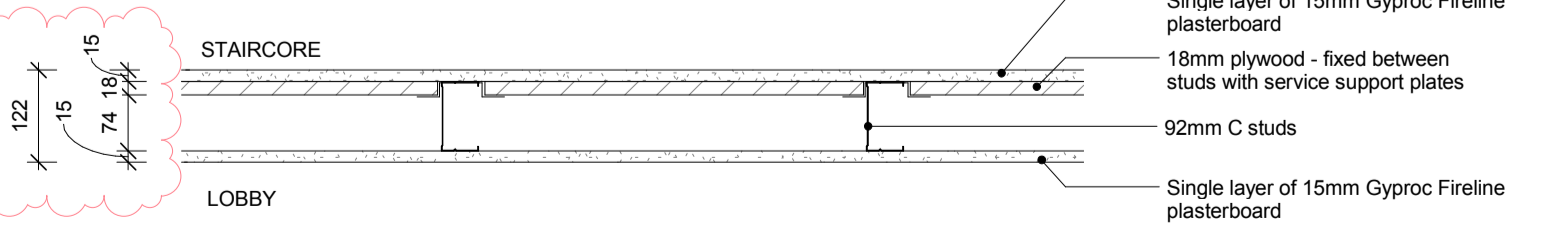

GENERAL NOTES
This drawing is copyright of PTE architects
Use figured dimensions only. DO NOT SCALE.
All dimensions are in millimetres unless noted otherwise
All levels are in metres above Ordnance datum unless noted otherwise
This drawing must be read in conjunction with all other relevant drawings and specifications from the Architect and other consultants

SETTING OUT NOTES
All setting out to be confirmed on site prior to construction - any discrepancy must be immediately reported to the Architect.
All setting out to face of structure or to grid.
All partitions set out to studwork or structure.
For setting out and specification of M&E services refer to M&E Consultants documents.
For setting out and specification of structure refer to Structural Engineer's documents.



NOTES:
TARGET ACOUSTIC RATINGS ARE 5dB ABOVE THE APPROVED DOCUMENT PART E REQUIREMENTS. ACOUSTIC CONSULTANT TO CONFIRM BUILD-UPS MEET TARGET ACOUSTIC REQUIREMENTS.
ACOUSTIC CONSULTANT TO CONFIRM DECIBEL REDUCTIONS ARE SATISFACTORY.
STRUCTURAL ENGINEER TO CONFIRM 200mm THICK RC WALLS MEET 120 MINS FIRE RESISTANCE REQUIREMENTS.

ACHIEVED U-VALUES TO BE CONFIRMED BY M+E ENGINEER

AWAITING U-VALUES FOR TYPES S29 - S45

B	15/09/17	MINOR UPDATES AND ANNOTATION CHANGES. UPDATES INCLUDE TA COMMENTS.	TH	AM
A	11/11/16	LEVEL 3 CONSTRUCTION ISSUE U-VALUES UPDATED. PLY LAYER INTRODUCED TO TYPES S30 + S32. NOTE UPDATED TO S35. IWL STUD POSITION MOVED IN TYPES S33 + S34. WALL DATA SETS UPDATED TO S29, S38, S39 + S44 ADDED. S30 CONSTRUCTION UPDATED.	DB	EN
/	25/08/16	ISSUED FOR COMMENT - ALL NEW WALL TYPES	AL	DPD
rev	date	description	dm	aud

LEVEL 3 FOR CONSTRUCTION

Diespeker Wharf
38 Graham Street
London N1 8JX
020 7336 7777
forename.surname@pte.a.co.uk
@ptearchitects
www.pollardthomaswards.co.uk

Pollard Thomas Edwards

project	job number	drawn	audited	scale	date
ABBEY AREA PHASE 1	15-029	AL	DPD	1:10@A1	AUG 16
drawing title	drawing number	revision			
TYPICAL SEPARATING WALLS SHEET 3	029_A(22)_004	B			