

**Ingleton
Wood**

Billerica
Cambridge
Colchester
Hertford
London
Norwich

www.ingletonwood.co.uk

**79 Redington Road
Mr & Mrs Tarn
Job No. 811365**

Structural Design Calculations


Author	[Adrian J Wong]
Checked by	[Andrew Wright]
Date	[06/02/18]
Status	[Preliminary]



architecture
building surveying
building services
planning
interiors
sustainability
civil and structural
quantity surveying
project management
CDM and H&S services

Vision, form and function

		Project 79 Redington Road		Project Number 811365	
		Calculation		Calc sheet no Rev / -	
		Drawing ref	Calc by AJW	Date JAN 18	Check by Date
Ref	Calculations				Output
	<u>ROOF LOADS</u> Pitched Roof 45°				
	TILES	:	0.64		
	BATTENS & RAFTERS	:	0.21		
	FELT & INSULATION	:	0.06		
			$0.91 \times \frac{1}{\cos 45^\circ}$		
	ON SLOPE	:	1.29		
	CEILING JOISTS	:	0.12		
	INSULATION	:	0.06		
	PLASTERBOARD	:	0.17		
			1.64 kW/m²		
	LIVE	:	0.75 kW/m²		
	<u>FLOOR LOADS</u>				
	BOARDS & SERVICES	:	0.35		
	JOISTS	:	0.15		
	PLASTERBOARD & skim	:	0.17		
			0.67 kW/m²		
	LIVE + PARTITIONS	:	2.50 kW/m²		
	<u>MASONRY LOADS</u>				
	320mm BRICK WALL	:	6.95		
	PLASTERWORK	:	0.25		
			7.20 kW/m²		
	215mm BRICKWORK	:	4.53		
	PLASTERWORK	:	0.50		
			5.03		

		Project <u>79 Redington Road</u>		Project Number <u>8/1365</u>	
		Calculation		Calc sheet no <u>1</u> Rev <u>-</u>	
		Drawing ref	Calc by <u>Am</u>	Date <u>5/11/18</u>	Check by
Ref	Calculations				Output
	<u>FLAT ROOF LOADS</u>				
	FELT	:	0.17		
	OSB BOARDS	:	0.12		
	FILLINGS	:	0.1		
	JOISTS	:	0.15		
	INSULATION	:	0.06		
	PLASTERBOARD SCUM	:	<u>0.17</u>		
			0.77 kw/m^2		
	LIVE	:	0.75 kw/m^2		
	<u>CONCRETE SLAB (SUSPENDED BL)</u>				METAL DECK ??
	200mm THK	:	4.8		
	INSULATION	:	0.06		
	FINISHES 75mm screed	:	<u>1.8</u>		
			6.7 kw/m^2		
	LIVE + PARTITIONS	:	2.50 kw/m^2		
	<u>METAL DECK (RIB DECK 80)</u>				
	METAL DECK	:	0.20		
	150mm CONCRETE	:	3.60		
	FINISHES	:	<u>0.50</u>		
			4.30 kw/m^2		
	LIVE + PARTITIONS	:	2.50 kw/m^2		

	Project 79 Redington Road			Project ref. 811365		
	Part of Structure EXISTING WALL LINE LOADS			Sheet no. 1		Rev.
	Drawing ref.	Calc by AW	Date Jan-18	Check by	Date	Date

Project 79 Readington Road	
-----------------------------------	--

Loadings All weights from BS 648 1964 Schedule of Weights for Building Materials
Live Loads based on BS 6399 Pt 1 1984

Element Loads

	Live Load (kN/m ²)	Dead Load (kN/m ²)
<u>Pitched Truss Roof</u>		
Tiles		0 65
Boards/Felt		0 25
Truss & Battens		0 35
Ceiling & Services		0 40
Ceiling Imposed		
Rafter Imposed	0 75	
	<u>0 75</u>	<u>1 65</u>
<u>Second Floor</u>		
Boards & Services		0 35
Joists		0 15
Plasterboard & Skim		0 17
Imposed	1 50	
Partitions	0 50	
	<u>2.00</u>	<u>0 67</u>
<u>First Floor</u>		
Boards & Services		0 35
Joists		0 15
Plasterboard & Skim		0 17
Imposed	1 50	
Partitions	0 50	
	<u>2.00</u>	<u>0.67</u>
<u>Ground Floor</u>		
Boards & Services		0 35
Joists		0 15
Plasterboard & Skim		0 17
Imposed	1 50	
Partitions	0 50	
	<u>2.00</u>	<u>0.67</u>
<u>30mm Solid Wall</u>		
Masonry		6 90
Plaster		0 25
		<u>7.15</u>
<u>Internal Wall</u>		
215mm THK Blockwork		4 53
Plaster both sides		0 50
		<u>5.03</u>
	<u>6 75</u>	<u>15.84</u>

	Project 79 Redington Road			Project ref. 811365	
	Part of Structure EXISTING WALL LINE LOADS			Sheet no. 2	Rev.
	Drawing ref.	Calc by AW	Date Jan-18	Check by	Date

Project	79 Readington Road
----------------	---------------------------

LINE LOADS

Refer to Load case Plan

Load Case

Wall A

Grid Ref

Pitched Truss Roof	2 3	m ² /m
Second Floor	2 4	m ² /m
First Floor	2 4	m ² /m
Ground Floor	2 4	m ² /m
330mm Solid Wall	8	m
Internal Wall		m
		m
		m
Beam Self Weight		kN/m

Service Load (kN/m run)	
Live Load	Dead Load
1 73	3 80
4 80	1 61
4 80	1 61
4 80	1 61
	57 60
16.13	66.22

Design Service Load = 82 34 kN/m

Design Ultimate Load = 118 51 kN/m

Load Case

Wall B

Grid Ref

Pitched Truss Roof	5	m ² /m
Second Floor	5 4	m ² /m
First Floor	5 4	m ² /m
Ground Floor	5 4	m ² /m
330mm Solid Wall		m
Internal Wall	8	m
		m
		m
Beam Self Weight		kN/m

Service Load (kN/m run)	
Live Load	Dead Load
3 75	8 25
10 80	3 62
10 80	3 62
10 80	3 62
	40 24
36 15	59 34

Design Service Load = 95 49 kN/m

Design Ultimate Load = 140 92 kN/m

Load Case

Wall C

Grid Ref

Pitched Truss Roof	2 7	m ² /m
Second Floor	2 7	m ² /m
First Floor	2 7	m ² /m
Ground Floor	2 7	m ² /m
330mm Solid Wall	8	m
Internal Wall		m
		m
		m
Beam Self Weight		kN/m

Service Load (kN/m run)	
Live Load	Dead Load
2 03	4 46
5 40	1 81
5 40	1 81
5 40	1 81
	57 60
18 23	67 48

Design Service Load = 85 71 kN/m

Design Ultimate Load = 123 63 kN/m

Load Case

Wall D

Grid Ref

Pitched Truss Roof	2 75	m ² /m
Second Floor	2 75	m ² /m
First Floor	2 75	m ² /m
Ground Floor	2 75	m ² /m
330mm Solid Wall	8	m
Internal Wall		m
		m
		m
Beam Self Weight		kN/m

Service Load (kN/m run)	
Live Load	Dead Load
2 06	
5 50	1 84
5 50	1 84
5 50	1 84
	57 60
18 56	63 13


Design Service Load = 81 69 kN/m

Design Ultimate Load = 118 08 kN/m

	Project 79 Redington Road			Project ref 811365	
	Part of Structure EXISTING WALL LINE LOADS			Sheet no. 3	Rev.
	Drawing ref	Calc by AW	Date Jan-18	Check by	Date

Project	79 Readington Road
---------	--------------------

<u>LINE LOADS</u>		<u>Refer to Load case Plan</u>	
<u>Load Case</u>	All other external walls		
Grid Ref.		Service Load (kN/m run)	
		Live Load	Dead Load
Pitched Truss Roof	m ² /m		
Second Floor	m ² /m		
First Floor	m ² /m		
Ground Floor	m ² /m		
330mm Solid Wall	10.7		77.04
Internal Wall	m		
	m		
	m		
	m		
Beam Self Weight	kN/m		
		77.04	
Design Service Load =		77.04	kN/m
Design Ultimate Load =		107.86	kN/m

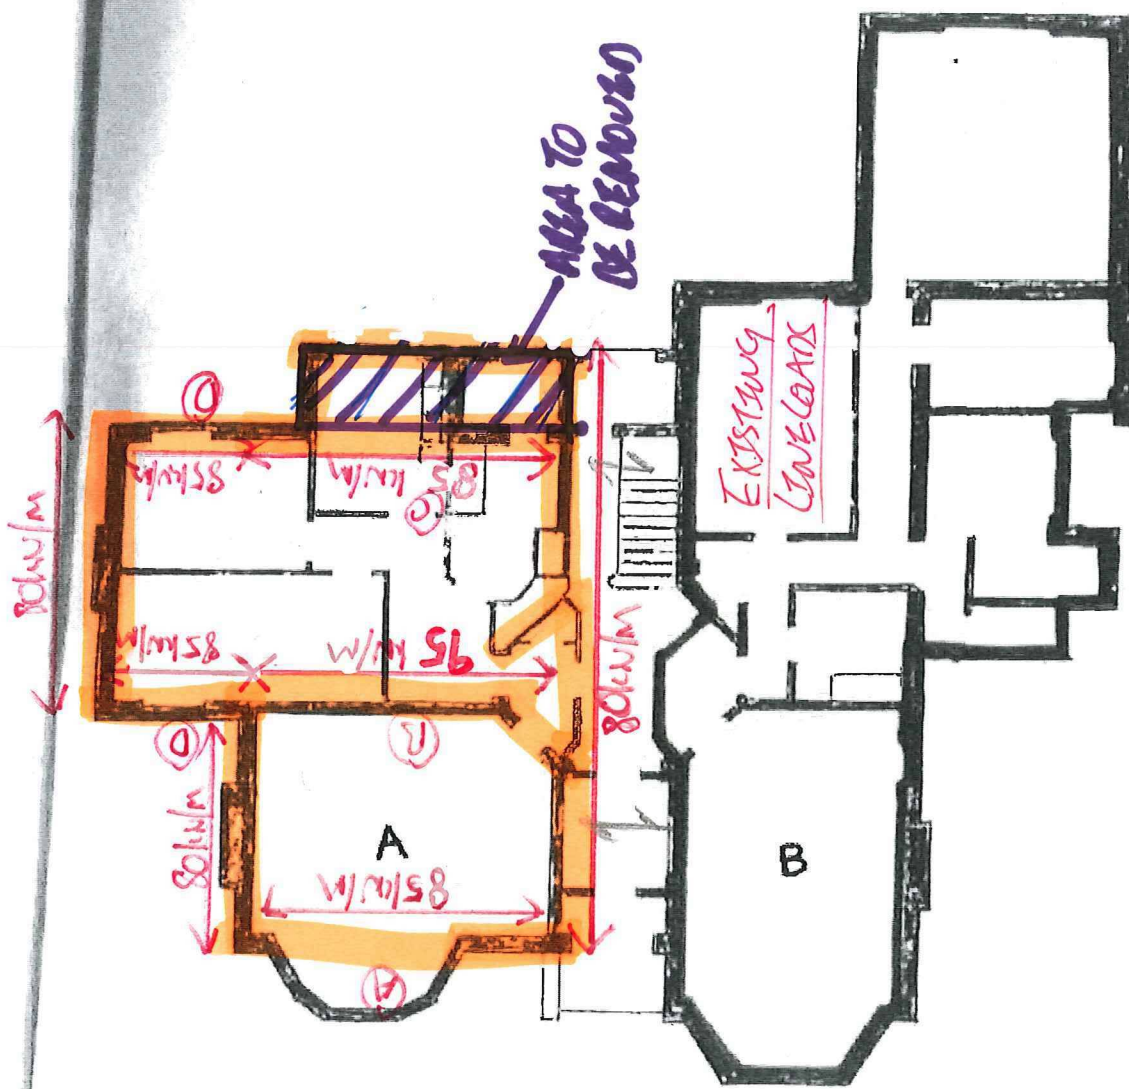

79 REDINGTON ROAD NW3

GROUND FLOOR

Sheila Dunne
 [Signature]

Ingleton
Wood

Project 79 Redington Road.

Project Number 811365

Calculation

Calc sheet no / Rev -

Drawing ref

Calc by A.W.

Date JAN 18

Check by

Date

Ref

Calculations

Output

PROPOSED WALL LINEWORKS

EXTERNAL LEGITIM WALL

WALL WDL $D = 7.2 \times 3 = 25 \text{ kWh}$

WALL CORNERS (SINGLE STOREY)

WALL WDL $D = 7.2 \times 6.0 = 43.2$

FLOOR WDL $D = 0.43 \times 2.2 = 0.95$
 $L = 2.50 \times 2.2 = 5.5$

ROOF WDL $D = 1.04 \times 2.2 = 2.3$
 $L = 1.00 \times 2.2 = 2.2$
55 kWh/m

Ref

Calculations

Output

(S) - Design existing condition. (span 5m)

Roof wall

$$\begin{array}{l} D - 1.64 \times 2.7 = 4.43 \times 1.4 = 6.2 \\ L - 0.75 \times 2.7 = 2.03 \times 1.6 = 3.25 \\ \hline 6.5 \quad 9.5 \end{array}$$

2ND Floor

$$\begin{array}{l} D - 0.67 \times 2.7 = 1.81 \times 1.4 = 2.53 \\ L - 2.50 \times 2.7 = 6.75 \times 1.6 = 10.80 \\ \hline 8.56 \quad 13.33 \end{array}$$

1ST Floor

$$\begin{array}{l} D - 0.67 \times 2.7 = 1.81 \times 1.4 = 2.53 \\ L - 2.50 \times 2.7 = 6.75 \times 1.6 = 10.80 \\ \hline 8.56 \quad 13.33 \end{array}$$

WALL
(320)

$$\begin{array}{l} D - 7.20 \times 2.8 = 20.2 \times 1.4 = 28.3 \\ \hline 44 \text{ kN/m} \quad 64.5 \text{ kN/m} \end{array}$$

$$\begin{array}{l} D - 28 \text{ kN/m} \\ L - 10.23 \end{array}$$

$$M - \frac{64.5 \times 5^2}{8} = 202 \text{ kNm} \quad \text{Deflection limit} \\ - 5 \text{ mm (D+0.5L)}$$

$$I_{req} = \frac{5 \times (28 + 15/2) \times 5000^4}{384 \times 205 \times 10^5 \times 5 \times 10^9} = 28185 \text{ cm}^4$$

∴ Provide 305x305 UC137 (M - 597 kNm
I_{xx} - 27700 cm⁴)

(B) - Design proposed condition (span 5m)

B3 PL

$$\begin{array}{l} D - 3.8 \times 4.8 = 18.24 \times 1.4 = 26 \\ L - 1.7 \times 4.8 = 8.16 \times 1.6 = 13.1 \\ \hline 26.4 \text{ kN} \quad 39.1 \text{ kN} \end{array}$$

+

ANALYSE WITH LOADS ABOVE

Refer to TENDS Design

$$\begin{array}{l} \text{Deflection} \\ \text{SWIT} - 13.9 \text{ mm} \\ \text{(LIVE)} \end{array}$$

∴ Provide 305x305 UC137

WORSTCASE LOADING ABOVE

Ref

Calculations

Output

(B2) - SPAN 3.8m (Proposed loading)

USE SAME LOADS AS BEAM 1

EXISTING UDL

$$D = 28 \times 1.4 = 39.2$$

$$L = 15.0 \times 1.6 = 24.0$$

$$43 \text{ kN/m} \quad 63.2 \text{ kN/m}$$

NEW HATCH
UDL

$$D = 0.77 \times 2.3 = 1.8 \text{ (1.4)} = 2.52$$

$$L = 0.75 \times 2.3 = 1.7 \times 1.6 = 2.72$$

$$3.5 \text{ kN/m} \quad 5.24 \text{ kN/m}$$

$$\text{MOMENT} = 123 \text{ kN.m}$$

$$\text{TOTAL UDL} \quad 47 \text{ kN/m} \quad 68.44 \text{ kN/m}$$

DL

$$\text{SPAN} / 250 = 15.2 \text{ mm}$$

$$I_{req} = \frac{5 \times 47 \times 3800^4}{384 \times 205 \times 10^5 \times 15.2 \times 10^4} = 4095 \text{ cm}^4$$

(B2) - SPAN 3.8m (Existing loading)

USE SAME LOADS AS BEAM 1

$$D = 28 \times 1.4 = 39.2$$

$$L = 15 \times 1.6 = 24$$

$$43 \text{ kN/m} \quad 63.2 \text{ kN/m}$$

$$\text{MOMENT} = 114 \text{ kN.m} \quad (\text{Deflection limit 5mm})$$

$$I_{req} = \frac{5 \times (28 + 150/2) \times 3800^4}{384 \times 205 \times 10^5 \times 5 \times 10^4} = 9403 \text{ cm}^4$$

$$\therefore \text{provide } 254 \times 254 \text{ UC89} \quad (I_{xx} = 3806 \text{ cm}^4)$$

Ref

Calculations

Output

B3 - SPAN 4.8m

Pitched roof
Roof

$$D - 1.64 \times 2.3 = 3.8 \times 1.4 = 5.32$$

$$L - 0.75 \times 2.3 = 1.7 \times 1.6 = 2.72$$

$$\frac{5.5 \text{ kN/m}}{8.04 \text{ kN/m}}$$

$$M - 23.2 \text{ kNm}$$

Deflection Limit

$$- 4000/360 = 13.3 \text{ mm}$$

$$I_{x \text{ req}} = \frac{5 \times 5.5 \times 4800^4}{384 \times 205 \times 10^5 \times 13.3 \times 10^4} = 1394 \text{ cm}^4$$

∴ provide 203x133x30 UB (M - 55 kNm)
I_{xx} - 2400 cm⁴

B4/B5 - SPAN 3.3m

Beam S. LOST CASE

FLAT ROOF
UR

$$D - 0.77 \times 2.3 = 1.78 \times 1.4 = 2.5$$

$$L - 0.75 \times 2.3 = 1.73 \times 1.6 = 2.8$$

$$\frac{3.51 \text{ kN/m}}{5.3 \text{ kN/m}}$$

$$MOMENT - 7.5 \text{ kNm}$$

Deflection Limit - 10mm

$$I_{x \text{ req}} = \frac{5 \times 3.51 \times 3300^4}{384 \times 205 \times 10^5 \times 10 \times 10^4} = 264.4 \text{ cm}^4$$

∴ provide 178x102x19 UB (M - 36 kNm)
I_{xx} - 1360 cm⁴

Ingleton
Wood

Project
79 Redington Road

Project Number
811365

Calculation

Calc sheet no
/

Rev
-

Drawing ref

Calc by
A.W

Date
JUN 18

Check by

Date

Ref

Calculations

Output

B6 - SPAN 2.5m

Pitched Raft w/c

$$D = 1.64 \times 5 = 8.2 \times 1.4 = 11.5$$

$$L = 0.75 \times 5 = 3.75 \times 1.6 = 6$$

2nd Floor

$$D = 0.67 \times 5.4 = 3.62 \times 1.4 = 5.1$$

$$L = 1.50 \times 5.4 = 8.10 \times 1.6 = 13$$

1st Floor

$$D = 0.67 \times 5.4 = 3.62 \times 1.4 = 5.1$$

$$L = 1.50 \times 5.4 = 8.10 \times 1.6 = 13$$

WALL (215)

$$D = 5.03 \times 6 = 30.18 \times 1.4 = 42$$

$$66 \text{ kW/m} \quad 96 \text{ kW/m}$$

$$D = 46$$

$$L = 20$$

B7 + B8. (Blockwork)
PL

$$D = 6.3 \times 2.5 = 15.8 \times 1.4 = 22$$

$$15.8 \text{ kW} \quad 22 \text{ kW}$$

Refer to TEND DESIGN UC: 254x254x71

B7/P1 - SPAN 2.5m

2nd Floor

$$D = 0.67 \times 2.1 = 1.41 \times 1.4 = 1.97$$

$$L = 1.50 \times 2.1 = 3.2 \times 1.6 = 5.12$$

1st Floor

$$D = 0.67 \times 2.1 = 1.41 \times 1.4 = 1.97$$

$$L = 1.50 \times 2.1 = 3.15 \times 1.6 = 5.12$$

Blockwork
+ plaster

$$D = 2.1 \times 3 = 6.3 \times 1.4 = 8.82$$

$$16 \text{ kW/m} \quad 23 \text{ kW/m}$$

MOMENT - 18 kNm

Deflection limit - Same
(D.O.S.C)

$$I_{req} = \frac{5 \times (9.12 + 6.4/2) \times 2500^4}{384 \times 205 \times 10^5 \times 5 \times 10^4} = 611 \text{ cm}^4$$

$$D = 9.12$$

$$L = 6.40$$

Provide 203x102x23 UB ($M_c = 56 \text{ kNm}$
 $I_{yy} = 2340 \text{ cm}^4$)

Ref

Calculations

Output

P1 - Post DESIGN

B1 - Proposed loading

$$D - 55.4 \times 1.4 = 78 \text{ kN}$$

$$L - 77.2 \times 1.6 = 124 \text{ kN}$$

B2 - Proposed loading

$$D - 30 \times 3.8m = 114/2 \times 1.4 = 80 \text{ kN}$$


$$L - 17 \times 3.8m = 64.6/2 \times 1.6 = 52 \text{ kN}$$

(DL+LL)

(B1)

(LL)

(B2)



$$(78 + 124) \times 0.150$$

$$= 30.3 \text{ kNm}$$

$$(52 \times 0.150) = 7.8 \text{ kNm}$$

$$\text{NOTIONAL MOMENT } (30.3 - 7.8) = 22.5 \text{ kNm}$$

$$\text{TOTAL AXIAL FORCE } (78 + 124 + 80 + 52) = 334 \text{ kN}$$

Refer to T&MS DESIGN - PROVIDE 120x120x10 SHS

FIRST FLOOR - Pitched ROOF RASTERS.

∴ 50x150 Dp C24 RASTERS @ 600 Centers

Refer to T&MS DESIGN.

FIRST FLOOR - FLAT ROOF JOISTS.

∴ 50x200 Dp C24 JOISTS @ 450 Centers

Refer to T&MS DESIGN.

Ref

Calculations

Output

BASEMENT BEAM (1) - SPAN 4.8m

EXISTING
FLOOR WFL

$$D - 0.67 \times 2.9 = 1.94 \times 1.4 = 2.72 \text{ kN/m}$$

$$L - 2.50 \times 2.9 = 7.3 \times 1.6 = 11.7 \text{ kN/m}$$

METAL DECK

$$D - 4.30 \times 2.65 = 11.4 \times 1.4 = 16 \text{ kN/m}$$

$$L - 2.50 \times 2.65 = 6.6 \times 1.6 = 10.6 \text{ kN/m}$$

$$27.2 \text{ kN/m} \quad 41 \text{ kN/m}$$

DL POST (1)
@ 3.8m

$$D - 55 + 57 = 112 \text{ (unbalanced)}$$

$$L - 7.7 + 32 = 109$$

Refers to TENDS DESIGN, provide UK 254x254x107 (355)

BASEMENT BEAM (2) - SPAN 3.3m

NEW FLAT
ROOF WFL

$$D - 0.77 \times 2.3 = 1.8 \times 1.4 = 2.53 \text{ kN/m}$$

$$L - 0.75 \times 2.3 = 1.7 \times 1.6 = 2.72 \text{ kN/m}$$

330mm WALL
ABOVE

$$D - 7.70 \times 6.0 = 43.2 \times 1.4 = 60.5 \text{ kN/m}$$

$$47 \text{ kN/m} \quad 66 \text{ kN/m}$$

MOMENT - 90 kN.m

10mm Limit Deflection,
(FOR DECK
ROOF)

$$I_{req} = \frac{5 \times 47 \times 3300^4}{384 \times 205 \times 10^6 \times 10 \times 10^4} = 3540 \text{ cm}^4$$

∴ provide 254x146x31 UB (W_{pl} = 101 kN.m)
(I_x = 4410 cm⁴)

BASEMENT BEAM (3) - SPAN 4.9m

Timber Floor
WFL

$$D - 0.77 \times 3 = 2.31 \times 1.4 = 3.23$$

$$L - 2.50 \times 3 = 7.50 \times 1.6 = 12$$

Refers to TENDS DESIGN

∴ provide 254x146 UB31

Ref

Calculations

Output

BASMENT PARTITIONES

BS1 UCS - 370kN

used masonry
- 7.5 N/mm²

$$\frac{370 \times 10^3}{1.5(2.5/3.6)} = 355200 \text{ mm}^2$$

MATERIAL FACTOR
- 3.5

∴ provide 2ND 150 x 1200 x 715 DP
concrete lintel PARTITIONES

BS1 UCS - 177kN

used masonry
- 2.8 N/mm²

$$\frac{177 \times 10^3}{1.5(2.5/3.6)} = 169920 \text{ mm}^2$$

MATERIAL FACTOR
- 3.5

∴ provide 200 x 900 x 715 DP
concrete lintel PARTITIONES

BS2 UCS - 109kN

NEW MASONRY
- 3.6 N/mm²

$$\frac{109 \times 10^3}{1.5(3.6/3.5)} = 70648 \text{ mm}^2$$

MATERIAL FACTOR
- 3.5

∴ provide 200 x 440 x 715
concrete lintel PARTITIONES

FLOOR JOISTS G G7

50 x 200 DP C24 @ 600 centers

∴ Refer to TRIMS DESIGN

Ref

Calculations

Output

BASEMENT SLAB DESIGN (suspended): 4.7m-span

$$\begin{aligned} \text{DL} &: 6.7 \times 1 = 6.7 \times 1.4 = 9.4 \\ \text{LL} &: 2.5 \times 1 = 2.5 \times 1.6 = 4.0 \\ &9.2 \text{ kN/m} \quad 13.4 \text{ kN/m} \end{aligned}$$

per
metre
width

$$\begin{aligned} \text{HYDROSTATIC WATER} &: 20 \times 1 = 20 \times 1.6 = 32 \text{ kN/m} \\ \text{PRESSURE (wp)} & \\ \text{(2m dp)} & \end{aligned}$$

LOADCASE 1 (DL+LL) TENSION BOT

$$\begin{aligned} - \text{MOMENT} &- \frac{13.4 \times 4.7^2}{8} = 37 \text{ kNm/m} \\ - \text{S.F.} &- \frac{13.4 \times 4.7}{2} = 31 \text{ kN/m} \end{aligned}$$

LOADCASE 2 (wp-DL) TENSION TOP UPLIFT

$$\begin{aligned} - \text{MOMENT} &- \frac{(32 - 9.4) \times 4.7^2}{8} = 62.4 \text{ kNm/m} \\ - \text{S.F.} &- \frac{(32 - 9.4) \times 4.7}{2} = 53 \text{ kN/m} \end{aligned}$$

REFER TO TENDS DESIGN.

PROVIDE 275mm RC SLAB

13785mm² SF TOP & BOT

Ref

Calculations

Output

RETAINING WALL DESIGN

SECTION 2-2, underpinning from BASEMENT LEVEL.

Vertical load - 80 kN/m

Horizontal load 0' top of wall.

- Active pressure $\frac{1}{3} \times 19 \times 2 = 12.7 \text{ kN/m}^2$

- Surcharge $\frac{1}{3} \times 10 \times 2 = 6.6 \text{ kN/m}^2$

Force $0.5 \times 19.4 \times 2 = 19.4 \text{ kN}$

Ref. to TEDS DESIGN.

SECTION 1-1, underpinning from G.F. LEVEL.

Vertical load - 55 kN/m

Horizontal load 0' top of wall

- Active pressure $\frac{1}{3} \times 19 \times 1 = 6.3$

- Surcharge $\frac{1}{3} \times 10 \times 1 = 3.3$

Force $0.5 \times 9.6 \times 1 = 4.8 \text{ kN}$

Ref. to TEDS DESIGN

SECTION 3-3, underpinning from BASEMENT LEVEL (with toe).

- Vertical load - 85 kN/m

NO horizontal load, just surcharge on plan.


Ref. to TEDS DESIGN.

 Ingleton Wood 1 Alie Street London	Project				Job no	
	79 Redington Road				811365	
	Calcs for				Start page no /Revision	
	Beam 1- Proposed Loading				1	
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	05/04/2018				

STEEL BEAM ANALYSIS & DESIGN (BS5950)

In accordance with BS5950-1:2000 incorporating Corrigendum No.1

TEDDS calculation version 3 0 05

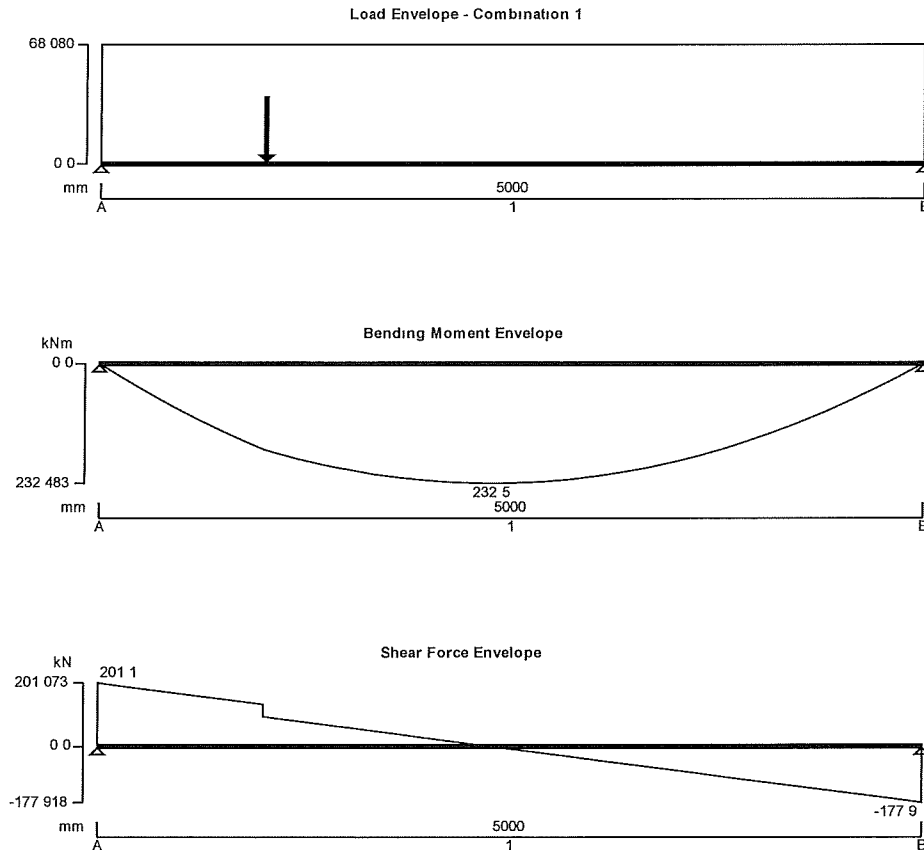

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Dead point load 18.24 kN at 1000 mm

Imposed point load 8.16 kN at 1000 mm

Imposed full UDL 28.25 kN/m

Dead full UDL 15 kN/m

Dead self weight of beam $\times 1$

Load combinations

Load combination 1

Support A

Dead $\times 1.40$

Imposed $\times 1.60$

Span 1

Dead $\times 1.40$

Imposed $\times 1.60$

Support B

Dead $\times 1.40$

 Ingleton Wood 1 Alie Street London	Project				Job no	
	79 Redington Road				811365	
	Calcs for				Start page no /Revision	
	Beam 1- Proposed Loading				2	
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	05/04/2018				


Imposed $\times 1.60$

Analysis results

Maximum moment	$M_{\max} = 232.5 \text{ kNm}$	$M_{\min} = 0 \text{ kNm}$
Maximum shear	$V_{\max} = 201.1 \text{ kN}$	$V_{\min} = -177.9 \text{ kN}$
Deflection	$\delta_{\max} = 3.6 \text{ mm}$	$\delta_{\min} = 0 \text{ mm}$
Maximum reaction at support A	$R_{A_{\max}} = 201.1 \text{ kN}$	$R_{A_{\min}} = 201.1 \text{ kN}$
Unfactored dead load reaction at support A	$R_{A_{\text{Dead}}} = 55.4 \text{ kN}$	
Unfactored imposed load reaction at support A	$R_{A_{\text{Imposed}}} = 77.2 \text{ kN}$	
Maximum reaction at support B	$R_{B_{\max}} = 177.9 \text{ kN}$	$R_{B_{\min}} = 177.9 \text{ kN}$
Unfactored dead load reaction at support B	$R_{B_{\text{Dead}}} = 44.5 \text{ kN}$	
Unfactored imposed load reaction at support B	$R_{B_{\text{Imposed}}} = 72.3 \text{ kN}$	

Section details

Section type UC 305x305x137 (BS4-1) Steel grade S275

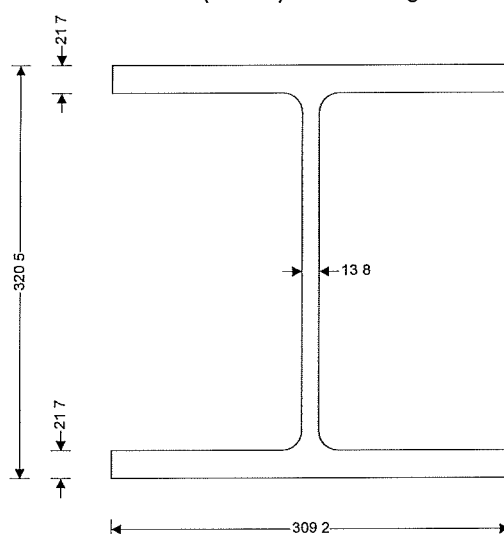

Classification of cross sections - Section 3.5

Tensile strain coefficient $\varepsilon = 1.02$ Section classification **Plastic**

Shear capacity - Section 4.2.3

Design shear force $F_v = 201.1 \text{ kN}$ Design shear resistance $P_v = 703.2 \text{ kN}$
PASS - Design shear resistance exceeds design shear force

Moment capacity - Section 4.2.5

Design bending moment $M = 232.5 \text{ kNm}$ Moment capacity low shear $M_c = 608.6 \text{ kNm}$

Buckling resistance moment - Section 4.3.6.4

Buckling resistance moment $M_b = 513.3 \text{ kNm}$ $M_b / m_{LT} = 513.3 \text{ kNm}$
PASS - Buckling resistance moment exceeds design bending moment

Check vertical deflection - Section 2.5.2

Consider deflection due to imposed loads

Limiting deflection $\delta_{\text{lim}} = 13.889 \text{ mm}$ Maximum deflection $\delta = 3.597 \text{ mm}$


PASS - Maximum deflection does not exceed deflection limit

 Ingleton Wood 1 Allie Street London	Project			Job no		
	79 Redington Road			811365		
	Calcs for			Start page no /Revision		
	Beam 6- Existing Loading			1		
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	02/02/2018				

STEEL BEAM ANALYSIS & DESIGN (BS5950)

In accordance with BS5950-1:2000 incorporating Corrigendum No.1

TEDDS calculation version 3 0 05

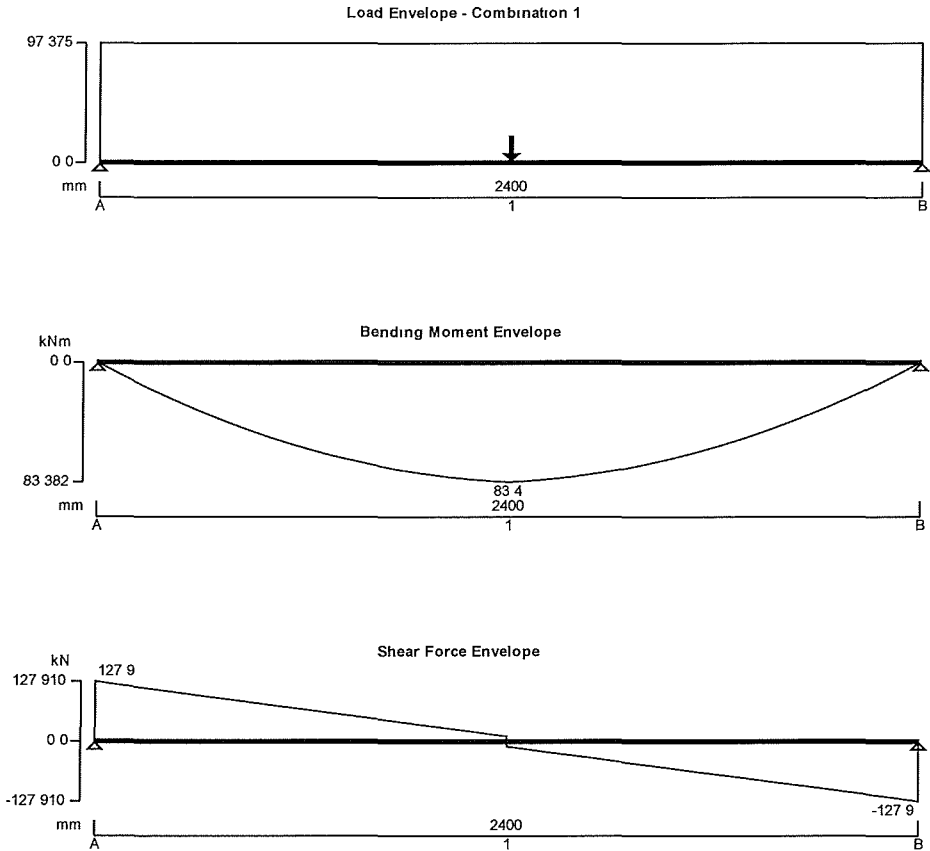

Support conditions

Support A	Vertically restrained
	Rotationally free
Support B	Vertically restrained
	Rotationally free

Applied loading

Beam loads	Dead point load 15.8 kN at 1200 mm
	Imposed full UDL 20 kN/m
	Dead full UDL 46 kN/m
	Dead self weight of beam x 1

Load combinations

Load combination 1	Support A	Dead x 1.40
		Imposed x 1.60
	Span 1	Dead x 1.40
		Imposed x 1.60
	Support B	Dead x 1.40
		Imposed x 1.60


 Ingleton Wood 1 Alie Street London	Project 79 Redington Road				Job no 811365	
	Calcs for Beam 6- Existing Loading				Start page no /Revision 2	
	Calcs by A W	Calcs date 02/02/2018	Checked by	Checked date	Approved by	Approved date

Analysis results

Maximum moment	$M_{max} = 83.4 \text{ kNm}$	$M_{min} = 0 \text{ kNm}$
Maximum shear	$V_{max} = 127.9 \text{ kN}$	$V_{min} = -127.9 \text{ kN}$
Deflection	$\delta_{max} = 2.1 \text{ mm}$	$\delta_{min} = 0 \text{ mm}$
Maximum reaction at support A	$R_{A_{max}} = 127.9 \text{ kN}$	$R_{A_{min}} = 127.9 \text{ kN}$
Unfactored dead load reaction at support A	$R_{A_{Dead}} = 63.9 \text{ kN}$	
Unfactored imposed load reaction at support A	$R_{A_{Imposed}} = 24 \text{ kN}$	
Maximum reaction at support B	$R_{B_{max}} = 127.9 \text{ kN}$	$R_{B_{min}} = 127.9 \text{ kN}$
Unfactored dead load reaction at support B	$R_{B_{Dead}} = 63.9 \text{ kN}$	
Unfactored imposed load reaction at support B	$R_{B_{Imposed}} = 24 \text{ kN}$	

Section details

Section type UC 203x203x71 (BS4-1) Steel grade S275

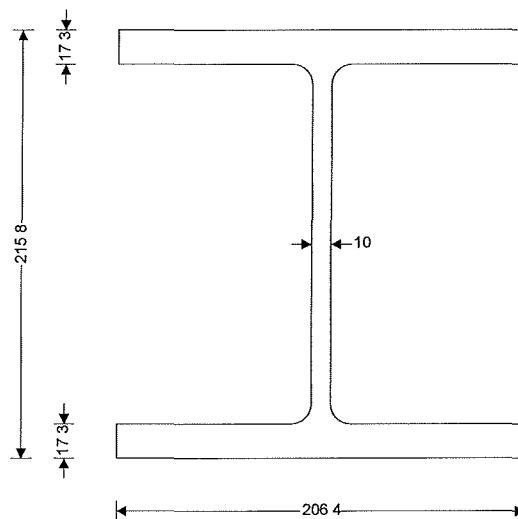

Classification of cross sections - Section 3.5

Tensile strain coefficient $\varepsilon = 1.02$ Section classification **Plastic**

Shear capacity - Section 4.2.3

Design shear force $F_v = 127.9 \text{ kN}$ Design shear resistance $P_v = 343.1 \text{ kN}$
PASS - Design shear resistance exceeds design shear force

Moment capacity - Section 4.2.5

Design bending moment $M = 83.4 \text{ kNm}$ Moment capacity low shear $M_c = 211.7 \text{ kNm}$

Buckling resistance moment - Section 4.3 6.4

Buckling resistance moment $M_b = 202.1 \text{ kNm}$ $M_b / m_{LT} = 202.1 \text{ kNm}$
PASS - Buckling resistance moment exceeds design bending moment

Check vertical deflection - Section 2.5.2

Consider deflection due to dead and imposed loads

Limiting deflection $\delta_{lim} = 5 \text{ mm}$ Maximum deflection $\delta = 2.136 \text{ mm}$
PASS - Maximum deflection does not exceed deflection limit

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road			Job no 811365		
	Calcs for Post 1			Start page no /Revision 1		
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

STEEL MEMBER DESIGN (BS5950)

In accordance with BS5950-1:2000 incorporating Corrigendum No.1

TEDDS calculation version 3.0.05


Section details

Section type

SHS 120x120x10 0 (Tata Steel Celsius)

Steel grade

S275

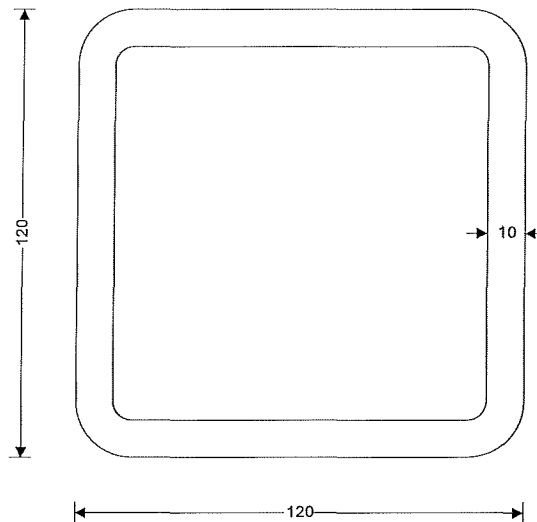

Classification of cross sections - Section 3.5

Tensile strain coefficient $\epsilon = 1.00$

Section classification

Semi-compact

Moment capacity - Section 4.2.5

Design bending moment $M = 22.5$ kNm

Moment capacity low shear $M_c = 46.9$ kNm

PASS - Moment capacity exceeds design bending moment

Compression members - Section 4.7

Design compression force $F_c = 334$ kN

Compression resistance $P_{cx} = 979.4$ kN

PASS - Compression resistance exceeds design compression force

Compression members with moments - Section 4.8.3

Comp and bending check $F_c / (A \times p_y) + M / M_c = 0.763$

PASS - Combined bending and compression check is satisfied

Member buckling resistance - cl.4.8.3.3


Buckling resistance check $F_c / P_{cx} + m_x \times M / M_c \times (1 + 0.5 \times F_c / P_{cx}) = 0.903$

PASS - Member buckling resistance checks are satisfied

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road				Job no 811365	
	Calcs for Pitched roof rafters				Start page no /Revision 1	
	Calcs by A W	Calcs date 02/02/2018	Checked by	Checked date	Approved by	Approved date

TIMBER RAFTER DESIGN (BS5268-2.2002)

TEDDS calculation version 1 0 03

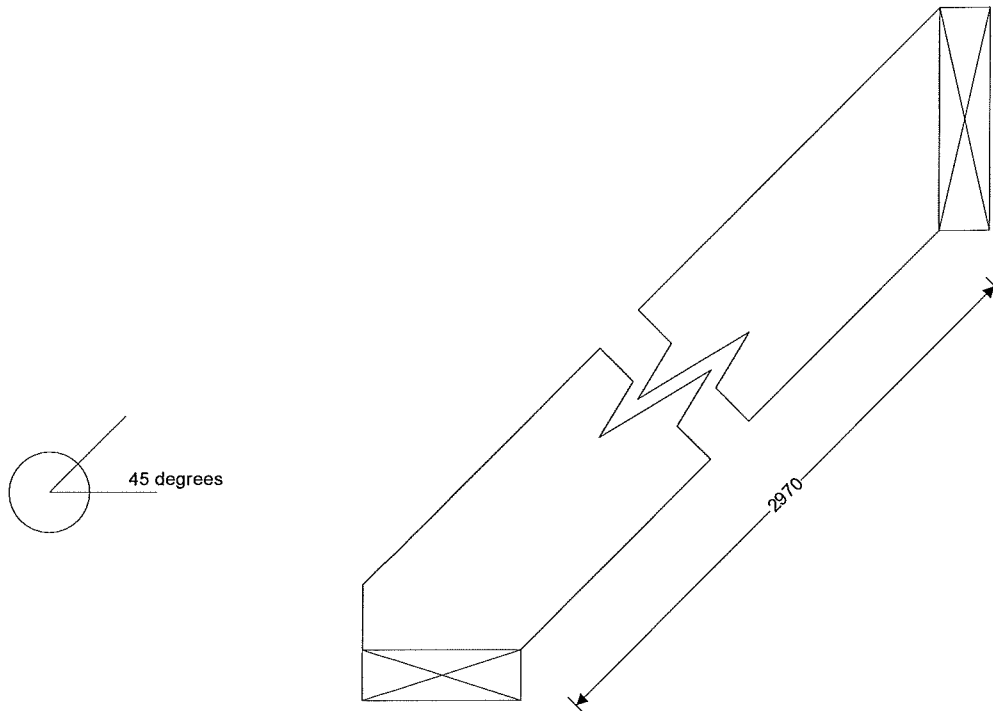

Rafter details

Breadth of timber sections $b = 47 \text{ mm}$
Rafter spacing $s = 600 \text{ mm}$
Clear length of span on slope $L_{cl} = 2970 \text{ mm}$
Timber strength class **C24**

Depth of timber sections $h = 147 \text{ mm}$
Rafter span **Single span**
Rafter slope $\alpha = 45.0 \text{ deg}$

Section properties

Cross sectional area of rafter $A = 6909 \text{ mm}^2$
Radius of gyration $r = 42 \text{ mm}$

Section modulus $Z = 169270 \text{ mm}^3$
Second moment of area $I = 12441382 \text{ mm}^4$

Loading details

Rafter self weight $F_j = 0.02 \text{ kN/m}$
Imposed snow load on plan $F_u = 0.75 \text{ kN/m}^2$

Dead load on slope $F_d = 1.20 \text{ kN/m}^2$
Imposed point load $F_p = 0.90 \text{ kN}$

Modification factors

Section depth factor $K_7 = 1.08$

Load sharing factor $K_8 = 1.10$

Consider long term load condition

Load duration factor $K_3 = 1.00$
Notional bearing length $L_b = 6 \text{ mm}$

Total UDL perp to rafter $F = 0.526 \text{ kN/m}$
Effective span $L_{eff} = 2976 \text{ mm}$

Check bending stress

Permissible bending stress $\sigma_{m_adm} = 8.923 \text{ N/mm}^2$

Applied bending stress $\sigma_{m_max} = 3.440 \text{ N/mm}^2$

PASS - Applied bending stress within permissible limits

Check compressive stress parallel to grain

Permissible comp stress $\sigma_{c_adm} = 5.161 \text{ N/mm}^2$

Applied compressive stress $\sigma_{c_max} = 0.453 \text{ N/mm}^2$

PASS - Applied compressive stress within permissible limits

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road			Job no 811365	
	Calcs for Pitched roof rafters			Start page no /Revision 2	
	Calcs by A W	Calcs date 02/02/2018	Checked by	Checked date	Approved by Approved date

Check combined bending and compressive stress parallel to grain

Combined loading check $0.484 < 1$

PASS - Combined compressive and bending stresses are within permissible limits

Check shear stress

Permissible shear stress $\tau_{adm} = 0.781 \text{ N/mm}^2$

Applied shear stress $\tau_{max} = 0.170 \text{ N/mm}^2$

PASS - Applied shear stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 8.929 \text{ mm}$

Total deflection $\delta_{max} = 4.148 \text{ mm}$

PASS - Total deflection within permissible limits

Consider medium term load condition

Load duration factor $K_3 = 1.25$

Total UDL perp to rafter $F = 0.751 \text{ kN/m}$

Notional bearing length $L_b = 9 \text{ mm}$

Effective span $L_{eff} = 2979 \text{ mm}$

Check bending stress

Permissible bending stress $\sigma_{m_adm} = 11.154 \text{ N/mm}^2$

Applied bending stress $\sigma_{m_max} = 4.921 \text{ N/mm}^2$

PASS - Applied bending stress within permissible limits

Check compressive stress parallel to grain

Permissible comp stress $\sigma_{c_adm} = 5.998 \text{ N/mm}^2$

Applied compressive stress $\sigma_{c_max} = 0.648 \text{ N/mm}^2$

PASS - Applied compressive stress within permissible limits

Check combined bending and compressive stress parallel to grain

Combined loading check $0.566 < 1$

PASS - Combined compressive and bending stresses are within permissible limits

Check shear stress

Permissible shear stress $\tau_{adm} = 0.976 \text{ N/mm}^2$

Applied shear stress $\tau_{max} = 0.243 \text{ N/mm}^2$

PASS - Applied shear stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 8.937 \text{ mm}$

Total deflection $\delta_{max} = 5.944 \text{ mm}$

PASS - Total deflection within permissible limits

Consider short term load condition

Load duration factor $K_3 = 1.50$

Total UDL perp to rafter $F = 0.526 \text{ kN/m}$

Notional bearing length $L_b = 9 \text{ mm}$

Effective span $L_{eff} = 2979 \text{ mm}$

Check bending stress

Permissible bending stress $\sigma_{m_adm} = 13.385 \text{ N/mm}^2$

Applied bending stress $\sigma_{m_max} = 6.246 \text{ N/mm}^2$

PASS - Applied bending stress within permissible limits

Check compressive stress parallel to grain

Permissible comp stress $\sigma_{c_adm} = 6.677 \text{ N/mm}^2$

Applied compressive stress $\sigma_{c_max} = 0.546 \text{ N/mm}^2$

PASS - Applied compressive stress within permissible limits

Check combined bending and compressive stress parallel to grain

Combined loading check $0.562 < 1$

PASS - Combined compressive and bending stresses are within permissible limits

Check shear stress

Permissible shear stress $\tau_{adm} = 1.172 \text{ N/mm}^2$

Applied shear stress $\tau_{max} = 0.308 \text{ N/mm}^2$

PASS - Applied shear stress within permissible limits

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road				Job no 811365	
	Calcs for Pitched roof rafters				Start page no /Revision 3	
	Calcs by A W	Calcs date 02/02/2018	Checked by	Checked date	Approved by	Approved date

Check deflection

Permissible deflection

$\delta_{adm} = 8.936$ mm

Total deflection

$\delta_{max} = 6.892$ mm

PASS - Total deflection within permissible limits


 Ingleton Wood 1 Alie Street London	Project				Job no	
	79 Reddington road				811365	
	Calcs for				Start page no /Revision	
	Flat Roof Timber Joists				1	
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	02/02/2018				

TIMBER JOIST DESIGN (BS5268-2.2002)

Tedds calculation version 1 1 04



Joist details

Joist breadth	b = 47 mm	Joist depth	h = 200 mm
Joist spacing	s = 450 mm	Service class of timber	1
Timber strength class	C24		



Span details

Number of spans	$N_{span} = 1$	Length of bearing	$L_b = 100$ mm
Clear length of span	$L_{s1} = 4600$ mm		

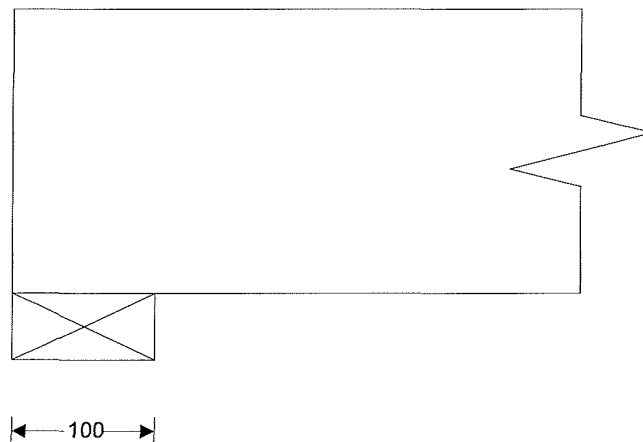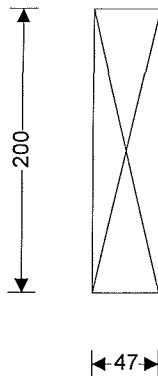

Section properties

Second moment of area	$I = 31333333$ mm ⁴	Section modulus	$Z = 313333$ mm ³
-----------------------	--------------------------------	-----------------	------------------------------

Loading details

Joist self weight	$F_{swt} = 0.03$ kN/m	Dead load	$F_{d_udl} = 0.77$ kN/m ²
Imposed UDL(Medium term)	$F_{l_udl} = 0.60$ kN/m ²		
Imposed point load (Short)	$F_{l_pt} = 0.90$ kN		

Consider medium term loads

Design bending moment	$M = 1.716$ kNm	Design shear force	$V = 1.492$ kN
Design support reaction	$R = 1.492$ kN	Design deflection	$\delta = 11.502$ mm

Check bending stress

Permissible bending stress	$\sigma_{m_adm} = 10.783$ N/mm ²	Applied bending stress	$\sigma_{m_max} = 5.477$ N/mm ²
PASS - Applied bending stress within permissible limits			

Check shear stress

Permissible shear stress	$\tau_{adm} = 0.976$ N/mm ²	Applied shear stress	$\tau_{max} = 0.238$ N/mm ²
--------------------------	--	----------------------	--

 Ingleton Wood 1 Alie Street London	Project		79 Reddington road		Job no 811365	
	Calcs for		Flat Roof Timber Joists		Start page no /Revision 2	
	Calcs by A W	Calcs date 02/02/2018	Checked by	Checked date	Approved by	Approved date

PASS - Applied shear stress within permissible limits

Check bearing stress

Permissible bearing stress $\sigma_{c_adm} = 3.300 \text{ N/mm}^2$

Applied bearing stress $\sigma_{c_max} = 0.317 \text{ N/mm}^2$

PASS - Applied bearing stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 13.800 \text{ mm}$

Actual deflection $\delta = 11.502 \text{ mm}$

PASS - Actual deflection within permissible limits

Consider short term loads

Design bending moment $M = 2.037 \text{ kNm}$

Design shear force $V = 1.771 \text{ kN}$

Design support reaction $R = 1.771 \text{ kN}$

Design deflection $\delta = 12.304 \text{ mm}$

Check bending stress

Permissible bending stress $\sigma_{m_adm} = 12.939 \text{ N/mm}^2$

Applied bending stress $\sigma_{m_max} = 6.501 \text{ N/mm}^2$

PASS - Applied bending stress within permissible limits

Check shear stress

Permissible shear stress $\tau_{adm} = 1.172 \text{ N/mm}^2$

Applied shear stress $\tau_{max} = 0.283 \text{ N/mm}^2$

PASS - Applied shear stress within permissible limits

Check bearing stress

Permissible bearing stress $\sigma_{c_adm} = 3.960 \text{ N/mm}^2$

Applied bearing stress $\sigma_{c_max} = 0.377 \text{ N/mm}^2$

PASS - Applied bearing stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 13.800 \text{ mm}$

Actual deflection $\delta = 12.304 \text{ mm}$


PASS - Actual deflection within permissible limits

Project 79 Readington Road				Job no 811365	
Calcs for Basement Beam 1				Start page no /Revision 1	
Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

STEEL BEAM ANALYSIS & DESIGN (BS5950)

In accordance with BS5950-1:2000 incorporating Corrigendum No 1

TEDDS calculation version 3 0 05

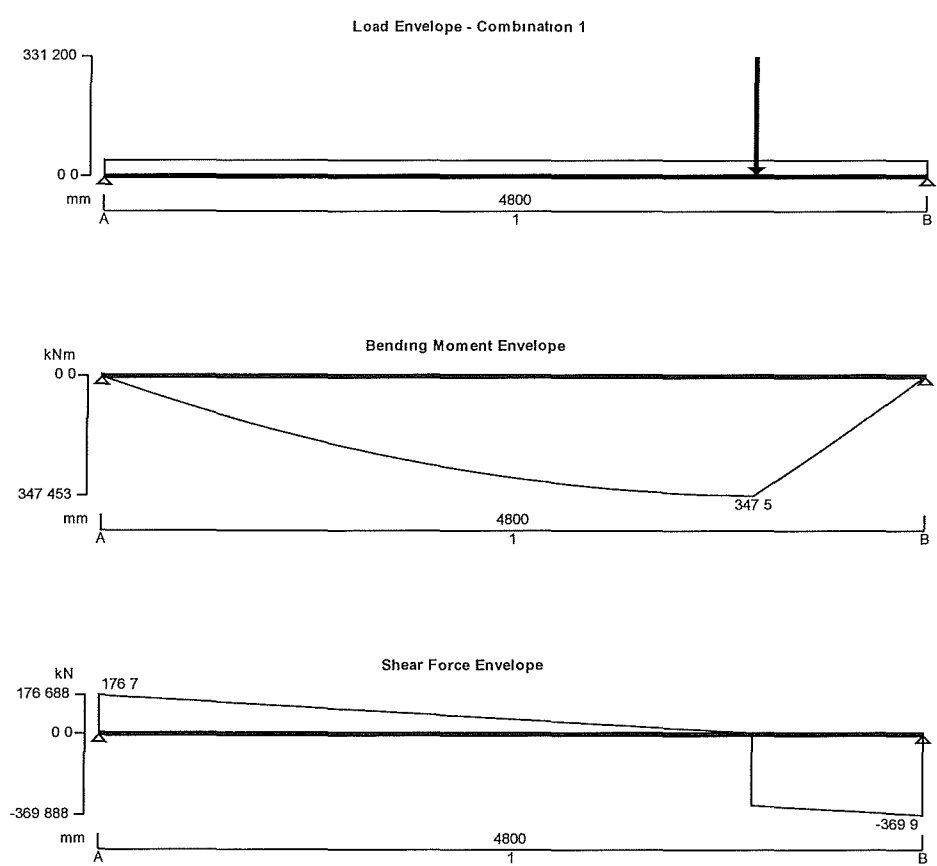

Support conditions

Support A	Vertically restrained
	Rotationally free
Support B	Vertically restrained
	Rotationally free

Applied loading

Beam loads	Dead point load 112 kN at 3800 mm
	Imposed point load 109 kN at 3800 mm
	Imposed full UDL 14 kN/m
	Dead full UDL 15 kN/m
	Dead self weight of beam $\times 1$

Load combinations

Load combination 1	Support A	Dead $\times 1.40$
		Imposed $\times 1.60$
	Span 1	Dead $\times 1.40$
		Imposed $\times 1.60$
	Support B	Dead $\times 1.40$

 Ingleton Wood 1 Alie Street London	Project				Job no	
	79 Readington Road				811365	
	Calcs for				Start page no /Revision	
	Basement Beam 1				2	
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	05/04/2018				


Imposed $\times 1.60$

Analysis results

Maximum moment	$M_{\max} = 347.5 \text{ kNm}$	$M_{\min} = 0 \text{ kNm}$
Maximum shear	$V_{\max} = 176.7 \text{ kN}$	$V_{\min} = -369.9 \text{ kN}$
Deflection	$\delta_{\max} = 6.9 \text{ mm}$	$\delta_{\min} = 0 \text{ mm}$
Maximum reaction at support A	$R_{A_{\max}} = 176.7 \text{ kN}$	$R_{A_{\min}} = 176.7 \text{ kN}$
Unfactored dead load reaction at support A	$R_{A_{\text{Dead}}} = 61.9 \text{ kN}$	
Unfactored imposed load reaction at support A	$R_{A_{\text{Imposed}}} = 56.3 \text{ kN}$	
Maximum reaction at support B	$R_{B_{\max}} = 369.9 \text{ kN}$	$R_{B_{\min}} = 369.9 \text{ kN}$
Unfactored dead load reaction at support B	$R_{B_{\text{Dead}}} = 127.2 \text{ kN}$	
Unfactored imposed load reaction at support B	$R_{B_{\text{Imposed}}} = 119.9 \text{ kN}$	

Section details

Section type UC 254x254x107 (BS4-1) Steel grade S355

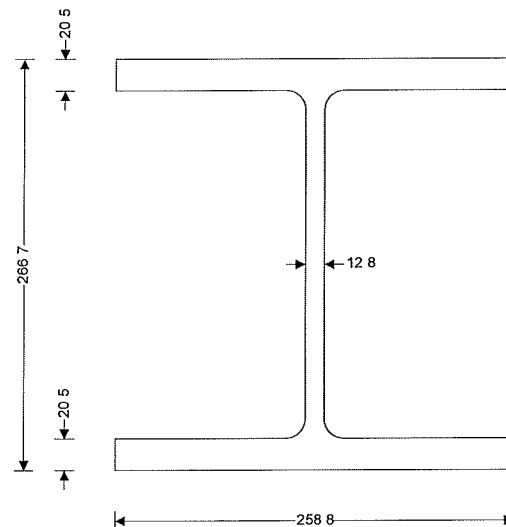

Classification of cross sections - Section 3.5

Tensile strain coefficient $\varepsilon = 0.89$ Section classification **Plastic**

Shear capacity - Section 4.2.3

Design shear force $F_v = 369.9 \text{ kN}$ Design shear resistance $P_v = 706.6 \text{ kN}$
PASS - Design shear resistance exceeds design shear force

Moment capacity - Section 4.2.5

Design bending moment $M = 347.5 \text{ kNm}$ Moment capacity low shear $M_c = 512.1 \text{ kNm}$
PASS - Moment capacity exceeds design bending moment

Check vertical deflection - Section 2.5.2

Consider deflection due to imposed loads


Limiting deflection $\delta_{\text{lim}} = 13.333 \text{ mm}$ Maximum deflection $\delta = 6.862 \text{ mm}$
PASS - Maximum deflection does not exceed deflection limit

 Ingleton Wood 1 Alie Street London	Project			Job no		
	79 Redington Road			811365		
	Calcs for			Start page no /Revision		
	Basement Beam 3			1		
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	05/04/2018				

STEEL BEAM ANALYSIS & DESIGN (BS5950)

In accordance with BS5950-1:2000 incorporating Corrigendum No.1

TEDDS calculation version 3 0 05

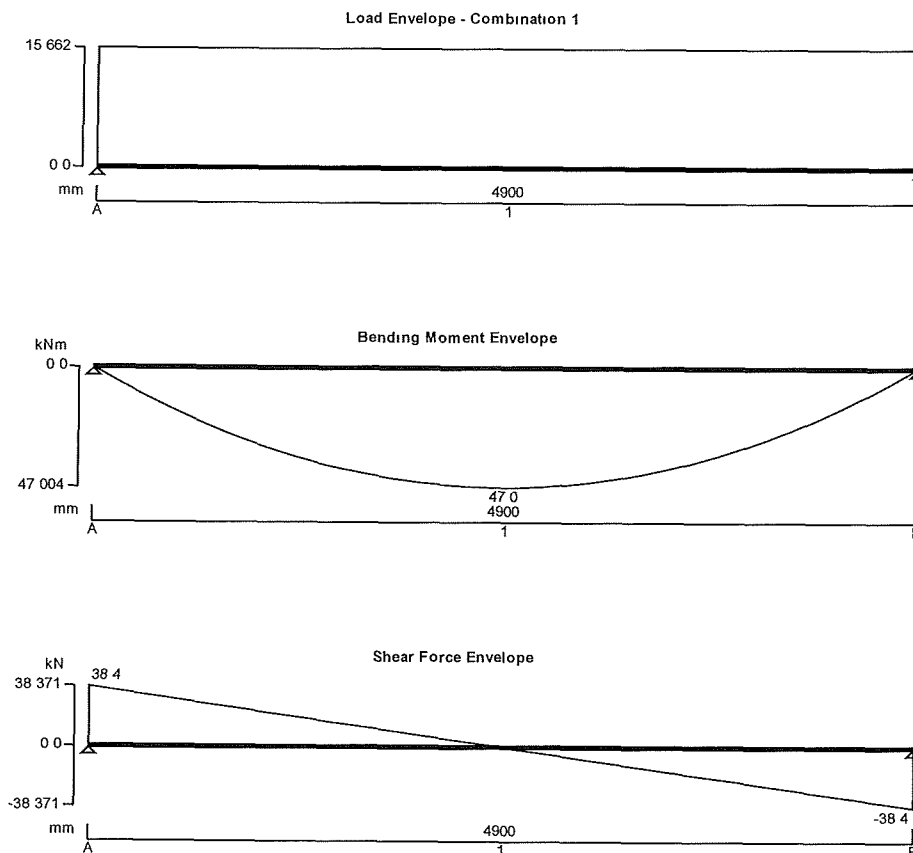

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Imposed full UDL 7.5 kN/m

Dead full UDL 2.31 kN/m

Dead self weight of beam $\times 1$

Load combinations

Load combination 1

Support A

Dead $\times 1.40$

Imposed $\times 1.60$

Span 1

Dead $\times 1.40$

Imposed $\times 1.60$

Support B

Dead $\times 1.40$

Imposed $\times 1.60$


 Ingleton Wood 1 Alie Street London	Project 79 Redington Road				Job no 811365	
	Calcs for Basement Beam 3				Start page no /Revision 2	
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

Analysis results

Maximum moment	$M_{max} = 47 \text{ kNm}$	$M_{min} = 0 \text{ kNm}$
Maximum moment span 1 segment 1	$M_{s1_seg1_max} = 47 \text{ kNm}$	$M_{s1_seg1_min} = 0 \text{ kNm}$
Maximum moment span 1 segment 2	$M_{s1_seg2_max} = 47 \text{ kNm}$	$M_{s1_seg2_min} = 0 \text{ kNm}$
Maximum shear	$V_{max} = 38.4 \text{ kN}$	$V_{min} = -38.4 \text{ kN}$
Maximum shear span 1 segment 1	$V_{s1_seg1_max} = 38.4 \text{ kN}$	$V_{s1_seg1_min} = 0 \text{ kN}$
Maximum shear span 1 segment 2	$V_{s1_seg2_max} = 0 \text{ kN}$	$V_{s1_seg2_min} = -38.4 \text{ kN}$
Deflection segment 3	$\delta_{max} = 6.2 \text{ mm}$	$\delta_{min} = 0 \text{ mm}$
Maximum reaction at support A	$R_{A_max} = 38.4 \text{ kN}$	$R_{A_min} = 38.4 \text{ kN}$
Unfactored dead load reaction at support A	$R_{A_Dead} = 6.4 \text{ kN}$	
Unfactored imposed load reaction at support A	$R_{A_Imposed} = 18.4 \text{ kN}$	
Maximum reaction at support B	$R_{B_max} = 38.4 \text{ kN}$	$R_{B_min} = 38.4 \text{ kN}$
Unfactored dead load reaction at support B	$R_{B_Dead} = 6.4 \text{ kN}$	
Unfactored imposed load reaction at support B	$R_{B_Imposed} = 18.4 \text{ kN}$	

Section details

Section type UB 254x146x31 (BS4-1) Steel grade S275

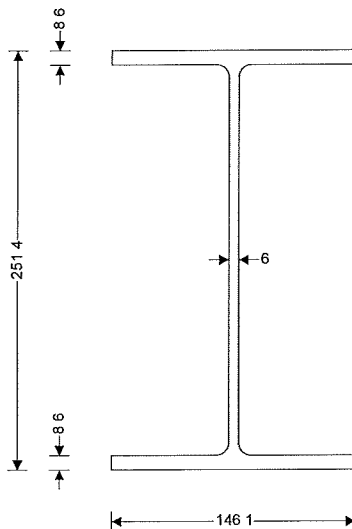

Classification of cross sections - Section 3.5

Tensile strain coefficient $\varepsilon = 1.00$ Section classification Plastic

Shear capacity - Section 4.2.3

Design shear force $F_v = 38.4 \text{ kN}$ Design shear resistance $P_v = 248.9 \text{ kN}$
PASS - Design shear resistance exceeds design shear force

Moment capacity at span 1 segment 1 - Section 4.2.5

Design bending moment $M = 47 \text{ kNm}$ Moment capacity low shear $M_c = 108.1 \text{ kNm}$

Buckling resistance moment - Section 4.3.6.4

Buckling resistance moment $M_b = 64.7 \text{ kNm}$ $M_b / m_{LT} = 64.7 \text{ kNm}$
PASS - Buckling resistance moment exceeds design bending moment

Check vertical deflection - Section 2.5.2

Consider deflection due to imposed loads

Limiting deflection $\delta_{lim} = 13.611 \text{ mm}$ Maximum deflection $\delta = 6.222 \text{ mm}$

PASS - Maximum deflection does not exceed deflection limit

 Ingleton Wood 1 Ale Street London	Project 79 Reddington Road				Job no 811365	
	Calcs for Basement Floor Slab				Start page no /Revision 1	
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

RC SLAB DESIGN (BS8110:PART1.1997)

TEDDS calculation version 1 0 04

CONCRETE SLAB DESIGN (CL 3 5.3 & 4)

SIMPLE ONE WAY SPANNING SLAB DEFINITION

Overall depth of slab $h = 275 \text{ mm}$

Cover to tension reinforcement resisting sagging $c_b = 40 \text{ mm}$


Trial bar diameter $D_{tryx} = 16 \text{ mm}$

Depth to tension steel (resisting sagging)

$$d_x = h - c_b - D_{tryx}/2 = 227 \text{ mm}$$

Characteristic strength of reinforcement $f_y = 500 \text{ N/mm}^2$

Characteristic strength of concrete $f_{cu} = 35 \text{ N/mm}^2$

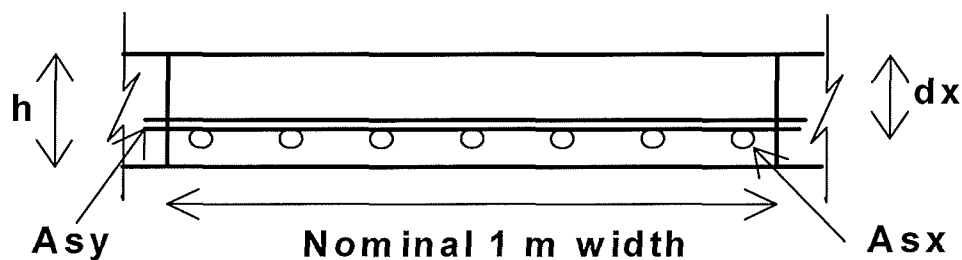

One-way spanning slab (simple)

ONE WAY SPANNING SLAB (CL 3.5.4)

MAXIMUM DESIGN MOMENTS IN SPAN

Design sagging moment (per m width of slab) $m_{sx} = 62.4 \text{ kNm/m}$

CONCRETE SLAB DESIGN – SAGGING – OUTER LAYER OF STEEL (CL 3.5 4)

Design sagging moment (per m width of slab) $m_{sx} = 62.4 \text{ kNm/m}$

Moment Redistribution Factor $\beta_{bx} = 1.0$

Area of reinforcement required

$$K_x = \text{abs}(m_{sx}) / (d_x^2 \times f_{cu}) = 0.035$$

$$K'_x = \min(0.156, (0.402 \times (\beta_{bx} - 0.4)) - (0.18 \times (\beta_{bx} - 0.4)^2)) = 0.156$$

Outer compression steel not required to resist sagging

One-way Spanning Slab requiring tension steel only (sagging) - mesh

$$z_x = \min((0.95 \times d_x), (d_x \times (0.5 + \sqrt{(0.25 - K_x/0.9)}))) = 216 \text{ mm}$$

$$\text{Neutral axis depth } x_x = (d_x - z_x) / 0.45 = 25 \text{ mm}$$

Area of tension steel required

 Ingleton Wood 1 Alie Street London	Project 79 Reddington Road				Job no 811365	
	Calcs for Basement Floor Slab				Start page no /Revision 2	
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

$$A_{sx_req} = \text{abs}(m_{sx}) / (1/\gamma_{ms} \times f_y \times z_x) = 666 \text{ mm}^2/\text{m}$$

Tension steel

Use B785 Mesh

$$A_{sx_prov} = A_{sl} = 785 \text{ mm}^2/\text{m} \quad A_{sy_prov} = A_{st} = 252 \text{ mm}^2/\text{m}$$

$$D_x = d_{sl} = 10 \text{ mm} \quad D_y = d_{st} = 8 \text{ mm}$$

Area of tension steel provided sufficient to resist sagging

Check min and max areas of steel resisting sagging

$$\text{Total area of concrete } A_c = h = 275000 \text{ mm}^2/\text{m}$$

$$\text{Minimum \% reinforcement } k = 0.13 \%$$

$$A_{st_min} = k \times A_c = 358 \text{ mm}^2/\text{m}$$

$$A_{st_max} = 4 \% \times A_c = 11000 \text{ mm}^2/\text{m}$$

Steel defined

$$\text{Outer steel resisting sagging } A_{sx_prov} = 785 \text{ mm}^2/\text{m}$$

Area of outer steel provided (sagging) OK

$$\text{Inner steel resisting sagging } A_{sy_prov} = 252 \text{ mm}^2/\text{m}$$

Less than min area of inner steel (sagging) FAIL

SHEAR RESISTANCE OF CONCRETE SLABS (CL 3.5.5)

Outer tension steel resisting sagging moments

$$\text{Depth to tension steel from compression face } d_x = 227 \text{ mm}$$

$$\text{Area of tension reinforcement provided (per m width of slab) } A_{sx_prov} = 785 \text{ mm}^2/\text{m}$$

$$\text{Design ultimate shear force (per m width of slab) } V_x = 53 \text{ kN/m}$$

$$\text{Characteristic strength of concrete } f_{cu} = 35 \text{ N/mm}^2$$

Applied shear stress

$$v_x = V_x / d_x = 0.23 \text{ N/mm}^2$$

Check shear stress to clause 3.5.5.2

$$v_{allowable} = \min((0.8 \text{ N}^{1/2}/\text{mm}) \times \sqrt{f_{cu}}, 5 \text{ N/mm}^2) = 4.73 \text{ N/mm}^2$$

Shear stress - OK

Shear stresses to clause 3.5.5.3

Design shear stress

$$f_{cu_ratio} = \text{if } (f_{cu} > 40 \text{ N/mm}^2, 40/25, f_{cu}/(25 \text{ N/mm}^2)) = 1.400$$

$$v_{cx} = 0.79 \text{ N/mm}^2 \times \min(3, 100 \times A_{sx_prov} / d_x)^{1/3} \times \max(0.67, (400 \text{ mm} / d_x)^{1/4}) / 1.25 \times f_{cu_ratio}^{1/3}$$

$$v_{cx} = 0.57 \text{ N/mm}^2$$

Applied shear stress

$$v_x = 0.23 \text{ N/mm}^2$$

No shear reinforcement required

 Ingleton Wood 1 Alie Street London	Project 79 Reddington Road				Job no 811365	
	Calcs for Basement Floor Slab				Start page no /Revision 3	
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by	Approved date

CONCRETE SLAB DEFLECTION CHECK (CL 3.5.7)

Slab span length $l_x = 4.600$ m

Design ultimate moment in shorter span per m width $m_{sx} = 62$ kNm/m

Depth to outer tension steel $d_x = 227$ mm

Tension steel

Area of outer tension reinforcement provided $A_{sx_prov} = 785$ mm²/m

Area of tension reinforcement required $A_{sx_req} = 666$ mm²/m

Moment Redistribution Factor $\beta_{bx} = 1.00$

Modification Factors

Basic span / effective depth ratio (Table 3 9) $ratio_{span_depth} = 20$

The modification factor for spans in excess of 10m (ref cl 3 4 6 4) has not been included

$$f_s = 2 \times f_y \times A_{sx_req} / (3 \times A_{sx_prov} \times \beta_{bx}) = 282.6 \text{ N/mm}^2$$

$$factor_{tens} = \min (2, 0.55 + (477 \text{ N/mm}^2 - f_s) / (120 \times (0.9 \text{ N/mm}^2 + m_{sx} / d_x^2))) = 1.317$$

Calculate Maximum Span

This is a simplified approach and further attention should be given where special circumstances exist Refer to clauses 3 4 6 4 and 3 4 6 7

$$\text{Maximum span } l_{max} = ratio_{span_depth} \times factor_{tens} \times d_x = 5.98 \text{ m}$$

Check the actual beam span

$$\text{Actual span/depth ratio } l_x / d_x = 20.26$$

$$\text{Span depth limit } ratio_{span_depth} \times factor_{tens} = 26.35$$

Span/Depth ratio check satisfied

CHECK OF NOMINAL COVER (SAGGING) – (BS8110:PT 1, TABLE 3.4)

Slab thickness $h = 275$ mm

Effective depth to bottom outer tension reinforcement $d_x = 227.0$ mm

Diameter of tension reinforcement $D_x = 10$ mm

Diameter of links $L_{dix} = 0$ mm

Cover to outer tension reinforcement

$$C_{tenx} = h - d_x - D_x / 2 = 43.0 \text{ mm}$$

Nominal cover to links steel

$$C_{nomx} = C_{tenx} - L_{dix} = 43.0 \text{ mm}$$

Permissible minimum nominal cover to all reinforcement (Table 3 4)

$$C_{min} = 35 \text{ mm}$$

Cover over steel resisting sagging OK


 Ingleton Wood 1 Alie Street London	Project 79 Redington road			Job no 811365	
	Calcs for Ground Floor Timber Joists			Start page no /Revision 1	
	Calcs by A W	Calcs date 05/04/2018	Checked by	Checked date	Approved by Approved date

TIMBER JOIST DESIGN (BS5268-2.2002)

Tedds calculation version 1 1 04



Joist details

Joist breadth	b = 47 mm	Joist depth	h = 200 mm
Joist spacing	s = 450 mm	Service class of timber	1
Timber strength class	C24		



Span details

Number of spans	N_{span} = 1	Length of bearing	L_b = 100 mm
Clear length of span	L_{s1} = 3000 mm		

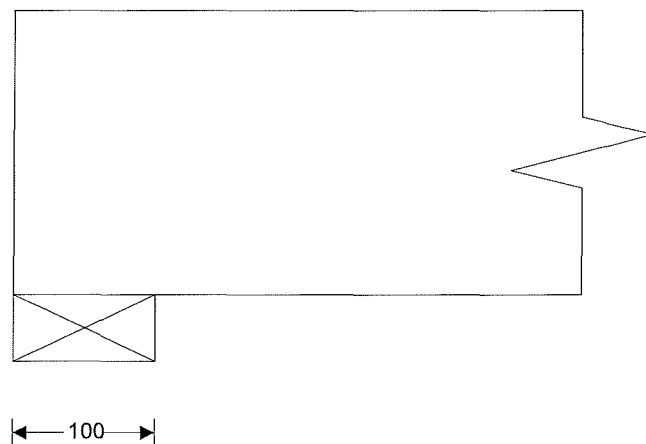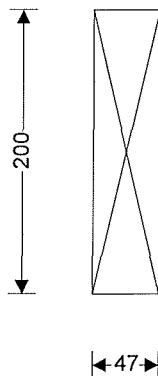

Section properties

Second moment of area	I = 31333333 mm⁴	Section modulus	Z = 313333 mm³
-----------------------	------------------------------------	-----------------	----------------------------------

Loading details

Joist self weight	F_{swt} = 0.03 kN/m	Dead load	F_{d_udl} = 0.75 kN/m²
Imposed UDL(Long term)	F_{l_udl} = 2.50 kN/m²		
Imposed point load (Medium)	F_{l_pt} = 1.40 kN		

Consider long term loads

Design bending moment	M = 1.682 kNm	Design shear force	V = 2 242 kN
Design support reaction	R = 2 242 kN	Design deflection	δ = 4 977 mm

Check bending stress

Permissible bending stress	σ_{m_adm} = 8 626 N/mm²	Applied bending stress	σ_{m_max} = 5.367 N/mm²
PASS - Applied bending stress within permissible limits			

Check shear stress

Permissible shear stress	τ_{adm} = 0.781 N/mm²	Applied shear stress	τ_{max} = 0.358 N/mm²
--------------------------	---	----------------------	---

 Ingleton Wood 1 Alie Street London	Project			Job no		
	79 Redington road			811365		
	Calcs for			Start page no /Revision		
	Ground Floor Timber Joists			2		
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	05/04/2018				

PASS - Applied shear stress within permissible limits

Check bearing stress

Permissible bearing stress $\sigma_{c_adm} = 2.640 \text{ N/mm}^2$

Applied bearing stress $\sigma_{c_max} = 0.477 \text{ N/mm}^2$

PASS - Applied bearing stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 9.000 \text{ mm}$

Actual deflection $\delta = 4.977 \text{ mm}$

PASS - Actual deflection within permissible limits

Consider medium term loads

Design bending moment $M = 1.466 \text{ kNm}$

Design shear force $V = 1.955 \text{ kN}$

Design support reaction $R = 1.955 \text{ kN}$

Design deflection $\delta = 3.757 \text{ mm}$

Check bending stress

Permissible bending stress $\sigma_{m_adm} = 10.783 \text{ N/mm}^2$

Applied bending stress $\sigma_{m_max} = 4.679 \text{ N/mm}^2$

PASS - Applied bending stress within permissible limits

Check shear stress

Permissible shear stress $\tau_{adm} = 0.976 \text{ N/mm}^2$

Applied shear stress $\tau_{max} = 0.312 \text{ N/mm}^2$

PASS - Applied shear stress within permissible limits

Check bearing stress

Permissible bearing stress $\sigma_{c_adm} = 3.300 \text{ N/mm}^2$

Applied bearing stress $\sigma_{c_max} = 0.416 \text{ N/mm}^2$

PASS - Applied bearing stress within permissible limits

Check deflection

Permissible deflection $\delta_{adm} = 9.000 \text{ mm}$


Actual deflection $\delta = 3.757 \text{ mm}$

PASS - Actual deflection within permissible limits

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road			Job no 811365	
	Calcs for Underpinning section from basement level with toe			Start page no /Revision 1	
	Calcs by A W	Calcs date 06/02/2018	Checked by	Checked date	Approved by Approved date

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1 2 01 06

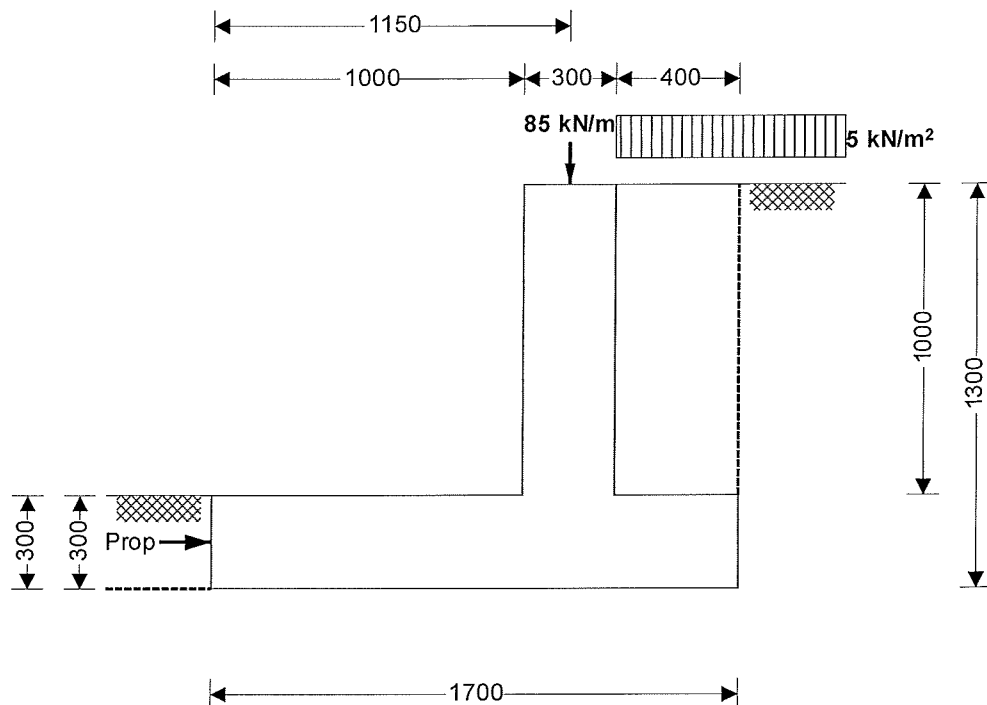

Wall details

Retaining wall type

Cantilever

Height of wall stem

$h_{stem} = 1000$ mm

Wall stem thickness

$t_{wall} = 300$ mm

Length of toe

$l_{toe} = 1000$ mm

Length of heel

$l_{heel} = 400$ mm

Overall length of base

$l_{base} = 1700$ mm

Base thickness

$t_{base} = 300$ mm

Height of retaining wall

$h_{wall} = 1300$ mm

Depth of downstand

$d_{ds} = 0$ mm

Thickness of downstand

$t_{ds} = 300$ mm

Position of downstand

$l_{ds} = 850$ mm

Depth of cover in front of wall

$d_{cover} = 0$ mm

Unplanned excavation depth

$d_{exc} = 300$ mm

Height of ground water

$h_{water} = 0$ mm

Density of water

$\gamma_{water} = 9.81$ kN/m³

Density of wall construction

$\gamma_{wall} = 23.6$ kN/m³

Density of base construction

$\gamma_{base} = 23.6$ kN/m³

Angle of soil surface

$\beta = 0.0$ deg

Effective height at back of wall

$h_{eff} = 1300$ mm

Mobilisation factor

$M = 1.5$

Moist density

$\gamma_m = 18.0$ kN/m³

Saturated density

$\gamma_s = 21.0$ kN/m³

Design shear strength

$\phi' = 24.2$ deg

Angle of wall friction

$\delta = 18.6$ deg

Design shear strength

$\phi'_b = 24.2$ deg

Design base friction

$\delta_b = 18.6$ deg

Moist density

$\gamma_{mb} = 18.0$ kN/m³

Allowable bearing

$P_{bearing} = 130$ kN/m²

Using Coulomb theory

Active pressure

$K_a = 0.369$

Passive pressure

$K_p = 4.187$

At-rest pressure

$K_0 = 0.590$

Loading details

Surcharge load

Surcharge = 5.0 kN/m²

Vertical dead load

$W_{dead} = 75.0$ kN/m

Vertical live load

$W_{live} = 10.0$ kN/m

Horizontal dead load


$F_{dead} = 0.0$ kN/m

Horizontal live load

$F_{live} = 0.0$ kN/m

 Ingleton Wood 1 Alie Street London	Project 79 Redington Road			Job no 811365	
	Calcs for Underpinning section from basement level with toe			Start page no /Revision 2	
	Calcs by A W	Calcs date 06/02/2018	Checked by	Checked date	Approved by Approved date

Position of vertical load $l_{load} = 1150 \text{ mm}$ Height of horizontal load $h_{load} = 0 \text{ mm}$

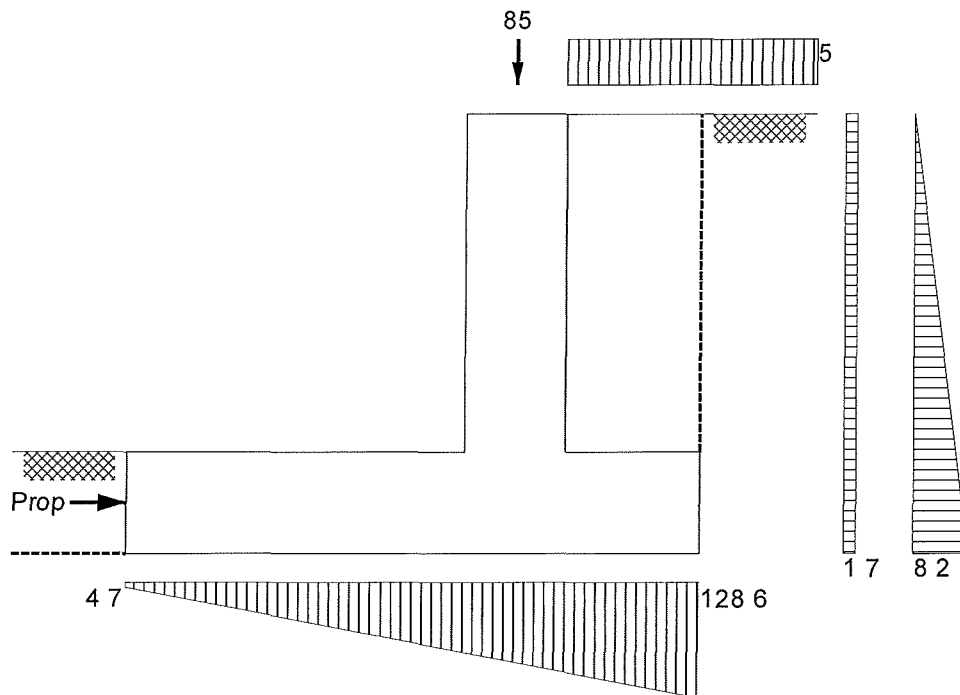

Loads shown in kN/m, pressures shown in kN/m²

Calculate propping force

Propping force $F_{prop} = 0.0 \text{ kN/m}$

Check bearing pressure

Total vertical reaction $R = 113.3 \text{ kN/m}$

Distance to reaction $x_{bar} = 1113 \text{ mm}$

Eccentricity of reaction $e = 263 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe $p_{toe} = 4.7 \text{ kN/m}^2$


Bearing pressure at heel $p_{heel} = 128.6 \text{ kN/m}^2$

PASS - Maximum bearing pressure is less than allowable bearing pressure

 Ingleton Wood 1 Alie Street London	Project			Job no		
	79 Redington Road			811365		
	Calcs for			Start page no /Revision		
	Underpinning section from Basement Level			1		
	Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
	A W	06/02/2018				

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1 2 01 06

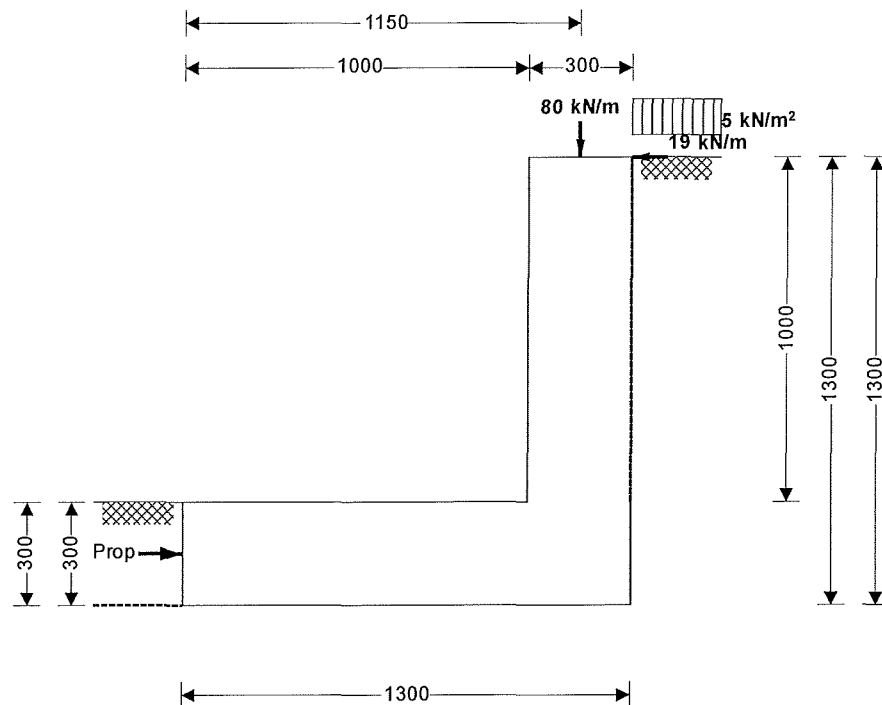

Wall details

Retaining wall type

Cantilever

Height of wall stem

$h_{\text{stem}} = 1000 \text{ mm}$

Wall stem thickness

$t_{\text{wall}} = 300 \text{ mm}$

Length of toe

$l_{\text{toe}} = 1000 \text{ mm}$

Length of heel

$l_{\text{heel}} = 0 \text{ mm}$

Overall length of base

$l_{\text{base}} = 1300 \text{ mm}$

Base thickness

$t_{\text{base}} = 300 \text{ mm}$

Height of retaining wall

$h_{\text{wall}} = 1300 \text{ mm}$

Depth of downstand

$d_{\text{ds}} = 0 \text{ mm}$

Thickness of downstand

$t_{\text{ds}} = 300 \text{ mm}$

Position of downstand

$l_{\text{ds}} = 850 \text{ mm}$

Depth of cover in front of wall

$d_{\text{cover}} = 0 \text{ mm}$

Unplanned excavation depth

$d_{\text{exc}} = 300 \text{ mm}$

Height of ground water

$h_{\text{water}} = 0 \text{ mm}$

Density of water

$\gamma_{\text{water}} = 9.81 \text{ kN/m}^3$

Density of wall construction

$\gamma_{\text{wall}} = 23.6 \text{ kN/m}^3$

Density of base construction

$\gamma_{\text{base}} = 23.6 \text{ kN/m}^3$

Angle of soil surface

$\beta = 0.0 \text{ deg}$

Effective height at back of wall

$h_{\text{eff}} = 1300 \text{ mm}$

Mobilisation factor

$M = 1.5$

Moist density

$\gamma_m = 18.0 \text{ kN/m}^3$

Saturated density

$\gamma_s = 21.0 \text{ kN/m}^3$

Design shear strength

$\phi' = 24.2 \text{ deg}$

Angle of wall friction

$\delta = 18.6 \text{ deg}$

Design shear strength

$\phi'_b = 24.2 \text{ deg}$

Design base friction

$\delta_b = 18.6 \text{ deg}$

Moist density

$\gamma_{mb} = 18.0 \text{ kN/m}^3$

Allowable bearing

$P_{\text{bearing}} = 130 \text{ kN/m}^2$

Using Coulomb theory

Active pressure

$K_a = 0.369$

Passive pressure

$K_p = 4.187$

At-rest pressure

$K_0 = 0.590$

Loading details

Surcharge load

Surcharge = 5.0 kN/m^2

Vertical dead load

$W_{\text{dead}} = 70.0 \text{ kN/m}$

Vertical live load

$W_{\text{live}} = 10.0 \text{ kN/m}$

Horizontal dead load

$F_{\text{dead}} = 0.0 \text{ kN/m}$

Horizontal live load

$F_{\text{live}} = 19.4 \text{ kN/m}$


 Ingleton Wood 1 Alie Street London	Project			Job no	
	79 Redington Road			811365	
	Calcs for			Start page no /Revision	
	Underpinning section from Basement Level			2	
	Calcs by	Calcs date	Checked by	Checked date	Approved by
	A W	06/02/2018			Approved date

Position of vertical load

$l_{load} = 1150 \text{ mm}$

Height of horizontal load

$h_{load} = 1300 \text{ mm}$

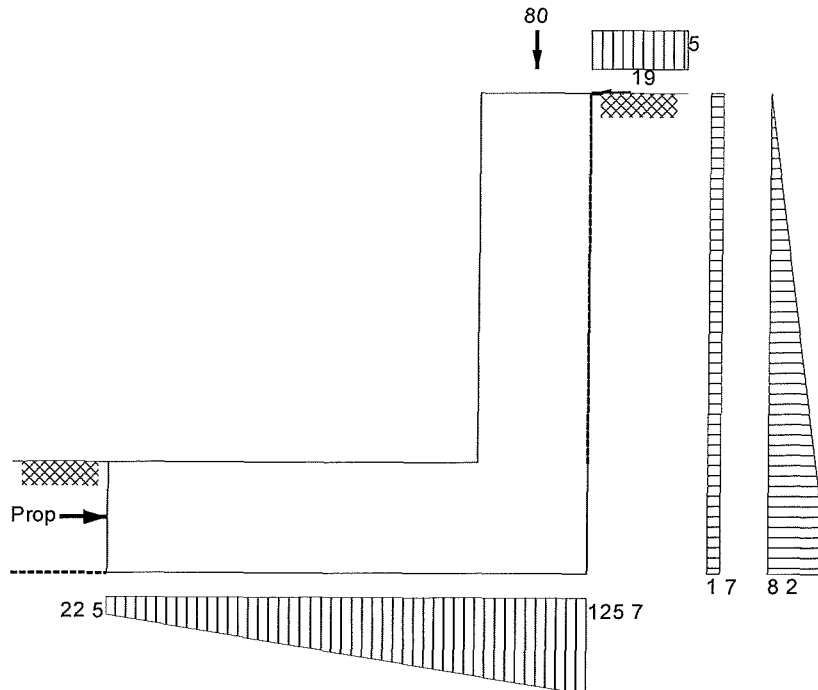

Loads shown in kN/m, pressures shown in kN/m²

Calculate propping force

Propping force

$$F_{prop} = 0.0 \text{ kN/m}$$

Check bearing pressure

Total vertical reaction

$$R = 96.3 \text{ kN/m}$$

Distance to reaction

$$x_{bar} = 801 \text{ mm}$$

Eccentricity of reaction

$$e = 151 \text{ mm}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{toe} = 22.5 \text{ kN/m}^2$$

Bearing pressure at heel


$$p_{heel} = 125.7 \text{ kN/m}^2$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

 Ingleton Wood 1 Alie Street London	Project			Job no	
	79 Redington Road			811365	
	Calcs for			Start page no /Revision	
	Underpinning from GF level			1	
	Calcs by	Calcs date	Checked by	Checked date	Approved by
	A W	04/06/2018			Approved date

RETAINING WALL ANALYSIS (BS 8002 1994)

TEDDS calculation version 1 2 01 06

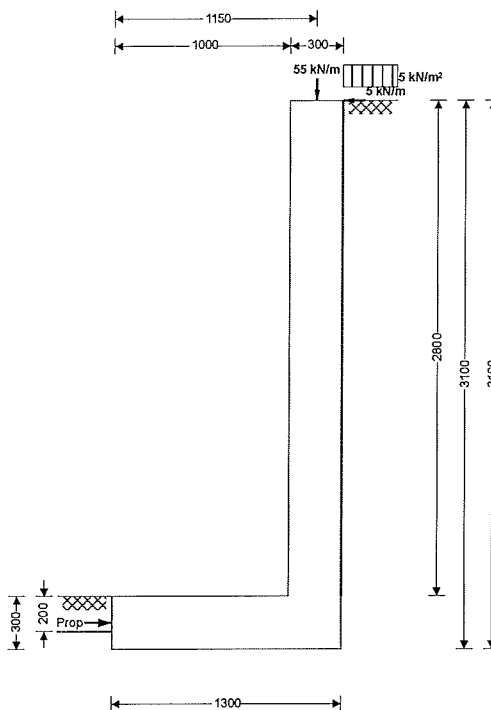

Wall details

Retaining wall type

Cantilever

Height of wall stem

$h_{\text{stem}} = 2800 \text{ mm}$

Wall stem thickness

$t_{\text{wall}} = 300 \text{ mm}$

Length of toe

$l_{\text{toe}} = 1000 \text{ mm}$

Length of heel

$l_{\text{heel}} = 0 \text{ mm}$

Overall length of base

$l_{\text{base}} = 1300 \text{ mm}$

Base thickness

$t_{\text{base}} = 300 \text{ mm}$

Height of retaining wall

$h_{\text{wall}} = 3100 \text{ mm}$

Depth of downstand

$d_{\text{ds}} = 0 \text{ mm}$

Thickness of downstand

$t_{\text{ds}} = 300 \text{ mm}$

Position of downstand

$l_{\text{ds}} = 850 \text{ mm}$

Depth of cover in front of wall

$d_{\text{cover}} = 0 \text{ mm}$

Unplanned excavation depth

$d_{\text{exc}} = 200 \text{ mm}$

Height of ground water

$h_{\text{water}} = 0 \text{ mm}$

Density of water

$\gamma_{\text{water}} = 9.81 \text{ kN/m}^3$

Density of wall construction

$\gamma_{\text{wall}} = 23.6 \text{ kN/m}^3$

Density of base construction

$\gamma_{\text{base}} = 23.6 \text{ kN/m}^3$

Angle of soil surface

$\beta = 0.0 \text{ deg}$

Effective height at back of wall

$h_{\text{eff}} = 3100 \text{ mm}$

Mobilisation factor

$M = 1.5$

Moist density

$\gamma_m = 18.0 \text{ kN/m}^3$

Saturated density

$\gamma_s = 21.0 \text{ kN/m}^3$

Design shear strength

$\phi' = 24.2 \text{ deg}$

Angle of wall friction

$\delta = 18.6 \text{ deg}$

Design shear strength

$\phi'_b = 24.2 \text{ deg}$

Design base friction

$\delta_b = 18.6 \text{ deg}$

Moist density

$\gamma_{mb} = 18.0 \text{ kN/m}^3$

Allowable bearing

$P_{\text{bearing}} = 130 \text{ kN/m}^2$

Using Coulomb theory

Active pressure

$K_a = 0.369$

Passive pressure

$K_p = 4.187$

At-rest pressure

$K_0 = 0.590$

Loading details

Surcharge load

Surcharge = 5.0 kN/m^2

Vertical dead load

$W_{\text{dead}} = 40.0 \text{ kN/m}$

Vertical live load

$W_{\text{live}} = 15.0 \text{ kN/m}$

Horizontal dead load

$F_{\text{dead}} = 0.0 \text{ kN/m}$

Horizontal live load

$F_{\text{live}} = 5.0 \text{ kN/m}$


 Ingleton Wood 1 Alie Street London	Project			Job no	
	79 Redington Road			811365	
	Calcs for			Start page no /Revision	
	Underpinning from GF level			2	
	Calcs by	Calcs date	Checked by	Checked date	Approved by
	A W	04/06/2018			Approved date

Position of vertical load

$l_{load} = 1150 \text{ mm}$

Height of horizontal load

$h_{load} = 3100 \text{ mm}$

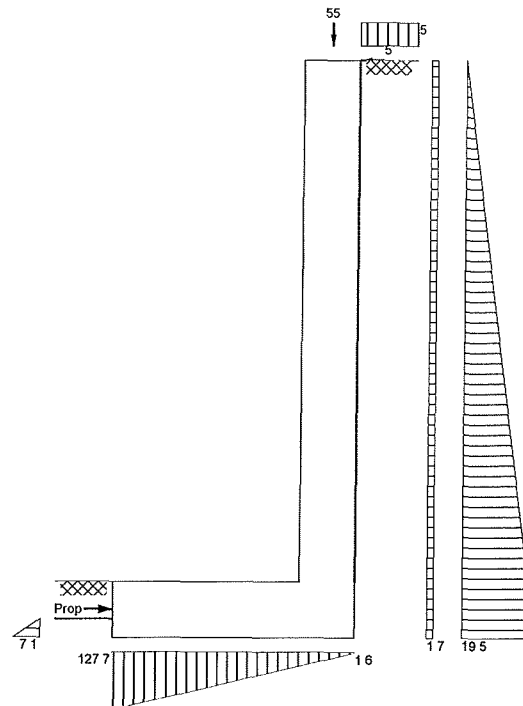

Loads shown in kN/m, pressures shown in kN/m²

Calculate propping force

Propping force

$$F_{prop} = 17.1 \text{ kN/m}$$

Check bearing pressure

Total vertical reaction

$$R = 84.0 \text{ kN/m}$$

Distance to reaction

$$x_{bar} = 439 \text{ mm}$$

Eccentricity of reaction

$$e = 211 \text{ mm}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{toe} = 127.7 \text{ kN/m}^2$$

Bearing pressure at heel


$$p_{heel} = 1.6 \text{ kN/m}^2$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

 Ingleton Wood 1 Alie Street London	Project		79 Redington Road		Job no		811365
	Calcs for		External Lightwell Retaining Wall		Start page no /Revision		1
	Calcs by	A W	Calcs date	04/06/2018	Checked by	Checked date	Approved by

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1 2 01 06

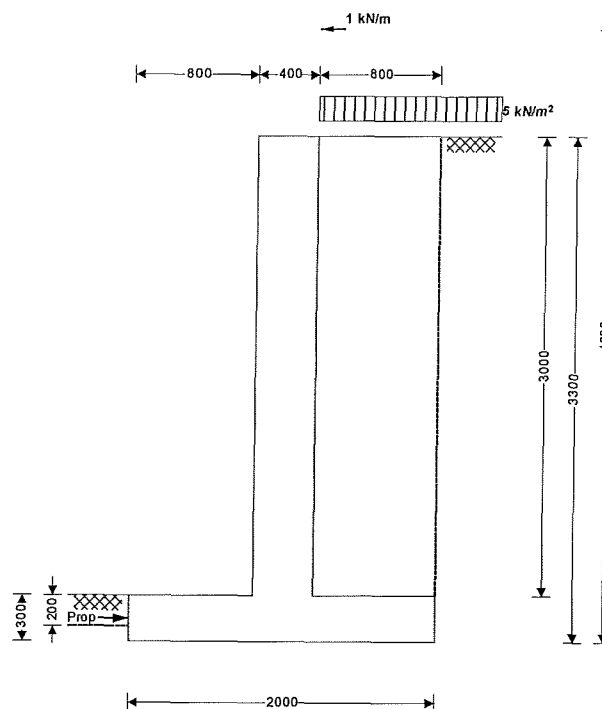

Wall details

Retaining wall type

Height of wall stem

Length of toe

Overall length of base

Height of retaining wall

Depth of downstand

Position of downstand

Depth of cover in front of wall

Height of ground water

Density of wall construction

Angle of soil surface

Mobilisation factor

Moist density

Design shear strength

Design shear strength

Moist density

Cantilever

$h_{\text{stem}} = 3000 \text{ mm}$

$l_{\text{toe}} = 800 \text{ mm}$

$l_{\text{base}} = 2000 \text{ mm}$

$h_{\text{wall}} = 3300 \text{ mm}$

$d_{\text{ds}} = 0 \text{ mm}$

$l_{\text{ds}} = 850 \text{ mm}$

$d_{\text{cover}} = 0 \text{ mm}$

$h_{\text{water}} = 0 \text{ mm}$

$\gamma_{\text{wall}} = 23.6 \text{ kN/m}^3$

$\beta = 0.0 \text{ deg}$

$M = 1.5$

$\gamma_m = 18.0 \text{ kN/m}^3$

$\phi' = 24.2 \text{ deg}$

$\phi'_b = 24.2 \text{ deg}$

$\gamma_{mb} = 18.0 \text{ kN/m}^3$

Wall stem thickness

Length of heel

Base thickness

Thickness of downstand

Unplanned excavation depth

Density of water

Density of base construction

Effective height at back of wall

Saturated density

Angle of wall friction

Design base friction

Allowable bearing

Passive pressure

Vertical live load

Horizontal live load

$t_{\text{wall}} = 400 \text{ mm}$

$l_{\text{heel}} = 800 \text{ mm}$

$t_{\text{base}} = 300 \text{ mm}$

$t_{\text{ds}} = 300 \text{ mm}$

$d_{\text{exc}} = 200 \text{ mm}$

$\gamma_{\text{water}} = 9.81 \text{ kN/m}^3$

$\gamma_{\text{base}} = 23.6 \text{ kN/m}^3$

$h_{\text{eff}} = 3300 \text{ mm}$

$\gamma_s = 21.0 \text{ kN/m}^3$

$\delta = 18.6 \text{ deg}$

$\delta_b = 18.6 \text{ deg}$

$P_{\text{bearing}} = 130 \text{ kN/m}^2$

$K_p = 4.187$

$W_{\text{live}} = 0.0 \text{ kN/m}$

$F_{\text{live}} = 0.8 \text{ kN/m}$

Using Coulomb theory

Active pressure

At-rest pressure

$K_a = 0.369$

$K_0 = 0.590$

Loading details

Surcharge load

Vertical dead load

Horizontal dead load

Surcharge = 5.0 kN/m^2

$W_{\text{dead}} = 0.0 \text{ kN/m}$

$F_{\text{dead}} = 0.0 \text{ kN/m}$


 Ingleton Wood 1 Allie Street London	Project			Job no	
	79 Redington Road			811365	
	Calcs for			Start page no /Revision	
	External Lightwell Retaining Wall			2	
	Calcs by	Calcs date	Checked by	Checked date	Approved by
	A W	04/06/2018			Approved date

Position of vertical load

$l_{load} = 0 \text{ mm}$

Height of horizontal load

$h_{load} = 4000 \text{ mm}$

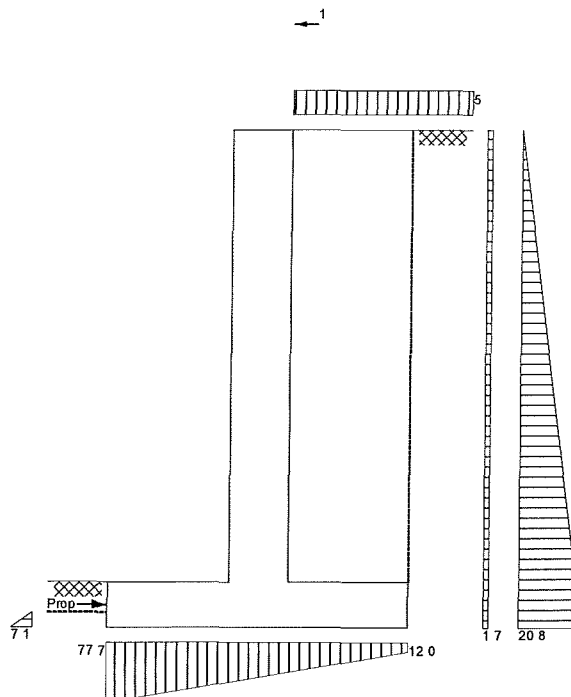

Loads shown in kN/m, pressures shown in kN/m²

Calculate propping force

Propping force

$F_{prop} = 11.6 \text{ kN/m}$

Check bearing pressure

Total vertical reaction

$R = 89.7 \text{ kN/m}$

Distance to reaction

$x_{bar} = 756 \text{ mm}$

Eccentricity of reaction

$e = 244 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe

$p_{toe} = 77.7 \text{ kN/m}^2$

Bearing pressure at heel

$p_{heel} = 12.0 \text{ kN/m}^2$

PASS - Maximum bearing pressure is less than allowable bearing pressure