


Project 9 St Georges Terrace				Job no. 17054	
Calcs for				Start page no./Revision 1	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date	Approved by	Approved date

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1.2.01.06

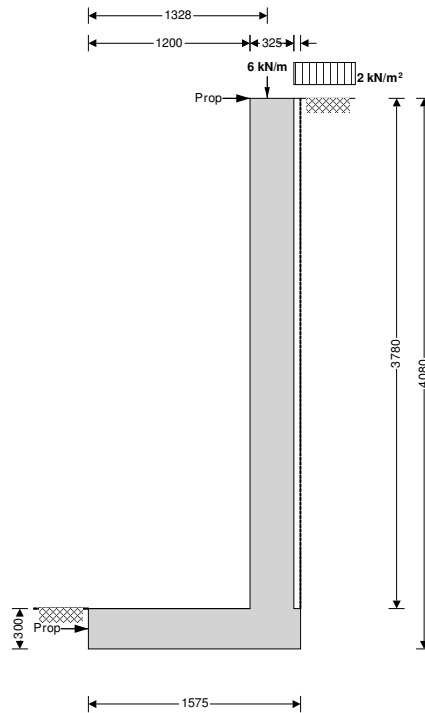

Wall details

Retaining wall type
 Height of retaining wall stem
 Thickness of wall stem
 Length of toe
 Length of heel
 Overall length of base
 Thickness of base
 Depth of downstand
 Position of downstand
 Thickness of downstand
 Height of retaining wall
 Depth of cover in front of wall
 Depth of unplanned excavation
 Height of ground water behind wall
 Height of saturated fill above base
 Density of wall construction
 Density of base construction
 Angle of rear face of wall
 Angle of soil surface behind wall
 Effective height at virtual back of wall

Cantilever propped at both

$h_{\text{stem}} = 3780$ mm
 $t_{\text{wall}} = 325$ mm
 $l_{\text{toe}} = 1200$ mm
 $l_{\text{heel}} = 50$ mm
 $l_{\text{base}} = l_{\text{toe}} + l_{\text{heel}} + t_{\text{wall}} = 1575$ mm
 $t_{\text{base}} = 300$ mm
 $d_{\text{ds}} = 0$ mm
 $l_{\text{ds}} = 1000$ mm
 $t_{\text{ds}} = 300$ mm
 $h_{\text{wall}} = h_{\text{stem}} + t_{\text{base}} + d_{\text{ds}} = 4080$ mm
 $d_{\text{cover}} = 0$ mm
 $d_{\text{exc}} = 0$ mm
 $h_{\text{water}} = 0$ mm
 $h_{\text{sat}} = \max(h_{\text{water}} - t_{\text{base}} - d_{\text{ds}}, 0 \text{ mm}) = 0$ mm
 $\gamma_{\text{wall}} = 23.6$ kN/m³
 $\gamma_{\text{base}} = 23.6$ kN/m³
 $\alpha = 90.0$ deg
 $\beta = 0.0$ deg
 $h_{\text{eff}} = h_{\text{wall}} + l_{\text{heel}} \times \tan(\beta) = 4080$ mm

Retained material details

Mobilisation factor
 $M = 1.5$

Project 9 St Georges Terrace				Job no. 17054	
Calcs for				Start page no./Revision 2	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date	Approved by	Approved date

Moist density of retained material $\gamma_m = 18.0 \text{ kN/m}^3$
 Saturated density of retained material $\gamma_s = 21.0 \text{ kN/m}^3$
 Design shear strength $\phi' = 24.2 \text{ deg}$
 Angle of wall friction $\delta = 0.0 \text{ deg}$

Base material details

Moist density $\gamma_{mb} = 18.0 \text{ kN/m}^3$
 Design shear strength $\phi'_b = 24.2 \text{ deg}$
 Design base friction $\delta_b = 18.6 \text{ deg}$
 Allowable bearing pressure $P_{\text{bearing}} = 120 \text{ kN/m}^2$

Using Coulomb theory

Active pressure coefficient for retained material

$$K_a = \sin(\alpha + \phi')^2 / (\sin(\alpha)^2 \times \sin(\alpha - \delta) \times [1 + \sqrt{(\sin(\phi' + \delta) \times \sin(\phi' - \beta) / (\sin(\alpha - \delta) \times \sin(\alpha + \beta)))^2}] = 0.419$$

Passive pressure coefficient for base material


$$K_p = \sin(90 - \phi'_b)^2 / (\sin(90 - \delta_b) \times [1 - \sqrt{(\sin(\phi'_b + \delta_b) \times \sin(\phi'_b) / (\sin(90 + \delta_b)))^2}] = 4.187$$

At-rest pressure

At-rest pressure for retained material $K_0 = 1 - \sin(\phi') = 0.590$

Loading details

Surcharge load on plan **Surcharge = 1.5 kN/m²**
 Applied vertical dead load on wall **$W_{\text{dead}} = 6.2 \text{ kN/m}$**
 Applied vertical live load on wall **$W_{\text{live}} = 0.0 \text{ kN/m}$**
 Position of applied vertical load on wall **$l_{\text{load}} = 1328 \text{ mm}$**
 Applied horizontal dead load on wall **$F_{\text{dead}} = 0.0 \text{ kN/m}$**
 Applied horizontal live load on wall **$F_{\text{live}} = 0.0 \text{ kN/m}$**
 Height of applied horizontal load on wall **$h_{\text{load}} = 0 \text{ mm}$**

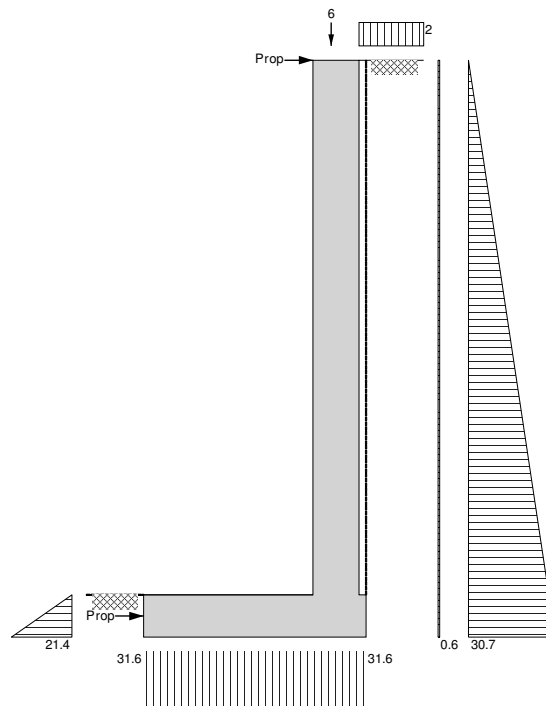



Project		9 St Georges Terrace		Job no.		17054	
Calcs for				Start page no./Revision			
				3			
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date		
MG	27/04/2018						

Vertical forces on wall

Wall stem	$W_{wall} = h_{stem} \times t_{wall} \times \gamma_{wall} = 29 \text{ kN/m}$
Wall base	$W_{base} = l_{base} \times t_{base} \times \gamma_{base} = 11.2 \text{ kN/m}$
Surcharge	$W_{sur} = \text{Surcharge} \times l_{heel} = 0.1 \text{ kN/m}$
Moist backfill to top of wall	$W_{m_w} = l_{heel} \times (h_{stem} - h_{sat}) \times \gamma_m = 3.4 \text{ kN/m}$
Applied vertical load	$W_v = W_{dead} + W_{live} = 6.2 \text{ kN/m}$
Total vertical load	$W_{total} = W_{wall} + W_{base} + W_{sur} + W_{m_w} + W_v = 49.8 \text{ kN/m}$

Horizontal forces on wall

Surcharge	$F_{sur} = K_a \times \text{Surcharge} \times h_{eff} = 2.6 \text{ kN/m}$
Moist backfill above water table	$F_{m_a} = 0.5 \times K_a \times \gamma_m \times (h_{eff} - h_{water})^2 = 62.7 \text{ kN/m}$
Total horizontal load	$F_{total} = F_{sur} + F_{m_a} = 65.3 \text{ kN/m}$

Calculate total propping force

Passive resistance of soil in front of wall	$F_p = 0.5 \times K_p \times \cos(\delta_b) \times (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 \times \gamma_{mb} = 3.2 \text{ kN/m}$
Propping force	$F_{prop} = \max(F_{total} - F_p - (W_{total} - W_{sur}) \times \tan(\delta_p), 0 \text{ kN/m})$ $F_{prop} = 45.3 \text{ kN/m}$

Overturning moments

Surcharge	$M_{sur} = F_{sur} \times (h_{eff} - 2 \times d_{ds}) / 2 = 5.2 \text{ kNm/m}$
Moist backfill above water table	$M_{m_a} = F_{m_a} \times (h_{eff} + 2 \times h_{water} - 3 \times d_{ds}) / 3 = 85.3 \text{ kNm/m}$
Total overturning moment	$M_{ot} = M_{sur} + M_{m_a} = 90.5 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall} = W_{wall} \times (l_{toe} + t_{wall} / 2) = 39.5 \text{ kNm/m}$
Wall base	$M_{base} = W_{base} \times l_{base} / 2 = 8.8 \text{ kNm/m}$
Moist backfill	$M_{m_r} = (W_{m_w} \times (l_{base} - l_{heel} / 2) + W_{m_s} \times (l_{base} - l_{heel} / 3)) = 5.3 \text{ kNm/m}$
Design vertical dead load	$M_{dead} = W_{dead} \times l_{load} = 8.2 \text{ kNm/m}$
Total restoring moment	$M_{rest} = M_{wall} + M_{base} + M_{m_r} + M_{dead} = 61.7 \text{ kNm/m}$

Check bearing pressure

Total vertical reaction	$R = W_{total} = 49.8 \text{ kN/m}$
Distance to reaction	$x_{bar} = l_{base} / 2 = 788 \text{ mm}$
Eccentricity of reaction	$e = \text{abs}((l_{base} / 2) - x_{bar}) = 0 \text{ mm}$
	Reaction acts within middle third of base
Bearing pressure at toe	$p_{toe} = (R / l_{base}) - (6 \times R \times e / l_{base}^2) = 31.6 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel} = (R / l_{base}) + (6 \times R \times e / l_{base}^2) = 31.6 \text{ kN/m}^2$

PASS - Maximum bearing pressure is less than allowable bearing pressure

Calculate propping forces to top and base of wall

Propping force to top of wall	$F_{prop_top} = (M_{ot} - M_{rest} + R \times l_{base} / 2 - F_{prop} \times t_{base} / 2) / (h_{stem} + t_{base} / 2) = 15.565 \text{ kN/m}$
Propping force to base of wall	$F_{prop_base} = F_{prop} - F_{prop_top} = 29.759 \text{ kN/m}$



Project 9 St Georges Terrace		Job no. 17054	
Calcs for		Start page no./Revision 4	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date
		Approved by	Approved date

RETAINING WALL DESIGN (BS 8002:1994)

TEDDS calculation version 1.2.01.06

Ultimate limit state load factors

Dead load factor	$\gamma_{f_d} = 1.4$
Live load factor	$\gamma_{f_l} = 1.6$
Earth and water pressure factor	$\gamma_{f_e} = 1.4$

Factored vertical forces on wall

Wall stem	$W_{wall_f} = \gamma_{f_d} \times h_{stem} \times t_{wall} \times \gamma_{wall} = 40.6 \text{ kN/m}$
Wall base	$W_{base_f} = \gamma_{f_d} \times l_{base} \times t_{base} \times \gamma_{base} = 15.6 \text{ kN/m}$
Surcharge	$W_{sur_f} = \gamma_{f_l} \times \text{Surcharge} \times l_{heel} = 0.1 \text{ kN/m}$
Moist backfill to top of wall	$W_{m_w_f} = \gamma_{f_d} \times l_{heel} \times (h_{stem} - h_{sat}) \times \gamma_m = 4.8 \text{ kN/m}$
Applied vertical load	$W_{v_f} = \gamma_{f_d} \times W_{dead} + \gamma_{f_l} \times W_{live} = 8.6 \text{ kN/m}$
Total vertical load	$W_{total_f} = W_{wall_f} + W_{base_f} + W_{sur_f} + W_{m_w_f} + W_{v_f} = 69.7 \text{ kN/m}$

Factored horizontal at-rest forces on wall

Surcharge	$F_{sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times h_{eff} = 5.8 \text{ kN/m}$
Moist backfill above water table	$F_{m_a_f} = \gamma_{f_e} \times 0.5 \times K_0 \times \gamma_m \times (h_{eff} - h_{water})^2 = 123.8 \text{ kN/m}$
Total horizontal load	$F_{total_f} = F_{sur_f} + F_{m_a_f} = 129.5 \text{ kN/m}$

Calculate total propping force

Passive resistance of soil in front of wall kN/m	$F_{p_f} = \gamma_{f_e} \times 0.5 \times K_p \times \cos(\delta_b) \times (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 \times \gamma_{mb} = 4.5$
Propping force	$F_{prop_f} = \max(F_{total_f} - F_{p_f} - (W_{total_f} - W_{sur_f}) \times \tan(\delta_b), 0 \text{ kN/m})$ $F_{prop_f} = 101.6 \text{ kN/m}$

Factored overturning moments

Surcharge	$M_{sur_f} = F_{sur_f} \times (h_{eff} - 2 \times d_{ds}) / 2 = 11.8 \text{ kNm/m}$
Moist backfill above water table	$M_{m_a_f} = F_{m_a_f} \times (h_{eff} + 2 \times h_{water} - 3 \times d_{ds}) / 3 = 168.3 \text{ kNm/m}$
Total overturning moment	$M_{ot_f} = M_{sur_f} + M_{m_a_f} = 180.1 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall_f} = W_{wall_f} \times (l_{toe} + t_{wall} / 2) = 55.3 \text{ kNm/m}$
Wall base	$M_{base_f} = W_{base_f} \times l_{base} / 2 = 12.3 \text{ kNm/m}$
Surcharge	$M_{sur_r_f} = W_{sur_f} \times (l_{base} - l_{heel} / 2) = 0.2 \text{ kNm/m}$
Moist backfill	$M_{m_r_f} = (W_{m_w_f} \times (l_{base} - l_{heel} / 2) + W_{m_s_f} \times (l_{base} - l_{heel} / 3)) = 7.4 \text{ kNm/m}$
Design vertical load	$M_{v_f} = W_{v_f} \times l_{load} = 11.4 \text{ kNm/m}$
Total restoring moment	$M_{rest_f} = M_{wall_f} + M_{base_f} + M_{sur_r_f} + M_{m_r_f} + M_{v_f} = 86.6 \text{ kNm/m}$

Factored bearing pressure

Total vertical reaction	$R_f = W_{total_f} = 69.7 \text{ kN/m}$
Distance to reaction	$X_{bar_f} = l_{base} / 2 = 788 \text{ mm}$
Eccentricity of reaction	$e_f = \text{abs}((l_{base} / 2) - X_{bar_f}) = 0 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe	$p_{toe_f} = (R_f / l_{base}) - (6 \times R_f \times e_f / l_{base}^2) = 44.3 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel_f} = (R_f / l_{base}) + (6 \times R_f \times e_f / l_{base}^2) = 44.3 \text{ kN/m}^2$
Rate of change of base reaction	$\text{rate} = (p_{toe_f} - p_{heel_f}) / l_{base} = 0.00 \text{ kN/m}^2/\text{m}$
Bearing pressure at stem / toe	$p_{stem_toe_f} = \max(p_{toe_f} - (\text{rate} \times l_{toe}), 0 \text{ kN/m}^2) = 44.3 \text{ kN/m}^2$
Bearing pressure at mid stem	$p_{stem_mid_f} = \max(p_{toe_f} - (\text{rate} \times (l_{toe} + t_{wall} / 2)), 0 \text{ kN/m}^2) = 44.3 \text{ kN/m}^2$

Project 9 St Georges Terrace				Job no. 17054	
Calcs for				Start page no./Revision 5	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date	Approved by	Approved date

Bearing pressure at stem / heel

$$p_{\text{stem_heel}_f} = \max(p_{\text{toe}_f} - (\text{rate} \times (l_{\text{toe}} + t_{\text{wall}})), 0 \text{ kN/m}^2) = \mathbf{44.3 \text{ kN/m}^2}$$

Calculate propping forces to top and base of wall

Propping force to top of wall

$$F_{\text{prop_top}_f} = (M_{\text{ot}_f} - M_{\text{rest}_f} + R_f \times l_{\text{base}} / 2 - F_{\text{prop}_f} \times t_{\text{base}} / 2) / (h_{\text{stem}} + t_{\text{base}} / 2) = \mathbf{33.880 \text{ kN/m}}$$

Propping force to base of wall

$$F_{\text{prop_base}_f} = F_{\text{prop}_f} - F_{\text{prop_top}_f} = \mathbf{67.750 \text{ kN/m}}$$

Design of reinforced concrete retaining wall toe (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{\text{cu}} = \mathbf{40 \text{ N/mm}^2}$$

Characteristic strength of reinforcement

$$f_y = \mathbf{500 \text{ N/mm}^2}$$

Base details

Minimum area of reinforcement

$$k = \mathbf{0.13 \%}$$

Cover to reinforcement in toe

$$c_{\text{toe}} = \mathbf{40 \text{ mm}}$$

Calculate shear for toe design

Shear from bearing pressure

$$V_{\text{toe_bear}} = (p_{\text{toe}_f} + p_{\text{stem_toe}_f}) \times l_{\text{toe}} / 2 = \mathbf{53.1 \text{ kN/m}}$$

Shear from weight of base

$$V_{\text{toe_wt_base}} = \gamma_{\text{f}_d} \times \gamma_{\text{base}} \times l_{\text{toe}} \times t_{\text{base}} = \mathbf{11.9 \text{ kN/m}}$$

Total shear for toe design

$$V_{\text{toe}} = V_{\text{toe_bear}} - V_{\text{toe_wt_base}} = \mathbf{41.2 \text{ kN/m}}$$

Calculate moment for toe design

Moment from bearing pressure


$$M_{\text{toe_bear}} = (2 \times p_{\text{toe}_f} + p_{\text{stem_mid}_f}) \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 6 = \mathbf{41.1 \text{ kNm/m}}$$

Moment from weight of base

$$M_{\text{toe_wt_base}} = (\gamma_{\text{f}_d} \times \gamma_{\text{base}} \times t_{\text{base}} \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 2) = \mathbf{9.2 \text{ kNm/m}}$$

Total moment for toe design

$$M_{\text{toe}} = M_{\text{toe_bear}} - M_{\text{toe_wt_base}} = \mathbf{31.9 \text{ kNm/m}}$$

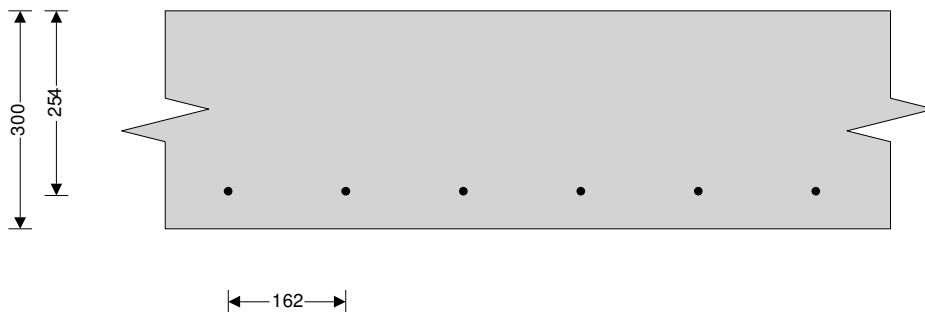

Check toe in bending

Width of toe

$$b = \mathbf{1000 \text{ mm/m}}$$

Depth of reinforcement

$$d_{\text{toe}} = t_{\text{base}} - c_{\text{toe}} - (\phi_{\text{toe}} / 2) = \mathbf{254.0 \text{ mm}}$$

Constant

$$K_{\text{toe}} = M_{\text{toe}} / (b \times d_{\text{toe}}^2 \times f_{\text{cu}}) = \mathbf{0.012}$$

Compression reinforcement is not required

Lever arm

$$z_{\text{toe}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{toe}}, 0.225) / 0.9))}, 0.95) \times d_{\text{toe}}$$

$$z_{\text{toe}} = \mathbf{241 \text{ mm}}$$

Area of tension reinforcement required

$$A_{\text{s_toe_des}} = M_{\text{toe}} / (0.87 \times f_y \times z_{\text{toe}}) = \mathbf{304 \text{ mm}^2/\text{m}}$$

Minimum area of tension reinforcement

$$A_{\text{s_toe_min}} = k \times b \times t_{\text{base}} = \mathbf{390 \text{ mm}^2/\text{m}}$$

Area of tension reinforcement required

$$A_{\text{s_toe_req}} = \text{Max}(A_{\text{s_toe_des}}, A_{\text{s_toe_min}}) = \mathbf{390 \text{ mm}^2/\text{m}}$$

Reinforcement provided

$$\mathbf{12 \text{ mm dia. bars @ 162 mm centres}}$$

Area of reinforcement provided

$$A_{\text{s_toe_prov}} = \mathbf{698 \text{ mm}^2/\text{m}}$$

PASS - Reinforcement provided at the retaining wall toe is adequate

Project 9 St Georges Terrace				Job no. 17054	
Calcs for				Start page no./Revision 6	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date	Approved by	Approved date

Check shear resistance at toe

Design shear stress

$$V_{toe} = V_{toe} / (b \times d_{toe}) = \mathbf{0.162 \text{ N/mm}^2}$$

Allowable shear stress

$$V_{adm} = \min(0.8 \times \sqrt{f_{cu}} / 1 \text{ N/mm}^2, 5) \times 1 \text{ N/mm}^2 = \mathbf{5.000 \text{ N/mm}^2}$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$V_{c_toe} = \mathbf{0.538 \text{ N/mm}^2}$$

$V_{toe} < V_{c_toe}$ - No shear reinforcement required

Design of reinforced concrete retaining wall heel (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{cu} = \mathbf{40 \text{ N/mm}^2}$$

Characteristic strength of reinforcement

$$f_y = \mathbf{500 \text{ N/mm}^2}$$

Base details

Minimum area of reinforcement

$$k = \mathbf{0.13 \%}$$

Cover to reinforcement in heel

$$C_{heel} = \mathbf{20 \text{ mm}}$$

Calculate shear for heel design

Shear from bearing pressure

$$V_{heel_bear} = (p_{heel_f} + p_{stem_heel_f}) \times l_{heel} / 2 = \mathbf{2.2 \text{ kN/m}}$$

Shear from weight of base

$$V_{heel_wt_base} = \gamma_{fd} \times \gamma_{base} \times l_{heel} \times t_{base} = \mathbf{0.5 \text{ kN/m}}$$

Shear from weight of moist backfill

$$V_{heel_wt_m} = w_{m_w_f} = \mathbf{4.8 \text{ kN/m}}$$

Shear from surcharge

$$V_{heel_sur} = w_{sur_f} = \mathbf{0.1 \text{ kN/m}}$$

Total shear for heel design

$$V_{heel} = -V_{heel_bear} + V_{heel_wt_base} + V_{heel_wt_m} + V_{heel_sur} = \mathbf{3.2 \text{ kN/m}}$$

Calculate moment for heel design

Moment from bearing pressure

$$M_{heel_bear} = (2 \times p_{heel_f} + p_{stem_mid_f}) \times (l_{heel} + t_{wall} / 2)^2 / 6 = \mathbf{1 \text{ kNm/m}}$$

Moment from weight of base

$$M_{heel_wt_base} = (\gamma_{fd} \times \gamma_{base} \times t_{base} \times (l_{heel} + t_{wall} / 2)^2 / 2) = \mathbf{0.2 \text{ kNm/m}}$$

Moment from weight of moist backfill


$$M_{heel_wt_m} = w_{m_w_f} \times (l_{heel} + t_{wall}) / 2 = \mathbf{0.9 \text{ kNm/m}}$$

Moment from surcharge

$$M_{heel_sur} = w_{sur_f} \times (l_{heel} + t_{wall}) / 2 = \mathbf{0 \text{ kNm/m}}$$

Total moment for heel design

$$M_{heel} = -M_{heel_bear} + M_{heel_wt_base} + M_{heel_wt_m} + M_{heel_sur} = \mathbf{0.1 \text{ kNm/m}}$$

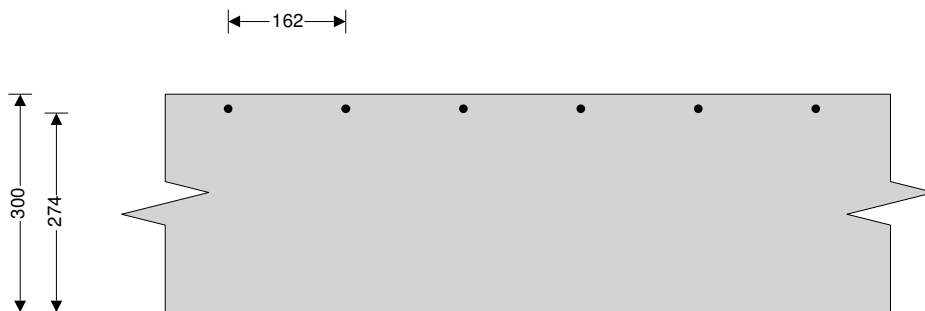

Check heel in bending

Width of heel

$$b = \mathbf{1000 \text{ mm/m}}$$

Depth of reinforcement

$$d_{heel} = t_{base} - C_{heel} - (\phi_{heel} / 2) = \mathbf{274.0 \text{ mm}}$$

Constant

$$K_{heel} = M_{heel} / (b \times d_{heel}^2 \times f_{cu}) = \mathbf{0.000}$$

Compression reinforcement is not required

Lever arm


$$Z_{heel} = \min(0.5 + \sqrt{(0.25 - (\min(K_{heel}, 0.225) / 0.9))}, 0.95) \times d_{heel}$$

$$Z_{heel} = \mathbf{260 \text{ mm}}$$

Area of tension reinforcement required

$$A_{s_heel_des} = M_{heel} / (0.87 \times f_y \times Z_{heel}) = \mathbf{1 \text{ mm}^2/\text{m}}$$



	Project			Job no.	
	9 St Georges Terrace			17054	
	Calcs for			Start page no./Revision	
			7		
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
MG	27/04/2018				

Minimum area of tension reinforcement

$$A_{s_heel_min} = k \times b \times t_{base} = \mathbf{390 \text{ mm}^2/m}$$

Area of tension reinforcement required

$$A_{s_heel_req} = \text{Max}(A_{s_heel_des}, A_{s_heel_min}) = \mathbf{390 \text{ mm}^2/m}$$

Reinforcement provided

12 mm dia.bars @ 162 mm centres

Area of reinforcement provided

$$A_{s_heel_prov} = \mathbf{698 \text{ mm}^2/m}$$

PASS - Reinforcement provided at the retaining wall heel is adequate

Check shear resistance at heel

Design shear stress

$$v_{heel} = V_{heel} / (b \times d_{heel}) = \mathbf{0.012 \text{ N/mm}^2}$$

Allowable shear stress

$$v_{adm} = \text{min}(0.8 \times \sqrt{f_{cu}} / 1 \text{ N/mm}^2, 5) \times 1 \text{ N/mm}^2 = \mathbf{5.000 \text{ N/mm}^2}$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$v_{c_heel} = \mathbf{0.515 \text{ N/mm}^2}$$

$v_{heel} < v_{c_heel}$ - No shear reinforcement required

Design of reinforced concrete retaining wall stem (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{cu} = \mathbf{40 \text{ N/mm}^2}$$

Characteristic strength of reinforcement

$$f_y = \mathbf{500 \text{ N/mm}^2}$$

Wall details

Minimum area of reinforcement

$$k = \mathbf{0.13 \%}$$

Cover to reinforcement in stem

$$c_{stem} = \mathbf{80 \text{ mm}}$$

Cover to reinforcement in wall

$$c_{wall} = \mathbf{80 \text{ mm}}$$

Factored horizontal at-rest forces on stem

Surcharge

$$F_{s_sur_f} = \gamma_{f,l} \times K_0 \times \text{Surcharge} \times (h_{eff} - t_{base} - d_{ds}) = \mathbf{5.4 \text{ kN/m}}$$

Moist backfill above water table

$$F_{s_m_a_f} = 0.5 \times \gamma_{f,e} \times K_0 \times \gamma_m \times (h_{eff} - t_{base} - d_{ds} - h_{sat})^2 = \mathbf{106.2 \text{ kN/m}}$$

Calculate shear for stem design

Surcharge

$$V_{s_sur_f} = 5 \times F_{s_sur_f} / 8 = \mathbf{3.3 \text{ kN/m}}$$

Moist backfill above water table

$$V_{s_m_a_f} = F_{s_m_a_f} \times b_l \times ((5 \times L^2) - b_l^2) / (5 \times L^3) = \mathbf{83.3 \text{ kN/m}}$$

Total shear for stem design

$$V_{stem} = V_{s_sur_f} + V_{s_m_a_f} = \mathbf{86.6 \text{ kN/m}}$$

Calculate moment for stem design

Surcharge

$$M_{s_sur} = F_{s_sur_f} \times L / 8 = \mathbf{2.6 \text{ kNm/m}}$$

Moist backfill above water table

$$M_{s_m_a} = F_{s_m_a_f} \times b_l \times ((5 \times L^2) - (3 \times b_l^2)) / (15 \times L^2) = \mathbf{59.6 \text{ kNm/m}}$$

Total moment for stem design

$$M_{stem} = M_{s_sur} + M_{s_m_a} = \mathbf{62.2 \text{ kNm/m}}$$

Calculate moment for wall design

Surcharge

$$M_{w_sur} = 9 \times F_{s_sur_f} \times L / 128 = \mathbf{1.5 \text{ kNm/m}}$$

Moist backfill above water table


$$M_{w_m_a} = F_{s_m_a_f} \times 0.577 \times b_l \times [(b_l^3 + 5 \times a_l \times L^2) / (5 \times L^3) - 0.577^2 / 3] = \mathbf{24.4 \text{ kNm/m}}$$

kNm/m

Total moment for wall design

$$M_{wall} = M_{w_sur} + M_{w_m_a} = \mathbf{25.8 \text{ kNm/m}}$$

Project 9 St Georges Terrace				Job no. 17054	
Calcs for				Start page no./Revision 8	
Calcs by MG	Calcs date 27/04/2018	Checked by	Checked date	Approved by	Approved date

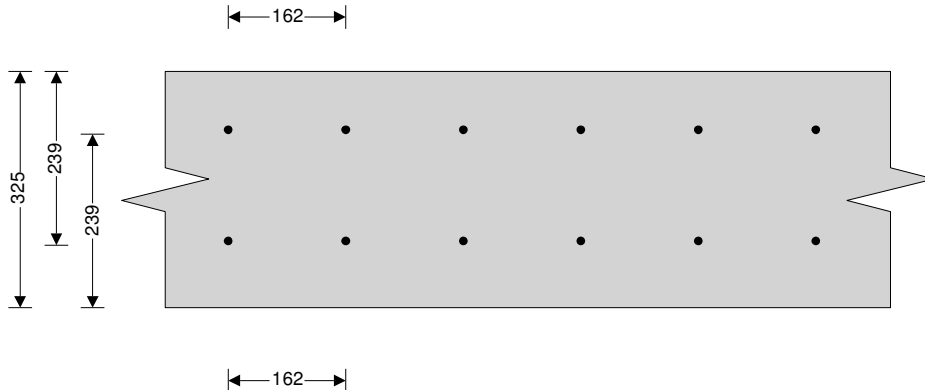

Check wall stem in bending

Width of wall stem

$$b = 1000 \text{ mm/m}$$

Depth of reinforcement

$$d_{\text{stem}} = t_{\text{wall}} - c_{\text{stem}} - (\phi_{\text{stem}} / 2) = 239.0 \text{ mm}$$

Constant

$$K_{\text{stem}} = M_{\text{stem}} / (b \times d_{\text{stem}}^2 \times f_{\text{cu}}) = 0.027$$

Compression reinforcement is not required

Lever arm

$$z_{\text{stem}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{stem}}, 0.225) / 0.9))}, 0.95) \times d_{\text{stem}}$$

$$z_{\text{stem}} = 227 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_stem_des} = M_{\text{stem}} / (0.87 \times f_y \times z_{\text{stem}}) = 630 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_stem_min} = k \times b \times t_{\text{wall}} = 423 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_stem_req} = \text{Max}(A_{s_stem_des}, A_{s_stem_min}) = 630 \text{ mm}^2/\text{m}$$

Reinforcement provided

12 mm dia.bars @ 162 mm centres

Area of reinforcement provided

$$A_{s_stem_prov} = 698 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided at the retaining wall stem is adequate

Check shear resistance at wall stem

Design shear stress

$$v_{\text{stem}} = V_{\text{stem}} / (b \times d_{\text{stem}}) = 0.362 \text{ N/mm}^2$$

Allowable shear stress

$$v_{\text{adm}} = \min(0.8 \times \sqrt{f_{\text{cu}} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 5.000 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$v_{c_stem} = 0.558 \text{ N/mm}^2$$

$v_{\text{stem}} < v_{c_stem}$ - No shear reinforcement required

Check mid height of wall in bending

Depth of reinforcement

$$d_{\text{wall}} = t_{\text{wall}} - c_{\text{wall}} - (\phi_{\text{wall}} / 2) = 239.0 \text{ mm}$$

Constant

$$K_{\text{wall}} = M_{\text{wall}} / (b \times d_{\text{wall}}^2 \times f_{\text{cu}}) = 0.011$$

Compression reinforcement is not required

Lever arm

$$z_{\text{wall}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{wall}}, 0.225) / 0.9))}, 0.95) \times d_{\text{wall}}$$

$$z_{\text{wall}} = 227 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_wall_des} = M_{\text{wall}} / (0.87 \times f_y \times z_{\text{wall}}) = 262 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_wall_min} = k \times b \times t_{\text{wall}} = 423 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_wall_req} = \text{Max}(A_{s_wall_des}, A_{s_wall_min}) = 423 \text{ mm}^2/\text{m}$$

Reinforcement provided

12 mm dia.bars @ 162 mm centres

Area of reinforcement provided

$$A_{s_wall_prov} = 698 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided to the retaining wall at mid height is adequate

Check retaining wall deflection

Basic span/effective depth ratio

$$\text{ratio}_{\text{bas}} = 20$$



Project				Job no.	
9 St Georges Terrace				17054	
Calcs for				Start page no./Revision	
				9	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
MG	27/04/2018				

Design service stress

$$f_s = 2 \times f_y \times A_{s_stem_req} / (3 \times A_{s_stem_prov}) = 300.6 \text{ N/mm}^2$$

Modification factor

$$\text{factor}_{tens} = \min(0.55 + (477 \text{ N/mm}^2 - f_s) / (120 \times (0.9 \text{ N/mm}^2 + (M_{stem} / (b \times d_{stem}^2)))), 2) = 1.29$$

Maximum span/effective depth ratio

$$\text{ratio}_{max} = \text{ratio}_{bas} \times \text{factor}_{tens} = 25.78$$

Actual span/effective depth ratio


$$\text{ratio}_{act} = h_{stem} / d_{stem} = 15.82$$

PASS - Span to depth ratio is acceptable



Project		9 St Georges Terrace		Job no.		17054	
Calcs for				Start page no./Revision			
				10			
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date		
MG	27/04/2018						

Indicative retaining wall reinforcement diagram

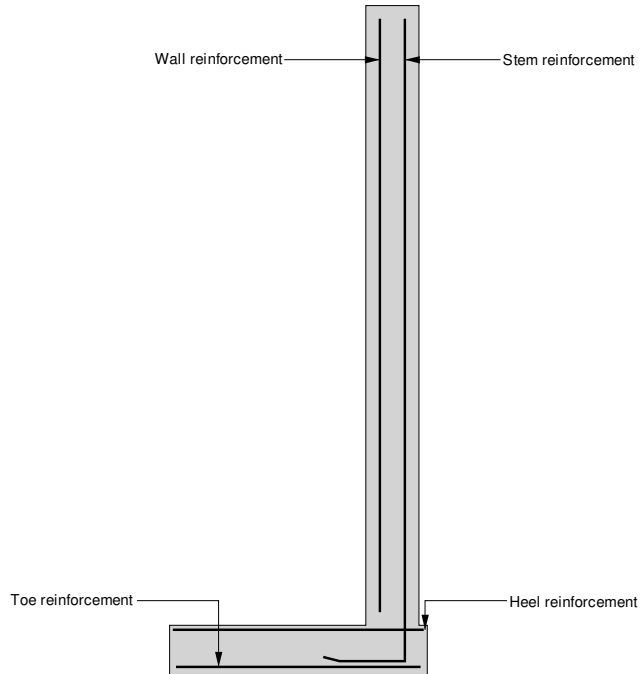

- Toe bars - 12 mm dia.@ 162 mm centres - (698 mm²/m)
- Heel bars - 12 mm dia.@ 162 mm centres - (698 mm²/m)
- Wall bars - 12 mm dia.@ 162 mm centres - (698 mm²/m)
- Stem bars - 12 mm dia.@ 162 mm centres - (698 mm²/m)