

Basement Impact Assessment

in connection with proposed development at

No. 8 Kentish Town Road

Camden

London

NW1 9NX

for

Kentish Town Spaces (UK) Ltd



LBH4535 Ver 1.1

July 2018

LBH WEMBLEY

ENGINEERING

Version	Date	Comment	Authorised
0.1	8th June 2018	Draft issue	Seamus Lefroy-Brooks BSc(hons) MSc CEng MICE CGeol FGS CEnv MEnvSc FRGS SiLC RoGEP UK Registered Ground Engineering Adviser NQMS SQP DoWCoP QP DEFRA National Expert Panel Member
1.0	6 th July 2018	Final issue	SRLB
1.1	20 th July 2018	Minor amendments	

LBH WEMBLEY ENGINEERING

12 Little Balmer

Buckingham Industrial Park

Buckingham

MK18 1TF

Tel: 01280 812310

email: enquiry@lbhgeo.co.uk

website: www.lbhgeo.co.uk

Executive Summary

It is proposed to construct a basement at this property.

A planning application (2018/0907/P) has been made to London Borough of Camden in April 2018 for the erection of a roof extension with a small first and second floor rear extension to the existing three storey terraced building at No. 8 Kentish Town Road.

It is now proposed to additionally construct a single storey basement beneath the footprint of the building.

This report provides an assessment of the potential impacts that the basement development may have upon the surrounding area, neighbouring structures and the local environment.

The ground conditions at the site comprise the London Clay Formation.

Hydrogeological Impacts

The BIA screening has not identified any potential groundwater issues.

Hydrological Impacts

The BIA screening has identified that Kentish Town Road flooded in 1975

An assessment of the risk has been undertaken and the surface water flood risk is to be mitigated by incorporating flood resistant measures into the building design. SUDS attenuation is to be included within the development in order to help reduce flood risk elsewhere.

Stability Impacts

The BIA screening has identified the need for extensive underpinning and ground movement assessments have been undertaken to demonstrate the acceptability of the likely impact of the proposed development upon neighbouring structures and the adjoining pavement and highway.

In addition, it has been established that the front wall of the site lies close to the London Underground assets beneath Kentish Town Road. The potential impact upon these is the subject of a separate assessment and is being addressed separately and directly with LUL.

Conclusion

No adverse residual or cumulative stability, hydrological or hydrogeological impacts are expected as a result of this development. This BIA concludes that the proposed development will not cause harm to its neighbours or the wider environment.

Contents

Executive Summary	3
Contents	4
Foreword-Guidance Notes	7
1. Introduction	8
1.1 Background	8
1.2 Brief	8
1.3 Policy	8
1.4 Report Structure	9
1.5 Documents Consulted	10
2. The Site	11
2.1 Site Location	11
2.2 Topographical Setting	11
2.3 Site Description	11
2.4 Proposed Development	11
3. Desk Study	13
3.1 Site History	13
3.2 Geological Information	13
3.3 Hydrogeological Information	13
3.4 Hydrological, Drainage and Flood Risk Information	13
4. Screening & Scoping Assessments	14
4.1 Screening Assessment	14
4.1.1 Screening Checklist for Subterranean (Groundwater) Flow	14
4.1.2 Screening Checklist for Surface Flow and Flooding	15
4.1.3 Screening Checklist for Stability	15
4.2 Scoping Assessment	16
4.2.1 Scoping for Surface Flow and Flooding	16
4.2.2 Scoping for Stability	17
5. Site Investigation	18
5.1 Ground Conditions	18
5.2 Made Ground	18
5.3 London Clay Formation	18
5.4 Groundwater	18

6. Outline Basement Construction Methodology	19
6.1 Summary	19
6.2 Methodology	19
6.3 Site Set-Up	19
6.4 Underpinning	20
6.5 Construction Sequence	20
6.6 Monitoring	21
7. Ground Movement to Neighbouring Properties	22
7.1 Structures Assessed for Ground Movement	22
7.1.1 No. 6 Kentish Town Road	22
7.1.2 Nos. 10 – 12 Kentish Town Road	22
7.1.3 Nos. 3a and 5 Camden Road	22
7.2 Modelled Ground Conditions	22
7.3 Short Term Movements	23
7.3.1 Underpinning	23
7.3.2 Excavation	24
7.3.3 Post Construction Movements	24
7.4 Impact on Neighbouring Structures	25
7.4.1 No. 6 Kentish Town Road – Long Party Wall Section (Section A-A')	26
7.4.2 No. 6 Kentish Town Road – Short Party Wall Section (Section B-B')	26
7.4.3 No. 5 Camden Road – Long Party Wall Section (Section C-C')	26
7.4.4 No. 5 Camden Road – Short Party Wall Section (Section D-D')	26
7.4.5 Nos. 10-12 Kentish Town Road – Two Storey Section (Section E-E')	26
7.4.6 Nos. 10-12 Kentish Town Road – Three Storey Section (Section F-F')	26
8. Impact Assessment	27
8.1 Potential Hydrogeological Impacts	27
8.2 Potential Hydrological Impacts	27
8.3 Potential Stability Impacts	27
8.3.1 Public Highway	27
8.3.2 London Clay	27
8.3.3 Tunnels	27
8.3.4 Ground Movements	27
8.4 Residual Impacts	28
9. Conclusion	29

Site: No. 8 Kentish Town Road, Camden, London, NW1 9NX
Client: Kentish Town Spaces (UK) Ltd

LBH4535
Page 6 of 29

Foreword-Guidance Notes

GENERAL

This report has been prepared for a specific client and to meet a specific brief. The preparation of this report may have been affected by limitations of scope, resources or time scale required by the client. Should any part of this report be relied on by a third party, that party does so wholly at its own risk and LBH Wembley Engineering disclaims any liability to such parties.

The observations and conclusions described in this report are based solely upon the agreed scope of work. LBH Wembley Engineering has not performed any observations, investigations, studies or testing not specifically set out in the agreed scope of work and cannot accept any liability for the existence of any condition, the discovery of which would require performance of services beyond the agreed scope of work.

VALIDITY

Should the purpose for which the report is used, or the proposed use of the site change, this report may no longer be valid and any further use of or reliance upon the report in those circumstances shall be at the client's sole and own risk. The passage of time may result in changes in site conditions, regulatory or other legal provisions, technology or economic conditions which could render the report inaccurate or unreliable. The information and conclusions contained in this report should therefore not be relied upon in the future and any such reliance on the report in the future shall again be at the client's own and sole risk.

THIRD PARTY INFORMATION

The report may present an opinion based upon information received from third parties. However, no liability can be accepted for any inaccuracies or omissions in that information.

1. Introduction

1.1 Background

A planning application (2018/0907/P) has been made to London Borough of Camden in April 2018 for the erection of a roof extension with a small first and second floor rear extension to the existing three storey terraced building at No. 8 Kentish Town Road.

It is now proposed to additionally construct a single storey basement beneath the footprint of the building.

1.2 Brief

LBH WEMBLEY have been appointed by Kentish Town Spaces (UK) Ltd to complete a Basement Impact Assessment (BIA) for submission to London Borough of Camden, in support of a forthcoming planning application for the proposed basement development.

This BIA has been prepared to satisfy the specific requirements of the 2017 Camden Planning Policy and Supplementary Planning Guidance CPG on Basements and Lightwells, and the associated 2010 Camden Geological, Hydrogeological and Hydrological Study.

1.3 Policy

The 2017 Camden Local Plan Policy A5 Basements reads as follows:

"The Council will only permit basement development where it is demonstrated to its satisfaction that the proposal would not cause harm to:

- a) neighbouring properties;*
- b) the structural, ground, or water conditions of the area;*
- c) the character and amenity of the area;*
- d) the architectural character of the building; and*
- e) the significance of heritage assets.*

In determining proposals for basements and other underground development, the Council will require an assessment of the scheme's impact on drainage, flooding, groundwater conditions and structural stability in the form of a Basement Impact Assessment and where appropriate, a Basement Construction Plan.

The siting, location, scale and design of basements must have minimal impact on, and be subordinate to, the host building and property. Basement development should:

- f) not comprise of more than one storey;*
- g) not be built under an existing basement;*
- h) not exceed 50% of each garden within the property;*
- i) be less than 1.5 times the footprint of the host building in area;*
- j) extend into the garden no further than 50% of the depth of the host building measured from the principal rear elevation;*
- k) not extend into or underneath the garden further than 50% of the depth of the garden;*
- l) be set back from neighbouring property boundaries where it extends beyond the footprint of the host building; and*

m) avoid the loss of garden space or trees of townscape or amenity value.

Exceptions to f. to k. above may be made on large comprehensively planned sites.

The Council will require applicants to demonstrate that proposals for basements:

n. do not harm neighbouring properties, including requiring the provision of a Basement Impact Assessment which shows that the scheme poses a risk of damage to neighbouring properties no higher than Burland Scale 1 'very slight';

o. avoid adversely affecting drainage and run-off or causing other damage to the water environment;

p. avoid cumulative impacts;

q. do not harm the amenity of neighbours;

r. provide satisfactory landscaping, including adequate soil depth;

s. do not harm the appearance or setting of the property or the established character of the surrounding area;

t. protect important archaeological remains; and

u. do not prejudice the ability of the garden to support trees where they are part of the character of the area.

The Council will not permit basement schemes which include habitable rooms and other sensitive uses in areas prone to flooding.

We will generally require a Construction Management Plan for basement developments.

Given the complex nature of basement development, the Council encourages developers to offer security for expenses for basement development to adjoining neighbours."

The following policies in the Local Plan are also relevant to basement development and will be taken into account when assessing basement schemes:

- "Policy A2 Open space";
- "Policy A3 Biodiversity";
- "Policy D1 Design";
- "Policy D2 Heritage"; and
- "Policy CC3 Water and flooding".

In addition to the Local Plan Policy, Camden publishes Camden Planning Guidance on Basements and Lightwells. These CPG documents do not carry the same weight as the main Camden Development Plan documents (including the above Policy A5) but they are important supporting documents.

It is noted that the CPG Planning Guidance on Basements (formerly CPG4 2015) has been updated (March 2018) to reflect the Local Plan.

1.4 Report Structure

This report commences with a desk study and characterisation of the site, before progressing to BIA screening and scoping assessments, whereby consideration is given to identifying the potential hydrogeological, hydrological and stability impacts to be associated with the proposed development.

Following this the findings of an intrusive ground investigation are reported and a ground model is developed. An outline construction methodology is then put forward, followed by an assessment of the potential ground movements affecting neighbouring structures.

Finally, an assessment of the potential impacts of the proposed scheme is presented.

1.5 Documents Consulted

The following documents have been consulted during the preparation of this document:

1. Proposed Ground Floor & Basement Plan by Ambigram Architects, dated April 2018, Dwg No. PR0001, Rev. WIP
2. Existing and Proposed Section AA by Ambigram Architects, dated April 2018, Dwg No. PR0110, Rev. WIP
3. Existing Ground Floor Plan by Ambigram Architects, dated April 2018, Dwg No. E0001, Rev. WIP
4. Geotechnical Survey Report by Fastrack, dated May 2018, Ref: 11466
5. Basement Structure Structural Report by Hinerti Ltd, dated July 2018
6. Flood Risk Assessment & SUDS Statement by LBH WEMBLEY, dated July 2018, ref: LBH4535fra Ver. 1.0

2. The Site

2.1 Site Location

The site is situated on the eastern side of Kentish Town Road, approximately 30m to the northeast of Camden Town underground station.

The site may be located approximately by postcode NW1 9NX or by National Grid Reference 528955, 183985.

2.2 Topographical Setting

The site lies on a very gentle south-eastwards falling slope on the west bank of the now culverted River Fleet, which runs approximately 200m from the site.

2.3 Site Description

The site is occupied by a three storey terraced building with a mansard roof which occupies the front two thirds of the site. To the rear of this there is a single storey extension including a former yard area at the rear of the site.

The existing ground floor level is indicated to be set at approximately +26.3m OD, raised by approximately 100mm from the street level to the front of the property.

To the north, the building adjoins a part two, part three storey terraced building at Nos. 10 -12 Kentish Town Road.

To the south, the building adjoins a four storey terraced building at No. 6 Kentish Town Road. This building is understood to include a basement that extends to approximately 2.5m depth below ground floor level.

To the rear the site backs onto three storey terraced buildings at Nos. 3A and 5 Camden Road. These buildings appear to have a cellar floors situated at roughly 1.5m below ground floor level.

Part of Camden Town Underground Station lies beneath the pavement immediately adjacent to the site.

The crown of the tunnel appears to lie at approximately +13m OD.


2.4 Proposed Development

It is proposed to construct a basement beneath the entire footprint of the building; which, along with the ground floor, will subsequently be occupied by retail space.


The proposed basement excavation will extend to approximately 4m (+22m OD) depth beneath the ground floor.



Location Plan

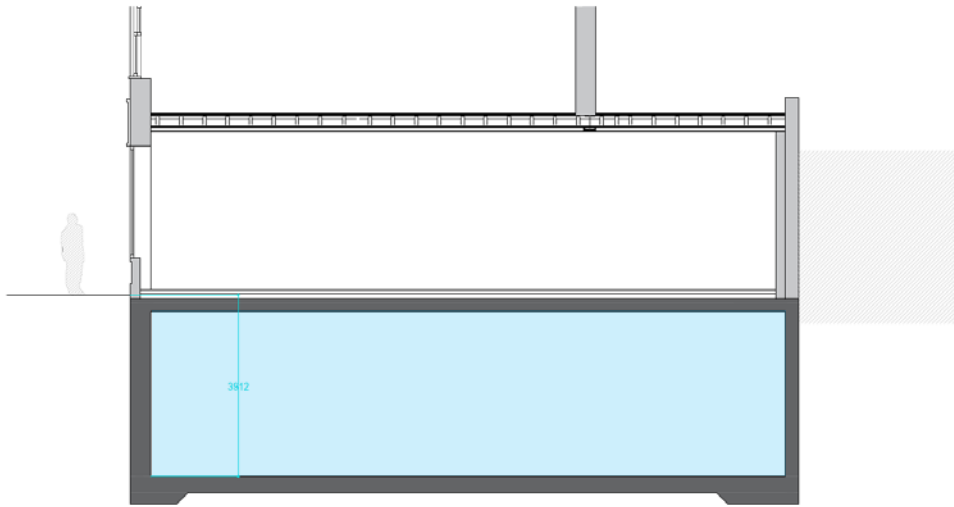

Section showing proposed basement (tinted pale blue)

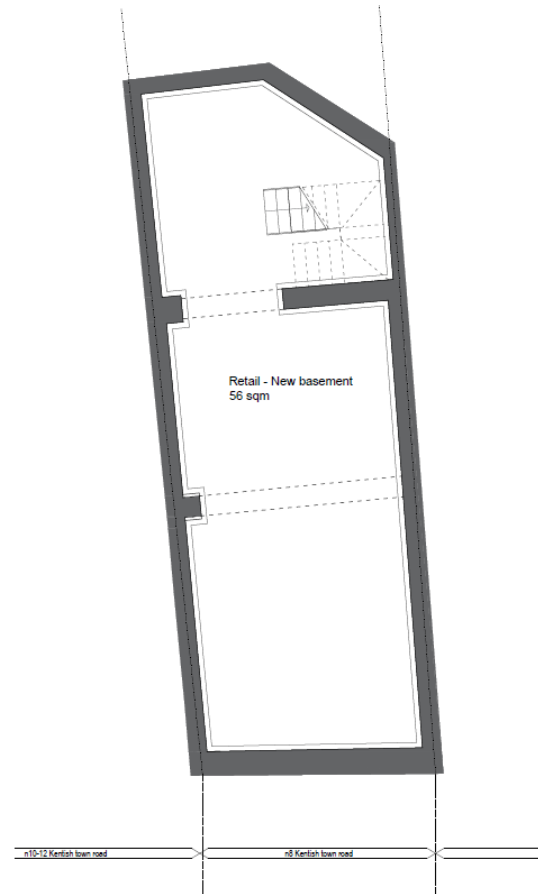

00 Basement floor plan

Plan showing proposed development

3. Desk Study

3.1 Site History

Earlier buildings on the site were demolished at the end of the 19th century and replaced by the existing row of terraced buildings. No. 8 Kentish Town Road was a three storey building that was occupied by a restaurant at ground level, with residential flats above. A single storey ground floor extension was located to the rear of the building.

At a similar time, although probably slightly earlier, the existing row of three storey terraced buildings that front onto Camden Road was also built.

The site and surrounding area has remained relatively unchanged since the early 1900s; however, in recent years, planning permission was granted to construct the existing mansard roof at No. 8 Kentish Town Road to provide additional residential accommodation.

3.2 Geological Information

The British Geological Survey (BGS) records indicate that the site is underlain by the London Clay Formation.

3.3 Hydrogeological Information

The London Clay Formation may be considered virtually impermeable; hence no significant groundwater flow is expected to occur beneath the site.

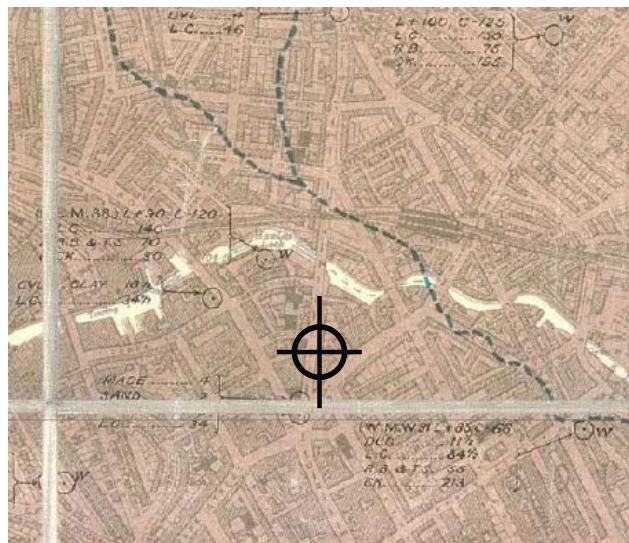


Figure 2: Camden 1920 Geological Map (CGHHS, 2010)
(dashed blue line shows the River Fleet)

3.4 Hydrological, Drainage and Flood Risk Information

Figure 2 of the CGHHS indicates that the River Fleet passes approximately 200m to the northeast of the site. There are no surface water features in the vicinity of the site.

The existing building occupies the entirety of the site.

Rainfall incident on the roof is collected via pipework down the rear side of building, where it then discharges to a combined sewer that is indicated to run along the rear of the property.

Environment Agency (EA) surface water flood maps indicate that the site is at a very low risk of surface water flooding. However, according to the Flood in Camden 2003 report, Kentish Town Road is reported to have flooded in 1975.

Figure 6 of the Camden SFRA indicates that the site lies within a Critical Drainage Area (Group 3 003).

4. Screening & Scoping Assessments

The Screening & Scoping Assessments have been undertaken with reference to Appendices E and F of the CGHSS, which is a process for determining whether or not a BIA is usually required.

4.1 Screening Assessment

The Screening Assessment consists of a series of checklists that identifies any matters of concern relating to the following:

- Subterranean (groundwater) flow
- Surface flow and flooding
- Slope stability

4.1.1 Screening Checklist for Subterranean (Groundwater) Flow

Question	Response	Justification
Is the site is located directly above an aquifer?	No	The site is underlain by London Clay
Will the proposed basement extend beneath the water table surface?	No	No shallow groundwater is present beneath the site.
Is the site within 100m of a watercourse, well (used/disused) or potential spring line?	No	The nearest watercourse is the culverted River Fleet, approximately 200m to the northeast of the site.
Is the site within the catchment of the pond chains on Hampstead Heath?	No	See CGHHS Fig.14.
Will the proposed development result in a change in the area of hard-surfaced/paved areas?	No	Both the existing site and proposed development are entirely hard surfaced.
Will more surface water (e.g. rainfall and run-off) than at present will be discharged to the ground (e.g. via soakaways and/or SUDS)?	No	All surface water falling within the development will be attenuated and discharged to the Thames Water combined sewer.
Is the lowest point of the proposed excavation (allowing for any drainage and foundation space under the basement floor) close to or lower than the mean water level in any local pond?	No	See CGHHS Fig.12.

4.1.2 Screening Checklist for Surface Flow and Flooding

Question	Response	Justification
Is the site within the catchment area of the pond chains on Hampstead Heath?	No	See CGHHS Fig.14.
As part of the site drainage, will surface water flows (e.g. rainfall and run-off) be materially changed from the existing route?	No	The existing drainage arrangement will be maintained.
Will the proposed basement development result in a change in the proportion of hard-surfaced/paved areas?	No	Both the existing site and proposed development are entirely hard surfaced.
Will the proposed basement result in changes to the profile of the inflows (instantaneous and long-term) of surface-water being received by adjacent properties or downstream watercourses?	No	The existing drainage arrangement will be maintained.
Will the proposed basement result in changes to the quality of surface water being received by adjacent properties or downstream watercourses?	No	The existing drainage arrangement will be maintained.
Is the site in an area known to be at risk from surface water flooding, or is it at risk from flooding for example because the proposed basement is below the static water level of a nearby surface water feature?	Yes	Kentish Town Road is reported to have flooded in 1975

4.1.3 Screening Checklist for Stability

Question	Response	Justification
Does the existing site include slopes, natural or manmade, greater than 7 degrees?	No	There are no slopes greater than 7 degrees within the site.
Does the proposed re-profiling of landscaping at the site change slopes at the property boundary to more than 7 degrees?	No	No re-profiling is planned at the site.
Does the development neighbour land, including railway cuttings and the like, with a slope greater than 7 degrees?	No	There are no slopes greater than 7 degrees within the development land.
Is the site within a wider hillside setting in which the general slope is greater than 7 degrees?	No	Figure 6 of the CGHHS indicates that the general slope of the wider hillside is less than 7 degrees.

Is London Clay the shallowest strata at the site?	Yes	The site is underlain by London Clay
Will trees be felled as part of the proposed development and/or are works proposed within tree protection zones where trees are to be retained?	No	There are no trees on the site.
Is there a history of seasonal shrink-swell subsidence in the local area, and/or evidence of such effects at the site?	No	
Is the site within 100m of a watercourse of a potential spring line?	No	The nearest watercourse is the culverted River Fleet, roughly 200m to the northeast of the site.
Is the site within an area of previously worked ground?	No	The British Geological Survey (BGS) records do not indicate that the site lies within an area of previously worked ground.
Is the site within an aquifer?	No	The site is underlain by London Clay
Will the proposed basement extend beneath the water table such that dewatering may be required during construction?	No	No shallow groundwater is present beneath the site.
Is the site within 50m of the Hampstead Heath ponds?	No	See CGHHS Fig.14.
Is the site within 5m of a highway or pedestrian right of way?	Yes	The proposed basement adjoins the pavement
Will the proposed basement significantly increase the differential depth of foundations relative to the neighbouring properties?	Yes	The proposed basement will increase the differential depth to foundations to Nos. 6 and 10-12 Kentish Town Road and Nos. 3a and 5 Camden Road.
Is the site over (or within the exclusion zone of) tunnels, e.g. railway lines?	Yes	The LUL Northern Line runs beneath the pavement to Kentish Town Road adjacent to the site.

4.2 Scoping Assessment

Where the checklist is answered with a “yes” or “unknown” to any of the questions posed in the flowcharts, these matters are carried forward to the scoping stage of the BIA process.

The scoping produces a statement which defines further the matters of concern identified in the screening stage. This defining should be in terms of ground processes, in order that a site specific BIA can be designed and executed (Section 6.3 of the CGHHS).

4.2.1 Scoping for Surface Flow and Flooding

- **Is the site in an area known to be at risk from surface water flooding, or is it at risk from flooding for example because the proposed basement is below the static water level of nearby surface water feature?**

The guidance advises that a Flood Risk Assessment is required.

4.2.2 Scoping for Stability

- **Is the London Clay the shallowest strata at the site?**

The guidance advises that of the at-surface soil strata present in LB Camden, the London Clay is the most prone to seasonal shrink-swell (subsidence and heave).

- **Is the site within 5m of a highway or pedestrian right of way?**

The guidance advises that excavation for a basement may result in damage to the road, pathway or any underground services buried in trenches beneath the road or pathway.

- **Will the proposed basement significantly increase the differential depth of foundations relative to neighbouring properties?**

The guidance advises that excavation for a basement may result in structural damage to neighbouring properties if there is a significant differential depth between adjacent foundations.

- **Is the site over (or within the exclusion zone of) any tunnels, e.g. railway lines?**

The guidance advises that excavation for a basement may result in damage to the tunnel.

5. Site Investigation

An intrusive site investigation, comprising a small diameter percussive borehole and hand excavated trial pits, was carried out in May 2018.

The site plan to the right indicates the approximate positions of the exploratory positions, while the associated factual site investigation report is appended.

5.1 Ground Conditions

The ground investigation confirms that the site is underlain by made ground overlying the London Clay Formation.

5.2 Made Ground


Made ground is present to approximately 0.5m depth and generally comprises dirty brown sandy gravelly clayey fill.

5.3 London Clay Formation

The London Clay underlies the made ground and consists of typical firm, becoming stiff, pale brown fissured silty clay.

5.4 Groundwater

A shallow groundwater table is not present beneath the site.

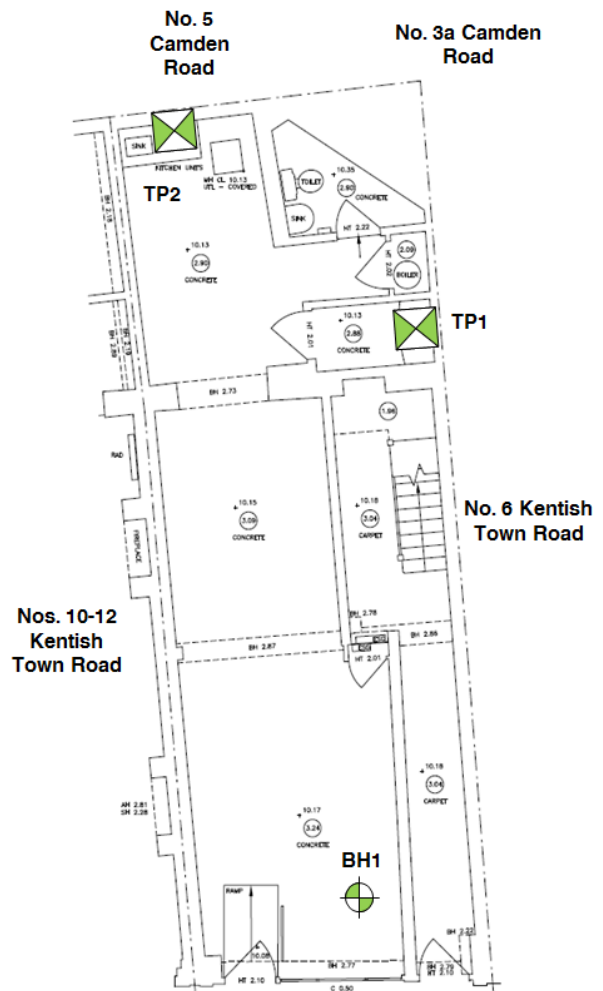

6. Outline Basement Construction Methodology

6.1 Summary

The following outline methodology and sequence of works should be varied by the basement contractor or the structural engineer only by agreement with the basement design engineer and should be incorporated into the engineer's construction design and the contractor's method statements.

6.2 Methodology

The basement excavation will extend down into the London Clay Formation.

In the absence of any substantial groundwater inflows into the basement excavation, the basement perimeter walls will be formed by conventional underpinning and the construction of L-shaped reinforced cast in-situ concrete segments excavated and cast around the site in a 'hit and miss' sequence of 1m wide sections.

The depth of underpinning will be around 3m and a single stage of underpinning will therefore be used.

During the works, temporary propping will be utilised in order to ensure that lateral ground movements are minimised.

An upper row of props will be installed across the site between the newly underpinned walls prior to the main basement excavation, within trenches set at around 1m depth below ground level.

Initial excavation of the main basement area will then be undertaken by means of a series of discrete trenches, to allow the installation of a second row of low level props.

In the permanent situation the reinforced concrete underpins connected to the reinforced concrete floorslab will combine to form a rigid concrete box to support the vertical structural loading of the overlying building. Both the basement raft slab and the ground floor slab will act as props.

6.3 Site Set-Up

The site set-up will be detailed within the Construction Management Plan (CMP), which will also set out the traffic management measures for agreement with the council.

A skip will be placed to the front of the property with the siting of a compressor and materials in the same location. Hoarding will be erected around the skip and materials to ensure the protection of passers-by.

A conveyor belt will be installed initially sited towards the front of the property. A local excavation will be extended down in the central area of the site to allow the installation of the conveyor belt. The conveyor will extend up to feed the skip at ground level.

Spoil will be wheel barrowed from the excavation faces to the base of the conveyor belt. Spoil will be removed via the conveyor belt and deposited into the skip. The skip will be emptied using a grab lorry when it is full, or alternatively the skip will be exchanged.

6.4 Underpinning

The walls to the perimeter of the new basement will be wholly underpinned in reinforced concrete. During their construction the walls and bases will be propped in the temporary condition against an unexcavated dumping of soil left in the central area of the site.

Underpinning sections will be excavated in short widths not exceeding 1000mm.

The sequence of the underpinning will be in an extended 1, 3, 5, 2, 4 & 6 type numbering sequence, such that any given underpin will be completed, dry packed, and a minimum period of 48 hours lapsed before and adjacent excavation is commenced to form another underpin.

In the event that the existing foundations to the wall are found to be unstable, sacrificial steel jacks will be installed underneath the existing foundation to prop the bottom few courses of bricks. These steel jacks will be left in place and will be incorporated into the concrete.

Each pin excavation will be undertaken only under the direct supervision of a suitably experienced and competent person. In the event that the vertical soil face to an underpin is judged to be potentially unstable, face support and lateral propping will be provided as required, using perforated plywood shutter sheeting supported by temporary walings and adjustable steel trench "acrow" props.

Where such sheeting is installed, great care will be taken to ensure that the concrete can flow through and fill any voids behind the shuttering. Any propping installed will be sacrificial and become part of the permanent works.

Subject to the requirements of the CMP, ready mixed concrete will be delivered to site and will be chuted into a catchment area within the excavated basement and placed by wheelbarrow or alternatively will be pumped.

Excavation for an underpin section will be excavated in a day, and the concrete to the base section of the underpin will be poured by the end of the same day. The concrete to the stem of the underpin will be poured the following day. This will be poured up to within 50-75mm of the underside of the existing wall foundations.

On the following day, the gap between the concrete and the underside of the existing foundation will be dry packed with a rammed mixture of sharp sand and cement (ratio 3:1).

Two levels of temporary laterally propping of the new stem section will then be installed and maintained until the basement floor slab and the ground floor slab are cast and cured.

Once the dry pack has gained sufficient strength, any protrusions of the original footing into the site will be carefully trimmed back using hand tools to be flush with the face of the stem wall.

A minimum of 48 hours will be allowed before adjacent sections will be excavated to form a new underpin.

Adjacent underpins will be connected using B12 steel dowel bars 600mm long with 300mm embedment each side, at 200mm vertical centres.

6.5 Construction Sequence

1. Carry out excavation of initial pin (#1) to 200mm above base of existing foundations.
2. Excavate a shaft beneath the existing foundations to a depth of approx. 3.0m beneath foundations, ensuring the shaft is fully supported and propped to the full depth of the shaft.
3. Continue underpinning of perimeter walls in specified sequence until completed.

4. Install high level propping to underpinning in shallow trenches
5. Install low level propping to underpinning in deep trenches.
6. Main Basement Bulk excavation to be progressed down to the basement slab formation level.
7. The below-slab drainage for foul and ground water, sumps and pumps will be installed.
8. Slab reinforcement placed and basement slab cast.
9. Ground floor slab cast
10. Temporary propping removed.
11. Basement liner walls, membranes, cavity drainage, insulation and screeds to be installed.

6.6 Monitoring

A structural survey and monitoring scheme will be agreed with the Party Wall Surveyors and with London Underground.

7. Ground Movement to Neighbouring Properties

Camden Council seeks to ensure that harm will not be caused to neighbouring properties by basement development.

Camden Local Plan (June 2017) states that the BIA must demonstrate that the proposed basement scheme has a risk of damage to the neighbouring properties no higher than Burland Scale 1 'Very Slight'.

Assessment of any potential impact upon the London Underground Ltd (LUL) assets beneath Kentish Town Road are being addressed separately and directly with LUL.

7.1 Structures Assessed for Ground Movement

7.1.1 No. 6 Kentish Town Road

No. 6 Kentish Town Road is a four storey terraced building that adjoins the site to the south.

This building comprises a basement beneath the full extent of the building. Structural drawings indicate that the party wall to No. 6 Kentish Town Road is supported by strip foundations situated at approximately 2.5m depth below ground floor level.

7.1.2 Nos. 10 – 12 Kentish Town Road

Nos. 10-12 Kentish Town Road is a part two, part three storey terraced building that adjoins the site to the north.

For the purpose of this assessment, it is assumed that the party wall to Nos. 10-12 Kentish Town Road is supported by strip foundations situated at approximately 1m depth below ground floor level.

7.1.3 Nos. 3a and 5 Camden Road

Nos 3a and 5 Camden Road are part of a three storey terraced building including a cellar, which adjoins the site to the east

The party walls to these buildings are supported by strip foundations situated at approximately 1.8m depth below ground floor level.

7.2 Modelled Ground Conditions

Excavation of the basement will result in unloading of the clay leading to theoretical heave movement of the underlying soil in both the short and long term, depending upon the reapplication of loading.

Therefore, an analysis of the vertical movements has been carried out for a modelled situation, based on a soil model devised from the results of the ground investigation, together with published information on the London Clay Formation.

The soil model used for the analysis is detailed in the table below:

Stratum:	Upper Boundary Level	Undrained Shear Strength C_u (kN/m²)	Undrained Elastic Modulus E_u (kN/m²)	Drained Elastic Modulus E' (kN/m²)
London Clay Formation	Proposed new excavation level	70kN/m ² increasing linearly to 310kN/m ² at 30m depth	52,500kN/m ² increasing linearly to 232,500kN/m ² at 30m depth	35,000 kN/m ² increasing linearly to 155,000kN/m ² at 30m depth

Poisson's Ratios of 0.5 and 0.2 have been used for short term (undrained) and long term (drained) conditions respectively.

Based on the above parameters and loading/unloading and ignoring any benefit gained from the loading of previous buildings on site, the potential vertical displacements and the post construction movements have been analysed.

The analysis uses classic modified Boussinesq elastic theory, assuming a fully flexible foundation applying a uniform loading/unloading to a semi-infinite elastic half-space, using the above parameters for stratified homogeneity and with the introduction of an assumed rigid boundary at approximately 30m depth.

The programme calculates the theoretical Boussinesq elastic stress increase/decrease due to the applied net loadings/unloadings (over the given loaded/unloaded areas) at the mid-level of each stratum.

Short-term and long-term displacements are then calculated at each calculation point for each stratum, using the given values of Stiffness Moduli and Poisson's Ratio of the whole area of the site on a 1m calculation grid.

7.3 Short Term Movements

There are two components of short term movement that will interact to affect the neighbouring structure.

These components are ground movements associated with underpinning of the party walls and the theoretical elastic heave movements due to excavation of the basement.

7.3.1 Underpinning

It is not possible to model the party wall settlement arising from the proposed conventional underpinning. Experience indicates that potential movements are very much dependent on workmanship.

It is suggested that given dry conditions and good workmanship, the amount of vertical movement of the party walls can be expected to be approximately 5mm per stage of underpinning.

Therefore, as one stage of underpinning will be utilised for both party walls to Nos. 6 and 10-12 Kentish Town and No. 5 Camden Road, around 5mm of vertical movement can be expected at each party wall.

The subsequent ground horizontal movements that may occur due to yielding of the underpinning wall during the basement excavation may also be estimated. As a first approximation, the magnitude of the horizontal movement is assumed to be equal to the vertical movement of the party wall.

As a result, up to 5mm of horizontal movement can be expected at the party walls to Nos. 6 and 10-12 Kentish Town Road and No. 5 Camden Road. These horizontal movements are assumed to decrease perpendicular from the underpinned wall on the basis of an assumed plane drawn upwards at an angle of 45° from the base of the excavation.

7.3.2 Excavation

It is envisaged that the basement excavation will extend to approximately 4m depth beneath the existing ground floor level.


As a result, the potential effect of the excavation may be considered by a net unloading of -76kN/m^2 due to soil unloading.

Approximately 5mm of short term soil heave is predicted at the centre of the basement excavation, reducing to less than 5mm beneath the party walls to Nos. 6 and 10-12 Kentish Town Road and No. 5 Camden Road.

7.3.3 Post Construction Movements

As a result of the basement excavation, there will be a residual mismatch between the weight of soil that is to be removed and the weight of the new structure that is to replace it. In this situation, a component of long term heave that could proceed for decades is inevitable.

In order to consider a worst case long term heave scenario, the new structural loading has not been included in the modelled analysis.

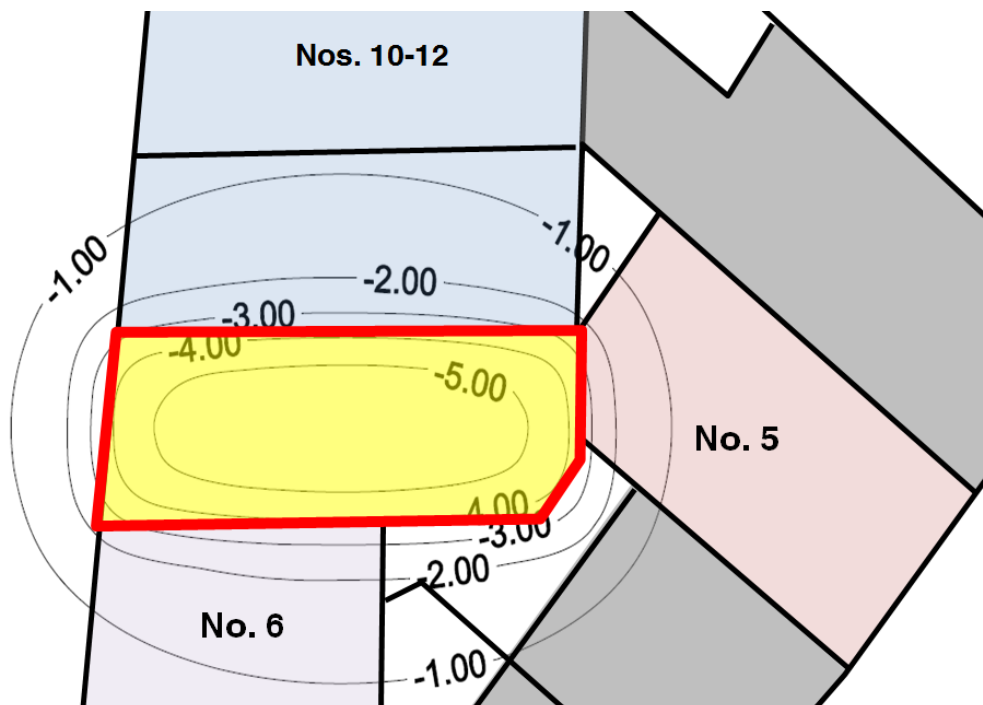

Plan showing theoretical approximate post-construction heave (mm) due to basement excavation (yellow colour)


The results of heave analysis, as presented on the plan shown above, suggest that the scale of this additional long term heave will amount to approximately 5mm beneath the centre of the basement,

decreasing to less than 5mm beneath the party walls to Nos. 6 and 10-12 Kentish Town Road and No. 5 Camden Road.

7.4 Impact on Neighbouring Structures

In view of the potential party wall movements described in the previous section, regardless of actual movements of the surrounding ground, the settlements affecting the party walls to Nos. 6 and 10-12 Kentish Town Road and No. 5 Camden Road could potentially reach approximately 5mm.

The deflections predicted in the previous section have been used in combination with the Burland damage assessment process that is based upon consideration of the theoretical deflection ratio that would be experienced by a masonry panel of a given height and length. The potential degree of damage due to the proposed basement excavation and construction has been assessed for each neighbouring property.

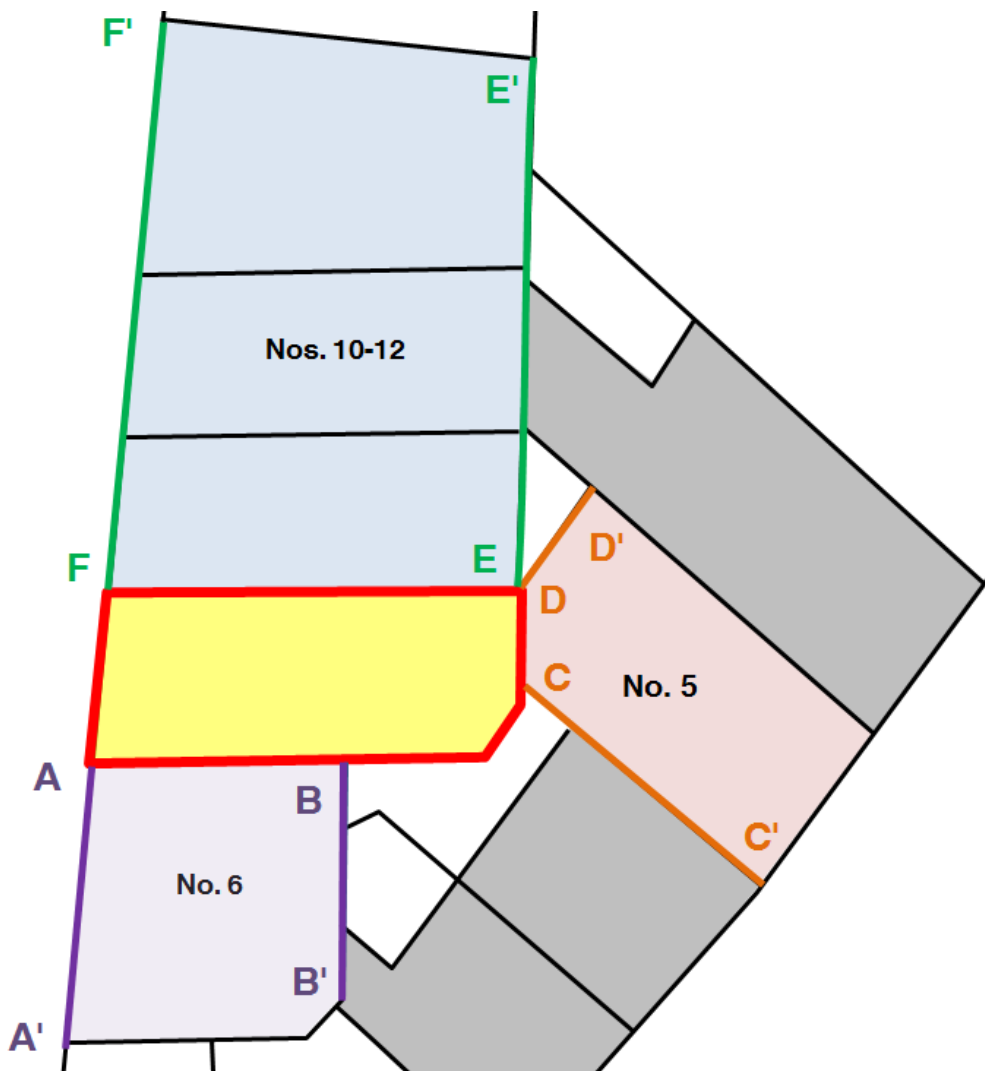

Plan showing line of sections used for damage category assessment
(yellow colour indicates basement extent)

7.4.1 No. 6 Kentish Town Road – Long Party Wall Section (Section A-A')

The length of section is taken as 9m and the wall height as 12m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.055%, producing a maximum deflection ratio $\Delta / L = -0.007$, within a limiting tensile strain of 0.06%, for a Burland Category 1 "Very Slight" condition.

7.4.2 No. 6 Kentish Town Road – Short Party Wall Section (Section B-B')

The length of section is taken as 8m and the wall height as 12m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.063%, producing a maximum deflection ratio $\Delta / L = -0.01$, within a limiting tensile strain of 0.065%, for a Burland Category 1 "Very Slight" condition.

7.4.3 No. 5 Camden Road – Long Party Wall Section (Section C-C')

The length of section is taken as 10m and the wall height as 10m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.05%, producing a maximum deflection ratio $\Delta / L = -0.006$, within a limiting tensile strain of 0.055%, for a Burland Category 1 "Very Slight" condition.

7.4.4 No. 5 Camden Road – Short Party Wall Section (Section D-D')

The length of section is taken as 4m and the wall height as 10m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.068%, producing a maximum deflection ratio $\Delta / L = -0.025$, within a limiting tensile strain of 0.075%, for a Burland Category 1 "Very Slight" condition.

7.4.5 Nos. 10-12 Kentish Town Road – Two Storey Section (Section E-E')

The length of section is taken as 17m and the wall height as 6m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.029%, producing a maximum deflection ratio $\Delta / L = -0.001$, within a limiting tensile strain of 0.03%, for a Burland Category 0 "Negligible" condition.

7.4.6 Nos. 10-12 Kentish Town Road – Three Storey Section (Section F-F')

The length of section is taken as 18m and the wall height as 9m.

The maximum horizontal strain, $\delta h (L)$ is assessed as 0.027%, producing a maximum deflection ratio $\Delta / L = -0.001$, within a limiting tensile strain of 0.03%, for a Burland Category 0 "Negligible" condition.

8. Impact Assessment

The screening and scoping stages identified potential aspects of the geological, hydrogeological and hydrological environment that could lead to the development having an unacceptable impact. This stage is concerned with evaluating the direct and indirect implications of each of these potential impacts.

8.1 Potential Hydrogeological Impacts

No groundwater table is present at the site therefore, the development is not expected to have any impact upon groundwater flow and there is additionally expected to be no cumulative impact.

8.2 Potential Hydrological Impacts

There will be no change to the flood risk at the site or at neighbouring sites as a result of the proposed basement. A Flood Risk Assessment (FRA) & SUDS Statement is presented as a separate report (LBH4535fra Ver. 1.0).

8.3 Potential Stability Impacts

8.3.1 Public Highway

The proposed basement lies directly adjacent to the pavement and there are various buried utilities located in this area. However, given normal standards of workmanship no adverse impact is expected to occur and in order to ensure the integrity both the pavement and any underlying buried services, a structural monitoring scheme will be instigated to provide an early warning of any movements and to allow the timely application of mitigation measures to prevent any unacceptable movements.

8.3.2 London Clay

The London Clay soils beneath the site are suggested to be of high volume change potential.

However, the depth of the proposed construction will obviate concerns regarding potential seasonal movement.

8.3.3 Tunnels

An Asset Impact Assessment is currently being prepared to ensure that the proposed scheme will not adversely impact the underlying LUL northern line tunnel.

8.3.4 Ground Movements

The predicted building damage levels resulting from ground movements associated with the proposed development have been analysed and found to be acceptable.

Nevertheless, a structural monitoring scheme will be instigated to provide an early warning of any movements and to allow the timely application of mitigation measures to prevent any unacceptable movements.

8.4 Residual Impacts

It is concluded that the proposed basement will have no residual unacceptable impacts upon the surrounding structures, infrastructure and environment. No cumulative impacts are envisaged.

9. Conclusion

No adverse residual or cumulative stability, hydrological or hydrogeological impacts are expected as a result of this development.

It is concluded that the proposed development will not cause harm to its neighbours or the wider environment and it has been demonstrated to comply with the requirements of Camden Local Plan Policy A5 in terms of protection of the local structural, hydrological and hydrogeological environment.