



















WALLS:	
	EXISTING WALLS & COLUMNS
	NEW PARTITIONS & WALL LININGS 122mm o/a / 70mm 'C' stud (unless specified)
	NEW PARTITIONS & WALL LININGS full height to u/s structural slab 146mm Gyproc 'C' studs
CEILING FINISHES:	
	LAY IN CEILING GRID new fitted lay in ceiling grid to pret standard nuts & bolts specification
	MF PLASTERBOARD CEILING painted: dulux trade white
note: • structural slab height to main shop from mezzanine level @ 2730mm aff	
void heights: • mezzanine lay-in grid ceiling 530mm	
MEANS OF ESCAPE:	
	ESCAPE ROUTE TRAVEL DISTANCES direction indicated from furthest travel distance point within unit to main fire exit means of escape.
FIRE DOORS:	
	FD30 (S) FIRE DOOR 30 minute fire rated solid core door with cold smoke seals & intumescent strips
	FD60 (S) FIRE DOOR 60 minute fire rated solid core door with cold smoke seals & intumescent strips
EMERGENCY LIGHTING: emergency lighting design to comply with BS 5266 all switching to comply with lighting design guide	
	05no. TYPE E RECESSED EMERGENCY LED cat no. SPLDEE3/105/E3/WH+L Stand alone recessed LED emergency downlight 105 degree beam complete with 3 hour emergency
	02no. TYPE tbc SURFACE MOUNTED EMERGENCY LED cat no. 98155 Stand alone surface mounted LED emergency downlight 105 degree beam complete with 3 hour emergency
SPRINKLERS:	
refer to Select Fire Services sprinkler drawings 14984-00M-01_B & 14984-00-01_B	

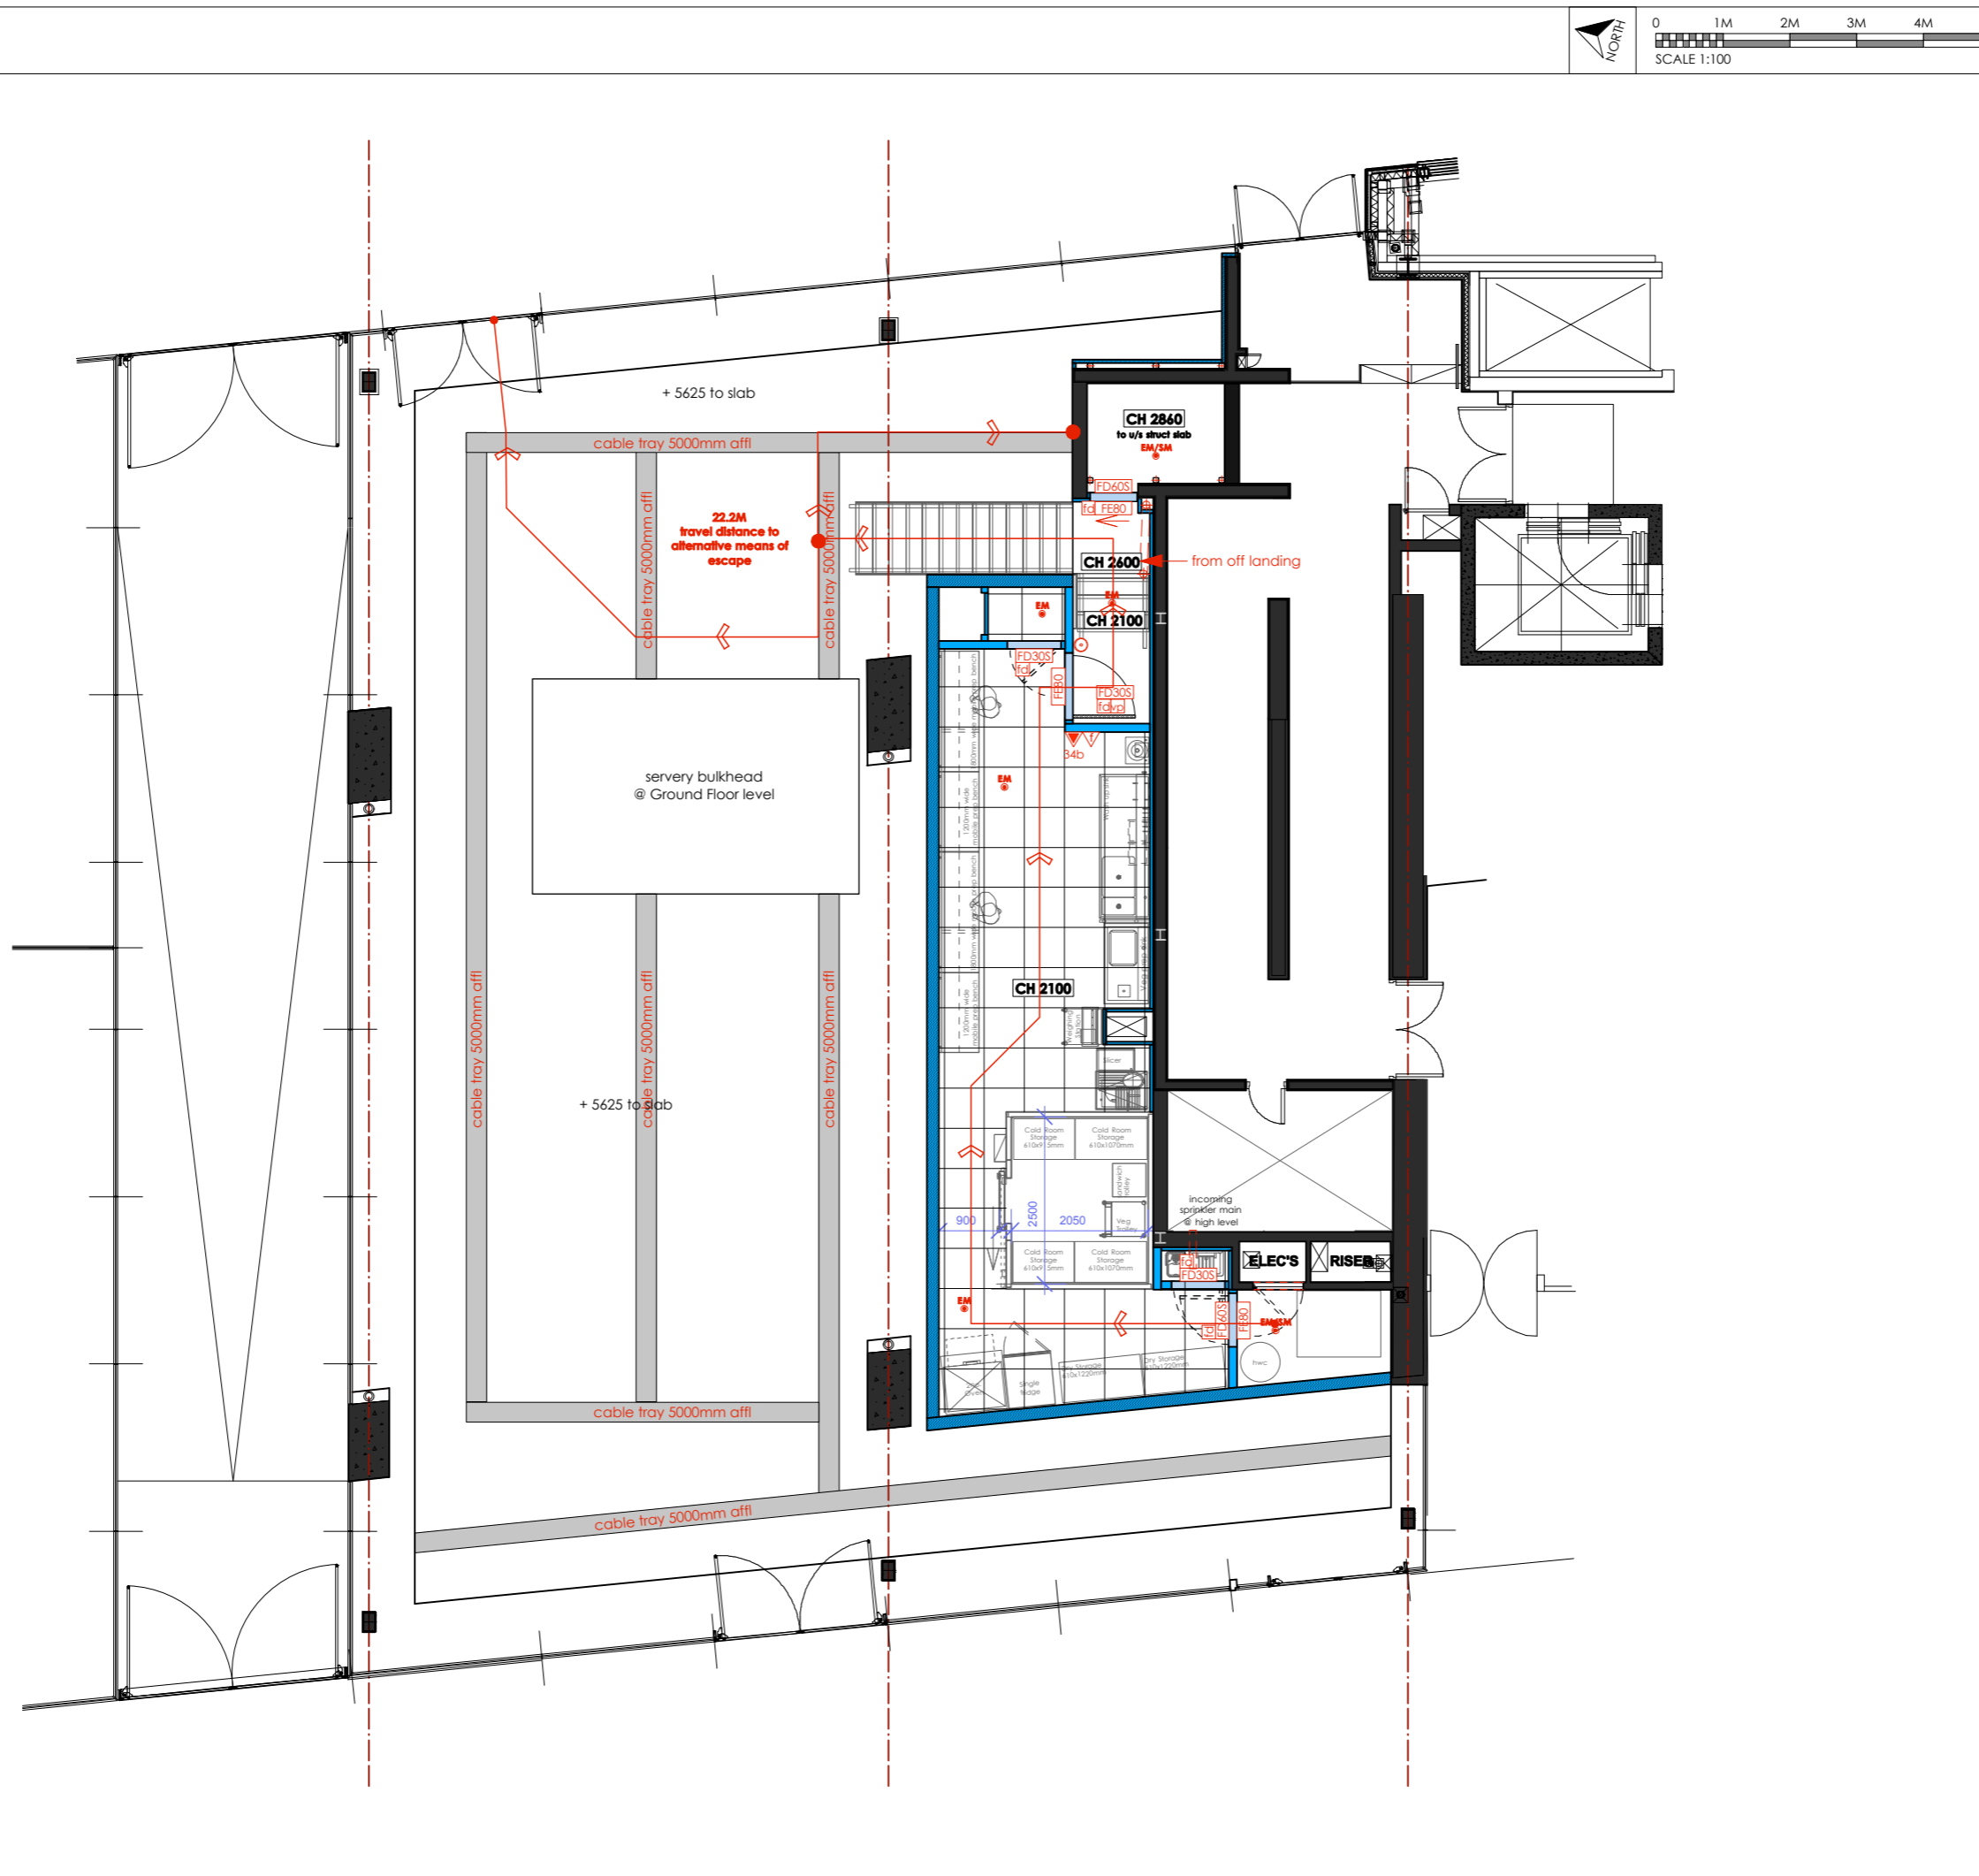

FIRE SIGNAGE exit signage to comply with BS 5499 part 1			
	04no. FIRE EXIT SIGN - sticker only fire exit sign with 80mm high letters with green running man legend arrow to suit direction of escape.		
	05no. NEW NOTICE FIRE DOOR KEEP SHUT		
	01no. VISION PANEL FITTED TO NEW DOOR		
FIRE & EMERGENCY fire alarm design to BS 5839 L1			
	01no. NEW MANUAL CALLPOINT break glass callpoint cerberus fdm2255-rp resettable with signage to meet building regulations		
	01no. NEW FOAM EXTINGUISHER NOTE: Fire extinguishers to be chrome on chrome stands not to be affixed directly to brickwork		
	01no. NEW CO2 EXTINGUISHER NOTE: Fire extinguishers to be chrome on chrome stands not to be affixed directly to brickwork		
NOTE: for smoke detector & sounder layouts, refer to Senseco drawing			
Rev:	Date:	By:	Description:
A	15.03.18	LW	call point location revised
B	25.05.18	LW	door specification of kitchen door revised to FD30s
C	05.07.18	LW	HVAC riser duct added to Refuse Store and dividing wall shown with access panel
PROJECT ★ PRET A MANGER ★			
LOCATION			
TITLE FIRE STRATEGY PLAN MEZZANINE			
DRAWING No. 1562-PRET-11.2			
REVISION	DATE DRAWN	SCALE @ A3	
C	06.03.17	1:100	
All dimensions to be confirmed on site by Contractor. Structural works to be confirmed by Structural Engineer. All elements to comply with statutory requirements.			
Copyright One Red Wall Ltd Claremont House, 22-24 Claremont Rd, Surbiton, Surrey, KT6 4QU. tel. 020 83993237 www.oneredwall.com			
