

Air Conditioning
Technical Data

RZAG-MY1



TABLE OF CONTENTS

RZAG-MY1

1	Features	2
2	Specifications	3
	Capacity and Power input	3
	Capacity and Power input	3
	Capacity and Power input	3
	Capacity and Power input	4
	Capacity and Power input	4
	Capacity and Power input	5
	Capacity and Power input	5
	Technical Specifications	5
	Electrical Specifications	7
3	Electrical data	8
4	Options	11
5	Combination table	12
6	Capacity tables	13
	Cooling/Heating Capacity Tables	13
7	Dimensional drawings	15
8	Centre of gravity	16
9	Piping diagrams	18
	Piping Diagrams	18
	Piping Diagram Twin Application	19
	Piping Diagram Triple Application	20
	Piping Diagram Double Twin Application	21
10	Wiring diagrams	22
	Wiring Diagrams - Three Phase	22
11	Sound data	23
	Sound Power Spectrum	23
	Sound Pressure Spectrum - Cooling	25
	Sound Pressure Spectrum - Heating	27
	Sound Pressure Spectrum Quiet Mode	29
12	Installation	30
	Installation Method	30
13	Operation range	32

1 Features

Industry leading technology for commercial applications and even for technical rooms

- Top efficiency: - Energy labels up to A++ in both cooling and heating - compressor offers substantial efficiency improvements
- Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A, leads directly to lower energy consumption thanks to its high energy efficiency and has a lower refrigerant charge
- The perfect balance in efficiency and comfort thanks to Variable Refrigerant Temperature: top seasonal efficiency throughout most of the year and quick reaction speed on the hottest days.
- Suits high sensible, infrastructure cooling applications
- Replace existing systems with R-32 technology without needing to replace the piping
- Guarantees operation in both heating and cooling mode down to -20°C
- Refrigerant cooled PCB guarantees reliable cooling, as it is not influenced by ambient temperature.
- Maximum piping length up to 85m
- Outdoor units for pair, twin, triple, double twin application



Infrastructure cooling



Inverter



Auto cooling-heating changeover

2 Specifications

2-1 Capacity and Power input			FBA71A/ RZAG71MY1	FBA100A/ RZAG71MY1	FBA100A/ RZAG100MY1	FBA140A/ RZAG100MY1	FBA125A/ RZAG125MY1	FBA140A/ RZAG140MY1	
Indoor unit			FBA71A2VEB	FBA100A2VEB		FBA140A2VE B	FBA125A2VE B	FBA140A2VE B	
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B		RZAG125M7Y 1B	RZAG140M7Y 1B	
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class		A++	A+	A++		-	
		Pdesign	kW	6.80		9.50		12.1	13.4
		SEER		6.22	5.81	6.47	6.39	6.19	6.42
		Annual energy consumption	kWh	382	410	514	520	1,173	1,252
	Heating (Average climate)	Energy efficiency class		A+				-	
		Pdesign	kW	4.70		7.80		9.52	
		SCOP/A		4.20	4.06	4.36	4.20	4.12	4.11
		Annual energy consumption	kWh	1,566	1,621	2,505	2,600	3,235	3,243

Notes

(1) Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

2-2 Capacity and Power input			FCAHG100G/ RZAG71MY1	FCAHG71G/ RZAG71MY1	FCAHG140G/ RZAG100MY1	FCAHG100G/ RZAG100MY1	FCAHG125G/ RZAG125MY1	FCAHG140G/ RZAG140MY1		
Indoor unit			FCAHG100GV EB	FCAHG71GV EB	FCAHG140GV EB	FCAHG100GV EB	FCAHG125GV EB	FCAHG140GV EB		
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B		RZAG125M7Y 1B	RZAG140M7Y 1B		
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)		
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)		
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class		A++				-		
		Pdesign	kW	6.80		9.50		12.1	13.4	
		SEER		7.05	7.72	7.93	7.35	8.02	7.93	
		Annual energy consumption	kWh	338	308	419	452	905	1,014	
	Heating (Average climate)	Energy efficiency class		A+	A++				-	
		Pdesign	kW	4.70		7.80		9.52		
		SCOP/A		4.20	4.61	4.70	4.81	4.53	4.44	
		Annual energy consumption	kWh	1,567	1,427	2,836	2,771	2,942	3,002	

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

2-3 Capacity and Power input			FCAG100A/ RZAG71MY1	FCAG71A/ RZAG71MY1	FCAG140A/ RZAG100MY1	FCAG100A/ RZAG100MY1	FCAG125A/ RZAG125MY1	FCAG140A/ RZAG140MY1
Indoor unit			FCAG100AVE B	FCAG71AVEB	FCAG140AVE B	FCAG100AVE B	FCAG125AVE B	FCAG140AVE B
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B		RZAG125M7Y 1B	RZAG140M7Y 1B
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)

2 Specifications

2

2-3 Capacity and Power input			FCAG100A/ RZAG71MY1	FCAG71A/ RZAG71MY1	FCAG140A/ RZAG100MY1	FCAG100A/ RZAG100MY1	FCAG125A/ RZAG125MY1	FCAG140A/ RZAG140MY1		
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class	A++				-			
		Pdesign	kW		6.80		9.50		12.1	13.4
		SEER			7.50	6.86	7.86	7.14	7.80	7.17
		Annual energy consumption	kWh		317	347	423	466	931	1,121
	Heating (Average climate)	Energy efficiency class			A+		A++		-	
		Pdesign	kW		4.70		7.80		9.52	
		SCOP/A			4.45	4.41	4.66	4.61	4.34	
		Annual energy consumption	kWh		1,479	1,492	2,343	2,369	3,071	

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

2-4 Capacity and Power input			FHA100A/ RZAG71MY1	FHA140A/ RZAG100MY1	FHA71A/ RZAG71MY1	FHA100A/ RZAG100MY1	FHA125A/ RZAG125MY1	FHA140A/ RZAG140MY1		
Indoor unit			FHA100AVEB	FHA140AVEB	FHA71AVEB	FHA100AVEB	FHA125AVEB	FHA140AVEB		
Outdoor unit			RZAG71M7Y1 B	RZAG100M7Y 1B	RZAG71M7Y1 B	RZAG100M7Y 1B	RZAG125M7Y 1B	RZAG140M7Y 1B		
Cooling capacity	Nom.	kW	6.80 (1)	9.50 (1)	6.80 (1)	9.50 (1)	12.1 (1)	13.4 (1)		
Heating capacity	Nom.	kW	7.50 (2)	10.8 (2)	7.50 (2)	10.8 (2)	13.5 (2)	15.5 (2)		
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class	A++				-			
		Pdesign	kW		6.80	9.50	6.80	9.50	12.1	13.4
		SEER			6.69	8.24	7.11	6.42	8.22	6.42
		Annual energy consumption	kWh		356	404	335	518	883	1,252
	Heating (Average climate)	Energy efficiency class			A+	A++	A+	A++	-	
		Pdesign	kW		4.70	7.80	4.70	7.80	9.52	
		SCOP/A			4.26	4.64	4.32	4.61	4.09	4.30
		Annual energy consumption	kWh		1,545	2,353	1,523	2,369	3,259	3,100

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

2-5 Capacity and Power input			FUA100A/RZAG71MY1	FUA71A/RZAG71MY1	FUA100A/RZAG100MY1	FUA125A/RZAG125MY1		
Indoor unit			FUA100AVEB	FUA71AVEB	FUA100AVEB	FUA125AVEB		
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B	RZAG125M7Y1B		
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)	12.1 (1)		
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)	13.5 (2)		
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class	A++				-	
		Pdesign	kW		6.80		9.50	12.1
		SEER			6.89	7.02	6.42	6.39
		Annual energy consumption	kWh		345	339	518	1,136
	Heating (Average climate)	Energy efficiency class			A+		-	
		Pdesign	kW		4.70		7.80	9.52
		SCOP/A			4.28	4.20	4.50	4.26
		Annual energy consumption	kWh		1,537	1,567	2,427	3,129

2 Specifications

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.
 Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

2-6 Capacity and Power input			FAA100A/RZAG71MY1	FAA71A/RZAG71MY1	FAA100A/RZAG100MY1	
Indoor unit			FAA100AUVEB	FAA71AUVEB	FAA100AUVEB	
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B	
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)	
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)	
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class		A++		
		Pdesign	kW	6.80		9.50
		SEER		6.43	6.58	6.42
		Annual energy consumption	kWh	370	362	518
	Heating (Average climate)	Energy efficiency class		A+		
		Pdesign	kW	4.70		7.80
		SCOP/A		4.16	4.02	4.01
		Annual energy consumption	kWh	1,582	1,637	2,723

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.
 Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

2-7 Capacity and Power input			FVA100A/RZAG71MY1	FVA71A/RZAG71MY1	FVA100A/RZAG100MY1	FVA140A/RZAG100MY1	FVA125A/RZAG125MY1	FVA140A/RZAG140MY1	
Indoor unit			FVA100AMVE B	FVA71AMVEB	FVA100AMVE B	FVA140AMVE B	FVA125AMVE B	FVA140AMVE B	
Outdoor unit			RZAG71M7Y1B		RZAG100M7Y1B		RZAG125M7Y1B	RZAG140M7Y1B	
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Seasonal efficiency (according to EN14825)	Cooling	Energy efficiency class		A++		A+	A++	-	
		Pdesign	kW	6.80		9.50		12.1	13.4
		SEER		6.41	6.37	6.00	6.43	6.41	6.12
		Annual energy consumption	kWh	371	374	554	517	1,133	1,314
	Heating (Average climate)	Energy efficiency class		A+				-	
		Pdesign	kW	4.70		7.80		9.52	
		SCOP/A		4.05		4.20	4.05	4.15	3.94
		Annual energy consumption	kWh	1,625		2,600	2,697	3,209	3,383

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2-8 Technical Specifications		RZAG71MY1	RZAG100MY1	RZAG125MY1	RZAG140MY1
Capacity control	Method	Inverter controlled			
Casing	Colour	Ivory white			
	Material	Painted galvanized steel plate			

2 Specifications

2

2-8 Technical Specifications					RZAG71MY1	RZAG100MY1	RZAG125MY1	RZAG140MY1
Dimensions	Unit	Height	mm		990	1,430		
		Width	mm		940			
		Depth	mm		320			
	Packed unit	Height	mm		1,170	1,610		
		Width	mm		1,015			
		Depth	mm		422			
Weight	Unit		kg	70	92			
	Packed unit		kg	78	101			
Packing	Weight		kg	9	10			
Heat exchanger	Fin	Type			WF fin			
		Treatment			Anti-corrosion treatment (PE)			
Compressor	Quantity			1				
	Type			Hermetically sealed swing compressor				
	Starting method			Inverter driven				
Fan	Type			Propeller				
	Discharge direction			Horizontal				
	Quantity			1	2			
	Air flow rate	Cooling	Nom.	m ³ /min	59	70	83	
		Heating	Nom.	m ³ /min	50	62		
Fan motor	Quantity			1	2			
	Model			Brushless DC motor				
	Output		W	94				
	Drive			Direct drive				
	Speed	Cooling	Super low	rpm	-			
		Heating	Super low	rpm	-			
Sound power level	Cooling			dBA	65	66	69	70
	Heating			dBA	-			
Sound pressure level	Night quiet mode	Level 2		dBA	42	44		
	Cooling	Nom.		dBA	46	47	50	51
	Heating	Nom.		dBA	49	51	52	
Operation range	Cooling	Ambient	Min.	°CDB	-20			
			Max.	°CDB	52			
	Heating	Ambient	Min.	°CWB	-20			
			Max.	°CWB	18.0			
Refrigerant	Type			R-32				
	Charge		kg	2.95	3.75			
			TCO ₂ eq	1.99	2.53			
	Control			Expansion valve (electronic type)				
	GWP			675				
	Circuits	Quantity		1				

2 Specifications

2-8 Technical Specifications				RZAG71MY1	RZAG100MY1	RZAG125MY1	RZAG140MY1	
Piping connections	Liquid	Quantity		1				
		Type		Flare connection				
		OD	mm	9,52				
	Gas	Quantity		1				
		Type		Flare connection				
		OD	mm	15.9				
	Drain	Quantity		5				
		Type		Hole				
		ID	mm	-				
		OD	mm	26				
	Piping length	OU - IU	Min.	m	3			
			Max.	m	55	85		
		System	Equivalent	m	75	100		
			Chargeless	m	40			
Additional refrigerant charge			kg/m	See installation manual				
Level difference	IU - OU	Max.	m	30.0				
	IU - IU	Max.	m	0.5				
Heat insulation			Both liquid and gas pipes					
Refrigerant oil	Type			FW68DA				
	Charged volume		l	0.90	1.35			
Defrost method			Reversed cycle					
Defrost control			Sensor for outdoor heat exchanger temperature					
Safety devices	Item	01	High pressure switch					
		02	Low pressure switch					
		03	Fan driver overload protector					
		04	Fuse					
		05	Compressor motor thermal protector					

Standard Accessories : Tie-wraps; Quantity : 2;

Standard Accessories : Installation manual; Quantity : 1;

Standard Accessories : Refrigerant label for F-gas regulation; Quantity : 1;

Standard Accessories : General safety precautions; Quantity : 1;

Standard Accessories : LOT10 Energy Label; Quantity : 1;

2-9 Electrical Specifications				RZAG71MY1	RZAG100MY1	RZAG125MY1	RZAG140MY1
Power supply	Name		Y1				
	Phase		3~				
	Frequency	Hz	50				
	Voltage	V	380-415				
Current - 50Hz	Maximum fuse amps (MFA)	A	16				
Current	Zmax	List	Complies to EN61000-3-11				
	Minimum Ssc value	kVa	Equipment complying with EN / IEC 61000-3-2 / (1) / See note 3				
Current - 60Hz	Maximum fuse amps (MFA)	A	-				
Wiring connections	For power supply	Remark	See installation manual outdoor unit				
	For connection with indoor	Remark	See installation manual outdoor unit				
Power supply intake			See installation manual outdoor unit				

Notes

(1) Ssc: Short-circuit power

(2) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current larger than 16A and ≤ 75A per phase.

3 Electrical data

3 - 1 Electrical Data

3

AZAS-MV1

AZAS-MY1

RZAG-MV1

RZAG-MY1

RZASG-MV1

RZASG-MY1

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 - Cooling
 - Indoor temperature 27.0°C DB / 19.0°C WB
 - Outdoor temperature 35.0°C DB
 - Heating
 - Indoor temperature 20.0°C DB
 - Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 - The capacity of the MFA must be greater than that of the MCA.
 - Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D110014A

RZAG-MV1

RZAG-MY1

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 - Cooling
 - Indoor temperature 27.0°C DB / 19.0°C WB
 - Outdoor temperature 35.0°C DB
 - Heating
 - Indoor temperature 20.0°C DB
 - Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 - The capacity of the MFA must be greater than that of the MCA.
 - Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D110015A

8

3 Electrical data

3 - 1 Electrical Data

RZAG71-100MY1

Indoor	Outdoor	Power supply	Voltage range		MCA	TOCA	MFA	MSC	RLA	Compressor		OFM		IFM		
										kW	FLA	kW	FLA	kW	FLA	
FCAG71GVEB	RZAG71M7Y1B	3N- 50Hz 380-415V	Minimum: 342 V	Maximum: 456 V	10.9	--	16	--	9.2	0.094	0.8	0.091	0.5			
FCAG35AVEB	x2 RZAG71M7Y1B				11.0	--	16	--	9.2	0.094	0.8	0.044 x2	0.3 x2			
FCAG71AVEB	RZAG71M7Y1B				10.8	--	16	--	9.2	0.094	0.8	0.054	0.4			
FFA35A2VEB	x2 RZAG71M7Y1B				11.2	--	16	--	9.2	0.094	0.8	0.050 x2	0.4 x2			
FBA35A2VEB	x2 RZAG71M7Y1B				11.6	--	16	--	9.2	0.094	0.8	0.089 x2	0.6 x2			
FBA71A2VEB	RZAG71M7Y1B				10.9	--	16	--	9.2	0.094	0.8	0.070	0.5			
FNA35A2VEB	x2 RZAG71M7Y1B				10.7	--	16	--	9.2	0.094	0.8	0.034 x2	0.3			
FUA71AVEB	RZAG71M7Y1B				11.3	--	16	--	9.2	0.094	0.8	0.046	0.9			
FAA71AUVEB	RZAG71M7Y1B				10.8	--	16	--	9.2	0.094	0.8	0.048	0.4			
FVA71AMVEB	RZAG71M7Y1B				11.0	--	16	--	9.2	0.094	0.8	0.117	0.6			
FDXM35F3V1B	x2 RZAG71M7Y1B		11.0	--	16	--	9.2	0.094	0.8	0.034 x2	0.3 x2					
FHA35AVEB	x2 RZAG71M7Y1B		11.6	--	16	--	9.2	0.094	0.8	0.060 x2	0.6 x2					
FHA71AVEB	RZAG71M7Y1B		11.2	--	16	--	9.2	0.094	0.8	0.091	0.8					
FCAG71GVEB	RZAG100M7Y1B		3N- 50Hz 380-415V	Minimum: 342 V	Maximum: 456 V	15.4	--	16	--	12.0	0.094+0.094	0.75+0.75	0.221	1.3		
FCAG35AVEB	x3 RZAG100M7Y1B					12.9	--	16	--	10.0	0.094+0.094	0.75+0.75	0.044 x3	0.3 x3		
FCAG50AVEB	x2 RZAG100M7Y1B					13.6	--	16	--	11.0	0.094+0.094	0.75+0.75	0.039 x2	0.3 x2		
FCAG100AVEB	RZAG100M7Y1B					14.8	--	16	--	12.0	0.094+0.094	0.75+0.75	0.117	0.7		
FFA35A2VEB	x3 RZAG100M7Y1B					13.2	--	16	--	10.0	0.094+0.094	0.75+0.75	0.050 x3	0.4 x3		
FFA50A2VEB	x2 RZAG100M7Y1B					13.8	--	16	--	11.0	0.094+0.094	0.75+0.75	0.050 x2	0.4 x2		
FBA35A2VEB	x3 RZAG100M7Y1B					13.8	--	16	--	10.0	0.094+0.094	0.75+0.75	0.089 x3	0.6 x3		
FBA50A2VEB	x2 RZAG100M7Y1B	14.2				--	16	--	11.0	0.094+0.094	0.75+0.75	0.089 x2	0.6 x2			
FBA100A2VEB	RZAG100M7Y1B	15.1				--	16	--	12.0	0.094+0.094	0.75+0.75	0.127	1.0			
FBA35A2VEB	x3 RZAG100M7Y1B	12.9				--	16	--	10.0	0.094+0.094	0.75+0.75	0.034 x3	0.3 x3			
FNA50A2VEB	x2 RZAG100M7Y1B	14.0		--	16	--	11.0	0.094+0.094	0.75+0.75	0.060 x2	0.5 x2					
FUA100AVEB	RZAG100M7Y1B	15.4		--	16	--	12.0	0.094+0.094	0.75+0.75	0.106	1.3					
FAA100AUVEB	RZAG100M7Y1B	14.5		--	16	--	12.0	0.094+0.094	0.75+0.75	0.064	0.4					
FVA100AMVEB	RZAG100M7Y1B	15.3		--	16	--	12.0	0.094+0.094	0.75+0.75	0.238	1.2					
FDXM35F3V1B	x3 RZAG100M7Y1B	12.9		--	16	--	10.0	0.094+0.094	0.75+0.75	0.034 x3	0.3 x3					
FDXM50F3V1B	x2 RZAG100M7Y1B	14.0		--	16	--	11.0	0.094+0.094	0.75+0.75	0.060 x2	0.5 x2					
FHA35AVEB	x3 RZAG100M7Y1B	13.8		--	16	--	10.0	0.094+0.094	0.75+0.75	0.060 x3	0.6 x3					
FHA50AVEB	x2 RZAG100M7Y1B	14.2		--	16	--	11.0	0.094+0.094	0.75+0.75	0.060 x2	0.6 x2					
FHA100AVEB	RZAG100M7Y1B	15.4		--	16	--	12.0	0.094+0.094	0.75+0.75	0.150	1.3					

3D110014A

RZAG71-100MY1

Indoor	Outdoor	Power supply	Voltage range		MCA	TOCA	MFA	MSC	RLA	Compressor		OFM		IFM		
										kW	FLA	kW	FLA	kW	FLA	
FCAG71GVEB	RZAG71M7Y1B	3N- 50Hz 380-415V	Minimum: 342 V	Maximum: 456 V	11.8	--	16	--	9.2	0.094	0.8	0.221	1.3			
FCAG35AVEB	x3 RZAG71M7Y1B				11.3	--	16	--	9.2	0.094	0.8	0.044 x3	0.3 x3			
FCAG50AVEB	x2 RZAG71M7Y1B				11.0	--	16	--	9.2	0.094	0.8	0.039 x2	0.3 x2			
FCAG100AVEB	RZAG71M7Y1B				11.1	--	16	--	9.2	0.094	0.8	0.117	0.7			
FFA35A2VEB	x3 RZAG71M7Y1B				11.6	--	16	--	9.2	0.094	0.8	0.050 x3	0.4 x3			
FFA50A2VEB	x2 RZAG71M7Y1B				11.2	--	16	--	9.2	0.094	0.8	0.050 x2	0.4 x2			
FBA35A2VEB	x3 RZAG71M7Y1B				12.3	--	16	--	9.2	0.094	0.8	0.089 x3	0.6 x3			
FBA50A2VEB	x2 RZAG71M7Y1B				11.6	--	16	--	9.2	0.094	0.8	0.089 x2	0.6 x2			
FBA100A2VEB	RZAG71M7Y1B				11.4	--	16	--	9.2	0.094	0.8	0.127	1.0			
FUA100AVEB	RZAG71M7Y1B				11.8	--	16	--	9.2	0.094	0.8	0.106	1.3			
FAA100AUVEB	RZAG71M7Y1B		10.8	--	16	--	9.2	0.094	0.8	0.064	0.4					
FVA100AMVEB	RZAG71M7Y1B		11.6	--	16	--	9.2	0.094	0.8	0.238	1.2					
FDXM35F3V1B	x3 RZAG71M7Y1B		11.3	--	16	--	9.2	0.094	0.8	0.034 x3	0.3 x3					
FDXM50F3V1B	x2 RZAG71M7Y1B		11.4	--	16	--	9.2	0.094	0.8	0.060 x2	0.5 x2					
FHA35AVEB	x3 RZAG71M7Y1B		12.3	--	16	--	9.2	0.094	0.8	0.060 x3	0.6 x3					
FHA50AVEB	x2 RZAG71M7Y1B		11.6	--	16	--	9.2	0.094	0.8	0.060 x2	0.6 x2					
FHA100AVEB	RZAG71M7Y1B		11.8	--	16	--	9.2	0.094	0.8	0.150	1.3					
FCAG71GVEB	RZAG100M7Y1B		3N- 50Hz 380-415V	Minimum: 342 V	Maximum: 456 V	14.0	--	16	--	11.0	0.094+0.094	0.75+0.75	0.091 x2	0.5 x2		
FCAG140GVEB	RZAG100M7Y1B					15.5	--	16	--	12.0	0.094+0.094	0.75+0.75	0.244	1.4		
FCAG35AVEB	x4 RZAG100M7Y1B					13.2	--	16	--	10.0	0.094+0.094	0.75+0.75	0.044 x4	0.3 x4		
FCAG50AVEB	x3 RZAG100M7Y1B	12.9				--	16	--	10.0	0.094+0.094	0.75+0.75	0.039 x3	0.3 x3			
FCAG71AVEB	x2 RZAG100M7Y1B	13.8				--	16	--	11.0	0.094+0.094	0.75+0.75	0.054 x2	0.4 x2			
FCAG140AVEB	RZAG100M7Y1B	15.1				--	16	--	12.0	0.094+0.094	0.75+0.75	0.168	1.0			
FFA35A2VEB	x4 RZAG100M7Y1B	13.6				--	16	--	10.0	0.094+0.094	0.75+0.75	0.050 x4	0.4 x4			
FFA50A2VEB	x3 RZAG100M7Y1B	13.2				--	16	--	10.0	0.094+0.094	0.75+0.75	0.050 x3	0.4 x3			
FBA35A2VEB	x4 RZAG100M7Y1B	14.5				--	16	--	10.0	0.094+0.094	0.75+0.75	0.089 x4	0.6 x4			
FBA50A2VEB	x3 RZAG100M7Y1B	13.8				--	16	--	10.0	0.094+0.094	0.75+0.75	0.089 x3	0.6 x3			
FBA71A2VEB	x2 RZAG100M7Y1B	14.0		--	16	--	11.0	0.094+0.094	0.75+0.75	0.07 x2	0.5 x2					
FBA140A2VEB	RZAG100M7Y1B	15.6		--	16	--	12.0	0.094+0.094	0.75+0.75	0.187	1.5					
FUA71AVEB	x2 RZAG100M7Y1B	14.9		--	16	--	11.0	0.094+0.094	0.75+0.75	0.046 x2	0.9 x2					
FAA71AUVEB	x2 RZAG100M7Y1B	13.8		--	16	--	11.0	0.094+0.094	0.75+0.75	0.048 x2	0.4 x2					
FVA140AMVEB	RZAG100M7Y1B	15.5		--	16	--	12.0	0.094+0.094	0.75+0.75	0.276	1.4					
FDXM35F3V1B	x4 RZAG100M7Y1B	13.2		--	16	--	10.0	0.094+0.094	0.75+0.75	0.034 x4	0.3 x4					
FDXM50F3V1B	x3 RZAG100M7Y1B	13.5		--	16	--	10.0	0.094+0.094	0.75+0.75	0.060 x3	0.5 x3					
FHA35AVEB	x4 RZAG100M7Y1B	14.5		--	16	--	10.0	0.094+0.094	0.75+0.75	0.060 x4	0.6 x4					
FHA50AVEB	x3 RZAG100M7Y1B	13.8		--	16	--	10.0	0.094+0.094	0.75+0.75	0.060 x3	0.6 x3					
FHA71AVEB	x2 RZAG100M7Y1B	14.7		--	16	--	11.0	0.094+0.094	0.75+0.75	0.091 x2	0.8 x2					
FHA140AVEB	RZAG100M7Y1B	15.9	--	16	--	12.0	0.094+0.094	0.75+0.75	0.150	1.8						

3D110015A

4 Options

4 - 1 Options

AZAS-MV1

AZAS-MY1

RZAG-MV1

RZAG-MY1

RZASG-MV1

RZASG-MY1

Available options for RZAG models

Option	Option kit			
	RZAG71M7V1B RZAG71M7Y1B	RZAG100M7V1B RZAG100M7Y1B	RZAG125M7V1B RZAG125M7Y1B	RZAG140M7V1B RZAG140M7Y1B
Bottom plate heater	EKBPH140L7			
Refrigerant branch piping	KHRQ22M20TA			
	Twin	KHRQ127H		
	Triple	KHRQ22M20TA (3x)		
	Double twin	KHRQ22M20TA (3x)		

Available options for RZASG models

Option	Option kit			
	RZASG71M2V1B	RZASG100M7V1B RZASG100M7Y1B	RZASG125M7V1B RZASG125M7Y1B	RZASG140M7V1B RZASG140M7Y1B
Bottom plate heater	-			
Refrigerant branch piping	KHRQ22M20TA			
	Twin	KHRQ127H		
	Triple	KHRQ22M20TA (3x)		
	Double twin	KHRQ22M20TA (3x)		

Available options for AZAS models

Option	Option kit			
	AZAS71M2V1B	AZAS100M7V1B AZAS100M7Y1B	AZAS125M7V1B AZAS125M7Y1B	AZAS140M7V1B AZAS140M7Y1B

3D108867

5 Combination table

5 - 1 Combination Table

5

AZAS-MV1
AZAS-MY1
RZAG-MV1
RZAG-MY1
RZASG-MV1
RZASG-MY1

Possible combinations

Pair	71	100	125	140
2= Twin	35+35	50+50	60+60	71+71
3= Triple		35+35+35 (*)	50+50+50 (*)	50+50+50 (*)
4= Double twin			35+35+35+35 (*)	35+35+35+35

Sky Air	High Cassette				Thin cassette						2x2 cassette			Duct (medium ESP)				Concealed floor standing type		Ceiling-mounted 4-way blow		Wall mounted type		Duct (high ESP)												
	FCAG710Q/VEB	FCAG100Q/VEB	FCAG125Q/VEB	FCAG140Q/VEB	FCAG35A/VEB	FCAG50A/VEB	FCAG60A/VEB	FCAG71A/VEB	FCAG100A/VEB	FCAG125A/VEB	FCAG140A/VEB	FFAS2A/VEB	FFAS3A/VEB	FFAS4A/VEB	FBA35A/VEB	FBA50A/VEB	FBA60A/VEB	FBA71A/VEB	FBA100A/VEB	FBA125A/VEB	FBA140A/VEB	FMA35A/VEB	FMA50A/VEB	FMA60A/VEB	FUA71A/VEB	FUA100A/VEB	FUA125A/VEB	FUA140A/VEB	FAA71A/VEB	FAA100A/VEB	FAA125A/VEB	FAA140A/VEB				
RZAG71M7V1B	RZAG71M7Y1B	P			2							2			2							2														
RZAG100M7V1B	RZAG100M7Y1B		P			3	2					3	2		3	2						3	2													
RZAG125M7V1B	RZAG125M7Y1B			P		4	3	2				4	3	2	4	3	2					4	3	2												
RZAG140M7V1B	RZAG140M7Y1B	2			P	4	3	2				4	3	2	4	3	2					4	3	2												
RZASG71M2V1B	RZASG71M2Y1B								2						2																					
RZASG100M7V1B	RZASG100M7Y1B					3	2					3	2		3	2						3	2													
RZASG125M7V1B	RZASG125M7Y1B					4	3	2				4	3	2	4	3	2					4	3	2												
RZASG140M7V1B	RZASG140M7Y1B					4	3	2				4	3	2	4	3	2					4	3	2												
AZAS71M2V1B	AZAS71M2Y1B																																			
AZAS100M7V1B	AZAS100M7Y1B																																			
AZAS125M7V1B	AZAS125M7Y1B																																			
AZAS140M7V1B	AZAS140M7Y1B																																			

Sky Air	Floor standing type				Slim duct			Ceiling-suspended						
	FVA71A/VEB	FVA100A/VEB	FVA125A/VEB	FVA140A/VEB	FDXA35F3V1B	FDXA50F3V1B	FDXA60F3V1B	FHA35A/VEB	FHA50A/VEB	FHA60A/VEB	FHA71A/VEB	FHA100A/VEB	FHA125A/VEB	FHA140A/VEB
RZAG71M7V1B	RZAG71M7Y1B	P						2						
RZAG100M7V1B	RZAG100M7Y1B		P					3	2					
RZAG125M7V1B	RZAG125M7Y1B			P				4	3	2				
RZAG140M7V1B	RZAG140M7Y1B	2			P			4	3	2				
RZASG71M2V1B	RZASG71M2Y1B										2			
RZASG100M7V1B	RZASG100M7Y1B											3	2	
RZASG125M7V1B	RZASG125M7Y1B													4
RZASG140M7V1B	RZASG140M7Y1B	2			P			4	3	2				4
AZAS71M2V1B	AZAS71M2Y1B													
AZAS100M7V1B	AZAS100M7Y1B													
AZAS125M7V1B	AZAS125M7Y1B													
AZAS140M7V1B	AZAS140M7Y1B													

Notes

- Maximum capacity is limited based on outdoor unit capacity.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.

Twin : KHRQ(M)58T
 Triple : KHRQ(M)58H
 Double twin : KHRQ(M)58T

3D108868

RZAG-MV1
RZAG-MY1

Sky Air	High Cassette				Thin cassette						2x2 cassette			Duct (medium ESP)				Concealed floor standing type		Ceiling-mounted 4-way blow		Wall mounted type		Duct (high ESP)											
	FCAG710Q/VEB	FCAG100Q/VEB	FCAG125Q/VEB	FCAG140Q/VEB	FCAG35A/VEB	FCAG50A/VEB	FCAG60A/VEB	FCAG71A/VEB	FCAG100A/VEB	FCAG125A/VEB	FCAG140A/VEB	FFAS2A/VEB	FFAS3A/VEB	FFAS4A/VEB	FBA35A/VEB	FBA50A/VEB	FBA60A/VEB	FBA71A/VEB	FBA100A/VEB	FBA125A/VEB	FBA140A/VEB	FMA35A/VEB	FMA50A/VEB	FMA60A/VEB	FUA71A/VEB	FUA100A/VEB	FUA125A/VEB	FUA140A/VEB	FAA71A/VEB	FAA100A/VEB	FAA125A/VEB	FAA140A/VEB			
RZAG71M7V1B	RZAG71M7Y1B		P																																
RZAG100M7V1B	RZAG100M7Y1B	2			P	4	3	2																											
RZAG125M7V1B	RZAG125M7Y1B			P		4	3	2																											
RZAG140M7V1B	RZAG140M7Y1B	2			P	4	3	2																											

Sky Air	Floor standing type				Slim duct			Ceiling-suspended						
	FVA71A/VEB	FVA100A/VEB	FVA125A/VEB	FVA140A/VEB	FDXA35F3V1B	FDXA50F3V1B	FDXA60F3V1B	FHA35A/VEB	FHA50A/VEB	FHA60A/VEB	FHA71A/VEB	FHA100A/VEB	FHA125A/VEB	FHA140A/VEB
RZAG71M7V1B	RZAG71M7Y1B		P					3	2					
RZAG100M7V1B	RZAG100M7Y1B			P				4	3	2				
RZAG125M7V1B	RZAG125M7Y1B				P			4	3	2				
RZAG140M7V1B	RZAG140M7Y1B				P			4	3	2				

Possible combinations P= Pair
 2= Twin
 3= Triple
 4= Double twin

Notes

- Maximum capacity is limited based on outdoor unit capacity.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.



Twin : KHRQ(M)58T
 Triple : KHRQ(M)58H
 Double twin : KHRQ(M)58T

3D108869

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG71MV1 RZAG71MY1

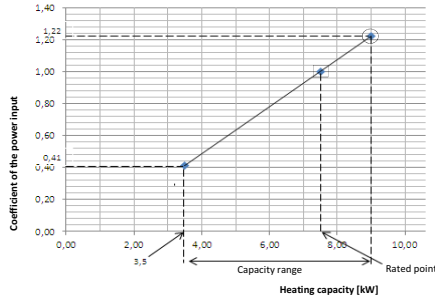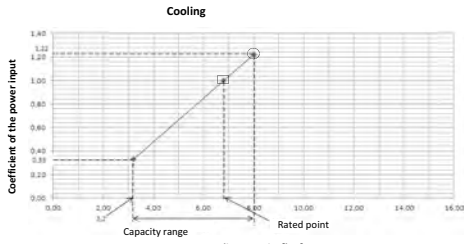

Heating

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

Indoor		Outdoor temperature [°C DB]												
		25			30			35			40			
°CWB	°CDB	kW	SHC	CPI	kW	SHC	CPI	kW	SHC	CPI	kW	SHC	CPI	
16	16	6.43	0.98	0.93	7.09	0.99	0.93	7.65	1.02	0.93	8.21	1.06	0.93	8.79
18	18	6.43	0.98	0.93	7.09	0.99	0.93	7.65	1.02	0.93	8.21	1.06	0.93	8.79
20	20	6.42	1.01	1.01	7.07	1.07	1.01	7.63	1.12	1.01	8.19	1.16	1.01	8.77
21	21	6.42	1.03	1.03	7.07	1.09	1.03	7.63	1.13	1.03	8.19	1.17	1.03	8.77
22	22	6.42	1.06	1.06	7.06	1.11	1.06	7.62	1.15	1.06	8.18	1.19	1.06	8.77
24	24	6.41	1.09	1.09	7.05	1.15	1.09	7.61	1.20	1.09	8.17	1.23	1.09	8.76

Indoor		Outdoor temperature [°C WB]											
		-15.0		-10.0		-5.0		0.0		6.0		10.0	
°CDB	kW	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	6.44	0.93	0.93	7.09	0.99	7.65	1.02	7.79	1.06	9.00	1.12	9.71	1.19
18	6.43	0.98	0.98	7.08	1.03	7.64	1.07	7.78	1.10	9.00	1.17	9.71	1.24
20	6.42	1.01	1.01	7.07	1.07	7.63	1.12	7.77	1.14	9.00	1.22	9.71	1.28
21	6.42	1.03	1.03	7.07	1.09	7.63	1.13	7.77	1.16	9.00	1.24	9.71	1.31
22	6.42	1.06	1.06	7.06	1.11	7.62	1.15	7.76	1.19	9.00	1.27	9.71	1.33
24	6.41	1.09	1.09	7.05	1.15	7.61	1.20	7.75	1.23	9.00	1.32	9.67	1.38

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
 SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1.8F) x (DB* - EDB)
 - The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG71G	FCAG71A	FAA71A	FVA71A	FHA71A	FUA71A	FBA71A
AFR	21.2	15.3	18.0	18.0	20.5	23.0	18.0
BF	(0.20)	(0.14)	(0.16)	(0.16)	(0.13)	(0.24)	(0.13)



Pair	FCAG71G	FCAG71A	FAA71A	FVA71A	FHA71A	FUA71A	FBA71A
Cooling	1.55	1.78	1.88	1.87	1.64	1.61	1.86
Heating	1.60	2.29	2.19	2.33	2.07	1.95	2.10

Twin		FCAG35A X 2	FHA35A X 2	FFA35A X 2	FDWM35F3 X 2	FBA35A X 2	FNA35A X 2
AFR	12.5 x 2	14.0 x 2	10.0 x 2	8.7 x 2	15.0 x 2	8.7 x 2	8.7 x 2
BF	(0.40 x 2)	(0.17 x 2)	(0.25 x 2)	(0.17 x 2)	(0.08 x 2)	(0.17 x 2)	(0.17 x 2)

Twin		FCAG35A X 2	FHA35A X 2	FFA35A X 2	FDWM35F3 X 2	FBA35A X 2	FNA35A X 2
Cooling	1.47	1.33	1.63	1.73	1.62	1.73	1.82
Heating	1.53	1.62	1.74	2.17	1.82	2.17	2.17

3D112140

RZAG100MV1 RZAG100MY1

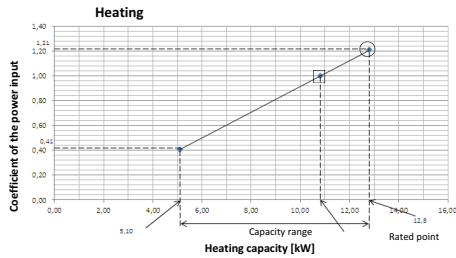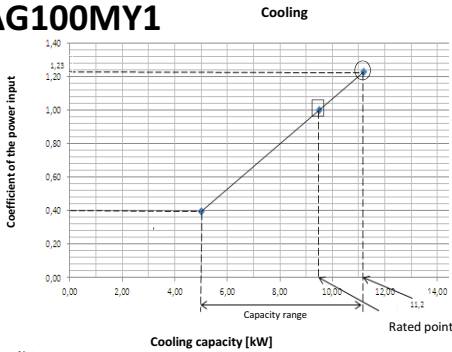

Heating

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
 SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1.8F) x (DB* - EDB)
 - The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

Indoor		Outdoor temperature [°C DB]											
		25			30			35			40		
°CWB	°CDB	kW	SHC	CPI	kW	SHC	CPI	kW	SHC	CPI	kW	SHC	CPI
16.0	22	11.20	7.61	1.01	10.85	7.44	1.11	10.50	7.29	1.22	10.11	7.09	1.32
18.0	25	13.80	7.59	1.01	11.37	7.49	1.12	11.00	7.27	1.23	10.55	7.09	1.33
19.5	27	12.00	7.57	1.02	11.62	7.44	1.12	11.20	7.26	1.23	10.80	7.04	1.33
19.5	27	12.15	7.59	1.02	11.74	7.37	1.13	11.43	7.34	1.23	10.91	7.04	1.34
22.0	30	12.80	7.52	1.02	12.37	7.36	1.13	11.90	7.16	1.24	11.52	7.03	1.35
24.0	32	13.30	7.42	1.03	12.88	7.27	1.14	12.40	7.06	1.25	11.97	6.91	1.36

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG100G	FCAG100A	FAA100A	FVA100A	FHA100A	FUA100A	FBA100A
AFR	32.3	22.8	26.0	28.0	28.0	31.0	29.0
BF	(0.17)	(0.17)	(0.20)	(0.20)	(0.09)	(0.20)	(0.03)

Pair	FCAG100G	FCAG100A	FAA100A	FVA100A	FHA100A	FUA100A	FBA100A
Cooling	1.88	2.15	2.14	2.24	1.95	2.24	2.26
Heating	2.12	2.72	3.45	2.88	2.58	2.62	2.78

Twin		FCAG50A X 2	FHA50A X 2	FFA50A X 2	FDWM50F3 X 2	FBA50A X 2	FNA50A X 2
AFR	12.5 x 2	15.0 x 2	12.0 x 2	15.8 x 2	15.0 x 2	16.0 x 2	16.0 x 2
BF	(0.22 x 2)	(0.18 x 2)	(0.16 x 2)	(0.11 x 2)	(0.13 x 2)	(0.11 x 2)	(0.11 x 2)

Twin		FCAG50A X 2	FHA50A X 2	FFA50A X 2	FDWM50F3 X 2	FBA50A X 2	FNA50A X 2
Cooling	1.94	1.95	2.50	1.89	1.98	1.98	1.89
Heating	2.04	2.55	3.16	2.47	2.68	2.47	2.47

Triple		FCAG35A X 3	FHA35A X 3	FFA35A X 3	FDWM35F3 X 3	FBA35A X 3	FNA35A X 3
AFR	12.5 x 3	14.0 x 3	10.0 x 3	8.7 x 3	15.0 x 3	8.7 x 3	8.7 x 3
BF	(0.40 x 3)	(0.17 x 3)	(0.25 x 3)	(0.17 x 3)	(0.08 x 3)	(0.17 x 3)	(0.17 x 3)

Triple		FCAG35A X 3	FHA35A X 3	FFA35A X 3	FDWM35F3 X 3	FBA35A X 3	FNA35A X 3
Cooling	1.74	1.84	2.02	1.99	2.21	1.99	1.99
Heating	2.07	2.06	3.14	2.85	2.33	2.85	2.85


3D112141

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG125MV1 RZAG125MY1

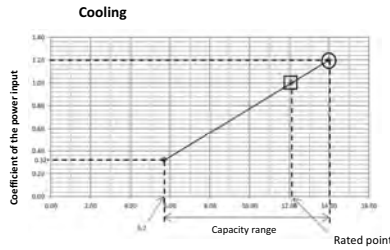

Cooling capacity [kW]


- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - ▣ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC - SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

Pair	FCAG125G	FCAG125A	FD4125A	FVA125A	FUA125A	FBA125A
AFR	33.5	26.0	39.0	28.0	31.0	32.5
(BF)	(0.19)	(0.21)	(0.16)	(0.16)	(0.14)	(0.19)

Twin	FCAG60A X 2	FHA60A X 2	FFA60A X 2	FDXM50F3 X 2	FBA60A X 2	FNA60A X 2
AFR	13.5 x 2	19.5 x 2	14.5 x 2	18.0 x 2	18.0 x 2	16.0 x 2
(BF)	(0.20 x 2)	(0.20 x 2)	(0.11 x 2)	(0.12 x 2)	(0.18 x 2)	(0.12 x 2)

Triple	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXM50F3 X 3	FBA50A X 3	FNA50A X 3
AFR	12.6 x 3	15.0 x 3	12.0 x 3	15.8 x 3	15.0 x 3	16.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin	FCAG35A X 4	FHA35A X 4	FFA35A X 4	FDXM35F3 X 4	FBA35A X 4	FNA35A X 4
AFR	12.5 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4	8.7 x 4
(BF)	(0.40 x 4)	(0.17 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

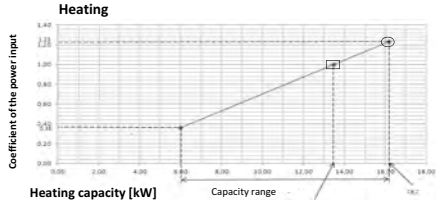

Heating capacity [kW]

- Symbols**
- AFR: Air flow rate (m³/min)
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature (°C WB)
 - EDB: Entering dry-bulb temperature (°C DB)
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
°CWB	°CDB	kW	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16.0	22	14.39	9.44	0.99	13.69	9.30	1.09	13.30	9.12	1.19	12.60	8.78	1.29
18.0	25	14.70	9.50	0.99	14.20	9.32	1.09	13.70	9.09	1.20	13.20	8.83	1.30
19.0	27	15.00	9.52	1.00	14.50	9.34	1.10	14.00	9.06	1.20	13.50	8.87	1.31
19.5	27	15.21	9.52	1.00	14.68	9.26	1.11	14.15	9.08	1.20	13.64	8.81	1.31
22.0	30	16.00	9.39	1.00	15.47	9.14	1.11	14.90	8.95	1.21	14.38	8.74	1.32
25.0	32	16.70	9.31	1.01	16.30	9.09	1.11	15.50	8.83	1.23	14.97	8.63	1.33

Indoor	Outdoor temperature [°C WB]											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
°CDB	kW	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	11.0	0.94	12.1	1.00	12.9	1.03	13.2	1.06	16.2	1.13	17.5	1.20
18	11.0	0.98	12.1	1.03	12.9	1.08	13.2	1.11	16.2	1.18	17.5	1.25
20	11.0	1.02	12.0	1.03	12.9	1.10	13.2	1.15	16.2	1.23	17.5	1.30
21	11.0	1.04	12.0	1.10	12.8	1.14	13.2	1.17	16.2	1.25	17.5	1.32
22	11.0	1.06	12.0	1.12	12.8	1.16	13.2	1.20	16.2	1.28	17.4	1.34
24	11.0	1.10	12.0	1.16	12.8	1.21	13.2	1.24	16.2	1.33	17.4	1.39

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG125G	FCAG125A	FD4125A	FVA125A	FUA125A	FBA125A
Cooling	2.81	3.17	3.17	3.72	2.94	3.98
Heating	3.02	5.83	3.61	4.63	4.24	3.75


Twin	FCAG60A X 2	FHA60A X 2	FFA60A X 2	FDXM50F3 X 2	FBA60A X 2	FNA60A X 2
Cooling	2.57	2.78	3.09	2.42	3.21	2.47
Heating	3.45	4.31	3.63	3.63	3.32	3.63

Triple	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXM50F3 X 3	FBA50A X 3	FNA50A X 3
Cooling	2.25	2.69	2.78	2.09	3.10	2.09
Heating	2.84	3.28	3.26	2.92	3.13	2.92

Double twin	FCAG35A X 4	FHA35A X 4	FFA35A X 4	FDXM35F3 X 4	FBA35A X 4	FNA35A X 4
Cooling	2.06	2.05	2.43	2.36	2.93	2.44
Heating	2.59	2.86	3.50	3.44	2.87	3.44

3D112142

RZAG140MV1 RZAG140MY1

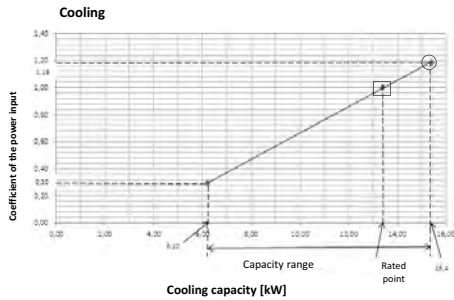

Cooling capacity [kW]


- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - ▣ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

Pair	FCAG140G	FCAG140A	FVA140A	FHA140A	FBA140A
AFR	33.5	26.0	30.0	34.0	34.0
(BF)	(0.15)	(0.23)	(0.18)	(0.17)	(0.06)

Twin	FCAG70G X 2	FCAG70A X 2	FVA70A X 2	FHA70A X 2	FUA70A X 2	FBA70A X 2
AFR	21.2 x 2	15.1 x 2	18.0 x 2	20.5 x 2	23.0 x 2	18.0 x 2
(BF)	(0.20 x 2)	(0.14 x 2)	(0.16 x 2)	(0.13 x 2)	(0.24 x 2)	(0.13 x 2)

Triple	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXM50F3 X 3	FBA50A X 3	FNA50A X 3
AFR	12.6 x 3	15.0 x 3	12.0 x 3	15.8 x 3	15.0 x 3	16.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin	FCAG35A X 4	FHA35A X 4	FFA35A X 4	FDXM35F3 X 4	FBA35A X 4	FNA35A X 4
AFR	12.5 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4	8.7 x 4
(BF)	(0.40 x 4)	(0.20 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

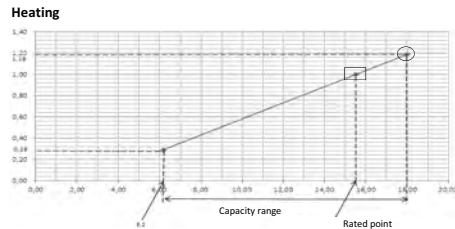

Heating capacity [kW]

- Symbols**
- AFR: Air flow rate (m³/min)
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature (°C WB)
 - EDB: Entering dry-bulb temperature (°C DB)
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
°CWB	°CDB	kW	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16.0	22	15.50	10.47	0.98	14.83	10.25	1.08	14.44	10.03	1.18	13.86	9.69	1.28
18.0	25	16.17	10.38	0.98	15.63	10.23	1.08	15.11	10.01	1.19	14.53	9.71	1.30
19.0	27	16.56	10.43	0.99	15.86	10.18	1.09	15.40	9.98	1.19	14.83	9.76	1.30
19.5	27	16.74	10.49	0.99	16.14	10.16	1.10	15.57	10.00	1.19	14.98	9.66	1.30
22.0	30	17.61	10.37	0.99	17.01	10.16	1.10	16.36	9.83	1.21	15.76	9.60	1.31
25.0	32	18.38	10.20	1.00	17.72	10.00	1.11	17.04	9.67	1.22	16.43	9.47	1.32

Indoor	Outdoor temperature [°C WB]											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
°CDB	kW	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	11.6	0.91	12.7	0.97	13.6	1.00	13.9	1.03	18.0	1.14	19.4	1.21
18	11.6	0.95	12.7	1.00	13.6	1.04	13.9	1.07	18.0	1.14	19.4	1.21
20	11.6	0.99	12.7	1.05	13.5	1.09	13.9	1.11	18.0	1.19	19.4	1.25
21	11.5	1.00	12.7	1.06	13.5	1.11	13.9	1.13	18.0	1.21	19.4	1.28
22	11.5	1.02	12.7	1.08	13.5	1.12	13.9	1.16	18.0	1.24	19.4	1.30
24	11.5	1.07	12.6	1.12	13.5	1.17	13.9	1.20	18.0	1.29	19.4	1.35

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG140G	FCAG140A	FVA140A	FHA140A	FBA140A
Cooling	3.44	4.21	4.61	4.49	4.30
Heating	3.49	5.83	5.56	3.46	5.04

Twin	FCAG70G X 2	FCAG70A X 2	FVA70A X 2	FHA70A X 2	FUA70A X 2	FBA70A X 2
Cooling	2.71	3.59	3.77	3.54	3.30	3.49
Heating	2.79	4.79	3.05	3.10	3.90	4.82

Triple	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXM50F3 X 3	FBA50A X 3	FNA50A X 3
Cooling	3.10	3.85	3.89	2.95	3.59	2.95
Heating	4.46	2.96	5.18	3.96	4.29	3.96


Double twin	FCAG35A X 4	FHA35A X 4	FFA35A X 4	FDXM35F3 X 4	FBA35A X 4	FNA35A X 4
Cooling	2.82	2.86	3.34	3.34	3.35	3.34
Heating	5.84	3.31	5.60	4.67	3.81	4.67

3D112143



7 Dimensional drawings

7 - 1 Dimensional Drawings

AZAS100-140MV1
 AZAS-MY1
 RZAG71MV1
 RZAG71MY1
 RZASG100-140MV1
 RZASG-MY1

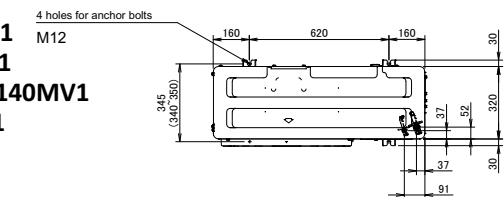




Model	AA	AB
RZAG71* / RZASG100-125* / AZAS100-125*	331	337
RZASG140* / AZAS140*	414	420

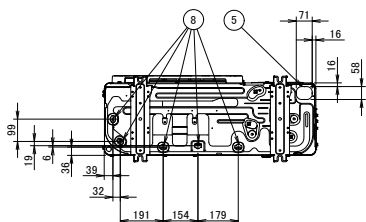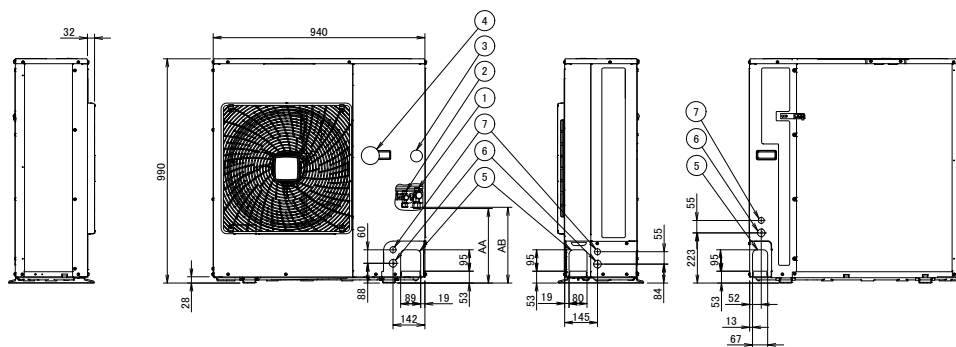

- ① Gas pipe connection Ø15.9 flare
- ② Liquid pipe connection Ø9.5 flare
- ③ Service port (in the unit)
- ④ Electronic connection and grounding terminal M5 (in the switch box)
- ⑤ Refrigerant piping intake
- ⑥ Power supply wiring intake (knockout hole Ø34)
- ⑦ Control wiring intake (knockout hole Ø27)
- ⑧ Drain outlet

3D110011

RZAG100-140MV1
 RZAG100-140MY1

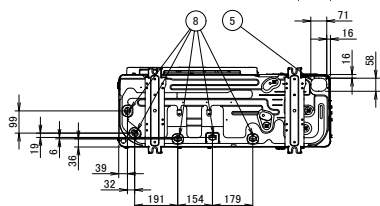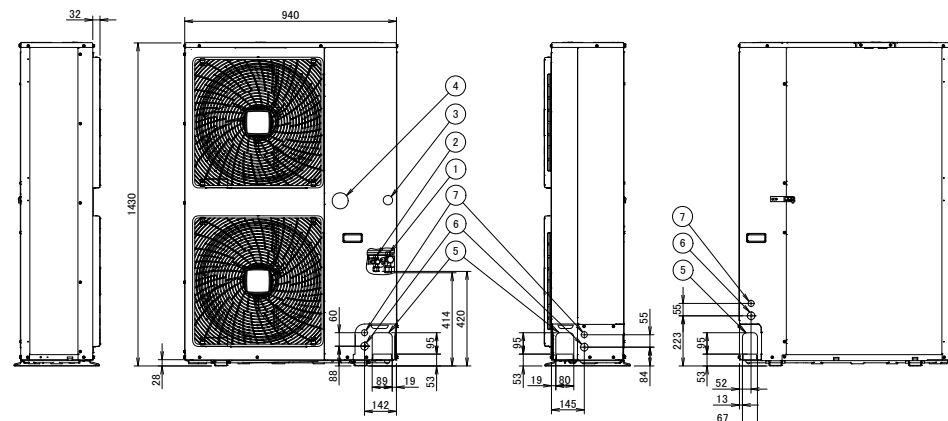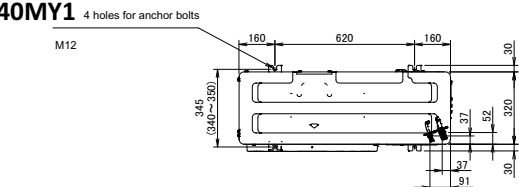

- ① Gas pipe connection Ø15.9 flare
- ② Liquid pipe connection Ø9.5 flare
- ③ Service port (in the unit)
- ④ Electronic connection and grounding terminal M5 (in the switch box)
- ⑤ Refrigerant piping intake
- ⑥ Power supply wiring intake (knockout hole Ø34)
- ⑦ Control wiring intake (knockout hole Ø27)
- ⑧ Drain outlet

3D110012

8 Centre of gravity

8 - 1 Centre of Gravity

8

AZAS100-140MV1


AZAS-MY1

RZAG71MV1

RZAG71MY1

RZASG100-140MV1

RZASG-MY1

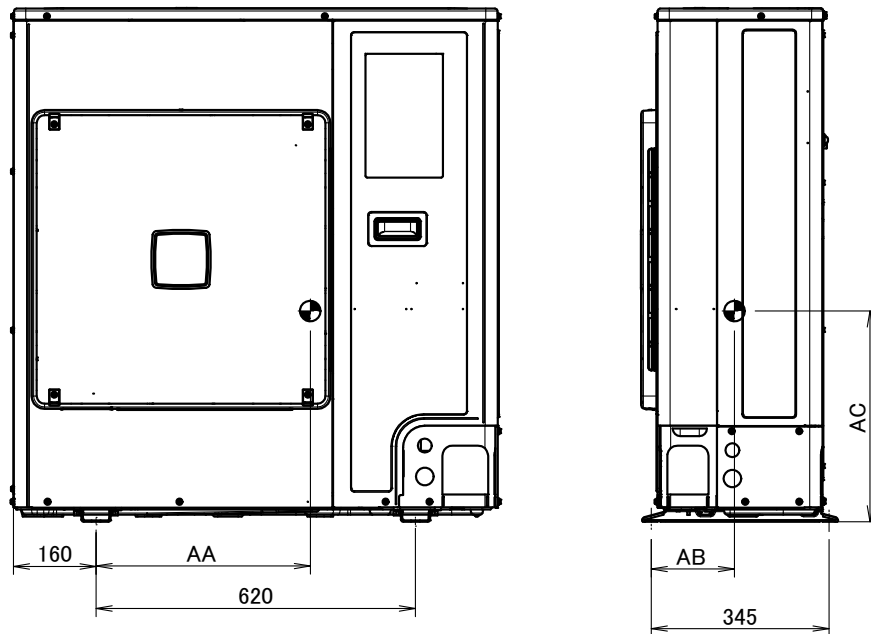

Model	AA	AB	AC
RZAG71M7V*	414	163	407
RZAG71M7Y*	432	137	407
RZASG100-125M7V* / AZAS100-125M7V*	425	181	422
RZASG100-125M7Y* / AZAS100-125M7Y*	414	156	417
RZASG140M7V* / AZAS140M7V*	414	161	423
RZASG140M7Y* / AZAS140M7Y*	416	151	418


4D110025

8 Centre of gravity

8 - 1 Centre of Gravity

RZAG100-140MV1

RZAG100-140MY1

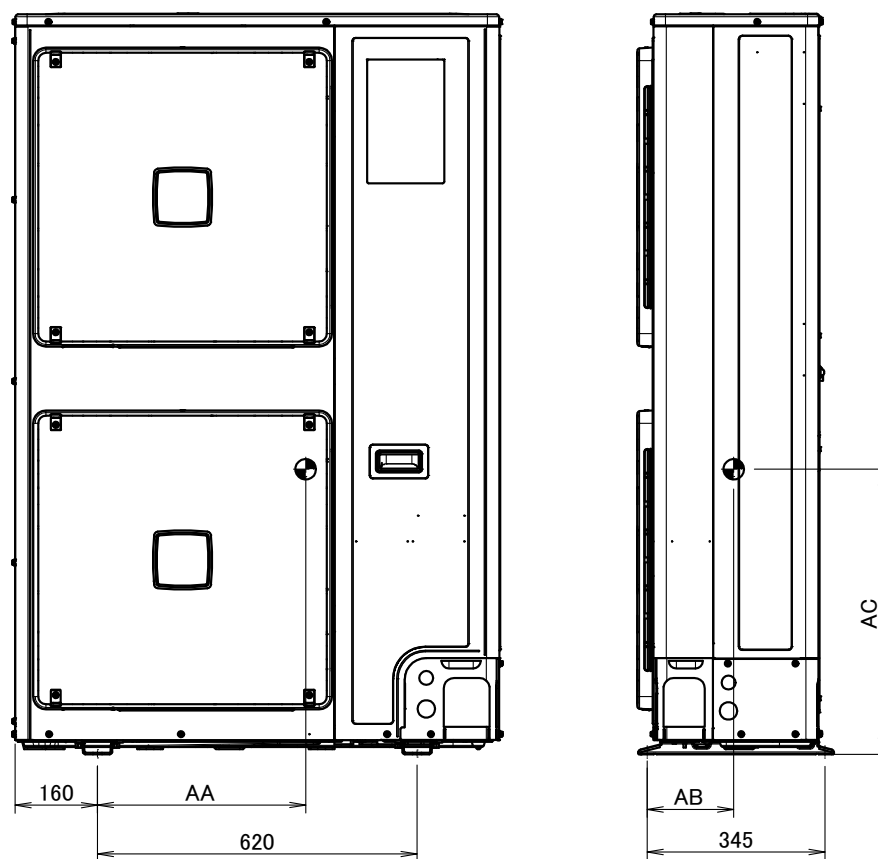

Model	AA	AB	AC
RZAG100-140M7V*	403	176	536
RZAG100-140M7Y*	396	173	572


4D110026

9 Piping diagrams

9 - 1 Piping Diagrams

9

AZAS-MV1
 AZAS-MY1
 RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1

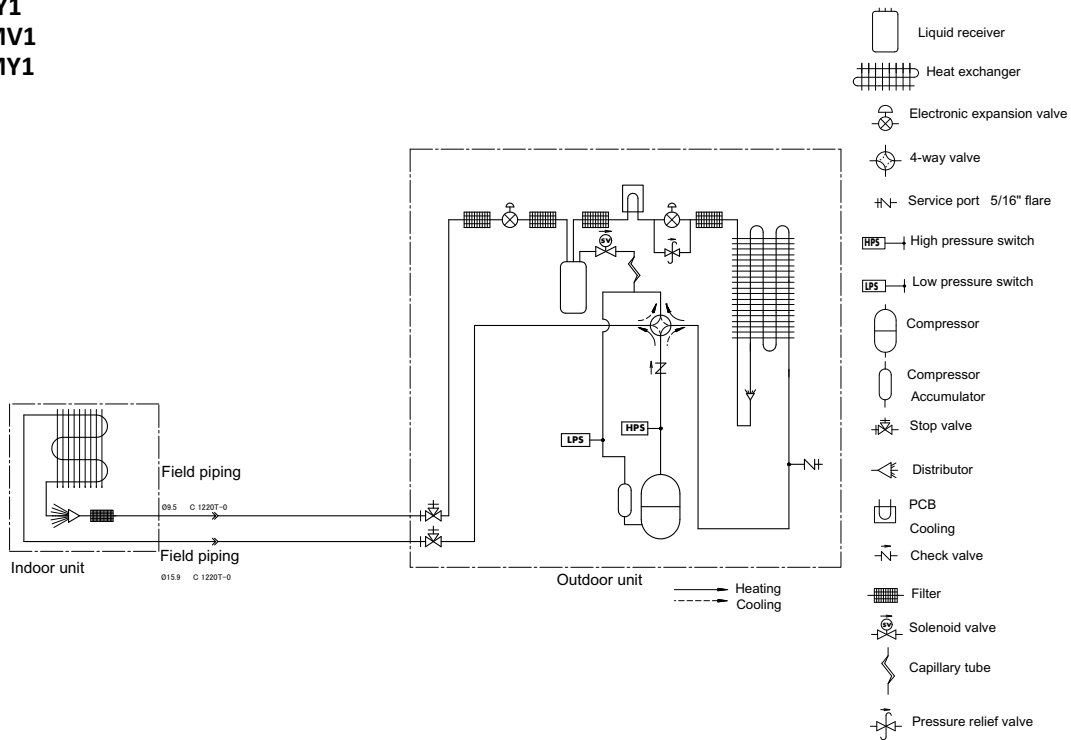

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D108855A

9 Piping diagrams

9 - 2 Piping Diagram Twin Application

RZAG-MV1
RZAG-MY1
RZASG-MV1
RZASG-MY1

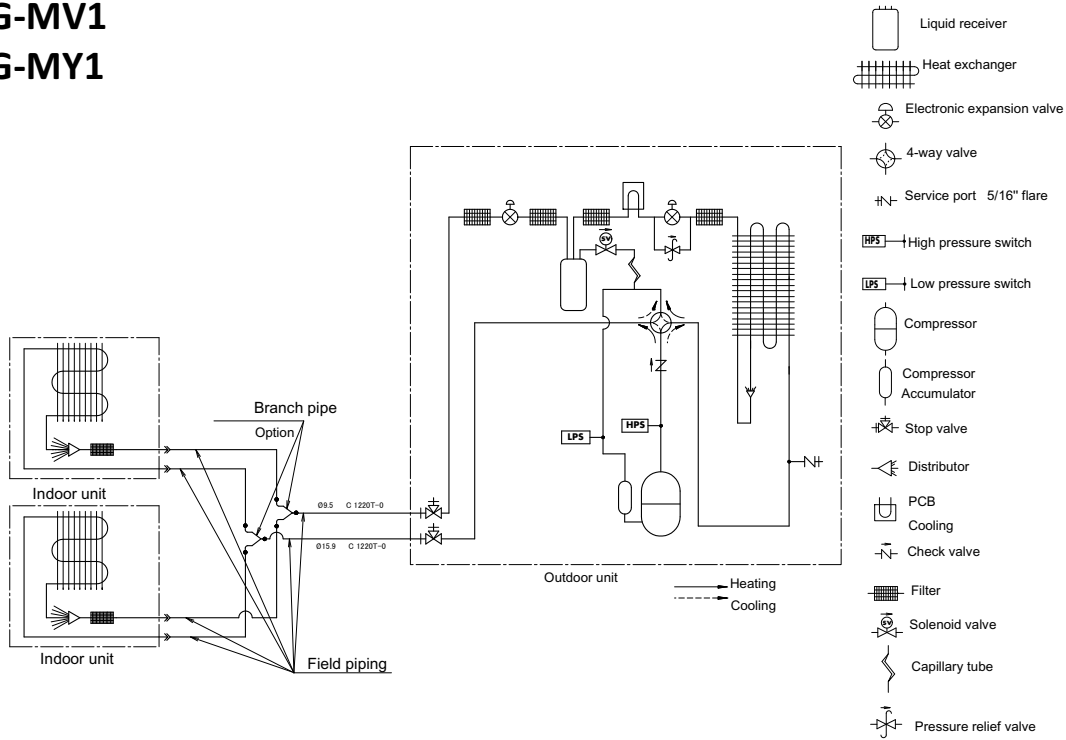

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D108856A

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

9

RZAG100-140MV1
RZAG100-140MY1
RZASG100-140MV1
RZASG-MY1

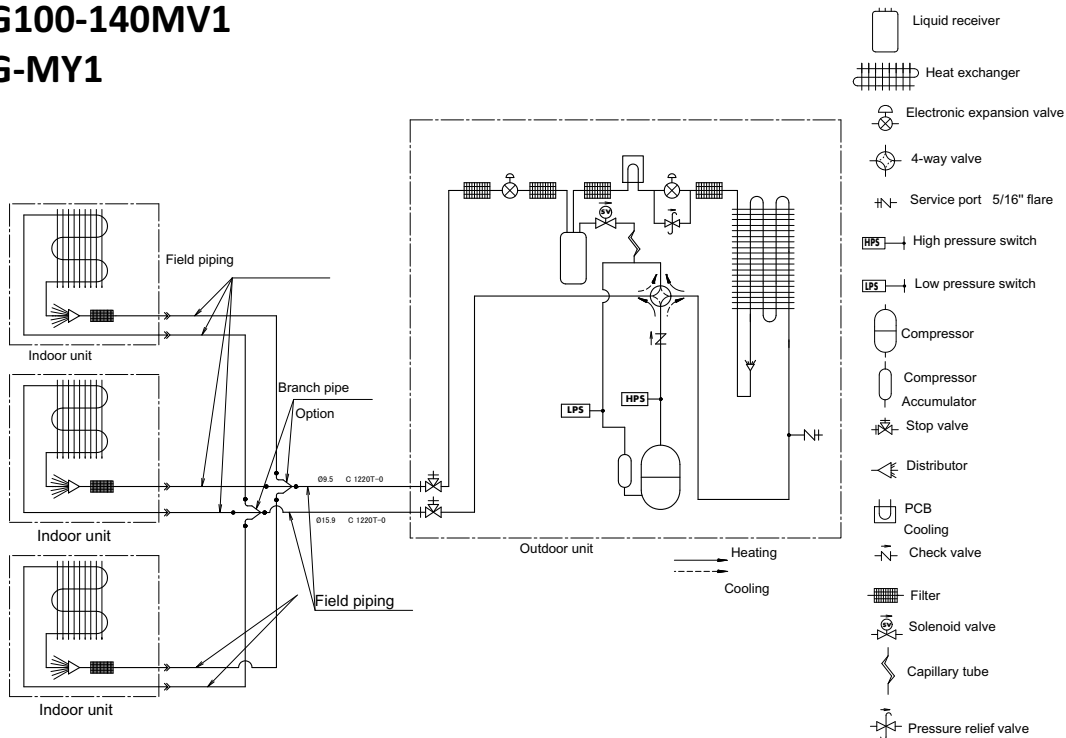


Notes
 1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D108857A

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

RZAG125-140MV1
 RZAG125-140MY1
 RZASG125-140MV1
 RZASG125-140MY1

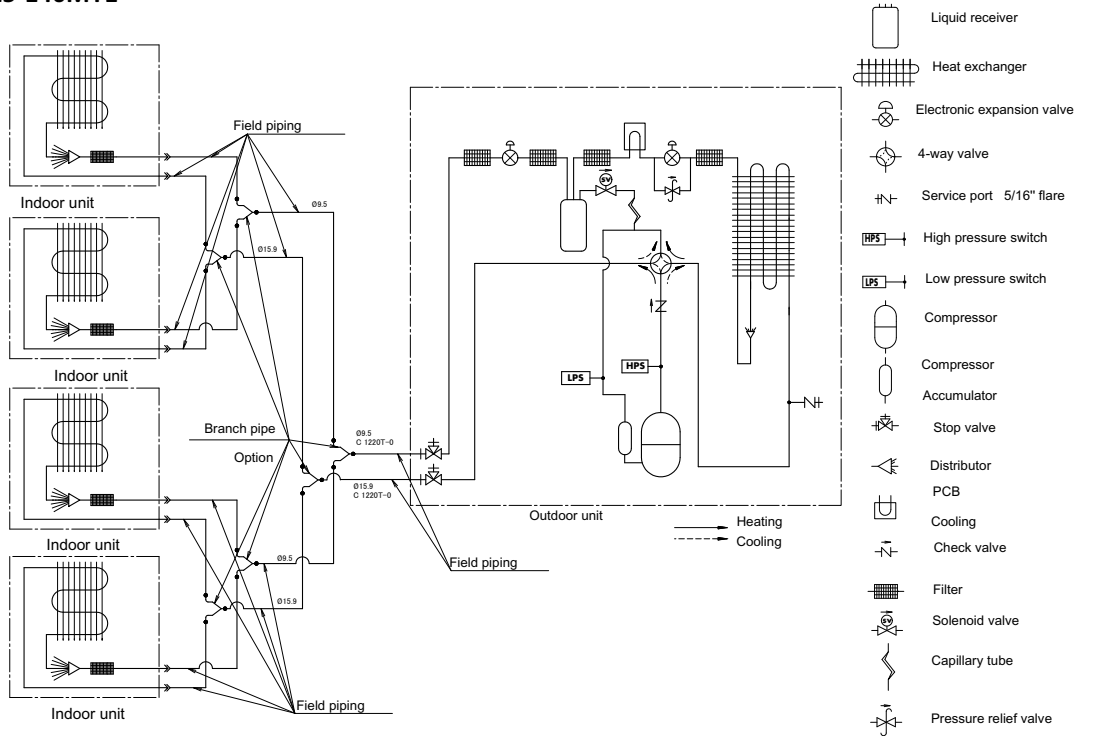

Notes

¹ The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D108858A

10 Wiring diagrams

10 - 1 Wiring Diagrams - Three Phase

10

RZAG-MY1, RZASG-MY1, AZAS-MY1

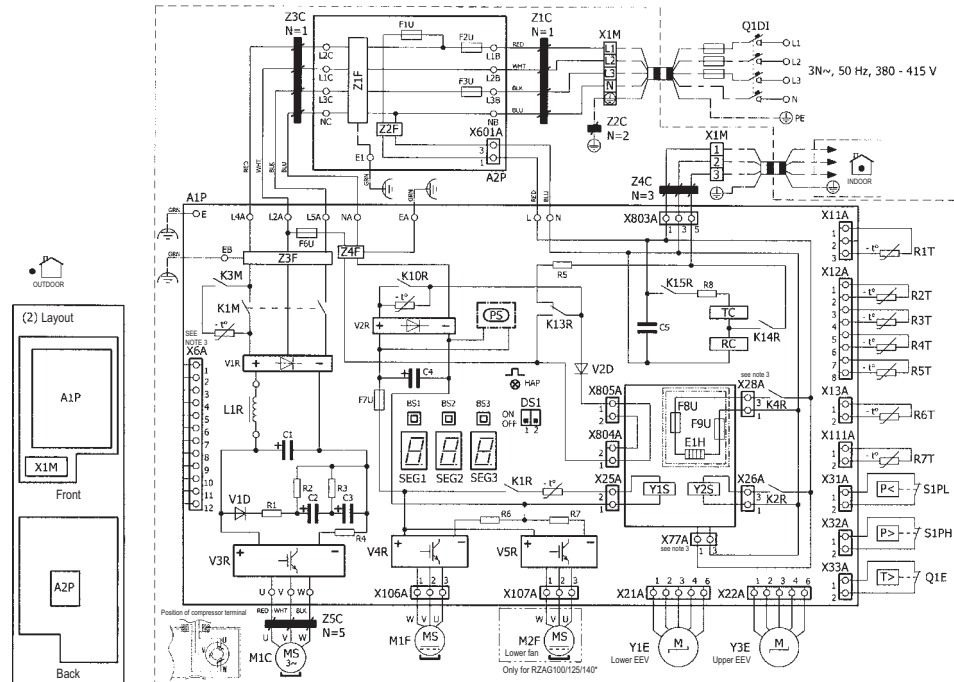

: Field supply
* : Optional

Part n°	Description
A1P	Printed circuit board (main)
A2P	Printed circuit board (noise filter)
BS1-BS3 (A1P)	Push-button switch
C1-C5 (A1P)	Capacitor
DS1 (A1P)	Dipswitch
E1H	Bottom plate heater
F1U (A2P)	Fuse T 6.3 A 250 V
F2U, F3U (A2P)	Fuse T 30 A 500 V
F6U (A1P)	Fuse T 6.3 A 250 V
F7U (A1P)	Fuse T 5 A 250 V
F8U, F9U	Fuse T 1 A 250 V
HAP (A1P)	Light-emitting diode (service monitor is green)
K1M, K3M (A1P)	Magnetic contactor
K1R (A1P)	Magnetic relay (Y1S)
K2R (A1P)	Magnetic relay (Y2S)
K4R (A1P)	Magnetic relay (E1H)
K13R-K15R (A1P)	Magnetic relay
L1R	Reactor
M1C	Compressor motor
M1F, M2F	Fan motor
PS (A1P)	Switching power supply
Q1D1	Earth leakage circuit breaker (30mA)
Q1E	Overload protection
R1-R8 (A1P)	Resistor
R1T	Thermistor (air)
R2T	Thermistor (discharge)
R3T	Thermistor (suction)
R4T	Thermistor (heat exchanger)
R5T	Thermistor (heat exchanger middle)
R6T	Thermistor (liquid)
R7T	Thermistor (fin)
RC (A1P)	Signal receiver circuit
S1PH	High pressure switch
S1PL	Low pressure switch
SEG1-SEG3 (A1P)	7-segment display
TC (A1P)	Signal transmission circuit
V1D, V2D (A1P)	Diode
V1R, V2R (A1P)	Diode module
V3R-V5R (A1P)	IGBT power module
X1M	Terminal strip
Y1E, Y3E	Electronic expansion valve
Y1S, Y2S	Solenoid valve (4-way valve)
Z1C-Z5C	Noise filter (ferrite core)
Z1F-Z4F	Noise filter
L'A, L'B, NA, NBE*, U, V, W, X'A (A1P, A2P)	Connector

+ : Connection
 X1M : Main terminal
 --- : Earth wiring
 --- : Field supply
 [] : Option
 [] : Switch box
 [] : PCB
 --- : Wiring depending on model
 ⊕ : Protective earth
 --- : Field wire


- NOTES**
1. Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
 2. When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
 3. Refer to the combination table and the option manual for how to connect the wiring to X5A, X28A and X77A.
 4. Colours: BLK: Black, RED: Red, BLU: Blue, WHI: White, GRN: Green.

4D109448

11 Sound data

11 - 1 Sound Power Spectrum

RZAG71MY1

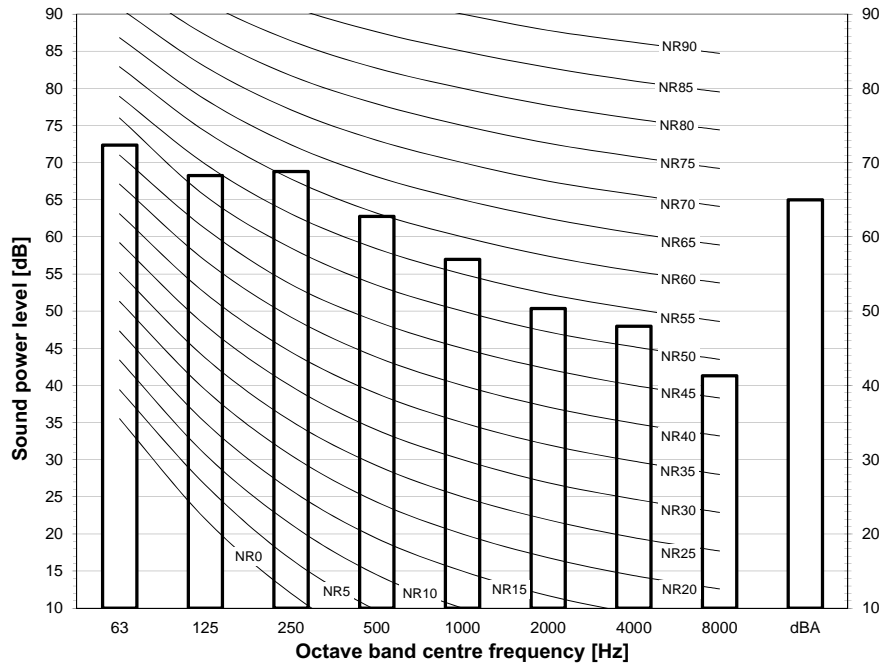


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = 10E-6μW/m²
- Measured according to ISO 3744

3D110033

RZAG100MY1

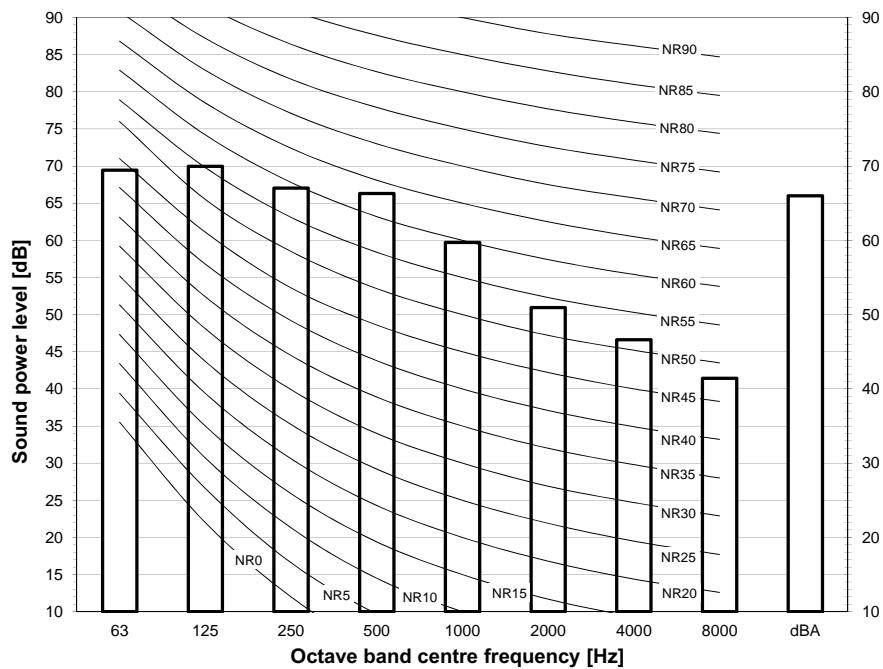

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = 10E-6μW/m²
- Measured according to ISO 3744


3D110034

11 Sound data

11 - 1 Sound Power Spectrum

11


RZAG125MY1

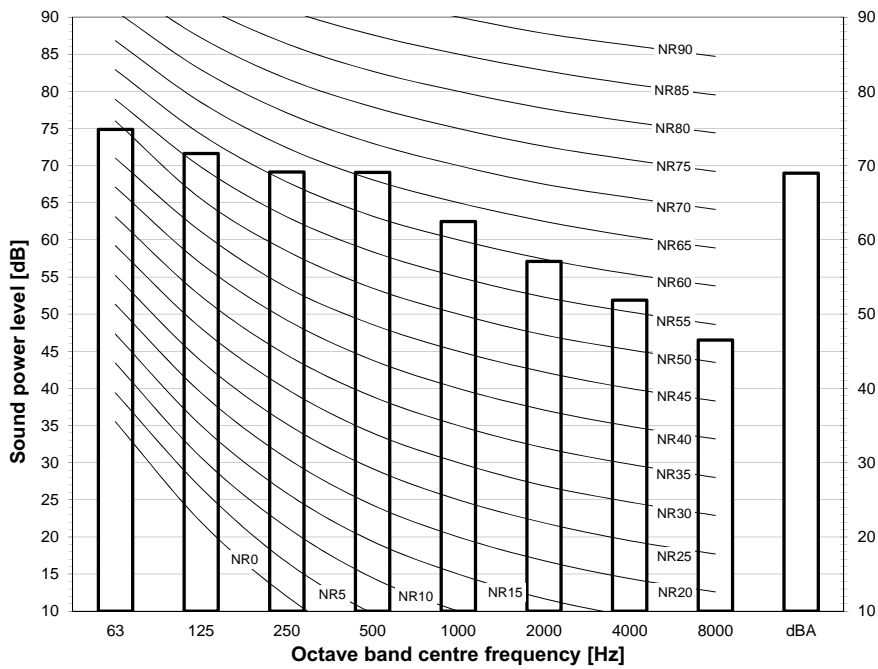

Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D110035

RZAG140MY1

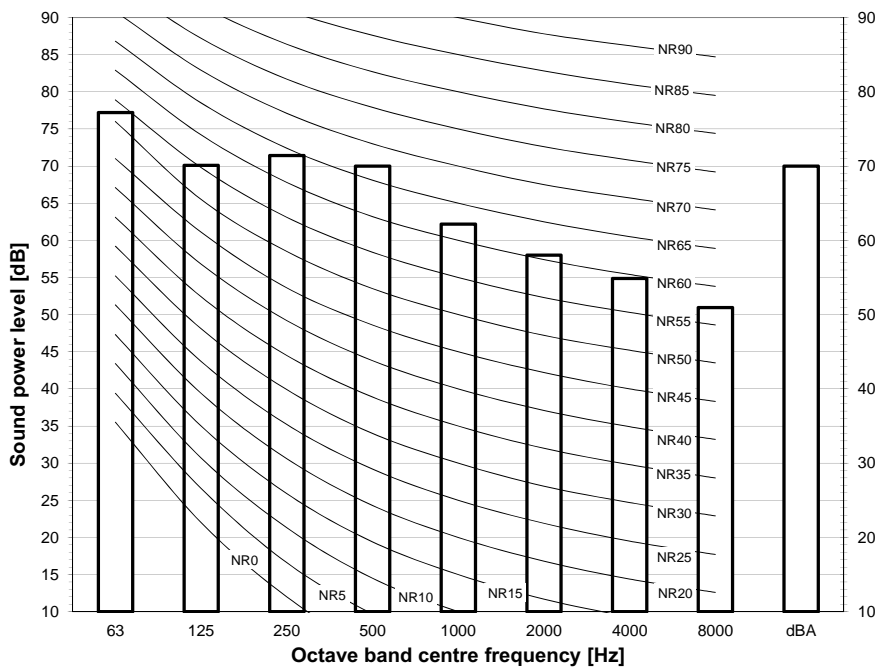



Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D110036

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG71MY1


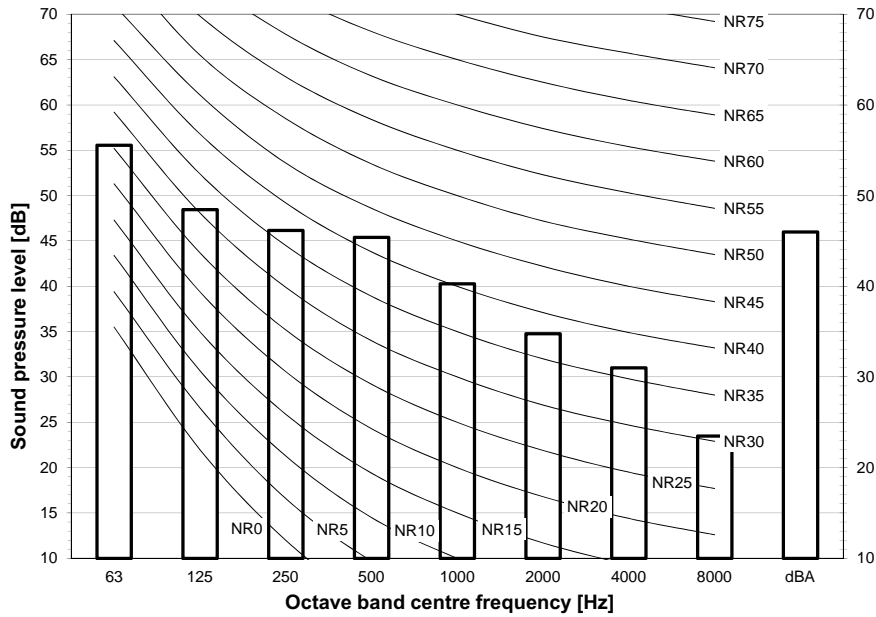


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D110045

RZAG100MY1

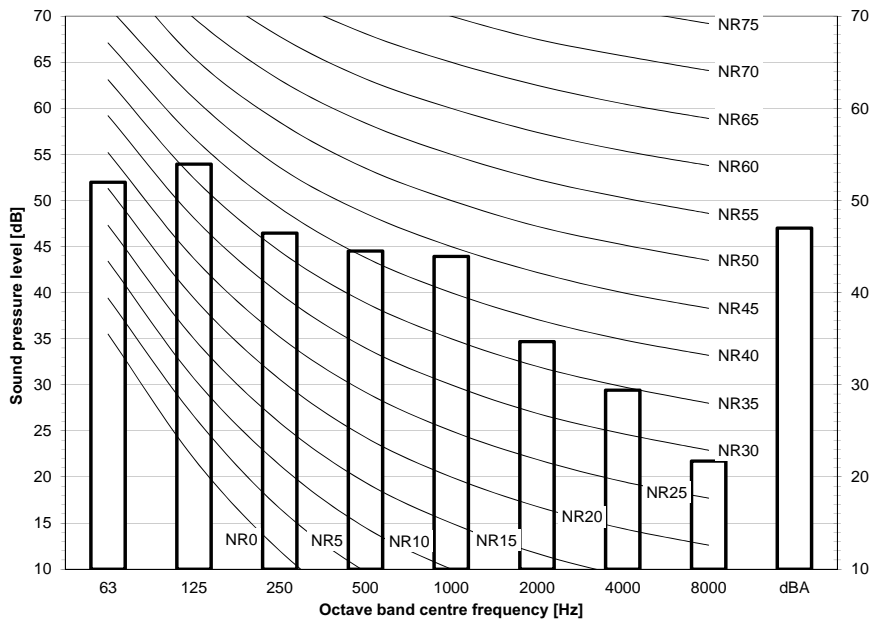

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa


3D110046

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

11


RZAG125MY1

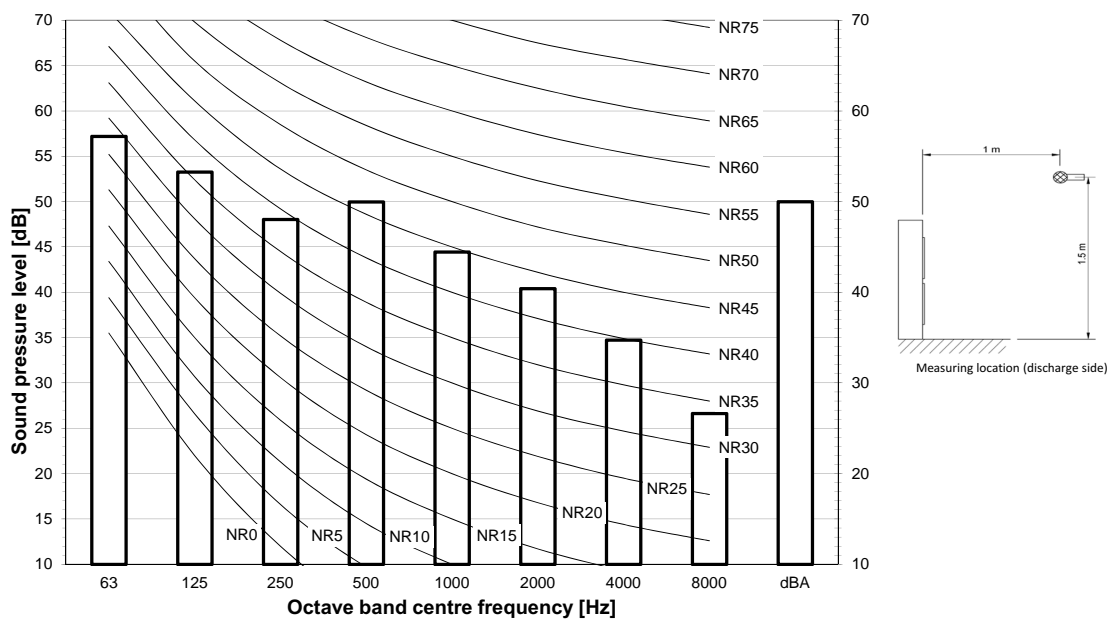

- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 µPa

3D110047

RZAG140MY1

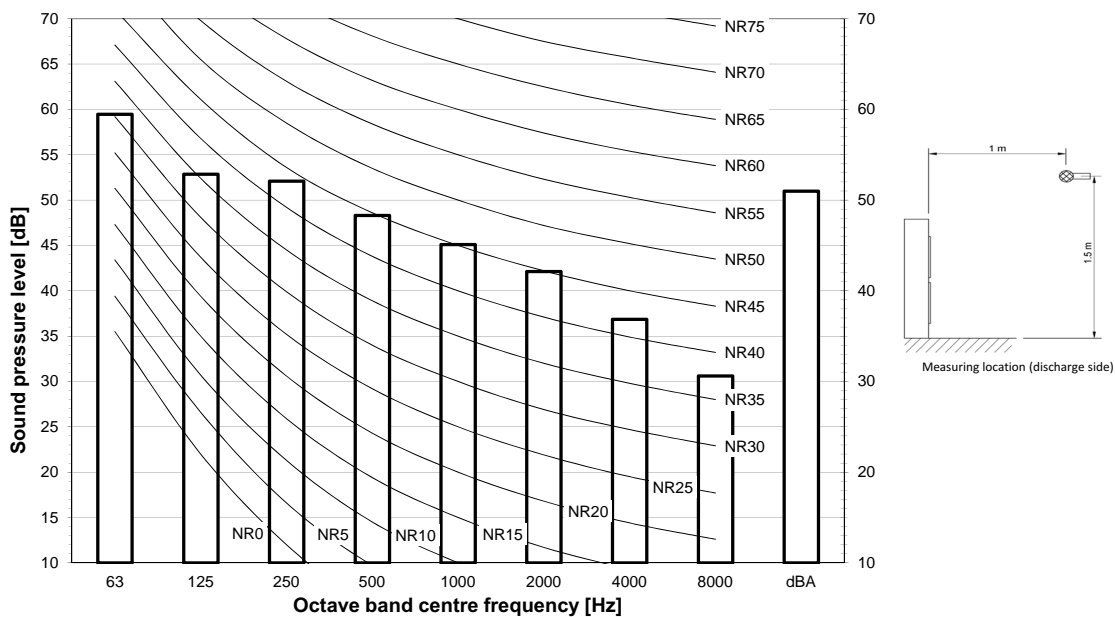


- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 µPa

3D110048

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

RZAG71MY1

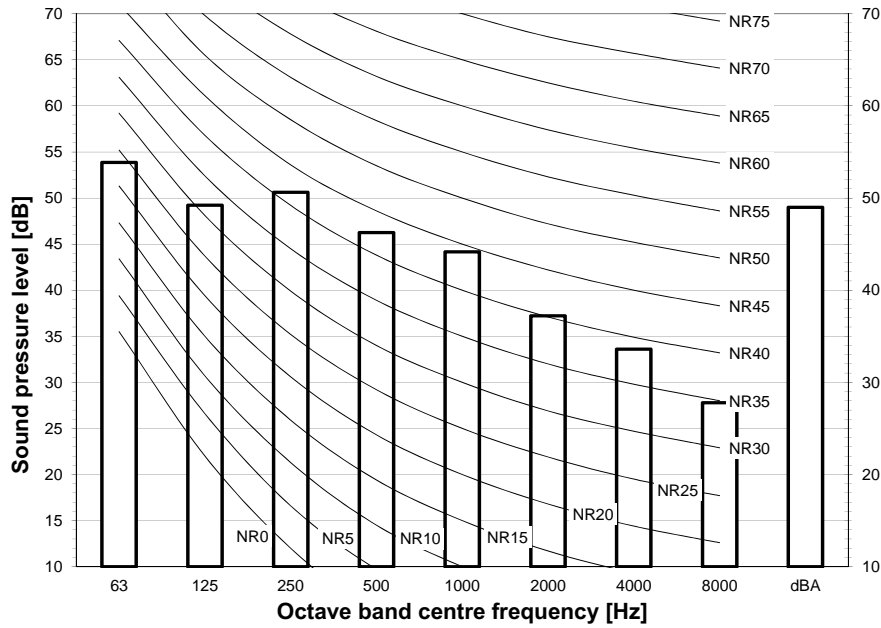


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111289

RZAG100MY1

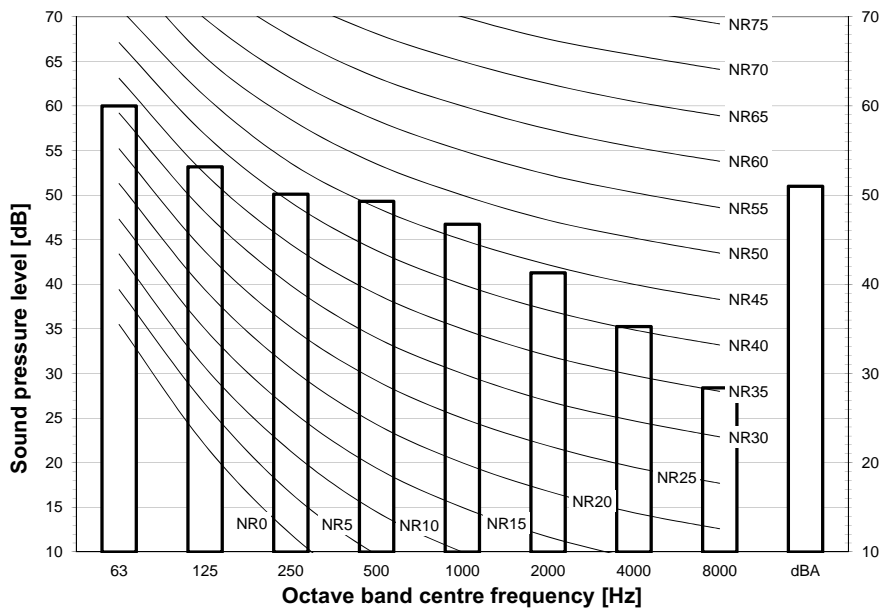

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa


3D111290

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

11

RZAG125MY1

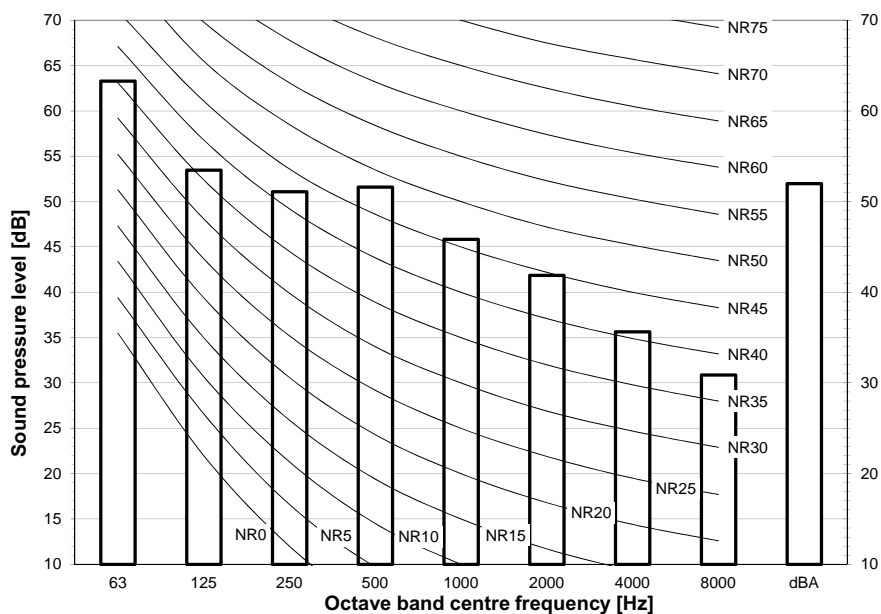


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111291

RZAG140MY1

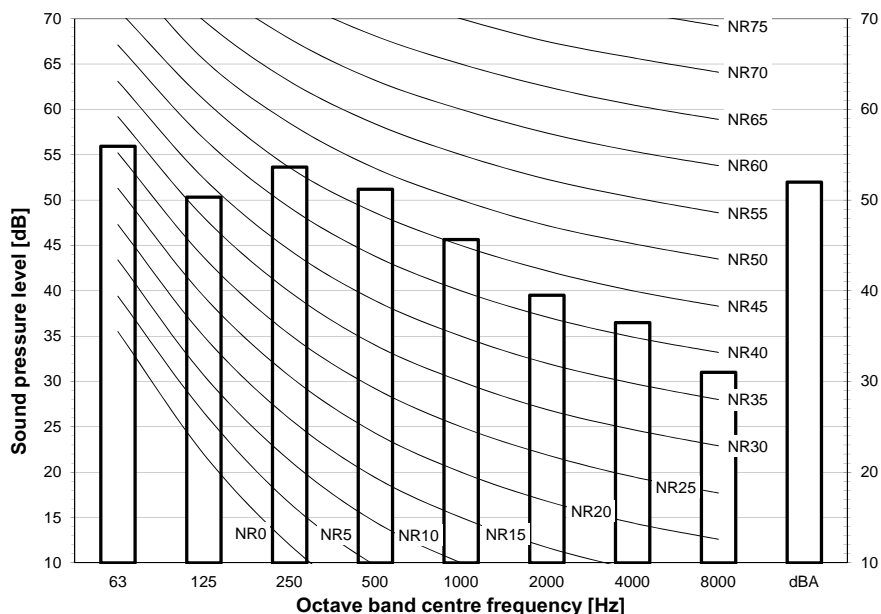

Notes


- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111292

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

RZAG71MY1

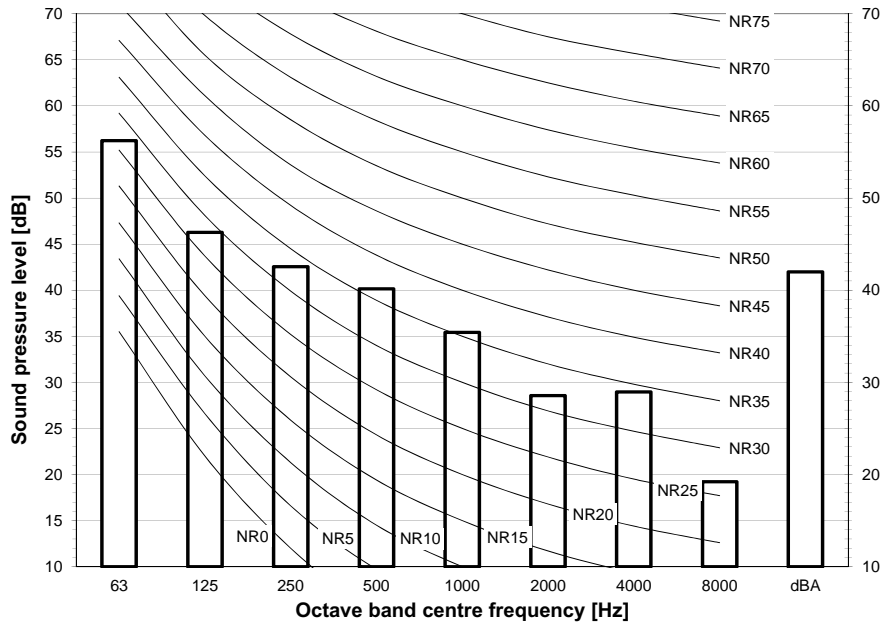


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111313

RZAG100-140MY1

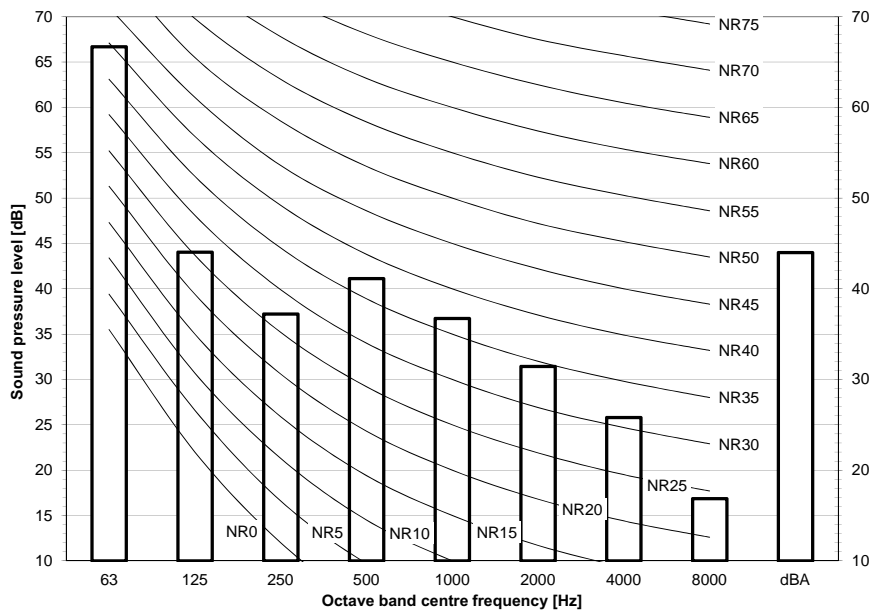

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111314

12 Installation

12 - 1 Installation Method

RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1
 AZAS-MV1
 AZAS-MY1


Installation service space

The measure of these values is "mm".


(A) When there are obstacles on suction sides.

• No obstacle above


- ① Stand-alone installation
 - Obstacle on the suction side only



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

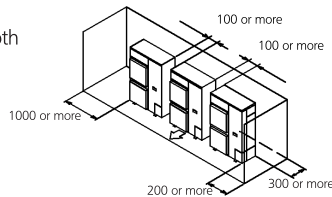


• Obstacle above, too.


- ① Stand-alone installation
 - Obstacle on the suction side, too



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

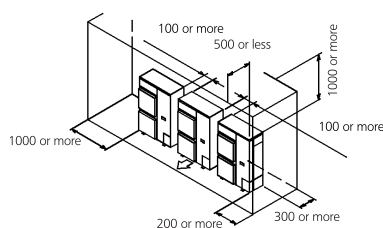


(B) When there are obstacles on discharge sides.

• No obstacle above

- ① Stand-alone installation
 - Obstacle on the discharge side only




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side only

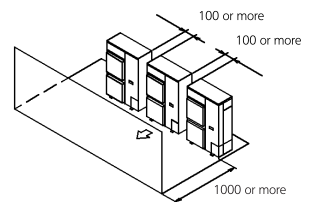


• Obstacle above, too

- ① Stand-alone installation
 - Obstacle on the discharge side only, too



- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side

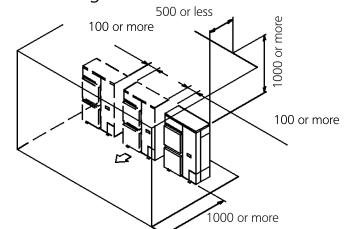


(C) When there are obstacles on both suction and discharge sides.

Pattern 1


When the obstacles on the discharge side is higher than the unit. (L>H)
 (There is no limit for the height of obstructions on the suction side.)

• No obstacle above

- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1)
 - No obstacle above

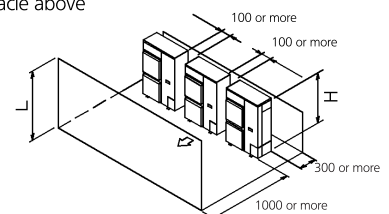

12 Installation

12 - 1 Installation Method


RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1
 AZAS-MV1
 AZAS-MY1

• Obstacle above, too

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	750 or more 1000 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on suction, discharge and top sides.


The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	1000 or more 1250 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	

Limit of series installation is 2 units.


Pattern 2

When the obstacle on the discharge side is lower than the unit ($L \leq H$) (There is no limit for the height of obstructions on the suction side.)



• No obstacle above


- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on both suction and discharge sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	250 or more 300 or more




• obstacle above

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	100 or more 200 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	




- ② Series installation (2 or more) (Note 1, 2)

- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.



	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	250 or more 300 or more
$L > H$	Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A	

Limit of series installation is 2 units.




(D) Double-decker installation

- ① Obstacle on the discharge side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.
- ② Obstacle on the suction side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.



(E) Multiple rows of series installation (on the rooftop, etc.)


- ① One row of stand-alone installation

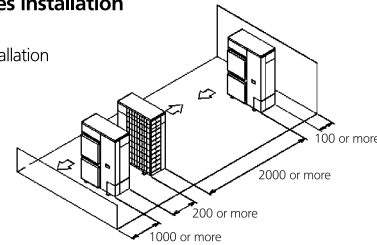

- ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$L \leq 1/2 H$ $1/2 H < L \leq H$	250 or more 300 or more
$L > H$	Can not be installed	

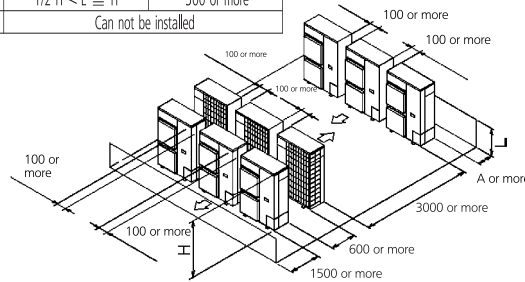

NOTES

- In case of the sideways piping, make a 100mm gap between the unit above.
- Close the bottom of the installation frame to prevent the discharged air from being bypassed.
- It is not necessary to install a roof cover if there is no danger of drainage dripping and freezing. In this case, the space between the upper and lower outdoor units should be at least 100mm. Close off the gap between the upper and lower units so there is no re-intake of discharged air.


13 Operation range

13 - 1 Operation Range

13


RZAG-MV1 RZAG-MY1

Cooling

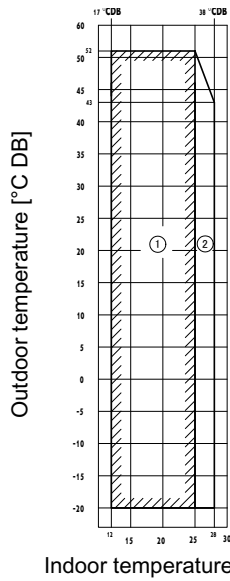

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

Heating

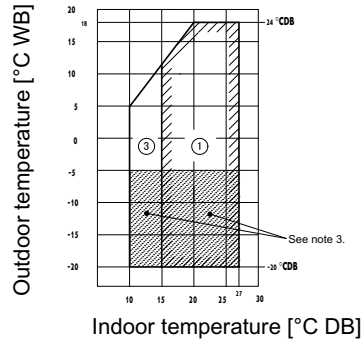


Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110020A



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN17 08/17



Daikin Europe N.V. participates in the Eurovent Certified Performance programme for Liquid Chilling Packages and Hydronic Heat Pumps, Fan Coil Units and Variable Refrigerant Flow systems. Check ongoing validity of certificate: www.eurovent-certification.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.