


Do Not Scale.
All Figured Dimensions To Be Checked On Site Prior To Construction.
All Copyright Reserved.

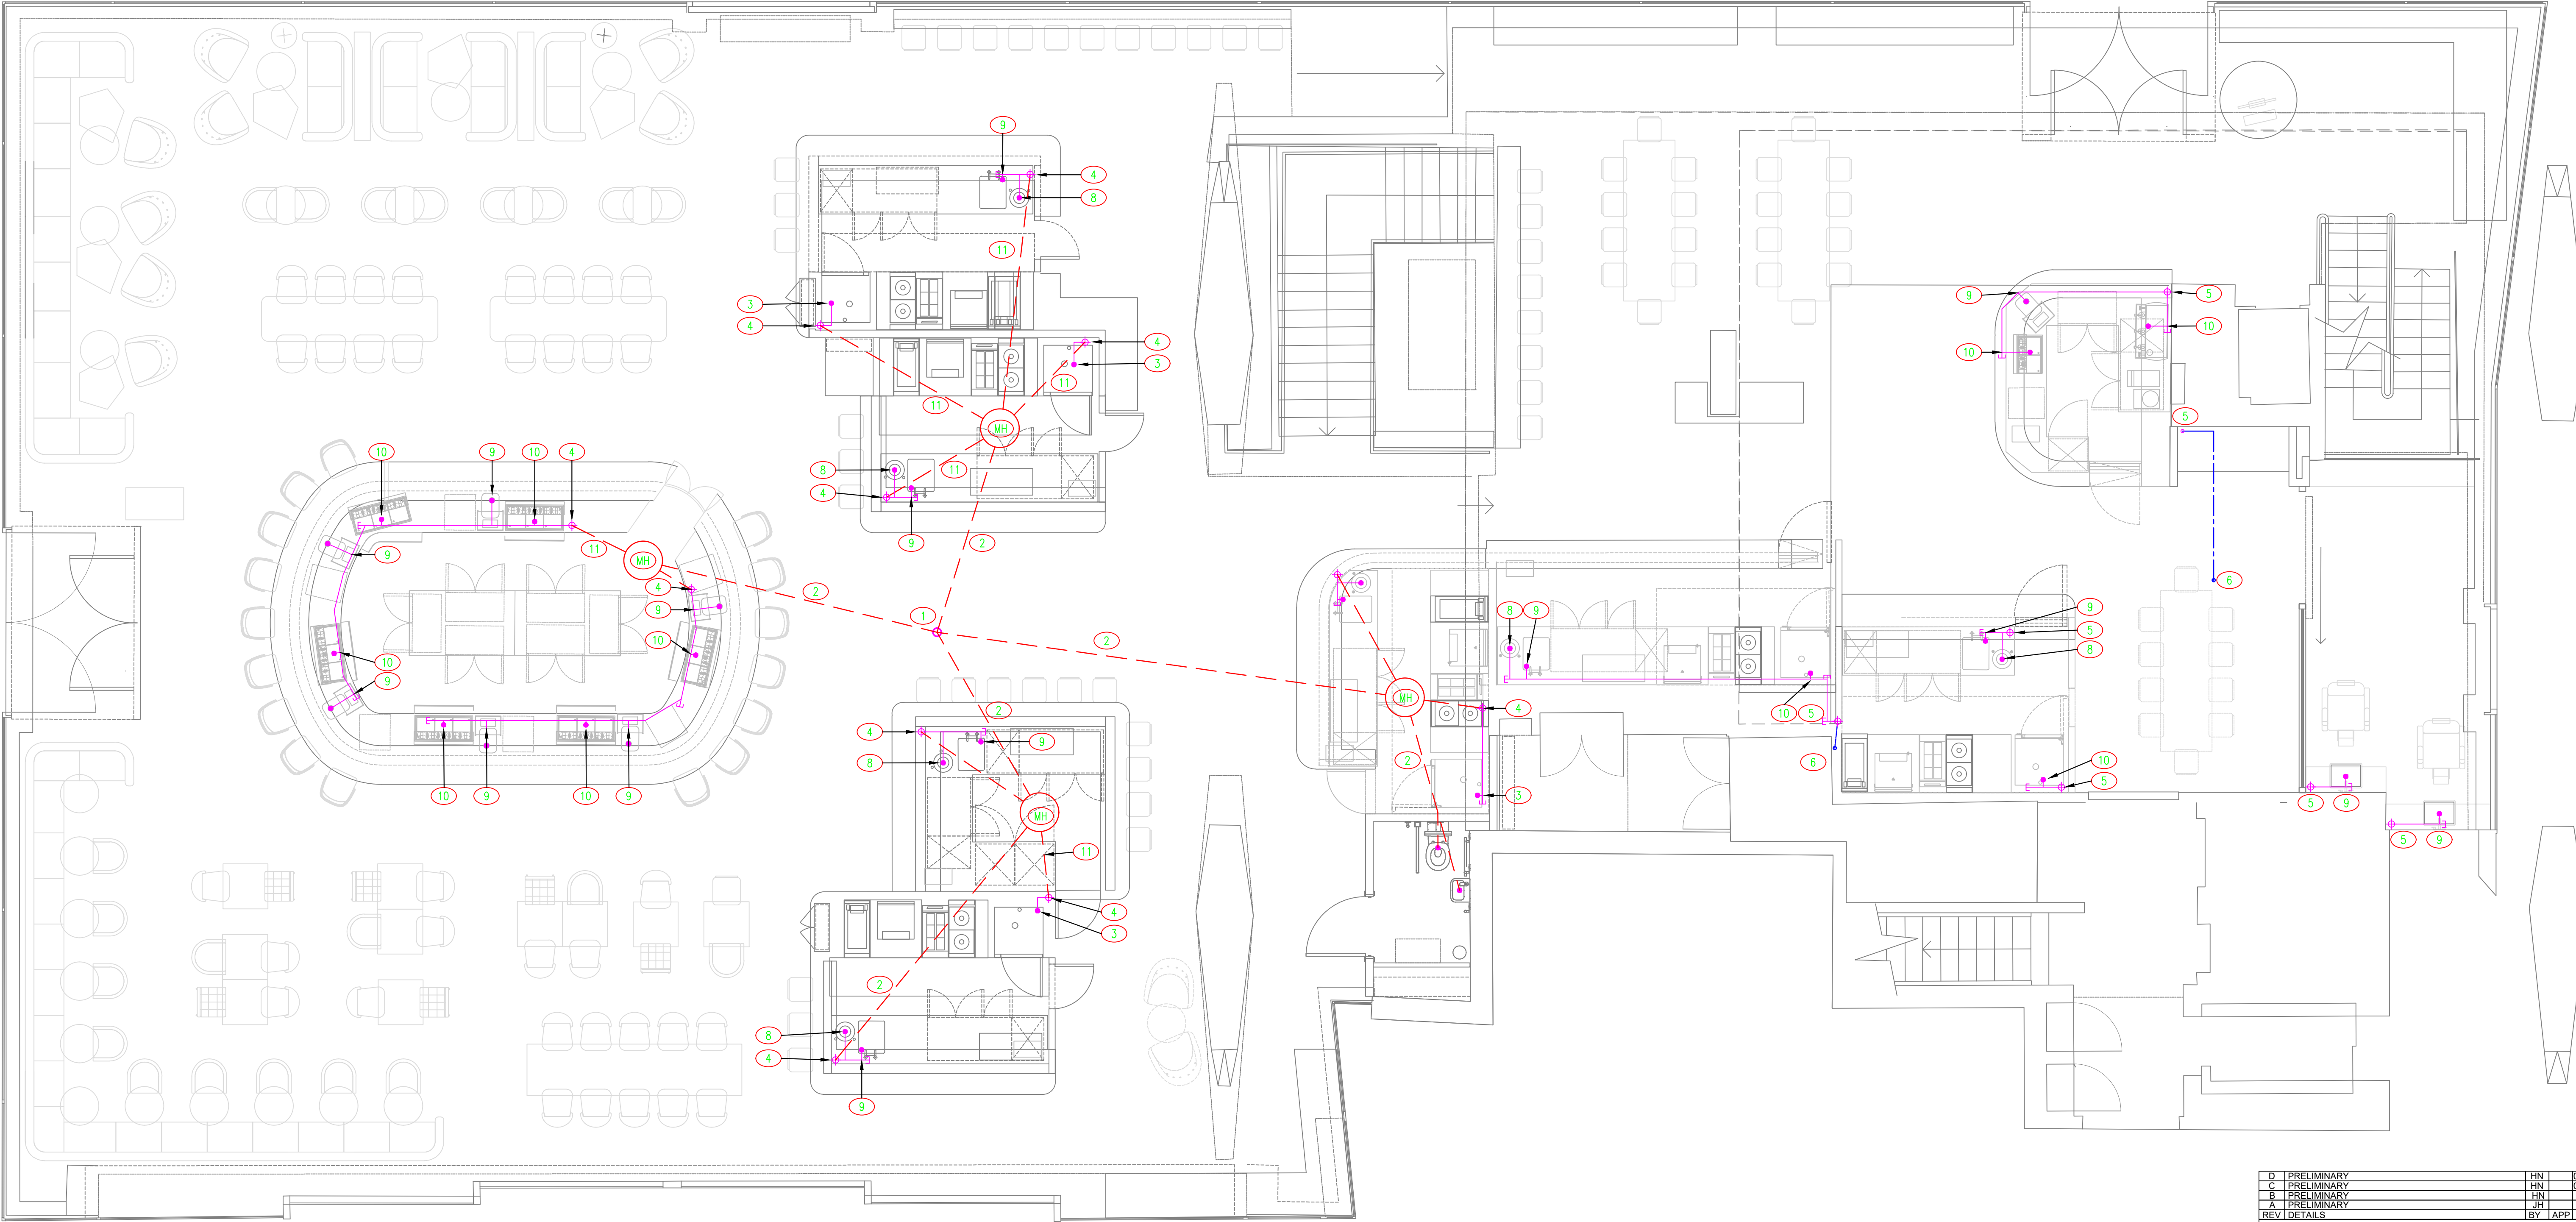

NOTES:

1. ALL SERVICES/ROUTES THROUGHOUT BUILDING TO BE FULLY COORDINATED ON SITE.
2. DRAWING TO BE READ IN CONJUNCTION WITH THE INSTALLATION SPECIFICATION AND ALL OTHER RELEVANT DRAWINGS.
3. ALL SOILS AND WASTES PIPEWORK TO BE UPVC, UNLESS OTHERWISE STATED.
4. ACCESS POINT TO BE PROVIDED AT ALL CHANGES OF DIRECTIONS FOR MAINTENANCE.
5. ALL SANITARY APPLIANCES TO BE FITTED WITH ANTY-SIPHON TRAPS WITH 75mm SEAL. TRAPS ON WHB'S TO BE CHROME PLATED.
6. ALL PENETRATION THROUGH FIRE COMPARTMENTS TO BE FIRE STOPPED. SEE ARCHITECTS DRAWING FOR LOCATION. ALL PENETRATIONS THOUGH FLOORS TO BE FIRE STOPPED.
7. ACCESS/RODDING POINTS IN STACK TO BE INSTALLED AT ALL LEVELS.
8. PROVIDE CONNECTIONS FOR CONDENSATE DRAIN IN EACH STACK.
9. PROVIDE AIR ADMITTANCE VALVES/ASP PIPEWORK CONNECTIONS WHERE APPLICABLE

LEGEND:

- | | |
|-----|--|
| | DRAINAGE PIPE AT LOW LEVEL |
| | VENT PIPE AT HIGH LEVEL |
| | DRAINAGE PIPE IN FLOOR VOID |
| SP | SOIL PIPE |
| WP | WASTE PIPE |
| VP | VENT PIPE |
| inv | PIPE INVERT LEVEL - FROM SSL TO BOTTOM OF PIPE |

NOTES:

- 1 WASTE PIPES CONNECT TO EXISTING 1000Ø DRAINAGE POINT
- 2 1000Ø COMMON WASTE @ 1:55 FALL.
- 3 500Ø WASTE TO 1000Ø COMMON
- 4 500Ø WASTE DROPS TO FLOOR VOID
- 5 500Ø WASTE DROPS TO FLOOR BELOW
- 6 500Ø WASTE DROPS FROM ABOVE TO HIGH LEVEL
- 7 500Ø WASTE DROPS FROM HIGH LEVEL TO FLOOR VOID
- 8 320 TRAPPED WASTE FROM WHB TO 500Ø COMMON
- 9 420 TRAPPED WASTE FROM SINK TO 500Ø COMMON
- 10 420 WASTE FROM APPLIANCE TO 500Ø COMMON
- 11 500Ø WASTE IN FLOOR VOID

D	PRELIMINARY	HN	07/09/2018
C	PRELIMINARY	HN	04/09/2018
B	PRELIMINARY	HN	30/07/2018
A	PRELIMINARY	JH	27/07/2018
REV	DETAILS	BY	APP DATE

CLIENT: **STREAT MARKETS LTD**

PROJECT: **CENTRE POINT, LINK BUILDING W1**
DRAWING TITLE: **GROUND FLOOR LEVEL 0
SOILS AND WASTES**

DRAWN BY: H.NISIC	APPROVED BY:	DATE: 20/07/2018
PROJECT No.: L2171	DRAWING No.: M006	SCALE: 1:50

